

PROJECT MANUAL

**SHADE STRUCTURES
AT
FIVE SITES**

**MORRILL MIDDLE SCHOOL
PIEDMONT MIDDLE SCHOOL
NOBLE ELEMENTARY SCHOOL
RUSKIN ELEMENTARY SCHOOL
VINCI PARK ELEMENTARY SCHOOL**

BERRYESSA UNION SCHOOL DISTRICT

Measure L Bond Program
Berryessa Union School District
1376 Piedmont Road
San Jose, CA 95132

Mandatory Pre-Bid Conference / Job Site Visit Dates:

Job Site Visit #1 will be conducted on October 15, 2020 at 11:00am

Job Site Visit #2 will be conducted on October 21, 2020 at 11:00am

**Bid Due Date:
October 29, 2020 at 1:00pm**

**Bid Number:
B-02-2020-21**

DOCUMENTS 00 01 10

TABLE OF CONTENTS

DIVISION 00 – PROCUREMENT AND CONTRACTING REQUIREMENTS

00 00 00	Title Page
00 01 00	Table of Contents
00 11 16	Notice to Bidders
00 21 13	Instructions to Bidders
00 31 00	Site Visit Certification
00 41 26	Bid Form
00 43 13	Bid Bond
00 43 36	Designation of Subcontractors
00 43 40	Sufficient Funds Declaration
00 45 19	Non Collusion Affidavit
00 45 26	Workers' Compensation Certification
00 45 32	Fingerprinting Notice and Acknowledgement
00 45 34	Iran Contracting Act Certification
00 50 50	Notice of Intent to Award
00 51 00	Notice of Award
00 52 26	Agreement between Owner and Contractor
00 54 00	Escrow Bid Documentation
00 54 26	Escrow Agreement for Security Deposits in Lieu of Retention
00 55 00	Notice to Proceed
00 61 13.13	Performance Bond
00 61 13.16	Payment Bond
00 72 00	General Conditions
00 73 00	Special Conditions
00 73 73	Compliance Monitoring and Enforcement Notice
00 81 00	Hazardous Materials Procedures and Requirements
00 88 00	Agreement and Release of Any and All Claims
00 89 00	Guarantee Form
00 92 00	Smoke-Free Environmental Certification
00 92 50	Asbestos and Other Hazardous Materials Certification
00 93 00	Lead-Based Paint Certification
00 93 50	Imported Materials Certification

DIVISION 01 – GENERAL REQUIREMENTS

01 10 00	Summary of Work
01 20 00	Price and Payment Procedures
01 21 00	Allowances
01 22 00	Unit Prices

01 23 00	Alternates & Unit Pricing
01 25 00	Substitution Procedures
01 30 00	Administrative Requirements
01 32 16	Construction Progress Schedule
01 40 00	Quality Requirements
01 50 00	Temporary Facilities and Controls
01 60 00	Materials and Equipment
01 60 05	Product Requirements
01 61 00	Delivery, Storage and Handling
01 70 00	Execution and Closeout Procedures
01 72 00	Field Engineering
01 77 00	Closeout Procedures
01 78 00	Closeout Submittals

Appendix A:

Morrill Middle School – DSA approved plans & DSA 103
Piedmont Middle School – DSA approved plans & DSA 103
Noble Elementary School – DSA approved plans & DSA 103
Ruskin Elementary School – DSA approved plans & DSA 103
Vinci Park Elementary School – DSA approved plans & DSA 103

Appendix B: Multiple Sites Geotech Report, dated April 16, 2016
Vinci Park Geotech Report, date October 26, 2017

END OF TABLE OF CONTENTS

DOCUMENT 00 11 16

NOTICE TO BIDDERS

Notice is hereby given that Berryessa Union School District (hereinafter referred to as “Owner”) will receive sealed bids prior to the date and time stated for the Bid Opening for:

BERRYESSA UNION SCHOOL DISTRICT

SHADE STRUCTURES

AT

FIVE SCHOOLS

Bid Number – B-02-2020-21

As described in more detail in the bidding documents:

Bids will be received for:

SHADE STRUCTURES

AT

FIVE SCHOOLS

**Morrill Middle School
Piedmont Middle School
Noble Elementary School
Ruskin Elementary School
Vinci Park Elementary School**

Work in the Contract comprises: Provide all materials and labor to install shade structures & covered walkway at five (5) schools. Including all work (materials & labor) associated with the installation of the shade structures, entry canopy and covered walkway.

Pre-Bid Conference/Job Site Visits

There will be two (2) mandatory pre-bid conference/job site visits held to familiarize bidders with the project and sites. Please note – all prime contractors submitting a bid must attend and sign-in at one (1) of the mandatory pre-bid conferences/job site visits. Bids received from prime contractors who have not attended and signed-in at one (1) of the mandatory pre-bid conferences/job site visits will be returned to the contractor unopened.

Job Site Visit #1 will be conducted on October 15, 2020 at 11:00am

Job Site Visit #2 will be conducted on October 21, 2020 at 11:00am

Pre-Bid conferences/job site visits will begin at the:

Berryessa Union District Office, 1376 Piedmont Rd., San Jose, CA 95132.

Please meet at the building front main entrance.

FACE COVERINGS WILL BE REQUIRED AND SOCIAL DISTANCING DURING THE SITE VISITS WILL BE STRICTLY ENFORCED.

On both days we will provide escorted visits to the school site.

Pre-Bid Questions/RFI's

Requests for clarification or interpretation of the Bidding Documents must be in writing and received no later than: October 23, 2020 at 4:00pm

Submission of Bids

Sealed bids must be received at the:

**Berryessa Union District Office, Purchasing Department
1376 Piedmont Rd., San Jose, CA 95132 on or before 1:00pm on
October 29, 2020, on the clock designated by the Owner or its
representative as the bid clock.**

Facsimile (FAX) copies of the bid will not be accepted.

**Bids will be opened, read, sealed and filed in the Purchasing Department of the
Owner. Bids shall not expire for a period of 90 days after the date set for bid
submission.**

The Owner reserves the right to add or deduct any of the additive or deductive items after the lowest responsible and responsive bidder is determined.

Addendum

Revisions, additions or deletions will be made by written addenda only as issued by Kitchell and Sugimura Finney Architects. The last Addendum, if any, will be issued on/or before October 26, 2020.

Basis of Award

Owner will award the contract in accordance with Document 00 21 13 Instructions to Bidders.

Contractor's License

The successful Bidder will be required to have the appropriate State of California Contractor's License current at the time of submission of Bid.

Class B Contractors License

Project Documents

Project Bidding Documents will be available on 10/9/2020 for download and print at:

<http://www.berryessa.k12.ca.us/OUR-DISTRICT/Business-Services/Purchasing/Current-Bids/index.html> or from Kitchell.

Stephen Goltiao – Kitchell Project Manager – sgoltiao@kitchell.com – 408-483-4267
Jim Wilson – Kitchell Project Director – jmwilson@kitchell.com – 408-605-7240

For public works contracts awarded on and after January 1, 2015, those public works projects shall be subject to compliance monitoring and enforcement by the Department of Industrial Relations.

As of March 1, 2015, a contractor or subcontractor shall not be qualified to submit a bid or to be listed in a bid proposal subject to the requirements of Public Contract Code section 4104 unless currently registered and qualified under Labor Code section 1725.5 to perform public work as defined by Division 2, Part 7, Chapter 1 (§§1720 et seq.) of the Labor Code.

As of April 1, 2015, a contractor or subcontractor shall not be qualified to enter into, or engage in the performance of, any contract of public work (as defined by Division 2, Part 7, Chapter 1 (§§1720 et seq.) of the Labor Code) unless currently registered and qualified under Labor Code section 1725.5 to perform public work.

Schedule

See document 01 10 00 Summary of Work for the project schedule for the Shade Structures at Five Schools work.

Bids must be accompanied by a bidder's bond, cashier's check, or certified check for at least ten percent (10%) of the amount of the base bid and made payable to the Owner. If a bid bond is used, it must be issued by an Admitted Surety (an insurance organization authorized by the Insurance Commissioner to transact surety insurance in the State of California during this calendar year), which shall be given as a guarantee that the bidder will enter into a Contract if awarded the Work and will be declared forfeited, paid to, or retained by the Owner as liquidated damages if the bidder refuses or neglects to enter into the Contract provided by the Owner after being requested to do so. The surety insurer must, unless otherwise agreed to by Owner in writing, at the time of issuance of the bond, have a rating not lower than "A-" as rated by A.M. Best Company, Inc. or other independent rating companies. Owner reserves the right to approve or reject the surety insurer selected by Contractor and to require Contractor to obtain a bond from a surety insurer satisfactory to the Owner.

Bids must be accompanied by an executed Fingerprinting Notice and Acknowledgment.

Pursuant to the Contract Documents, the successful bidder will be required to furnish a Payment (Labor and Material) Bond in the amount of one hundred percent (100%) of the Contract Sum, and a Faithful Performance Bond in the amount of one hundred percent (100%) of the Contract Sum, said bonds to be secured from Admitted Surety insurers (an insurance organization authorized by the Insurance Commissioner to transact business of insurance in the State of California during this calendar year). The surety insurers must,

unless otherwise agreed to by Owner in writing, at the time of issuance of the bonds, have a rating not lower than “A-” as rated by A.M. Best Company, Inc. or other independent rating companies. Owner reserves the right to approve or reject the surety insurers selected by the successful bidder and to require the successful bidder to obtain bonds from surety insurers satisfactory to the Owner. The bidder will be required to furnish insurance as set forth in the Contract Documents.

The successful bidder will be allowed to substitute securities or establish an escrow in lieu of retainage, pursuant to Public Contract Code Section 22300, and as described in the Agreement Between Owner and Contractor and General Conditions.

The Owner will not consider or accept any bids from contractors who are not licensed to do business in the State of California, in accordance with the California Public Contract Code, providing for the licensing of contractors. In accordance with Section 3300 of said Code, the bidder shall have a “Class B” license and shall maintain that license in good standing through Project completion and all applicable warranty periods. Bidder shall state the California contractor license number on the Designation of Subcontractors form for all subcontractors doing more than one-half of one percent (0.5%) of the bidder’s total bid. An inadvertent error in listing a California contractor’s license number shall not be grounds for filing a bid protest or for considering the bid nonresponsive if the bidder submits the corrected contractor’s license number to the Owner within 24 hours after the bid opening, or any continuation thereof, so long as the corrected contractor’s license number corresponds to the submitted name and location for that subcontractor.

Subcontractors shall maintain their licenses in good standing through Project completion and all applicable warranty periods. Owner reserves the right to reject any bid as nonresponsive if bidder or any subcontractor is not licensed in good standing from the time the bid is submitted to Owner up to award of the Contract, whether or not the bidder listed the subcontractor inadvertently, or if a listed subcontractor’s license is suspended or expires prior to award of the Contract. Owner also reserves the right to reject any bid as non responsive if a listed subcontractor’s license is not in good standing to perform the work for which it is listed from the time of submission of the bidder’s bid to award of the Contract.

The Director of Industrial Relations of the State of California, in the manner provided by law, has ascertained the general prevailing rate of per diem wages and rate for legal holidays and overtime work. The Contractor must pay for any labor therein described or classified in an amount not less than the rates specified. Copies of the required rates are on file at the Owner’s business office and are available to any interested party on request.

The Owner reserves the right to waive any irregularity and to reject any or all bids.

Unless otherwise required by law, no bidder may withdraw its bid for a period of ninety (90) days after the date set for the opening thereof or any authorized postponement thereof. The Owner reserves the right to take more than ninety (90) days to make a decision regarding the rejection of bids or the award of the Contract.

Advertise: 1st Publication Date
2nd Publication Date

October 9, 2020
October 16, 2020

By: _____
Its: _____

END OF DOCUMENT

INSTRUCTIONS TO BIDDERS

SECURING DOCUMENTS:

Project Bidding Documents will be available at: BUSD Website or Kitchell.

<http://www.berryessa.k12.ca.us/OUR-DISTRICT/Business-Services/Purchasing/Current-Bids/index.html>

Contact: Stephen Goltiao: sgoltiao@kitchell.com, 408-483-4267 or
Jim Wilson: jmwilson@kitchell.com 408-605-7240

REGISTRATION:

The Owner shall not accept any bid as of March 1, 2015, or enter into any contract as of April 1, 2015, without proof of the bidder's current registration to perform public work under Labor Code section 1725.5.

The bidder shall not accept any subbid as of March 1, 2015, or enter into any subcontract as of April 1, 2015, without proof of the subcontractor's current registration to perform public work under Labor Code section 1725.5.

BIDS:

Bids to receive consideration shall be made in accordance with the following instructions:

1. Bids shall be made on a form therefor, obtained from the Construction Manager or Owner. Bids not made on the proper form shall be disregarded.

SHADE STRUCTURES

AT

FIVE SCHOOLS

**Morrill Middle School
Piedmont Middle School
Noble Elementary School
Ruskin Elementary School
Vinci Park Elementary School**

Numbers must be stated in words and figures, and the signatures of all individuals must be in longhand.

Bidder must complete and submit all of the following documents with Bid Form and Proposal:

- a. Signed Bid Proposal**
 - b. Bid Bond on the District's form or other security**
 - c. Designated Subcontractors List**
 - d. Sufficient Funds Declaration**
 - e. Site Visit Certification**
 - f. Non Collusion Affidavit**
2. No bid will be considered which makes exceptions, changes, or in any manner makes reservations to the terms of the drawings or specifications.
3. Questions regarding documents, discrepancies, omissions, or doubt as to meanings shall be referred immediately to the Architect who will send written instructions clarifying such questions to each bidder. Oral responses will not be binding on the Owner or Architect or any Construction Manager.
4. Each bid must give the full business address of the bidder and be signed by bidder with bidder's usual signature. Bids by partnerships must furnish the full name of all partners and must be signed in the partnership name by a general partner with authority to bind the partnership in such matters, followed by the signature and designation of the person signing. The name of the person signing shall also be typed or printed below the signature. Bids by corporations must be signed with the legal name of the corporation, followed by the name of the state of incorporation and by the signature and designation of the chairman of the board, president or any vice president, and then followed by a second signature by the secretary, assistant secretary, the chief financial officer or assistant treasurer. All persons signing must be authorized to bind the corporation in the matter. The name of each person signing shall also be typed or printed below the signature. Satisfactory evidence of the authority of the officer signing on behalf of a corporation shall be furnished.
5. Pursuant to the provisions of Sections 4100 to 4114, inclusive, of the Public Contract Code of the State of California, which are hereby incorporated and made a part hereof and these Instructions to Bidders, every bidder shall set forth in its bid:
 - A. The name and location of the place of business and the California contractor's license number of each subcontractor who will perform work or labor or render service to the bidder in or about the construction of the work or improvement, or a subcontractor licensed by the State of California who, under subcontract to the bidder, specially fabricates and installs a portion of the Work or improvement according to detailed drawings contained in the plans and specifications, in an amount in excess of one-half ($\frac{1}{2}$) of one percent (1%) of the bidder's total bid. An inadvertent error in listing a California contractor's license number shall not be grounds for filing a bid protest or for considering the bid nonresponsive if the bidder submits the corrected contractor's license

number to the Owner within 24 hours after the bid opening, or any continuation thereof, so long as the corrected contractor's license number corresponds to the submitted name and location for that subcontractor.

- B. The portion of the Work which will be done by each such subcontractor. If the bidder fails to specify a subcontractor for any portion of the Work to be performed under the Contract in excess of one-half (½) of one percent (1%) of the bidder's total bid, the bidder agrees to perform that portion itself. The successful bidder shall not, without the consent of the Owner:
- 1) Substitute any person as subcontractor in place of the subcontractor designated in the original bid.
 - 2) Permit any subcontract to be assigned or transferred or allow it to be performed by anyone other than the original subcontractor listed in the bid.
 - 3) Sublet or subcontract any portion of the Work in excess of one-half (½) of one percent (1%) of the total bid as to which the original bid did not designate a subcontractor.
6. The Director of Industrial Relations of the State of California, in the manner provided by law, has ascertained the general prevailing rate of per diem wages and the rate for legal holidays and overtime work. The Contractor must pay for any labor therein described or classified in an amount not less than the rates specified. Copies of the required rates are on file at the Owner's business office and are available to any interested party on request.
7. All bids must be accompanied by a completed Noncollusion Declaration and Sufficient Funds Declaration (Labor Code § 2810). All bids must be accompanied by an executed Fingerprinting Notice and Acknowledgment.
8. Bids must be accompanied by a certified check, cashier's check, or bidder's bond, for an amount not less than ten percent (10%) of the amount of the base bid, made payable to the order of the Owner. If a bidder's bond accompanies the bid, said bond shall be secured by an Admitted Surety (an insurance organization authorized by the Insurance Commissioner to transact business of insurance in the State of California during this calendar year). The surety insurer must, unless otherwise agreed to by Owner in writing, at the time of issuance of the bond, have a rating not lower than "A-" as rated by A.M. Best Company, Inc. or other independent rating companies. Owner reserves the right to approve or reject the surety insurer selected by Contractor and to require Contractor to obtain a bond from a surety insurer satisfactory to the Owner. Said check or bond shall be given as a guarantee that the bidder will enter into the Contract if awarded the Work, and in case of refusal or failure to enter into said Contract, the check or bond, as the case may be, shall be payable to the Owner and retained as liquidated damages.

9. Bids shall be sealed and filed as indicated in the Notice to Bidders. Irrespective of how a bidder chooses to deliver the bid and other documents to the Owner, the bidder is responsible for ensuring that the bid and other documents are actually received at the location designated in the Contract Documents for receipt of the bid and other documents prior to the time for the bid opening. Bids and other documents for any reason not actually received at the designated location prior to the time for the bid opening shall not be opened or considered.

WITHDRAWAL OF BIDS:

Bids may be withdrawn by bidders prior to the time fixed for the submittal of bids or any authorized postponement thereof. A successful bidder shall not be relieved of the bid unless by consent of the Owner or bidder's recourse to Public Contract Code §5100 et seq.

OPENING OF BIDS:

Opening of bids shall be as soon after the hour set as will be possible; opening and declaration to be as set forth in the Notice to Bidders. Any and all bidders will be permitted to attend. **FACE COVERINGS WILL BE REQUIRED AND SOCIAL DISTANCING DURING THE BID OPENING WILL BE STRICTLY ENFORCED.**

EXAMINATION OF CONTRACT DOCUMENTS AND SITE:

Before submitting a bid, bidders shall examine the drawings, read the specifications, the form of Agreement between Contractor and Owner, and the other Contract Documents. Bidders shall visit the site of the proposed Work; examine the building, or buildings, if any, and any work that may have been done thereon. Bidders shall fully inform themselves of all conditions, in, at, and about the site, the building or buildings, if any, and any work that may have been done thereon.

Pursuant to Public Contract Code section 1104:1) bidders shall not be required to assume responsibility for the completeness and accuracy of architectural or engineering plans and specifications, except on clearly designated design build projects; 2) however, bidders shall be required to review architectural or engineering plans and specifications prior to submission of their bids and to report any errors and omissions to the Architect or Owner; and 3) the review shall be confined to the bidder's capacity as a bidder and not as a licensed design professional.

FORM OF AGREEMENT BETWEEN OWNER AND CONTRACTOR:

The form of Agreement between Owner and Contractor which the successful bidder will be required to execute, if awarded the Work, is a part of this Bid Package.

ADDENDA OR BULLETINS:

Any addenda or bulletins, issued during the time of bidding, shall form a part of the drawings and specifications loaned to the bidder for the preparation of its bid, shall be covered in the bid, and shall be made a part of the Contract Documents. All addenda or bulletins shall be signed by the Architect and approved by the Division of State Architect.

EVIDENCE OF RESPONSIBILITY:

Upon the request of Owner, a bidder shall submit promptly to the Owner or its designee satisfactory evidence showing the bidder's financial resources, the bidder's experience in the type of work required by the Owner, the bidder's organization available for the performance of the Contract, and any other required evidence of the bidder's or its subcontractor's qualifications to perform the proposed Contract. The Owner may consider such evidence before making its decision awarding the proposed Contract. Failure to submit evidence of the bidder's or its subcontractors' responsibility to perform the proposed Contract may result in rejection of the bid.

AWARD OF CONTRACT:

Rejection of any or all bids, to contract work with whomever and in whatever manner, to abandon work entirely, and/or to waive any informality in receiving of bids is reserved as the right of the Owner. Before the Contract is awarded, the Owner may at its sole discretion, require from the proposed Contractor on the Project further evidence of the reasonable qualifications of such contractor to faithfully, capably, and reasonably perform such proposed Contract and may consider such evidence before making its decision on the award of such proposed Contract.

The Contract shall be awarded to the lowest responsible and responsive bidder as interpreted by the Owner under California law and as specified herein and shall be entered into by the successful bidder within ten (10) days after mailing, faxing or delivery of the Notice of Award of Contract. Owner reserves the right, without any liability, to cancel the award of any bid for any reason at any time before the full execution of the Agreement between Owner and Contractor.

EXECUTION OF AGREEMENT BETWEEN OWNER AND CONTRACTOR:

The Agreement between Owner and Contractor shall be signed by the successful bidder in as many originals as the Owner deems necessary and returned, together with the required Contract bonds, insurance certificates, additional insured endorsement, declarations page, a Public Contract Code section 3006(a) Roof Project Certification, if required, and Independent Contractor Student Contact Form, within ten (10) days after the mailing, faxing or delivering of the Notice of Award of Contract. If the ten (10) day period would expire after the date for commencement of the Work, Contractor must submit the documents before the date of commencement of the Work. If the successful bidder does not comply with this paragraph, Owner may revoke and/or cancel the award to the successful bidder and award the Contract to the next lowest bidder, or may otherwise proceed as allowed by law. A Roof Project Certification is not required if (1) the Owner has ADA (average daily attendance) of 2,500 or less, or (2) the Project involves repair of 25% or less of the roof, or costs \$21,000 or less.

CONTRACT BONDS:

As required by the Contract Documents, two bonds, as itemized below and in the forms presented in these Contract Documents, shall be furnished by the successful bidder on the Project at the time of entering into the Contract and filed with the Owner before the successful bidder commences any work on the Project. They shall be in the form of surety bonds issued by Admitted Surety insurers (an insurance organization authorized by the Insurance Commissioner to transact business of insurance in the State of California during this calendar year). The surety insurers must, unless otherwise agreed to by Owner in writing, at the time of issuance of the bond, have a rating not lower than "A-" as rated by A.M. Best Company, Inc. or other independent rating companies. Owner reserves the right to approve or reject the surety insurers selected by Contractor and to require Contractor to obtain bonds from surety insurers satisfactory to the Owner.

Performance Bond in the amount of one hundred percent (100%) of the Contract Sum to insure Owner during construction, and for one year after completion and during any warranty or guaranty period, against faulty or improper materials or workmanship and to assure Owner of full and prompt performance of the Contract.

Payment Bond (Labor and Material) in the amount of one hundred percent (100%) of the Contract Sum in accordance with the laws of the State of California to secure payment of any and all claims for labor and materials used or consumed in performance of this Contract.

SUBSTITUTION OF MATERIALS:

The Contractor must ensure that the proposed substitutions by the Contractor or its subcontractors are submitted to the Architect's office a minimum of seven (7) calendar days prior to the Bid Opening for review and possible approval of any equipment or materials thought to be equal to or better than those specified in the drawings or specifications. An addendum will be issued seven (7) calendar days prior to Bid Opening, including all equipment and materials deemed equivalent to those specified and approved by the Architect. Submittals shall include comparative spec-data of the specified equipment or material and the proposed substitution as set forth in the Contract Documents. Submittals without this information will be automatically rejected.

PAYMENTS:

Payments to the Contractor on account of the Contract shall be made in accordance with the terms of the Contract Documents.

TAXES:

The Owner is generally exempt from payment of Federal Excise Tax on materials. The Owner will furnish exemption certificates to the Contractor to be used to obtain materials ordinarily subject to Federal Excise Tax without payment of the tax. Bidder shall deduct

Federal Excise Taxes from their bid prices before submitting bids, so that such taxes will not be included in the Contract Sum.

EARLY TERMINATION:

Notwithstanding any provision herein to the contrary, if for any fiscal year of this Contract the governing body of the Owner fails to appropriate or allocate funds for future periodic payments under the Contract after exercising reasonable efforts to do so, the Owner may upon thirty (30) days' notice, order work on the Project to cease. The Owner will remain obligated to pay for the work already performed but shall not be obligated to pay the balance remaining unpaid beyond the fiscal period for which funds have been appropriated or allocated and for which the work has not been done.

TIME OF COMPLETION AND LIQUIDATED DAMAGES:

Time of Completion – See document 01 10 00 Summary of Work.

Liquidated damages will accrue and may be assessed as provided in the Contract Documents. Should said Work not be Completed within the time limit as may be extended as herein provided (i.e., the Completion deadline), damages will be sustained by the Owner. It is understood and agreed that it is and will be impracticable or extremely difficult to determine the actual amount of damages which the Owner will sustain in the event of and by reason of such delay, and it is therefore agreed that the Contractor will pay the Owner the sum of **One Thousand Dollars (\$1,000.00) per calendar day** for each and every day's delay beyond the Completion deadline as and for liquidated damages, during or as a result of each calendar day by which Completion of the Project is delayed beyond the Completion deadline; in case the Contractor fails to make such payment, the Owner may deduct the amount thereof from any money due or that may become due the Contractor under the Contract. Should such money not be sufficient, the Owner shall have the right to recover the balance from the Contractor or its sureties.

END OF DOCUMENT

DOCUMENT 00 31 00

SITE-VISIT CERTIFICATION
TO BE EXECUTED BY BIDDER AND SUBMITTED WITH BID

PROJECT: Shade Structures at Five Sites

I certify that I visited the Sites of the proposed Work and became fully acquainted with the conditions relating to construction and labor. I fully understand the facilities, difficulties, and restrictions attending the execution of the Work under contract.

Bidder fully indemnifies the Berryessa Union School District, its Architect, its Engineer, its Construction Manager, and all of their respective officers, agents, employees, and consultants from any damage, or omissions, related to conditions that could have been identified during my visit and/or the Bidder's representative's visit to the Site.

I certify under penalty of perjury under the laws of the State of California that the foregoing is true and correct.

Date: _____

Proper Name of Bidder: _____

Signature: _____

Print Name: _____

Title: _____

END OF DOCUMENT

DOCUMENT 00 41 26

BID FORM

Berryessa Union School District
1376 Piedmont Rd.
San Jose, CA 95132

Dear Board Members:

The undersigned doing business under the firm name of:

_____ hereby propose and agree to enter into a Contract, to furnish any and all labor, materials, applicable taxes, equipment and services for the completion of Work described hereinafter and in the Contract Documents:

Shade Structures at Five Sites

**Morrill Middle School
Piedmont Middles School
Noble Elementary School
Ruskin Elementary School
Vinci Park Elementary School**

Bid Number – B-02-2020-21

Prepared by: Sugimura / Finney Architects
for the amount of:

Morrill Middle School – Shade Structure Base Bid <p style="text-align: right;">Dollars \$ _____</p>
Piedmont Middle School – Shade Structure Base Bid <p style="text-align: right;">Dollars \$ _____</p>
Piedmont Middle School – Entry Canopy Base Bid <p style="text-align: right;">Dollars \$ _____</p>
Noble Elementary School – Shade Structure Base Bid <p style="text-align: right;">Dollars \$ _____</p>

Ruskin Elementary School – Shade Structure Base Bid <p style="text-align: right;">Dollars \$ _____</p>
Vinci Park Elementary School – Shade Structure Base Bid <p style="text-align: right;">Dollars \$ _____</p>
Allowance Unforeseen Conditions One Hundred Twenty Thousand Dollars \$120,000.00
Total of All Sites Plus Allowance <p style="text-align: right;">Dollars\$ _____</p>
Total Base Bids of All Sites + Allowance

11.1.6.1 COURSE-OF-CONSTRUCTION INSURANCE REQUIREMENTS

Contractor, during the progress of the Work and until final acceptance of the Work by Owner upon completion of the entire Contract, shall maintain Builder’s Risk/Course-of-Construction insurance satisfactory to the Owner, issued on a completed value basis on all insurable Work included under the Contract Documents. This insurance shall insure against all risks, including but not limited to the following perils: vandalism, theft, malicious mischief, fire, sprinkler leakage, civil authority, sonic boom, explosion, collapse, flood, earthquake (for projects not solely funded through revenue bonds, limited to earthquakes equivalent to or under 3.5 on the Richter Scale in magnitude), wind, hail, lightning, smoke, riot or civil commotion, debris removal (including demolition) and reasonable compensation for the Architect’s services and expenses required as a result of such insured loss. This insurance shall provide coverage in an amount not less than the full cost to repair, replace or reconstruct the Work. Such insurance shall include the Owner, the Architect, and any other person or entity with an insurable interest in the Work as an additional named insured.

The Contractor shall submit to the Owner for its approval all items deemed to be uninsurable under the Builder’s Risk/Course-of Construction insurance. The risk of the damage to the Work due to the perils covered by the Builder’s Risk/Course-of-Construction insurance, as well as any other hazard which might result in damage to the Work, is that of the Contractor and the surety, and no claims for such loss or damage shall be recognized by the Owner, nor will such loss or damage excuse the complete and satisfactory performance of the Contract by the Contractor.

If written notice of the Award of Contract is mailed, faxed, or delivered to the undersigned at any time before this bid is withdrawn, the undersigned shall, within ten

(10) days after the date of such mailing, faxing, or delivering of such notice, execute and deliver an agreement in the form of agreement present in these Contract Documents and give Performance and Payment Bonds in accordance with the specifications and bid as accepted.

The undersigned hereby designates as the office to which such Notice of Award of Contract may be mailed, faxed, or delivered:

Our Public Liability and Property Damage Insurance is placed with:

Our Workers' Compensation Insurance is placed with:

Circular letters, bulletins, addenda, etc., bound with the specifications or issued during the time of bidding are included in the bid, and, in completing the Contract, they are to become a part thereof.

The receipt of the following addenda to the specifications is acknowledged:

Addendum No. _____ Date _____ Addendum No. _____ Date _____
Addendum No. _____ Date _____ Addendum No. _____ Date _____

This bid may be withdrawn at any time prior to the scheduled time for the opening of bids or any authorized postponement thereof.

A bidder shall not submit a bid unless the bidder's California contractor's license number appears clearly on the bid, the license expiration date and class are stated, and the bid contains a statement that the representations made therein are made under penalty of perjury. Any bid submitted by a contractor who is not licensed pursuant to Business and Professions Code section 7028.15 shall be considered nonresponsive and shall be rejected. Any bid not containing the above information may be considered nonresponsive and may be rejected.

NOTE: Each bid must give the full business address of the bidder and be signed by bidder with bidder's usual signature. Bids by partnerships must furnish the full name of all partners and must be signed in the partnership name by a general partner with authority to bind the partnership in such matters, followed by the signature and designation of the person signing. The name of the person signing shall also be typed or printed below the signature. Bids by corporations must be signed with the legal name of the corporation, followed by the name of the state of incorporation and by the signature and designation of the chairman of the board, president or any vice president, and then followed by a second signature by the secretary, assistant secretary, the chief financial officer or assistant treasurer. All persons signing must be authorized to bind the corporation in the matter. The name of each person signing shall also be typed or printed below the

signature. Satisfactory evidence of the authority of the officer signing on behalf of a corporation shall be furnished.

The undersigned declares under penalty of perjury under the laws of the State of California that the representations made in this bid are true and correct.

Print or Type Name: _____

Title: _____

Name of Company as Licensed: _____

Business Address: _____

Telephone Number: _____

California Contractor License No.: _____

Class and Expiration Date: _____

State of Incorporation, if Applicable: _____

() Evidence of authority to bind corporation is attached.

Dated: _____, _____

Signed: _____

END OF DOCUMENT

DOCUMENT 00 43 13

BID BOND

KNOW ALL MEN BY THESE PRESENTS that we the undersigned _____ as Principal and _____ as Surety, are hereby held and firmly bound unto the Berryessa Union School District (“Owner”) in the sum of _____ Dollars (\$_____) for payment of which sum, well and truly to be made, we hereby jointly and severally bind ourselves, our heirs, executors, administrators, successors and assigns.

The condition of the above obligation is such that whereas the Principal has submitted to the Owner a certain bid, attached hereto and hereby made a part hereof, to enter into a Contract in writing for the construction of Morrill Middle School Flexible Instructional Space Alteration and Related Modernization in strict accordance with Contract Documents.

NOW, THEREFORE,

a. If said bid shall be rejected, or, in the alternative;

b. If said bid shall be accepted and the Principal shall execute and deliver a contract in the form of agreement attached hereto and shall execute and deliver Performance and Payment Bonds in the forms attached hereto (all properly completed in accordance with said bid), and shall in all other respects perform the agreement created by the acceptance of said bid;

Then this obligation shall be void, otherwise the same shall remain in full force and effect, it being expressly understood and agreed that the liability of the Surety for any and all default of the Principal hereunder shall be the amount of this obligation as herein stated.

Surety, for value received, hereby stipulates and agrees that no change, extension of time, alteration or addition to the terms of the Contract on the call for bids, or to the Work to be performed hereunder, or the specifications accompanying the same, shall in any way affect its obligation under this bond, and it does hereby waive notice of any such change, extension of time, alteration or addition to the terms of said Contract or the call for bids, or to the Work, or to the specifications.

IN WITNESS WHEREOF, the above-bounden parties have executed this instrument under several seals this ____ day of _____, 201__, the name and corporate party being hereto affixed and these presents duly signed by its undersigned representative, pursuant to authority of its governing body. In the presence of:

(Notary Seal)

(Principal)

(Business Address)

(Corporate Surety)

Business Address)

By: _____

The rate or premium of this bond is _____ per thousand, the total amount of premium charged, \$_____.

(The above must be filled in by Corporate Surety).

END OF DOCUMENT

DESIGNATION OF SUBCONTRACTORS

Each bidder shall set forth below the name and the location of the place of business of each subcontractor and the California contractor license number of each subcontractor who will perform work or labor or render service to the Contractor in or about the construction of the Work or improvement, or to a subcontractor licensed by the State of California who, under subcontract to the Contractor, specially fabricates and installs a portion of the Work or improvement according to detailed drawings contained in the plans and specifications, in an amount in excess of one-half of 1 percent (0.5%) of the bidder's total bid, and the portion of the Work which will be done by each subcontractor. An inadvertent error in listing a California contractor's license number shall not be grounds for filing a bid protest or for considering the bid nonresponsive if the bidder submits the corrected contractor's license number to the Owner within 24 hours after the bid opening, or any continuation thereof, so long as the corrected contractor's license number corresponds to the submitted name and location for that subcontractor.

If the Contractor fails to specify a subcontractor for any portion of the Work to be performed under the Contract in excess of one-half of 1 percent (0.5%) of the Contractor's total bid, the Contractor shall be deemed to have agreed to perform such portion itself, and shall not be permitted to subcontract that portion of the Work except under the conditions hereinafter set forth.

Subletting or subcontracting of any portion of the Work as to which no subcontractor was designated in the original bid shall only be permitted in cases of public emergency or necessity, and then only after a finding reduced to writing as a public record of the legislative body of the Owner.

As of March 1, 2015, for any bid proposal submitted, and as of April 1, 2015, for any contract for public work entered into, an inadvertent error in listing a subcontractor who is not registered under Labor Code section 1725.5 shall not be grounds for filing a bid protest or grounds for considering the bid nonresponsive, provided that either: the subcontractor is registered prior to the bid opening; or the subcontractor is registered and has paid the penalty registration fee specified in Labor Code section 1725.5(a)(2)(E), if applicable, within 24 hours after the bid opening; or the subcontractor is replaced by another registered subcontractor under Public Contract Code section 4107. Failure of a listed subcontractor to be registered shall be grounds under Public Contract Code section 4107 for the Contractor, with the Owner's consent, to substitute a registered subcontractor for the unregistered subcontractor.

Failure to provide this information in a legible manner may result in the rejection of an otherwise acceptable bid.

NOTE: *Reproduce page two of this section for additional listings needed beyond the length of this form.*

DOCUMENT 00 43 40

SUFFICIENT FUNDS DECLARATION

(Labor Code section 2810)

TO BE EXECUTED BY BIDDER AND SUBMITTED WITH BID

Owner: Berryessa Union School District

Project: _____

I, _____, declare that I am the _____ of _____, the entity making and submitting the bid for the above Project that accompanies this Declaration, and that such bid includes sufficient funds to permit _____ *[insert name of entity]* to comply with all local, state or federal labor laws or regulations during the Project, including payment of prevailing wage, and that _____ *[the entity]* will comply with the provisions of Labor Code section 2810(d) if awarded the Contract.

I declare under penalty of perjury under the laws of the State of California that the foregoing is true and correct and executed on _____20__, at _____ *[city]*, _____ *[state]*.

Date: _____

Signature

Print Name: _____

Print Title: _____

END OF DOCUMENT

DOCUMENT 00 45 19

NON COLLUSION DECLARATION
TO BE EXECUTED BY BIDDER AND SUBMITTED WITH BID

Owner: Berryessa Union School District

Project: Shade Structures at Five Sites

The undersigned declares:

I am the _____ of _____, the party making the foregoing bid.

The bid is not made in the interest of, or on behalf of, any undisclosed person, partnership, company, association, organization, or corporation. The bid is genuine and not collusive or sham. The bidder has not directly or indirectly induced or solicited any other bidder to put in a false or sham bid. The bidder has not directly or indirectly colluded, conspired, connived, or agreed with any bidder or anyone else to put in a sham bid, or to refrain from bidding. The bidder has not in any manner, directly or indirectly, sought by agreement, communication, or conference with anyone to fix the bid price of the bidder or any other bidder, or to fix any overhead, profit, or cost element of the bid price, or of that of any other bidder. All statements contained in the bid are true. The bidder has not, directly or indirectly, submitted his or her bid price or any breakdown thereof, or the contents thereof, or divulged information or data relative thereto, to any corporation, partnership, company, association, organization, bid depository, or to any member or agent thereof, to effectuate a collusive or sham bid, and has not paid, and will not pay, any person or entity for such purpose.

Any person executing this declaration on behalf of a bidder that is a corporation, partnership, joint venture, limited liability company, limited liability partnership, or any other entity, hereby represents that he or she has full power to execute, and does execute, this declaration on behalf of the bidder.

I declare under penalty of perjury under the laws of the State of California that the foregoing is true and correct and that this declaration is executed on _____, 201__, at _____ [city], _____ [state].

Signature

Print Name

END OF DOCUMENT

DRUG-FREE WORKPLACE CERTIFICATION

PROJECT/CONTRACT NO.: _____ for the _____
between Berryessa Union School District (the “District” or the “Owner”) and
_____ (the “Contractor” or the “Bidder”) for
Shade Structures at Five Sites (the “Contract” or the “Project”).

This Drug-Free Workplace Certification form is required from the successful Bidder pursuant to Government Code section 8350 et seq., the Drug-Free Workplace Act of 1990. The Drug-Free Workplace Act of 1990 requires that every person or organization awarded a contract or grant for the procurement of any property or service from any state agency must certify that it will provide a drug-free workplace by doing certain specified acts. In addition, the Act provides that each contract or grant awarded by a state agency may be subject to suspension of payments or termination of the contract or grant, and the contractor or grantee may be subject to debarment from future contracting, if the contracting agency determines that specified acts have occurred.

The District is not a “state agency” as defined in the applicable section(s) of the Government Code, but the District is a local agency and public school district under California law and requires all contractors on District projects to comply with the provisions and requirements of Government Code section 8350 et seq., the Drug-Free Workplace Act of 1990.

Contractor shall certify that it will provide a drug-free workplace by doing all of the following:

- a. Publishing a statement notifying employees that the unlawful manufacture, distribution, dispensation, possession, or use of a controlled substance is prohibited in the person’s or organization’s workplace and specifying actions which will be taken against employees for violations of the prohibition;
- b. Establishing a drug-free awareness program to inform employees about all of the following:
 - (1) The dangers of drug abuse in the workplace.
 - (2) The person’s or organization’s policy of maintaining a drug-free workplace.
 - (3) The availability of drug counseling, rehabilitation, and employee-assistance programs.
 - (4) The penalties that may be imposed upon employees for drug abuse violations.
- c. Requiring that each employee engaged in the performance of the contract or grant be given a copy of the statement required above, and that, as a condition of

employment on the contract or grant, the employee agrees to abide by the terms of the statement.

I, the undersigned, agree to fulfill the terms and requirements of Government Code section 8355 listed above and will publish a statement notifying employees concerning (a) the prohibition of controlled substance at the workplace, (b) establishing a drug-free awareness program, and (c) requiring that each employee engaged in the performance of the contract be given a copy of the statement required by section 8355(a), and requiring that the employee agree to abide by the terms of that statement.

I also understand that if the District determines that I have either (a) made a false certification herein, or (b) violated this certification by failing to carry out the requirements of section 8355, that the Contract awarded herein is subject to termination, suspension of payments, or both. I further understand that, should I violate the terms of the Drug-Free Workplace Act of 1990, I may be subject to debarment in accordance with the requirements of section 8350 et seq.

I acknowledge that I am aware of the provisions of Government Code section 8350 et seq. and hereby certify that I will adhere to the requirements of the Drug-Free Workplace Act of 1990.

Date: _____

Proper Name of Contractor: _____

Signature: _____

Print Name: _____

Title: _____

END OF DOCUMENT

DOCUMENT 00 45 26

WORKERS' COMPENSATION CERTIFICATE

Labor Code Section 3700, in relevant part, provides:

"Every employer except the state shall secure the payment of compensation in one or more of the following ways:

(a) By being insured against liability to pay compensation in one or more insurers duly authorized to write compensation insurance in this state.

(b) By securing from the Director of Industrial Relations a certificate of consent to self-insure either as an individual employer or as one employer in a group of employers. Said certificate may be given upon furnishing proof satisfactory to the Director of Industrial Relations of ability to self-insure and to pay any compensation that may become due to his or her employees, ... "

I am aware of the provisions of the Labor Code Section 3700 which require every employer to be insured against liability for workers' compensation or to undertake self-insurance in accordance with the provisions of that code, and I will comply with such provisions before commencing the performance of the work of this contract. I shall supply the Owner with certificates of insurance evidencing that Workers' Compensation Insurance is in effect and providing that the Owner will receive thirty (30) days' notice of cancellation.

Name of Contractor

Signature

Print Name

Date

(In accordance with Article 5 (commencing at Section 1860), Chapter 1, Part 7, Division 2 of the Labor Code, the above certificate must be signed and filed with the awarding body prior to performing any work under the contract.)

END OF DOCUMENT

DOCUMENT 00 45 32

FINGERPRINTING NOTICE AND ACKNOWLEDGMENT

(Education Code Section 45125.2(a))

Business entities entering into contracts with the Owner for the construction, reconstruction, rehabilitation or repair of a facility must comply with Education Code sections 45125.1 and 45125.2. Such entities are responsible for ensuring full compliance with the law and should therefore review all applicable statutes and regulations. The following information is provided simply to assist such entities with compliance with the law.

1. If the Owner determines your employee(s) will have more than limited contact with students, then you must take one or more of the following steps:
 - a. Install a physical barrier at the worksite to limit contact with pupils.
 - b. Have an employee, who the Department of Justice has ascertained has not been convicted of a violent or serious felony, continually monitor and supervise employees. The entity shall verify in the Independent Contractor Student Contact Form to the Owner that the employee charged with monitoring and supervising its employees has no such convictions. (See attached.)
 - c. Arrange, with Owner’s approval, for surveillance by Owner’s personnel.

If one or more of these steps is taken, you are not required to comply with Education Code section 45125.1.

2. If you are providing the services in an emergency or exceptional situation, you are not required to comply with Education Code section 45125.2. An “emergency or exceptional” situation is one in which pupil health or safety is endangered or when repairs are needed to make a facility safe and habitable. Owner shall determine whether an emergency or exceptional situation exists.

I have read the foregoing and agree to comply with the requirements of Education Code §§ 45125.1 and 45125.2 as applicable.

Dated: _____

Signature

Name: _____

Title: _____

ATTACHMENT

Under Education Code section 45125.1, no employee of a contractor or subcontractor who has been convicted of or has criminal proceedings pending for a violent or serious felony may come into contact with any student. A violent felony is any felony listed in subdivision (c) of Section 667.5 of the Penal Code. Those felonies are presently defined as:

- (1) Murder or voluntary manslaughter.
- (2) Mayhem.
- (3) Rape as defined in paragraph (2) or (6) of subdivision (a) of Section 261 or paragraph (1) or (4) of subdivision (a) of Section 262.
- (4) Sodomy as defined in subdivision (c) or (d) of Section 286.
- (5) Oral copulation as defined in subdivision (c) or (d) of Section 288a.
- (6) Lewd or lascivious act as defined in subdivision (a) or (b) of Section 288.
- (7) Any felony punishable by death or imprisonment in the state prison for life.
- (8) Any felony in which the defendant inflicts great bodily injury on any person other than an accomplice which has been charged and proved as provided for in Section 12022.7, 12022.8, or 12022.9 on or after July 1, 1977, or as specified prior to July 1, 1977, in Sections 213, 264, and 461, or any felony in which the defendant uses a firearm which use has been charged and proved as provided in subdivision (a) of Section 12022.3, or Section 12022.5 or 12022.55.
- (9) Any robbery.
- (10) Arson, in violation of subdivision (a) or (b) of Section 451.
- (11) Sexual penetration as defined in subdivision (a) or (j) of Section 289.
- (12) Attempted murder.
- (13) A violation of Section 18745, 18750, or 18755.
- (14) Kidnapping.
- (15) Assault with the intent to commit a specified felony, in violation of Section 220.
- (16) Continuous sexual abuse of a child, in violation of Section 288.5.

- (17) Carjacking, as defined in subdivision (a) of Section 215.
- (18) Rape, spousal rape, or sexual penetration, in concert, in violation of Section 264.1.
- (19) Extortion, as defined in Section 518, which would constitute a felony violation of Section 186.22 of the Penal Code.
- (20) Threats to victims or witnesses, as defined in Section 136.1, which would constitute a felony violation of Section 186.22 of the Penal Code.
- (21) Any burglary of the first degree, as defined in subdivision (a) of Section 460, wherein it is charged and proved that another person, other than an accomplice, was present in the residence during the commission of the burglary.
- (22) Any violation of Section 12022.53.
- (23) A violation of subdivision (b) or (c) of Section 11418.

A serious felony is any felony listed in subdivision (c) Section 1192.7 of the Penal Code. Those felonies are presently defined as:

- (1) Murder or voluntary manslaughter; (2) Mayhem; (3) Rape; (4) Sodomy by force, violence, duress, menace, threat of great bodily injury, or fear of immediate and unlawful bodily injury on the victim or another person; (5) Oral copulation by force, violence, duress, menace, threat of great bodily injury, or fear of immediate and unlawful bodily injury on the victim or another person; (6) Lewd or lascivious act on a child under the age of 14 years; (7) Any felony punishable by death or imprisonment in the state prison for life; (8) Any felony in which the defendant personally inflicts great bodily injury on any person, other than an accomplice, or any felony in which the defendant personally uses a firearm; (9) Attempted murder; (10) Assault with intent to commit rape, or robbery; (11) Assault with a deadly weapon or instrument on a peace officer; (12) Assault by a life prisoner on a non-inmate; (13) Assault with a deadly weapon by an inmate; (14) Arson; (15) Exploding a destructive device or any explosive with intent to injure; (16) Exploding a destructive device or any explosive causing bodily injury, great bodily injury, or mayhem; (17) Exploding a destructive device or any explosive with intent to murder; (18) Any burglary of the first degree; (19) Robbery or bank robbery; (20) Kidnapping; (21) Holding of a hostage by a person confined in a state prison; (22) Attempt to commit a felony punishable by death or imprisonment in the state prison for life; (23) Any felony in which the defendant personally used a dangerous or deadly weapon; (24) Selling, furnishing, administering, giving, or offering to sell, furnish, administer, or give to a minor any heroin, cocaine, phencyclidine (PCP), or any

methamphetamine-related drug, as described in paragraph (2) of subdivision (d) of Section 11055 of the Health and Safety Code, or any of the precursors of methamphetamines, as described in subparagraph (A) of paragraph (1) of subdivision (f) of Section 11055 or subdivision (a) of Section 11100 of the Health and Safety Code; (25) Any violation of subdivision (a) of Section 289 where the act is accomplished against the victim's will by force, violence, duress, menace, or fear of immediate and unlawful bodily injury on the victim or another person; (26) Grand theft involving a firearm; (27) carjacking; (28) any felony offense, which would also constitute a felony violation of Section 186.22; (29) assault with the intent to commit mayhem, rape, sodomy, or oral copulation, in violation of Section 220; (30) throwing acid or flammable substances, in violation of Section 244; (31) assault with a deadly weapon, firearm, machine gun, assault weapon, or semiautomatic firearm or assault on a peace officer or firefighter, in violation of Section 245; (32) assault with a deadly weapon against a public transit employee, custodial officer, or school employee, in violation of Sections 245.2, 245.3, or 245.5; (33) discharge of a firearm at an inhabited dwelling, vehicle, or aircraft, in violation of Section 246; (34) commission of rape or sexual penetration in concert with another person, in violation of Section 264.1; (35) continuous sexual abuse of a child, in violation of Section 288.5; (36) shooting from a vehicle, in violation of subdivision (c) or (d) of Section 26100; (37) intimidation of victims or witnesses, in violation of Section 136.1; (38) criminal threats, in violation of Section 422; (39) any attempt to commit a crime listed in this subdivision other than an assault; (40) any violation of Section 12022.53; (41) a violation of subdivision (b) or (c) of Section 11418; and (42) any conspiracy to commit an offense described in this subdivision.

INDEPENDENT CONTRACTOR STUDENT CONTACT FORM

Contractor Name: _____
Supervisor/Foreman Name: _____
Start Date: _____
Completion Date: _____
Location of Work: _____
Hours of Work: _____
Length of Time on Grounds: _____
Number of Employees on the Job: _____

Yes No
[] [] Employees will have more than limited contact with students as determined by
Owner, or if by Contractor, please explain:

If yes, the following steps will be taken to ensure student safety (check):

- A physical barrier will be installed at the worksite to limit contact with pupils.
- Employees will be continually monitored and supervised by an employee who has not been convicted of a violent or serious felony.

Name of Supervising Employee:

Date of Department of Justice verification that supervising employee has not been
convicted of a violent or serious felony:

Name of employee who is the custodian of the Department of Justice verification
information:

- Owner agrees: Employees will be surveilled by Owner’s personnel.

I declare under penalty of perjury that the foregoing is true and correct to the best of my
knowledge.

Dated: _____
Signature _____
Typed Name: _____
Title: _____

*Note: This document must be executed and submitted with the executed Agreement between
Owner and Contractor.*

END OF DOCUMENT

DOCUMENT 00 45 34

IRAN CONTRACTING ACT CERTIFICATION
(Public Contract Code sections 2202-2208)
TO BE EXECUTED BY BIDDER AND SUBMITTED WITH BID

As required by Public Contract Code (“PCC”) section 2204 for contracts of \$1,000,000 or more, please insert bidder’s or financial institution’s name and Federal ID Number (if available) and complete **one** of the options below. Please note that California law establishes penalties for providing false certifications, including civil penalties equal to the greater of \$250,000 or twice the amount of the contract for which the false certification was made; contract termination; and three-year ineligibility to bid on contracts. (PCC §2205.)

OPTION #1 - CERTIFICATION

I, the official named below, certify I am duly authorized to execute this certification on behalf of the bidder/financial institution identified below, and the bidder/financial institution identified below is **not** on the current list of persons engaged in investment activities in Iran created by California Department of General Services (“DGS”) and is not a financial institution extending twenty million dollars (\$20,000,000) or more in credit to another person/bidder, for 45 days or more, if that other person/bidder will use the credit to provide goods or services in the energy sector in Iran and is identified on the current list of persons engaged in investment activities in Iran created by DGS. (PCC §2204(a).)

<i>Bidder Name/Financial Institution (Printed)</i>		<i>Federal ID Number (or n/a)</i>
<i>By (Authorized Signature)</i>		
<i>Printed Name and Title of Person Signing</i>		
<i>Date Executed</i>	<i>Executed in</i>	

OPTION #2 – EXEMPTION

Pursuant to Public Contract Code sections 2203(c) and (d), a public entity may permit a bidder/financial institution engaged in investment activities in Iran, on a case-by-case basis, to be eligible for, or to bid on, submit a proposal for, or enters into or renews, a contract for goods and services. If you have obtained an exemption from the certification requirement under the Iran Contracting Act, please fill out the information below, and attach documentation demonstrating the exemption approval.

<i>Bidder Name/Financial Institution (Printed)</i>		<i>Federal ID Number (or n/a)</i>
<i>By (Authorized Signature)</i>		
<i>Printed Name and Title of Person Signing</i>		<i>Date Executed</i>

END OF DOCUMENT

DOCUMENT 00 50 50

NOTICE OF INTENT TO AWARD

DATE POSTED:

CONTRACT NUMBER: B-02-2020-21

PROJECT TITLE: Shade Structures at Five Sites

Bonny S Gregorius, the Purchasing and Contracts Manager of the Berryessa Union School District, intends to recommend to the Board of Trustees of the Berryessa Union School District the Award of the above-referenced Project to at _____ meeting of the Board of Trustees.

Deliver to the District FOUR fully executed counterparts of Document 00 52 26 (Agreement). Each copy of Document 00 52 26 (Agreement) must bear your original signature on the signature page and your initials on each page. Please print as single sided copies.

You must provide a scanned signed copy of the agreement before 3:00pm on _____. You must provide the original completed documents listed below by 2:00pm on_____.

FOR THE BERRYESSA UNION SCHOOL DISTRICT

By: _____

Bonny S Gregorius
Purchasing and Contracts Manager
408-923-1871 ofc
408-926-8329 fax
bgregorius@busd.net

END OF DOCUMENT

DOCUMENT 00 52 26

AGREEMENT BETWEEN OWNER AND CONTRACTOR

This Agreement effective _____, 202__, by and between Berryessa Union School District, Santa Clara County, California, hereinafter called the "Owner," and _____, hereinafter called the "Contractor."

WITNESSETH: That the Contractor and the Owner for the consideration hereinafter named agree as follows:

ARTICLE I. SCOPE OF WORK. The Contractor agrees to furnish all labor, equipment and materials, including tools, implements, and appliances required, and to perform all the work in a good and workmanlike manner, free from any and all liens and claims from mechanics, material suppliers, subcontractors, artisans, machinists, teamsters, freight carriers, and laborers required for:

Shade Structures at Five Sites

all in strict compliance with the plans, drawings and specifications therefore prepared by:

Sugimura / Finney Architects

and other contract documents relating thereto.

ARTICLE II. CONTRACT DOCUMENTS. The Contractor and the Owner agree that all of the documents listed in Article 1.1.1 of the General Conditions form the Contract Documents which form the Contract.

ARTICLE III. TIME TO COMPLETE AND LIQUIDATED DAMAGES.

Time is of the essence in this contract, and the time of Completion for the Project shall be One Hundred Twenty Nine (129) consecutive calendar days from receipt of the Owner's Notice to Proceed.

Failure to Complete the Project within the time and in the manner provided for by the Contract Documents (i.e., by the Completion deadline) shall subject the Contractor to liquidated damages. For purposes of liquidated damages, the concept of "substantial completion" shall not constitute Completion and is not part of the Contract Documents. The actual occurrence of damages and the actual amount of the damages which the Owner would suffer if the Project were not Completed by the Completion deadline are dependent upon many circumstances and conditions which could prevail in various combinations and, from the nature of the case, it is impracticable and extremely difficult to fix the actual damages. Damages which the Owner would suffer in the event of delay include, but are not limited to, loss of the use of the Project, disruption of activities, costs of administration, supervision and the incalculable inconvenience and loss suffered by the public.

Accordingly, the parties agree that the amount herein set forth shall be the amount of damages which the Owner shall directly incur upon failure of the Contractor to Complete the Project by the Completion deadline: **\$1,000.00, for each calendar day** by which Completion of the Project is delayed beyond the Completion deadline as adjusted by change orders.

If the Contractor becomes liable under this section, the Owner, in addition to all other remedies provided by law, shall have the right to withhold any and all retained percentages of payments and/or progress payments, and to collect the interest thereon, which would otherwise be or become due the Contractor until the liability of the Contractor under this section has been finally determined. If the retained percentages and withheld progress payments appear insufficient to discharge all liabilities of the Contractor incurred under this Article, the Contractor and its sureties shall continue to remain liable to the Owner for such liabilities until all such liabilities are satisfied in full.

If the Owner accepts any work or makes any payment under this Agreement after a default by reason of delays, the payment or payments shall in no respect constitute a waiver or modification of any Agreement provisions regarding time of Completion and liquidated damages.

ARTICLE IV. PAYMENT AND RETENTION. The Owner agrees to pay the Contractor in current funds _____ dollars (\$_____) for work satisfactorily performed after receipt of properly documented and submitted Applications for Payment and to make payments on account thereof, as provided in the General Conditions.

The retention amount on this Project is Five Percent (5%).

ARTICLE V. CHANGES. Changes in this Agreement or in the Work to be done under this Agreement shall be made as provided in the General Conditions.

ARTICLE VI. TERMINATION. The Owner or Contractor may terminate the Contract as provided in the General Conditions.

ARTICLE VII. PREVAILING WAGES. The Project is a public work, the Work shall be performed as a public work and pursuant to the provisions of Section 1770 et seq. of the Labor Code of the State of California, which are hereby incorporated by reference and made a part hereof, the Director of Industrial Relations has determined the general prevailing rate of per diem wages and the general prevailing rate for holiday and overtime work in the locality in which the work is to be performed, for each craft, classification or type of worker needed to execute this Contract. Per diem wages shall be deemed to include employer payments for health and welfare, pension, vacation, apprenticeship or other training programs, and similar purposes. Copies of the rates are on file at the Owner's principal office. The rate of prevailing wage for any craft, classification or type of workmanship to be employed on this Project is the rate established by the applicable collective bargaining agreement which rate so provided is hereby adopted by reference and shall be effective for the life of this Agreement or until the Director of the Department of Industrial Relations determines that another rate be

adopted. It shall be mandatory upon the Contractor and on any subcontractor to pay not less than the said specified rates to all workers employed in the execution of this Agreement.

The Contractor and any subcontractor under the Contractor as a penalty to the Owner shall forfeit not more than Two Hundred Dollars (\$200.00) for each calendar day or portion thereof for each worker paid less than the stipulated prevailing rates for such work or craft in which such worker is employed. The difference between such stipulated prevailing wage rates and the amount paid to each worker for each calendar day or portion thereof for which each worker was paid less than the stipulated prevailing wage rate shall be paid to each worker by the Contractor.

The Contractor and each Subcontractor shall keep or cause to be kept an accurate record for work on this Project showing the names, addresses, social security numbers, work classification, straight time and overtime hours worked and occupations of all laborers, workers and mechanics employed by them in connection with the performance of this Contract or any subcontract thereunder, and showing also the actual per diem wage paid to each of such workers, which records shall be open at all reasonable hours to inspection by the Owner, its officers and agents and to the representatives of the Division of Labor Law Enforcement of the State Department of Industrial Relations. The Contractor and each subcontractor shall furnish a certified copy of all payroll records directly to the Labor Commissioner.

For public works contracts awarded on and after January 1, 2015, those public works projects shall be subject to compliance monitoring and enforcement by the Department of Industrial Relations.

As of March 1, 2015, a contractor or subcontractor shall not be qualified to submit a bid or to be listed in a bid proposal subject to the requirements of Public Contract Code section 4104 unless currently registered and qualified under Labor Code section 1725.5 to perform public work as defined by Division 2, Part 7, Chapter 1 (§§1720 et seq.) of the Labor Code.

As of April 1, 2015, a contractor or subcontractor shall not be qualified to enter into, or engage in the performance of, any contract of public work (as defined by Division 2, Part 7, Chapter 1 (§§1720 et seq.) of the Labor Code) unless currently registered and qualified under Labor Code section 1725.5 to perform public work.

ARTICLE VIII. WORKING HOURS. In accordance with the provisions of Sections 1810 to 1815, inclusive, of the Labor Code of the State of California, which are hereby incorporated and made a part hereof, the time of service of any worker employed by the Contractor or a Subcontractor doing or contracting to do any part of the Work contemplated by this Agreement is limited and restricted to eight hours during any one calendar day and forty hours during any one calendar week, provided, that work may be performed by such employee in excess of said eight hours per day or forty hours per week provided that compensation for all hours worked in excess of eight hours per day, and forty hours per week, is paid at a rate not less than one and one-half (1½) times the basic rate of pay. The Contractor and every Subcontractor shall keep an accurate record

showing the name of and the actual hours worked each calendar day and each calendar week by each worker employed by them in connection with the Work. The records shall be kept open at all reasonable hours to inspection by representatives of the Owner and the Division of Labor Law Enforcement. The Contractor shall as a penalty to the Owner forfeit Twenty-five Dollars (\$25.00) for each worker employed in the execution of this Agreement by the Contractor or by any subcontractor for each calendar day during which such worker is required or permitted to work more than eight hours in any one calendar day, and forty hours in any one calendar week, except as herein provided.

ARTICLE IX. APPRENTICES. The Contractor agrees to comply with Chapter 1, Part 7, Division 2, Sections 1777.5 and 1777.6 of the California Labor Code, which are hereby incorporated and made a part hereof. These sections require that contractors and subcontractors employ apprentices in apprenticeable occupations in a ratio of not less than one hour of apprentice's work for each five hours of work performed by a journeyman (unless an exemption is granted in accordance with Section 1777.5) and that contractors and subcontractors shall not discriminate among otherwise qualified employees as indentured apprentices on any public works solely on the ground of sex, race, religious creed, national origin, ancestry or color. Only apprentices as defined in Labor Code Section 3077, who are in training under apprenticeship standards and who have signed written apprentice agreements, will be employed on public works in apprenticeable occupations. The responsibility for compliance with these provisions is fixed with the Contractor for all apprenticeable occupations.

ARTICLE X. DSA OVERSIGHT PROCESS. The Contractor must comply with the applicable requirements of the Division of State Architect ("DSA") Construction Oversight Process ("DSA Oversight Process"), including but not limited to (a) notifying the Owner's Inspector of Record/Project Inspector ("IOR") upon commencement and completion of each aspect of the work as required under DSA Form 156; (b) coordinating the Work with the IOR's inspection duties and requirements; (c) submitting verified reports under DSA Form 6-C; and (d) coordinating with the Owner, Owner's Architect, any Construction Manager, any laboratories, and the IOR to meet the DSA Oversight Process requirements without delay or added costs to the Project.

Contractor shall be responsible for any additional DSA fees related to review of proposed changes to the DSA-approved construction documents, to the extent the proposed changes were caused by Contractor's wrongful act or omissions. If inspected work is found to be in non-compliance with the DSA-approved construction documents or the DSA-approved testing and inspection program, then it must be removed and corrected. Any construction that covers unapproved or uninspected work is subject to removal and correction, at Contractor's expense, in order to permit inspection and approval of the covered work in accordance with the DSA Oversight Process.

ARTICLE XI. INDEMNIFICATION AND INSURANCE. The Contractor will defend, indemnify and hold harmless the Owner, its governing board, officers, agents, trustees, employees and others as provided in the General Conditions.

By this statement the Contractor represents that it has secured the payment of Workers' Compensation in compliance with the provisions of the Labor Code of the State

of California and during the performance of the work contemplated herein will continue so to comply with said provisions of said Code. The Contractor shall supply the Owner with certificates of insurance evidencing that Workers' Compensation Insurance is in effect and providing that the Owner will receive thirty (30) days' notice of cancellation.

Contractor shall provide the insurance set forth in the General Conditions. The amount of general liability insurance shall be \$1,000,000.00 per occurrence for bodily injury, personal injury and property damage and a minimum of \$2,000,000.00 aggregate. The amount of automobile liability insurance shall be \$1,000,000.00 per accident for bodily injury and property damage combined single limit.

ARTICLE XII. ENTIRE AGREEMENT. The Contract constitutes the entire agreement between the parties relating to the Project, and supersedes any prior or contemporaneous agreement between the parties, oral or written, including the Owner's award of the Project to Contractor, unless such agreement is expressly incorporated herein. The Owner makes no representations or warranties, express or implied, not specified in the Contract. The Contract is intended as the complete and exclusive statement of the parties' agreement pursuant to Code of Civil Procedure section 1856.

ARTICLE XIII. EXECUTION OF OTHER DOCUMENTS. The parties to this Agreement shall cooperate fully in the execution of any and all other documents and in the completion of any additional actions that may be necessary or appropriate to give full force and effect to the terms and intent of the Contract.

ARTICLE XIV. EXECUTION IN COUNTERPARTS. This Agreement may be executed in counterparts such that the signatures may appear on separate signature pages. A copy, or an original, with all signatures appended together, shall be deemed a fully executed Agreement.

ARTICLE XV. BINDING EFFECT. Contractor, by execution of this Agreement, acknowledges that Contractor has read this Agreement and the other Contract Documents, understands them, and agrees to be bound by their terms and conditions. The Contract shall inure to the benefit of and shall be binding upon the Contractor and the Owner and their respective successors and assigns.

ARTICLE XVI. SEVERABILITY; GOVERNING LAW; CHOICE OF FORUM. If any provision of the Contract shall be held invalid or unenforceable by a court of competent jurisdiction, such holding shall not invalidate or render unenforceable any other provision hereof. The Contract shall be governed by the laws of the State of California. Any action or proceeding seeking any relief under or with respect to this Agreement shall be brought solely in the Superior Court of the State of California for the County of Santa Clara, subject to transfer of venue under applicable State law, provided that nothing in this Agreement shall constitute a waiver of immunity to suit by Owner.

ARTICLE XVII. AMENDMENTS. The terms of the Contract shall not be waived, altered, modified, supplemented or amended in any manner whatsoever except by written agreement signed by the parties and approved or ratified by the Governing Board.

ARTICLE XVIII. ASSIGNMENT OF CONTRACT. The Contractor shall not assign or transfer by operation of law or otherwise any or all of its rights, burdens, duties or obligations without the prior written consent of the surety on the payment bond, the surety on the performance bond and the Owner.

ARTICLE XIX. WRITTEN NOTICE. Written notice shall be deemed to have been duly served if delivered in person to the individual or member of the firm or to an officer of the corporation for whom it was intended, or if delivered at or sent by registered or certified or overnight mail to the last business address known to the person who gives the notice.

(CONTRACTOR)

(OWNER)

SIGNED BY (Contractor)

(Title)

CALIFORNIA CONTRACTOR'S
LICENSE NO.

LICENSE EXPIRATION DATE

NOTE: Contractor must give the full business address of the Contractor and sign with Contractor's usual signature. Partnerships must furnish the full name of all partners and the Agreement must be signed in the partnership name by a general partner with authority to bind the partnership in such matters, followed by the signature and designation of the person signing. The name of the person signing shall also be typed or printed below the signature. Corporations must sign with the legal name of the corporation, followed by the name of the state of incorporation and by the signature and designation of the chairman of the board, president or any vice president, and then followed by a second signature by the secretary, assistant secretary, the chief financial officer or assistant treasurer. All persons signing must be authorized to bind the corporation in the matter. The name of each person signing shall also be typed or printed below the signature. Satisfactory evidence of the authority of the officer signing on behalf of a corporation shall be furnished.

END OF DOCUMENT

NOTICE OF AWARD

Attn:

CONTRACT NO.: B-02-2020-21
CONTRACT FOR: Shade Structures at Five Sites

The Contract Sum:
_____ Dollars (\$ _____)

1. One electronic copy of the proposed Contract Documents listed below accompanies this Notice of Intent to Award.
2. You must provide the original completed documents listed below by 2:00pm on_____.
 - a. Deliver to District TWO originals of Document 00 61 13.13 (Construction Performance Bond), executed by you and your surety.
 - b. Deliver to District TWO originals of Document 00 61 13.16 (Construction Labor and Material Payment Bond), executed by you and your surety.
 - c. Deliver to District TWO original sets of the insurance certificates with endorsements required under Document 00 72 00 (General Conditions).
3. Failure to comply with these conditions within the time specified will entitle District to consider your Bid abandoned, to annul this Notice of Award, and to declare your Bid security forfeited.
4. Within 10 days after you comply with the conditions in Paragraph 2 of this Document 00 51 00, District will return to you one fully signed counterpart of Document 00 52 26 (Agreement).
5. Before you may start any Work at the Site, you must attend a preconstruction conference. The preconstruction conference will be arranged through Kitchell CEM. Questions regarding bonds and insurance may be directed to Bonny S Gregorius, Purchasing Manager at 408-923-1871.

6. **SB 854 COMPLIANCE:** No contractor or subcontractor may be listed on a bid proposal for a public works project unless registered with the Department of Industrial Relations pursuant to Labor Code section 1725.5.

No contractor or subcontractor may be awarded a contract for public work on a public works project unless registered with the Department of Industrial Relations pursuant to Labor Code section 1725.5.

This project is subject to compliance monitoring and enforcement by the Department of Industrial Relations.

7. **FURNISHING OF ELECTRONIC CERTIFIED PAYROLL RECORDS TO LABOR COMMISSIONER:**

All contractors and subcontractors must furnish electronic certified payroll records directly to the Labor Commissioner (aka Division of Labor Standards Enforcement).

FOR THE BERRYESSA UNION SCHOOL DISTRICT

By: _____

Bonny S Gregorius
Purchasing and Contracts Manager

Board Approval Date: _____

END OF DOCUMENT

DOCUMENT 00 54 00

ESCROW BID DOCUMENTATION

1. Requirement to Escrow Bid Documentation

- a. Contractor shall submit, within seven (7) days after the date of the Notice of Award, one copy of all documentary information received or generated by Contractor in preparation of bid prices for this Contract, and additional documentary information about the preparation of bid prices as required herein. This material is referred to herein as "Escrow Bid Documentation." The Escrow Bid Documentation of the Contractor will be held in escrow for the duration of the Contract.
- b. Contractor agrees, as a condition of award of the Contract, that the Escrow Bid Documentation constitutes all written information used in the preparation of its bid, and that no other written bid preparation information shall be considered in resolving disputes or claims. Contractor also agrees that nothing in the Escrow Bid Documentation shall change or modify the terms or conditions of the Contract Documents.
- c. The Escrow Bid Documentation will not be opened by District except as indicated herein. The Escrow Bid Documentation will be used only for the resolution of change orders and claims disputes.
- d. Contractor's submission of the Escrow Bid Documentation, as with the bonds and insurance documents required, is considered an essential part of the Contract award. Should the Contractor fail to make the submission within the allowed time specified above, District may deem the Contractor to have failed to enter into the Contract, and the Contractor shall forfeit the amount of its bid security, accompanying the Contractor's bid, and District may award the Contract to the next lowest responsive responsible bidder.
- e. NO PAYMENTS WILL BE MADE, NOR WILL DISTRICT ACCEPT PROPOSED CHANGE ORDERS UNTIL THE ABOVE REQUIRED INFORMATION IS SUBMITTED AND APPROVED.
- f. The Escrow Bid Documentation shall be submitted in person by an authorized representative of the Contractor to the District.

2. Ownership of Escrow Bid Documentation

- a. The Escrow Bid Documentation is, and shall always remain, the property of Contractor, subject to review by District, as provided herein.

- b. The Escrow Bid Documentation constitutes trade secrets (i) not known outside Contractor's business, (ii) known only to a limited extent and only by a limited number of employees of Contractor's business, (iii) safeguarded while in Contractor's possession, (iv) extremely valuable to Contractor, and (v) potentially extremely valuable to Contractor's competitors by virtue of it reflecting Contractor's contemplated techniques of construction. Subject to the provisions herein, District agrees to safeguard the Escrow Bid Documentation, and all information contained therein, against disclosure to the fullest extent permitted by law, except that District shall not be obligated to seek a protective order from a court, or otherwise incur any costs in relation to court proceedings, related to a request for disclosure. In the event that the District is required to participate in a court proceeding related to a request for disclosure of the Escrow Bid Documentation, or in the event that the District is requested by Contractor to participate in such a court proceeding, Contractor shall pay for any and all attorneys' fees and costs incurred by the District in connection with such proceeding.

3. Format and Contents of Escrow Bid Documentation

- a. Contractor may submit Escrow Bid Documentation in its usual cost-estimating format; a standard format is not required. The Escrow Bid Documentation shall be submitted in the language (e.g., English) of the specification.
- b. Escrow Bid Documentation must clearly itemize the estimated costs of performing the work of each bid item contained in the bid schedule, separating bid items into sub-items as required to present a detailed cost estimate and allow a detailed cost review. The Escrow Bid Documentation shall include all subcontractor bids or quotes, supplier bids or quotes, quantity takeoffs, crews, equipment, calculations of rates of production and progress, copies of quotes from subcontractors and suppliers, and memoranda, narratives, add/deduct sheets, and all other information used by the Contractor to arrive at the prices contained in the bid proposal. Estimated costs should be broken down into Contractor's usual estimate categories such as direct labor, repair labor, equipment ownership and operation, expendable materials, permanent materials, and subcontract costs as appropriate. Plant and equipment and indirect costs should be detailed in the Contractor's usual format. The Contractor's allocation of indirect costs, contingencies, markup, and other items to each bid item shall be identified.
- c. All costs shall be identified. For bid items amounting to less than \$10,000, estimated unit costs are acceptable without a detailed cost estimate, provided that labor, equipment, materials, and subcontracts, as applicable, are included and provided that indirect costs, contingencies, and markup, as applicable, are allocated.
- d. Bid Documentation provided by District should not be included in the Escrow Bid Documentation unless needed to comply with the following requirements.

4. Submittal of Escrow Bid Documentation

- a. The Escrow Bid Documentation shall be submitted by the Contractor in a sealed container within seven (7) days after the date of the Notice of Award. The container shall be clearly marked on the outside with the Contractor's name, date of submittal, project name and the words "Escrow Bid Documentation – Intended to be opened in the presence of Authorized Representatives of Both District and Contractor".
- b. By submitting Escrow Bid Documentation, Contractor represents that the material in the Escrow Bid Documentation constitutes all the documentary information used in preparation of the bid and that the Contractor has personally examined the contents of the Escrow Bid Documentation container and has found that the documents in the container are complete.
- c. If Contractor's proposal is based upon subcontracting any part of the work, each subcontractor whose total subcontract price exceeds 5 percent of the total contract price proposed by Contractor, shall provide separate Escrow Documents to be included with those of Contractor. Those documents shall be opened and examined in the same manner and at the same time as the examination described above for Contractor.
- d. If Contractor wishes to subcontract any portion of the Work after award, District retains the right to require Contractor to submit Escrow Documents for the Subcontractor before the subcontract is approved.

5. Storage, Examination and Final Disposition of Escrow Bid Documentation

- a. The Escrow Bid Documentation will be placed in escrow, for the life of the Contract, in a mutually agreeable institution. The cost of storage will be paid by Contractor for the duration of the project until final Contract payment. The storage facilities shall be the appropriate size for all the Escrow Bid Documentation and located conveniently to both District's and Contractor's offices.
- b. The Escrow Bid Documentation shall be examined by both District and Contractor, at any time deemed necessary by either District or Contractor, to assist in the negotiation of price adjustments and change orders or the settlement of disputes and claims. In the case of legal proceedings between District and Contractor, Escrow Bid Documentation shall be used subject to the terms of an appropriate protective order if requested by Contractor and ordered by a court of competent jurisdiction. Examination of the Escrow Bid Documentation is subject to the following conditions:
 - (1) As trade secrets, the Escrow Bid Documentation is proprietary and confidential to the extent allowed by law.

- (2) District and Contractor shall each designate, in writing to the other party seven (7) days prior to any examination, the names of representatives who are authorized to examine the Escrow Bid Documentation. No other person shall have access to the Escrow Bid Documentation.
 - (3) Access to the documents may take place only in the presence of duly designated representatives of the District and Contractor. If Contractor fails to designate a representative or appear for joint examination on seven (7) days notice, then the District representative may examine the Escrow Bid Documents alone upon an additional three (3) days notice if a representative of the Contractor does not appear at the time set.
 - (4) If a subcontractor has submitted sealed information to be included in the Escrow Bid Documents, access to those documents may take place only in the presence of a duly designated representative of the District, Contractor and that subcontractor. If that subcontractor fails to designate a representative or appear for joint examination on seven (7) days notice, then the District representative and/or the Contractor may examine the Escrow Bid Documentation without that subcontractor present upon an additional three (3) days notice if a representative of that subcontractor does not appear at the time set.
- c. The Escrow Bid Documentation will be returned to Contractor at such time as the Contract has been completed and final settlement has been achieved.

END OF DOCUMENT

DOCUMENT 00 54 26

This is a fiduciary account created by statute, Public Contract Code section 22300. The funds deposited in this account shall not be released to Contractor or any other person or entity, other than Owner, including pursuant to any purported lien or writ of attachment or execution, without the prior written, express approval of Owner.

**ESCROW AGREEMENT FOR
SECURITY DEPOSITS IN LIEU OF RETENTION**

This Escrow Agreement is made and entered into by and between the Berryessa Union School District, whose address is 1376 Piedmont Road, San Jose, California 95132 (hereinafter called "Owner"); _____, whose address is _____ (hereinafter called "Contractor"); and _____, a state or federally chartered bank in California whose address is _____ (hereinafter called "Escrow Agent").

For the consideration hereinafter set forth, the Owner, Contractor, and Escrow Agent agree as follows:

1. Pursuant to section 22300 of the Public Contract Code of the State of California, Contractor has the option to deposit securities with Escrow Agent as a substitute for retention earnings required to be withheld by the Owner pursuant to the Contract entered into between the Owner and Contractor in the amount of _____ Dollars (\$_____), and dated _____, _____, (the "Contract"). Alternatively, on written request of the Contractor, the Owner shall make payments of the retention earnings directly to the Escrow Agent. When Contractor deposits the securities as a substitute for retention earnings, the Escrow Agent shall notify the Owner within ten (10) calendar days of the deposit. The market value of the securities at the time of the substitution, as valued by the Owner, shall be at least equal to the cash amount then required to be withheld as retention under the terms of the Contract between the Owner and Contractor. If the Owner determines that the securities are not adequate it will notify Contractor and Escrow Agent, and Contractor shall deposit additional security as further determined by the Owner. Securities shall be held in the name of the Owner and shall designate the Contractor as the beneficial owner.
2. Thereafter, Owner shall make progress payments to the Contractor for such funds which otherwise would be withheld from progress payments pursuant to the Contract provisions, provided that the Escrow Agent holds securities in the form and amount specified above.
3. Pursuant to Public Contract Code section 22300, as an alternative to the procedures set forth above, Contractor may request in writing that the Owner pay

retention amounts directly to Escrow Agent. When the Owner makes payment of retentions earned directly to the Escrow Agent, the Escrow Agent shall hold them for benefit of the Contractor until such time as the escrow created under this Escrow Agreement is terminated. The Contractor may direct the investment of the payments into securities. All terms and conditions of this Escrow Agreement and the rights and responsibilities of the parties shall be equally applicable and binding when the Owner pays the Escrow Agent directly.

4. The Contractor shall be responsible for paying all fees for the expenses incurred by Escrow Agent in administering the Escrow Account and all expenses of the Owner. These expenses and payment terms shall be determined by the Owner, Contractor and Escrow Agent.
5. The interest earned on the securities or the money market accounts held in escrow and all interest earned on that interest shall be for the sole account of Contractor and shall be subject to withdrawal by Contractor at any time and from time to time without notice to the Owner.
6. Contractor shall have the right to withdraw all or any part of the principal in the Escrow Account only by written notice to Escrow Agent accompanied by written authorization from Owner to the Escrow Agent that Owner consents to the withdrawal of the amount sought to be withdrawn by Contractor.
7. The Owner shall have the right to draw upon the securities or any amount paid directly to Escrow Agent in the event of default by the Contractor. Upon seven (7) days written notice to the Escrow Agent from the Owner of the default, the Escrow Agent shall immediately convert the securities to cash and shall distribute the cash, including any amounts paid directly to Escrow Agent pursuant to Section 3 above, as instructed by Owner. Escrow Agent shall not be concerned with the validity of any notice of default given by Owner pursuant to this paragraph, and shall promptly comply with Owner's instructions to pay over said escrowed assets. Escrow Agent further agrees to not interplead the escrowed assets in response to a conflicting demand and hereby waives any present or future opportunity of interpleader.
8. Upon receipt of written notification from the Owner certifying that the Contract is final and complete, and that the Contractor has complied with all requirements and procedures applicable to the Contract, Escrow Agent shall release to Contractor all securities and interest on deposit less escrow fees and charges of the Escrow Account. The escrow shall be closed immediately upon disbursement of all moneys and securities on deposit and payment of fees and charges.
9. Escrow Agent shall rely on the written notifications from the Owner and Contractor pursuant to Sections (4), (5), (6), (7) and (8) of this Agreement and the

Owner and Contractor shall hold Escrow Agent harmless from Escrow Agent's release and disbursement of the securities and interest as set forth above.

10. The names of the persons who are authorized to give written notice or to receive written notice on behalf of the Owner, the Contractor and the Escrow Agent in connection with the foregoing, and exemplars of their respective signatures are as follows:

ON BEHALF OF OWNER:

Signature

Typewritten Name

Title

ON BEHALF OF CONTRACTOR:

Signature

Typewritten Name

Title

ON BEHALF OF ESCROW AGENT:

Signature

Typewritten Name

Title

IN WITNESS WHEREOF, the parties have executed this Agreement by their proper officers on the date first set forth above.

OWNER:

Signature

Typewritten Name

Title

CONTRACTOR:

Signature

Typewritten Name

Title

ESCROW AGENT:

Signature

Typewritten Name

Title

At the time the Escrow Account is opened, the Owner and Contractor shall deliver to the Escrow Agent a fully executed counterpart of this Agreement.

END OF DOCUMENT

DOCUMENT 00 55 00

NOTICE TO PROCEED

Dated: _____, 20__

TO: _____
(Contractor)

ADDRESS: _____

PROJECT: _____

PROJECT/CONTRACT NO.: _____ between the Berryessa Union School District and Contractor (“Contract”).

You are notified that the Contract Time under the above Contract will commence to run on _____, 20__. By that date, you are to start performing your obligations under the Contract Documents. In accordance with the Agreement executed by Contractor, the date of completion is _____, 20__.

You must submit the following documents by 5:00 p.m. of the **TENTH (10TH)** calendar day following the date of this Notice to Proceed:

- a. Contractor’s preliminary schedule of construction.
- b. Contractor’s preliminary schedule of values for all of the Work.
- c. Contractor’s preliminary schedule of submittals, including Shop Drawings, Product Data, and Samples submittals
- d. Contractor’s Safety Plan specifically adapted for the Project.
- e. A complete subcontractors list, including the name, address, telephone number, facsimile number, California State Contractors License number, classification, and monetary value of all Subcontracts.

Thank you. We look forward to a very successful Project.

Berryessa Union School District

BY: _____

NAME: _____

TITLE: _____

END OF DOCUMENT

DOCUMENT 00 61 13.16

PAYMENT BOND
(Labor and Material)

KNOW ALL MEN BY THESE PRESENTS:

That WHEREAS, Berryessa Union School District (the "Owner" of the public works project described below) and _____, hereinafter designated as the "Principal," have entered into a Contract for the furnishing of all materials and labor, services and transportation, necessary, convenient, and proper to construct:

Shade Structures
At
Five Sites

Which said agreement dated _____, 201__, and all of the Contract Documents are hereby referred to and made a part hereof; and

WHEREAS, the Principal is required, before entering upon the performance of the work, to file a good and sufficient bond with the body by whom the Contract is awarded to secure the claims arising under said agreement.

NOW, THEREFORE, THESE PRESENTS WITNESSETH:

That the said Principal and the undersigned _____ ("Surety") are held and firmly bound unto all laborers, material men, and other persons, and bound for all amounts due, referred to in Civil Code section 9554, subdivision (b), in the sum of _____ Dollars (\$_____) which sum well and truly be made, we bind ourselves, our heirs, executors, administrators, successors, or assigns, jointly and severally, by these presents.

The condition of this obligation is that if the said Principal or any of its subcontractors, or the heirs, executors, administrators, successors, or assigns of any, all, or either of them, shall fail to pay any of the persons named in Civil Code section 9100, or any of the amounts due, as specified in Civil Code section 9554, subdivision (b), that said Surety will pay the same in an amount not exceeding the amount hereinabove set forth, and also in case suit is brought upon this bond, will pay costs and reasonable attorney's fees to be awarded and fixed by the Court, and to be taxed as costs and to be included in the judgment therein rendered.

It is hereby expressly stipulated and agreed that this bond shall inure to the benefit of any and all persons, companies, and corporations entitled to file claims so as to give a right of action to them or their assigns in any suit brought upon this bond.

Should the condition of this bond be fully performed, then this obligation shall become null and void, otherwise it shall be and remain in full force and effect.

And the said Surety, for value received, thereby stipulates and agrees that no change, extension of time, alteration, or addition to the terms of said contract or the specifications accompanying the same shall in any manner affect its obligations on this bond, and it does hereby waive notice of any such change, extension, alteration, or addition.

IN WITNESS WHEREOF, this instrument has been duly executed by the Principal and Surety this _____ day of _____, 201__.

(To be signed by)
(Principal and Surety,)
(and acknowledged and)
(Notarial Seal attached)

Principal

Surety

By: _____
Attorney-in-Fact

The above bond is accepted and approved this ____ day of _____.

END OF DOCUMENT

DOCUMENT 00 61 13.13

PERFORMANCE BOND

KNOW ALL MEN BY THESE PRESENTS that we, _____
_____ as Principal and
_____ as Surety, are held and
firmly bound unto Berryessa Union School District, in the County of Santa Clara, State of
California (“Owner”) in the sum of _____ Dollars
(\$_____) for the payment of which sum well and truly made, we bind
ourselves, our heirs, executors, administrators, and successors, jointly and severally, to
the Owner for the full performance of a certain contract with the Owner, the terms of
which are incorporated herein by reference, dated _____, 201__, for
construction of:

**Shade Structures
At
Five Sites**

The condition of this obligation is such that, if the Principal shall well and truly perform and fulfill all the undertakings, covenants, terms, conditions, and agreements of said Contract during the original term of said Contract and any extensions thereof that may be granted by the Owner, with or without notice to the Surety, and for the period of time specified in the Contract after completion for correction of faulty or improper materials and workmanship and during the life of any guaranty or warranty required under the Contract, and shall also well and truly perform and fulfill all the undertakings, covenants, terms, conditions and agreement of any and all duly authorized modifications of said Contract that may hereafter be made, then this obligation is to be void, otherwise to remain in full force and virtue.

And the said Surety, for value received, hereby stipulates and agrees that no change, extension of time, alteration or addition to the terms of the Contract or to the Work to be performed thereunder or the specifications accompanying the same, shall in any way affect its obligation on this bond, and it does hereby waive notice of any such change, extension of time, alteration or addition to the terms of the Contract, or to the Work, or to the specifications.

No further agreement between Surety and Owner shall be required as a prerequisite to the Surety performing its obligations under this bond.

IN WITNESS WHEREOF, the above-bounden parties have executed this instrument under their several seals this _____ day of _____, 201__ hereto affixed and these presents duly signed by its undersigned representative, pursuant to authority of its governing body.

(To be signed by _____)
(Principal and Surety, _____)
(and acknowledged and _____)
(Notarial Seal attached _____)

(Affix Corporate Seal)

(Individual Principal)

(Business Address)

(Affix Corporate Seal)

(Corporate Principal)

(Business Address)

(Affix Corporate Seal)

(Corporate Surety)

(Business Address)

By: _____

The rate of premium on this bond is _____ per thousand.

The total amount of premium charged is _____.

The above must be filled in by Corporate Surety.

END OF DOCUMENT

DOCUMENT 00 72 00

GENERAL CONDITIONS

for

CONTRACT OF CONSTRUCTION

Shade Structures

At

Five Sites

BERRYESSA UNION SCHOOL DISTRICT

10/9/2020

SUMMARY OF CONTENTS

ARTICLE 1: GENERAL CONDITIONS1

ARTICLE 2: OWNER.....6

ARTICLE 3: THE CONTRACTOR.....10

ARTICLE 4: ADMINISTRATION OF THE CONTRACT26

ARTICLE 5: SUBCONTRACTORS41

ARTICLE 6: CONSTRUCTION BY OWNER OR BY SEPARATE CONTRACTORS.....47

ARTICLE 7: CHANGES IN THE WORK49

ARTICLE 8: TIME.....57

ARTICLE 9: PAYMENTS AND COMPLETION61

ARTICLE 10: PROTECTION OF PERSONS AND PROPERTY71

ARTICLE 11: INSURANCE AND BONDS77

ARTICLE 12: UNCOVERING AND CORRECTION OF WORK.....82

ARTICLE 13: MISCELLEOUS PROVISIONS84

ARTICLE 14: TERMINATION OR SUSPENSION OF THE CONTRACT.....96

TABLE OF CONTENTS

ARTICLE 1	1	2.2 INFORMATION AND SERVICES	
GENERAL CONDITIONS	1	REQUIRED OF THE OWNER.....	6
1.1 BASIC DEFINITIONS	1	2.2.1 INTENTIONALLY LEFT BLANK	6
1.1.1 THE CONTRACT DOCUMENTS.....	1	2.2.2 SITE SURVEY	7
1.1.2 THE CONTRACT.....	1	2.2.3 SOILS.....	7
1.1.3 THE WORK	1	2.2.3.1 <i>Owner Furnished Services</i>	7
1.1.4 THE PROJECT	2	2.2.3.2 <i>Contractor Reliance</i>	7
1.1.5 THE DRAWINGS.....	2	2.2.4 UTILITY SURVEY	7
1.1.6 THE SPECIFICATIONS.....	2	2.2.5 INFORMATION.....	7
1.1.7 THE PROJECT MANUAL	2	2.2.6 EXISTING UTILITY LINES; REMOVAL,	
1.1.8 OR 2		RELOCATION	8
1.1.9 COMPLETION OR COMPLETE.....	2	2.2.6.1 <i>Removal, Relocation</i>	8
1.2 EXECUTION, CORRELATION AND		2.2.6.2 <i>Assessment</i>	8
INTENT 3		2.2.6.3 <i>Notification</i>	8
1.2.1 CORRELATION AND INTENT.....	3	2.2.6.4 <i>Underground Utility Clearance</i>	8
1.2.1.1 <i>Documents Complementary and</i>		2.2.7 EASEMENTS	8
1.2.1.1.1 <i>Inclusive 3</i>		2.2.8 REASONABLE PROMPTNESS	8
1.2.1.1.2 <i>Coverage of the Drawings and</i>		2.2.9 COPIES FURNISHED.....	9
1.2.1.1.2.1 <i>Specifications</i>	3	2.2.10 DUTIES CUMULATIVE.....	9
1.2.1.1.2.2 <i>Conflicts</i>	3	2.3 OWNER’S RIGHT TO STOP THE	
1.2.1.1.2.3 <i>Conformance With Laws</i>	3	WORK 9	
1.2.1.1.2.4 <i>Ambiguity</i>	4	2.4 OWNER’S RIGHT TO CARRY OUT	
1.2.1.1.2.5 <i>Execution</i>	4	THE WORK.....	9
1.2.2 ADDENDA AND DEFERRED APPROVALS	4	ARTICLE 3	10
1.2.2.1 <i>Addenda</i>	4	THE CONTRACTOR.....	10
1.2.2.2 <i>Deferred Approvals</i>	4	3.1 DEFINITION	10
1.2.3 SPECIFICATION INTERPRETATION	4	3.2 SUPERVISION AND CONSTRUCTION	
1.2.3.1 <i>Titles</i>	5	PROCEDURES.....	10
1.2.3.2 <i>As Shown, Etc</i>	5	3.2.1 CONTRACTOR	10
1.2.3.3 <i>Provide</i>	5	3.2.2 CONTRACTOR RESPONSIBILITY	10
1.2.3.4 <i>General Conditions</i>	5	3.2.3 OBLIGATIONS NOT CHANGED BY	
1.2.3.5 <i>Abbreviations</i>	5	ARCHITECT’S ACTIONS	10
1.2.3.6 <i>Plural</i>	5	3.2.4 CONTRACTOR RESPONSIBILITY FOR	
1.2.3.7 <i>Metric</i>	5	READINESS FOR WORK.....	10
1.2.3.8 <i>Standard Specifications</i>	5	3.2.5 PROJECT MEETINGS.....	11
1.2.3.9 <i>Absence of Modifiers</i>	5	3.3 SUPERINTENDENT	11
1.3 OWNERSHIP AND USE OF		3.3.1 FULL TIME SUPERINTENDENT.....	11
ARCHITECT’S DRAWINGS,		3.3.2 STAFF	11
SPECIFICATIONS AND OTHER		3.3.3 RIGHT TO REMOVE	11
DOCUMENTS	6	3.4 LABOR AND MATERIALS	11
ARTICLE 2	6	3.4.1 CONTRACTOR TO PROVIDE	11
OWNER 6		3.4.2 QUALITY	11
2.1 DEFINITION.....	6	3.4.3 REPLACEMENT.....	12

3.4.4 DISCIPLINE	12	3.11.4.2 <i>Two or More Products Specified</i>	21
3.5 WARRANTY.....	12	3.11.4.3 <i>Substitution Request Form</i>	21
3.6 TAXES	12	3.11.4.4 <i>List of Manufacturers and Products</i>	
3.7 PERMITS, FEES AND NOTICES.....	12	<i>Required</i>	21
3.7.1 PAYMENT	12	3.11.5 DEFERRED APPROVALS	22
3.7.2 COMPLIANCE.....	13	3.12 CUTTING AND PATCHING	22
3.7.3 CONTRACT DOCUMENTS	13	3.12.1 SCOPE	22
3.7.4 RESPONSIBILITY	13	3.12.2 CONSENT.....	22
3.8.1 CONTRACT	13	3.12.3 STRUCTURAL MEMBERS	22
3.8.2 SCOPE	13	3.12.4 Subsequent Removal.....	22
3.8.2.1 <i>Prompt Selection</i>	13	3.13 CLEANING UP	23
3.8.2.2 <i>Cost</i>	13	3.13.1 CONTRACTOR’S RESPONSIBILITY	23
3.8.2.3 <i>Cost Included in Contract Sum</i> ..	13	3.13.2 FAILURE TO CLEANUP	23
3.8.2.4 <i>Contract Sum Adjustment</i>	14	3.13.3 CONSTRUCTION BUILDINGS	23
3.9 CONTRACTOR’S CONSTRUCTION		3.14 ACCESS TO WORK.....	23
SCHEDULES	14	3.15 ROYALTIES AND PATENTS	23
3.9.1 Requirements.....	14	3.15.1 PAYMENT AND INDEMNITY	23
3.9.2 DSA OVERSIGHT PROCESS.....	16	3.15.2 REVIEW.....	24
3.9.3 FAILURE TO MEET REQUIREMENTS	16	3.16 INDEMNIFICATION	24
3.10 DOCUMENTS AND SAMPLES AT		3.16.1 SCOPE: CONTRACTOR	24
THE SITE	17	3.16.2 SCOPE: SUBCONTRACTORS.....	24
3.11 SHOP DRAWINGS, PRODUCT DATA,		3.16.2.1 <i>Indemnity</i>	25
AND SAMPLES.....	17	3.16.2.2 <i>Joint and Several Liability</i>	25
3.11.1 SUBMITTALS DEFINED	17	3.16.3 No LIMITATION.....	25
3.11.1.1 <i>Shop Drawings</i>	17	3.17 OWNER AS INTENDED	
3.11.1.2 <i>Samples</i>	17	BENEFICIARY	25
3.11.1.3 <i>Contractor’s Responsibility</i>	17	3.18 NOTICE OF EXCUSE FOR	
3.11.1.4 <i>Extent of Review</i>	18	NONPERFORMANCE	26
3.11.2 DRAWING SUBMISSION PROCEDURE...18		ARTICLE 4.....	26
3.11.2.1 <i>Transmittal Letter and Other</i>		ADMINISTRATION OF THE CONTRACT	26
<i>Requirements</i>	18	4.1 ARCHITECT.....	26
3.11.2.2 <i>Copies Required</i>	19	4.1.1 DEFINITION.....	26
3.11.2.3 <i>Corrections</i>	19	4.1.2 MODIFICATION	26
3.11.2.4 <i>Approval Prior to Commencement</i>		4.1.3 TERMINATION.....	26
<i>of Work</i>	19	4.2 ARCHITECT’S ADMINISTRATION OF	
3.11.3 SAMPLE SUBMISSIONS PROCEDURE19		THE CONTRACT.....	27
3.11.3.1 <i>Samples Required</i>	19	4.2.1 STATUS.....	27
3.11.3.2 <i>Labels and Instructions</i>	19	4.2.2 SITE VISITS.....	27
3.11.3.3 <i>Architect’s Review</i>	20	4.2.3 LIMITATIONS OF CONSTRUCTION	
3.11.3.4 <i>Record Drawings and Annotated</i>		RESPONSIBILITY	27
<i>Specifications</i>	20	4.2.4 COMMUNICATIONS FACILITATING	
3.11.3.5 <i>Equipment Manuals</i>	20	CONTRACT ADMINISTRATION	27
3.11.3.6 <i>Owner’s Property</i>	20	4.2.5 PAYMENT APPLICATIONS	27
3.11.4 SUBSTITUTIONS	20	4.2.6 REJECTION OF WORK.....	27
3.11.4.1 <i>One Product Specified</i>	21	4.2.7 CHANGE ORDERS	28

4.2.8 WARRANTIES UPON COMPLETION	28	4.5.9.1 Trenches or Excavations Less Than Four Feet Below the Surface	39
4.2.9 INTERPRETATION.....	28	4.5.9.2 Trenches or Excavations Greater Than Four Feet Below the Surface	39
4.2.10 ADDITIONAL INSTRUCTIONS	28	4.5.10 INJURY OR DAMAGE TO PERSON OR PROPERTY	40
4.2.10.1 Architect’s Interpretations and Decisions	28	ARTICLE 5.....	40
4.2.10.2 Typical Parts and Sections	28	SUBCONTRACTORS.....	40
4.2.10.3 Dimensions	29	5.1 DEFINITIONS	40
4.3 INSPECTOR OF RECORD.....	29	5.1.1 SUBCONTRACTOR	40
4.3.1 GENERAL	29	5.1.2 SUB-SUBCONTRACTOR	40
4.3.2 INSPECTOR’S OF RECORD’S DUTIES	29	5.1.3 SPECIALTY CONTRACTORS	40
4.3.3 INSPECTOR OF RECORD’S AUTHORITY TO REJECT OR STOP WORK	29	5.2 AWARD OF SUBCONTRACTS AND OTHER CONTRACTS FOR PORTIONS OF THE WORK.....	40
4.3.4 INSPECTOR OF RECORD’S FACILITIES	29	5.2.1 ASSIGNMENT OR SUBSTITUTION - CONSENT OF OWNER.....	41
4.4 RESPONSIBILITY FOR ADDITIONAL CHARGES INCURRED BY THE OWNER FOR PROFESSIONAL SERVICES.....	30	5.2.2 GROUNDS FOR SUBSTITUTION	41
4.5 NOTICES OF POTENTIAL CHANGE, CHANGE ORDER REQUESTS, AND CLAIMS 30		5.2.2.1 No Change in Contract	42
4.5.1 NOTICE OF POTENTIAL CHANGE	31	5.2.2.2 Substitution Due to Clerical Error.....	42
4.5.2 CHANGE ORDERS REQUESTS.....	31	5.3 SUBCONTRACTUAL RELATIONS.	42
4.5.3 DEFINITION OF CLAIM.....	32	5.4 CONTINGENT ASSIGNMENT OF SUBCONTRACTS	43
4.5.4 TIME FOR SUBMITTING CLAIM; WAIVER 33		5.5 SUBCONTRACTOR’S RESPONSIBILITIES.....	43
4.5.5 CONTENT OF CLAIM	33	5.5.1 SUPERVISION BY SUBCONTRACTORS	43
4.5.5.1 Claim Format; Waiver.....	33	5.5.2 DISCIPLINE AND ORDER	43
4.5.5.2 Claims for Additional Money.....	35	5.5.3 DEFECTS DISCOVERED	44
4.5.5.3 Claims for Additional Time	35	5.5.4 SUBCONTRACTOR INFORMATION.....	44
4.5.5.3.1 Notice of Extent of Claim.....	35	5.5.5 TEMPORARY STRUCTURES.....	44
4.5.5.3.2 Unusually Severe Weather Claims	35	5.5.6 CHARGES TO SUBCONTRACTOR	44
4.5.5.4 Pass Through Claims.....	36	5.5.7 FINES IMPOSED	44
4.5.6 PROCEDURES FOR CLAIMS LESS THAN OR EQUAL TO \$375,000 (PUBLIC CONTRACT CODE SECTION 20104.2).....	36	5.5.8 PROJECT SIGNS	45
4.5.6.1 Claims for Less Than \$50,000.....	36	5.5.9 REMEDIES FOR FAILURE TO PERFORM ..	45
4.5.6.2 Claims Over \$50,000 and Less Than or equal to \$375,000	37	5.5.10 DISPUTES NOT TO AFFECT WORK.....	45
4.5.6.3 Meet and Confer	37	5.5.11 APPLICATION FOR PAYMENT.....	45
4.5.6.4 Government Code Claim	38	5.5.12 COMPLIANCE WITH PROCEDURES.....	46
4.5.7 PROCEDURES FOR CLAIMS OVER \$375,000 38		5.5.13 ON-SITE RECORD KEEPING.....	46
4.5.8 CONTINUING CONTRACT PERFORMANCE 38		5.5.14 NON-EXCLUSIVE OBLIGATIONS	46
4.5.9 CLAIMS FOR CONCEALED OR UNKNOWN CONDITIONS	39	ARTICLE 6.....	46
		CONSTRUCTION BY OWNER OR BY SEPARATE CONTRACTORS	46
		6.1 OWNER’S RIGHT TO PERFORM CONSTRUCTION AND TO AWARD SEPARATE CONTRACTS.....	46

6.1.1 OWNER’S RIGHTS.....	46
6.1.2 DESIGNATION AS CONTRACTOR.....	47
6.1.3 CONTRACTOR DUTIES.....	47
6.1.4 OWNER OBLIGATIONS.....	47
6.2 MUTUAL RESPONSIBILITY.....	47
6.2.1 DELIVERY AND STORAGE.....	47
6.2.2 NOTICE BY CONTRACTOR.....	47
6.2.3 COSTS INCURRED.....	48
6.2.4 CORRECTION OF DAMAGE.....	48
6.3 OWNER’S RIGHT TO CLEAN UP	48
ARTICLE 7.....	48
CHANGES IN THE WORK.....	48
7.1 CHANGES.....	48
7.1.1 NO CHANGES WITHOUT AUTHORIZATION	48
7.1.2 AUTHORITY TO ORDER MINOR CHANGES	49
7.2 CHANGE ORDERS.....	49
7.3 CONSTRUCTION CHANGE	
DIRECTIVES (“CCD”).....	50
7.3.1 DEFINITION.....	50
7.3.2 USE TO DIRECT CHANGE.....	50
7.4 REQUEST FOR INFORMATION	
(“RFI”) 50	
7.4.1 DEFINITION.....	50
7.4.2 SCOPE.....	50
7.4.3 RESPONSE TIME.....	50
7.4.4 COSTS INCURRED.....	51
7.5 REQUEST FOR PROPOSAL (“RFP”) 51	
7.5.1 DEFINITION.....	51
7.5.2 SCOPE.....	51
7.6 CHANGE ORDER REQUEST (“COR”)	
51	
7.6.1 DEFINITION.....	51
7.6.2 CHANGES IN PRICE.....	51
7.6.3 CHANGES IN TIME.....	52
7.7 PRICE OF CHANGE ORDERS.....	52
7.7.1 SCOPE.....	52
7.7.2 DETERMINATION OF COST.....	52
7.7.3 FORMAT FOR PROPOSED COST CHANGE	54
7.7.4 DISCOUNTS, REBATES, AND REFUNDS ..	56
7.7.5 ACCOUNTING RECORDS.....	56
7.7.6 NOTICE REQUIRED.....	56
7.7.7 APPLICABILITY TO SUBCONTRACTORS ..	56

7.8 WAIVER OF RIGHT TO CLAIM MONEY OR	
TIME 56	
ARTICLE 8.....	56
TIME 56	
8.1 DEFINITIONS.....	56
8.1.1 CONTRACT TIME.....	56
8.1.2 NOTICE TO PROCEED.....	56
8.1.3 DAYS.....	57
8.2 HOURS OF WORK.....	57
8.2.1 SUFFICIENT FORCES.....	57
8.2.2 PERFORMANCE DURING WORKING HOURS	
57	
8.2.3 LABOR CODE APPLICATION.....	57
8.2.4 COSTS FOR AFTER HOURS INSPECTIONS	58
8.2.5 TIME FOR COMMENCEMENT BY	
SUBCONTRACTORS.....	58
8.3 PROGRESS AND COMPLETION.....	58
8.3.1 TIME OF THE ESSENCE.....	58
8.3.2 NO COMMENCEMENT WITHOUT	
INSURANCE.....	58
8.3.3 EXPEDITIOUS COMPLETION.....	58
8.4 EXTENSIONS OF TIME -	
LIQUIDATED DAMAGES.....	59
8.4.1 CONDITIONS ALLOWING FOR EXTENSIONS	
OF TIME TO COMPLETE THE WORK ONLY	
(EXCUSABLE DELAY).....	59
8.4.2 COMPENSABLE DELAY (TIME AND	
MONEY) 59	
8.4.3 NOTICE BY CONTRACTOR REQUIRED;	
PROCEDURES FOR DEMANDING ADDITIONAL	
TIME OR MONEY.....	59
8.4.4 EARLY COMPLETION.....	59
8.4.5 LIQUIDATED DAMAGES.....	60
8.5 GOVERNMENT APPROVALS.....	60
ARTICLE 9.....	61
PAYMENTS AND COMPLETION.....	61
9.1 CONTRACT SUM.....	61
9.2 COST BREAKDOWN.....	61
9.2.1 REQUIRED INFORMATION.....	61
9.2.2 OWNER ACCEPTANCE REQUIRED.....	61
9.3 APPLICATIONS FOR PAYMENT....	62
9.3.1 PROCEDURE.....	62
9.3.2 PURCHASE OF MATERIALS AND	
EQUIPMENT.....	63
9.3.3 WARRANTY OF TITLE.....	63

9.4	REVIEW OF PROGRESS PAYMENT	63	10.2.1	THE CONTRACTOR	72
	63		10.2.2	CONTRACTOR NOTICES	72
9.4.1	OWNER ACCEPTANCE	63	10.2.3	SAFETY BARRIERS AND SAFEGUARDS	72
9.4.2	OWNER’S REVIEW	63	10.2.4	USE OR STORAGE OF HAZARDOUS	
9.5	DECISIONS TO WITHHOLD		MATERIAL		72
	PAYMENT	64	10.2.5	FINGERPRINTING	72
9.5.1	REASONS TO WITHHOLD PAYMENT	64	10.3	PROTECTION OF WORK AND	
9.5.2	PAYMENT AFTER CURE	66		PROPERTY	73
9.5.3	OVERPAYMENT AND/OR FAILURE TO		10.3.1	PROTECTION OF WORK	73
	WITHHOLD	66	10.3.2	PROTECTION FOR ELEMENTS	73
9.6	PROGRESS PAYMENTS	66	10.3.3	SHORING AND STRUCTURAL LOADING	73
9.6.1	PAYMENTS TO CONTRACTOR	66	10.3.4	CONFORMANCE WITHIN ESTABLISHED	
9.6.2	PAYMENTS TO SUBCONTRACTORS	67		LIMITS	73
9.6.3	PERCENTAGE OF COMPLETION OR		10.3.5	SUBCONTRACTOR ENFORCEMENT OF	
	PAYMENT INFORMATION	67		RULES	73
9.6.4	NO OBLIGATION OF OWNER FOR		10.3.6	SITE ACCESS	74
	SUBCONTRACTOR PAYMENT	67	10.3.7	PROTECTION OF MATERIALS	74
9.6.5	PAYMENT TO SUPPLIERS	67	10.4	EMERGENCIES	74
9.6.6	PAYMENT NOT CONSTITUTING APPROVAL		10.4.1	EMERGENCY ACTION	74
	OR ACCEPTANCE	67	10.4.2	ACCIDENT REPORTS	74
9.6.7	JOINT CHECKS	68	10.5	HAZARDOUS MATERIALS	74
9.7	COMPLETION OF THE WORK	68	10.5.1	DISCOVERY OF HAZARDOUS MATERIALS	
9.7.1	CLOSE-OUT PROCEDURES	68		74	
9.7.2	COSTS OF MULTIPLE INSPECTIONS	68	10.5.2	HAZARDOUS MATERIAL WORK	
9.8	PARTIAL OCCUPANCY OR USE	68		LIMITATIONS	75
9.9	FINAL PROGRESS PAYMENT AND		10.5.3	INDEMNIFICATION BY OWNER FOR	
	RELEASE OF RETENTION	69		HAZARDOUS MATERIAL NOT CAUSED BY	
9.9.1	FINAL APPLICATION FOR PROGRESS		CONTRACTOR		75
	PAYMENT	69	10.5.4	INDEMNIFICATION BY CONTRACTOR FOR	
9.9.2	PROCEDURES FOR APPLICATION FOR FINAL			HAZARDOUS MATERIAL CAUSED BY	
	PROGRESS PAYMENT	69	CONTRACTOR		75
9.9.3	RELEASE OF RETAINAGE	70	10.5.5	TERMS OF HAZARDOUS MATERIAL	
9.10	SUBSTITUTION OF SECURITIES	70		PROVISION	75
ARTICLE 10		71	10.5.6	ARCHEOLOGICAL MATERIALS	76
PROTECTION OF PERSONS AND			ARTICLE 11		76
PROPERTY		71	INSURANCE AND BONDS		76
10.1	SAFETY PRECAUTIONS AND		11.1	CONTRACTOR’S LIABILITY	
	PROGRAMS	71		INSURANCE	76
10.1.1	CONTRACTOR RESPONSIBILITY	71	11.1.1	LIABILITY INSURANCE REQUIREMENTS	
10.1.2	SUBCONTRACTOR RESPONSIBILITY	71		76	
10.1.3	COOPERATION	71	11.1.2	SUBCONTRACTOR INSURANCE	
10.1.4	ACCIDENT REPORTS	71		REQUIREMENTS	77
10.1.5	FIRST-AID SUPPLIES AT SITE	72	11.1.3	OWNER’S INSURANCE	77
10.2	SAFETY OF PERSONS AND		11.1.4	ADDITIONAL INSURED ENDORSEMENT	
	PROPERTY	72		REQUIREMENTS	77

11.1.5 WORKERS' COMPENSATION INSURANCE 78	13.5.1 COMPLIANCE..... 84
11.1.6 BUILDER'S RISK/78	13.5.2 INDEPENDENT TESTING LABORATORY 84
11.1.6.1 COURSE-OF-CONSTRUCTION INSURANCE REQUIREMENTS78	13.5.3 ADVANCE NOTICE TO INSPECTOR OF RECORD 84
11.1.7 CONSENT OF INSURER FOR PARTIAL OCCUPANCY OR USE.....79	13.5.4 TESTING OFF-SITE 84
11.1.8 FIRE INSURANCE.....79	13.5.5 ADDITIONAL TESTING OR INSPECTION 84
11.1.9 OTHER INSURANCE79	13.5.6 COSTS FOR RETESTING..... 85
11.1.10 PROOF OF CARRIAGE OF INSURANCE 79	13.5.7 COSTS FOR PREMATURE TEST 85
11.1.11 COMPLIANCE80	13.5.8 TESTS OR INSPECTIONS NOT TO DELAY WORK 85
11.2 PERFORMANCE AND PAYMENT BONDS 80	13.6 [INTENTIONALLY LEFT BLANK] . 85
11.2.1 BOND REQUIREMENTS80	13.7 TRENCH EXCAVATION 85
11.2.2 SURETY QUALIFICATION.....80	13.7.1 TRENCHES GREATER THAN FIVE FEET 85
ARTICLE 1281	13.7.2 EXCAVATION SAFETY 85
UNCOVERING AND CORRECTION OF WORK 81	13.7.3 NO TORT LIABILITY OF OWNER 86
12.1 UNCOVERING OF WORK81	13.7.4 NO EXCAVATION WITHOUT PERMITS. 86
12.1.1 UNCOVERING WORK FOR REQUIRED INSPECTIONS81	13.8 WAGE RATES..... 86
12.1.2 COSTS FOR INSPECTIONS NOT REQUIRED 81	13.8.1 WAGE RATES 86
12.2 CORRECTION OF WORK; WARRANTY81	13.8.2 HOLIDAY AND OVERTIME PAY 86
12.2.1 CORRECTION OF REJECTED WORK.....81	13.8.3 WAGE RATES NOT AFFECTED BY SUBCONTRACTS 86
12.2.2 REMOVAL OF NONCONFORMING WORK 81	13.8.4 CHANGE IN PREVAILING WAGE DURING BID OR CONSTRUCTION..... 86
12.2.3 OWNER'S RIGHTS IF CONTRACTOR FAILS TO CORRECT81	13.8.5 FORFEITURE AND PAYMENTS 87
12.2.4 COST OF CORRECTING THE WORK82	13.8.6 MINIMUM WAGE RATES 87
12.2.5 WARRANTY CORRECTIONS82	13.8.7 PER DIEM WAGES 87
12.2.6 No TIME LIMITATION82	13.8.8 POSTING OF WAGE RATES 87
12.3 NONCONFORMING WORK83	13.9 RECORD OF WAGES PAID: INSPECTION 87
ARTICLE 1383	13.9.1 APPLICATION OF LABOR CODE..... 87
MISCELLANEOUS PROVISIONS.....83	13.10 APPRENTICES..... 90
13.1 GOVERNING LAW83	13.10.1 APPRENTICE WAGES AND DEFINITIONS 90
13.2 SUCCESSORS AND ASSIGNS.....83	13.10.2 APPRENTICE LABOR POOL..... 90
13.3 WRITTEN NOTICE83	13.10.3 JOURNEYMAN/APPRENTICE RATIO; COMPUTATION OF HOURS 90
13.4 RIGHTS AND REMEDIES83	13.10.4 JOURNEYMAN/APPRENTICE RATIO 91
13.4.1 DUTIES AND OBLIGATIONS CUMULATIVE 83	13.10.4.1 <i>Apprenticeable Craft or Trade</i> .. 91
13.4.2 No WAIVER84	13.10.5 RATIO EXEMPTION 92
13.5 TESTS AND INSPECTIONS84	13.10.6 APPRENTICE FUND 92
	13.10.7 PRIME CONTRACTOR COMPLIANCE 92
	13.10.8 DECISIONS OF JOINT APPRENTICESHIP COMMITTEE 92
	13.10.9 NO BIAS 93

13.10.10 VIOLATION OF LABOR CODE.....	93	14.2.3 PAYMENTS WITHHELD	96
13.11 ASSIGNMENT OF ANTITRUST CLAIMS	94	14.2.4 PAYMENTS UPON COMPLETION	96
13.11.1 APPLICATION	94	14.2.5 INCLUSION OF TERMINATION FOR CONVENIENCE.....	96
13.11.2 ASSIGNMENT OF CLAIM	94	14.3 SUSPENSION OR TERMINATION BY THE OWNER FOR CONVENIENCE.....	97
13.12 AUDIT	94	14.3.1 SUSPENSION BY OWNER	97
13.13 STORM WATER DISCHARGE PERMIT 94		14.3.1.1 <i>Adjustments</i>	97
ARTICLE 14	95	14.3.1.2 <i>Adjustments for Fixed Cost</i>	97
TERMINATION OR SUSPENSION OF THE CONTRACT	95	14.3.2 TERMINATION BY THE OWNER FOR CONVENIENCE.....	97
14.1 TERMINATION BY THE CONTRACTOR FOR CAUSE.....	95	14.4 NOT A WAIVER	97
14.2 TERMINATION BY THE OWNER FOR CAUSE	95	14.5 MUTUAL TERMINATION FOR CONVENIENCE	97
14.2.1 GROUNDS FOR TERMINATION	95	14.6 EARLY TERMINATION	98
14.2.2 NOTIFICATION OF TERMINATION	96		

ARTICLE 1

GENERAL CONDITIONS

1.1 BASIC DEFINITIONS

1.1.1 THE CONTRACT DOCUMENTS

The “Contract Documents” consist of the Agreement between Owner and Contractor (hereinafter the Agreement), Conditions of the Contract (General, Supplementary and other Conditions), Drawings, Specifications, addenda issued prior to bid, Instructions to Bidders, Notice to Bidders, the Bid Form, Payment Bond, Performance Bond, required insurance certificates, additional insured endorsement and declarations page, Designation of Subcontractors, Noncollusion Declaration, Roof Project Certification (where applicable), Sufficient Funds Declaration (Labor Code section 2810) and the Fingerprinting Notice and Acknowledgment and Independent Contractor Student Contact Form, other documents referred to in the Agreement, and Modifications issued after execution of the Agreement. A Modification is a written amendment to the Contract signed by both parties, a Change Order, a Construction Change Directive, or a written order for a minor change in the Work issued by the Owner. The Contract Documents are complementary, and each obligation of the Contractor, Subcontractors, material or equipment suppliers in any one shall be binding as if specified in all.

1.1.2 THE CONTRACT

The Contract Documents form the Contract. The “Contract” represents the entire and integrated agreement between the parties hereto and supersedes prior negotiations, representations, or agreements, either written or oral. The Contract may be amended or modified only by a written Modification. The Contract Documents shall not be construed to create a contractual relationship of any kind between the Architect and Contractor, between the Owner and any Subcontractor or Sub-subcontractor, or between any persons or entities other than the Owner and the Contractor. The terms of the Contract shall not be waived, altered, modified, supplemented or amended in any manner whatsoever except by written agreement signed by the parties and approved or ratified by the Governing Board.

1.1.3 THE WORK

The “Work” shall include all labor, materials, services and equipment necessary for the Contractor to fulfill all of its obligations pursuant to the Contract Documents, including but not limited to punch list items. It shall include the initial obligation of any Contractor or Subcontractor, who performs any portion of the Work, to visit the Site of the proposed Work with Owner’s representatives, a continuing obligation after the commencement of the Work to fully acquaint and familiarize itself with the conditions as they exist and the character of the operations to be carried on under the Contract Documents, and make such investigation as it may see fit so that it shall fully understand the facilities, physical conditions, and restrictions attending the Work under the Contract Documents. Each such Contractor or Subcontractor shall also thoroughly examine and become familiar with the Drawings, Specifications, and associated

bid documents. The “Site” refers to the grounds of the Project as defined in the Contract Documents and such adjacent lands as may be directly affected by the performance of the Work. The Work shall constitute a “work of improvement” under Civil Code section 8050 and Public Contract Code section 7107.

1.1.4 THE PROJECT

The “Project” is the total construction of the Work performed in accordance with the Contract Documents in whole or in part and which may include construction by the Owner or by separate contractors.

1.1.5 THE DRAWINGS

The “Drawings” are graphic and pictorial portions of the Contract Documents prepared for the Project and approved changes thereto, wherever located and whenever issued, showing the design, location, and scope of the Work, generally including plans, elevations, sections, details, schedules, and diagrams as drawn or approved by the Architect.

1.1.6 THE SPECIFICATIONS

The “Specifications” are that portion of the Contract Documents consisting of the written requirements for material, equipment, construction systems, instructions, quality assurance standards, workmanship, and performance of related services.

1.1.7 THE PROJECT MANUAL

The “Project Manual” is the volume usually assembled for the Work which may include, without limitation, the bidding requirements, sample forms, Agreement, Conditions of the Contract, and Specifications.

1.1.8 OR

“Or” shall include “and/or.”

1.1.9 COMPLETION OR COMPLETE

Statutory definitions of “completion” and “complete” shall apply for those statutory purposes. For accrual of liquidated damages, Claim and warranty purposes, “completion” and “complete” mean the point in the Project where (1) Contractor has fully and correctly performed all Work in all parts and requirements, including corrective and punch list work, and (2) Owner’s representatives have conducted a final inspection that confirmed this performance. Substantial, or any other form of partial or non-compliant, performance of the Work shall not constitute “completion” or “complete” under the Contract Documents.

1.2 EXECUTION, CORRELATION AND INTENT

1.2.1 CORRELATION AND INTENT

1.2.1.1 Documents Complementary and Inclusive. The Contract Documents are complementary and are intended to include all items required for the proper execution and completion of the Work. Any item of work mentioned in the Specifications and not shown on the Drawings, or shown on the Drawings and not mentioned in the Specifications, shall be provided by Contractor as if shown or mentioned in both.

1.2.1.2 Coverage of the Drawings and Specifications. The Drawings and Specifications generally describe the work to be performed by Contractor. Generally, the Specifications describe work which cannot be readily indicated on the Drawings and indicate types, qualities, and methods of installation of the various materials and equipment required for the Work. It is not intended to mention every item of Work in the Specifications, which can be adequately shown on the Drawings, or to show on the Drawings all items of Work described or required by the Specifications even if they are of such nature that they could have been shown. All materials or labor for Work, which is shown on the Drawings or the Specifications (or is reasonably inferable therefrom as being necessary to complete the Work), shall be provided by the Contractor whether or not the Work is expressly covered in the Drawings or the Specifications. It is intended that the Work be of sound, quality construction, and the Contractor shall be responsible for the inclusion of adequate amounts to cover installation of all items indicated, described, or implied in the portion of the Work to be performed by Contractor.

1.2.1.3 Conflicts. Without limiting Contractor’s obligation to identify conflicts for resolution by the Owner, it is intended that the more stringent, higher quality, and greater quantity of Work shall apply.

1.2.1.4 Conformance With Laws. Each and every provision of law required by law to be inserted in this Contract shall be deemed to be inserted herein, and the Contract shall be read and enforced as though it were included herein, and if through mistake or otherwise any such provision is not inserted, or is not correctly inserted, then upon application of either party the Contract shall be amended in writing to make such insertion or correction.

Before commencing any portion of the Work, Contractor shall check and review the Drawings and Specifications for such portion for conformance and compliance with all laws, ordinances, codes, rules and regulations of all governmental authorities and public utilities affecting the construction and operation of the physical plant of the Project, all quasi-governmental and other regulations affecting the construction and operation of the physical plant of the Project, and other special requirements, if any, designated in the Contract Documents. In the event Contractor observes any violation of any law, ordinance, code, rule or regulation, or inconsistency with any such restrictions or special requirements of the Contract Documents, Contractor shall promptly notify Architect and Owner in writing of same and shall ensure that any such violation or inconsistency shall be corrected in the manner provided hereunder prior to the construction of that portion of the Project. Where requirements of the Contract Documents

exceed those of the applicable building codes and ordinances, the Contract Documents shall govern. Contractor shall comply with all applicable Federal, State and local laws.

If, as and to the extent that Public Contract Code section 1104 is deemed to apply after the Award of the Contract, Contractor shall not be required to assume responsibility for the completeness and accuracy of architectural or engineering plans and specifications, notwithstanding any other provision in the Contract Documents, except to the extent that Contractor discovered or should have discovered and reported any errors and omissions to the Architect or Owner, including but not limited to as the result of any review of the plans and specifications by Contractor required by the Instructions to Bidders or other Contract Documents, whether or not actually performed by Contractor.

1.2.1.5 Ambiguity. Before commencing any portion of the Work, Contractor shall carefully examine all Drawings and Specifications and other information given to Contractor as to materials and methods of construction and other Project requirements. Contractor shall immediately notify Architect and Owner in writing of any perceived or alleged error, inconsistency, ambiguity, or lack of detail or explanation in the Drawings and Specifications in the manner provided herein. If the Contractor or its Subcontractors, material or equipment suppliers, or any of their officers, agents, and employees performs, permits, or causes the performance of any Work under the Contract Documents, which it knows or should have known to be in error, inconsistent, or ambiguous, or not sufficiently detailed or explained, Contractor shall bear any and all costs arising therefrom including, without limitation, the cost of correction thereof without increase or adjustment to the Contract Sum or the time for performance. If Contractor performs, permits, or causes the performance of any Work under the Contract Documents prepared by or on behalf of Contractor which is in error, inconsistent or ambiguous, or not sufficiently detailed or explained, Contractor shall bear any and all resulting costs, including, without limitation, the cost of correction, without increase to or adjustment in the Contract Sum or the time for performance. In no case shall any Subcontractor proceed with the Work if uncertain without the Contractor's written direction and/or approval.

1.2.1.6 Execution. Execution of the Agreement Between Owner and Contractor by the Contractor is a representation that the Contractor has visited the site, become familiar with the local conditions under which the Work is to be performed and has correlated personal observations with the requirements of the Contract Documents.

1.2.2 ADDENDA AND DEFERRED APPROVALS

1.2.2.1 Addenda. Subsequent addenda issued shall govern over prior addenda only to the extent specified. In accordance with Title 24, California Code of Regulations, addenda shall be approved by the Division of the State Architect ("DSA").

1.2.2.2 Deferred Approvals. The requirements approved by the DSA on any item submitted as a deferred approval in accordance with Title 24, California Code of Regulations, shall take precedence over any previously issued addenda, drawing or specification.

1.2.3 SPECIFICATION INTERPRETATION

1.2.3.1 **Titles.** The Specifications are separated into titled sections for convenience only and not to dictate or determine the trade or craft involved. Organization of the Specifications into divisions, sections and articles, and arrangement of Drawings shall not control the Contractor in dividing the Work among Subcontractors or in establishing the extent of work to be performed by any trade.

1.2.3.2 **As Shown, Etc.** Where “as shown,” “as indicated,” “as detailed,” or words of similar import are used, reference is made to the Drawings accompanying the Specifications unless otherwise stated. Where “as directed,” “as required,” “as permitted,” “as authorized,” “as accepted,” “as selected,” or words of similar import are used, the direction, requirement, permission, authorization, approval, acceptance, or selection by Architect is intended unless otherwise stated.

1.2.3.3 **Provide.** “Provide” means “provided complete in place,” that is, furnished, installed, tested, and ready for operation and use.

1.2.3.4 **General Conditions.** The General Conditions and any supplementary general conditions are a part of each and every section of the Specifications.

1.2.3.5 **Abbreviations.** In the interest of brevity, the Specifications are written in an abbreviated form and may not include complete sentences. Omission of words or phrases such as “Contractor shall,” “shall be,” etc., are intentional. Nevertheless, the requirements of the Specifications are mandatory. Omitted words or phrases shall be supplied by inference in the same manner as they are when a “note” occurs on the Drawings.

1.2.3.6 **Plural.** Words in the singular shall include the plural whenever applicable or the context so indicates.

1.2.3.7 **Metric.** The Specifications may indicate metric units of measurement as a supplement to U.S. customary units. When indicated thus: 1” (25 mm), the U. S. customary unit is specific, and the metric unit is nonspecific. When not shown with parentheses, the unit is specific. The metric units correspond to the “International System of Units” (SI) and generally follow ASTM E 380, “Standard for Metric Practice.”

1.2.3.8 **Standard Specifications.** Any reference to standard specifications of any society, institute, association, or governmental authority is a reference to the organization’s standard specifications, which are in effect as of the date the Notice to Bidders is first published. If applicable specifications are revised prior to completion of any part of the Work, the Contractor may, if acceptable to Owner and Architect, perform such Work in accordance with the revised specifications. The standard specifications, except as modified in the Specifications for the Project, shall have full force and effect as though printed in the Specifications. Architect will furnish, upon request, information as to how copies of the standard specifications referred to may be obtained.

1.2.3.9 **Absence of Modifiers.** In the interest of brevity, the Contract Documents frequently omit modifying words such as “all” and “any” and articles such as “the” and “an,” but

the fact that a modifier or an article is absent from one statement and appears in another is not intended to affect the interpretation of either statement.

1.3 OWNERSHIP AND USE OF ARCHITECT'S DRAWINGS, SPECIFICATIONS AND OTHER DOCUMENTS

The Drawings, Specifications, and other documents prepared on behalf of the Owner are instruments of the services of the Architect and its consultants and are the property of the Owner. The Contractor may retain one contract record set. Neither the Contractor nor any Subcontractor, Sub-subcontractor, or material or equipment supplier shall own or claim a copyright in the Drawings, Specifications, and other documents prepared by the Architect, and unless otherwise indicated the Architect shall be deemed the author of them. All copies of them, except the Contractor's record set, shall be returned or suitably accounted for to the Owner, upon request upon completion of the Work. The Drawings, Specifications, and other documents prepared by the Architect, and copies thereof furnished to the Contractor, are for use solely with respect to this Project. They are not to be used by the Contractor or any Subcontractor, Sub-subcontractor, or material or equipment supplier on other projects or for additions to this Project outside the scope of the Work without the specific written consent of the Owner and the Architect. The Contractor, Subcontractors, Sub-subcontractors, and material or equipment suppliers are granted a limited license to use and reproduce applicable portions of the Drawings, Specifications, and other documents prepared by the Architect appropriate to and for use in the execution of their Work under the Contract Documents. Submittal or distribution to meet official regulatory requirements or for other purposes in connection with this Project is not to be construed as publication in derogation of the Owner's property interest or other reserved right. All copies made under this license shall bear appropriate attribution and the statutory copyright notice, if any, shown on the Drawings, Specifications and other documents prepared by the Architect.

ARTICLE 2

OWNER

2.1 DEFINITION

The term "Owner" means the person or entity identified as such in the Agreement and is referred to throughout the Contract Documents as if singular in number. The term "Owner" means the Owner and/or the Owner's authorized representatives, including but not limited to architects and construction managers. To the extent the Contract Documents indicate that Owner has assigned duties to particular representatives of the Owner (such as the architect, or any construction manager), Owner reserves the right at all times to reassign such duties to different Owner representatives.

2.2 INFORMATION AND SERVICES REQUIRED OF THE OWNER

2.2.1 INTENTIONALLY LEFT BLANK

2.2.2 SITE SURVEY

When required by the scope of the Project, the Owner will furnish, at its expense, a legal description or a land survey of the Site, giving, as applicable, grades and lines of streets, alleys, pavements, adjoining property, rights-of-way, restrictions, easements, encroachments, zoning, deed restrictions, boundaries, and contours of the Site. Surveys to determine locations of construction, grading, and site work shall be provided by the Contractor.

2.2.3 SOILS

2.2.3.1 Owner Furnished Services. When required by the scope of the Project, the Owner will furnish, at its expense, the services of geotechnical engineers or consultants when reasonably required or as required by local or state codes. Such services with reports and appropriate professional recommendations shall include test boring, test pits, soil bearing values, percolation tests, air and water pollution tests, and ground corrosion and resistivity tests, including necessary operations for determining subsoil, air, and water conditions.

2.2.3.2 Contractor Reliance. Test borings and soils reports for the Project have been made for the Owner to indicate the subsurface materials that might be encountered at particular locations on the Project. The Owner has made these documents available to the Contractor and the Contractor has studied the results of such test borings and information that it has as to the subsurface conditions and Site geology as set forth in the test borings and soils reports. The Owner does not assume any responsibility whatsoever with respect to the sufficiency or accuracy of the borings made, or of the logs of the test borings, or of other investigations, or of the soils reports furnished pursuant hereto, or of the interpretations to be made beyond the location or depth of the borings. There is no warranty or guarantee, either express or implied that the conditions indicated by such investigations, borings, logs, soil reports or other information are representative of those existing throughout the Site of the Project, or any part thereof, or that unforeseen developments may not occur. At the Owner's request, the Contractor shall make available to the Owner the results of any Site investigation, test borings, analyses, studies or other tests conducted by or in the possession of the Contractor of any of its agents. Nothing herein contained shall be deemed a waiver by the Contractor to pursue any available legal right or remedy it may have at any time against any third party who may have prepared any report and/or test relied upon by the Contractor.

2.2.4 UTILITY SURVEY

When required by the scope of the Project, the Owner will furnish, at its expense, all information regarding known existing utilities on or adjacent to the Site, including location, size, inverts, and depths.

2.2.5 INFORMATION

Upon the request of the Contractor, Owner will make available such existing information regarding utility services and Site features, including existing construction, related to the Project

as is available from Owner's records. The Contractor may not rely upon the accuracy of any such information, other than that provided under Sections 2.2.2 and 2.2.4 (except that the Contractor may not rely upon and must question in writing to the Owner and the Architect any information which appears incorrect based upon Contractor's Site inspection, knowledge of the Project, and prior experience with similar projects), unless specifically stated in writing that the Contractor may rely upon the designated information.

2.2.6 EXISTING UTILITY LINES; REMOVAL, RELOCATION

2.2.6.1 Removal, Relocation. Pursuant to Government Code section 4215, the Owner assumes the responsibility for removal, relocation, and protection of utilities located on the Site at the time of commencement of construction under this Contract with respect to any such utility facilities which are not identified in the drawings and specifications made part of the invitation to bid. The Contractor shall not be assessed for liquidated damages for delay in completion of the Project caused by failure of the Owner to provide for removal or relocation of such utility facilities. Owner shall compensate the Contractor for the costs of locating, repairing damage not due to the failure of the Contractor to exercise reasonable care, removing or relocating such utility facilities, and for equipment necessarily idle during such work.

2.2.6.2 Assessment. These subparagraphs shall not be construed to preclude assessment against the Contractor for any other delays in completion of the Work. Nothing in these subparagraphs shall be deemed to require the Owner to indicate the presence of existing service laterals or appurtenances whenever the presence of such utilities on the Site can be inferred from the presence of other visible facilities, such as buildings, or meter junction boxes on or adjacent to the Site.

2.2.6.3 Notification. If the Contractor, while performing work under this Contract, discovers utility facilities not identified by the Owner in the Contract plans or specifications, Contractor shall immediately notify the Owner and the utility in writing.

2.2.6.4 Underground Utility Clearance. It shall be Contractor's sole responsibility to timely notify all public and private utilities serving the Site prior to commencing work. The Contractor shall notify and receive clearance from any cooperative agency, such as Underground Service Alert, in accordance with Government Code section 4216, et seq. Contractor shall promptly provide a copy of all such notifications to the Owner.

2.2.7 EASEMENTS

Owner shall secure and pay for easements for permanent structures or permanent changes in existing facilities, if any, unless otherwise specified in the Contract or Contract Documents.

2.2.8 REASONABLE PROMPTNESS

Information or services under Owner's control will be furnished by the Owner with reasonable promptness. The Owner shall not be liable for any delays caused by factors beyond the Owner's

control including but not limited to DSA's or any other local, State or federal agency's review of bids, change order requests, RFI's or any other documents.

2.2.9 COPIES FURNISHED

The Contractor will be furnished such copies of Drawings and Project Manuals as are stated in the Contract Documents.

2.2.10 DUTIES CUMULATIVE

The foregoing are in addition to other duties and responsibilities of the Owner enumerated herein, and especially those in Article 6 (Construction by Owner or by Separate Contractors), Article 9 (Payments and Completion), and Article 11 (Insurance and Bonds).

2.3 OWNER'S RIGHT TO STOP THE WORK

If the Contractor fails to correct Work which is not in accordance with the requirements of the Contract Documents, or persistently fails to carry out Work in accordance with the Contract Documents, the Owner, after providing Notice pursuant to paragraph 2.4, may order the Contractor to stop the Work or any portion thereof, until the Contractor corrects the deficiencies. The right of the Owner to stop the Work shall not give rise to a duty on the part of the Owner to exercise this right for the benefit of the Contractor or any other person or entity, except to the extent required by Article 6.

2.4 OWNER'S RIGHT TO CARRY OUT THE WORK

If the Contractor fails or refuses to carry out the Work in accordance with the Contract Documents, Owner may correct such deficiencies by whatever reasonable method the Owner may deem expedient without prejudice to other remedies the Owner may have, including but not limited to having another contractor perform some or all of the Work without terminating the Contract with Contractor. Owner may exercise this right at any time during the Contractor's Work.

Owner shall first provide written notice to Contractor of Contractor's failure or refusal to perform. The notice will provide the time period within which Contractor must begin correction of the failure or refusal to perform. If the Contractor fails to begin correction within the stated time, or fails to continue correction, the Owner may proceed to correct the deficiencies. In the event the Owner bids the work, Contractor shall not be eligible for the award of the contract. The Contractor may be invoiced the cost to Owner of the work, including compensation for additional professional and internally generated services and expenses made necessary by Contractor's failure or refusal to perform. Owner may withhold that amount from the retention, or progress payments due the Contractor, pursuant to Section 9.5. If retention and payments withheld then or thereafter due the Contractor are not sufficient to cover that amount, the Contractor shall pay the difference to the Owner.

ARTICLE 3

THE CONTRACTOR

3.1 DEFINITION

The Contractor is the person or entity identified as such in the Agreement and is referred to throughout the Contract Documents as if singular in number. The term “Contractor” means the Contractor or the Contractor’s authorized representative. To the extent that any portion of the Work is provided with the Contractor’s own forces, any reference to Subcontractors shall be equally applicable to the Contractor.

3.2 SUPERVISION AND CONSTRUCTION PROCEDURES

3.2.1 CONTRACTOR

The Contractor shall supervise and direct the Work using the Contractor’s best skill and attention, which shall meet or exceed the standards in the industry. The Contractor shall be solely responsible for and have control over construction means, methods, techniques, sequences, procedures, and coordinating all portions of the Work under the Contract, unless Contract Documents give other specific instructions concerning these matters. If any of the Work is performed by contractors retained directly by the Owner, Contractor shall be responsible for the coordination and sequencing of the Work of those other contractors so as to avoid any impact on the Project Schedule pursuant to the requirements of Article 6. Specific duties of the Contractor shall be in accordance with Title 24 of the California Code of Regulations. Contractor shall fully comply with any and all reporting requirements of Education Code sections 17309 and 81141 in the manner prescribed by Title 24.

3.2.2 CONTRACTOR RESPONSIBILITY

The Contractor shall be responsible to the Owner for acts and omissions of the Contractor’s employees, Subcontractors, material and equipment suppliers, and their agents, employees, invitees, and other persons performing portions of the Work under direct or indirect contract with the Contractor or any of its Subcontractors.

3.2.3 OBLIGATIONS NOT CHANGED BY ARCHITECT’S ACTIONS

The Contractor shall not be relieved of obligations to perform the Work in accordance with the Contract Documents by the activities or duties of the Owner’s representatives, including but not limited to any construction manager and the Architect, or the Inspector of Record; or by tests, inspections, or approvals required or performed by persons other than the Contractor.

3.2.4 CONTRACTOR RESPONSIBILITY FOR READINESS FOR WORK

The Contractor shall be responsible for inspection of Work already performed under the Contract Documents to determine that such portions are in proper condition to receive subsequent work.

3.2.5 PROJECT MEETINGS

Contractor shall attend Owner's Project meetings as scheduled by the Contract Documents, or as otherwise instructed by Owner, to discuss the current status of the Project and the future progress of the Work. Contractor shall have five (5) days after receipt of Owner's Project meeting minutes to provide written objections and suggested corrections.

3.3 SUPERINTENDENT

3.3.1 FULL TIME SUPERINTENDENT

The Contractor shall provide a competent superintendent and assistants as necessary, all of whom shall be reasonably proficient in speaking, reading and writing English and, who shall be in attendance at the Project site during performance of the Work. The superintendent shall represent the Contractor, and communications given to the superintendent shall be as binding as if given to the Contractor.

3.3.2 STAFF

The Contractor and each Subcontractor shall: furnish a competent and adequate staff as necessary for the proper administration, coordination, supervision, and superintendence of its portion of the Work; organize the procurement of all materials and equipment so that the materials and equipment will be available at the time they are needed for the Work; and keep an adequate force of skilled workers on the job to complete the Work in accordance with all requirements of the Contract Documents.

3.3.3 RIGHT TO REMOVE

Owner shall have the right, but not the obligation, to require the removal from the Project of any superintendent, staff member, agent, or employee of any Contractor, Subcontractor, material or equipment supplier, etc., for cause.

3.4 LABOR AND MATERIALS

3.4.1 CONTRACTOR TO PROVIDE

Unless otherwise provided in the Contract Documents, the Contractor shall provide and pay for labor, material, equipment, tools, construction equipment and machinery, water, heat, utilities, transportation, and other facilities and services necessary for proper execution and completion of the Work whether temporary or permanent and whether or not incorporated or to be incorporated in the Work.

3.4.2 QUALITY

Unless otherwise specified, all materials and equipment to be permanently installed in the Project shall be new and shall be of such quality as required to satisfy the standards of the Contract

Documents. The Contractor shall, if requested, promptly furnish satisfactory evidence as to kind and quality of all materials and equipment. All labor shall be performed by workers skilled in their respective trades, and the quality of their work shall meet whichever is the higher standard for their work: the standard in the industry or the standard in the Contract Documents.

3.4.3 REPLACEMENT

Any work, materials, or equipment, which does not conform to these standards may be disapproved and rejected by the Owner, in which case, they shall be removed and replaced by the Contractor at no cost to the Owner.

3.4.4 DISCIPLINE

The Contractor shall enforce strict discipline and good order among the Contractor's employees and other persons carrying out the Contract in accordance with paragraph 5.5.1 including, but not limited to, Subcontractors, and material or equipment suppliers retained for the Project.

3.5 WARRANTY

For the period of one (1) year after completion of the Work (see Sections 9.7.1 and 12.2.5), the Contractor warrants to the Owner that material and equipment furnished under the Contract will be of good quality and new unless otherwise required or permitted by the Contract Documents, that the Work will be free from defects not inherent in the quality required or permitted, and that the Work will conform with the requirements of the Contract Documents. Work not conforming to these requirements, including substitutions not properly approved and authorized, may be considered defective. The Contractor's warranty does not cover damage or defect caused by abuse, modifications not executed by the Contractor, improper or insufficient maintenance, improper operation, or normal wear and tear under normal usage. If required by the Owner, the Contractor shall furnish satisfactory evidence as to the kind and quality of materials and equipment.

3.6 TAXES

Contractor will pay all applicable Federal, State, and local taxes on all materials, labor, or services furnished by it, and all taxes arising out of its operations under the Contract Documents. Owner is exempt from Federal Excise Tax, and a Certificate of Exemption shall be provided upon request.

3.7 PERMITS, FEES AND NOTICES

3.7.1 PAYMENT

The Contractor shall secure and pay for all permits and governmental fees, licenses, and inspections necessary for proper execution and completion of the Work which are customarily secured after execution of the Contract and are legally required by any authority having jurisdiction over the Project, except those required by the Division of the State Architect (DSA).

Owner shall be responsible for all testing and inspection as required by the DSA on-Site or within the distance limitations set forth in paragraph 13.5.2, unless a different mileage range is specified in the Contract Documents.

3.7.2 COMPLIANCE

The Contractor shall comply with and give notices required by any law, ordinance, rule, regulation, and lawful order of public authorities bearing on performance of the Work.

3.7.3 CONTRACT DOCUMENTS

It is not the Contractor's responsibility to ascertain that the Contract Documents are in accordance with any applicable law, statute, ordinance, building codes, rule, or regulation. However, if the Contractor knew, or should have known, or observes that portions of the Contract Document are at variance therewith, the Contractor shall promptly notify the Architect, any construction manager, and Owner in writing, and necessary changes shall be accomplished by appropriate modification.

3.7.4 RESPONSIBILITY

If the Contractor performs Work that it knows, or should have known, is contrary to any law, statute, ordinance, building code, rule or regulation, the Contractor shall assume full responsibility for such Work, for all delays attributable thereto, and shall bear the attributable cost of correction or Project delay.

3.8 ALLOWANCES

3.8.1 CONTRACT

The Contractor shall include in the Contract Sum all allowances stated in the Contract Documents. Items covered by allowances shall be supplied for such amounts and by such persons or entities as the Owner may direct, but the Contractor shall not be required to employ persons or entities against whom the Contractor makes reasonable and timely objection.

3.8.2 SCOPE

3.8.2.1 *Prompt Selection.* Materials and equipment under an allowance shall be selected promptly by the Owner to avoid delay to the Work.

3.8.2.2 *Cost.* Allowances shall cover the cost to the Contractor of materials and equipment delivered at the Site and all required taxes, less applicable trade discounts, etc., as delineated in paragraph 7.7.4.

3.8.2.3 *Cost Included in Contract Sum.* Contractor's costs for unloading and handling at the Site, labor, installation costs, overhead, profit, and other expenses contemplated for stated allowance amounts shall be included in the Contract Sum and not in the allowances.

3.8.2.4 *Contract Sum Adjustment.* Whenever costs are more than or less than allowances, the Contract Sum shall be adjusted accordingly by Change Order. The amount of the Change Order shall reflect the difference between actual cost and the allowances under paragraph 3.8.2.2 and the change in the Contractor's costs under paragraph 3.8.2.3.

3.9 CONTRACTOR'S CONSTRUCTION SCHEDULES

3.9.1 REQUIREMENTS

Before the Contractor's commencement of Work on the Project Site or within two (2) weeks of award of the Contract, whichever is earlier, Contractor shall prepare and submit for the Owner's, and any construction manager's, information the construction schedule for the Work, which shall conform to the Contract Documents' requirements.

Contractor shall submit a monthly updated schedule that will include an accurate as-built schedule and the current as-planned schedule, both of which shall conform to the Contract Documents' requirements. Contractor shall submit its daily logs for the prior month with the updated schedule.

The schedule and updates shall conform, at a minimum, to industry standards for critical path scheduling and to facilitate Owner's Project management and evaluation of Contractor Claims for additional money or time.

The schedule and updates shall not exceed time limits (including milestone deadlines) under the Contract Documents and shall comply with the Contract Documents scheduling requirements and with any scheduling requirements the Owner provides to the Contractor at the beginning of the Work. The original schedule and all updates shall accurately reflect work performed to date, all construction tasks (including procurement), the critical path schedule for completion of the remainder of the Project, and the percentage of the Work completed. The original schedule and updates shall include all delay days for weather not unusually severe, even though that weather will not entitle Contractor to additional time or money.

The construction schedule shall be in the form of either a tabulation, chart, or graph, unless otherwise stated in Division 1 of the Specifications, and shall be in sufficient detail to show the chronological relationship of all activities of the Project including, but not limited to, estimated starting and completion dates of various activities, (including early and late dates and reasonable float for each activity), procurement of materials, the critical path, and scheduling of equipment. Float suppression techniques such as preferential sequencing, special lead/lag logic restraints, extended activity durations, or imposed dates shall be apportioned for the benefit of the Project. Whenever in the Contract Documents Contractor is required to provide a schedule and/or schedule updates, the Contractor shall provide the schedule and updates in electronic format as well as hard copy. Contractor shall be solely responsible for the accuracy, utility and reasonableness of all of its schedules. Owner's acceptance, approval or non-rejection of Contractor's schedules shall not affect Contractor's responsibility for its schedules.

The Contractor and Owner shall use any float on a “first come, first served” basis. The original schedule and updates shall reflect Contractor’s and Owner’s use of float. Float is not for the exclusive use or benefit of either Owner or Contractor, but it is a jointly owned expiring Project resource available to both parties as needed to meet schedule milestones. For the original schedule and updates, Contractor shall use a critical path network format with the critical paths clearly indicated. Contractor shall use an MS Project, Primavera, or an equivalent or better program. Contractor shall provide schedule conversion to MS Project or as directed by District. Contractor shall include reports that sort and list the activities in order of increasing float and by early and late start dates. Contractor shall endeavor to label ten to thirty percent (10-30%) of the tasks as critical, but shall not label less than five (5%) or more than fifty (50%) as critical. Contractor shall use calendar days.

If any change in Contractor’s method of operations will cause a change in the construction schedule, Contractor shall submit to Owner, Architect and any construction manager, a revised construction schedule within seven (7) days of the change, unless a different time period is stated in Division 1 of the Specifications.

If, in the Owner’s opinion, the Contractor is not prosecuting the Work at a rate sufficient to meet the Project schedule, a contractual milestone or the Project completion date (as adjusted by change orders) or if the Contractor’s actual progress falls behind the Project schedule or it is apparent to Owner or Contractor that Contractor will not meet contractual milestones or the Project completion date (as adjusted by change orders), the Owner may require that the Contractor prepare and submit a recovery plan. Contractor must submit a recovery plan within seven (7) days of a demand for the plan, unless a different time period is stated in Division 1 of the Specifications. At a minimum, the recovery plan must include a revised schedule that gets the Work back on schedule and completes all Work by the contractual milestones and Project completion date (as adjusted by change orders) or by other dates Owner specifies in the demand for a recovery plan. The recovery plan shall state the corrective actions Contractor will undertake to implement it. The recovery plan shall also list any additional money that Contractor believes it should receive if Owner orders Contractor to fully or partially implement the recovery plan. If the Owner orders Contractor to implement the recovery plan, Contractor shall do so, but the order shall not act constitute an admission by Owner that Contractor is entitled to additional money. To recover additional money, Contractor must comply with General Conditions Articles 4.5, 7 and 8.

All schedules Contractor submits shall be certified as true and correct, as follows:

I, [name of declarant], declare the following:

[Contractor company name] has contracted with [public entity name] for the [name of project] Project. [Contractor company name] authorized me to prepare schedules for [public entity name] for this Project, and I prepared the attached schedule. I am the most knowledgeable person at [contractor company name] regarding the scheduling of this Project.

The attached schedule does not breach the Contract between [contractor company name] and [public entity name] for this Project, does not violate any applicable law, satisfies all provisions of the Contract applicable to submission of the Claim, only contains truthful and accurate as-built and as-planned dates of work on the Project (including supporting data), and is not a false claim.

The attached schedule is submitted in compliance with all laws applicable to submission of a Claim, including but not limited to California Penal Code section 72 (Fraudulent Claims), Government Code sections 12650 et seq. (False Claims Act; for example, Government Code section 12651(a)(7)), and Business and Professions Code sections 17200 et seq. (Unfair Business Practices Act). I am aware that submission or certification of false claims, or other Claims that violate law or the Contract, may lead to fines, imprisonment, and/or other serious legal consequences for myself and/or [contractor company name].

While preparing this declaration and schedule I consulted with others (including attorneys, consultants, or others who work for [contractor company name]) when necessary to ensure that the statements were true and correct.

I declare under the penalty of perjury under the laws of the State of California that the foregoing is true and correct. Executed _____, 20__, at _____, California.

[name of declarant]

3.9.2 DSA OVERSIGHT PROCESS

In connection with the DSA Construction Oversight Process which includes inspection cards and review of changes to the DSA-approved construction documents, the Contractor must (a) include specific tasks in its baseline schedule to take into account these procedures since they are critical path issues; and (b) include a reasonable amount of float in the baseline schedule to accommodate the additional time required by these DSA procedures.

3.9.3 FAILURE TO MEET REQUIREMENTS

Failure of the Contractor to provide proper schedules may, at the sole discretion of Owner, constitute either grounds to withhold, in whole or in part, progress payments to the Contractor, or a breach of contract allowing Owner to terminate the Contract.

3.10 DOCUMENTS AND SAMPLES AT THE SITE

The Contractor shall maintain at the Site for the Owner one applicable copy of Titles 19 and 24 and record copy of the Drawings, Specifications, Addenda, Change Orders, and other Modifications, in good order and marked currently to record changes and selections made during construction. In addition, the Contractor shall maintain at the Site approved Shop Drawings, Product Data, Samples, and similar required submittals. These documents shall be available to the Owner and shall be delivered to the Architect for delivery to the Owner upon completion of the Work.

3.11 SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES

3.11.1 SUBMITTALS DEFINED

3.11.1.1 *Shop Drawings.* The term “shop drawings” as used herein means drawings, diagrams, schedules, and other data, which are prepared by Contractor, Subcontractors, manufacturers, suppliers, or distributors illustrating some portion of the Work, and includes: illustrations; fabrication, erection, layout and setting drawings; manufacturer’s standard drawings; schedules; descriptive literature, instructions, catalogs, and brochures; performance and test data including charts; wiring and control diagrams; and all other drawings and descriptive data pertaining to materials, equipment, piping, duct and conduit systems, and methods of construction as may be required to show that the materials, equipment, or systems and their position conform to the requirements of the Contract Documents. The Contractor shall obtain and submit with the shop drawings all seismic and other calculations and all product data from equipment manufacturers. “Product data” as used herein are illustrations, standard schedules, performance charts, instructions, brochures, diagrams, and other information furnished by the Contractor to illustrate a material, product, or system for some portion of the Work. As used herein, the term “manufactured” applies to standard units usually mass-produced, and “fabricated” means items specifically assembled or made out of selected materials to meet individual design requirements. Shop drawings shall: establish the actual detail of all manufactured or fabricated items, indicate proper relation to adjoining work, amplify design details of mechanical and electrical systems and equipment in proper relation to physical spaces in the structure, and incorporate minor changes of design or construction to suit actual conditions.

3.11.1.2 *Samples.* The term “samples” as used herein are physical examples furnished by Contractor to illustrate materials, equipment, or quality and includes natural materials, fabricated items, equipment, devices, appliances, or parts thereof as called for in the Specifications, and any other samples as may be required by the Owner to determine whether the kind, quality, construction, finish, color, and other characteristics of the materials, etc., proposed by the Contractor conform to the required characteristics of the various parts of the Work. All Work shall be in accordance with the approved samples.

3.11.1.3 *Contractor’s Responsibility.* Contractor shall obtain and shall submit to Architect all required shop drawings and samples in accordance with Contractor’s “Schedule for Submission of Shop Drawings and Samples” provisions in Division 1 of the Specifications and

in accordance with the Contractor's original and updated schedules, and with such promptness as to cause no delay in its own Work or in that of any other contractor, Owner or subcontractor but in no event later than fifteen (15) days after the execution of the Agreement. Contractor may be assessed \$100 a day for each day it is late in submitting a shop drawing or sample. No extensions of time will be granted to Contractor or any Subcontractor because of its failure to have shop drawings and samples submitted in accordance with the Schedule. Each Subcontractor shall submit all shop drawings, samples, and manufacturer's descriptive data for the review of the Owner, the Contractor, and the Architect through the Contractor. By submitting shop drawings, product data, and samples, the Contractor or submitting party (if other than Contractor) represents that it has determined and verified all materials, field measurements, field conditions, catalog numbers, related field construction criteria, and other relevant data in connection with each such submission, and that it has checked, verified, and coordinated the information contained within such submittals with the requirements of the Work and of the Contract Documents. At the time of submission, any deviation in the shop drawings, product data, or samples from the requirements of the Contract Documents shall be narratively described in a transmittal accompanying the submittal. However, submittals shall not be used as a means of requesting a substitution, the procedure for which is defined in paragraph 3.11.4, "Substitutions." Review by Owner and Architect shall not relieve the Contractor or any Subcontractor from its responsibility in preparing and submitting proper shop drawings in accordance with the Contract Documents. Contractor shall stamp, sign, and date each submittal indicating its representation that the submittal meets all of the requirements of the Contract Documents. Any submission, which in Owner's or Architect's opinion is incomplete, contains numerous errors, or has been checked only superficially by Contractor will be returned unreviewed for resubmission by the Contractor.

3.11.1.4 ***Extent of Review.*** In reviewing shop drawings, the Owner will not verify dimensions and field conditions. The Architect will review and approve shop drawings, product data, and samples for aesthetics and for conformance with the design concept of the Work and the information given in the Contract Documents. The Architect's review shall neither be construed as a complete check nor relieve the Contractor, Subcontractor, manufacturer, fabricator, or supplier from responsibility for any deficiency that may exist or from any departures or deviations from the requirements of the Contract Documents unless the Contractor has, in writing, called the Architect's attention to the deviations at the time of submission and the Architect has given specific written approval. The Architect's review shall not relieve the Contractor or Subcontractors from responsibility for errors of any sort in shop drawings or schedules, for proper fitting of the Work, or from the necessity of furnishing any Work required by the Contract Documents, which may not be indicated on shop drawings when reviewed. Contractor and Subcontractors shall be solely responsible for determining any quantities, whether or not shown on the shop drawings.

3.11.2 **DRAWING SUBMISSION PROCEDURE**

3.11.2.1 ***Transmittal Letter and Other Requirements.*** All shop drawings must be properly identified with the name of the Project and dated, and each lot submitted must be accompanied by a letter of transmittal referring to the name of the Project and to the Specification section number for identification of each item clearly stating in narrative form, as

well as “clouding” on the submissions, all qualifications, departures, or deviations from the Contract Documents, if any. Shop drawings, for each section of the Work, shall be numbered consecutively, and the numbering system shall be retained throughout all revisions. All Subcontractor submissions shall be made through the Contractor. Each drawing shall have a clear space for the stamps of Architect and Contractor. Only shop drawings required to be submitted by the Contract Documents shall be reviewed.

3.11.2.2 Copies Required. Each submittal shall include one (1) legible, reproducible and five (5) legible prints and one (1) electronic copy of each drawing, including fabrication, erection, layout and setting drawings, and such other drawings as required under the various sections of the Specifications until final acceptance thereof is obtained. Subcontractor shall submit copies, in an amount as requested by the Contractor, of: manufacturers’ descriptive data for materials, equipment, and fixtures, including catalog sheets showing dimensions, performance, characteristics, and capacities; wiring diagrams and controls; schedules; all seismic calculations and other calculations; and other pertinent information as required.

3.11.2.3 Corrections. The Contractor shall make any corrections required by Architect and shall resubmit as required by Architect the required number of corrected copies of shop drawings or new samples until approved. Contractor shall direct specific attention in writing or on resubmitted shop drawings to revisions other than the corrections required by the Architect on previous submissions. Professional services required for more than one (1) re-review of required submittals of shop drawings, product data, or samples are subject to charge to the Contractor pursuant to paragraph 4.4.

3.11.2.4 Approval Prior to Commencement of Work. No portion of the Work requiring a shop drawing or sample submission shall be commenced until the submission has been reviewed by Owner and approved by Architect unless specifically directed in writing by the Owner. All such portions of the Work shall be in accordance with approved shop drawings and samples.

3.11.3 SAMPLE SUBMISSIONS PROCEDURE

3.11.3.1 Samples Required. In case a considerable range of color, graining, texture, or other characteristics may be anticipated in finished products, a sufficient number of samples of the specified materials shall be furnished by the Contractor to indicate the full range of characteristics, which will be present in the finished products; and products delivered or erected without submittal and approval of full range samples shall be subject to rejection. Except for range samples, and unless otherwise called for in the various sections of the Specifications, samples shall be submitted in duplicate. All samples shall be marked, tagged, or otherwise properly identified with the name of the submitting party, the name of the Project, the purpose for which the samples are submitted, and the date and shall be accompanied by a letter of transmittal containing similar information, together with the Specification section number for identification of each item. Each tag or sticker shall have clear space for the review stamps of Contractor and Architect.

3.11.3.2 Labels and Instructions. Samples of materials, which are generally furnished in containers bearing the manufacturers’ descriptive labels and printed application instructions,

shall, if not submitted in standard containers, be supplied with such labels and application instructions.

3.11.3.3 **Architect's Review.** The Architect will review and, if appropriate, approve submissions and will return them to the Contractor with the Architect's stamp and signature applied thereto, indicating the appropriate action in compliance with the Architect's standard procedures.

3.11.3.4 **Record Drawings and Annotated Specifications.** The Contractor will prepare and maintain on a current basis an accurate and complete set of Record Drawings showing clearly all changes, revisions, and substitutions during construction, including, without limitation, field changes and the final location of all mechanical equipment, utility lines, ducts, outlets, structural members, walls, partitions, and other significant features, and Annotated Specifications showing clearly all changes, revisions, and substitutions during construction. A copy of such Record Drawings and Annotated Specifications will be delivered to Owner in accordance with the Schedule prepared by Contractor. In the event of a specification that allows Contractor to elect one of several brands, makes, or types of material or equipment, the annotations shall show which of the allowable items the Contractor has furnished. The Contractor will update the Record Drawings and Annotated Specifications as often as necessary to keep them current but no less often than weekly. The Record Drawings and Annotated Specifications shall be kept at the Site and available for inspection by the Owner, Inspector of Record and the Architect. On completion of the Contractor's portion of the Work and prior to Application for Final Progress Payment, the Contractor will provide one complete set of Record Drawings and Annotated Specifications to the Owner, certifying them to be a complete and accurate reflection of the actual construction conditions of the Work.

3.11.3.5 **Equipment Manuals.** Contractor shall obtain and furnish three (3) complete sets of manuals containing the manufacturers' instructions for maintenance and operation of each item of equipment and apparatus furnished under the Contract Documents and any additional data specifically requested under the various sections of the Specifications for each division of the Work. The manuals shall be arranged in proper order, indexed, and placed in three-ring binders. At the completion of its Work, the Contractor shall certify, by endorsement thereon, that each of the manuals is complete, accurate, and covers all of its Work. Prior to submittal of Contractor's Application for Final Progress Payment, and as a further condition to its approval by the Architect, each Subcontractor shall deliver the manuals, arranged in proper order, indexed, endorsed, and placed in three-ring binders, to the Contractor, who shall assemble these manuals for all divisions of the Work, review them for completeness, and submit them to the Owner through the Architect.

3.11.3.6 **Owner's Property.** All shop drawings and samples submitted shall become the Owner's property.

3.11.4 SUBSTITUTIONS

3.11.4.1 **One Product Specified.** Unless the Specifications state that no substitution is permitted, whenever in the Contract Documents any specific article, device, equipment, product, material, fixture, patented process, form, method, or type of construction is indicated or specified by name, make, trade name, or catalog number, with or without the words “or equal,” such specification shall be deemed to be used for the purpose of facilitating description of material, process, or article desired and shall be deemed to be followed by the words “or equal.” Contractor may, unless otherwise stated, offer any material, process, or article, which shall be substantially equal or better in every respect to that so indicated or specified and will completely accomplish the purpose of the Contract Documents.

3.11.4.2 **Two or More Products Specified.** When two or more acceptable products are specified for an item of the Work, the choice will be up to the Contractor. Contractor shall utilize the same product throughout the Project. If a timely substitution request as set forth in Section 3.11.4.3 is not provided and an “or equal” substitution is requested, the Owner may consider the substitution if the product specified is no longer commercially available. If the Owner allows the substitution to be proposed pursuant to such an untimely request, the Contractor will be responsible for the professional fees incurred by the Architect or Architect’s consultants in reviewing the proposed substitution which fees may be withheld from progress payments and/or retention.

3.11.4.3 **Substitution Request Form.** Requests for substitutions of products, materials, or processes other than those specified must be made on the Substitution Request form available from the Owner prior to the date of the bid opening. Any Requests submitted less than fourteen (14) days prior to the date of the bid opening will not be considered, except as noted in paragraph 3.11.4.2. A Substitution Request must be accompanied by evidence as to whether or not the proposed substitution: is equal in quality and serviceability to the specified item; will entail no changes in detail and construction of related work; will be acceptable in consideration of the required design and artistic effect; will provide no cost disadvantage to Owner; and will require no excessive or more expensive maintenance, including adequacy and availability of replacement parts. The burden of proof of these facts shall be upon the Contractor. The Contractor shall furnish with its request sufficient information to determine whether the proposed substitution is equivalent including but not limited to all drawings, specifications, samples, performance data, calculations, and other information as may be required to assist the Architect and the Owner in determining whether the proposed substitution is acceptable. The final decision shall be the Owner’s. The written approval of the Owner, consistent with the procedure for Change Orders, shall be required for the use of a proposed substitute material. Owner may condition its approval of the substitution upon delivery to Owner of an extended warranty or other assurances of adequate performance of the substitution. All risks of delay due to the Division of the State Architect’s, or any other governmental agency having jurisdiction, approval of a requested substitution shall be on the requesting party.

3.11.4.4 **List of Manufacturers and Products Required.** The Subcontractor shall prepare and submit to the Contractor within thirty (30) days of execution of the Subcontract comprehensive lists, in quadruplicate, of the manufacturers and products proposed for the Project, including information on materials, equipment, and fixtures required by the Contract Documents, as may be required for Contractor’s or Architect’s preliminary approval. Approval

of such lists of products shall not be construed as a substitute for the shop drawings, manufacturer's descriptive data, and samples, which are required by the Contract Documents, but rather as a base from which more detailed submittals shall be developed for the final review of the Contractor and the Architect.

3.11.5 DEFERRED APPROVALS

Deferred approvals shall be submitted and processed pursuant to the requirements of Division 1 of the Specifications. All risks of delay due to the Division of the State Architect's, or any other governmental agency having jurisdiction, approval of a deferred approval shall be on the requesting party.

3.12 CUTTING AND PATCHING

3.12.1 SCOPE

The Contractor shall be responsible for cutting, fitting, or patching required to complete the Work or to make its parts fit together properly.

3.12.2 CONSENT

The Contractor shall not damage or endanger a portion of the Work or fully or partially completed construction of the Owner or separate contractors by cutting, patching, or otherwise altering such construction, or by excavation. The Contractor shall not cut or otherwise alter such construction by the Owner or a separate contractor except with written consent of the Owner and of such separate contractor; such consent shall not be unreasonably withheld. The Contractor shall not unreasonably withhold from the Owner or a separate contractor the Contractor's consent to cutting or otherwise altering the Work. All cutting shall be done promptly, and all repairs shall be made as necessary.

3.12.3 STRUCTURAL MEMBERS

New or existing structural members and elements, including reinforcing bars and seismic bracing, shall not be cut, bored, or drilled except by written authority of the Architect and DSA. Work done contrary to such authority is at the Contractor's risk, subject to replacement at its own expense and without reimbursement under the Contract. Agency approvals shall be obtained by the Architect, not by the Contractor.

3.12.4 SUBSEQUENT REMOVAL

Permission to patch any areas or items of the Work shall not constitute a waiver of the Owner's or the Architect's right to require complete removal and replacement of the areas or items of the Work if, in the opinion of the Architect or the Owner, the patching does not satisfactorily restore quality and appearance of the Work or does not otherwise conform to the Contract Documents. Any costs caused by defective or ill-timed cutting or patching shall be borne by the person or entity responsible.

3.13 CLEANING UP

3.13.1 CONTRACTOR'S RESPONSIBILITY

The Contractor shall keep the Site and surrounding area free from accumulation of waste material or rubbish caused by operations under the Contract. The Site shall be maintained in a neat and orderly condition. All crates, cartons, paper, and other flammable waste materials shall be removed from Work areas and properly disposed of at the end of each day. The Contractor shall continuously remove from and about the Site the waste materials, rubbish, tools, construction equipment, machinery, and materials no longer required for the Work.

3.13.2 FAILURE TO CLEANUP

If the Contractor fails to clean up as provided in the Contract Documents, the Owner may do so, without prior notice to the Contractor and the cost thereof shall be invoiced to the Contractor and withheld from progress payments and/or retention. Each Subcontractor shall have the responsibility for the cleanup of its own Work. If the Subcontractor fails to clean up, the Contractor must do so.

3.13.3 CONSTRUCTION BUILDINGS

When directed by the Owner or the Architect, Contractor and Subcontractor shall dismantle temporary structures, if any, and remove from the Site all construction and installation equipment, fences, scaffolding, surplus materials, rubbish, and supplies belonging to Contractor or Subcontractor. If the Contractor does not remove the tools, equipment, machinery, and materials within fifteen (15) days after completion of its Work, then they shall be deemed abandoned, and the Owner can dispose of them for its own benefit in whatever way it deems appropriate. Contractor shall pay for any costs to dispose of the items.

3.14 ACCESS TO WORK

The Contractor shall provide the Owner, the Architect, and the Inspector of Record, access to the Work in preparation and progress wherever located.

3.15 ROYALTIES AND PATENTS

3.15.1 PAYMENT AND INDEMNITY

The Contractor shall pay all royalties and license fees. The Contractor shall defend suits or claims of infringement of patent rights and shall hold the Owner and the Architect harmless and indemnify them, to the extent not caused by the Owner's active negligence, sole negligence or willful misconduct, from loss on account thereof but shall not be responsible for such defense or loss when a particular design, process, or product of a particular manufacturer is required by the Contract Documents. However, if the Contractor has reason to believe the required design,

process, or product is an infringement of a patent, the Contractor shall be responsible for such loss unless such information is promptly furnished to the Owner and Architect.

3.15.2 REVIEW

The review by the Owner or Architect of any method of construction, invention, appliance, process, article, device, or material of any kind shall be for its adequacy for the Work and shall not be an approval for the use by the Contractor in violation of any patent or other rights of any person or entity.

3.16 INDEMNIFICATION

3.16.1 SCOPE: CONTRACTOR

To the fullest extent permitted by law, the Contractor shall defend, indemnify, and hold harmless the Owner, the construction manager, Architect, Architect's consultants, the Inspector of Record, the State of California, and their respective agents, employees, officers, volunteers, Boards of Trustees, members of the Boards of Trustees, and directors ("Indemnitees"), from and against claims, actions, damages, liabilities, losses (including but not limited to injury or death of persons, property damage, and compensation owed to other parties), and expenses (including but not limited to attorneys' fees and costs including fees of consultants) alleged by third parties against Indemnitees arising out of or resulting from the following: Contractor's, its Subcontractors', or its suppliers' performance of the Work, including but not limited to the Contractor's or its Subcontractors' use of the Site; the Contractor's or its Subcontractors' construction of the Project, or failure to construct the Project, or any portion thereof; the use, misuse, erection, maintenance, operation, or failure of any machinery or equipment including, but not limited to, scaffolds, derricks, ladders, hoists, and rigging supports, whether or not such machinery or equipment was furnished, rented, or loaned by any of the Indemnitees; or any act, omission, negligence, or willful misconduct of the Contractor or its Subcontractors or their respective agents, employees, material or equipment suppliers, invitees, or licensees but only to the extent caused in whole or in part by the acts or omissions of the Contractor, its Subcontractors, its suppliers, anyone directly or indirectly employed by any of them, or anyone for whose acts they may be liable, regardless of whether or not such claim, damage, loss, or expense is caused in part by a party indemnified hereunder. Such obligation shall not be construed to negate, abridge, or reduce other rights or obligations of indemnity, which would otherwise exist as to a party, person, or entity described in this paragraph. The obligation to defend, indemnify and hold harmless includes any claims or actions by third parties arising out of or resulting from Labor Code section 2810. Contractor shall have no obligation to defend or indemnify the Indemnitees against claims, actions, damages, liabilities, losses, and expenses caused by the active negligence, sole negligence or willful misconduct of Indemnitees. This indemnification shall apply to all liability, as provided for above, regardless of whether any insurance policies are applicable, and insurance policy limits do not act as a limitation upon the amount of the indemnification to be provided by the Contractor.

3.16.2 SCOPE: SUBCONTRACTORS

3.16.2.1 **Indemnity.** The Subcontractors shall defend, indemnify, and hold harmless the Indemnitees from and against claims, actions, damages, liabilities, and losses (including but not limited to injury or death of persons, property damage, and compensation owed to other parties), and expenses (including but not limited to attorneys' fees and costs including fees of consultants) alleged by third parties against Indemnitees arising out of or resulting from the following: Subcontractors' performance of the Work, including but not limited to the Subcontractors' use of the Site; the Subcontractors' construction of the Project or failure to construct the Project or any portion thereof; the use, misuse, erection, maintenance, operation, or failure of any machinery or equipment, including, but not limited to, scaffolds, derricks, ladders, hoists, and rigging supports, whether or not such machinery or equipment was furnished, rented, or loaned by any of the Indemnitees; or any act, omission, negligence, or willful misconduct of the Subcontractors or their respective agents, employees, material or equipment suppliers, invitees, or licensees but only to the extent caused in whole or in part by the acts or omissions of the Subcontractors, anyone directly or indirectly employed by any of them, or anyone for whose acts they may be liable, regardless of whether or not such claim, damage, loss, or expense is caused in part by a party indemnified hereunder. Such obligation shall not be construed to negate, abridge, or reduce other rights or obligations of indemnity, which would otherwise exist as to a party, person, or entity described in this paragraph. This obligation to defend, indemnify and hold harmless includes any claims or actions by third parties arising out of or resulting from Labor Code section 2810. Subcontractors shall have no obligation to defend or indemnify the Indemnitees against claims, actions, damages, liabilities, losses, and expenses caused by the active negligence, sole negligence or willful misconduct of Indemnitees. This indemnification shall apply to all liability, as provided for above, regardless of whether any insurance policies are applicable, and insurance policy limits do not act as a limitation upon the amount of the indemnification to be provided by the Subcontractors.

3.16.2.2 **Joint and Several Liability.** In the event more than one Subcontractor is connected with an accident or occurrence covered by this indemnification, then all such Subcontractors shall be jointly and severally responsible to each of the Indemnitees for indemnification, and the ultimate responsibility among such indemnifying Subcontractors for the loss and expense of any such indemnification shall be resolved without jeopardy to any Indemnitee. The provisions of the indemnity provided for herein shall not be construed to indemnify any Indemnitee for its own negligence if not permitted by law or to eliminate or reduce any other indemnification or right which any Indemnitee has by law or equity.

3.16.3 NO LIMITATION

The Contractor's and the Subcontractor's obligation to indemnify and defend the Indemnitees hereunder shall include, without limitation, any and all claims, damages, and costs: for injury to persons and property (including loss of use), and sickness, disease or death of any person; for breach of any warranty, express or implied; for failure of the Contractor or the Subcontractor to comply with any applicable governmental law, rule, regulation, or other requirement; and for products installed in or used in connection with the Work.

3.17 OWNER AS INTENDED BENEFICIARY

The Owner is an intended beneficiary of any architectural or engineering work secured by, or performed by, the Contractor to fulfill its obligations under the Contract. Contractor shall state in its contracts with architectural or engineering consultants that their work is for the intended benefit of the Owner.

3.18 NOTICE OF EXCUSE FOR NONPERFORMANCE

If Contractor believes that acts or omissions of Owner (including but not limited to Owner caused delay) have prevented Contractor from performing the Work as required by the Contract Documents and Contractor intends to rely on Owner's acts or omissions and Civil Code section 1511(1) as reasons to excuse Contractor's nonperformance or to support, among other things, Contractor's requests for time extensions under General Conditions section 4.5, Contractor shall provide written notice of the excuse within five (5) days of the Owner's acts or omissions. If Contractor fails to timely submit the written notice Contractor shall have waived any right to later rely on the acts or omissions as a defense to Contractor's nonperformance, regardless of the merits of the defense. Contractor will not have satisfied a condition precedent or exhausted administrative remedies. Contractor acknowledges that these written notices are of critical importance to the Owner's Project management and the mitigation of Project costs and delays.

ARTICLE 4

ADMINISTRATION OF THE CONTRACT

4.1 ARCHITECT

4.1.1 DEFINITION

The Architect is the person lawfully licensed to practice architecture or an entity lawfully practicing architecture identified as such in the Agreement and is referred to throughout the Contract Documents as if singular in number. The term "Architect" means the Architect or the Architect's authorized representative, and shall also refer to all consultants under the Architect's direction and control.

4.1.2 MODIFICATION

To the extent the Contract Documents indicate that Owner has assigned duties or responsibilities to the Architect, Owner reserves the right at all times to reassign such duties or responsibilities to different Owner representatives.

4.1.3 TERMINATION

In the case of the termination of the Architect, the Owner may appoint an architect or another construction professional or may perform such functions with its own licensed professional

personnel. The status of the replacement Architect under the Contract Documents shall be that of the former architect.

4.2 ARCHITECT'S ADMINISTRATION OF THE CONTRACT

4.2.1 STATUS

The Architect will provide administration of the Contract and may be one of several Owner's representatives during construction, through release of all retention, and during the one (1) year period following the commencement of any warranties. The Architect will advise and consult with the Owner. The Architect will have authority to act on behalf of the Owner only to the extent set forth in the Owner/Architect agreement. The Architect will have all responsibilities and power established by law, including California Code of Regulations, Title 24, to the extent set forth in the Owner/Architect agreement.

4.2.2 SITE VISITS

The Architect will visit the Site at intervals necessary in the judgment of the Architect or as otherwise agreed by the Owner and the Architect in writing to become generally familiar with the progress and quality of the completed Work and to determine in general if the Work is being performed in a manner indicating that the Work, when completed, will be in accordance with the Contract Documents.

4.2.3 LIMITATIONS OF CONSTRUCTION RESPONSIBILITY

The Contractor shall not be relieved of obligations to perform the Work in accordance with the Contract Documents either by activities or duties of the Architect in the Architect's administration of the Contract Documents, or by tests, inspections, or approvals required or performed by persons other than the Contractor.

4.2.4 COMMUNICATIONS FACILITATING CONTRACT ADMINISTRATION

The Owner and the Contractor shall communicate through the Architect, unless there is a construction manager for the Project or the Owner directs otherwise. Communications between Owner and Subcontractors or material or equipment suppliers shall be through the Contractor.

4.2.5 PAYMENT APPLICATIONS

The Contractor shall submit payment applications to the Architect, unless there is a construction manager for the Project or the Owner directs otherwise.

4.2.6 REJECTION OF WORK

The Architect, Inspector of Record, any construction manager and others may recommend to the Owner that the Owner reject Work which does not conform to the Contract Documents or that the Owner require additional inspection or testing of the Work in accordance with paragraph

13.5.5, whether or not the Work is fabricated, installed, or completed. However, no recommendation shall create a duty or responsibility to the Contractor, Subcontractors, material and equipment suppliers, their agents or employees, or other persons performing portions of the Work.

4.2.7 CHANGE ORDERS

The Architect will prepare change orders and construction change directives and may authorize minor changes in the Work.

4.2.8 WARRANTIES UPON COMPLETION

The Architect in conjunction with the Inspector of Record, or as otherwise directed by Owner, will conduct field reviews of the Work to determine the date of completion, shall receive and forward to the Owner for the Owner's review and records, written warranties and related documents required by the Contract and assembled by the Contractor. The handling by the Architect of such warranties, maintenance manuals, or similar documents shall not diminish or transfer to the Architect any responsibilities or liabilities required by the Contract Documents of the Contractor or other entities, parties, or persons performing or supplying the Work.

Except as may be otherwise directed by Owner, the Architect will conduct a field review of the Contractor's comprehensive list of items to be completed or corrected for development of a punch list and one (1) follow-up field review if required. The cost incurred by the Owner for further field reviews or the preparation of further punch lists by the Architect shall be invoiced to the Contractor and withheld from payment and/or retention.

4.2.9 INTERPRETATION

The Architect, Inspector of Record, any construction manager, the Owner or any independent consultant of Owner, as Owner deems appropriate, will interpret and decide matters concerning performance under and requirements of the Contract Documents on written request of the Contractor. The Owner's response to such requests will be made with reasonable promptness, while allowing sufficient time to permit adequate review and evaluation of the request.

4.2.10 ADDITIONAL INSTRUCTIONS

4.2.10.1 *Architect's Interpretations and Decisions.* Interpretations and decisions of the Architect will be consistent with the intent of and reasonably inferable from the Contract Documents and will be in writing or in the form of drawings. When making such interpretations of and decisions regarding the Contract Documents, the Architect will endeavor to secure faithful performance under the Contract Documents by both the Owner and the Contractor and will not show partiality to either. The Work shall be executed in conformity with, and the Contractor shall do no work without, approved drawings, Architect's clarifying instructions, and/or submittals.

4.2.10.2 *Typical Parts and Sections.* Whenever typical parts or sections of the Work are completely detailed on the Drawings, and other parts or sections which are essentially of the

same construction are shown in outline only, the complete details shall apply to the Work which is shown in outline.

4.2.10.3 **Dimensions.** Dimensions of Work shall not be determined by scale or rule. Figured dimensions shall be followed at all times. If figured dimensions are lacking on Drawings, Architect shall supply them on request. The Owner's decisions on matters relating to aesthetic effect will be final if consistent with the Contract Documents.

4.3 INSPECTOR OF RECORD

4.3.1 GENERAL

One or more Project inspectors ("Inspector of Record") employed by the Owner and approved by the Division of the State Architect will be assigned to the Work in accordance with the requirements of Title 24 of the California Code of Regulations. The Inspector of Record's duties will be as specifically defined in Title 24.

4.3.2 INSPECTOR OF RECORD'S DUTIES

All Work shall be under the observation of or with the knowledge of the Inspector of Record. The Inspector of Record shall have free access to any or all parts of the Work at any time. The Contractor shall furnish the Inspector of Record such information as may be necessary to keep the Inspector of Record fully informed regarding progress and manner of work and character of materials. Such observations shall not, in any way, relieve the Contractor from responsibility for full compliance with all terms and conditions of the Contract, or be construed to lessen to any degree the Contractor's responsibility for providing efficient and capable superintendence. The Inspector of Record is not authorized to make changes in the drawings or specifications nor shall the Inspector of Record's approval of the Work and methods relieve the Contractor of responsibility for the correction of subsequently discovered defects, or from its obligation to comply with the Contract Documents.

4.3.3 INSPECTOR OF RECORD'S AUTHORITY TO REJECT OR STOP WORK

The Inspector of Record shall have the authority to reject work that does not comply with the provisions of the Contract Documents. In addition, the Inspector of Record may stop any work which poses a probable risk of harm to persons or property. The Contractor shall instruct its employees, Subcontractors, material and equipment suppliers, etc., accordingly. The absence of any Stop Work order or rejection of any portion of the Work shall not relieve the Contractor from any of its obligations pursuant to the Contract Documents.

4.3.4 INSPECTOR OF RECORD'S FACILITIES

Within seven (7) days after notice to proceed, the Contractor shall provide the Inspector of Record with the temporary facilities as required under Division 1 of the Specifications.

4.4 **RESPONSIBILITY FOR ADDITIONAL CHARGES INCURRED BY THE OWNER FOR PROFESSIONAL SERVICES**

If at any time prior to the completion of the requirements under the Contract Documents, through no fault of its own, the Owner is required to provide or secure additional professional services for any reason by any act or omission of the Contractor, the Contractor shall be invoiced by the Owner for any actual costs incurred for any such additional services, which costs may, among other remedies, be withheld from the progress payments and/or retention. Such invoicing shall be independent from any other Owner remedies, including but not limited to liquidated damages. If payments then or thereafter due to the Contractor are not sufficient to cover such amounts, the Contractor shall pay the difference to the Owner. Additional services shall include, but shall not be limited to, the following:

- A. Services made necessary by the default of the Contractor.
- B. Services made necessary due to the defects or deficiencies in the Work of the Contractor.
- C. Services required by failure of the Contractor to perform according to any provision of the Contract Documents.
- D. Services in connection with evaluating substitutions of products, materials, equipment, Subcontractors proposed by the Contractor, and making subsequent revisions to drawings, specifications, and providing other documentation required (except for the situation where the specified item is no longer manufactured or available).
- E. Services for evaluating and processing Claims submitted by the Contractor in connection with the Work outside the established Change Order process.
- F. Services required by the failure of the Contractor to prosecute the Work in a timely manner in compliance within the specified time of completion.
- G. Services in conjunction with the testing, adjusting, balancing and start-up of equipment other than the normal amount customarily associated for the type of Work involved.
- H. Services in conjunction with more than one (1) re-review of required submittals of shop drawings, product data, and samples.

4.5 **NOTICES OF POTENTIAL CHANGE, CHANGE ORDER REQUESTS, AND CLAIMS**

If the Contractor identifies the potential for extra work, delay in the critical path schedule, or the need for additional money or time, or if the Contractor requests additional money or time, or if the Contractor believes that Owner has failed to pay amounts due or otherwise breached the Contract, or otherwise believes that it is entitled to a modification of the Contract terms and conditions, then Contractor shall follow the procedures in this Section 4.5 and Article 7,

otherwise Contractor shall have waived its rights to pursue those issues and any later attempts to recover money or obtain a modification shall be barred. Contractor specifically acknowledges the Owner's and public's interest in, and need to know of, potential changes and disputes as early as possible so Owner can investigate, mitigate and resolve adverse cost and time impacts, if any. It is Contractor's obligation to know and comply with the requirements of Section 4.5 and Article 7, and Owner has no obligation to notify Contractor of any failure to comply with those requirements.

4.5.1 NOTICE OF POTENTIAL CHANGE

Contractor shall submit a written Notice of Potential Change for extra work, critical path delay, or additional money or time. Contractor shall submit written Notices of Potential Change to Owner within five (5) days of Contractor becoming aware of the issues creating the potential for change, unless the issues are, or may soon be, adversely affecting the costs or critical path of the Work, in which case the Contractor must submit the written notice without delay so the Owner may take immediate action to mitigate cost and schedule impacts of the change, if any. The written notice shall explain the nature of the potential change so the Owner may take action to mitigate costs and schedule impacts, if necessary.

When submitting a written Notice of Potential Change based on extra work, Contractor shall not perform the extra work until directed in writing to do so by Owner. When submitting a written Notice of Potential Change for an issue of critical path delay, Contractor shall proactively mitigate the effects of the alleged delay as much as reasonably possible so as to minimize any impact to the schedule, until otherwise directed by Owner.

Failure to timely submit a written Notice of Potential Change shall constitute a complete waiver by Contractor of any right to later submit a change order request or pursue a Claim on that issue, or to later pursue any additional money or time extensions in any manner related to that issue, regardless of the merits. Contractor will not have satisfied a condition precedent or exhausted administrative remedies. Contractor acknowledges that these written notices are of critical importance to the Owner's Project management and the mitigation of Project costs and delays.

4.5.2 CHANGE ORDERS REQUESTS

If, after submitting a written Notice of Potential Change pursuant to Section 4.5.1, Contractor continues to believe that it is entitled to additional money or time (including but not limited to grant of a time extension; payment of money or damages arising from work done by, or on behalf of, the Contractor, payment of which is not otherwise expressly provided for or the claimant is not otherwise entitled to; or an amount the payment of which is disputed by the Owner) based on an issue, then Contractor shall submit a Change Order Request ("COR") to Owner within twenty (20) days of (i) becoming aware of the issues creating a potential change, or (ii) the date by which it should have become aware of the issues creating a potential change. A rejection at any time or a lack of a rejection by Owner of a Notice of Potential Change does not affect the timeline for submitting a COR.

Failure to timely submit a COR related to an issue, or failure to comply with any of the COR requirements in the Contract shall constitute a complete waiver by Contractor of any right to later submit a COR or Claim on that issue, or to later pursue any additional money (including time extensions) in any manner related to that issue, regardless of the merits. Contractor will not have satisfied a condition precedent or exhausted administrative remedies.

The COR shall state the grounds for the additional money or time requested and the amount of money or time requested, and Contractor shall include all information supporting the COR.

Contractor shall certify the COR using the form set forth in Section 4.5.5.1, except that every reference to "Claim" shall be changed to "COR." If a COR is submitted without certification, a certification can still be submitted within the timelines set forth in the first paragraph of section 4.5.2. If the COR is not timely certified, Contractor will have completely waived its rights to any money or time for that issue. Contractor will not have satisfied a condition precedent or exhausted administrative remedies.

The Owner may accept the entire COR, accept part of the COR and reject the remainder, reject the entire COR, or request additional information. If the Owner does not respond within thirty (30) days by accepting the entire COR, accepting part of the COR and rejecting the remainder, or requesting additional information, the entire COR shall be deemed rejected as of the thirtieth (30th) day. If the Owner requests additional information, then the Contractor shall submit the information within fifteen (15) days of the date of the request and the Owner shall have fifteen (15) days after the receipt of the additional information to accept or reject (in whole or in part) the COR. If the Owner fails to respond within fifteen (15) days after the submission of additional information, the entire COR shall be deemed rejected as of the fifteenth (15th) day.

4.5.3 DEFINITION OF CLAIM

A "Claim" is a separate demand by the Contractor for (a) a time extension, (b) payment of money or damages arising from work done by, or on behalf of, the Contractor, payment of which is not otherwise expressly provided for or the claimant is not otherwise entitled to, or (c) an amount the payment of which is disputed by the Owner. A claim includes any claim within the scope of Public Contract Code section 20104 et seq. Resubmittal in any manner of a COR which was previously rejected under Section 4.5.2 constitutes a Claim, whether the COR was rejected in whole or in part, and whether the COR was rejected expressly or deemed rejected by Owner inaction. A Claim includes any dispute Contractor may have with the Owner, including one which does not require a Notice of Potential Change or COR under Sections 4.5.1 and 4.5.2, and includes an alleged breach of contract by the Owner. A Claim under this Article 4.5 shall also constitute a claim for purposes of the California False Claims Act. In the event of a conflict between a Claims provision in Division 1 of the Specifications and Section 4.5, Section 4.5 shall take precedence.

The Notice of Potential Change and COR procedures above are less formal procedures which precede the more formal Claim. A Notice of Potential Change does not constitute a Claim. A COR does not constitute a Claim; **except that** if insufficient time remains before the Claim deadline (see Article 4.5.4) for Contractor to submit a COR and for Owner to process and reject

the COR under Article 4.5.2, then either (1) Contractor may submit a COR which Owner shall treat as a Claim, but only if the COR complies with all requirements in this Article 4.5 and Article 7 for COR's and Claims, or (2) a COR is not required so long as a Claim complying with this Article 4.5 is timely submitted.

A Claim does not include vouchers, invoices, progress payment applications, or other routine or authorized forms of requests for progress payments on the Contract; however, those documents remain "claims" for purposes of the California False Claims Act. A Claim does not include a Government Code Claim. ("Government Code Claim" means a claim under Government Code sections 900 et seq. and 910 et seq.)

4.5.4 TIME FOR SUBMITTING CLAIM; WAIVER

Contractor shall submit a Claim to the Owner's construction manager (or in the absence of a construction manager, to Architect and Owner) on or before the date of the Final Progress Payment. Owner's rejection, or lack of rejection, of a COR at any time does not affect the deadline for filing a Claim.

In addition, on or before submitting its request for a final progress payment based on 100% completion of the work, Contractor shall submit to Owner, in writing, a summary of all Claims for money or time extensions under or arising out of this Contract which were timely filed and which were fully compliant with the Contract's requirements for Claims. The submission of an Application for Payment for the Final Progress Payment shall constitute a complete waiver of all Claims against Owner under or arising out of this Contract, except those identified in the above summary. Contractor will not have satisfied a condition precedent or exhausted administrative remedies. This Claim summary requirement shall not extend the time for submitting a Claim.

Failure to timely submit a Claim, failure to include a Claim in the Claim summary, or failure to comply with any of the Claim requirements in the Contract, including but not limited to this Article 4, will act as a complete waiver of Contractor's rights to (a) recover money or time on the issues for which a Claim was required, (b) submit a Government Code Claim for the money or time (see Section 4.5.6.4), and (c) initiate any action, proceeding or litigation for the money or time, regardless of the merits. Contractor will not have satisfied a condition precedent or exhausted administrative remedies. Owner does not have an obligation to reject the Claim for a failure to comply with any of the Claim requirements in the Contract, including the lack of certification, and any failure by Owner to reject, or any delay in rejecting, a Claim on that basis does not waive the Owner's right to reject the Claim on that basis at a later time. In no event may the Contractor reserve its rights to assert a Claim for a time extension or additional money beyond the timelines set forth in this provision unless the Owner agrees in writing to allow the reservation.

4.5.5 CONTENT OF CLAIM

4.5.5.1 *Claim Format; Waiver.* Every Claim shall be in writing. All money or time extensions sought must be stated and itemized in the Claim at the time submitted. The

responsibility to substantiate Claims shall rest with the Contractor. In addition, the Contractor shall include a certification with each and every Claim at the time of submission, as follows:

I, [name of declarant], declare the following:

[Contractor company name] has contracted with Berryessa Union School District for the Northwood Elementary School Flexible Instructional Space Alteration and Related Modernization Project. ([Contractor company name]) authorized me to prepare the attached Claim for money and/or time extension) for Berryessa Union School District regarding this Project (dated _____, 20__, entitled _____, and requesting \$_____ and/or ____ additional days), and I prepared the attached Claim. I am the most knowledgeable person at [contractor company name] regarding this Claim.

The attached Claim complies with all laws applicable to submission of a Claim, including but not limited to California Penal Code section 72, Government Code sections 12650 et seq. (False Claims Act), and Business and Professions Code sections 17200 et seq. (Unfair Business Practices Act). I am aware that submission or certification of false claims, or other claims that violate law or the Contract, may lead to fines, imprisonment, and/or other serious legal consequences for myself or [contractor company name].

The attached Claim does not breach the Contract between [contractor company name] and Berryessa Union School District for this Project, is not a false claim, does not violate any applicable law, satisfies all provisions of the Contract applicable to submission of the Claim, only contains truthful and accurate supporting data, and only requests money and/or time extensions that accurately reflect the adjustments to money and time for which I believe that Berryessa Union School District is responsible under its Contract with [contractor company name].

While preparing this declaration and Claim I consulted with others (including attorneys, consultants, or others who work for [Contractor company name]) when necessary to ensure that the statements were true and correct.

Contractor understands and agrees that any Claim submitted without this certification does not meet the terms of the Contract Documents; that Owner, or Owner's representatives, may reject the Claim on that basis; and that unless Contractor properly and timely files the Claim with the certification, Contractor cannot further pursue the Claim in any forum and all rights to additional money or time for the issues covered by the Claim are waived due to a condition precedent not having been satisfied.

I declare under the penalty of perjury under the laws of the State of California that the foregoing is true and correct. Executed _____, 2____, at _____, California.

[name of declarant]

Contractor's failure to timely submit a certification will constitute a complete waiver of Contractor's rights to (a) recover money or time on the issues for which a Claim was required, (b) submit a Government Code Claim (see Section 4.5.6.4) for the money or time, and (c) initiate any action, proceeding or litigation for the money or time. Contractor will not have satisfied a condition precedent or exhausted administrative remedies.

4.5.5.2 *Claims for Additional Money.* Each Claim for additional money (including but not limited to those described in (b) and (c) of the first paragraph of Section 4.5.3) must include all facts supporting the Claim, including but not limited to all supporting documentation plus a written analysis as to (a) why the claimed cost was incurred, (b) why Contractor could not mitigate its costs, (c) why the claimed cost is the responsibility of the Owner, and (d) why the claimed cost is a reasonable amount. In no event will the Contractor be allowed to reserve its rights to assert a Claim for money at a later time, unless the Owner expressly agrees in writing to allow the reservation. Any costs, direct or indirect, not asserted shall be waived. A Claim may not include any costs incurred in preparation of the Claim or in preparation of any underlying COR, including but not limited to costs of delay analysis.

4.5.5.3 *Claims for Additional Time*

4.5.5.3.1 *Notice of Extent of Claim.* If the Contractor wishes to make a Claim for an increase in the Contract Time (including but not limited to Section 4.5.3(a)), the Claim shall include, but not be limited to, all facts supporting the Claim, all documentation of such facts, all information required by the Contract Documents, and a current schedule and delay analysis explaining (a) the nature of the delay, (b) the Owner's responsibility for the claimed delay, (c) the claimed delay's impact on the critical path, (d) the claimed delay's impact on completion date (including an analysis of any float still remaining and whether the alleged delay in work exceeds such remaining float), and (e) why Contractor could not mitigate the delay impacts.

In the case of a continuing delay, only one (1) initial Claim is necessary that is based on estimates of when the continuing delay will end, but within thirty (30) days of the end of the continuing delay an updated final Claim must be submitted, which shall also be certified. In no event will the Contractor be allowed to reserve its rights to assert a Claim for a time extension, unless the Owner expressly agrees in writing to allow the reservation. Any time extension not asserted shall be waived.

4.5.5.3.2 *Unusually Severe Weather Claims.* If unusually severe weather is the basis for a Claim for additional time, Contractor must provide Owner data and facts showing that the weather conditions were abnormal for the period of time, could not have been reasonably

anticipated or mitigated, and had an adverse effect on the critical path of the scheduled construction.

4.5.5.4 **“Pass Through” Claims.** A Subcontractor or supplier to Contractor may not submit a request for additional time or money directly to the Owner. If a subcontractor or supplier submits a request for additional money or time to Contractor and Contractor wishes to pass it through to Owner, then Contractor must comply with all requirements of Section 4.5, including Notices of Potential Change, Change Order Requests, and Claims. Contractor must prepare and submit its own analysis of the Subcontractor’s request, and the Claim must include a copy of the Subcontractor’s request along with any other necessary supporting documentation.

The Contractor’s analysis of the Subcontractor’s request must include Contractor’s detailed explanation as to why the Subcontractor or supplier’s request is the Owner’s responsibility, including Contractor’s analysis of (a) why the amount of damages the Subcontractor or supplier requests is justified and appropriate, (b) how Contractor’s breach of the subcontract caused the Subcontractor or supplier to incur these damages, and (c) how the Owner’s breach of the Contract caused the Contractor’s breach of the subcontract. Any Contractor Claim that fails to include the above information, or that states that Owner is responsible for the Subcontractor’s request only in the event that Contractor is found to owe money to Subcontractor, shall act as a complete waiver of Contractor’s rights to (a) recover money or time on the issues for which a Claim was required, (b) submit a Government Code Claim (see Section 4.5.6.4) for the money or time, and (c) initiate any action, proceeding or litigation for the money or time. Contractor will not have satisfied a condition precedent or exhausted administrative remedies.

4.5.6 PROCEDURES FOR CLAIMS LESS THAN OR EQUAL TO \$375,000 (PUBLIC CONTRACT CODE SECTION 20104.2)

Claims less than or equal to \$375,000 are subject to this section 4.5.6, as well as the separate procedures and substantive provisions of Sections 4.5.1 through 4.5.5.

4.5.6.1 **Claims for Less Than \$50,000.** For Claims of less than fifty thousand dollars (\$50,000), the Owner shall respond in writing to any written Claim within 45 days of receipt of the Claim, or may request, in writing, within 30 days of receipt of the Claim, any additional documentation supporting the Claim or relating to defenses to the claim the Owner may have against the Contractor.

If additional information is thereafter required, it shall be requested and provided pursuant to this subsection, upon mutual agreement of the Owner and Contractor. If Owner and Contractor cannot reach mutual agreement, Contractor’s failure to provide any reasonably-requested information within fifteen (15) days after the request, shall act as a complete waiver of Contractor’s rights to (a) recover money or time on the issues for which a Claim was required, (b) submit a Government Code Claim (see Section 4.5.6.4) for the money or time, and (c) initiate any action, proceeding or litigation for such money or time. Contractor will not have satisfied a condition precedent or exhausted administrative remedies.

The Owner's written response to the Claim, as further documented, shall be submitted to the Contractor within 15 days after receipt of the further documentation, or within a period of time no greater than that taken by the Contractor in producing the additional information, whichever is greater.

4.5.6.2 Claims Over \$50,000 and Less Than or equal to \$375,000. For claims over fifty thousand dollars (\$50,000) and less than or equal to three hundred seventy-five thousand dollars (\$375,000), the Owner shall respond in writing to all written Claims within 60 days of receipt of the Claim, or may request, in writing, within 30 days of receipt of the Claim, any additional documentation supporting the Claim or relating to defenses to the Claim the Owner may have against the Contractor.

If additional information is thereafter required, it shall be requested and provided pursuant to this subsection, upon mutual agreement of the Owner and Contractor. If Owner and Contractor cannot reach mutual agreement, Contractor's failure to provide any reasonably-requested information within thirty (30) days after the request, shall act as a complete waiver of Contractor's rights to (a) recover money or time on the issues for which a Claim was required, (b) submit a Government Code Claim (see Section 4.5.6.4) for such money or time, and (c) initiate any action, proceeding or litigation for such money or time. Contractor will not have satisfied a condition precedent or exhausted administrative remedies.

The Owner's written response to the Claim, as further documented, shall be submitted to the Contractor within 30 days after receipt of the further documentation, or within a period of time no greater than that taken by the Contractor in producing the additional information or requested documentation, whichever is greater.

4.5.6.3 Meet and Confer. If the Contractor disputes the Owner's written response, or the Owner fails to respond within the time prescribed, the Contractor may so notify the Owner, in writing, either within 15 days of receipt of the Owner's response or within 15 days of the Owner's failure to respond within the time prescribed, respectively, and demand an informal conference to meet and confer for settlement of the issues in dispute. Upon a demand, the Owner shall schedule a meet and confer conference for settlement of the dispute, which shall take place within 30 days of the demand. Upon written agreement of the Owner and Contractor, the conference may take place during regularly scheduled Project meetings.

If Contractor fails to timely notify the Owner that it wishes to meet and confer pursuant to the previous paragraph, then Contractor will have waived all rights to (a) recover money or time on the issues for which a Claim was required, (b) submit a Government Code Claim (see Section 4.5.6) for such money or time, and (c) initiate any action, proceeding or litigation for such money or time. Contractor will not have satisfied a condition precedent or exhausted administrative remedies.

If a Claim, or any portion of a Claim, over \$100,000 remains in dispute after the meet and confer and Contractor wishes to pursue it, Contractor must demand non-binding mediation in writing within fifteen (15) days. If Contractor fails to timely notify the Owner in writing that it wishes to mediate pursuant to this paragraph, Contractor will have waived all right to further pursue the

Claim pursuant to section 4.5.4. The parties shall reasonably cooperate to schedule and attend a mediation as soon as reasonably possible.

4.5.6.4 Government Code Claim. If the Claim or any portion remains in dispute after the meet and confer conference and Contractor wishes to pursue it, the Contractor **must** file a timely and proper Government Code Claim. The filing of a Government Code Claim is specifically required in addition to all contractual procedures described in Sections 4.5 through 4.5.6.3. The above contractual procedures do not act as a substitute for the Government Code Claim process, and the two sets of procedures shall be sequential with the contractual procedures coming first.

Failure to timely file a Government Code Claim shall act as complete waiver of Contractor's rights to (a) recover money or time on the issues for which a Government Code Claim was required, and (b) initiate any action, proceeding or litigation for such money or time. Contractor will not have satisfied a condition precedent or exhausted administrative remedies.

Owner and Contractor shall proceed with the Government Code Claim according to Government Code, Section 900 et seq., and as otherwise permitted by law. For purposes of the applicable Government Code provisions, and as provided in Public Contract Code section 20104.2(e), the running of the time period within which a Contractor must file a Government Code Claim shall be tolled from the time the Contractor submits a written Claim under Article 4.5 until the time that the Claim is denied, in whole or in part, as a result of the meet and confer process in Section 4.5.6.3, including any period of time utilized by the meet and confer process.

4.5.7 PROCEDURES FOR CLAIMS OVER \$375,000

Contractor and Owner shall proceed with Claims over \$375,000 pursuant to Section 4.5.6, except as follows: (a) Section 4.5.6.1, shall not be applicable; (b) for Section 4.5.6.2, Owner shall respond in writing to all written Claims within 90 days of receipt of the Claim, or may request, in writing, within 45 days of receipt of the Claim, any additional documentation supporting the Claim or relating to defenses to the Claim the Owner may have against the Contractor; (c) for Section 4.5.6.2, Owner shall respond within 45 days after receipt of the further documentation, or within a period of time no greater than that taken by the Contractor in producing the additional information or documentation, whichever is greater; and (d) for Section 4.5.6.3, following the meet and confer conference, if the Claim or any portion of it remains in dispute and Contractor wishes to pursue it, Contractor must demand in writing within fifteen (15) days that the parties mediate (non-binding). If Contractor fails to timely notify the Owner in writing that it wishes to mediate pursuant to this paragraph, then Contractor will have waived all rights to further pursue the Claim pursuant to Section 4.5.4. The parties shall reasonably cooperate to schedule and attend a mediation as soon as reasonably possible.

4.5.8 CONTINUING CONTRACT PERFORMANCE

Despite submission or rejection of a Notice of Potential Change, COR or Claim, the Contractor shall proceed diligently with performance of the Contract as directed by Owner, and the Owner shall continue to make any undisputed payments in accordance with the Contract.

4.5.9 CLAIMS FOR CONCEALED OR UNKNOWN CONDITIONS

4.5.9.1 *Trenches or Excavations Less Than Four Feet Below the Surface.* If Contractor encounters conditions at the Site which are subsurface or otherwise concealed physical conditions, which differ materially from those indicated in the Contract Documents, or unknown physical conditions of an unusual nature, which differ materially from those ordinarily found to exist and generally recognized as inherent in construction activities of the character provided for in the Contract Documents, the Contractor shall give notice to the Owner promptly before conditions are disturbed and in no event later than ten (10) days after first observance of the conditions. If Contractor believes that such conditions differ materially and will cause an increase in the Contractor's cost of, time required for, or performance of any part of the Work, Contractor must comply with the provisions above for Notice of Potential Change, Change Order Request, and Claims (beginning with Section 4.5.1).

4.5.9.2 *Trenches or Excavations Greater Than Four Feet Below the Surface.* Pursuant to Public Contract Code section 7104, when any excavation or trenching extends greater than four feet below the surface:

4.5.9.2.1 The Contractor shall promptly, and before the following conditions are disturbed, notify the public entity, in writing, of any:

(1) Material that the Contractor believes may be material that is hazardous waste, as defined in Section 25117 of the Health and Safety Code, that is required to be removed to a Class I, Class II, or Class III disposal site in accordance with the provisions of existing law.

(2) Subsurface or latent physical conditions at the site differing from those indicated by information about the site made available to bidders prior to the deadline for submitting bids.

(3) Unknown physical conditions at the site of any unusual nature, different materially from those ordinarily encountered and generally recognized as inherent in work of the character provided for in the Contract.

4.5.9.2.2 The public entity shall promptly investigate the conditions, and if it finds that the conditions do materially so differ, or do involve hazardous waste, and cause a decrease or increase in the Contractor's cost of, or the time required for, performance of any part of the work shall issue a change order under the procedures described in the Contract.

4.5.9.2.3 In the event that a dispute arises between the public entity and the Contractor whether the conditions materially differ, or involve hazardous waste, or cause a decrease or increase in the Contractor's cost of, or time required for, performance of any part of the work, the Contractor shall not be excused from any scheduled completion date provided for by the Contract, but shall proceed with all work to be performed under the Contract. The Contractor

shall retain any and all rights provided either by Contract or by law which pertain to the resolution of disputes and protests between the contracting parties.

4.5.10 INJURY OR DAMAGE TO PERSON OR PROPERTY

If either party to the Contract suffers injury or damage to person or property because of an act or omission of the other party, any of the other party's employees or agents, or others for whose acts such party is legally liable, written notice of such injury or damage, whether or not insured, shall be given to the other party within a reasonable time not exceeding ten (10) days after first observance. The notice shall provide sufficient detail to enable the other party to investigate the matter. For a Notice of Potential Change, COR and Claim for additional cost or time related to this injury or damage, Contractor shall follow Section 4.5.

ARTICLE 5

SUBCONTRACTORS

5.1 DEFINITIONS

5.1.1 SUBCONTRACTOR

A Subcontractor is a person or entity, who has a contract with the Contractor to perform a portion of the Work at the Site. The term "Subcontractor" is referred to throughout the Contract Documents as if singular in number and means a Subcontractor or an authorized representative of the Subcontractor. The term "Subcontractor" does not include a separate contractor or subcontractors of a separate contractor. To the extent that the term Trade Contractor is utilized in the Contract Documents, it shall have the same meaning as the term "Subcontractor."

5.1.2 SUB-SUBCONTRACTOR

A Sub-subcontractor is a person or entity who has a direct or indirect contract with a Subcontractor to perform a portion of the Work at the Site. The term "Sub-subcontractor" is referred to throughout the Contract Documents as if singular in number and means a Sub-subcontractor or an authorized representative of the Sub-subcontractor.

5.1.3 SPECIALTY CONTRACTORS

If a Subcontractor is designated as a "Specialty Contractor" as defined in section 7058 of the Business and Professions Code, all of the Work outside of that Subcontractor's specialty shall be performed in compliance with the Subletting and Subcontracting Fair Practices Act, Public Contract Code sections 4100, et seq.

5.2 AWARD OF SUBCONTRACTS AND OTHER CONTRACTS FOR PORTIONS OF THE WORK

5.2.1 ASSIGNMENT OR SUBSTITUTION - CONSENT OF OWNER

In accordance with Public Contract Code sections 4107 and 4107.5, no Contractor whose bid is accepted shall, without the written consent of the Owner: substitute any person or entity as a Subcontractor in place of the Subcontractor designated in the original bid; permit any such Subcontract to be assigned or transferred, or allow it to be performed by any person or entity other than the original Subcontractor listed in the original bid; sublet or subcontract any portion of the Work in excess of one-half of one percent (0.5%) of the Contractor's total bid as to which its original bid did not designate a Subcontractor. Any assignment or substitution made without the prior written consent of the awarding authority shall be void, and the assignees shall acquire no rights in the Contract. Any consent, if given, shall not relieve Contractor or its Subcontractors from their obligations under the terms of the Contract Documents.

5.2.2 GROUNDS FOR SUBSTITUTION

Pursuant to Public Contract Code section 4107 and the procedure set forth therein, no Contractor whose bid is accepted may request to substitute any person or entity as a Subcontractor in place of a Subcontractor listed in the original bid except in the following instances:

- A. When the Subcontractor listed in the bid after having a reasonable opportunity to do so, fails or refuses to execute a written Contract for the scope of work specified in the subcontractor's bid and at the price specified in the subcontractor's bid, when that written Contract, based upon the general terms, conditions, plans and specifications for the Project involved or the terms of that Subcontractor's written bid, is presented to the Subcontractor by the prime contractor;
- B. When the listed Subcontractor becomes insolvent or the subject of an order for relief in bankruptcy;
- C. When the listed Subcontractor fails or refuses to perform his or her Subcontract;
- D. When the listed Subcontractor fails or refuses to meet the bond requirements of the prime contractor set forth in Public Contract Code section 4108.
- E. When the Contractor demonstrates to the awarding authority, or its duly authorized officer, subject to the further provisions of Public Contract Code section 4107.5, that the name of the Subcontractor was listed as the result of inadvertent clerical error;
- F. When the listed Subcontractor is not licensed pursuant to the Contractors License Law; or
- G. When the awarding authority, or its duly authorized officer, determines that the Work being performed by the listed Subcontractor is substantially unsatisfactory and not in substantial accordance with the plans and specifications, or the Subcontractor is substantially delaying or disrupting the progress of the Work.

- H. When the listed Subcontractor is ineligible to work on a public works project pursuant to Section 1777.1 of the Labor Code.
- I. When the awarding authority determines that a listed Subcontractor is not a responsible contractor.

5.2.2.1 **No Change in Contract.** Any substitutions of Subcontractors shall not result in any increase in the Contract Sum or result in the granting of any extension of time for the completion of the Project.

5.2.2.2 **Substitution Due to Clerical Error.** The Contractor, as a condition of asserting a claim of inadvertent clerical error in the listing of a Subcontractor, shall, pursuant to Public Contract Code section 4107.5, within two (2) working days after the time of the prime bid opening by the awarding authority, give written notice to the awarding authority and copies of such notice to both the Subcontractor it claims to have listed in error, and the intended Subcontractor who had bid to the Contractor prior to bid opening. Any listed Subcontractor who has been notified by the Contractor in accordance with the provisions of this section as to an inadvertent clerical error, shall be allowed six (6) working days from the time of the prime bid opening within which to submit to the awarding authority and to the Contractor written objection to the Contractor's claim of inadvertent clerical error.

In all other cases, the Contractor must make a request in writing to the awarding authority for the substitution of a subcontractor, giving reasons therefore. The awarding authority shall mail a written notice to the listed Subcontractor giving reasons for the proposed substitution. The listed Subcontractor shall have five (5) working days from the date of such notice within which to file with the awarding authority written objections to the substitution.

Failure to file written objections pursuant to the provisions of this section within the times specified herein shall constitute a complete waiver of objection to the substitution by the listed Subcontractor and, where the ground for substitution is an inadvertent clerical error, an agreement by the listed Subcontractor that an inadvertent clerical error was made.

If written objections are filed, the awarding authority shall give five (5) days notice to the Contractor and to the listed Subcontractor of a hearing by the awarding authority on the Contractor's request for substitution as provided in Public Contract Code section 4107. The determination by the awarding authority shall be final.

5.3 SUBCONTRACTUAL RELATIONS

By appropriate agreement, written where legally required for validity, the Contractor shall require each Subcontractor, to the extent of the Work to be performed by the Subcontractor, to be bound to the Contractor by terms of the Contract Documents, and to assume toward the Contractor all obligations and responsibilities, which the Contractor, by the Contract Documents, assumes toward the Owner. Each subcontract agreement shall preserve and protect the rights of the Owner under the Contract Documents with respect to the Work to be performed by the

Subcontractor so that subcontracting thereof will not prejudice such rights, and shall allow to the Subcontractor, unless specifically provided otherwise in the subcontract agreement, the benefit of all rights, remedies, and redress against the Contractor that the Contractor, by the Contract Documents, has against the Owner. Where appropriate, the Contractor shall require each Subcontractor to enter into similar agreements with Sub-subcontractors. The Contractor shall make available to each proposed Subcontractor, prior to the execution of the subcontract agreement, copies of the Contract Documents to which the Subcontractor will be bound. Upon written request of the Subcontractor, the Contractor shall identify to the Subcontractor the terms and conditions of the proposed subcontract agreement, which may be at variance with the Contract Documents. Subcontractors shall similarly make copies of applicable portions of such documents available to their respective proposed Sub-subcontractors.

5.4 CONTINGENT ASSIGNMENT OF SUBCONTRACTS

Each subcontract agreement for a portion of the Work is assigned by the Contractor to the Owner provided that:

- A. Assignment is effective only after termination of the Contract with the Contractor by the Owner for cause pursuant to Article 14 and only for those subcontract agreements which the Owner accepts by notifying the Subcontractor in writing; and
- B. Assignment is subject to the prior rights of the surety, if any, obligated under any bond relating to the Contract.

5.5 SUBCONTRACTOR'S RESPONSIBILITIES

Every Subcontractor is bound to the following provisions, unless specifically noted to the contrary in the Subcontractor's contract subject to the limitations of section 5.3.

5.5.1 SUPERVISION BY SUBCONTRACTORS

Subcontractors shall efficiently supervise their Work, using their best skill and attention. Each of them shall carefully study and compare all Drawings, Specifications, and other instructions, shall at once report to Contractor any error or omission which any of them may discover, and shall subsequently proceed with the Work in accordance with instructions from the Contractor concerning such error or omission. Each Subcontractor shall be fully responsible for and shall bear the full risk of loss of all of its property.

5.5.2 DISCIPLINE AND ORDER

Each Subcontractor shall at all times enforce strict discipline and good order among its Subcontractors, material or equipment suppliers, or their agents, employees, and invitees, and shall establish and maintain surveillance over the activities of each of the foregoing to minimize any disturbance, damage, pollution, or unsightly conditions relative to property areas adjacent to or in the vicinity of the Site. The Contractor shall have the right to remove from the Work any

employee of a Subcontractor for any reason including, without limitation, incompetence or carelessness.

5.5.3 DEFECTS DISCOVERED

Should the proper and accurate performance of the Work depend upon the proper and accurate performance of other work not included in its Contract, each Subcontractor shall use all necessary means to discover any defect in such other work and shall allow the Contractor, the Owner and Architect, or other Subcontractors as Contractor elects, a reasonable amount of time to remedy such defects. If the Subcontractor should proceed with its Work, it shall be considered to have accepted such other work, unless the Subcontractor shall have proceeded pursuant to instructions in writing by the Contractor over its written objection.

5.5.4 SUBCONTRACTOR INFORMATION

Each Subcontractor shall submit to the Owner, the Contractor, or the Architect, as the case may be, promptly when requested by any of the foregoing, information with respect to the names, responsibilities, and titles of the principal members of its staff, the adequacy of the Subcontractor's equipment and the availability of necessary materials and supplies. Subcontractor shall fully cooperate with Contractor in its periodic review of the adequacy of Subcontractor's supervision, personnel, and equipment, and the availability of necessary materials and supplies and shall promptly comply with the requirements of the Contractor with respect thereto.

5.5.5 TEMPORARY STRUCTURES

Each Subcontractor shall furnish at its expense its own temporary facilities and storage except those specifically agreed to be furnished to it by the Contractor in the Subcontract Agreement. Subcontractor's material storage rooms and field offices, etc., will be placed in locations designated by the Contractor. When it becomes necessary due to the progress of the Project for the Subcontractor to relocate its field operations, it will do so in an expeditious manner and at no additional cost to Contractor or Owner. The construction of material storage rooms and field offices, etc., will be of fire resistive material only, such as concrete or gypsum block, rated drywall, or sheet metal.

5.5.6 CHARGES TO SUBCONTRACTOR

Each Subcontractor may be subject to the Contractor's reasonable charges for hoisting, repair to other work caused by the fault or negligence of Subcontractor, removal of Subcontractor's rubbish, and clean-up occasioned by Subcontractor.

5.5.7 FINES IMPOSED

Subcontractor shall comply with and pay any fines or penalties imposed for violation of any applicable law, ordinance, rule, regulation, Environmental Impact Report mitigation requirement, and lawful order of any public authority, including, without limitation, all OSHA and California OSHA requirements and those of other authorities having jurisdiction of the safety of persons or property.

5.5.8 PROJECT SIGNS

Each Subcontractor shall not display on or about the Project any sign, trademark, or other advertisement. The Owner will permit a single Project sign, which shall be subject to the Owner's prior and sole discretion and approval, as to all matters including, without limitation, size, location, material, colors, style and size of printing, logos and trademarks (if any), text, and selection of names to be displayed.

5.5.9 REMEDIES FOR FAILURE TO PERFORM

Without limitation of any other right or remedy available to Contractor under the Contract Documents or at law, should: the Subcontractor fail to perform its portion of the Work in a skilled and expeditious manner in accordance with the terms of the Contract Documents with sufficient labor, materials, equipment, and facilities; delays the progress of the job or otherwise fail in any of its obligations; or either a receiver is appointed for the Subcontractor or the Subcontractor is declared to be bankrupt or insolvent, and such appointment, bankruptcy, or insolvency proceedings or declaration is not set aside within thirty (30) days, then the Contractor, upon three (3) days notice to the Subcontractor (subject to the requirements of Pub. Contracts Code, § 4107), may provide such labor, materials, or perform such work and recover the cost plus profit and overhead from monies due or to become due thereafter to the Subcontractor. The Contractor may terminate the employment of the Subcontractor, taking possession of its tools, materials, and equipment related to the Work and cause the entire portion of the Subcontractor's Work to be finished either by another Subcontractor or through the Contractor's own forces.

5.5.10 DISPUTES NOT TO AFFECT WORK

In the event of any dispute as to whether or not any portion of the Work is within the scope of the Work to be performed by a Subcontractor, or any dispute as to whether or not the Subcontractor is entitled to a Change Order for any Work requested of it or entitled to payment, the Subcontractor shall continue to proceed diligently with the performance of the Work. Regardless of the size or nature of the dispute, the Subcontractor shall not under any circumstances cease or delay performance of its portion of the Work during the existence of the dispute. The Contractor shall continue to pay the undisputed amounts called for under the Subcontract Agreement during the existence of the dispute. Any party stopping or delaying the progress of the Work because of a dispute shall be responsible in damages to the Owner, the Architect, and the Contractor for any losses suffered as a result of the delay.

5.5.11 APPLICATION FOR PAYMENT

Contractor agrees to advise the Subcontractor if any documentation in connection with the Subcontractor's application for payment has not been accepted or is in any way unsatisfactory.

5.5.12 COMPLIANCE WITH PROCEDURES

Each Subcontractor shall comply with all procedures established by the Contractor for coordination among the Owner, the Owner's consultants, Architect, Contractor, and the various Subcontractors for coordination of the Work with all local municipal authorities, government agencies, utility companies, and any other agencies with jurisdiction over all or any portion of the Work. The Subcontractor shall cooperate fully with all of the foregoing parties and authorities.

5.5.13 ON-SITE RECORD KEEPING

Subcontractor shall comply with all on-Site record keeping systems established by the Contractor and shall, upon the request of the Contractor, provide the Contractor with such information and reports as the Contractor may deem appropriate. Without limitation of the foregoing, the Subcontractor shall assemble all required permits and certificates so that they are readily accessible at the Site.

5.5.14 NON-EXCLUSIVE OBLIGATIONS

The specific requirements of Article 5 are not intended to exclude the obligation of the Subcontractor to comply with any of the other provisions of the General Conditions and the other Contract Documents which are relevant to the proper performance of its portion of the Work.

ARTICLE 6

CONSTRUCTION BY OWNER OR BY SEPARATE CONTRACTORS

6.1 OWNER'S RIGHT TO PERFORM CONSTRUCTION AND TO AWARD SEPARATE CONTRACTS

6.1.1 OWNER'S RIGHTS

The Owner reserves the right to perform work related to the Project with the Owner's own forces, and to award separate contracts in connection with other portions of the Project or other construction or operations on the Site under Conditions of the Contract identical or substantially similar to these including those portions related to insurance. Upon the election to perform work with its own forces or by separate contracts, the Owner shall notify the Contractor. If the

Contractor claims that delay or additional cost is involved because of such action by the Owner, the Contractor shall proceed pursuant to Section 4.5 in the Contract Documents.

6.1.2 DESIGNATION AS CONTRACTOR

When separate contracts are awarded for different portions of the Project or other construction or operations on the Site, the term “Contractor” in the Contract Documents in each case shall mean the Contractor who executes each separate Owner/Contractor Agreement.

6.1.3 CONTRACTOR DUTIES

The Contractor shall have overall responsibility for coordination and scheduling of the activities of the Owner’s own forces and of each separate contractor with the Work of the Contractor, who shall cooperate with them. The Contractor shall participate with other separate contractors and the Owner in reviewing their construction schedules when directed to do so. The Contractor shall make any revisions to the construction schedule and Contract Sum deemed necessary after a joint review and mutual agreement. The construction schedules shall then constitute the schedules to be used by the Contractor, separate contractors, and the Owner until subsequently revised.

6.1.4 OWNER OBLIGATIONS

Unless otherwise provided in the Contract Documents, when the Owner performs work related to the Project with the Owner’s own forces, the Owner shall be deemed to be subject to the same obligations, and to have the same rights, which apply to the Contractor under the General Conditions, including, without excluding others, those stated in Article 3, this Article 6 and Articles 10 and 12.

6.2 MUTUAL RESPONSIBILITY

6.2.1 DELIVERY AND STORAGE

The Contractor shall afford the Owner and separate contractor’s reasonable opportunity for delivery and storage of their materials and equipment and performance of their activities, and shall connect and coordinate the separate contractors’ construction and operations with theirs as required by the Contract Documents.

6.2.2 NOTICE BY CONTRACTOR

If part of the Contractor’s Work depends upon proper execution or results from work by the Owner or a separate contractor, the Contractor shall, prior to proceeding with that portion of the Work, promptly report to the Owner patent discrepancies or defects in such other construction that would render it unsuitable for such proper execution and results. Failure of the Contractor to so report shall constitute an acknowledgment that the Owner’s or separate contractors’

completed or partially completed construction is fit and proper to receive the Contractor's Work, except as to defects not then reasonably discoverable.

6.2.3 COSTS INCURRED

Costs, expenses, and damages caused by delays, improperly timed activities, defective construction, or damages to another's work/Work or property shall be borne by the party responsible. Should Contractor/any contractor cause damage to the work/Work or property of any separate contractor on the Project, or cause any delay to any such contractor, the Contractor shall defend, indemnify and hold Owner harmless for such damage or delay under section 3.16. Owner may withhold from progress payments and/or retention the cost of delay or damage to another contractor's work or damage to another contractor's property caused by Contractor.

6.2.4 CORRECTION OF DAMAGE

The Contractor shall promptly remedy damage wrongfully caused by the Contractor to completed or partially completed construction or to property of the Owner or separate contractors.

6.3 OWNER'S RIGHT TO CLEAN UP

If a dispute arises among the Contractor, separate contractors, and the Owner as to the responsibility under their respective contracts for maintaining the premises and surrounding area free from waste materials and rubbish as described in Section 3.13, the Owner may clean up and allocate the cost among those responsible as the Owner determines to be just.

ARTICLE 7

CHANGES IN THE WORK

7.1 CHANGES

7.1.1 NO CHANGES WITHOUT AUTHORIZATION

The Owner reserves the right to change the Work by making such alterations, deviations, additions to, or deletions from the plans and specifications, as may be deemed by the Owner to be necessary or advisable for the proper completion or construction of the Work contemplated, and Owner reserves the right to require Contractor to perform such work. No adjustment will be made in the Contract unit price of any Contract item regardless of the quantity ultimately required.

Owner shall compensate Contractor with money or grant extra time for any extra work ordered by the Owner to be performed. Contractor shall follow the provisions of 7.6 and 7.7 when requesting additional money or additional time. Contractor shall expeditiously perform all extra

work upon direction, even if no agreement has been reached on extra time or money. For all such changes resulting in a credit to Owner, Contractor shall follow 7.5 and 7.7 in providing the credit to Owner. Contractor shall bring all potential credits to the Owner's attention.

There shall be no change whatsoever in the drawings, specifications, or in the Work or payments under the Contract Documents without an executed Change Order, Construction Change Directive, or order by the Owner pursuant to Section 7.1.2. Owner shall not be liable for the cost of any extra work or any substitutions, changes, additions, omissions, or deviations from the Drawings and Specifications unless the same shall have been properly requested under Section 4.5 and authorized by, and the cost thereof approved in writing by, Change Order or Construction Change Directive. No extension of time for performance of the Work shall be allowed hereunder unless request for such extension is properly made under Section 4.5 and such time is thereof approved in writing by Change Order or Construction Change Directive. The provisions of the Contract Documents shall apply to all such changes, additions, and omissions with the same effect as if originally embodied in the Drawings and Specifications.

7.1.2 AUTHORITY TO ORDER MINOR CHANGES

The Owner has authority to order minor changes in the Work not involving any adjustment in the Contract Sum, an extension of the Contract Time, or a change which is inconsistent with the intent of the Contract Documents. Such changes shall be effected by written Construction Change Directive and shall be binding on the Contractor. The Contractor shall carry out such written orders promptly.

7.2 CHANGE ORDERS ("CO")

A CO is a written instrument signed by the Owner and the Contractor, stamped (or sealed) and signed by Architect, and approved by the Owner's Governing Board and DSA where required, stating the agreement of Owner and Contractor upon all of the following:

- A. A change in the Work;
- B. The amount of the adjustment in the Contract Sum, if any; and
- C. The extent of the adjustment in the Contract Time, if any.

Unless expressly stated otherwise in the CO, any CO executed by Owner and Contractor constitutes and includes full and complete money and time (including but not limited to, adjustments to money and time) for all costs and effects caused by any of the changes described within it. Unless expressly stated otherwise in the CO, in consideration for the money received for the changes described in the CO, Contractor waives all Claims for all costs and effects caused by any of the changes, including but not limited to labor, equipment, materials, delay, extra work, overhead (home and field), profit, direct costs, indirect costs, acceleration, disruption, impaired productivity, time extensions, and any the costs and effects on Subcontractors and suppliers of any tier.

7.3 CONSTRUCTION CHANGE DIRECTIVES (“CCD”)

7.3.1 DEFINITION

A CCD is a written unilateral order signed by the Owner, and if necessary by the Architect, directing a change in the Work and stating an adjustment, if any, in the Contract Sum or Contract Time, or both. The Owner may by CCD, without invalidating the Contract, order changes in the Work within the general scope of the Contract consisting of additions, deletions, or other revisions pursuant to Section 7.1.1.

7.3.2 USE TO DIRECT CHANGE

A CCD shall be used in the absence of agreement on the terms of a CO. If Contractor disagrees with the terms of a CCD, it shall nevertheless perform the work directed by the CCD, but it may pursue the Notice of Potential Change, COR and Claim procedures of Section 4.5 if Contractor believes it is entitled to changes in the Contract Sum or Contract Time.

7.4 REQUEST FOR INFORMATION (“RFI”)

7.4.1 DEFINITION

An RFI is a written request prepared by the Contractor asking the Owner to provide additional information necessary to clarify an item which the Contractor feels is not clearly shown or called for in the drawings or specifications, or to address problems which have arisen under field conditions.

7.4.2 SCOPE

The RFI shall reference all the applicable Contract Documents including specification section, detail, page numbers, drawing numbers, and sheet numbers, etc. The Contractor shall make suggestions and/or interpretations of the issue raised by the RFI. An RFI cannot modify the Contract Sum, Contract Time, or the Contract Documents.

7.4.3 RESPONSE TIME

Unless Owner expressly directs otherwise in writing, Contractor shall submit RFIs directly to the Architect, with copies forwarded to the Owner. Contractor shall submit a revised and updated priority schedule with each RFI. The Architect shall endeavor to follow the Contractor’s requested order of priorities. The Owner and Contractor agree that an adequate time period for the Architect (or other designated recipient of the RFI) to respond to an RFI is generally fourteen (14) calendar days after the Architect’s receipt of an RFI, unless the Owner and Contractor agree otherwise in writing. However, in all cases, the Architect shall take such time, whether more or less than 14 days, as is necessary in the Architect’s professional judgment to permit adequate review and evaluation of the RFI. If Contractor informs the Architect that it needs a response to

an RFI expedited to avoid delay to the critical path, the Architect shall provide a response as quickly as reasonably possible. The total time required for the Architect to respond is subject to the complexity of the RFI, the number of RFI's submitted concurrently and the reprioritization of pending RFI's submitted by the Contractor, among other things. If Contractor believes that the Architect's response results in a change in the Work that warrants additional money or time, or that Architect's response was unreasonably delayed and caused delay to the Project's critical path, Contractor shall follow the procedures for additional money or time under Section 4.5. No presumption shall arise as to the timeliness of the response if the response is more than fourteen (14) days after the Architect's receipt of the RFI. Contractor shall review the Contract Documents before submitting an RFI to ensure that the information is not already in the Contract Documents. To compensate the Owner for time and costs incurred for each time the information was already in the Contract Documents, Owner may withhold \$100 from progress payments or retention in addition to any other remedies which Owner may have the right to pursue.

7.4.4 COSTS INCURRED

The Contractor shall be invoiced by the Owner for any costs incurred for professional services, which shall be withheld from progress payments or retention, if an RFI requests an interpretation or decision of a matter where the information sought is equally available to the party making such request.

7.5 REQUEST FOR PROPOSAL ("RFP")

7.5.1 DEFINITION

An RFP is Owner's written request asking the Contractor to submit to the Owner an estimate of the effect, including credits, of a proposed change on the Contract Sum and the Contract Time.

7.5.2 SCOPE

An RFP shall contain adequate information, including any necessary drawings and specifications, to enable Contractor to provide the cost breakdowns required by section 7.7. The Contractor shall not be entitled to any additional money for preparing a response to an RFP, whether ultimately accepted or not.

7.6 CHANGE ORDER REQUEST ("COR")

7.6.1 DEFINITION

A COR is a written request prepared by the Contractor asking the Owner for additional money or time.

7.6.2 CHANGES IN PRICE

A COR shall include breakdowns per section 7.7 to validate any proposed change in Contract Sum.

7.6.3 CHANGES IN TIME

Where a change in Contract Time is requested, a COR shall also include delay analysis to validate any proposed change to the Contract Time, and shall meet all requirements in these General Conditions, including but not limited to Section 8.4. Any additional time requested shall not be the number of days to make the proposed change, but must be based upon the impact to the Project Schedule as defined in section 3.9 and Division 1 of the Specifications.

7.7 PRICE OF CHANGE ORDERS

7.7.1 SCOPE

Any COR shall provide in writing to the Owner, the Architect and any construction manager, the effect of the proposed CO upon the Contract Sum and the actual cost of construction, which shall include a complete itemized cost breakdown of all labor and material showing actual quantities, hours, unit prices, wage rates, required for the change, and the effect upon the Contract Time of such CO.

7.7.2 DETERMINATION OF COST

The amount of the increase or decrease in the Contract Sum resulting from a CO, if any, shall be determined in one or more of the following ways as applicable to a specific situation:

- A. Mutual acceptance of a lump sum properly itemized and supported by sufficient substantiating data to permit evaluation;
- B. Unit prices stated in the Contractor's original bid, the Contract Documents, or subsequently agreed upon between the Owner and the Contractor;
- C. Cost to be determined in a manner agreed upon by the parties and a mutually acceptable fixed or percentage fee; or
- D. By cost of material and labor and percentage of overhead and profit. If the value is determined by this method the following requirements shall apply:

1. **Daily Reports by Contractor.**

a) General: At the close of each working day, the Contractor shall submit a daily report to the Inspector of Record and any construction manager, on forms approved by the Owner, together with applicable delivery tickets, listing all labor, materials, and equipment involved for that day, the location of the work, and for other services and expenditures when authorized concerning extra work items. An attempt shall be made to reconcile the report daily, and it shall be signed by the Inspector of Record and the Contractor. In the event of disagreement, pertinent notes shall be entered by each party to explain points which cannot be resolved immediately. Each party shall retain a signed copy

of the report. Reports by Subcontractors or others shall be submitted through the Contractor.

- b) Labor: Show names of workers, classifications, and hours worked.
- c) Materials: Describe and list quantities of materials used.
- d) Equipment: Show type of equipment, size, identification number, and hours of operation, including, if applicable, loading and transportation.
- e) Other Services and Expenditures: Describe in such detail as the Owner may require.

2. **Basis for Establishing Costs.**

a) Labor will be the actual cost for wages prevailing locally for each craft or type of workers at the time the extra work is done, plus employer payments of payroll taxes and insurance, health and welfare, pension, vacation, apprenticeship funds, and other direct costs resulting from Federal, State, or local laws, as well as assessments or benefits required by lawful collective bargaining agreements. The use of a labor classification, which would increase the extra work cost, will not be permitted unless the Contractor establishes the necessity for such additional costs. Labor costs for equipment operators and helpers shall be reported only when such costs are not included in the invoice for equipment rental.

b) Materials shall be at invoice or lowest current price at which such materials are locally available and delivered to the Site in the quantities involved, plus sales tax, freight, and delivery.

The Owner reserves the right to approve materials and sources of supply or to supply materials to the Contractor if necessary for the progress of the Work. No markup shall be applied to any material provided by the Owner.

c) Tool and Equipment Rental. No payment will be made for the use of tools which have a replacement value of \$100 or less.

Regardless of ownership, the rates to be used in determining equipment rental costs shall not exceed listed rates prevailing locally at equipment rental agencies or distributors at the time the work is performed.

The rental rates paid shall include the cost of fuel, oil, lubrication, supplies, small tools, necessary attachments, repairs and maintenance of any kind, depreciation, storage, insurance, and all incidentals.

Necessary loading and transportation costs for equipment used on the extra work shall be included. If equipment is used intermittently and, when not in use, could be returned to its rental source at less expense to the Owner than holding it at the work Site, it shall be returned unless the Contractor elects to keep it at the work Site at no expense to the Owner.

All equipment shall be acceptable to the Inspector of Record, in good working condition, and suitable for the purpose for which it is to be used. Manufacturer's ratings and modifications shall be used to classify equipment, and equipment shall be powered by a unit of at least the minimum rating recommended by the manufacturer.

d) Other Items. The Owner may authorize other items which may be required on the extra work. Such items include labor, services, material, and equipment which are different in their nature from those required by the Work, and which are of a type not ordinarily available from the Contractor or any of the Subcontractors. Invoices covering all such items in detail shall be submitted with the Application for Payment.

e) Invoices. Vendors' invoices for material, equipment rental, and other expenditures shall be submitted with the COR. If the Application for Payment is not substantiated by invoices or other documentation, the Owner may establish the cost of the item involved at the lowest price which was current at the time of the Daily Report.

f) Overhead, premiums and profit. For overhead, including direct and indirect costs, submit with the COR and include: home office overhead, off-Site supervision, CO preparation/negotiation/research for Owner initiated changes, time delays, project interference and disruption, additional guaranty and warranty durations, on-Site supervision, additional temporary protection, additional temporary utilities, additional material handling costs, and additional safety equipment costs.

7.7.3 **FORMAT FOR PROPOSED COST CHANGE**

The following format shall be used as applicable by the Owner and the Contractor to communicate proposed additions and deductions to the Contract.

	<u>EXTRA</u>	<u>CREDIT</u>
A. Material (attach itemized quantity and unit cost plus sales tax, invoices, receipts, truck tags, etc., for force account work)	_____	_____
B. Labor (attach itemized hours and rates, daily logs, certified payroll, etc.)	_____	_____
C. Equipment (attach any invoices)	_____	_____
D. Subtotal	_____	_____
E. If Subcontractor performed Work, add Subcontractor's overhead and profit to portions performed by Subcontractor, not to exceed fifteen percent (15%) of item D.	_____	_____
F. Liability and Property Damage Insurance, Worker's Compensation Insurance, Social Security, and Unemployment Taxes, not to exceed twenty percent (20%) of Item B.		
G. Subtotal	_____	_____
H. General Contractor's Overhead and Profit, not to exceed fifteen percent (15%) of Item G; and for work performed by subcontractors, not to exceed five percent (5%).	_____	_____
I. Subtotal	_____	_____
J. Bond not to exceed one percent (1%) of Item I.	_____	_____
K. TOTAL	_____	_____

It is expressly understood that the value of such extra work or changes, as determined by any of the aforementioned methods, expressly includes (1) any and all of the Contractor's costs and expenses, both direct and indirect, resulting from additional time required on the project or resulting from delay to the project, and (2) any costs of preparing a COR, including but not limited to delay analysis. Any costs or expenses not included are deemed waived.

It is further understood that the **total** percentage markup on any change order shall not exceed twenty five percent (25%).

7.7.4 DISCOUNTS, REBATES, AND REFUNDS

For purposes of determining the cost, if any, of any change, addition, or omission to the Work hereunder, all trade discounts, rebates, refunds, and all returns from the sale of surplus materials and equipment shall accrue and be credited to the Contractor, and the Contractor shall make provisions so that such discounts, rebates, refunds, and returns may be secured, and the amount thereof shall be allowed as a reduction of the Contractor's cost in determining the actual cost of construction for purposes of any change, addition, or omissions in the Work as provided herein.

7.7.5 ACCOUNTING RECORDS

With respect to portions of the Work performed by COs and CCDs on a time-and-materials, unit-cost, or similar basis, the Contractor shall keep and maintain cost-accounting records satisfactory to the Owner, which shall be available to the Owner on the same terms as any other books and records the Contractor is required to maintain under the Contract Documents.

7.7.6 NOTICE REQUIRED

Contractor shall submit a written Notice of Potential Change for additional money or time pursuant to section 4.5.1.

7.7.7 APPLICABILITY TO SUBCONTRACTORS

Any requirements under this Article 7 shall be equally applicable to COs or CCDs issued to Subcontractors by the Contractor to the same extent required of the Contractor.

7.8 WAIVER OF RIGHT TO CLAIM MONEY OR TIME

Failure to demand money based on costs, or time extensions, as part of a COR constitutes a complete waiver of Contractor's right to claim the omitted money or time. All money or time for an issue must be included in the COR at the time submitted.

ARTICLE 8

TIME

8.1 DEFINITIONS

8.1.1 CONTRACT TIME

Unless otherwise provided, Contract Time is the period of time, including authorized adjustments, allotted in the Contract Documents for Completion of the Work.

8.1.2 NOTICE TO PROCEED

Contractor shall not commence the Work until it receives a Notice to Proceed from Owner. The date of commencement of the Work is the date established in the Notice to Proceed. The date of commencement shall not be postponed by the failure to act of the Contractor or of persons or entities for whom the Contractor is responsible.

8.1.3 DAYS

The term “day” as used in the Contract Documents shall mean calendar day unless otherwise specifically defined.

8.2 HOURS OF WORK

8.2.1 SUFFICIENT FORCES

Contractors and Subcontractors shall furnish sufficient forces to ensure the prosecution of the Work in accordance with the Construction Schedule.

8.2.2 PERFORMANCE DURING WORKING HOURS

Work shall be performed during regular working hours except that in the event of an emergency or when required to complete the Work in accordance with job progress, work may be performed outside of regular working hours with the advance written consent of the Owner.

8.2.3 LABOR CODE APPLICATION

As provided in Article 3 (commencing at § 1810), Chapter 1, Part 7, Division 2 of the Labor Code, eight (8) hours of labor shall constitute a legal day’s work. The time of service of any worker employed at any time by the Contractor or by any Subcontractor on any subcontract under this Contract, upon the work or upon any part of the work contemplated by this Contract, is limited and restricted to eight (8) hours during any one calendar day and forty (40) hours during any one calendar week, except as hereinafter provided. Notwithstanding the provision hereinabove set forth, work performed by employees of Contractors in excess of eight (8) hours per day and forty (40) hours during any one week shall be permitted upon this public work with compensation provided for all hours worked in excess of eight (8) hours per day at not less than one and one-half (1-1/2) times the basic rate of pay.

Contractor or subcontractor shall pay to the Owner a penalty of Twenty-five Dollars (\$25.00) for each worker employed in the execution of this Contract by the Contractor, or by any Subcontractor, for each calendar day during which such worker is required or permitted to work more than eight (8) hours in any calendar day and forty (40) hours in any one (1) calendar week, in violation of the provisions of Article 3 (commencing at § 1810), Chapter 1, Part 7, Division 2 of the Labor Code, unless compensation for the workers so employed by Contractor is not less than one and one-half (1-1/2) times the basic rate of pay for all hours worked in excess of eight (8) hours per day.

8.2.4 COSTS FOR AFTER HOURS INSPECTIONS

If the work done after hours is required by the Contract Documents to be done outside the Contractor's or the Inspector of Record's regular working hours, the costs of any inspections, if required to be done outside normal working hours, shall be borne by the Owner.

If the Owner allows the Contractor to do work outside regular working hours for the Contractor's own convenience, the costs of any inspections required outside regular working hours, among other remedies, shall be invoiced to the Contractor by the Owner and withheld from progress payments and/or retention. Contractor shall give Owner at least 48 hours notice prior to working outside regular working hours.

If the Contractor elects to perform work outside the Inspector of Record's regular working hours, costs of any inspections required outside regular working hours, among other remedies, may be invoiced to the Contractor by the Owner and withheld from progress payments and/or retention.

8.2.5 TIME FOR COMMENCEMENT BY SUBCONTRACTORS

Unless otherwise provided in the Contract Documents, all Subcontractors shall commence their Work within two (2) consecutive business days after notice to them by the Contractor and shall prosecute their Work in accordance with the progress of the Work.

8.3 PROGRESS AND COMPLETION

8.3.1 TIME OF THE ESSENCE

Time limits stated in the Contract Documents are of the essence of the Contract. By executing the Agreement the Contractor confirms that the Contract Time is a reasonable period for performing the Work.

8.3.2 NO COMMENCEMENT WITHOUT INSURANCE

The Contractor shall not knowingly, except by agreement or instruction of the Owner, in writing, commence operations on the Site or elsewhere prior to the effective date of insurance required by Article 11 to be furnished by the Contractor. The date of commencement of the Work shall not be changed by the effective date of such insurance.

8.3.3 EXPEDITIOUS COMPLETION

The Contractor shall proceed expeditiously to perform the Work, with adequate forces, labor, materials, equipment, services and management, and shall achieve Completion within the Contract Time.

8.4 EXTENSIONS OF TIME - LIQUIDATED DAMAGES

8.4.1 CONDITIONS ALLOWING FOR EXTENSIONS OF TIME TO COMPLETE THE WORK, ONLY (EXCUSABLE DELAY)

If Contractor exercises due diligence, but the critical path schedule of the Work is unavoidably delayed due to acts of God, acts of public enemy, acts of the Government, acts of the Owner or anyone employed by it, acts of another contractor in performance of a contract (other than this Contract) with the Owner, fires, floods, epidemics, quarantine restrictions, labor disputes, unusually severe weather, or delays of subcontractors due to such causes, the Owner shall extend the time to complete the Work if Contractor complies with Section 4.5 and Article 7. Owner shall take into consideration other relevant factors such as concurrent delays. Contractor has the burden of proving that any delay was excusable.

8.4.2 COMPENSABLE DELAY (TIME AND MONEY)

Compensable delays are those excusable delays for which Contractor is also entitled to money. To be compensable, an excusable delay must be one for which the Owner is responsible, where the delay was unreasonable under the circumstances involved, and where the delay was not within the contemplation of the parties; *however*, Contractor shall not be entitled to monetary compensation when (a) Contractor could have reasonably anticipated the delay and avoided or minimized the cost impacts of it, (b) there was a concurrent delay which does not qualify for monetary compensation under this paragraph, (c) the cause of the delay was reasonably unforeseen by the City or the delay was caused by factors beyond the control of the Owner, including but not limited to a delay under Section 2.2.8 above or a delay caused by a utility company's failure to perform despite Owner's reasonable arrangements for such performance; or (d) any other defense available to Owner under law or equity applies. Contractor has the burden of proving that any delay was excusable and compensable, including an analysis that establishes non-concurrency.

8.4.3 NOTICE BY CONTRACTOR REQUIRED; PROCEDURES FOR DEMANDING ADDITIONAL TIME OR MONEY

For notice and other required procedures related to requests by Contractor for additional time or money related to delay, Contractor shall comply with the Contract Documents, including but not limited to Sections 3.18 and 4.5, and Article 7, above.

8.4.4 EARLY COMPLETION

Regardless of the cause therefore, the Contractor may not maintain any Claim or cause of action against the Owner for damages incurred as a result of its failure or inability to complete its work on the Project in a shorter period than established in the Contract Documents, the parties stipulating that the period set forth in the Contract Documents is a reasonable time within which to perform the Work on the Project.

8.4.5 LIQUIDATED DAMAGES

Failure to Complete the Project within the time and in the manner provided for by the Contract Documents (i.e., by the Completion deadline) shall subject the Contractor to liquidated damages. For purposes of liquidated damages, the concept of “substantial completion” shall not constitute Completion and is not part of this agreement. The actual occurrence of damages and the actual amount of the damages which the Owner would suffer if the Project were not completed by the Completion deadline are dependent upon many circumstances and conditions which could prevail in various combinations and, from the nature of the case, it is impracticable and extremely difficult to fix the actual damages. Damages which the Owner would suffer in the event of delay include, but are not limited to, loss of the use of the Project, disruption of activities, costs of administration, supervision and the incalculable inconvenience and loss suffered by the public.

Accordingly, the parties agree that the amount set forth in the Agreement shall be presumed to be the amount of damages which the Owner shall directly incur upon failure of the Contractor to Complete the Project by the Completion deadline, during or as a result of each calendar day by which Completion of the Project is delayed beyond the Completion deadline as adjusted by Change Orders.

If the Contractor fails to Complete the Project by the Completion deadline as adjusted by Change Orders, and liquidated damages therefore accrue, the Owner, in addition to all other remedies provided by law, shall have the right to assess liquidated damages at any time, and to withhold liquidated damages (and any interest thereon) at any time from any and all retention or progress payments, which would otherwise be or become due the Contractor. In addition, if it is reasonably apparent to the Owner before the Completion deadline (as adjusted by Change Orders) that the Contractor cannot or will not complete the Work before that Completion deadline, Owner may assess and withhold, from retention or progress payments, the estimated amount of liquidated damages that will accrue in the future. If the retained percentage or withheld progress payments are not sufficient to discharge all liabilities of the Contractor incurred under this Article, the Contractor and its sureties shall continue to remain liable to the Owner until all such liabilities are satisfied in full.

If the Owner accepts any work or makes any payment under this Agreement after a default by reason of delays, the payment or payments shall in no respect constitute a waiver or modification of any Agreement provisions regarding time of Completion and liquidated damages.

8.5 GOVERNMENT APPROVALS

Owner shall not be liable for any delays or damages related to the time required to obtain government approvals.

ARTICLE 9

PAYMENTS AND COMPLETION

9.1 CONTRACT SUM

The Contract Sum is stated in the Agreement, later adjusted by Change Orders and Construction Change Directives, and is the total amount payable by the Owner to the Contractor for performance of the Work under the Contract Documents.

9.2 COST BREAKDOWN

9.2.1 REQUIRED INFORMATION

On forms approved by the Owner, the Contractor shall furnish the following:

- A. Within ten (10) days of the mailing, faxing or delivering of the Notice of Award of the Contract, a detailed breakdown of the Contract Sum (Schedule of Values) for each Project or Site. Each item in the schedule of values shall include its proper share of the overhead and profit.
- B. Within ten (10) days of the mailing, faxing or delivering of the Notice of Award of the Contract, a schedule of estimated monthly payment requests (cash flow) due the Contractor showing the values and construction time of the various portions of the Work to be performed by it and by its Subcontractors or material and equipment suppliers containing such supporting evidence as to its correctness as the Owner may require;
- C. Five (5) days prior to the submission of a pay request, an itemized breakdown of work done for the purpose of requesting partial payments;
- D. Within ten (10) days of the mailing, faxing or delivering of the Notice of Award of the Contract, the name, address, telephone number, fax number, license number, and classification of all of its Subcontractors and of all other parties furnishing labor, material, or equipment for its Contract, along with the amount of each such subcontract or the price of such labor, material, and equipment needed for its entire portion of the Work.

9.2.2 OWNER ACCEPTANCE REQUIRED

The Owner shall review all submissions received pursuant to paragraph 9.2.1 in a timely manner.

All submissions must be accepted by the Owner before becoming the basis of any payment.

9.3 APPLICATIONS FOR PAYMENT

9.3.1 PROCEDURE

On or before the fifth (5th) day of each calendar month during the progress of the portion of the Work for which payment is being requested, the Contractor shall submit to the Architect, unless there is a construction manager for the Project or the Owner directs otherwise, an itemized Application for Payment for operations completed in accordance with the Schedule of Values through the end of the previous calendar month. Such application shall be notarized, if required, and supported by the following or such portion thereof as the applicable entity requires:

- A. The amount paid to the date of the Application to the Contractor, to all its Subcontractors, and all others furnishing labor, material, or equipment for its Contract;
- B. The amount being requested with the Application for Payment by the Contractor on its own behalf and separately stating the amount requested on behalf of each of the Subcontractors and all others furnishing labor, material, and equipment under the Contract;
- C. The balance that will be due to each of such entities after said payment is made;
- D. A certification that the Record Drawings and Annotated Specifications are current;
- E. The Owner approved additions to and subtractions from the Contract Sum and Time;
- F. A summary of the retentions (each Application shall provide for retention, as set out in Article 9.6);
- G. Material invoices, evidence of equipment purchases, rentals, and other support and details of cost as the Owner may require from time to time;
- H. The percentage of completion of the Contractor's Work by line item;
- I. A statement showing all payments made by the Contractor for labor and materials on account of the Work covered in the preceding Application for Payment. Such applications shall not include requests for payment of amounts the Contractor does not intend to pay to subcontractors or others because of a dispute or other reason; and
- J. Contractor's monthly reports, daily reports, and monthly schedule updates for all months of Work prior to the Application for Payment that Contractor has not previously submitted.

9.3.2 PURCHASE OF MATERIALS AND EQUIPMENT

As the Contractor is required to order, obtain, and store materials and equipment sufficiently in advance of its Work at no additional cost or advance payment from Owner, to assure that there will be no delays, payment by the Owner for stored material shall be made only in unusual circumstances where the Architect specifically recommends, and Owner specifically approves the payment in writing. If payments are to be made on account of materials and equipment not incorporated in the Work, but delivered and suitably stored at the Site or at some other location agreed upon in writing by the Owner, the payments shall be conditioned upon submission by the Contractor, Subcontractor, or vendor of bills of sale and such other documents satisfactory to the Owner to establish the Owner's title to such materials or equipment free of all liens and encumbrances, and otherwise protect the Owner's interest, including, without limitation, provision of applicable insurance and transportation to the Site. All stored items shall be inventoried, specified by identification numbers (if applicable), released to the Owner by sureties of the Contractor and the Subcontractor and, if stored off-Site, stored only in a bonded warehouse.

9.3.3 WARRANTY OF TITLE

The Contractor warrants that title to all work covered by an Application for Payment will pass to the Owner no later than the time of payment. The Contractor further warrants that upon submittal of an Application for Payment all work for which Certificates for Payment have been previously issued and payments received from the Owner shall, to the best of the Contractor's knowledge, information, and belief, be free and clear of liens, claims, security interests, or encumbrances in favor of the Contractor, Subcontractors, material and equipment suppliers, or other persons or entities making a claim by reason of having provided labor, materials, and equipment relating to the work. Transfer of title to work does not constitute a waiver by Owner of any defects in the work.

9.4 REVIEW OF PROGRESS PAYMENT

9.4.1 OWNER ACCEPTANCE

The Owner will, within seven (7) days after receipt of the Contractor's Application for Payment, either accept such payment or notify the Contractor in writing of the Owner's reasons for withholding acceptance in whole or in part as provided in paragraph 9.5.1.

9.4.2 OWNER'S REVIEW

The review of the Contractor's Application for Payment by the Owner will be based, at least in part, on the Owner's observations at the Site and the data comprising the Application for Payment that the Work has progressed to the point indicated. The review is also subject to an evaluation of the Work for conformance with the Contract Documents, to results of subsequent tests and inspections, to minor deviations from the Contract Documents correctable prior to completion, and to specific qualifications expressed by the Owner. The Owner may reject the Application for Payment if it is not complete under section 9.3. The issuance of a Certificate for

Payment will constitute a representation that the Contractor is entitled to payment in the amount certified, subject to any specific qualifications Owner expresses in the Certificate for Payment. However, Contractor's entitlement to payment may be affected by subsequent evaluations of the Work for conformance with the Contract Documents, test and inspections and discovery of minor deviations from the Contract Documents correctable prior to completion. The issuance of a Certificate for Payment will not be a waiver by the Owner of any defects in the work covered by the Application for Payment, nor will it be a representation that the Owner has:

- A. Made exhaustive or continuous on-Site inspections to check the quality or quantity of the Work;
- B. Reviewed construction means, methods, techniques, sequences, or procedures;
- C. Reviewed copies of requisitions received from Subcontractors, material and equipment suppliers, and other data requested by the Owner to substantiate the Contractor's right to payment; or
- D. Made an examination to ascertain how or for what purpose the Contractor has used money previously paid on account of the Contract Sum.

9.5 DECISIONS TO WITHHOLD PAYMENT

9.5.1 REASONS TO WITHHOLD PAYMENT

The Owner may withhold from a progress payment, in whole or in part, to such extent as may be necessary to protect the Owner due to any of the following:

- A. Defective or incomplete Work not remedied;
- B. Stop Payment Notices. For any stop payment notice, the Owner shall withhold the amount stated in the stop payment notice, the stop notice claimant's anticipated interest and court costs and an amount to provide for the public entity's reasonable cost of any litigation pursuant to the stop payment notice. For any stop payment notice action the parties resolve before judgment is entered, Owner has the right to permanently withhold for any reasonable cost of litigation for that stop payment notice, even if it exceeds the amount originally withheld by Owner for the estimated reasonable cost of litigation. However, if (1) the Contractor at its sole expense provides a bond or other security satisfactory to the Owner in the amount of at least one hundred twenty-five percent (125%) of the claim, in a form satisfactory to the Owner, which protects the Owner against such claim, and (2) the Owner chooses to accept the bond, then Owner would release the stop payment notice funds withheld to the Contractor, except that Owner may permanently withhold for any reasonable cost of litigation. Any stop payment notice release bond shall be executed by a California admitted, fiscally solvent surety, completely unaffiliated with and separate from the surety on the payment and performance bonds, that does not have any assets pooled with the payment and performance bond sureties.

- C. Liquidated damages against the Contractor, whether already accrued or estimated to accrue in the future;
- D. Reasonable doubt that the Work can be completed for the unpaid balance of any Contract Sum or by the completion date;
- E. Damage to the property or work of the Owner, another contractor, or subcontractor;
- F. Unsatisfactory prosecution of the Work by the Contractor;
- G. Failure to store and properly secure materials;
- H. Failure of the Contractor to submit on a timely basis, proper and sufficient documentation required by the Contract Documents, including, without limitation, monthly progress schedules, shop drawings, submittal schedules, schedule of values, product data and samples, proposed product lists, executed change orders, and verified reports;
- I. Failure of the Contractor to maintain record drawings;
- J. Erroneous estimates by the Contractor of the value of the Work performed, or other false statements in an Application for Payment;
- K. Unauthorized deviations from the Contract Documents;
- L. Failure of the Contractor to prosecute the Work in a timely manner in compliance with established progress schedules and completion dates;
- M. Subsequently discovered evidence or observations nullifying the whole or part of a previously issued Certificate for Payment;
- N. Failure by Contractor to pay Subcontractors or material suppliers as required by Contract or law, which includes but is not limited to Contractor's failure to pay prevailing wage and any assessment of statutory penalties;
- O. Overpayment to Contractor on a previous payment;
- P. Credits owed to Owner for reduced scope of work or work that Contractor will not perform;
- Q. The estimated cost of performing work pursuant to Section 2.4;
- R. Actual damages related to false claims by Contractor;
- S. Breach of any provision of the Contract Documents;

- T. Owner's potential or actual loss, liability or damages caused by the Contractor; and
- U. As permitted by other provisions in the Contract or as otherwise allowed by law, including statutory penalties Owner or other entities assessed against Contractor. (See e.g., Labor Code section 1813 (working hours) or Public Contract Code section 4110 (subcontractor listings and substitutions))

Owner may, but is not required to, provide to Contractor with the progress payment written notice of the items for which Owner is withholding amounts from the payment. To claim wrongful withholding by the Owner, or if Contractor otherwise disputes any amount being withheld, Contractor must submit an inquiry in writing to Owner within thirty (30) days of receipt of the notice, and Owner shall respond within fifteen (15) days of receipt of the inquiry. If any disputed issues remain unresolved after Owner's response, Contractor shall timely submit a Claim pursuant to Section 4.5.

For any withhold amount based on an estimate where the actual amount later becomes known and certain, no later than the final accounting for the Project the Owner will release any amount withheld over that certain and known amount. If the certain and known amount exceeds the amount previously withheld, Owner may withhold additional amounts from Contractor to cover the excess amount. If available funds are not sufficient, Contractor shall pay Owner the difference.

9.5.2 PAYMENT AFTER CURE

When Contractor removes or cures the grounds for withholding amounts, payment shall be made for amounts withheld because of them. No interest shall be paid on any retainage or amounts withheld due to the failure of the Contractor to perform in accordance with the terms and conditions of the Contract Documents.

9.5.3 OVERPAYMENT AND/OR FAILURE TO WITHHOLD

Neither Owner's overpayment to Contractor, nor Owner's failure to withhold an amount from payment that Owner had the right to withhold, shall constitute a waiver by Owner of its rights to withhold those amounts from future payments to Contractor or to otherwise pursue recovery of those amounts from Contractor.

9.6 PROGRESS PAYMENTS

9.6.1 PAYMENTS TO CONTRACTOR

Unless otherwise stated in the Contract Documents, within thirty (30) days after receipt of an undisputed and properly submitted Application for Payment, Contractor shall be paid a sum equal to ninety-five percent (95%) of the undisputed value of the Work performed up to the last day of the previous month, less the aggregate of previous payments; and Owner shall retain the

other five percent (5%) of the undisputed value of the Work. The value of the Work completed shall be an estimate only, no inaccuracy or error in said estimate shall operate to release the Contractor, or any bondsman, from damages arising from such Work or from enforcing each and every provision of this Contract, and the Owner shall have the right subsequently to correct any error made in any estimate for payment. Contractor shall base an Application for Payment only on the original Contract Sum plus any fully executed and Board-approved Change Orders. Contractor shall not include Notices of Potential Claims, CORs, Claims or disputed amounts.

The Contractor shall not be entitled to have any payment requests processed, or be entitled to have any payment made for work performed, so long as any lawful or proper direction given by the Owner concerning the Work, or any portion thereof, remains uncomplished with. Payment shall not be a waiver of any such direction.

9.6.2 PAYMENTS TO SUBCONTRACTORS

No later than ten (10) days after receipt of payment from Owner, pursuant to Business and Professions Code section 7108.5, the Contractor shall pay to each Subcontractor, out of the amount paid to the Contractor on account of such Subcontractor's portion of the Work, the amount to which said Subcontractor is entitled, reflecting percentages actually retained from payments to the Contractor on account of such Subcontractor's portion of the Work. The Contractor shall, by appropriate agreement with each Subcontractor, require each Subcontractor to make payments to Sub-subcontractors in a similar manner.

9.6.3 PERCENTAGE OF COMPLETION OR PAYMENT INFORMATION

The Owner will, on request, furnish to a Subcontractor, if practicable, information regarding percentages of completion or amounts applied for by the Contractor, and action taken thereon by the Owner, on account of portions of the Work done by such Subcontractor.

9.6.4 NO OBLIGATION OF OWNER FOR SUBCONTRACTOR PAYMENT

The Owner shall have no obligation to pay, or to see to the payment of, money to a Subcontractor except as may otherwise be required by law.

9.6.5 PAYMENT TO SUPPLIERS

Payment to material or equipment suppliers shall be treated in a manner similar to that provided in paragraphs 9.6.2, 9.6.3 and 9.6.4.

9.6.6 PAYMENT NOT CONSTITUTING APPROVAL OR ACCEPTANCE

An accepted Application for Payment, issuance of a Certificate for Payment, a progress payment, or partial or entire use or occupancy of the Project by the Owner shall not constitute acceptance or approval of any portion of the Work, especially any Work not in accordance with the Contract Documents.

9.6.7 JOINT CHECKS

Owner shall have the right, if necessary for the protection of the Owner, to issue joint checks made payable to the Contractor and Subcontractors and/or material or equipment suppliers. The joint check payees shall be responsible for the allocation and disbursement of funds included as part of any such joint payment. However, Owner has no duty to issue joint checks. In no event shall any joint check payment be construed to create any contract between the Owner and a Subcontractor of any tier, any obligation from the Owner to such Subcontractor, or rights in such Subcontractor against the Owner.

9.7 COMPLETION OF THE WORK

9.7.1 CLOSE-OUT PROCEDURES

When the Contractor considers that the Work is complete and submits a written notice to Owner requesting an inspection of the Work, the Owner shall review the Work and prepare and submit to the Contractor a comprehensive list of items to be completed or corrected (the "Punch List"). The Contractor and/or its Subcontractors shall proceed promptly to complete and correct items on the Punch List. Failure to include an item on the Punch List does not alter the responsibility of the Contractor to complete all Work (including the omitted item) in accordance with the Contract Documents, and to complete or correct the work so long as the statute of limitations (or repose) has not run.

When the Contractor believes the Punch List work is complete and in accordance with the Contract Documents, it shall then submit a request for an additional inspection by the Owner to determine completion. Owner shall again inspect the Work and inform the Contractor of any items that are incomplete or incorrect. Contractor shall promptly complete or correct items until no items remain.

After the Work, including all Punch List work, is inspected and informally deemed by the Owner to be complete, the Owner's governing body may formally accept the Work as complete at a meeting of the governing body. Warranties required by the Contract Documents shall commence on the date of Contractor's completion of the Work.

9.7.2 COSTS OF MULTIPLE INSPECTIONS

More than two (2) requests by Contractor to make inspections to confirm completion as required under paragraph 9.7.1 shall be considered an additional service of Owner, and all subsequent costs will be invoiced to Contractor and withheld from remaining payments.

9.8 PARTIAL OCCUPANCY OR USE

The Owner may occupy or use any completed, or partially completed, portion of the Work at any stage prior to acceptance, or prior to completion if there is no formal acceptance. Occupancy or use of any portion of the Work, or the whole Work, shall not constitute approval or acceptance of it, nor shall such occupancy or use relieve Contractor of any of its obligations under the Contract Documents regarding that portion of, or the whole, Work.

The Owner and the Contractor shall agree in writing to the responsibilities assigned to each of them for payments, security, maintenance, heat, utilities, damage to the Work, insurance, the period for correction of the Work, and the commencement of warranties required by the Contract Documents. When the Contractor considers a portion complete, the Contractor may request an inspection of that portion and preparation of a Punch List by the Owner for that portion, as set forth for the entire Work under paragraph 9.7.1; however, such inspection and Punch List shall not act as any form of approval or acceptance of that portion of the Work, or of any Work not complying with the requirements of the Contract, and that portion shall be subject to subsequent inspections and Punch Lists.

Immediately prior to such partial occupancy or use, the Owner, the Architect and the Contractor shall jointly inspect the area to be occupied or portion of the Work to be used in order to determine and record the condition of the Work.

9.9 FINAL PROGRESS PAYMENT AND RELEASE OF RETENTION

9.9.1 FINAL APPLICATION FOR PROGRESS PAYMENT

When, pursuant to Section 9.7.1, the Owner finds all of the Work is completed in accordance with the Contract Documents, it shall so notify Contractor, who shall then submit to the Owner its final Application for Payment.

Upon receipt and approval of such final Application for Payment, the Owner shall issue a final Certificate of Payment, based on its knowledge, information, and belief, and on the basis of its observations, inspections, and all other data accumulated or received by the Owner in connection with the Work, that such Work has been completed in accordance with the Contract Documents.

9.9.2 PROCEDURES FOR APPLICATION FOR FINAL PROGRESS PAYMENT

The Application for Final Progress Payment pursuant to Section 9.9.1 shall be accompanied by the same details as set forth in paragraph 9.3, and in addition, the following conditions must be fulfilled:

- A. The Work shall be complete, and the Contractor shall have made, or caused to have been made, all corrections to the Work which are required to remedy any defects therein, to obtain compliance with the Contract Documents or any requirements of applicable codes and ordinances, or to fulfill any of the orders or directions of Owner required under the Contract.
- B. Each Subcontractor shall have delivered to the Contractor all written guarantees, warranties, applications, and bonds required by the Contract Documents for its portion of the Work, and Contractor delivered them to the Owner.
- C. The Contractor shall deliver to the Owner (i) reproducible final Record Drawings and Annotated Specifications showing the Contractor's Work "as built," with the Contractor's certification of the accuracy of the Record Drawings and Annotated

Specifications, (ii) all warranties and guarantees, (iii) operation and maintenance instructions, manuals and materials for equipment and apparatus, and (iv) all other documents required by the Contract Documents.

- D. Contractor shall provide extensive assistance in the utilization of any equipment or system such as initial start-up or testing, adjusting and balancing, preparation of operation and maintenance manuals and training personnel for operation and maintenance.

Acceptance of Final Progress Payment shall constitute a complete waiver of Claims except for those previously identified in writing and identified by that payee as unsettled at the time of Final Progress Payment.

9.9.3 **RELEASE OF RETAINAGE**

Owner may withhold from release or payment of retainage (or “retention”) up to 150% of disputed amounts listed in Section 9.5. If retainage is held in an escrow account pursuant to an escrow agreement under Public Contract Code section 22300 (see Section 9.10) and Owner withholds from release of retainage based on a breach of the Contract, or other default, by Contractor, Owner may withdraw the withheld retainage from the escrow account. Owner shall release the undisputed retainage within sixty (60) days after completion of the Work. For this purpose, “completion” is defined in Public Contract Code section 7107(c). No interest shall be paid on any retainage, or on any amounts withheld, except as provided to the contrary in any Escrow Agreement and General Conditions between the Owner and the Contractor under Public Contract Code section 22300.

9.10 **SUBSTITUTION OF SECURITIES**

In accordance with section 22300 of the Public Contract Code, the Owner will permit the substitution of securities for any retention monies withheld by the Owner to ensure performance under the Contract. At the request and expense of the Contractor, securities equivalent to the amount withheld shall be deposited with the Owner, or with a state or federally chartered bank as the escrow agent, who shall then pay such retention monies to the Contractor. Upon completion of the Contract, the securities shall be returned to the Contractor if Owner has no basis to withhold under the Contract Documents.

Securities eligible for investment under this section shall include those listed in Government Code section 16430, bank or savings and loan certificates of deposit, interest-bearing, demand-deposit accounts, standby letters of credit, or any other security mutually agreed to by the Contractor and the Owner.

The Contractor shall be the beneficial owner of any securities substituted for monies withheld and shall receive any interest thereon.

Any escrow agreement entered by Owner and Contractor pursuant to Public Contract Code section 22300, shall be substantially similar to the form set forth in Public Contract Code section 22300.

ARTICLE 10

PROTECTION OF PERSONS AND PROPERTY

10.1 SAFETY PRECAUTIONS AND PROGRAMS

10.1.1 CONTRACTOR RESPONSIBILITY

The Contractor shall have responsibility for initiating, maintaining, and supervising all safety precautions and programs in connection with the performance of the Contract. Each Contractor shall designate a responsible member of its organization whose duties shall include loss and accident prevention, and who shall have the responsibility and full authority to enforce the program. This person shall attend meetings with the representatives of the various Subcontractors employed to ensure that all employees understand and comply with the programs. Contractor will ensure that his employees and Subcontractors cooperate and coordinate safety matters with any other contractors to form a joint safety effort.

10.1.2 SUBCONTRACTOR RESPONSIBILITY

Subcontractors have the responsibility for participating in, and enforcing, the safety and loss prevention programs established by the Contractor for the Project, which will cover all Work performed by the Contractor and its Subcontractors. Each Subcontractor shall designate a responsible member of its organization whose duties shall include loss and accident prevention, and who shall have the responsibility and full authority to enforce the program. This person shall attend meetings with the representatives of the various Subcontractors employed to ensure that all employees understand and comply with the programs.

10.1.3 COOPERATION

All Subcontractors and material or equipment suppliers, shall cooperate fully with Contractor, the Owner, and all insurance carriers and loss prevention engineers.

10.1.4 ACCIDENT REPORTS

Subcontractors shall promptly report in writing to the Contractor all accidents whatsoever arising out of, or in connection with, the performance of the Work, whether on or off the Site, which caused death, personal injury, or property damage, giving full details and statements of witnesses. In addition, if death or serious injuries or serious damages are caused, the accident shall be reported immediately by telephone or messenger. Contractor shall thereafter promptly report the facts in writing to the Owner giving full details of the accident.

10.1.5 FIRST-AID SUPPLIES AT SITE

The Contractor will provide and maintain at the Site first-aid supplies for minor injuries.

10.2 SAFETY OF PERSONS AND PROPERTY

10.2.1 THE CONTRACTOR

The Contractor shall take reasonable precautions for the safety of, and shall provide reasonable protection to prevent damage, injury, or loss to:

- A. Employees on the Work and other persons who may be affected thereby;
- B. The Work, material, and equipment to be incorporated therein, whether in storage on or off the Site, under the care, custody, or control of the Contractor or the Contractor's Subcontractors or Sub-subcontractors; and
- C. Other property at the Site or adjacent thereto such as trees, shrubs, lawns, walks, pavement, roadways, structures, and utilities not designated for removal, relocation, or replacement in the course of construction.

10.2.2 CONTRACTOR NOTICES

The Contractor shall give notices and comply with applicable laws, ordinances, rules, regulations, and lawful orders of public authorities bearing on the safety of persons or property or their protection from damage, injury, or loss.

10.2.3 SAFETY BARRIERS AND SAFEGUARDS

The Contractor shall erect and maintain, as required by existing conditions and performance of the Contract, reasonable safeguards for safety and protection, including posting danger signs and other warnings against hazards, promulgating safety regulations, and notifying owners and users of adjacent sites and utilities.

10.2.4 USE OR STORAGE OF HAZARDOUS MATERIAL

When use or storage of explosives, other hazardous materials or equipment, or unusual methods are necessary for execution of the Work, the Contractor shall exercise utmost care and carry on such activities under supervision of properly qualified personnel. The Contractor shall notify the Owner any time that explosives or hazardous materials are expected to be stored on Site. Location of storage shall be coordinated with the Owner and local fire authorities.

10.2.5 FINGERPRINTING

At its own expense, Contractor shall comply with all fingerprinting requirements under law and Contract, including but not limited to the requirements of Education Code section 45125.2 and the Independent Contractor Student Contact Form which is a part of the Contract. Contractor

shall hold harmless, defend and indemnify the Owner under section 3.16, for any costs, including attorneys' fees, Owner incurs from Contractor's failure to comply.

10.3 PROTECTION OF WORK AND PROPERTY

10.3.1 PROTECTION OF WORK

The Contractor and Subcontractors shall continuously protect the Work, the Owner's property, and the property of others, from damage, injury, or loss until formal acceptance of the Work or completion of the Work if there is no formal acceptance of the Work. The Contractor and Subcontractors shall make good any such damage, injury, or loss, except such as may be solely due to, or caused by, agents or employees of the Owner.

10.3.2 PROTECTION FOR ELEMENTS

The Contractor will remove all mud, water, or other elements as may be required for the proper protection and prosecution of its Work. The Contractor shall at all times provide heat, coverings, and enclosures necessary to maintain adequate protection against weather so as to preserve the Work, materials, equipment, apparatus, and fixtures free from injury or damage.

10.3.3 SHORING AND STRUCTURAL LOADING

The Contractor shall not impose structural loading upon any part of the Work under construction or upon existing construction on or adjacent to the Site in excess of safe limits, or loading such as to result in damage to the structural, architectural, mechanical, electrical, or other components of the Work. The design of all temporary construction equipment and appliances used in construction of the Work and not a permanent part thereof, including, without limitation, hoisting equipment, cribbing, shoring, and temporary bracing of structural steel, is the sole responsibility of the Contractor. All such items shall conform to the requirements of governing codes and all laws, ordinances, rules, regulations, and orders of all authorities having jurisdiction. The Contractor shall take special precautions, such as shoring of masonry walls and temporary tie bracing of structural steel work, to prevent possible wind damage during construction of the Work. The installation of such bracing or shoring shall not damage or cause damage to the Work in place or the Work installed by others. Any damage which does occur shall be promptly repaired by the Contractor at no cost to the Owner.

10.3.4 CONFORMANCE WITHIN ESTABLISHED LIMITS

The Contractor and Subcontractors shall confine their construction equipment, the storage of materials, and the operations of workers to the limits indicated by laws, ordinances, permits, and the limits established by the Owner, and shall not unreasonably encumber the premises with construction equipment or materials.

10.3.5 SUBCONTRACTOR ENFORCEMENT OF RULES

Subcontractors shall enforce the Owner's and the Contractor's instructions, laws, and regulations regarding signs, advertisements, fires, smoking, the presence of liquor, and the presence of firearms by any person at the Site.

10.3.6 SITE ACCESS

The Contractor and the Subcontractors shall use only those ingress and egress routes designated by the Owner, observe the boundaries of the Site designated by the Owner, park only in those areas designated by the Owner, which areas may be on or off the Site, and comply with any parking control program established by the Owner such as furnishing license plate information and placing identifying stickers on vehicles.

10.3.7 PROTECTION OF MATERIALS

The Contractor and the Subcontractors shall receive, count, inspect for damage, record, store, and protect construction materials for the Work and Subcontractors shall promptly send to the Contractor evidence of receipt of such materials, indicating thereon any shortage, change, or damage (failure to so note shall constitute acceptance by the Subcontractor of financial responsibility for any shortage).

10.4 EMERGENCIES

10.4.1 EMERGENCY ACTION

In an emergency affecting the safety of persons or property, the Contractor shall take any action necessary, at the Contractor's discretion, to prevent threatened damage, injury, or loss. Additional money or extension of time claimed by the Contractor on account of an emergency shall be determined as provided in Section 4.5 and Article 7.

10.4.2 ACCIDENT REPORTS

The Contractor shall promptly report in writing to the Owner all accidents arising out of or in connection with the Work, which caused death, personal injury, or property damage, giving full details and statements of any witnesses. In addition, if death, serious personal injuries, or serious property damages are caused, the accident shall be reported immediately by telephone or messenger to the Owner.

10.5 HAZARDOUS MATERIALS

10.5.1 DISCOVERY OF HAZARDOUS MATERIALS

In the event the Contractor encounters or suspects the presence on the Site material reasonably believed to be asbestos, polychlorinated biphenyl (PCB), or any other material defined as being hazardous by section 25249.5 of the California Health and Safety Code, which (a) has not been rendered harmless, and (b) the handling or removal of which is not within the scope of the Work, the Contractor shall immediately stop Work in the area affected and report the condition to the Owner and the Architect in writing, whether or not such material was generated by the

Contractor or the Owner. The Work in the affected area shall not thereafter be resumed, except by written agreement of the Owner and the Contractor, if in fact the material is asbestos, polychlorinated biphenyl (PCB), or other hazardous material, and has not been rendered harmless. The Work in the affected area shall be resumed only in the absence of asbestos, polychlorinated biphenyl (PCB), or other hazardous material, or when it has been rendered harmless by written agreement of the Owner and the Contractor.

10.5.2 HAZARDOUS MATERIAL WORK LIMITATIONS

In the event that the presence of hazardous materials is suspected or discovered on the Site, the Owner shall retain an independent testing laboratory to determine the nature of the material encountered and whether corrective measures or remedial action is required. The Contractor shall not be required pursuant to Article 7 to perform without consent any Work in the affected area of the Site relating to asbestos, polychlorinated biphenyl (PCB), or other hazardous material, until any known or suspected hazardous material has been removed, or rendered harmless, or determined to be harmless by Owner, as certified by an independent testing laboratory and/or approved by the appropriate government agency.

10.5.3 INDEMNIFICATION BY OWNER FOR HAZARDOUS MATERIAL NOT CAUSED BY CONTRACTOR

In the event the presence of hazardous materials on the Site is not caused by the Contractor, Owner shall pay for all costs of testing and remediation, if any, and shall compensate Contractor for any additional costs incurred or Project delay in accordance with the applicable provisions of Article 7 herein. Owner shall defend, indemnify and hold harmless the Contractor and its agents, officers, directors and employees from and against any and all claims, damages, losses, costs and expenses incurred in connection with or arising out of, or relating to, the performance of the Work in the area affected by the hazardous material, except to the extent the claims, damages, losses, costs, or expenses were caused by Contractor's active negligence, sole negligence or willful misconduct. By providing this indemnification, District does not waive any immunities.

10.5.4 INDEMNIFICATION BY CONTRACTOR FOR HAZARDOUS MATERIAL CAUSED BY CONTRACTOR

In the event the presence of hazardous materials on the Site is caused by Contractor, Subcontractors, materialmen or suppliers, the Contractor shall pay for all costs of testing and remediation, if any, and shall compensate the Owner for any additional costs incurred as a result of the generation of hazardous material on the Project Site. In addition, the Contractor shall defend, indemnify and hold harmless Owner and its agents, officers, and employees from and against any and all claims, damages, losses, costs and expenses incurred in connection with, arising out of, or relating to, the presence of hazardous material on the Site, except to the extent the claims, damages, losses, costs, or expenses were caused by Owner's active negligence, sole negligence or willful misconduct.

10.5.5 TERMS OF HAZARDOUS MATERIAL PROVISION

The terms of this Hazardous Material provision shall survive the completion of the Work and/or any termination of this Contract.

10.5.6 ARCHEOLOGICAL MATERIALS

In the event the Contractor encounters or reasonably suspects the presence on the Site of archeological materials, the Contractor shall immediately stop Work in the area affected and report the condition to the Owner and the Architect in writing. The Work in the affected area shall not thereafter be resumed, except after Contractor's receipt of written notice from the Owner.

ARTICLE 11

INSURANCE AND BONDS

11.1. CONTRACTOR'S LIABILITY INSURANCE

11.1.1 LIABILITY INSURANCE REQUIREMENTS

11.1.1 By the earlier of the deadline set forth in the Instructions to Bidders or the commencement of the Work and within limits acceptable to the Owner, the Contractor shall purchase from and maintain in a company or companies lawfully authorized to do business in California as admitted carriers with a financial rating of at least A+, Class XII status as rated in the most recent edition of Best's Insurance Reports such commercial general liability insurance per occurrence for bodily injury, personal injury and property damage as set forth in the Agreement and automobile liability insurance per accident for bodily injury and property damage combined single limit as set forth in the Agreement as will protect the Contractor from claims set forth below, which may arise out of or result from the Contractor's operations under the Contract and for which the Contractor may be legally liable, whether such operations are by the Contractor, by a Subcontractor, by Sub-subcontractor, by anyone directly or indirectly employed by any of them, or by anyone for whose acts any of them may be liable:

- 11.1.1.1 claims for damages because of bodily injury (including emotional distress), sickness, disease, or death of any person other than the Contractor's employees. This coverage shall be provided in a form at least as broad as Insurance Services Office (ISO) Form CG 0001 11188;
- 11.1.1.2 claims for damages arising from personal or advertising injury in a form at least as broad as ISO Form CG 0001 11188;
- 11.1.1.3 claims for damages because of injury or destruction of tangible property, including loss of use resulting therefrom, arising from operations under the Contract Documents; and

- 11.1.1.4 claims for damages because of bodily injury, death of a person, or property damage arising out of the ownership, maintenance, or use of a motor vehicle, all mobile equipment, and vehicles moving under their own power and engaged in the Work; and
- 11.1.1.5 claims involving blanket contractual liability applicable to the Contractor's obligations under the Contract Documents, including liability assumed by and the indemnity and defense obligations of the Contractor and the Subcontractors; and
- 11.1.1.6 claims involving Completed Operations, Independent Contractors' coverage, and Broad Form property damage, without any exclusions for collapse, explosion, demolition, underground coverage, and excavating. (XCU)

If commercial general liability insurance or another insurance form with a general aggregate limit is used, either the general aggregate limit shall apply separately to the project location (with the ISO CG 2501 or insurer's equivalent endorsement provided to the Owner) or the general aggregate limit shall be twice the required occurrence limit.

Any deductible or self-insured retention must be declared to and approved by the Owner. At the option of the Owner, either the insurer shall reduce or eliminate such deductibles or self-insured retentions as respects the Owner, its Board of Trustees, members of its Board of Trustees, officers, employees, agents and volunteers; or the Contractor shall procure a bond guaranteeing payment of losses and related investigations, claim administration and defense expenses.

11.1.2 SUBCONTRACTOR INSURANCE REQUIREMENTS

The Contractor shall require its Subcontractors and any Sub-subcontractors to take out and maintain similar public liability insurance and property damage insurance, in a company or companies lawfully authorized to do business in California as admitted carriers with a financial rating of at least A+, Class XII status as rated in the most recent edition of Best's Insurance Reports, in like amounts and scope of coverage.

11.1.3 OWNER'S INSURANCE

The Owner shall be responsible for purchasing and maintaining the Owner's usual liability insurance. Optionally, the Owner may purchase and maintain other insurance for self protection against claims which may arise from operations under the Contract. The Contractor shall not be responsible for purchasing and maintaining this optional Owner's liability insurance unless specifically required by the Contract Documents.

11.1.4 ADDITIONAL INSURED ENDORSEMENT REQUIREMENTS

The Contractor shall name, on any policy of insurance, the Owner and the Architect as additional insureds. Subcontractors shall name the Contractor, the Owner and the Architect as additional insureds. The Additional Insured Endorsement included on all such insurance policies shall state

that coverage is afforded the additional insured with respect to claims arising out of operations performed by or on behalf of the insured. If the additional insureds have other insurance which is applicable to the loss, such other insurance shall be excess to any policy of insurance required herein. The amount of the insurer's liability shall not be reduced by the existence of such other insurance.

11.1.5 WORKERS' COMPENSATION INSURANCE

During the term of this Contract, the Contractor shall provide workers' compensation insurance for all of the Contractor's employees engaged in Work under this Contract on or at the site of the Project and, in case any of the Contractor's work is sublet, the Contractor shall require the Subcontractor to provide workers' compensation insurance for all the Subcontractor's employees engaged in Work under the subcontract. Any class of employee or employees not covered by a Subcontractor's insurance shall be covered by the Contractor's insurance. In case any class of employees engaged in Work under this Contract on or at the site of the Project is not protected under the Workers' Compensation laws, the Contractor shall provide or cause a Subcontractor to provide adequate insurance coverage for the protection of those employees not otherwise protected. The Contractor shall file with the Owner certificates of insurance as required under this Article and in compliance with Labor Code section 3700.

If the contractor fails to maintain such insurance, the Owner may take out compensation insurance which the Owner might be liable to pay under the provisions of the Act by reason of an employee of the Contractor being injured or killed, and withhold from progress payments and/or retention the amount of the premium for such insurance.

11.1.6 BUILDER'S RISK/"ALL RISK" INSURANCE

11.1.6.1 COURSE-OF-CONSTRUCTION INSURANCE REQUIREMENTS. Unless provided by Owner at Owner's sole discretion, Contractor, during the progress of the Work and until final acceptance of the Work by Owner upon completion of the entire Contract, shall maintain Builder's Risk/Course-of-Construction insurance satisfactory to the Owner, issued on a completed value basis on all insurable Work included under the Contract Documents. This insurance shall insure against all risks, including but not limited to the following perils: vandalism, theft, malicious mischief, fire, sprinkler leakage, civil authority, sonic boom, explosion, collapse, flood, earthquake (for projects not solely funded through revenue bonds, limited to earthquakes equivalent to or under 3.5 on the Richter Scale in magnitude), wind, hail, lightning, smoke, riot or civil commotion, debris removal (including demolition) and reasonable compensation for the Architect's services and expenses required as a result of such insured loss. This insurance shall provide coverage in an amount not less than the full cost to repair, replace or reconstruct the Work. Such insurance shall include the Owner, the Architect, and any other person or entity with an insurable interest in the Work as an additional named insured.

The Contractor shall submit to the Owner for its approval all items deemed to be uninsurable under the Builder's Risk/Course-of Construction insurance. The risk of the damage to the Work due to the perils covered by the Builder's Risk/Course-of-Construction insurance, as well as any other hazard which might result in damage to the Work, is that of the Contractor and the surety,

and no claims for such loss or damage shall be recognized by the Owner, nor will such loss or damage excuse the complete and satisfactory performance of the Contract by the Contractor.

11.1.7 CONSENT OF INSURER FOR PARTIAL OCCUPANCY OR USE

Partial occupancy or use in accordance with the Contract Documents shall not commence until the insurance company providing property insurance has consented to such partial occupancy or use by endorsement or otherwise. The Owner and the Contractor shall take reasonable steps to obtain consent of the insurance company and shall, without mutual consent, take no action with respect to partial occupancy or use that would cause cancellation, lapse, or reduction of the insurance.

11.1.8 FIRE INSURANCE

Before the commencement of the Work, the Contractor shall procure, maintain, and cause to be maintained at the Contractor's expense, fire insurance on all Work included under the Contract Documents, insuring the full replacement value of such Work as well as the cost of any removal and demolition necessary to replace or repair all Work damaged by fire. The amount of fire insurance shall be subject to approval by the Owner and shall be sufficient to protect the Project against loss or damage in full until the Work is accepted by the Owner. Should the Work being constructed be damaged by fire or other causes during construction, it shall be replaced in accordance with the requirements of the drawings and specifications without additional expense to the Owner.

11.1.9 OTHER INSURANCE

The Contractor shall provide all other insurance required to be maintained under applicable laws, ordinances, rules, and regulations.

11.1.10 PROOF OF CARRIAGE OF INSURANCE

The Contractor shall not commence Work nor shall it allow any Subcontractor to commence Work under this Contract until all required insurance, certificates, and an Additional Insured Endorsement and Declarations Page have been obtained and delivered in duplicate to the Owner for approval subject to the following requirements:

- (a) Certificates and insurance policies shall include the following clause:

This policy shall not be non-renewed, canceled, or reduced in required limits of liability or amounts of insurance until notice has been mailed to the Owner. Date of cancellation or reduction may not be less than thirty (30) days after the date of mailing notice.

- (b) Certificates of insurance shall state in particular those insured, the extent of insurance, location and operation to which the insurance applies, the expiration date, and cancellation and reduction notices.

- (c) Certificates of insurance shall clearly state that the Owner, the Architect and the Construction Manager are named as additional insureds under the policy described and that such insurance policy shall be primary to any insurance or self-insurance maintained by Owner and any other insurance carried by the Owner with respect to the matters covered by such policy shall be excess and non-contributing.
- (d) The Contractor and its Subcontractors shall produce a certified copy of any insurance policy required under this Section upon written request of the Owner.

11.1.11 COMPLIANCE

In the event of the failure of any contractor to furnish and maintain any insurance required by this Article, the Contractor shall be in default under the Contract. Compliance by Contractor with the requirement to carry insurance and furnish certificates, policies, Additional Insured Endorsement and Declarations Page evidencing the same shall not relieve the Contractor from liability assumed under any provision of the Contract Documents, including, without limitation, the obligation to defend and indemnify the Owner and the Architect.

11.2 PERFORMANCE AND PAYMENT BONDS

11.2.1 BOND REQUIREMENTS

Unless otherwise specified in the Contract Documents, prior to commencing any portion of the Work, the Contractor shall apply for and furnish Owner separate payment and performance bonds for its portion of the Work which shall cover 100% faithful performance of and payment of all obligations arising under the Contract Documents and/or guaranteeing the payment in full of all claims for labor performed and materials supplied for the Work. All bonds shall be provided by a corporate surety authorized and admitted to transact business in California. All bonds shall be submitted on the Owner's approved form.

To the extent, if any, that the Contract Sum is increased in accordance with the Contract Documents, the Contractor shall cause the amount of the bonds to be increased accordingly and shall promptly deliver satisfactory evidence of such increase to the Owner. To the extent available, the bonds shall further provide that no change or alteration of the Contract Documents (including, without limitation, an increase in the Contract Sum, as referred to above), extensions of time, or modifications of the time, terms, or conditions of payment to the Contractor will release the surety. If the Contractor fails to furnish the required bond, the Owner may terminate the Contract for cause.

11.2.2 SURETY QUALIFICATION

Only bonds executed by admitted Surety insurers as defined in Code of Civil Procedure section 995.120 shall be accepted. The surety insurers must, unless otherwise agreed to by Owner in writing, at the time of issuance of the bonds, have a rating not lower than "A-" as rated

by A.M. Best Company, Inc. or other independent rating companies. Owner reserves the right to approve or reject the surety insurers selected by Contractor and to require Contractor to obtain bonds from surety insurers satisfactory to the Owner.

ARTICLE 12

UNCOVERING AND CORRECTION OF WORK

12.1 UNCOVERING OF WORK

12.1.1 UNCOVERING WORK FOR REQUIRED INSPECTIONS

If a portion of the Work is covered contrary to the Owner's request or to requirements specifically expressed in the Contract Documents, Contractor must, if required in writing by the Owner, uncover it for the Owner's observation and replace the removed work at the Contractor's expense without change in the Contract Sum or Time.

12.1.2 COSTS FOR INSPECTIONS NOT REQUIRED

If a portion of the Work has been covered which the Owner has not specifically requested to observe prior to its being covered, the Owner may request to see such work, and it shall be uncovered by the Contractor. If such work is in accordance with the Contract Documents, costs of uncover and replacement shall, by appropriate Change Order, be paid by the Owner. If such work is not in accordance with Contract Documents, the Contractor shall pay such costs, unless the condition was caused by the Owner or a separate contractor, in which event the Owner shall be responsible for payment of such costs to the Contractor.

12.2 CORRECTION OF WORK; WARRANTY

12.2.1 CORRECTION OF REJECTED WORK

The Contractor shall promptly correct the work rejected by the Owner for failing to conform to the requirements of the Contract Documents, until the statutes of limitation (or repose) and all warranties have run, as applicable, and whether or not fabricated, installed or completed. The Contractor shall bear costs of correcting the rejected work, including additional testing, inspections, and compensation for the Owner's expenses and costs incurred.

12.2.2 REMOVAL OF NONCONFORMING WORK

The Contractor shall remove from the Site portions of the Work which are not in accordance with the requirements of the Contract Documents and are not corrected by the Contractor or accepted or approved by the Owner.

12.2.3 OWNER'S RIGHTS IF CONTRACTOR FAILS TO CORRECT

If the Contractor fails to correct nonconforming work within a reasonable time, the Owner may correct it in accordance with Section 2.4. As part of Owner's correction of the work, the Owner

may remove any portion of the nonconforming Work and store any salvageable materials or equipment at the Contractor's expense. If the Contractor does not pay costs of such removal and storage within ten (10) days after written notice, the Owner may upon ten (10) additional days written notice sell such material or equipment at auction or at private sale and shall account for the proceeds thereof, after deducting costs and damages that should have been borne by the Contractor, including compensation for the Architect's and other professionals and representatives' services and expenses, made necessary thereby. If such proceeds of sale do not cover costs which the Contractor should have borne, the Contractor shall be invoiced for the deficiency or Owner may withhold such costs from payment pursuant to Section 9.5. If progress payments or retention then or thereafter due the Contractor are not sufficient to cover such amount, the Contractor shall pay the difference to the Owner.

12.2.4 COST OF CORRECTING THE WORK

The Contractor shall bear the cost of correcting destroyed or damaged construction of the Owner or separate contractors, whether completed or partially completed, caused by the Contractor's correction or removal of the nonconforming work.

12.2.5 WARRANTY CORRECTIONS (INCLUDES REPLACEMENT)

Pursuant to the warranty in Section 3.5, if within one (1) year after the completion of the Work or within a longer time period for an applicable special warranty or guarantee required by the Contract Documents, any of the Work does not comply with the Contract Documents, the Contractor shall correct it after receipt of Owner's written notice to do so, unless the Owner has previously waived in writing such right to demand correction. Contractor shall correct the Work promptly, and passage of the applicable warranty period shall not release Contractor from its obligation to correct the Work if Owner provided the written notice within the applicable warranty period. Contractor's obligation to correct the warranty item continues until the correction is made. After the correction is made to Owner's satisfaction, a new warranty period of the same length as the original warranty period shall run on the corrected work. The obligations under this paragraph 12.2.5 shall survive acceptance of the Work under the Contract and termination of the Contract.

12.2.6 NO TIME LIMITATION

Nothing contained in this Section 12.2 shall be construed to establish a period of limitation with respect to other obligations which the Contractor might have under the Contract Documents. Establishment of the time period of one (1) year as described in Section 12.2.5 relates only to the specific warranty obligation of the Contractor to correct the Work after the date of commencement of warranties under Sections 3.5 and 9.7.1, and has, for example, no relationship to the time within which the obligation to comply with the Contract Documents may be sought to be enforced, or to the time within which proceedings may be commenced to establish the Contractor's liability with respect to the Contractor's obligations other than specifically to correct the Work.

12.3 NONCONFORMING WORK AND WITHHOLDING THE VALUE OF IT

If it is found at any time before completion of the Work that the Contractor has varied from the Contract Documents in materials, quality, form, finish, or in the amount or value of the materials or labor used, the Owner may, in addition to other remedies in the Contract Documents or under law and as allowed by law, accept the improper work. The Owner may withhold from any amount due or to become due Contractor that sum of money equivalent to the difference in value between the Work performed and that called for by the Drawings and Specifications. The Owner shall determine such difference in value. No structural related work shall be accepted that is not in conformance with the Contract Documents.

ARTICLE 13

MISCELLANEOUS PROVISIONS

13.1 GOVERNING LAW

The Contract shall be governed by the law of the place where the Project is located.

13.2 SUCCESSORS AND ASSIGNS

The Owner and the Contractor respectively bind themselves, their partners, successors, assigns, and legal representatives to the other party hereto and to partners, successors, assigns, and legal representatives of such other party in respect to covenants, agreements, and obligations contained in the Contract Documents. Neither party to the Contract shall assign the Contract as a whole or in part without written consent of the other. If either party attempts to make such an assignment without such consent, that party shall nevertheless remain legally responsible for all obligations under the Contract.

13.3 WRITTEN NOTICE

In the absence of specific notice requirements in the Contract Documents, written notice shall be deemed to have been duly served if delivered in person to the individual, member of the firm or entity, or to an officer of the corporation for which it was intended, or if delivered at or sent by registered or certified or overnight mail to the last business address known to the party giving notice. Owner shall, at Contractor’s cost, timely notify Contractor of Owner’s receipt of any third party claims relating to the Contract pursuant to Public Contract Code section 9201.

13.4 RIGHTS AND REMEDIES

13.4.1 DUTIES AND OBLIGATIONS CUMULATIVE

Duties and obligations imposed by the Contract Documents and rights and remedies available thereunder shall be in addition to and not a limitation of duties, obligations, rights, and remedies otherwise imposed or available by law.

13.4.2 NO WAIVER

No action or failure to act by the Owner, Inspector of Record, Architect or any construction manager shall constitute a waiver of a right or duty afforded them under the Contract Documents, nor shall such action or failure to act constitute approval of or acquiescence in a breach thereunder, except as may be specifically agreed to in a written amendment to the Contract.

13.5 TESTS AND INSPECTIONS

13.5.1 COMPLIANCE

Tests, inspections, and approvals of portions of the Work required by the Contract Documents will comply with Title 24, and with all other laws, ordinances, rules, regulations, or orders of public authorities having jurisdiction.

13.5.2 INDEPENDENT TESTING LABORATORY

The Owner will select and pay an independent testing laboratory to conduct all tests and inspections, including shipping or transportation costs or expenses (mileage and hours). Selection of the materials required to be tested shall be made by the laboratory or the Owner's representative and not by the Contractor. However, if Contractor requests that the Owner use a different testing laboratory and Owner chooses to approve such request, Contractor shall obtain prior approval. Owner will pay all costs for testing, contractor may not pay any testing expenses. Owner may invoice such costs or expenses to the Contractor or withhold such costs or expenses from progress payments and/or retention.

13.5.3 ADVANCE NOTICE TO INSPECTOR OF RECORD

The Contractor shall notify the Inspector of Record a sufficient time in advance of its readiness for required observation or inspection so that the Inspector of Record may arrange for same. The Contractor shall notify the Inspector of Record a sufficient time in advance of the manufacture of material to be supplied under the Contract Documents which must, by terms of the Contract Documents, be tested in order that the Inspector of Record may arrange for the testing of the material at the source of supply.

13.5.4 TESTING OFF-SITE

Any material shipped by the Contractor from the source of supply, prior to having satisfactorily passed such testing and inspection or prior to the receipt of notice from said Inspector of Record that such testing and inspection will not be required, shall not be incorporated in the Work.

13.5.5 ADDITIONAL TESTING OR INSPECTION

If the Inspector of Record, the Architect, the Owner, or public authority having jurisdiction determines that portions of the Work require additional testing, inspection, or approval not

included under section 13.5.1, the Inspector of Record will, upon written authorization from the Owner, make arrangements for such additional testing, inspection, or approval. The Owner shall bear such costs except as provided in section 13.5.6.

13.5.6 COSTS FOR RETESTING

If such procedures for testing, inspection, or approval under sections 13.5.1, 13.5.2 and 13.5.5 reveal failure of the portions of the Work to comply with requirements established by the Contract Documents, the Contractor shall bear all costs arising from such failure, including those of re-testing, re-inspection, or re-approval, including, but not limited to, compensation for the Architect's services and expenses. Any such costs shall be paid by the Owner, invoiced to the Contractor, and, among other remedies, can be withheld from progress payments and/or retention.

13.5.7 COSTS FOR PREMATURE TEST

In the event the Contractor requests any test or inspection for the Project and is not completely ready for the inspection, the Contractor shall be invoiced by the Owner for all costs and expenses resulting from that testing or inspection, including, but not limited to, the Architect's fees and expenses, and the amount of the invoice can among other remedies, be withheld from progress payments and/or retention.

13.5.8 TESTS OR INSPECTIONS NOT TO DELAY WORK

Tests or inspections conducted pursuant to the Contract Documents shall be made promptly to avoid unreasonable delay in the Work.

13.6 [INTENTIONALLY LEFT BLANK]

13.7 TRENCH EXCAVATION

13.7.1 TRENCHES GREATER THAN FIVE FEET

Pursuant to Labor Code section 6705, if the Contract Sum exceeds \$25,000 and involves the excavation of any trench or trenches five (5) feet or more in depth, the Contractor shall, in advance of excavation, submit to the Owner or a registered civil or structural engineer employed by the Owner a detailed plan showing the design of shoring for protection from the hazard of caving ground during the excavation of such trench or trenches.

13.7.2 EXCAVATION SAFETY

If such plan varies from the Shoring System Standards established by the Construction Safety Orders, the plan shall be prepared by a registered civil or structural engineer, but in no case shall such plan be less effective than that required by the Construction Safety Orders. No excavation

of such trench or trenches shall be commenced until said plan has been accepted by the Owner or by the person to whom authority to accept has been delegated by the Owner.

13.7.3 NO TORT LIABILITY OF OWNER

Pursuant to Labor Code section 6705, nothing in this Article shall impose tort liability upon the Owner or any of its employees.

13.7.4 NO EXCAVATION WITHOUT PERMITS

The Contractor shall not commence any excavation work until it has secured all necessary permits including the required CAL OSHA excavation/shoring permit. Any permits shall be prominently displayed on the Site prior to the commencement of any excavation.

13.8 WAGE RATES

13.8.1 WAGE RATES

Pursuant to the provisions of Article 2 (commencing at § 1770), Chapter 1, Part 7, Division 2, of the Labor Code, the governing board of the Owner has obtained the general prevailing rate of per diem wages and the general prevailing rate for holiday and overtime work in the locality in which this public work is to be performed for each craft, classification, or type of worker needed for this Project from the Director of Industrial Relations (“Director”). These rates are on file with the Clerk of the Owner’s Governing Board, and copies will be made available to any interested party on request. The Contractor shall post a copy of such wage rates at the Site.

13.8.2 HOLIDAY AND OVERTIME PAY

Holiday and overtime work, when permitted by law, shall be paid for at a rate of at least one and one-half (1½) times the above specified rate of per diem wages, unless otherwise specified. Holidays shall be defined in the Collective Bargaining Agreement applicable to each particular craft, classification, or type of worker employed.

13.8.3 WAGE RATES NOT AFFECTED BY SUBCONTRACTS

The Contractor shall pay and shall cause to be paid each worker engaged in work on the Project not less than the general prevailing rate of per diem wages determined by the Director, regardless of any contractual relationship which may be alleged to exist between the Contractor or any Subcontractor and such workers.

13.8.4 CHANGE IN PREVAILING WAGE DURING BID OR CONSTRUCTION

If during the period this bid is required to remain open, the Director of Industrial Relations determines that there has been a change in any prevailing rate of per diem wages in the locality

in which this public work is to be performed, such change shall not alter the wage rates discussed in the Notice to Bidders or the Contract subsequently awarded.

13.8.5 FORFEITURE AND PAYMENTS

Pursuant to Labor Code section 1775, the Contractor and any subcontractor under the Contractor shall as a penalty to the Owner, forfeit not more than two hundred dollars (\$200.00) for each calendar day, or portion thereof, for each worker paid less than the prevailing rate of per diem wages, determined by the Director, for such craft or classification in which such worker is employed for any public work done under the Agreement by the Contractor or by any Subcontractor under it. Minimum penalties shall apply, as also provided in Labor Code section 1775. The amount of the penalty shall be determined by the Labor Commissioner and shall be based on both of the following: (1) whether the failure of the contractor or subcontractor to pay the correct rate of per diem wages was a good faith mistake and, if so, the error was promptly and voluntarily corrected upon being brought to the attention of the contractor or subcontractor; and (2) whether the contractor or subcontractor has a prior record of failing to meet its prevailing wage obligations. The difference between such prevailing rate of per diem wage and the amount paid to each worker for each calendar day or portion thereof for which each worker was paid less than the prevailing rate of per diem wage shall be paid to each worker by the Contractor or subcontractor.

13.8.6 MINIMUM WAGE RATES

Any worker employed to perform work on the Project, which work is not covered by any craft or classification listed in the general prevailing rate of per diem wages determined by the Director, shall be paid not less than the minimum rate of wages specified therein for the craft or classification which most nearly corresponds to the Work to be performed by them, and such minimum wage rate shall be retroactive to time of initial employment of such person in such craft or classification.

13.8.7 PER DIEM WAGES

Pursuant to Labor Code section 1773.1, per diem wages include fringe benefits such as employer payments for health and welfare, pension, and vacation pay.

13.8.8 POSTING OF WAGE RATES AND OTHER REQUIRED JOB SITE NOTICES

The Contractor shall post at appropriate conspicuous points on the Site, a schedule showing all determined wage rates and all other required job site notices as prescribed by regulation.

13.9 RECORD OF WAGES PAID: INSPECTION

13.9.1 APPLICATION OF LABOR CODE

Pursuant to section 1776 of the Labor Code:

(a) Each Contractor and subcontractor shall keep accurate payroll records, showing the name, address, social security number, work classification, and straight time and overtime hours worked each day and week, and the actual per diem wages paid to each journeyman, apprentice, worker, or other employee employed by him or her in connection with the public work. Each payroll record shall contain or be verified by a written declaration that is made under penalty of perjury, stating both of the following:

- (1) The information contained in the payroll record is true and correct.
- (2) The employer has complied with the requirements of sections 1771, 1811 and 1815 for any work performed by his or her employees on the public works project.

(b) The payroll records enumerated under subdivision (a) shall be certified and shall be available for inspection at all reasonable hours at the principal office of the Contractor on the following basis:

(1) A certified copy of an employee's payroll record shall be made available for inspection or furnished to the employee or his or her authorized representative on request.

(2) A certified copy of all payroll records enumerated in subdivision (a) shall be made available for inspection or furnished upon request to a representative of the body awarding the contract and the Division of Labor Standards Enforcement of the Department of Industrial Relations ("DIR"). The Contractor and each subcontractor shall furnish a certified copy of all payroll records directly to the Labor Commissioner monthly or more frequently, if so specified in the Agreement and in a format the Labor Commissioner prescribes.

(3) A certified copy of all payroll records enumerated in subdivision (a) shall be made available upon request by the public for inspection or for copies thereof. However, a request by the public shall be made through either the body awarding the contract or the Division of Labor Standards Enforcement of the DIR. If the requested payroll records have not been provided pursuant to paragraph (2), the requesting party shall, prior to being provided the records, reimburse the costs of the preparation by the contractor, subcontractors, and the entity through which the request was made. The public may not be given access to such records at the principal office of the Contractor.

(c) Unless required as of January 1, 2016, to be furnished directly to the Labor Commissioner under Labor Code section 1771.4(a)(3), the certified payroll records shall be on forms provided by the Division of Labor Standards Enforcement of the DIR or shall contain the same information as the forms provided by the division. The payroll records may consist of printouts of payroll data that are maintained as computer records, if the printouts contain the same information as the forms provided by the division and the printouts are verified in the manner specified in (a) above.

(d) A Contractor or subcontractor shall file a certified copy of the records enumerated in subdivision (a) with the entity that requested such records within 10 days after receipt of a written request.

(e) Except as provided in subdivision (f), any copy of records made available for inspection as copies and furnished upon request to the public or any public agency by the awarding body or the Division of Labor Standards Enforcement of the DIR shall be marked or obliterated to prevent disclosure of an individual's name, address and social security number. The name and address of the Contractor awarded the Contract or the subcontractor performing the Contract shall not be marked or obliterated. Any copy of records made available for inspection by, or furnished to, a multiemployer Taft-Hartley trust fund (29 U.S.C. Sec. 186(c)(5) that requests the records for the purposes of allocating contributions to participants shall be marked or obliterated only to prevent disclosure of an individual's full social security number, but shall provide the last four digits of the social security number. Any copy of records made available for inspection by, or furnished to, a joint labor-management committee established pursuant to the federal Labor Management Cooperation Act of 1978 (29 U.S.C. Sec. 175a) shall be marked or obliterated only to prevent disclosure of an individual's social security number.

(f) Notwithstanding any other provision of law, agencies that are included in the Joint Enforcement Strike Force on the Underground Economy established pursuant to Section 329 of the Unemployment Insurance Code and other law enforcement agencies investigating violations of law shall, upon request, be provided nonredacted copies of certified payroll records. Any copies of records or certified payroll made available for inspection and furnished upon request to the public by an agency included in the Joint Enforcement Strike Force on the Underground Economy or to a law enforcement agency investigating a violation of law shall be marked or redacted to prevent disclosure of an individual's name, address, and social security number. An employer shall not be liable for damages in a civil action for any reasonable act or omission taken in good faith in compliance with this subsection.

(g) The contractor shall inform the body awarding the contract of the location of the records enumerated under subdivision (a), including the street address, city and county, and shall, within five working days, provide a notice of a change of location and address.

(h) The contractor or subcontractor has 10 days in which to comply subsequent to receipt of written notice requesting the records enumerated in subdivision (a). In the event that the Contractor or subcontractor fails to comply within the 10-day period, he or she shall, as a penalty to the state or political subdivision on whose behalf the contract is made or awarded, forfeit one hundred dollars (\$100.00) for each calendar day, or portion thereof, for each worker, until strict compliance is effectuated. Upon the request of the Division of Labor Standards Enforcement of the DIR, these penalties shall be withheld from progress payments then due. A contractor is not subject to a

penalty assessment pursuant to this section due to the failure of the subcontractor to comply with this section.

13.10 APPRENTICES

13.10.1 APPRENTICE WAGES AND DEFINITIONS

All apprentices employed by the Contractor to perform services under the Contract shall be paid the standard wage paid to apprentices under the regulations of the craft or trade at which he or she is employed, and shall be employed only at the work of the craft or trade to which he or she is registered. Only apprentices, as defined in section 3077 of the Labor Code, who are in training under apprenticeship standards and written apprenticeship agreements under Chapter 4 (commencing with § 3070) of Division 3, are eligible to be employed under this Contract. The employment and training of each apprentice shall be in accordance with the apprenticeship standards and apprentice agreements under which he or she is training.

13.10.2 APPRENTICE LABOR POOL

When the Contractor to whom the Contract is awarded by the Owner, or any Subcontractor under him or her, in performing any of the Work under the Contract or subcontract, employs workers in any apprenticeable craft or trade, the Contractor and Subcontractor may apply to the joint apprenticeship committee administering the apprenticeship standards of the craft or trade in the area of the Site of the Project, for a certificate approving the Contractor or Subcontractor under the apprenticeship standards for the employment and training of apprentices in the area or industry affected. However, approval as established by the joint apprenticeship committee or committees shall be subject to review by the Administrator of Apprenticeship. The joint apprenticeship committee or committees, subsequent to approving the subject Contractor or Subcontractor, shall arrange for the dispatch of apprentices to the Contractor or Subcontractor in order to comply with this section. Every Contractor and Subcontractor shall submit the contract award information to the applicable joint apprenticeship committee which shall include an estimate of journeyman hours to be performed under the Contract, the number of apprentices to be employed, and the approximate dates the apprentices will be employed. There shall be an affirmative duty upon the joint apprenticeship committee or committees administering the apprenticeship standards of the crafts or trade in the area of the Site of the public work, to ensure equal employment and affirmative action and apprenticeship for women and minorities. Contractors or Subcontractors shall not be required to submit individual applications for approval to local joint apprenticeship committees provided they are already covered by the local apprenticeship standards. The ratio of work performed by apprentices to journeymen, who shall be employed in the craft or trade on the Project, may be the ratio stipulated in the apprenticeship standards under which the joint apprenticeship committee operates, but, except as otherwise provided in this section, in no case shall the ratio be less than one (1) hour of apprentice work for every five (5) hours of labor performed by a journeyman. However, the minimum ratio for the Operating Engineer and Labor classification shall not be less than one (1) apprentice for each four (4) journeymen.

13.10.3 JOURNEYMAN/APPRENTICE RATIO; COMPUTATION OF HOURS

Any ratio shall apply during any day or portion of a day when any journeyman or the higher standard stipulated by the joint apprenticeship committee, is employed at the job Site and shall be computed on the basis of the hours worked during the day by journeymen so. Any work performed by a journeyman in excess of eight (8) hours per day or forty (40) hours per week, shall not be used to calculate the hourly ratio required by the section. The Contractor shall employ apprentices for the number of hours computed as above before the end of the Contract. However, the Contractor shall endeavor, to the greatest extent possible, to employ apprentices during the same time period that the journeymen in the same craft or trade are employed at the job Site. Where an hourly apprenticeship ratio is not feasible for a particular craft or trade, the Division of Apprenticeship Standards, upon application of a joint apprenticeship committee, may order a minimum ratio of not less than one (1) apprentice for each five (5) journeymen in a craft or trade classification.

13.10.4 JOURNEYMAN/APPRENTICE RATIO

The Contractor or Subcontractor, if he or she is covered by this section upon the issuance of the approval certificate, or if he or she has been previously approved in the craft or trade, shall employ the number of apprentices or the ratio of apprentices to journeymen stipulated in the apprenticeship standards. Upon proper showing by the Contractor that he or she employs apprentices in the craft or trade in the state on all of his or her contracts on an annual average of not less than one (1) hour of apprentice work for every five (5) hours of labor performed by a journeyman, or in the land surveyor classification, one (1) apprentice for each five (5) journeymen, the Division of Apprenticeship Standards may grant a certificate exempting the Contractor from the 1-to-5 hourly ratio as set forth in this section. This section shall not apply to contracts of general contractors or to contracts of specialty contractors not bidding for work through a general or prime contractor, when the contracts of general contractors or those specialty contractors involve less than Thirty Thousand Dollars (\$30,000).

13.10.4.1 *Apprenticeable Craft or Trade.* “Apprenticeable craft or trade” as used in this Article means a craft or trade determined as an apprenticeable occupation in accordance with the rules and regulations prescribed by the California Apprenticeship Council. The joint apprenticeship committee shall have the discretion to grant a certificate, which shall be subject to the approval of the Administrator of Apprenticeship, exempting a Contractor from the 1-to-5 ratio set forth in this Article when it finds that any one of the following conditions is met:

- A. Unemployment for the previous three-month period in the area exceeds an average of fifteen percent (15%).
- B. The number of apprentices in training in such area exceeds a ratio of 1-to-5.
- C. There is a showing that the apprenticeable craft or trade is replacing at least one-thirtieth (1/30) of its journeymen annually through the apprenticeship training, either on a statewide basis or on a local basis.

- D. Assignment of an apprentice to any work performed under this contract would create a condition which would jeopardize his or her life or the life, safety, or property of fellow employees or the public at large or if the specific task to which the apprentice is to be assigned is of such a nature that training cannot be provided by a journeyman.

13.10.5 RATIO EXEMPTION

When exemptions are granted to an organization which represents Contractors in a specific trade from the 1-to-5 ratio on a local or statewide basis, the member Contractors will not be required to submit individual applications for approval to local joint apprenticeship committees, if they are already covered by the local apprenticeship standards.

13.10.6 APPRENTICE FUND

A contractor to whom a contract is awarded, who, in performing any of the work under the contract, employs journeymen or apprentices in any apprenticeable craft or trade shall contribute to the California Apprenticeship Council the same amount that the director determines is the prevailing amount of apprenticeship training contributions in the area of the public works site. A contractor may take as a credit for payments to the council any amounts paid by the contractor to an approved apprenticeship program that can supply apprentices to the site of the public works project. The contractor may add the amount of the contributions in computing his or her bid for the contract. The Division of Labor Standards Enforcement is authorized to enforce the payment of the contributions to the fund or funds as set forth in the Labor Code section 227.

13.10.7 PRIME CONTRACTOR COMPLIANCE

The responsibility of compliance with section 13.10 and section 1777.5 of the Labor Code for all apprenticeable occupations is with the Prime Contractor. However, if a subcontractor is found to have violated Section 1777.5, the prime contractor of the project is not liable for any penalties under subdivision (2) unless the prime contractor had knowledge of the subcontractor's failure to comply with the provisions of Section 1777.5 or unless the contract executed between the contractor and the subcontractor for the performance of work on the public works project failed to include a copy of the provisions of Section 1771, 1775, 1776, 1777.5, 1831 and 1851. Additionally, the contractor shall continually monitor a subcontractor's use of apprentices required to be employed on the public works project pursuant to subdivision (d) of Section 1777.5, including, but not limited to, periodic review of the certified payroll of the subcontractor, and upon becoming aware of a failure of the subcontractor to employ the required number of apprentices, the contractor shall take corrective action, including, but not limited to, retaining funds due to the subcontractor for work performed on the public works project until the failure is corrected.

13.10.8 DECISIONS OF JOINT APPRENTICESHIP COMMITTEE

All decisions of the joint apprenticeship committee under this section 13.10 and Labor Code section 1777.5 are subject to Labor Code section 3081.

13.10.9 **NO BIAS**

It shall be unlawful for an employer or a labor union to refuse to accept otherwise qualified employees as registered apprentices on any public works on the grounds of race, religious creed, color, national origin, ancestry, sex, or age, except as provided in the Labor Code section 3077.

13.10.10 **VIOLATION OF LABOR CODE**

Pursuant to Labor Code section 1777.1, in the event a Contractor or Subcontractor willfully fails to comply with the provisions of this section 13.10 and Labor Code section 1777.5, among other things:

(a) The Labor Commissioner may deny to the contractor or subcontractor, and to its responsible officers, the right to bid on, or be awarded or perform work as a subcontractor on, any public works project for a period of up to one year for the first violation and for a period of up to three years for the second and subsequent violation. Each period of debarment shall run from the date the determination of noncompliance by the Labor Commissioner becomes a final order.

(b) A contractor or subcontractor who violates section 1777.5 shall forfeit as a civil penalty an amount not exceeding the sum of one hundred dollars (\$100) for each full calendar day of noncompliance for a first violation and not more than three hundred dollars (\$300) for a second or subsequent violation within a three-year period. Upon receipt of a determination that a civil penalty has been imposed, the awarding body shall enforce the penalty, which includes withholding the amount of the civil penalty from the contract progress payments or retention then due or to become due.

(c) In lieu of the penalty provided, the Labor Commissioner may for a first time violation and with the concurrence of an applicable apprenticeship program, order the contractor or subcontractor to provide apprentice employment equivalent to the work hours that would have been provided for apprentices during the period of noncompliance.

(d) Any funds withheld by the awarding body pursuant to this section shall be deposited in the General Fund.

(e) The interpretation and enforcement of section 1777.5 and this section shall be in accordance with the regulations of the California Apprenticeship Council.

Pursuant to Public Contract Code section 6109, no contractor or subcontractor may bid on, be awarded, or perform work as a subcontractor on a public works project if ineligible to bid or work on, or be awarded, a public works project pursuant to section 1777.1 of the Labor Code.

13.11 ASSIGNMENT OF ANTITRUST CLAIMS

13.11.1 APPLICATION

Pursuant to Public Contract Code section 7103.5 and Government Code section 4552, in entering into a public works contract or a subcontract to supply goods, services, or materials pursuant to a public works contract, the Contractor or Subcontractor offers and agrees to assign to the Owner all rights, title, and interest in and to all causes of action it may have under Section 4 of the Clayton Act, (15 U.S.C. § 15) or under the Cartwright Act (Chapter 2 [commencing with § 16700] of Part 2 of Division 7 of the Bus. & Prof. Code), arising from the purchase of goods, services, or materials pursuant to the public works contract or the subcontract. This assignment shall be made and become effective at the time the awarding body tenders Final Progress Payment to the Contractor, without further acknowledgment by the parties. If the Owner receives, either through judgment or settlement, a monetary recovery for a cause of action assigned under Chapter 11 (commencing with § 4550) of Division 5 of Title 1 of the Government Code, the assignor may, upon demand, recover from the Owner any portion of the recovery, including treble damages, attributable to overcharges that were paid by the assignor but were not paid by the Owner as part of the bid price, less the expenses incurred in obtaining that portion of the recovery.

13.11.2 ASSIGNMENT OF CLAIM

Upon demand in writing by the assignor, the Owner shall, within one (1) year from such demand, reassign the cause of action assigned pursuant to this Article if the assignor has been or may have been injured by the violation of law for which the cause of action arose and the Owner has not been injured thereby or the Owner declines to file a court action for the cause of action.

13.12 AUDIT

Pursuant to and in accordance with the provisions of Government Code section 8546.7, or any amendments thereto, all books, records, and files of the Owner, the Contractor, or any Subcontractor connected with the performance of this Contract involving the expenditure of state funds in excess of Ten Thousand Dollars (\$10,000.00), including, but not limited to, the administration thereof, shall be subject to the examination and audit of the Office of the Auditor General of the State of California for a period of three (3) years after release of all retention under this Contract. Contractor shall preserve and cause to be preserved such books, records, and files for the audit period. During the progress of the Work and for three (3) years after release of all retention under the Contract, Owner shall also have the right to an audit, and Contractor must cooperate by producing all information requested within seven (7) days.

13.13 STORM WATER DISCHARGE PERMIT

If applicable, the Contractor shall file a Notice of Intent to comply with the terms of the general permit to discharge storm water associated with construction activity Order 2009-0009-DWQ (as amended by 2010-0014-DWQ and 2017-006-DWQ). The Notice of Intent must be sent to the

following address along with the appropriate payment (warrant to be furnished by the Owner upon request by the Contractor, allow warrant processing time.): California State Water Resources Control Board, Division of Water Quality, Storm Water Permit Unit, P.O. Box 1977, Sacramento, CA 95812-1977. The Contractor may also call the State Water Board's Construction Activity Storm Water Hotline at (916) 657-1146. The Notice of Intent shall be filed prior to the start of any construction activity.

ARTICLE 14

TERMINATION OR SUSPENSION OF THE CONTRACT

14.1 TERMINATION BY THE CONTRACTOR FOR CAUSE

Contractor may not terminate for convenience. Contractor may only terminate for cause if the Work is stopped by others for a period of one hundred eighty (180) consecutive days through no act or fault of the Contractor, a Subcontractor of any tier, their agents or employees, or any other persons performing portions of the Work for whom the Contractor is contractually responsible, **and** the Work was stopped by others for one of the following reasons: (A) Issuance of an order of a court or other public authority having jurisdiction which requires Owner to stop all Work; or (B) an act of government, such as a declaration of national emergency, making material unavailable which requires Owner to stop all Work. If such grounds exist, the Contractor may serve written notice of such grounds on Owner and demand a meet-and-confer conference to negotiate a resolution in good faith within twenty (20) days of Owner's receipt of such notice. If such conference does not lead to resolution and the grounds for termination still exist, Contractor may terminate the Contract and recover from the Owner payment for Work executed and for reasonable verified costs with respect to materials, equipment, tools, construction equipment, and machinery, including reasonable overhead, profit, and damages for the Work executed, but excluding overhead (field and home office) and profit for (i) Work not performed and (ii) the period of time that the Work was stopped.

14.2 TERMINATION BY THE OWNER FOR CAUSE

14.2.1 GROUNDS FOR TERMINATION

The Owner may terminate the Contract if the Contractor:

- A. Refuses or fails to supply enough properly skilled workers or proper materials, or refuses or fails to take steps to adequately prosecute the work toward completion within the Contract Time;
- B. Fails to make payment to Subcontractors for materials or labor in accordance with Public Contract Code section 10262 or Business and Professions Code section 7108.5, as applicable;

- C. Violates Labor Code section 1771.1(a), subject to the provisions of Labor Code section 1771.1(f);
- D. Disregards laws, ordinances, rules, regulations, or orders of a public authority having jurisdiction; or
- E. Otherwise is in breach of the Contract Documents.

14.2.2 NOTIFICATION OF TERMINATION

When any of the above reasons exist, the Owner may, without prejudice to any other rights or remedies of the Owner, give notice to Contractor of the grounds for termination and demand cure of the grounds within seven (7) days (a “Notice of Intent to Terminate”). If Contractor fails to **either** (a) completely cure the grounds for termination within seven (7) days **or** (b) reasonably commence cure of the grounds for termination within seven (7) days and reasonably continue to cure the grounds for termination until such cure is complete, then Owner may terminate the Contract effective immediately upon service of written Notice of Termination and may, subject to any prior rights of Contractor’s surety on the performance bond (“Surety”):

- A. Take possession of the Site and of all material, equipment, tools, and construction equipment and machinery thereon owned by the Contractor;
- B. Accept assignment of subcontracts pursuant to section 5.4; and
- C. Complete the Work by whatever reasonable method the Owner may deem expedient.

14.2.3 PAYMENTS WITHHELD

If the Owner terminates the Contract for one of the reasons stated in section 14.2.1, the Contractor shall not be entitled to receive further payment until the Work is complete.

14.2.4 PAYMENTS UPON COMPLETION

If the unpaid balance of the Contract Sum exceeds costs of completing the Work, including compensation for professional services and expenses made necessary thereby, such excess shall be paid to the Contractor. If such costs exceed the unpaid balance, the Contractor shall pay the difference to the Owner. This payment obligation shall survive completion of the Contract.

14.2.5 INCLUSION OF TERMINATION FOR CONVENIENCE

Any purported termination by Owner for cause under this section 14.2, which is revoked or determined to not have been for cause, shall be deemed to have been a termination for convenience effective as of the same date as the purported termination for cause.

14.3 SUSPENSION OR TERMINATION BY THE OWNER FOR CONVENIENCE

14.3.1 SUSPENSION BY OWNER

The Owner may, without cause, order the Contractor in writing to suspend, delay, or interrupt the Work in whole or in part for such period of time as the Owner may determine.

14.3.1.1 *Adjustments.* An adjustment shall be made for increases in the cost of performance of the Contract, including profit on the increased cost of performance caused by suspension, delay, or interruption. No adjustment shall be made to the extent:

- A. That performance is, was or would have been so suspended, delayed, or interrupted by another cause for which the Contractor is responsible; or
- B. That an equitable adjustment is made or denied under another provision of this Contract.

14.3.1.2 *Adjustments for Fixed Cost.* Adjustments made in the cost of performance may have a mutually agreed fixed or percentage fee.

14.3.2 TERMINATION BY THE OWNER FOR CONVENIENCE

14.3.2.1 The Owner may, at any time, terminate the Contract for the Owner's convenience and without cause.

14.3.2.2 Upon receipt of written notice from the Owner of such termination for the Owner's convenience, the Contractor shall:

- 1. Cease operations as directed by the Owner in the notice;
- 2. Take actions necessary, or that the Owner may direct, for the protection and preservation of the Work; and
- 3. Except for Work directed to be performed prior to the effective date of termination stated in the notice, terminate all existing subcontracts and purchase orders and enter into no further subcontracts and purchase orders.

14.3.2.3 In case of such termination for the Owner's convenience, the Contractor shall be entitled to receive payment for Work executed, and costs incurred by reason of such termination.

14.4 NOT A WAIVER

Any suspension or termination by Owner for convenience or cause under this Article 14 shall not act as a waiver of any claims by Owner against Contractor or others for damages based on breach of contract, negligence or other grounds.

14.5 MUTUAL TERMINATION FOR CONVENIENCE

The Contractor and the Owner may mutually agree in writing to terminate this Contract for convenience. The Contractor shall receive payment for all Work performed to the date of termination in accordance with the provisions of Article 9.

14.6 EARLY TERMINATION

Notwithstanding any provision herein to the contrary, if for any fiscal year of this Contract the governing body of the Owner fails to appropriate or allocate funds for future periodic payments under the Contract after exercising reasonable efforts to do so, the Owner may upon thirty (30) days' notice, order work on the Project to cease. The Owner will remain obligated to pay for the work already performed but shall not be obligated to pay the balance remaining unpaid beyond the fiscal period for which funds have been appropriated or allocated and for which the work has not been done.

END OF DOCUMENT

SPECIAL CONDITIONS

1. **Mitigation Measures**

Contractor shall comply will all applicable mitigation measures, if any, adopted by any public agency with respect to this Project pursuant to the California Environmental Quality Act. (Public Resources Code section 21000 et. seq.).

2. **Modernization / Post Occupancy Projects**

- a. **Access.** Access to the school buildings and entry to buildings, classrooms, restrooms, mechanical rooms, electrical rooms, or other rooms, for construction purposes, must be coordinated with District and onsite District personnel before Work is to start. Unless agreed to otherwise in writing, only a school custodian will be allowed to unlock and lock doors in existing building(s). The custodian will be available only while school is in session. If a custodian is required to arrive before 7:00 a.m. or leave after 3:30 p.m. to accommodate Contractor's Work, the overtime wages for the custodian will be paid by the Contractor, unless, at the discretion of the District, other arrangements are made in advance.
- b. **Master Key.** Upon request, the District may, at is own discretion, provide a master key to the school site for the convenience of the Contractor. The Contractor agrees to pay all expenses to re-key the entire school site and all other affected District buildings if the master key is lost or stolen or if any unauthorized party obtains a copy of the key or access to the school.
- c. **Maintaining Services.** The Contractor is advised that Work is to be performed in spaces regularly scheduled for instruction. Interruption and/or periods of shutdown of public access, electrical service, water service, lighting, or other utilities shall be only as arranged in advance with the District. Contractor shall provide temporary services to all facilities interrupted by Contractor's Work.
- d. **Maintaining Utilities.** The Contractor shall maintain in operation during duration of Contract, drainage lines, storm drains, sewers, water, gas, electrical, steam, and other utility service lines within working area. No new services or connections shall be anticipated for operation of existing facilities during construction.
- e. **Confidentiality.** Contractor shall maintain the confidentiality of all information, documents, programs, procedures and all other items that Contractor encounters while performing the Work. This requirement shall be ongoing and shall survive the expiration or termination of this Contract and specifically includes, without limitation, all student, parent, and employee disciplinary information and health information.

- f. **No Work During Student Testing**. Contractor shall, at no additional cost to the District and at the District's request, coordinate its Work to not disturb District students including, without limitation, not performing any Work when students at the Site are taking State-required tests.

3. **Substitution for Specified Items**

- a. Requests for substitutions prior to award of the Contract shall be done within the time period indicated in the Instructions to Bidders.
- b. Whenever in the Specifications any materials, process, or article is indicated or specified by grade, patent, or proprietary name, or by name of manufacturer, that Specification shall be deemed to be followed by the words "or equal." Contractor may, unless otherwise stated, offer any material, process, or article that shall be substantially equal or better in every respect to that so indicated or specified.
- (1) If the material, process, or article offered by Contractor is not, in the opinion of the District, substantially equal or better in every respect to that specified, then Contractor shall furnish the material, process, or article specified in the Specifications without any additional compensation or change order.
 - (2) This provision shall not be applicable with respect to any material, product, thing or service for which District made findings and gave notice in accordance with Public Contract Code section 3400(b); therefore, Contractor shall not be entitled to request a substitution with respect to those materials, products or services.
- c. A request for a substitution shall be in writing and shall include:
- (1) All variations of the proposed substitute from the material specified including, but not limited to, principles of operation, materials, or construction finish, thickness or gauge of materials, dimensions, weight, and tolerances;
 - (2) Available maintenance, repair or replacement services;
 - (3) Increases or decreases in operating, maintenance, repair, replacement, and spare parts costs;
 - (4) Whether or not acceptance of the substitute will require other changes in the Work (or in work performed by the District or others under Contract with the District); and
 - (5) The time impact on any part of the Work resulting directly or indirectly from acceptance of the proposed substitute.

- d. No substitutions shall be made until approved, in writing, by the District. The burden of proof as to equality of any material, process, or article shall rest with Contractor. The Contractor warrants that if substitutes are approved:
- (1) The proposed substitute is equal or superior in all respects to that specified, and that such proposed substitute is suitable and fit for the intended purpose and will perform adequately the function and achieve the results called for by the general design and the Contract Documents;
 - (2) The Contractor provides the same warranties and guarantees for the substitute that would be provided for that specified;
 - (3) The Contractor shall be fully responsible for the installation of the substitute and any changes in the Work required, either directly or indirectly, because of the acceptance of such substitute, with no increase in Contract Price or Contract Time. Incidental changes or extra component parts required to accommodate the substitute will be made by the Contractor without a change in the Contract Price or Contract Time;
 - (4) The Contractor shall be responsible for any re-design costs occasioned by District's acceptance and/or approval of any substitute; and
 - (5) The Contractor shall, in the event that a substitute is less costly than that specified, credit the District with one hundred percent (100%) of the net difference between the substitute and the originally specified material. In this event, the Contractor agrees to execute a deductive Change Order to reflect that credit.
- e. In the event Contractor furnishes a material, process, or article more expensive than that specified, the difference in the cost of that material, process, or article so furnished shall be borne by Contractor.
- f. In no event shall the District be liable for any increase in Contract Price or Contract Time due to any claimed delay in the evaluation of any proposed substitute or in the acceptance or rejection of any proposed substitute.

4. **Fingerprinting**

Contractor shall comply with the provisions of Education Code section 45125.2 regarding the submission of employee fingerprints to the California Department of Justice and the completion of criminal background investigations of its employees, its subcontractor(s), and its subcontractors' employees. Contractor shall not permit any employee to have any contact with District pupils until such time as Contractor has verified in writing to the governing board of the District, that such employee has not

been convicted of a felony, as defined in Education Code section 45122.1. Contractor shall fully complete and perform all tasks required pursuant to the Criminal Background Investigation/ Fingerprinting Certification.

5. **Weather Days**

Extensions of the Performance Period shall be determined by reference to the Terms and Conditions to Field Contract. Rain in excess of one-tenth of an inch (1/10”) in one (1) day, or temperature which does not exceed 32° F shall be considered adverse weather. The following chart shows the normal number of adverse weather days:

Jan 10	Feb 8	Mar 8	Apr 5	May 2	Jun 1	Jul 0	Aug 0	Sep 1	Oct 3	Nov 7	Dec 8
-----------	----------	----------	----------	----------	----------	----------	----------	----------	----------	----------	----------

6. **Insurance Policy Limits.** All of Contractor’s insurance shall be with insurance companies with an A.M. Best rating of no less than A: XI. All limits of insurance shall not be less than what is specified in Agreement Between Owner and Contractor Document 00 52 26, Article XI, Indemnifications and Insurance in the.

7. **Permits, Certificates, Licenses, Fees, Approval**

a. **Payment for Permits, Certificates, Licenses, and Fees.** As required in the Terms and Conditions to Field Contract, the Contractor shall secure and pay for all permits, licenses and certificates necessary for the prosecution of the Work with the exception of the following:

- (1) Water connection fees
- (2) Sewer connection fees
- (3) Electrical connection fees
- (4) Gas connections fees
- (5) Cable TV connection fees
- (6) Phone connection fee

With respect to the above listed items, Contractor shall be responsible for securing such items, however, District will be responsible for payment of these charges or fees. Contractor shall notify the District of the amount due with respect to such items and to whom the amount is payable. Contractor shall provide the District with an invoice and receipt with respect to such charges or fees. The contractor shall receive written approval from the District prior to any payment.

b. The Contractor shall obtain a Grading Permit: **Not Used.**

c. **Storm Water Pollution Prevention Plan**

• NPDES PERMITTING

1. General. The intent of these requirements is to enforce federal, state and local laws, ordinances, codes and regulations that pertain to storm water pollution attributable to construction projects. Storm drains discharge directly to creeks without treatment. Therefore, discharge of pollutants (i.e. any substance, material or waste other than uncontaminated storm water) into the storm drain system is strictly prohibited.

For the purpose of eliminating storm water pollution, the Contractor shall implement effective

control measures over the entire project. There are several publications which provide guidance on selecting and implementing effective control measures known as Best Management Practices (BMPs). BMPs include, but are not limited to, schedules of activities, prohibition of practices, general good housekeeping practices, operational practices, pollution prevention practices, maintenance procedures and other management procedures designed to prevent the discharge of pollutants directly or indirectly to the storm drain system. BMPs also include the construction of some facilities which may be required to prevent, control and abate storm water pollution. The reference publications are as follows:

- * California Storm Water Best Management Practices Handbook-Industrial/Commercial
- * California Storm Water Best Management Practices Handbook-Construction Activity

These handbooks may be purchased from Blue Print Services (BPS), 1700 Jefferson Street, Oakland, California 94612, (510) 287-5485.

The Contractor shall be responsible for preparing and submitting to the Owner a Storm Water Pollution Prevention Plan (SWPPP) in conformance with the California NPDES (National Pollution Discharge Elimination System) General Permit for Storm Water Discharges associated with construction activity. The SWPPP shall address intended methods to reduce the amount of pollutants contained in storm water runoff during construction of the work.

The SWPPP is considered a report available to the public under Section 308 (b) of the Clean Water Act. The SWPPP shall be kept at the site during construction and made available upon request of a representative of the Regional Water Board or other local agency. The Contractor shall amend the SWPPP for any change in construction or operations which may affect the discharge of pollutants to surface water, ground waters, or storm drain system.

The Contractor shall submit the SWPPP to the Owner and governing agencies within fifteen (15) days of the Notice to Proceed. Upon approval of the

SWPPP, the Contractor shall be responsible for implementing, maintaining, and repairing all storm water pollution controls as described in his approved SWPPP for the duration of the work. The Contractor shall make any repairs to the storm water pollution controls and amend the SWPPP if, in the opinion of the Owner, the Contractor is not in compliance with the SWPPP. Failure to make the necessary repairs or other maintenance when directed by the Owner shall result in the necessary repair work being done by District forces, and the Contractor will be billed at double the rate of all District expenses. In addition, the Contractor shall be responsible for any fines imposed by the Regional Water Quality Control Board or other agency as a result of noncompliance, negligence, or violation of permit conditions.

Records of all inspections and compliance certifications reporting must be retained as part of the Storm Water Pollution Prevention Plan for a period of three years. Upon completion of the project construction and termination of coverage under the General Permit, the records shall be retained by the contractor with a copy of the final SWPPP.

2. Material Storage. Storage and exposure of raw materials, by-products, finished products, and containers shall be controlled as described below:

All construction materials shall be stored at least ten (10) feet away from inlets, catch basins, and curb returns. The Contractor shall not allow any material to enter the storm drain system. At the end of each working day, the Contractor shall collect and dispose of all scrap, debris, and waste material.

During wet weather or when rain is forecast, the Contractor shall store materials that can contaminate rainwater or be transported by storm water or other runoff to the storm drain system inside a building or cover them with a tarp or other waterproof material secured with weighted tires or sandbags to prevent contact with rain.

The Contractor is reminded that storage and disposal of all hazardous materials such as paints, thinners, solvents, and fuels; and all hazardous wastes such as waste oil must meet all federal, state and local standards and requirements.

3. De-watering Operations. All groundwater removed from the trench or excavations must be de-silted prior to discharging it into the storm drain system through filtering materials and methods meeting the Association of Bay Area Governments (ABAG) Standards for Erosion & Sediment Control Measures and/or through methods and procedures described in the California Storm Water Best Management Practice Handbook - Construction Activity (latest edition).
4. Pavement Saw-Cutting Operations. The Contractor shall prevent any saw-cutting debris from entering the storm drain system. The Contractor, preferably, shall use dry cutting techniques and sweep up residue. If wet methods are used, the Contractor shall vacuum slurry as cutting proceeds or collect all wastewater by constructing a sand bag sediment barrier. The bermed area shall be of adequate size to collect all wastewater and solids. The Contractor shall allow collected

water to evaporate if the wastewater volume is minimal and if maintaining the ponding area does not interfere with public use of the street area or create a safety hazard. If approved by the Owner, the Contractor may direct or pump saw-cutting wastewater to a dirt area and allow to infiltrate. The dirt area shall be adequate to contain all the wastewater. After wastewater has infiltrated, all remaining saw-cutting residue must be removed and disposed of properly. Remaining silt and debris from the ponding or bermed area shall be removed or vacuumed and disposed of properly.

If a suitable dirt area is not available or discharge to the sanitary sewer is not feasible, with the approval of the Owner and Contra Costa County Flood Control (CCCFC) & Water Conservation District (WCD), the Contractor shall filter the saw-cutting wastewater through filtering materials and methods meeting ABAG Standards for Erosion and Sedimentation Control Measures (latest edition) before discharging to the storm drain.

5. Pavement Operations. The Contractor shall prevent the discharge of pollutants from paving operations by using measures to prevent run-on and run-off pollution, disposing of wastes properly, and by implementing the procedures in the Best Management Practices Handbook. In addition, the Contractor shall observe the following guidelines:
 - Paving during wet weather:
 - a) No paving while it is raining.
 - b) No paving of the top lift of asphalt concrete (AC) on any day that experiences ¼” of rain in a twenty-four (24) hour period.
 - c) No paving of bottom lift if previous seventy-two (72) hour period experienced more than ½” rain, unless directed by the Owner.
 - Store materials as required under section 2.
 - Cover inlets and manholes when applying asphalt, seal coat, tack coat, slurry seal, fog seal, etc.
 - Place drip pans or absorbent materials under paving equipment when not in use. During wet weather, store contaminated paving equipment indoors, or cover with tarp or other waterproof covering.
 - Sweep site daily using mechanical methods to prevent sand, gravel or excess asphalt from entering or being transported by rain into the storm drain system.
 - Keep ample supplies of drip pans or absorbent materials on-site.
 - If paving involves Portland cement concrete, refer to section G6 below.
 - All of the above at the discretion of the Owner.

6. Concrete Operations. **Do not wash out concrete trucks into storm drains, open ditches, streets, streams, etc.** The Contractor shall prevent the discharge of pollutants from concrete operations by using measures to prevent run-on and run-off pollution, properly disposing of wastes, and by implementing the following BMPs:
 - Store all materials in waterproof containers or under cover away from drain inlets or drainage areas.

- Avoid mixing excess amounts of Portland cement materials. Dispose of any excess materials properly.
 - Whenever possible, perform washout of concrete trucks off-site where discharge is controlled and not permitted to discharge to the storm drain system. For on-site washout:
 - Locate washout area at least fifty (50) feet from storm drains, open ditches or other water bodies, preferably in a dirt area. Confine run-off from this area by constructing a temporary pit or bermed area large enough for the liquid and solid waste.
 - Wash out concrete wastes into the temporary pit where the concrete can set, be broken up and then disposed of properly. If the volume of water is greater than what will allow concrete to set, allow the wash water to infiltrate and/or evaporate, if possible. Remove or vacuum the remaining silt and debris from the ponding or bermed area and dispose of it properly.
 - Dispose of wastewater from washing of exposed aggregate to dirt area. The dirt area shall be adequate to contain all the wastewater and once the wastewater has infiltrated, any remaining residue must be removed.
 - Collect and return sweepings from exposed aggregate concrete to a stockpile or dispose of the waste in trash container.
7. Grading and Excavation Operations. The Contractor shall prepare a 40 scale erosion control plan and submit it to the Owner and governing agencies for approval, within fifteen (15) days of the Notice To Proceed.

The erosion and sedimentation control materials and methods shall be in accordance with ABAG Standards For Erosion And Sediment Control Measures and/or the procedures and methods described in the California Storm Water Best Management Practice Handbook - Construction Activity (latest edition).

Sedimentation and erosion control/filter materials shall be placed in a manner that will retain any debris or sediment from flowing into the storm drain system. The Contractor shall have labor, tools, equipment and materials needed, at the job site, to provide the erosion control measures necessary as a result of earthwork or trenching before beginning or continuing these construction activities. Sand bags and straw wattle shall be stockpiled adjacent to the locations of activity and ready to be installed when the rainfall forecast for 48 hours is 40% or greater or when directed by the Owner.

The Contractor shall install siltation control devices around catch basins at the end of each working day. These devices shall be maintained at all times during the construction period, and shall be removed when construction is complete.

The Contractor shall not be allowed to block existing drainage flowing onto the work area. The Contractor shall install temporary drainage facilities, if necessary. There shall be no extra compensation to the Contractor for keeping existing drainage open. The Contractor is responsible for any damage to property or existing improvements resulting from blocking existing drainage.

The Contractor shall inspect the sites of work at the beginning and once every 24-hour period through the duration of each storm to assure that inlets and pipes are not blocked with silt or debris and shall be prepared to make repairs to the erosion control devices and take any other remedial measures as directed by the Owner. At the end of a storm event all depressions with ponded water, the water in catch basins, and the check dam ponds shall be pumped dry and all silt and debris removed. This work shall be completed within twenty-four (24) hours after the end of each storm.

8. Spill Prevention and Control. The Contractor shall take any and all precautions to prevent accidental spills during the work under this contract. However, in the event of a spill:
 - The Contractor shall immediately contain and prevent leaks and spills from entering the storm drain system, and properly clean-up and dispose of the waste and clean-up materials. If waste is hazardous, the Contractor shall comply with all federal, state and local hazardous waste requirements.
 - The Contractor shall not wash any spilled material into the streets, gutters, storm drains, or creeks.
 - The Contractor shall report any hazardous material spills immediately to the Owner and the City of San Jose Police Department, as per hazardous material response protocol.

9. Vehicle/Equipment Cleaning. The Contractor shall not perform vehicle or equipment cleaning or maintenance on-site or in the street using soaps, solvents, de-greasers, steam cleaning equipment or equivalent methods. The Contractor shall perform vehicle or equipment cleaning with water only in a designated, bermed area that will not allow rinse water to run off-site or into the storm drain system. The rinse-water shall be permitted to infiltrate in dirt area or shall be discharged to the sanitary sewer with the approval of the Owner.

The Contractor shall dispose of wash water from the cleaning of water base paint equipment and tools to the sanitary sewer.

If using oil based paint, to the maximum extent practicable, the Contractor shall filter the paint thinner and solvents for reuse and dispose of the waste thinner and solvent, and sludge from cleaning of equipment and tools as hazardous waste. No disposal of oil base materials is allowed into the City sewer system.

10. Contractor Training and Awareness. The Contractor shall train all employees on the water pollution prevention requirements contained in these specifications. The Contractor shall inform all subcontractors of the water pollution prevention contract requirements and include appropriate subcontract provisions to ensure that these requirements are met.

The Contractor shall utilize thermoplastic to stencil new catch basins, constructed as part of the project, with “No Dumping, Drains to Bay”.

11. Good Housekeeping Practices. In addition to the practices and procedures discussed above, the Contractor shall implement the following applicable good housekeeping practices.

- Store materials that have the potential to be transported to the storm drain system by storm run-off or by a spill under cover in a contained area or in sealed waterproof containers.
- Use tarps on the ground to collect fallen debris or splatters that could contribute to storm water pollution.
- Secure opened bags of cement, and of other light or powdered materials which can be transported by wind.
- Pick up litter, construction debris and other wastes daily from outside areas including the sidewalk area, gutter, street pavement and storm drains impacted by the project. All wastes shall be stored in covered containers or disposed of or recycled immediately.
- Dispose of wash water to the sanitary sewer with the approval of Owner or recycle wash water (refer to section 6).
- Inspect vehicles and equipment arriving on-site for leaking fluids and promptly repair leaking vehicles and equipment. Vehicles leaking fluids will not be allowed on the construction site and if not repaired, must be removed.
- Avoid spills by handling materials carefully. Keep a stockpile of spill control materials, such as rags or absorbents, readily accessible on-site. Clean up all spills immediately to prevent any material from being discharged to the storm drain (refer to section 8).
- Train employees regularly on good housekeeping practices and BMPs. Assign responsibility to specific employees on BMPs, good housekeeping practices, and what to do in the event of a spill (refer to section 10).
- Maintain and replace all sediment and water pollution control devices as necessary to ensure that said controls are working effectively (e.g. inspect all sediment ponds or sandbag sedimentation/filtering systems after each rain. Remove accumulated sediment and debris and replace or repair damaged sandbags immediately).

END OF DOCUMENT

DOCUMENT 00 73 73

COMPLIANCE MONITORING AND ENFORCEMENT NOTICE

The _____ is a public works project that is subject to compliance monitoring and enforcement by the Department of Industrial Relations. The prevailing wage laws require that all workers be paid at least the minimum hourly prevailing wage rate as determined by the Director of Industrial Relations for the specific classification (or type of work) performed by workers on the project. The awarding body shall post prevailing wage rates and all other job site postings prescribed by regulation or require the prime contractor to do so.

The Contractor, and each subcontractor, shall submit weekly certified payrolls directly to the Labor Commissioner at least monthly or more frequently if specified in the contract with the District. CPRs shall be in a format prescribed by the Labor Commissioner and the department shall undertake those activities it deems necessary to monitor and enforce compliance with prevailing wage requirements. Complaints concerning nonpayment of the required prevailing wage rates to workers on this project may be filed with the Division of Labor Standards Enforcement (DLSE).

END OF DOCUMENT

HAZARDOUS MATERIALS PROCEDURES AND REQUIREMENTS

1. Summary

This document includes information applicable to hazardous materials and hazard waste abatement.

2. Notice of Hazardous Waste or Materials Conditions

- a. Contractor shall give notice in writing to the District, the Construction Manager, and the Architect promptly, before any of the following conditions are disturbed, and in no event later than twenty-four (24) hours after first observance, of any:
 - (1) Material that Contractor believes may be material that is hazardous waste or hazardous material, as defined in section 25117 of the Health and Safety Code, that is required to be removed to a Class I, Class II, or Class III disposal site in accordance with provisions of existing law;
 - (2) Other material that may present a substantial danger to persons or property exposed thereto in connection with Work at the site.
- b. Contractor's written notice shall indicate whether the hazardous waste or material was shown or indicated in the Contract Documents to be within the scope of Work, and whether the materials were brought to the site by Contractor, its Subcontractors, suppliers, or anyone else for whom Contractor is responsible. As used in this document the term "hazardous materials" shall include, without limitation, asbestos, lead, Polychlorinated biphenyl (PCB), petroleum and related hydrocarbons, and radioactive material.
- c. In response to Contractor's written notice, the District shall investigate the identified conditions.
- d. If the District determines that conditions do not involve hazardous materials or that no change in terms of Contract is justified, the District shall so notify Contractor in writing, stating reasons. If the District and Contractor cannot agree on whether conditions justify an adjustment in Contract Price or Contract Times, or on the extent of any adjustment, Contractor shall proceed with the Work as directed by the District.
- e. If after receipt of notice from the District, Contractor does not agree to resume Work based on a reasonable belief it is unsafe, or does not agree to resume Work under special conditions, then District may order such portion of Work that is in connection with such hazardous condition or such affected area to be deleted from the Work, or performed by others, or District may invoke its

rights to terminate the Contract in whole or in part. District will determine entitlement to or the amount or extent of an adjustment, if any, in Contract Price or Contract Times as a result of deleting such portion of Work, or performing the Work by others.

- f. If Contractor stops Work in connection with any hazardous condition and in any area affected thereby, Contractor shall immediately redeploy its workers, equipment, and materials, as necessary, to other portions of the Work to minimize delay and disruption.

3. Additional Warranties and Representations

- a. Contractor represents and warrants that it, its employees, and its subcontractors and their employees, shall at all times have the required levels of familiarity with the Site and the Work, training, and ability to comply fully with all applicable law and contract requirements for safe and expeditious performance of the Work, including whatever training is or may be required regarding the activities to be performed (including, but not limited to, all training required to address adequately the actual or potential dangers of Contract performance).
- b. Contractor represents and warrants that it, its employees, and its subcontractors and their employees, shall at all times have and maintain in good standing any and all certifications and licenses required by applicable federal, state, and other governmental and quasi-governmental requirements applicable to the Work.
- c. Contractor represents and warrants that it has studied carefully all requirements of the Specifications regarding procedures for demolition, hazardous waste abatement, or safety practices, specified in the Contract, and prior to submitting its bid, has either (a) verified to its satisfaction that the specified procedures are adequate and sufficient to achieve the results intended by the Contract Documents, or (b) by way of approved "or equal" request or request for clarification and written Addenda, secured changes to the specified procedures sufficient to achieve the results intended by the Contract Documents. Contractor accepts the risk that any specified procedure will result in a completed Project in full compliance with the Contract Documents.

4. Monitoring and Testing

- a. District reserves the right, in its sole discretion, to conduct air monitoring, earth monitoring, Work monitoring, and any other tests (in addition to testing required under the agreement or applicable law), to monitor Contract requirements of safe and statutorily compliant work methods and (where applicable) safe re-entry level air standards under state and federal law upon

completion of the job, and compliance of the work with periodic and final inspection by public and quasi-public entities having jurisdiction.

- b. Contractor acknowledges that District has the right to perform, or cause to be performed, various activities and tests including, but not limited to, pre-abatement, during abatement, and post-abatement air monitoring, that District shall have no obligation to perform said activities and tests, and that a portion of said activities and tests may take place prior to the completion of the Work by Contractor. In the event District elects to perform these activities and tests, Contractor shall afford District ample access to the Site and all areas of the Work as may be necessary for the performance of these activities and tests. Contractor will include the potential impact of these activities or tests by District in the Contract Price and the Scheduled Completion Date.
- c. Notwithstanding District's rights granted by this paragraph, Contractor may retain its own industrial hygiene consultant at Contractor's own expense and may collect samples and may perform tests including, but not limited to, pre-abatement, during abatement, and post-abatement personal air monitoring, and District reserves the right to request documentation of all such activities and tests performed by Contractor relating to the Work and Contractor shall immediately provide that documentation upon request.

5. Compliance with Laws

- a. Contractor shall perform safe, expeditious, and orderly work in accordance with the best practices and the highest standards in the hazardous waste abatement, removal, and disposal industry, the applicable law, and the Contract Documents, including, but not limited to, all responsibilities relating to the preparation and return of waste shipment records, all requirements of the law, delivering of all requisite notices, and obtaining all necessary governmental and quasi-governmental approvals.
- b. Contractor represents that it is familiar with and shall comply with all laws applicable to the Work or completed Work including, but not limited to, all federal, state, and local laws, statutes, standards, rules, regulations, and ordinances applicable to the Work relating to:
 - (1) The protection of the public health, welfare and environment;
 - (2) Storage, handling, or use of asbestos, PCB, lead, petroleum based products or other hazardous materials;
 - (3) The generation, processing, treatment, storage, transport, disposal, destruction, or other management of asbestos, PCB, lead, petroleum, or hazardous waste materials or other waste materials of any kind; and
 - (4) The protection of environmentally sensitive areas such as wetlands and coastal areas.

6. Disposal

- a. Contractor has the sole responsibility for determining current waste storage, handling, transportation, and disposal regulations for the job Site and for each waste disposal facility. Contractor must comply fully at its sole cost and expense with these regulations and any applicable law. District may, but is not obligated to, require submittals with this information for it to review consistent with the Contract Documents.
- b. Contractor shall develop and implement a system acceptable to District to track hazardous waste from the Site to disposal, including appropriate "Hazardous Waste Manifests" on the EPA form, so that District may track the volume of waste it put in each landfill and receive from each landfill a certificate of receipt.
- c. Contractor shall provide District with the name and address of each waste disposal facility prior to any disposal, and District shall have the express right to reject any proposed disposal facility. Contractor shall not use any disposal facility to which District has objected. Contractor shall document actual disposal or destruction of waste at a designated facility by completing a disposal certificate or certificate of destruction forwarding the original to the District.

7. Permits

- a. Before performing any of the Work, and at such other times as may be required by applicable law, Contractor shall deliver all requisite notices and obtain the approval of all governmental and quasi-governmental authorities having jurisdiction over the Work. Contractor shall submit evidence satisfactory to District that it and any disposal facility
 - (1) have obtained all required permits, approvals, and the like in a timely manner both prior to commencement of the Work and thereafter as and when required by applicable law, and
 - (2) are in compliance with all such permits, approvals and the regulations.

For example, before commencing any work in connection with the Work involving asbestos-containing materials, or PCBs, or other hazardous materials subject to regulation, Contractor agrees to provide the required notice of intent to renovate or demolish to the appropriate state or federal agency having jurisdiction, by certified mail, return receipt requested, or by some other method of transmittal for which a return receipt is obtained, and to send a copy of that notice to District. Contractor shall not conduct any Work involving asbestos-containing materials or PCBs unless Contractor has first confirmed that the appropriate agency having jurisdiction is in receipt of the

required notification. All permits, licenses, and bonds that are required by governmental or quasi-governmental authorities, and all fees, deposits, tap fees, offsite easements, and asbestos and PCB disposal facilities expenses necessary for the prosecution of the Work, shall be procured and paid for by Contractor. Contractor shall give all notices and comply with the all applicable laws bearing on the conduct of the Work as drawn and specified. If Contractor observes or reasonably should have observed that Plans and Specifications and other Contract Documents are at variance therewith, it shall be responsible for promptly notifying District in writing of such fact. If Contractor performs any Work contrary to applicable laws, it shall bear all costs arising therefrom.

- b. In the case of any permits or notices held in District's name or of necessity to be made in District's name, District shall cooperate with Contractor in securing the permit or giving the notice, but the Contractor shall prepare for District review and execution upon approval, all necessary applications, notices, and other materials.

8. Indemnification

- a. To the extent permitted by law, the indemnities and limitations of liability expressed throughout the Contract Documents apply with equal force and effect to any claims or liabilities imposed or existing by virtue of the removal, abatement, and disposal of hazardous waste. This includes, but is not limited to, liabilities connected to the selection and use of a waste disposal facility, personal injury, property damage, loss of use of property, damage to the environment or natural resources, or “disposal” and “release” of materials associated with the Work (as defined in 42 U.S.C. § 9601 et seq.).

9. Termination

- a. District shall have an absolute right to terminate for default immediately without notice and without an opportunity to cure should Contractor knowingly or recklessly commit a material breach of the terms of the Contract Documents, or any applicable law, on any matter involving the exposure of persons or property to hazardous waste. However, if the breach of contract exposing persons or property to hazardous waste is due solely to an ordinary, unintentional, and non-reckless failure to exercise reasonable care, then the procedures for termination for cause shall apply without modification.

END OF DOCUMENT

AGREEMENT AND RELEASE OF ANY AND ALL CLAIMS

THIS AGREEMENT AND RELEASE OF CLAIMS (“Agreement and Release”) IS MADE AND ENTERED INTO THIS ____ DAY OF _____, 20____ by and between the Berryessa Union School District (“District”) and _____ (“Contractor”), whose place of business is _____.

RECITALS:

1. District and Contractor entered into _____ NO.:_____ (“Contract” or “Project”) in the County of Santa Clara, California.
2. The Work under the Contract has been completed.

NOW, THEREFORE, it is mutually agreed between District and Contractor as follows:

AGREEMENT

3. Contractor will only be assessed liquidated damages as detailed below:

Original Contract Sum \$ _____

Modified Contract Sum \$ _____

Payment to Date \$ _____

Liquidated Damages \$ _____

Payment Due Contractor \$ _____

4. Subject to the provisions hereof, District shall forthwith pay to Contractor the undisputed sum of \$_____ (_____ Dollars and _____ Cents) under the Contract, less any amounts represented by any notice to withhold funds on file with District as of the date of such payment.
5. Contractor acknowledges and hereby agrees that there are no unresolved or outstanding claims in dispute against District arising from the performance of work under the Contract, except for the claims described in Paragraph 6 and continuing obligations described in Paragraph 8. It is the intention of the parties in executing this Agreement and Release that this Agreement and Release shall be effective as a full, final and general release of all claims, demands, actions, causes of action, obligations, costs, expenses, damages, losses and liabilities of Contractor against District, all its respective agents, employees, inspectors, assignees and transferees except for the

Disputed Claim is set forth in Paragraph 6 and continuing obligations described in Paragraph 8 hereof.

6. The following claims are disputed (hereinafter, the "Disputed Claims") and are specifically excluded from the operation of this Agreement and Release:

<u>Claim No.</u>	<u>Description of Claim</u>	<u>Amount of Claim</u>	<u>Date Claim Submitted</u>
------------------	-----------------------------	------------------------	-----------------------------

[Insert information, including attachment if necessary]

7. Consistent with California Public Contract Code section 7100, Contractor hereby agrees that, in consideration of the payment set forth in Paragraph 4 hereof, Contractor hereby releases and forever discharges District, all its agents, employees, inspectors, assignees, and transferees from any and all liability, claims, demands, actions, or causes of action of whatever kind or nature arising out of or in any way concerned with the Work under the Contract.
8. Guarantees and warranties for the Work, and any other continuing obligation of Contractor, shall remain in full force and effect as specified in the Contract Documents.
9. To the furthest extent permitted by California law, Contractor shall defend, indemnify, and hold harmless the District, its agents, representatives, officers, consultants, employees, trustees, and volunteers (the "indemnified parties") from any and all losses, liabilities, claims, suits, and actions of any kind, nature, and description, including, but not limited to, attorneys' fees and costs, directly or indirectly arising out of, connected with, or resulting from the performance of the Contract unless caused wholly by the sole negligence or willful misconduct of the indemnified parties.
10. Contractor hereby waives the provisions of California Civil Code section 1542 which provides as follows:

A GENERAL RELEASE DOES NOT EXTEND TO CLAIMS WHICH THE CREDITOR DOES NOT KNOW OR SUSPECT TO EXIST IN HIS FAVOR AT THE TIME OF EXECUTING THE RELEASE, WHICH IF KNOWN BY HIM MUST HAVE MATERIALLY AFFECTED HIS SETTLEMENT WITH THE DEBTOR.

11. The provisions of this Agreement and Release are contractual in nature and not mere recitals and shall be considered independent and severable. If any such provision or any part thereof shall be at any time held invalid in whole or in part under any federal, state, county, municipal, or other law, ruling, or regulations, then such provision, or part thereof, shall remain in force and effect to the extent permitted by law, and the remaining provisions of this Agreement and Release shall also remain in full force and effect, and shall be enforceable.

12. All rights of District shall survive completion of the Work or termination of Contract, and execution of this Release.

* * * CAUTION: THIS IS A RELEASE - READ BEFORE EXECUTING * * *

Berryessa Union School District

TITLE: _____

NAME: _____

SIGNATURE: _____

CONTRACTOR

TITLE: _____

NAME: _____

SIGNATURE: _____

END OF DOCUMENT

11/13/13

DOCUMENT 00 89 00

GUARANTEE FORM

_____ ("Contractor") hereby agrees that the _____ ("Work" of Contractor) which Contractor has installed for the Berryessa Union School District ("District") for the following project:

PROJECT: Shade Structures at Five Sites

has been performed in accordance with the requirements of the Contract Documents and that the Work as installed will fulfill the requirements of the Contract Documents.

The undersigned agrees to repair or replace any or all of such Work that may prove to be defective in workmanship or material together with any other adjacent Work that may be displaced in connection with such replacement within a period of _____ year(s) from the date of completion as defined in Public Contract Code section 7107, subdivision (c), ordinary wear and tear and unusual abuse or neglect excepted. The date of completion is _____, 20____.

In the event of the undersigned's failure to comply with the above-mentioned conditions within a reasonable period of time, as determined by the District, but not later than seven (7) days after being notified in writing by the District, the undersigned authorizes the District to proceed to have said defects repaired and made good at the expense of the undersigned. The undersigned shall pay the costs and charges therefore upon demand.

Date: _____

Proper Name of Contractor: _____

Signature: _____

Print Name: _____

Title: _____

Representatives to be contacted for service subject to terms of Contract:

NAME: _____

ADDRESS: _____

PHONE NO.: _____

END OF DOCUMENT

11/13/13

DOCUMENT 00 92 00

SMOKE-FREE ENVIRONMENT CERTIFICATION

PROJECT/CONTRACT NO.: **B-02-2020-21** between Berryessa Union School District (the “District” or the “Owner”) and _____ (the “Contractor” or the “Bidder”) (the “Contract” or the “Project”).

This Smoke-Free Environment Certification form is required from the successful Bidder.

Per District Board Policy and consistent with Education Code section 48901 and Health and Safety Code section 39002 all District sites, including the Project site are Tobacco Free Environments. Smoking and the use of tobacco products by all persons is prohibited on or in District property. District property includes; school buildings, school grounds, school owned vehicles and vehicles owned by others while on District property.

I acknowledge that I am aware of the District’s policy regarding smoke-free environments at District sites, including the Project site and hereby certify that I will adhere to the requirements of that policy and not permit any of my firm’s employees, agents, subcontractors, or my firm’s subcontractors’ employees or agents to smoke on the Project site.

Date: _____

Proper Name of Contractor: _____

Signature: _____

Print Name: _____

Title: _____

END OF DOCUMENT

DOCUMENT 00 92 50

ASBESTOS AND OTHER HAZARDOUS MATERIALS CERTIFICATION

Contractor hereby certifies that no Asbestos, or Asbestos-Containing Materials, polychlorinated biphenyl (PCB), or any material listed by the federal or state Environmental Protection Agency or federal or state health agencies as a hazardous material, or any other material defined as being hazardous under federal or state laws, rules, or regulations “New Material Hazardous”, shall be furnished, installed, or incorporated in any way into the Project or in any tools, devices, clothing, or equipment used to affect any portion of Contractor's work on the Project for District.

Contractor further certifies that it has instructed its employees with respect to the above-mentioned standards, hazards, risks, and liabilities.

Asbestos and/or asbestos-containing material shall be defined as all items containing but not limited to chrysotile, crocidolite, amosite, anthophyllite, tremolite, and actinolite. Any or all material containing greater than one-tenth of one percent (.1%) asbestos shall be defined as asbestos-containing material.

Any disputes involving the question of whether or not material is New Hazardous Material shall be settled by electron microscopy or other appropriate and recognized testing procedure, at the District’s determination. The costs of any such tests shall be paid by Contractor if the material is found to be New Hazardous Material.

All Work or materials found to be New Hazardous Material or Work or material installed with “New Hazardous Material” containing equipment will be immediately rejected and this Work will be removed at Contractor's expense at no additional cost to the District.

Contractor has read and understood the document Hazardous Materials Procedures & Requirements, and shall comply with all the provisions outlined therein.

Date: _____

Proper Name of Bidder: _____

Signature: _____

Print Name: _____

Title: _____

END OF DOCUMENT

DOCUMENT 00 93 00

LEAD-BASED PAINT CERTIFICATION

California Occupational Safety and Health Administration (CalOSHA), Environmental Protection Agency (EPA), California Department of Health Services (DHS), California Department of Education (CDE), and the Consumer Product Safety Commission (CPSC) regulate lead-containing paint and lead products. Because the Contractor and its employees will be providing services for the District, and because the Contractor's work may disturb lead-containing building materials, **CONTRACTOR IS HEREBY NOTIFIED** of the potential presence of lead-containing materials located within certain buildings utilized by the District. All school buildings built prior to 1993 are presumed to contain some lead-based paint until sampling proves otherwise.

The CDE mandates that school districts utilize DHS lead-certified personnel when a lead-based hazard is identified. Examples of lead-certified personnel include: project designers, inspectors, and abatement workers. Furthermore, since it is assumed by the district that all painted surfaces (interior as well as exterior) within the District contain some level of lead, it is imperative that the Contractor, its workers and subcontractors fully and adequately comply with all applicable laws, rules and regulations governing lead-based materials (**Including Title 8, California Code of Regulations, Section 1532.1**). Any and all Work which may result in the disturbance of lead-containing building materials must be coordinated through the District.

The California Education Code also prohibits the use or import of lead-containing paint, lead plumbing and solders, or other potential sources of lead contamination in the construction of any new school facility or in the modernization or renovation of any existing school facility. The Contractor shall provide the District with any sample results prior to beginning Work, during the Work, and after the completion of the Work. The District may request to examine, prior to the commencement of the Work, the lead training records of each employee of the Contractor.

If failure to comply with these laws, rules, and regulations results in a site or worker contamination, the Contractor will be held solely responsible for all costs involved in any required corrective actions, and shall defend, indemnify and hold harmless the District, pursuant to the indemnification provisions of the Contract, for all damages and other claims arising therefrom. If lead disturbance is anticipated in the Work, only persons with appropriate accreditation, registrations, licenses and training shall conduct this Work.

It shall be the responsibility of the Contractor to properly dispose of any and all waste products, including but not limited to, paint chips, any collected residue, or any other visual material that may occur from the prepping of any painted surface. It will be the responsibility of the Contractor to provide the proper disposal of any hazardous waste by a certified hazardous waste hauler. This company shall be registered with the

Department of Transportation (DOT) and shall be able to issue a current manifest number upon transporting any hazardous material from any school site within the District.

THE UNDERSIGNED HEREBY ACKNOWLEDGES, UNDER PENALTY OF PERJURY, THAT HE OR SHE HAS RECEIVED NOTIFICATION OF POTENTIAL LEAD-BASED MATERIALS ON THE OWNER'S PROPERTY, AS WELL AS THE EXISTENCE OF APPLICABLE LAWS, RULES AND REGULATIONS GOVERNING WORK WITH, AND DISPOSAL OF, SUCH MATERIALS WITH WHICH IT MUST COMPLY. THE UNDERSIGNED ALSO WARRANTS THAT HE OR SHE HAS THE AUTHORITY TO SIGN ON BEHALF OF AND BIND THE CONTRACTOR.

Date: _____

Proper Name of Contractor: _____

Signature: _____

Print Name: _____

Title: _____

THE UNDERSIGNED HEREBY ACKNOWLEDGES, UNDER PENALTY OF PERJURY, THAT HE OR SHE HAS RECEIVED NOTIFICATION OF POTENTIAL LEAD-BASED MATERIALS ON THE OWNER'S PROPERTY, AS WELL AS THE EXISTENCE OF APPLICABLE LAWS, RULES AND REGULATIONS GOVERNING WORK WITH, AND DISPOSAL OF, SUCH MATERIALS WITH WHICH IT MUST COMPLY. THE UNDERSIGNED ALSO WARRANTS THAT HE OR SHE HAS THE AUTHORITY TO SIGN ON BEHALF OF AND BIND THE CONTRACTOR. THE OWNER MAY REQUIRE PROOF OF SUCH AUTHORITY.

Date: _____

Proper Name of Bidder: _____

Signature: _____

Print Name: _____

Title: _____

END OF DOCUMENT

IMPORTED MATERIALS CERTIFICATION

PROJECT/CONTRACT NO.: **B-02-2020-21** between Berryessa Union School District (the "District") and _____ (the "Contractor" or the "Bidder") (the "Contract" or the "Project").

This form shall be executed by the Contractor and by all entities that, in any way, provide or deliver and/or supply any soils, aggregate, or related materials ("Fill") to the Project Site. All Fill shall satisfy all requirements of any environmental review of the Project performed pursuant to the statutes and guidelines of the California Environmental Quality Act, section 21000 et seq. of the Public Resources Code ("CEQA"), and all requirements of section 17210 et seq. of the Education Code, including requirements for a Phase I environmental assessment acceptable to the State of California Department of Education and Department of Toxic Substances Control.

To the furthest extent permitted by California law, Contractor shall defend, indemnify, and hold harmless the District, its agents, representatives, officers, consultants, employees, trustees, and volunteers pursuant to the indemnification provisions in the Contract Documents for, without limitation, any claim(s) connected with providing, delivering, and/or supplying Fill.

Certification of: Delivery Firm/Transporter Supplier Manufacturer
 Wholesaler Broker Retailer
 Distributor Other _____

Type of Entity Corporation General Partnership
 Limited Partnership Limited Liability Company
 Sole Proprietorship Other _____

Name of firm ("Firm"): _____

Mailing address: _____

Addresses of branch office used for this Project: _____

If subsidiary, name and address of parent company: _____

_____ =

By my signature below, I hereby certify that I am aware of section 25260 of the Health and Safety Code and the sections referenced therein regarding the definition of hazardous material. I further certify on behalf of the Firm that all soils, aggregates, or related materials provided, delivered, and/or supplied or that will be provided, delivered, and/or supplied by this Firm to the Project Site are free of any and all hazardous material as defined in section 25260 of the Health and Safety Code. I further certify that I am authorized to make this certification on behalf of the Firm.

Date: _____
Proper Name of Contractor: _____
Signature: _____
Print Name: _____
Title: _____

END OF DOCUMENT

11/13/13

SECTION 01 20 00
PRICE AND PAYMENT PROCEDURES

PART 1 GENERAL

1.1 SECTION INCLUDES

- A. Procedures for preparation and submittal of applications for progress payments.
- B. Documentation of changes in Contract Sum and Contract Time.
- C. Change procedures.
- D. Correlation of Contractor submittals based on changes.
- E. Procedures for preparation and submittal of application for final payment.

1.2 RELATED REQUIREMENTS

- A. Document 00 50 00 - Contracting Forms and Supplements: Forms to be used.
- B. Document 00 52 00 - Agreement Form: Contract Sum, retainages, payment period, monetary values of unit prices.
- C. Document 00 72 00 - General Conditions and Document 00 73 00 - Supplementary Conditions: Additional requirements for progress payments, final payment, changes in the Work.
- D. Document 00 73 00 - Supplementary Conditions: Percentage allowances for Contractor's overhead and profit.
- E. Section 01 2100 - Allowances: Payment procedures relating to allowances.
- F. Section 01 2200 - Unit Prices: Monetary values of unit prices, payment and modification procedures relating to unit prices.

1.3 SCHEDULE OF VALUES

- A. Electronic media printout including equivalent information will be considered in lieu of standard form specified; submit draft to Architect and Construction Manager for approval.
- B. Forms filled out by hand will not be accepted.
- C. Submit Schedule of Values in duplicate within 10 days after date of the Notice of Award of the Contract. This date is per the District's General Conditions

Section 9.2.1.A by the District.

- D. Format: Utilize the Table of Contents of this Project Manual. Identify each line item with number and title of the specification Section. Identify site mobilization.
- E. Include in each line item, the amount of Allowances specified in this section. For unit cost Allowances, identify quantities taken from Contract Documents multiplied by the unit cost to achieve the total for the item.
- F. Include separately from each line item, a direct proportional amount of Contractor's overhead and profit.
- G. Revise schedule to list approved Change Orders, with each Application For Payment.

1.4 APPLICATIONS FOR PROGRESS PAYMENTS

- A. Payment Period: Submit at intervals stipulated in the Agreement.
- B. Electronic media printout including equivalent information will be considered in lieu of standard form specified; submit sample to Architect for approval.
- C. Forms filled out by hand will not be accepted.
- D. For each item, provide a column for listing each of the following:
 - 1. Item Number.
 - 2. Description of work.
 - 3. Scheduled Values.
 - 4. Previous Applications.
 - 5. Work in Place and Stored Materials under this Application.
 - 6. Authorized Change Orders.
 - 7. Total Completed and Stored to Date of Application.
 - 8. Percentage of Completion.
 - 9. Balance to Finish.
 - 10. Retainage.
- E. Execute certification by signature of authorized officer.

- F. Use data from approved Schedule of Values. Provide dollar value in each column for each line item for portion of work performed and for stored products.
- G. List each authorized Change Order as a separate line item, listing Change Order number and dollar amount as for an original item of Work.
- H. Submit Four copies of each Application for Payment.
- I. Include the following with the application:
 - 1. Transmittal letter as specified for Submittals in Section 01 3000.
 - 2. Construction progress schedule, revised and current as specified in Section 01 3000.
 - 3. Partial release of liens from major Subcontractors and vendors.
 - 4. Affidavits attesting to off-site stored products.
 - 5. Conditional and Unconditional Waiver Releases.
- J. When Architect requires substantiating information, submit data justifying dollar amounts in question. Provide one copy of data with cover letter for each copy of submittal. Show application number and date, and line item by number and description.

1.5 MODIFICATION PROCEDURES

- A. Submit name of the individual authorized to receive change documents and who will be responsible for informing others in Contractor's employ and/or subcontractors of changes to the Contract Documents.
- B. For required changes, Owner, Architect or Construction Manager will issue a CCD approved by DSA and signed by Owner instructing Contractor to proceed with the change, for subsequent inclusion in a Change Order.
 - 1. The document will describe the required changes and will designate method of determining any change in Contract Sum or Contract Time.
 - 2. Promptly execute the change.
- C. Contractor may propose a change by submitting a request for change to Owner, Architect or Construction Manager describing the proposed change and its full effect on the Work, with a statement describing the reason for the change, and the effect on the Contract Sum and Contract Time with full documentation and a statement describing the effect on Work by separate or other contractors. Document any requested substitutions in accordance with Section 01 6000.

- D. Computation of Change in Contract Amount: As specified in the Agreement and Conditions of the Contract.
1. For change requested by Owner, Architect or Construction Manager for work falling under a fixed price contract, the amount will be based on Contractor's price quotation.
 2. For change requested by Contractor, the amount will be based on the Contractor's request for a Change Order as approved by Owner, Architect or Construction Manager.
 3. For pre-determined unit prices and quantities, the amount will be based on the fixed unit prices.
 4. For change ordered by Owner, Architect or Construction Manager without a quotation from Contractor, the amount will be determined by Architect based on the Contractor's substantiation of costs as specified for Time and Material work.
- E. Substantiation of Costs: Provide full information required for evaluation.
1. On request, provide the following data:
 - a. Quantities of products, labor, and equipment.
 - b. Taxes, insurance, and bonds.
 - c. Overhead and profit.
 - d. Justification for any change in Contract Time.
 - e. Credit for deletions from Contract, similarly documented.
 2. Support each claim for additional costs with additional information:
 - a. Origin and date of claim.
 - b. Dates and times work was performed, and by whom.
 - c. Time records and wage rates paid.
 - d. Invoices and receipts for products, equipment, and subcontracts, similarly documented.
 3. For Time and Material work, submit itemized account and supporting data after completion of change, within time limits indicated in the Conditions of the Contract.

- F. Execution of Change Orders: Owner, Architect or Construction Manager will issue Change Orders for signatures of parties as provided in the Conditions of the Contract.
- G. After execution of Change Order, promptly revise Schedule of Values and Application for Payment forms to record each authorized Change Order as a separate line item and adjust the Contract Sum.
- H. Promptly revise progress schedules to reflect any change in Contract Time, revise sub-schedules to adjust times for other items of work affected by the change, and resubmit.
- I. Promptly enter changes in Project Record Documents.

1.06 APPLICATION FOR FINAL PAYMENT

- J. Prepare Application for Final Payment as specified for progress payments, identifying total adjusted Contract Sum, previous payments, and sum remaining due.
- K. Application for Final Payment will not be considered until the following have been accomplished:
 - 1. All closeout procedures specified in Section 01 7000 have been accomplished and the project is Certified by DSA.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION - NOT USED

END OF SECTION

SECTION 01 10 00
SUMMARY OF WORK

PART 1 GENERAL

1.1 PROJECT

- A. Project Name: **Shade Structures at Five Sites**
- B. Owner's Name: Berryessa Union School District.
- C. Architect's Name: Sugimura / Finney Architects
- D. Work in the Contract comprises: Provide all materials and labor to install shade structures & covered walkway at five (5) schools. Including all work (materials & labor) associated with the installation of the shade structures, entry canopy and covered walkway. See section 1.3 for additional information.

1.2 CONTRACT DESCRIPTION

- A. Contract Type: A single prime contract based on a Stipulated Price as described in Document 00 5200 - Agreement Form.

1.3 DESCRIPTION OF WORK & SCHEDULE FOR COMPLETION

- A. Work in this Contract:
Provide all labor and materials as needed to construct shade structures, entry canopy and covered walkways as shown on the project drawings and project manual.

CLARIFICATION – ALL SHADE STRUCTURES, COVERED WALKWAYS & ENTRY CANOPY ARE CONTRACTOR FURNISHED / CONTRACTOR INSTALLED. DISREGARD GENERAL NOTE STATING SHADE STRUCTURES ARE O.F.C.I.

Also included:

1. Removal and lawful disposal of all spoils from all sites (soil, asphalt, concrete, etc.) resulting from the work.
2. Provide a underground survey of work area at all sites by licensed underground locating service prior to any drilling, coring or excavating work. Provide copies to the Owner, IOR & Architect.
3. Provide repair or replacement of all surfaces damaged or disturbed during the work at all sites.
4. Provide temporary fencing around all work and staging areas at all sites.

5. Provide labor and equipment to off-load and store materials for the work at all sites.
6. Provide debris bins and sanitary facilities at all sites where work is being performed.
7. Removal and replacement / re-installation of any fencing removed to access any of the sites.

B. Work Not Included in this Contract:

1. Morrill Middles School – ADA Parking Stall / ADA work.
2. Piedmont Middle School – Tree Removal, AC paving, Fencing/Gates, Signage, Marquee Sign & Associated Marquee Sign Work.
3. Noble Elementary School – ADA Parking Stall / ADA Work, AC Paving, Signage.
4. Ruskin Elementary School – ADA Parking Stall / ADA Work, AC Paving, Signage
5. Vinci Park Elementary School – Marquee Sign.

C. Schedule for Completion of the Work: One Hundred Twenty Nine (129) Consecutive Calendar Days after Contractor's Receipt of the District's Notice to Proceed.

The Sequence of Work is as Shown Below:

1. Piedmont Middle School
2. Morrill Middle School
3. Noble Elementary School
4. Ruskin Elementary School
5. Vinci Park Elementary School

1.4 OWNER OCCUPANCY

- A. Owner currently occupies the sites.
- B. Cooperate with Owner and site staff to minimize conflict and to facilitate Owner's operations.
- C. Schedule the Work to accommodate Owner occupancy as needed.
- D. No work on sites by subcontractors without on-site supervision by Prime Contractor.
- E. Work by Others at Sites:
 - 1) Site Paving
 - 2) Site Fencing
 - 3) District Maintenance Work
 - 4) District IT Work

Coordinate with Other Contractors, District and/or Vendors to complete the work.

1.5 CONTRACTOR USE OF SITE AND PREMISES

- A. Construction Operations: Limited to areas noted on Drawings.
- B. Provide access to and from site as required by law and by Owner.
 - 1. Emergency Building Exits During Construction: Keep all exits required by code open during construction period; provide temporary exit signs if exit routes are temporarily altered.
 - 2. Do not obstruct roadways, sidewalks, or other public ways without permit.
- C. Utility Outages and Shutdown.
 - 1. Do not disrupt or shut down life safety systems, including but not limited to fire sprinklers and fire alarm system, without 7 days' notice to Owner and authorities having jurisdiction.
 - 2. Limit shutdown of utility services to minimal hours, arranged at least 48 hours in advance with Owner.
 - 3. Prevent accidental disruption of utility services to other facilities.

END OF SECTION

SECTION 01 21 00
ALLOWANCES

PART 1 GENERAL

1.1 SECTION INCLUDES

1.2 RELATED REQUIREMENTS

- A. Section 01 2000 - Price and Payment Procedures: Additional payment and modification procedures.

1.3 CONTINGENCY ALLOWANCE

- A. Contractor's costs for products, delivery, installation, labor, insurance, payroll, taxes, bonding, equipment rental, overhead and profit will be included in Change Orders authorizing expenditure of funds from this Contingency Allowance.
- B. Funds will be drawn from the Contingency Allowance only by Change Order.
- C. Labor quantities MUST be verified by the I.O.R. prior to payment.
- D. At closeout of Contract, funds remaining in Contingency Allowance will be credited to Owner by Change Order.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION - NOT USED

END OF SECTION

SECTION 01 22 00
UNIT PRICES

PART 1 GENERAL

1.1 SECTION INCLUDES

- A. List of unit prices, for use in preparing Bids.
- B. Measurement and payment criteria applicable to Work performed under a unit price payment method.

1.2 RELATED REQUIREMENTS

- A. Document 00 21 13 - Instructions to Bidders: Instructions for preparation of pricing for Unit Prices.
- B. Document 00 43 22 - Unit Prices Form: List of Unit Prices as supplement to Bid Form.
- C. Section 01 2000 - Price and Payment Procedures: Additional payment and modification procedures.

1.3 COSTS INCLUDED

- A. Unit Prices included on the Bid Form shall include full compensation for all required labor, products, tools, equipment, plant, transportation, services and incidentals; erection, application or installation of an item of the Work; overhead and profit.

1.4 UNIT QUANTITIES SPECIFIED

- A. Quantities indicated in the Bid Form are for bidding and contract purposes only. Quantities and measurements of actual Work will determine the payment amount.

1.5 MEASUREMENT OF QUANTITIES

- A. Measurement methods delineated in the individual specification sections complement the criteria of this section. In the event of conflict, the requirements of the individual specification section govern.
- B. Take all measurements and compute quantities. Measurements and quantities will be verified by Architect, Owner or Construction Manager.
- C. Assist by providing necessary equipment, workers, and survey personnel as required.

- D. Measurement by Weight: Concrete reinforcing steel, rolled or formed steel or other metal shapes will be measured by handbook weights. Welded assemblies will be measured by handbook or scale weight.
- E. Measurement by Volume: Measured by cubic dimension using mean length, width and height or thickness.
- F. Measurement by Area: Measured by square dimension using mean length and width or radius.
- G. Linear Measurement: Measured by linear dimension, at the item centerline or mean chord.
- H. Stipulated Price Measurement: Items measured by weight, volume, area, or linear means or combination, as appropriate, as a completed item or unit of the Work.
- I. Perform surveys required to determine quantities, including control surveys to establish measurement reference lines. Notify Architect prior to starting work.
- J. Contractor's Engineer Responsibilities: Sign surveyor's field notes or keep duplicate field notes, calculate and certify quantities for payment purposes.

1.6 PAYMENT

- A. Payment for Work governed by unit prices will be made on the basis of the actual measurements and quantities of Work that is incorporated in or made necessary by the Work and accepted by the Architect, multiplied by the unit price.
- B. Payment will not be made for any of the following:
 - 1. Products wasted or disposed of in a manner that is not acceptable.
 - 2. Products determined as unacceptable before or after placement.
 - 3. Products not completely unloaded from the transporting vehicle.
 - 4. Products placed beyond the lines and levels of the required Work.
 - 5. Products remaining on hand after completion of the Work.
 - 6. Loading, hauling, and disposing of rejected Products.

1.7 DEFECT ASSESSMENT

- A. Replace Work, or portions of the Work, not conforming to specified requirements.

- B. If, in the opinion of Architect, Owner or Construction Manager it is not practical to remove and replace the Work, Architect will direct one of the following remedies:
1. The defective Work may remain, but the unit price will be adjusted to a new unit price at the discretion of Architect, Owner or Construction Manager.
 2. The defective Work will be partially repaired to the instructions of the Architect, and the unit price will be adjusted to a new unit price at the discretion of Architect.
- C. The individual specification sections may modify these options or may identify a specific formula or percentage price reduction.
- D. The authority of Architect to assess the defect and identify payment adjustment is final.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION - NOT USED

END OF SECTION

ALTERNATES AND UNIT PRICING

PART I – ALTERNATES

1.01 RELATED DOCUMENTS AND PROVISIONS

- A. All Contract Documents should be reviewed for applicable provisions related to the provisions in this document, including without limitation:
1. General Conditions;
 2. Special Conditions;
 3. Bid Form and Proposal;
 4. Instruction to Bidders.

1.02 DESCRIPTION

- A. The following items of work include proposed modifications to, substitutions for, to and/or deletions from the various parts of the Work specified in other Documents of the Specifications. The acceptance or rejection of any of the alternates is strictly at the option of the District subject to District's acceptance of Contractor's stated prices contained in this Proposal.

1.03 GENERAL

- A. Where an item is omitted, or scope of Work is decreased, all Work pertaining to the item whether specifically stated or not, shall be omitted and where an item is added or modified or where scope of Work is increased, all Work pertaining to that required to render same ready for use on the Project in accordance with intention of Drawings and Specifications shall be included in an agreed upon price amount.

1.04 BASE BID

- A. The Base Bid includes all work required to construct the Project completely and in accordance with the Contract Documents.

1.05 ALTERNATES

- A. The below Alternate descriptions are general in nature and for reference purposes only. The Contract Documents, including, without limitation, the Drawings and Specifications, must be referred to for the complete scope of Work.

PART 2 - UNIT PRICING

2.01 GENERAL

- A. Contractor shall completely state all required figures based on Unit Prices listed below. Where scope of Work is decreased, all Work pertaining to the item, whether specifically stated or not, shall be omitted and where scope of Work is increased, all work pertaining to that item required to render same ready for use on the Project in

accordance with intention of Drawings and Specifications shall be included in an agreed upon price amount.

2.02 UNIT PRICES

- A. Furnish unit prices for each of the named items included on the bid form on a square foot, lineal foot, or per each basis, as applies. Unit prices shall include all labor, materials, services, profit, overhead, insurance (excluding costs of insurance covered by OCIP), bonds, taxes, and all other incidental costs of Contractor, subcontractors, and supplier(s).

PART 3 – EXECUTION Not Used.

END OF DOCUMENT

11/13/13

SUBSTITUTION PROCEDURES

PART 1 - GENERAL

1.01 RELATED DOCUMENTS AND PROVISIONS

All Contract Documents should be reviewed for applicable provisions related to the provisions in this document, including without limitation:

- A. General Conditions, including, without limitation, Substitutions For Specified Items;
- B. Special Conditions.

1.02 SUBSTITUTIONS OF MATERIALS AND EQUIPMENT

- A. Catalog numbers and specific brands or trade names followed by the designation "or equal" are used in conjunction with material and equipment required by the Specifications to establish the standards of quality, utility, and appearance required. Substitutions which are equal in quality, utility, and appearance to those specified may be reviewed subject to the provisions of the General Conditions.
- B. Wherever more than one manufacturer's product is specified, the first-named product is the basis for the design used in the work and the use of alternative-named manufacturers' products or substitutes may require modifications in that design. If such alternatives are proposed by Contractor and are approved by the District and-or the Architect, Contractor shall assume all costs required to make necessary revisions and modifications of the design resulting from the substitutions requested by the Contractor.
- C. When materials and equipment are specified by first manufacturer's name and product number, second manufacturer's name and "or approved equal," supporting data for the second product, if proposed by Contractor, shall be submitted in accordance with the requirements for substitutions.
- D. If the District and-or Architect, in reviewing proposed substitute materials and equipment, requires revisions or corrections to be made to previously accepted Shop Drawings and supplemental supporting data to be resubmitted, Contractor shall promptly do so. If any proposed substitution is judged by the District and-or Architect to be unacceptable, the specified material or equipment shall be provided.

- E. Samples may be required. Tests required by the District and-or Architect for the determination of quality and utility shall be made at the expense of Contractor, with acceptance of the test procedure first given by the District.
- F. In reviewing the supporting data submitted for substitutions, the District and-or Architect will use for purposes of comparison all the characteristics of the specified material or equipment as they appear in the manufacturer's published data even though all the characteristics may not have been particularly mentioned in the Contract Documents. If more than two (2) submissions of supporting data are required, the cost of reviewing the additional supporting data shall be borne by Contractor, and the District will deduct the costs from the Contract Price.

1.03 SUBMITTALS

- A. Substitution Request Submittal: Requests for substitution will be considered if received as noted in the contract documents. Requests not received within the timeline established may be considered or rejected at the discretion of the Architect.
 - 1. Submit 3 copies of each request for substitution for consideration. Submit requests in the form and in accordance with procedures required for Change Order proposals.
 - 2. Identify the product, or the fabrication or installation method to be replaced in each request. Include related Specification Document and Drawing numbers. Provide complete documentation showing compliance with the requirements for substitutions, and the following information, as appropriate:
 - a. Product Data, including Drawings and descriptions, or products, fabrication and installation procedures.
 - b. Samples, where applicable or requested.
 - c. A detailed comparison of significant qualities of the proposed substitution with those of the Work specified. Significant qualities may include elements such as size, weight, durability, performance and visual effect.
 - d. Coordination information, including a list of changes or modifications needed to other parts of the Work and to construction performed by the Owner and separate Contractors that will become necessary to accommodate the proposed substitution.

- e. A statement indicating the substitution's effect on the Contractor's Construction Schedule compared to the schedule without approval of the substitution. Indicate the effect of the proposed substitution on overall Contract Time.
 - f. Cost information, including a proposal of the net change, if any in the Contract Sum.
 - g. Certification by the Contractor that the substitution proposed is equal-to or better in every significant respect to that required by the Contract Documents, and that it will perform adequately in the application indicated. Include the Contractor's waiver of rights to additional payment or time that may subsequently become necessary because of the failure of the substitution to perform adequately.
- B. Architect's Action: Within one week of receipt of the request for substitution, the Architect will request additional information or documentation necessary for evaluation of the request. Within 2 weeks of receipt of the request, or one week of receipt of the additional information or documentation, whichever is later, the Architect will notify the Contractor of acceptance or rejection of the proposed substitution. If a decision on use of a proposed substitute cannot be made or obtained within the time allocated, use the product specified by name.

PART 2 – PRODUCTS

2.01 SUBSTITUTIONS

- A. Conditions: The Contractor's substitution request will be received and considered by the Architect when one or more of the following conditions are satisfied, as determined by the Architect; otherwise, requests will be returned without action except to record noncompliance with these requirements.
1. Extensive revisions to Contract Documents are not required.
 2. Proposed changes are in keeping with the general intent of Contract Documents.
 3. The request is timely, fully documented and properly submitted.
 4. The request is directly related to an "or equal" clause or similar language in the Contract Documents.
 5. The specified product or method of construction cannot be provided within the Contract Time. The request will not be considered if the product or method cannot be provided as a result of failure to pursue the Work promptly or coordinate activities properly.

6. The specified product or method of construction cannot receive necessary approval by a governing authority, and the requested substitution can be approved.
 7. A substantial advantage is offered the Owner, in terms of cost, time, energy conservation or other considerations of merit, after deducting offsetting responsibilities for the Owner may be required to bear. Additional responsibilities for the Owner may include additional compensation to the Architect for redesign and evaluation services, increased cost of other construction by the Owner or separate Contractors, and similar considerations.
 8. The specified product or method of construction cannot be provided in a manner that is compatible with other materials, and where the Contractor certifies that the substitution will overcome the incompatibility.
 9. The specified product or method of construction cannot be coordinated with other materials, and where the Contractor certifies that the proposed substitution can be coordinated.
 10. The specified product or method of construction cannot provide a warranty required by the Contract Documents and where the Contractor certifies that the proposed substitution provide the required warranty.
- B. The Contractor's submittal and Architect's acceptance of Shop Drawings, Product Data or Samples that relate to construction activities not complying with the Contract Documents does not constitute an acceptable or valid request for substitution, nor does it constitute approval
- C. By making requests for substitutions based on Sub-paragraph above, the Contractor:
1. Represents that the Contractor has personally investigated the proposed substitute product and determined that it is equal or superior in all respects to the specified.
 2. Represents that the Contractor will provide the same warranty for the substitution that the Contractor would for the specified.
 3. Certifies that the cost data presented is complete and includes all related costs under this Contract except the Architect's redesign costs, and waives all claims for additional costs related to the substitution which subsequently becomes apparent.
 4. Will coordinate the installation of the accepted substitute, making such changes as may be required for the Work to be completed in all respects.

- D. If a proposed substitution requires investigation, testing or approval to determine its suitability for incorporation into the work, the testing of the proposed substitution shall be as determined by the Architect. The Contractor shall bear all cost of such investigations or test.
- E. All Substitutions that affect Structural Safety, Fire and Life Safety, Access Compliance or Energy (as applicable) shall be submitted to the Division of the State Architect for review and approval.

PART 3 – EXECUTION Not Used.

END OF DOCUMENT

SECTION 01 30 00
ADMINISTRATIVE REQUIREMENTS

PART 1 GENERAL

1.1 SECTION INCLUDES

- A. Electronic document submittal service.
- B. Preconstruction meeting.
- C. Site mobilization meeting.
- D. Progress meetings.
- E. Construction progress schedule.
- F. Submittals for review, information, and project closeout.
- G. Submittal procedures.

1.2 RELATED REQUIREMENTS

- A. Division 00 - Procurement and Contracting Requirements
- B. Section 01 3216 - Construction Progress Schedule: Form, content, and administration of schedules.
- C. Section 01 7000 - Execution and Closeout Requirements: Additional coordination requirements.
- D. Section 01 7800 - Closeout Submittals: Project record documents.

1.3 PROJECT COORDINATION

- A. Project Coordinator: Construction Manager.
- B. Cooperate with the Construction Manager in allocation of mobilization areas of site; staging, Contractor access, traffic, and parking facilities.
- C. Coordinate field engineering and layout work under instructions of the District, CM and Architect.
- D. Make the following types of submittals to Architect through the Construction Manager and I.O.R.:
 - 1. Requests for information.
 - 2. Requests for substitution.
 - 3. Shop drawings, product data, and samples.
 - 4. Test and inspection reports.
 - 5. Applications for payment and change order requests.

6. Progress schedules.

7. Closeout submittals.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION

3.1 ELECTRONIC DOCUMENT SUBMITTAL SERVICE

- A. All documents transmitted for purposes of administration of the contract are to be in electronic (PDF) format and transmitted via email or an Internet-based submittal service as determined by the CM that receives, logs and stores documents, provides electronic stamping and signatures, and notifies addressees via email.
1. Besides submittals for review, information, and closeout, this procedure applies to requests for information (RFIs), progress documentation, contract modification documents (e.g. supplementary instructions, change proposals, change orders), applications for payment, field reports and meeting minutes, Contractor's correction punchlist, and any other document any participant wishes to make part of the project record.
 2. [] All parties are required to use this service.
 3. It is Contractor's responsibility to submit documents in PDF format.
 4. Subcontractors, suppliers, and Architect's consultants will be permitted to use the service at no extra charge.
 5. Users of the service need an email address, Internet access, and PDF review software that includes ability to mark up and apply electronic stamps (such as Adobe Acrobat, www.adobe.com, or Bluebeam PDF Revu, www.bluebeam.com), unless such software capability is provided by the service provider.
 6. Paper document transmittals will be reviewed if submitted with samples or other similar items only; emailed PDF documents will not be reviewed if an internet service is agreed to.
 7. All other specified submittal and document transmission procedures apply, except that electronic document requirements do not apply to samples or color selection charts.
- B. Submittal Service: The selected service is:
1. To be approved by the Owner.
- C. Training: One, one-hour, web-based training session will be arranged for all participants, with representatives of Architect and Contractor participating; further training is the responsibility of the user of the service.
1. Representatives of Owner and Construction Manager will be included in this training as necessary.

- D. Project Closeout: Architect will determine when to terminate the service for the project and is responsible for obtaining archive copies of files for Owner.

3.2 CONTRACTOR MEETINGS

- A. Conduct trade preconstruction meeting with each trade to review scope and schedule prior to start of work.
- B. Conduct coordination meetings with multiple trades prior to start of work in cases where more than two trades are working simultaneously in the same work area, or where two or more trades' work intersects, or impacts the other.

3.3 PRECONSTRUCTION MEETING

- A. Owner will schedule a meeting after Notice of Award.
- B. Project Coordinator will schedule a meeting after Notice of Award.
- C. Attendance Required:
 - 1. Owner.
 - 2. Architect.
 - 3. Contractor.
 - 4. Construction Manager.
 - 5. [].
- D. Agenda:
 - 1. Execution of Owner-Contractor Agreement.
 - 2. Submission of executed bonds and insurance certificates.
 - 3. Distribution of Contract Documents.
 - 4. Submission of list of Subcontractors, list of Products, schedule of values, and progress schedule.
 - 5. Designation of personnel representing the parties to the Contract, Owner, Construction Manager and Architect.
 - 6. Procedures and processing of field decisions, submittals, substitutions, applications for payments, proposal request, Change Orders, and Contract closeout procedures.
 - 7. Scheduling.
 - 8. Review site logistics plans, site safety plans and construction sequencing.
- E. The Construction Manager will record minutes and distribute copies within 48 hours after meeting to participants.[]

3.4 SITE MOBILIZATION MEETING

- A. Construction Manager will schedule meeting at the Project site prior to [] occupancy.
- B. Attendance Required:
 - 1. Contractor.
 - 2. Owner.
 - 3. I.O.R..
- C. Agenda:
 - 1. Use of premises by Owner and Contractor.
 - 2. Owner's requirements and occupancy prior to completion.
 - 3. Construction facilities and controls provided by Owner.
 - 4. Temporary utilities provided by Owner.
 - 5. Survey and building layout.
 - 6. Security and housekeeping procedures.
 - 7. Schedules.
 - 8. Application for payment procedures.
 - 9. Procedures for testing.
 - 10. Procedures for maintaining record documents.
 - 11. Requirements for start-up of equipment.
 - 12. Inspection and acceptance of equipment put into service during construction period.
- D. Record minutes and distribute copies within two days after meeting to participants, with two copies to Architect, Owner, participants, and those affected by decisions made.

3.5 PROGRESS MEETINGS

- A. Construction Manager will make arrangements for meetings, prepare agenda with copies for participants, preside at meetings.
- B. Attendance Required: Job superintendent, Owner, CM, Architect, I.O.R., subcontractors as appropriate to agenda topics for each meeting.
- C. Agenda:
 - 1. Review minutes of previous meetings.
 - 2. Review of Work progress and three week look-ahead against the original schedule submitted by the contractor prior to initiation of work.
 - 3. Field observations, issues, and decisions.

4. Identification of issues that impede, or will impede, planned progress including open RFIs.
5. Review of submittals schedule and status of submittals.
6. Maintenance of progress schedule.
7. Corrective measures to regain projected schedules.
8. Planned progress during succeeding work period.
9. Maintenance of quality and work standards.
10. Effect of proposed changes on progress schedule and coordination.
11. Other business relating to Work.

D. Record minutes and distribute copies within 48 hours after meeting to participants.

3.6 SUBMITTALS FOR REVIEW

A. When the following are specified in individual sections, submit them for review:

1. Product data.
2. Shop drawings.
3. Samples for selection.

B. Submit to Architect for review for the limited purpose of checking for conformance with information given and the design concept expressed in the contract documents.

C. Samples will be reviewed only for aesthetic, color, or finish selection.

D. After review, provide copies and distribute in accordance with SUBMITTAL PROCEDURES article below.

3.7 SUBMITTALS FOR INFORMATION

A. When the following are specified in individual sections, submit them for information:

1. Design data.
2. Certificates upon completion of installation.
3. Test reports.
4. Inspection reports.
5. Manufacturer's instructions.
6. Manufacturer's field reports.
7. Other types indicated.

B. Submit for Architect's knowledge as contract administrator and to Owner.

3.8 SUBMITTALS FOR PROJECT CLOSEOUT

- A. When the following are specified in individual sections, submit them at project closeout:
 - 1. Project record documents with field marked as-built drawings.
 - 2. Operation and maintenance data.
 - 3. Warranties.
 - 4. Bonds.
 - 5. Training Manuals.
 - 6. Other types as indicated.
- B. Submit for Owner's benefit during and after project completion.

3.9 NUMBER OF COPIES OF SUBMITTALS

- A. Documents: Submit one electronic copy in PDF format; an electronically-marked up file will be returned. Create PDFs at native size and right-side up; illegible files will be rejected.
- B. Upon review and acceptance of submittals, provide two hard copies, one to the Architect and one to the Owner.
- C. Samples: Submit the number specified in individual specification sections; one of which will be retained by Architect.
 - 1. After review, produce duplicates.
 - 2. Retained samples will not be returned to Contractor unless specifically so stated.

3.10 SUBMITTAL PROCEDURES

- A. Shop Drawing Procedures:
 - 1. Prepare accurate, drawn-to-scale, original shop drawing documentation by interpreting the Contract Documents and coordinating related Work.
 - 2. Use of the Construction drawings for shop drawing production will only be allowed if the contractor and specific sub-contractor submit a signed release of liability statement provided by the Architect. [].
 - 3. Generic, non-project specific information submitted as shop drawings do not meet the requirements for shop drawings.
- B. Transmit each submittal with a copy of approved submittal form.
- C. Submit complete list of anticipated submittals no later than 10 days after notice to proceed[].
- D. Submittals must be submitted and review completed and accepted prior to the start of work.
- E. Submittals are to be complete for all items in each specification section. Partial

submittals may not be reviewed.

- F. Transmit each submittal with a transmittal.
- G. Sequentially number the transmittal form. Revise submittals with original number and a sequential alphabetic suffix.
- H. Identify Project, Contractor, Subcontractor or supplier; pertinent drawing and detail number, and specification section number, as appropriate on each copy.
- I. Apply Contractor's stamp, signed or initialed certifying that review, approval, verification of Products required, field dimensions, adjacent construction work, and coordination of information is in accordance with the requirements of the Work and Contract Documents and date of review.
- J. Deliver submittals to Architect via email or Contractor's website. Provide email notification when submittals are loaded to website.
- K. Schedule submittals to expedite the Project, and coordinate submission of related items.
- L. For each submittal for review, allow 10 business days excluding delivery time to and from the Contractor.
- M. Identify variations from Contract Documents and Product or system limitations that may be detrimental to successful performance of the completed Work. Describe proposed substitutions or equals on the submittal cover. Accepting a submittal that does not identify deviations from the contract does not constitute acceptance of the deviations.
- N. Provide space for Contractor and Architect review stamps.
- O. When revised for resubmission, identify all changes made since previous submission.
- P. Distribute reviewed submittals as appropriate. Instruct parties to promptly report any inability to comply with requirements.
- Q. Submittals not requested will not be recognized or processed.

END OF SECTION

SECTION 01 32 16
CONSTRUCTION PROGRESS SCHEDULE

PART 1 GENERAL

1.1 SECTION INCLUDES

- A. Preliminary schedule.
- B. Construction progress schedule, bar chart type.

1.2 RELATED SECTIONS

- A. Section 01 3000 - Administrative Requirements

1.3 REFERENCES

- A. AGC (CPSM) - Construction Planning and Scheduling Manual; Associated General Contractors of America; 2004.

1.4 SUBMITTALS

- A. Within 10 days after notice to proceed, submit complete, detailed construction schedule.
 - 1. This project will be built in conjunction and concurrently with other projects. Integrate schedule for this project with other projects being performed.
 - 2. Schedules to be maintained in Primavera, P6 Project Planner platform or other scheduling software approved by the District.
 - 3. Submit three copies of the schedule in 11 by 17 format, landscape.
- B. Submit updated schedule with each Application for Payment.

1.5 SCHEDULE FORMAT

- A. Listings: In chronological order according to the start date for each activity. Identify each activity with the applicable specification section number.

PART 2 PRODUCTS

- 2.1 Software: Primavera P6 Project Planner

PART 3 EXECUTION

3.1 NETWORK ANALYSIS

- A. Prepare network analysis diagrams and supporting mathematical analyses using the Critical Path Method.
- B. Illustrate order and interdependence of activities and sequence of work; how start of a given activity depends on completion of preceding activities, and how completion of the activity may restrain start of subsequent activities.
- C. Mathematical Analysis: Tabulate each activity of detailed network diagrams, using calendar dates, and identify for each activity:
 - 1. Preceding and following event numbers.
 - 2. Activity description.
 - 3. Estimated duration of activity, in maximum 15 day intervals.
 - 4. Earliest start date.
 - 5. Earliest finish date.
 - 6. Actual start date.
 - 7. Actual finish date.
 - 8. Latest start date.
 - 9. Latest finish date.
 - 10. Total and free; float time shall accrue to Owner and to Owner's benefit.

3.2 REVIEW AND EVALUATION OF SCHEDULE

- A. Participate in joint review and evaluation of schedule with Architect at each submittal.
- B. Evaluate project status to determine work behind schedule and work ahead of schedule.
- C. After review, revise as necessary as result of review, and resubmit within two business days.

3.3 UPDATING SCHEDULE

- A. Maintain schedules to record actual start and finish dates of completed activities.
- B. Indicate progress of each activity to date of revision, with projected completion date of each activity.

- C. Annotate diagrams to graphically depict current status of Work.
- D. Identify activities modified since previous submittal, major changes in Work, and other identifiable changes.
- E. Indicate changes required to maintain Date of Substantial Completion.

3.4 UPDATE INTERVALS

- A. Provide monthly updates from notice to proceed to start of construction.
- B. Provide updates every other week during construction.

3.5 DISTRIBUTION OF SCHEDULE

- A. Distribute copies of updated schedules to Contractor's project site file, Architect, and Owner.

END OF SECTION

SECTION 01 50 00
TEMPORARY FACILITIES AND CONTROLS

PART 1 GENERAL

1.1 SECTION INCLUDES

- A. Temporary utilities.
- B. Temporary telecommunications services.
- C. Temporary sanitary facilities.
- D. Temporary Controls: Barriers, enclosures, and fencing.
- E. Security requirements.
- F. Vehicular access and parking.
- G. Waste removal facilities and services.
- H. Field offices.

1.2 TEMPORARY UTILITIES

- A. Contractor may use Owner's existing utilities on the site at no charge.
- B. Contractor to provide equipment and devices to properly tap into existing utilities or to increase capacity of utilities if Owner's capacity is not adequate.
 - 1. Electrical power and metering, consisting of connection to existing facilities.
 - 2. Water supply, consisting of connection to existing facilities.
- C. Use trigger-operated nozzles for water hoses, to avoid waste of water.

1.3 TELECOMMUNICATIONS SERVICES

- A. Provide, maintain, and pay for telecommunications services to the Project Manager and Project Superintendent.
- B. Telecommunications services shall include:
 - 1. Cell phone lines: One line, minimum; per person.

2. Internet Connections: Minimum of one; DSL modem or faster.
3. Email: Account/address reserved for project use for each person.

1.4 TEMPORARY SANITARY FACILITIES by Contractor

- A. Provide and maintain required facilities and enclosures. Provide at time of project mobilization.
- B. Maintain daily in clean and sanitary condition.

1.5 BARRIERS by Contractor

- A. Provide barriers to prevent unauthorized entry to construction areas, to prevent access to areas that could be hazardous to workers or the public, to allow for owner's use of site and to protect existing facilities and adjacent properties from damage from construction operations and demolition.
- B. Provide barricades and covered walkways required by governing authorities for public rights-of-way and for public access to existing building.
- C. Protect non-owned vehicular traffic, stored materials, site, and structures from damage.

1.6 FENCING by Contractor (All work & staging areas)

- A. Construction: Commercial grade temporary chain link fence.
- B. Areas of work including storage and lay down areas are to be separated from staff and students by fencing.
- C. Provide 6 foot (1.8 m) high fence around construction site; equip with vehicular and pedestrian gates with locks.

1.7 EXTERIOR ENCLOSURES

- A. Provide temporary insulated weather tight closure of exterior openings to accommodate acceptable working conditions and protection for Products, to allow for temporary heating and maintenance of required ambient temperatures identified in individual specification sections, and to prevent entry of unauthorized persons. Provide access doors with self-closing hardware and locks.

1.8 INTERIOR ENCLOSURES

- A. Provide temporary partitions and ceilings as indicated to separate work areas from Owner-occupied areas, to prevent penetration of dust and moisture into Owner-occupied areas, and to prevent damage to existing materials and equipment.

- B. Construction: Framing and reinforced polyethylene sheet materials with closed joints and sealed edges at intersections with existing surfaces.

1.9 SECURITY

- A. Provide security and facilities to protect Work, existing facilities, and Owner's operations from unauthorized entry, vandalism, or theft. Do not disable Owner's security system without notification.

1.10 VEHICULAR ACCESS AND PARKING

- A. Coordinate access and haul routes with governing authorities and Owner.
- B. Provide and maintain access to fire hydrants, free of obstructions.
- C. Limited parking is available on site. Make provisions for contractor parking with the school's staff and the Construction Manager.
- D. Manage trade workers parking areas ensuring workers only parked in approved areas.

1.11 WASTE REMOVAL by Contractor

- A. Provide waste removal facilities and services as required to maintain the site in clean and orderly condition.
- B. Provide containers with lids. Remove trash from site weekly.
- C. If materials to be recycled or re-used on the project must be stored on-site, provide suitable non-combustible containers; locate containers holding flammable material outside the structure unless otherwise approved by the authorities having jurisdiction.

1.12 FIELD OFFICES

- A. Field office is not required.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION - NOT USED

END OF SECTION

SECTION 01 40 00
QUALITY REQUIREMENTS

PART 1 GENERAL

1.1 SECTION INCLUDES

- A. References and standards.
- B. Quality assurance submittals.
- C. Control of installation.
- D. Tolerances.
- E. Testing and inspection services.

1.2 RELATED REQUIREMENTS

- A. Section 01 3000 - Administrative Requirements: Submittal procedures.

1.3 REFERENCE STANDARDS

- A. ASTM C1077 - Standard Practice for Laboratories Testing Concrete and Concrete Aggregates for Use in Construction and Criteria for Laboratory Evaluation; 2013a.

1.4 SUBMITTALS

- A. Certificates: When specified in individual specification sections, submit certification by the manufacturer and Contractor or installation/application subcontractor to Architect, in quantities specified for Product Data.
 - 1. Indicate material or product conforms to or exceeds specified requirements. Submit supporting reference data, affidavits, and certifications as appropriate.
- B. Manufacturer's Instructions: When specified in individual specification sections, submit printed instructions for delivery, storage, assembly, installation, start-up, adjusting, and finishing, for the Owner's information. Indicate special procedures, perimeter conditions requiring special attention, and special environmental criteria required for application or installation.

1.5 REFERENCES AND STANDARDS

- A. For products and workmanship specified by reference to a document or documents not included in the Project Manual, also referred to as reference standards, comply with requirements of the standard, except when more rigid requirements are specified or are required by applicable codes.
- B. Conform to reference standard of date of issue current on date of Contract Documents, except where a specific date is established by applicable code.

- C. Obtain copies of standards where required by product specification sections.
- D. Maintain copy at project site during submittals, planning, and progress of the specific work, until Substantial Completion.
- E. Should specified reference standards conflict with Contract Documents, request clarification from Architect before proceeding.
- F. Neither the contractual relationships, duties, or responsibilities of the parties in Contract nor those of Architect shall be altered from the Contract Documents by mention or inference otherwise in any reference document.

PART 2 PRODUCTS - NOT

USED PART 3 EXECUTION

3.1 CONTROL OF INSTALLATION

- A. Monitor quality control over suppliers, manufacturers, products, services, site conditions, and workmanship, to produce Work of specified quality.
- B. Comply with manufacturers' instructions, including each step in sequence.
- C. Should manufacturers' instructions conflict with Contract Documents, request clarification from Architect before proceeding.
- D. Comply with specified standards as minimum quality for the Work except where more stringent tolerances, codes, or specified requirements indicate higher standards or more precise workmanship.
- E. Have Work performed by persons qualified to produce required and specified quality.
- F. Verify that field measurements are as indicated on shop drawings or as instructed by the manufacturer.
- G. Secure products in place with positive anchorage devices designed and sized to withstand stresses, vibration, physical distortion, and disfigurement.

3.2 TOLERANCES

- A. Monitor fabrication and installation tolerance control of products to produce acceptable Work. Do not permit tolerances to accumulate.
- B. Comply with manufacturers' tolerances. Should manufacturers' tolerances conflict with Contract Documents, request clarification from Architect before proceeding.
- C. Adjust products to appropriate dimensions; position before securing products in place.

3.3 TESTING AND INSPECTION

Project Inspector to be approved by DSA and employed by the District.

Testing laboratory is to be employed by owner.

A. Limits on Testing/Inspection Agency Authority:

1. Agency may not release, revoke, alter, or enlarge on requirements of Contract Documents.
2. Agency may not approve or accept any portion of the Work.
3. Agency may not assume any duties of Contractor.
4. Agency has no authority to stop the Work.

B. Contractor Responsibilities:

1. Make available to agency at designated location, adequate samples of materials proposed to be used that require testing, along with proposed mix designs.
2. Cooperate with laboratory personnel, and provide access to the Work and to manufacturers' facilities.
3. Provide incidental labor and facilities:
 - a. To provide access to Work to be tested/inspected.
 - b. To obtain and handle samples at the site or at source of Products to be tested/inspected.
 - c. To facilitate tests/inspections.
 - d. To provide storage and curing of test samples.
4. Notify Architect and laboratory 24 hours prior to expected time for operations requiring testing/inspection services.
5. Employ services of an independent qualified testing laboratory and pay for additional samples, tests, and inspections required by Contractor beyond specified requirements.
6. Arrange with Owner's agency and pay for additional samples, tests, and inspections required by Contractor beyond specified requirements.

C. Re-testing required because of non-conformance to specified requirements shall be performed by the same agency on instructions by Architect.

D. Re-testing, re-inspection, stand-by time, and other cost or time impacts required because of non-conformance to specified requirements shall be paid for by the Contractor.

3.4 DIVISION OF THE STATE ARCHITECT TESTING AND INSPECTION FORM

A. Architect shall provide to Contractor DSA Testing and Inspection Form approved for the project and Contractor to cooperate with the testing agency in performing the tests indicated.

3.5 DEFECT ASSESSMENT

A. Replace Work or portions of the Work not conforming to specified requirements.

- B. If, in the opinion of Architect, it is not practical to remove and replace the Work, Architect will direct an appropriate remedy or adjust payment.

END OF SECTION

MATERIALS AND EQUIPMENT

PART 1 - GENERAL

1.01 RELATED DOCUMENTS AND PROVISIONS

All Contract Documents should be reviewed for applicable provisions related to the provisions in this document, including without limitation:

- A. General Conditions, including, without limitation, Purchase of Materials and Equipment;
- B. Special Conditions;
- C. Imported Materials Certification.

1.02 MATERIAL AND EQUIPMENT

- A. Only items approved by the District and-or Architect shall be used.
- B. Contractor shall submit lists of products and other product information in accordance with the Contract Documents, including, without limitation, the provisions regarding the submittals.

1.03 MATERIAL AND EQUIPMENT COLORS

- A. The District and-or Architect will provide a schedule of colors.
- B. No individual color selections will be made until after approval of all pertinent materials and equipment and after receipt of appropriate samples in accordance with the Contract Documents, including, without limitation, the provisions regarding the submittals.
- C. Contractor shall request priority in writing for any item requiring advance ordering to maintain the approved Construction Schedule.

1.04 DELIVERY, STORAGE, AND HANDLING

- A. Contractor shall deliver manufactured materials in original packages, containers, or bundles (with seals unbroken), bearing name or identification mark of manufacturer.

- B. Contractor shall deliver fabrications in as large assemblies as practicable; where specified as shop-primed or shop-finished, package or crate as required to preserve such priming or finish intact and free from abrasion.
- C. Contractor shall store materials in such a manner as necessary to properly protect them from damage. Materials or equipment damaged by handling, weather, dirt, or from any other cause will not be accepted.
- D. Materials are not acceptable that have been warehoused for long periods of time, stored or transported in improper environment, improperly packaged, inadequately labeled, poorly protected, excessively shipped, deviated from normal distribution pattern, or reassembled.
- E. Contractor shall store material so as to cause no obstructions of sidewalks, roadways, and underground services. Contractor shall protect material and equipment furnished under Contract.
- F. Contractor may store materials on Site with prior written approval by the District, all material shall remain under Contractor's control and Contractor shall remain liable for any damage to the materials. Should the Project Site not have storage area available, the Contractor shall provide for off-site storage at no cost to District.
- G. When any room in Project is used as a shop or storeroom, the Contractor shall be responsible for any repairs, patching, or cleaning necessary due to that use. Location of storage space shall be subject to prior written approval by District.

PART 2 - PRODUCTS

2.01 MANUFACTURERS

- A. Manufacturers listed in various sections of Contract Documents are names of those manufacturers that are believed to be capable of supplying one or more of items specified therein.
- B. The listing of a manufacturer does not imply that every product of that manufacturer is acceptable as meeting the requirements of the Contract Documents.

2.02 FACILITIES AND EQUIPMENT

- A. Contractor shall provide, install, maintain, and operate a complete and adequate facility for handling, the execution, disposal, and distribution of material and equipment as required for proper and timely performance of Work connected with Contract.

2.03 MATERIAL REFERENCE STANDARDS

- A. Where material is specified solely by reference to “standard specifications” and if requested by District, Contractor shall submit for review data on actual material proposed to be incorporated into Work of Contract listing name and address of vendor, manufacturer, or producer, and trade or brand names of those materials, and data substantiating compliance with standard specifications.

PART 3 - EXECUTION

3.01 WORKMANSHIP

- A. Where not more specifically described in any other Contract Documents, workmanship shall conform to methods and operations of best standards and accepted practices of trade or trades involved and shall include items of fabrication, construction, or installation regularly furnished or required for completion (including finish and for successful operation, as intended).
- B. Work shall be executed by tradepersons skilled in their respective lines of Work. When completed, parts shall have been durably and substantially built and present a neat appearance.

3.02 COORDINATION

- A. Contractor shall coordinate installation of Work so as to not interfere with installation of others. Adjustment or rework because of Contractor’s failure to coordinate will be at no additional cost to District.
- B. Contractor shall examine in-place work for readiness, completeness, fitness to be concealed or to receive other work, and in compliance with Contract Documents. Concealing or covering Work constitutes acceptance of additional cost which will result should in-place Work be found unsuitable for receiving other Work or otherwise deviating from the requirements of the Contract Documents.

3.03 COMPLETENESS

- A. Contractor shall provide all portions of the Work, unless clearly stated otherwise, installed complete and operational with all elements, accessories, anchorages, utility connections, etc., in manner to assure well-balanced performance, in accordance with manufacturer's recommendations and by Contract Documents. For example, electric water coolers require water, electricity, and drain services; roof drains require drain system; sinks fit within countertop, etc. Terms such as "installed complete," "operable condition," "for use intended," "connected to all utilities," "terminate with proper cap," "adequately anchored," "patch and refinish," "to match similar,"

should be assumed to apply in all cases, except where completeness of functional or operable condition is specifically stated as not required.

3.04 APPROVED INSTALLER OR APPLICATOR

- A. Installation by a manufacturer's approved installer or applicator is an understood part of Specifications and only approved installer or applicator is to provide on-site Work where specified manufacturer has on-going program of approving (i.e. certifying, bonding, re-warranting) installers or applicators. Newly established relationships between a manufacturer and an installer or applicator who does not have other approved applicator work in progress or completed is not approved for this Project.

3.05 MANUFACTURER'S RECOMMENDATIONS

- A. All installations shall be in accordance with manufacturer's published recommendations and specific written directions of manufacturer's representative. Should Contract Documents differ from recommendations of manufacturer or directions of his representative, Contractor shall analyze differences, make recommendations to the District and the Architect in writing, and shall not proceed until interpretation or clarification has been issued by the District and-or the Architect.

END OF DOCUMENT

11/13/13

SECTION 01 60 05
PRODUCT REQUIREMENTS

PART 1 GENERAL

1.1 SECTION INCLUDES

- A. General product requirements.
- B. Transportation, handling, storage and protection.
- C. Product option requirements.
- D. Substitution limitations and procedures.
- E. Maintenance materials, including extra materials, spare parts, tools, and software.

1.2 RELATED REQUIREMENTS

- A. Section 01 4000 - Quality Requirements: Product quality monitoring.

1.3 REFERENCE STANDARDS

- A. NFPA 70 - National Electrical Code; National Fire Protection Association; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.

1.4 SUBMITTALS

- A. Product Data Submittals: Submit manufacturer's standard published data and installation instructions. Mark each copy to identify applicable products, models, options, and other data. Supplement manufacturers' standard data to provide information specific to this Project.
- B. Shop Drawing Submittals: Prepared specifically for this Project; indicate utility and electrical characteristics, utility connection requirements, and location of utility outlets for service for functional equipment and appliances.
 - 1. Detail structural assemblies and structural connections to the building components.
- C. Sample Submittals: Illustrate functional and aesthetic characteristics of the product, with integral parts and attachment devices. Coordinate sample submittals for interfacing work.
 - 1. For selection from standard finishes, submit samples of the full range of the manufacturer's standard colors, textures, and patterns.

PART 2 PRODUCTS

2.1 NEW PRODUCTS

- A. Provide new products only unless noted otherwise on the Drawings.
- B. Where all other criteria are met, Contractor shall give preference to products that:
 - 1. If used on interior, have lower emissions.
 - 2. If wet-applied, have lower VOC content.
 - 3. Have a published GreenScreen Chemical Hazard Analysis.

2.2 PRODUCT OPTIONS

- A. Products Specified by Reference Standards or by Description Only: Use any product meeting those standards or description.
- B. Products Specified by Naming One or More Manufacturers with a Provision for equal: Equal products are acceptable with Architect's or Owner's review.
- C. If specified product does not come with required options, select alternate manufacturer or customize product to suit.

2.3 MAINTENANCE MATERIALS

- A. Furnish extra materials, spare parts, tools, and software of types and in quantities specified in individual specification sections.
- B. Deliver to a site selected by the Owner within the District's boundaries; obtain receipt prior to final payment. Prior to delivery, coordinate delivery with Owner.

PART 3 EXECUTION

3.1 SUBSTITUTION PROCEDURES

- A. Instructions to Bidders specify time restrictions for submitting requests for substitutions.
- B. Architect will consider requests for substitutions only within 15 days after date established in Notice to Proceed.
- C. Document each request with complete data substantiating compliance of proposed substitution with Contract Documents. Organize in side-by-side tabular format with specified product attributes in the left column and proposed substitution in the right column.
- D. A request for substitution constitutes a representation that the submitter:
 - 1. Has investigated proposed product and determined that it meets or exceeds the quality level of the specified product.
 - 2. Will provide the same warranty for the substitution as for the specified product.
 - 3. The installer is qualified or certified to install the proposed substitution.

4. Will coordinate installation and make changes to other Work that may be required for the Work to be complete with no additional cost to Owner.
5. Waives claims for additional costs or time extension that may subsequently become apparent.
6. Credit cost savings for substitutions to Owner.

E. Substitution Submittal Procedure:

1. Submit one copy of request for substitution for consideration. Limit each request to one proposed substitution.
2. Submit shop drawings, product data, and certified test results attesting to the proposed product equivalence. Burden of proof is on proposer.
3. The Architect will notify Contractor in writing of decision to accept or reject request.
4. If the product is accepted as equal, but additional information indicates that the product is not equal in a significant quality or property, the product will be removed and replaced at no cost to the Owner or a credit will be passed on to the Owner for diminished quality.

3.2 TRANSPORTATION AND HANDLING

- A. Coordinate schedule of product delivery to designated prepared areas in order to minimize site storage time and potential damage to stored materials.
- B. Transport and handle products in accordance with manufacturer's instructions.
- C. Transport materials in covered trucks to prevent contamination of product and littering of surrounding areas.
- D. Promptly inspect shipments prior to off-loading and stockpiling to ensure that products comply with requirements, quantities are correct, and products are undamaged.
- E. Provide equipment and personnel to handle products by methods to prevent soiling, disfigurement, or damage.
- F. Arrange for the return of packing materials, such as wood pallets, where economically feasible.
- G. Provide traffic control and flagmen for deliveries.

3.3 STORAGE AND PROTECTION

- A. Designate receiving/storage areas for incoming products so that they are delivered according to installation schedule and placed convenient to work area in order to minimize waste due to excessive materials handling and misapplication.
- B. Store and protect products in accordance with manufacturers' instructions.
- C. Store with seals and labels intact and legible.

- D. Store sensitive and absorbent products in weather tight, climate controlled, enclosures in an environment favorable to product.
- E. For exterior storage of fabricated products, place on sloped supports above ground and wrap in plastic.
- F. Protect products from damage or deterioration due to construction operations, weather, precipitation, humidity, temperature, sunlight and ultraviolet light, dirt, dust, and other contaminants.
- G. Comply with manufacturer's warranty conditions, if any.
- H. Cover products subject to deterioration with impervious sheet covering. Provide ventilation to prevent condensation and degradation of products.
- I. Prevent contact with material that may cause corrosion, discoloration, or staining.
- J. Provide equipment and personnel to store products by methods to prevent soiling, disfigurement, or damage.
- K. Arrange storage of products to permit access for inspection. Periodically inspect to verify products are undamaged and are maintained in acceptable condition.

END OF SECTION

DELIVERY, STORAGE AND HANDLING

PART 1 - GENERAL

1.01 RELATED DOCUMENTS AND PROVISIONS

All Contract Documents should be reviewed for applicable provisions related to the provisions in this document, including without limitation:

- A. General Conditions, including, without limitation, Site Access, Conditions and Requirements;
- B. Special Conditions.

1.02 PRODUCTS

- A. Products are as defined in the General Conditions.
- B. Contractor shall not use and-or reuse materials and-or equipment removed from existing Premises, except as specifically permitted by the Contract Documents.
- C. Contractor shall provide interchangeable components of the same manufacturer, for similar components.

1.03 TRANSPORTATION AND HANDLING

- A. Contractor shall transport and handle Products in accordance with manufacturer's instructions.
- B. Contractor shall promptly inspect shipments to confirm that Products comply with requirements, quantities are correct, and products are undamaged.
- C. Contractor shall provide equipment and personnel to handle Products by methods to prevent soiling, disfigurement, or damage.

1.04 STORAGE AND PROTECTION

- A. Contractor shall store and protect Products in accordance with manufacturer's instructions, with seals and labels intact and legible. Contractor shall store sensitive products in weather-tight, climate controlled enclosures.
- B. For exterior storage of fabricated Products, Contractor shall place on sloped supports, above ground.

- C. Contractor shall provide off-site storage and protection when Site does not permit on-site storage or protection.
- D. Contractor shall cover products subject to deterioration with impervious sheet covering and provide ventilation to avoid condensation.
- E. Contractor shall store loose granular materials on solid flat surfaces in a well-drained area and prevent mixing with foreign matter.
- F. Contractor shall provide equipment and personnel to store Products by methods to prevent soiling, disfigurement, or damage.
- G. Contractor shall arrange storage of Products to permit access for inspection and periodically inspect to assure Products are undamaged and are maintained under specified conditions.

PART 2 – PRODUCTS Not Used.

PART 3 - EXECUTION Not Used.

END OF DOCUMENT

11/13/13

SECTION 01 70 00
EXECUTION AND CLOSEOUT REQUIREMENTS

PART 1 GENERAL

1.1 SECTION INCLUDES

- A. Examination, preparation, and general installation procedures.
- B. Requirements for alterations work, except removal, disposal, and/or remediation of hazardous materials and toxic substances.
- C. Surveying for laying out the work.
- D. Cleaning and protection.
- E. Closeout procedures, except payment procedures.

1.2 RELATED REQUIREMENTS

- A. Section 01 1000 - Summary: Limitations on working in existing building; continued occupancy; work sequence; identification of salvaged and relocated materials.
- B. Section 01 3000 - Administrative Requirements: Submittals procedures.
- C. Section 01 4000 - Quality Requirements: Testing and inspection procedures.
- D. Section 01 7800 - Closeout Submittals: Project record documents, operation and maintenance data, warranties and bonds.
- E. Section 02 4050 - Cutting and Patching

1.3 REFERENCE STANDARDS

- A. NFPA 241 - Standard for Safeguarding Construction, Alteration, and Demolition Operations; 2013.

1.4 QUALIFICATIONS

- A. For survey work, employ a land surveyor registered in the State in which the Project is located and acceptable to Architect. Submit evidence of Surveyor's Errors and Omissions insurance coverage in the form of an Insurance Certificate.

1.5 PROJECT CONDITIONS

- A. Ventilate enclosed areas to assist cure of materials, to dissipate humidity, and to prevent accumulation of dust, fumes, vapors, or gases.
- B. Dust Control: Execute work by methods to minimize raising dust from construction operations. Provide positive means to prevent air-borne dust from dispersing into atmosphere and over adjacent property.

- C. Noise Control: Provide methods, means, and facilities to minimize noise produced by construction operations.
 - 1. Indoors: Limit conduct of especially noisy interior work to times when the building is not occupied by the owner.
 - 2. Provide sound attenuation systems to prevent disruption of staff and students (if occupied by them), neighboring residents and to meet City noise ordinance requirements.

1.6 COORDINATION

- A. Coordinate scheduling, submittals, and work of the various sections of the Project Manual to ensure efficient and orderly sequence of installation of interdependent construction elements, with provisions for accommodating items installed later.
- B. Notify affected utility companies and comply with their requirements.
- C. Verify that utility requirements and characteristics of new operating equipment are compatible with building utilities. Coordinate work of various sections having interdependent responsibilities for installing, connecting to, and placing in service, such equipment.
- D. Coordinate space requirements, supports, and installation of mechanical and electrical work that are indicated diagrammatically on Drawings. Follow routing shown for pipes, ducts, and conduit, as closely as practicable; place runs parallel with lines of building. Utilize spaces efficiently to maximize accessibility for other installations, for maintenance, and for repairs.
- E. In finished areas, conceal pipes, ducts, and wiring within the construction. Coordinate locations of fixtures and outlets with finish elements. Exposed piping or ducts will not be allowed unless specifically noted as such on the Drawings.
- F. Coordinate completion and clean-up of work of separate sections.
- G. After Owner occupancy of premises, coordinate access to site for correction of defective work and work not in accordance with Contract Documents, to minimize disruption of Owner's activities.

PART 2 PRODUCTS

2.1 PATCHING MATERIALS

- A. New Materials: As specified in product sections; match existing products and work for patching and extending work.
- B. Type and Quality of Existing Products: Determine by inspecting and testing products where necessary, referring to existing work as a standard.
- C. See 02 4050 Cutting and Patching for additional information.

PART 3 EXECUTION

3.1 EXAMINATION

- A. Verify that existing site conditions and substrate surfaces are acceptable for subsequent work. Start of work means acceptance of existing conditions.
- B. Verify that existing substrate is capable of structural support or attachment of new work being applied or attached.
- C. Examine and verify specific conditions described in individual specification sections.
- D. Take field measurements before confirming product orders or beginning fabrication, to minimize waste due to over-ordering or misfabrication.
- E. Verify that utility services are available, of the correct characteristics, and in the correct locations.
- F. Prior to Cutting: Examine existing conditions prior to commencing work, including elements subject to damage or movement during cutting and patching. After uncovering existing work, assess conditions affecting performance of work. Beginning of cutting or patching means acceptance of existing conditions.
- G. Verify Drawings are coordinated and match existing conditions prior to start of work.

3.2 PREPARATION

- A. Clean substrate surfaces prior to applying next material or substance.
- B. Seal cracks or openings of substrate prior to applying next material or substance.
- C. Apply manufacturer required or recommended substrate primer, sealer, or conditioner prior to applying any new material or substance in contact or bond.

3.3 LAYING OUT THE WORK

- A. Verify locations of survey control points prior to starting work.
- B. Promptly notify Architect of any discrepancies discovered.
- C. Contractor shall locate and protect survey control and reference points.
- D. Protect survey control points prior to starting site work; preserve permanent reference points during construction.
- E. Promptly report to Architect the loss or destruction of any reference point or relocation required because of changes in grades or other reasons.
- F. Replace dislocated survey control points based on original survey control. Make no changes without prior written notice to Architect.
- G. Utilize recognized engineering survey practices.
- H. Establish elevations, lines and levels. Locate and lay out by instrumentation and similar appropriate means:

1. Site improvements including pavements; stakes for grading, fill and topsoil placement; utility locations, slopes, and invert elevations; and control or expansion joints.
 2. Grid or axis for structures.
 3. Building foundation, column locations, ground floor elevations, and Eave heights.
- I. Periodically verify layouts by same means.
 - J. Maintain a complete and accurate log of control and survey work as it progresses.

3.4 GENERAL INSTALLATION REQUIREMENTS

- A. Install products as specified in individual sections, in accordance with manufacturer's instructions and recommendations, and so as to avoid waste due to necessity for replacement.
- B. Make vertical elements plumb and horizontal elements level, unless otherwise indicated.
- C. Install equipment and fittings plumb and level, neatly aligned with adjacent vertical and horizontal lines, unless otherwise indicated.
- D. Make consistent texture on surfaces, with seamless transitions, unless otherwise indicated.
- E. Make neat transitions between different surfaces, maintaining texture and appearance.

3.5 ALTERATIONS

- A. Drawings showing existing construction and utilities are based on casual field observation and existing record documents only.
 1. Verify that construction and utility arrangements are as shown.
 2. Report discrepancies to Architect before disturbing existing installation.
 3. Beginning of alterations work constitutes acceptance of existing conditions.
- B. Remove existing work as indicated and as required to accomplish new work.
 1. Remove items indicated on drawings.
 2. Relocate items indicated on drawings.
 3. Where new surface finishes are to be applied to existing work, perform removals, patch, and prepare existing surfaces as required to receive new finish; remove existing finish if necessary for successful application of new finish.
 4. Where new surface finishes are not specified or indicated, patch holes and damaged surfaces to match adjacent finished surfaces as closely as possible.
- C. Services (Including but not limited to HVAC, Plumbing, Fire Protection, Electrical, Telecommunications, and Fire Alarm): Remove, relocate, and extend existing systems to accommodate new construction.
 1. Maintain existing active systems that are to remain in operation; maintain access to equipment and operational components; if necessary, modify installation to allow

- access or provide access panel.
2. Where existing systems or equipment are not active and Contract Documents require reactivation, put back into operational condition; repair supply, distribution, and equipment as required.
 3. Where existing active systems serve occupied facilities but are to be replaced with new services, maintain existing systems in service until new systems are complete and ready for service.
 - a. Disable existing systems only to make switchovers and connections; minimize duration of outages.
 - b. Provide temporary connections as required to maintain existing systems in service.
 4. Verify that services serve only abandoned facilities.
 5. Remove abandoned pipe, ducts, conduits, and equipment, including those above accessible ceilings; remove back to source of supply where possible, otherwise cap stub and tag with identification; patch holes left by removal using materials specified for new construction.
- D. Protect existing work to remain.
1. Prevent movement of structure; provide shoring and bracing if necessary.
 2. Perform cutting to accomplish removals neatly and as specified for cutting new work.
 3. Repair adjacent construction and finishes damaged during removal work.
- E. Adapt existing work to fit new work: Make as neat and smooth transition as possible.
- F. Patching: Where the existing surface is not indicated to be refinished, patch to match the surface finish that existed prior to cutting. Where the surface is indicated to be refinished, patch so that the substrate is ready for the new finish.
- G. Refinish existing surfaces as indicated:
1. Where rooms or spaces are indicated to be refinished, refinish all visible existing surfaces to remain to the specified condition for each material, with a neat transition to adjacent finishes.
 2. If mechanical or electrical work is exposed accidentally during the work, re-cover and refinish to match.
- H. Clean existing systems and equipment.
- I. Remove demolition debris and abandoned items from alterations areas and dispose of off-site; do not burn or bury.
- J. Do not begin new construction in alterations areas before demolition is complete.
- K. Comply with all other applicable requirements of this section.

3.6 CUTTING AND PATCHING

- A. Whenever possible, execute the work by methods that avoid cutting or patching.
- B. See Alterations article above for additional requirements.
- C. Perform whatever cutting and patching is necessary to:
 - 1. Complete the work.
 - 2. Replace curb cuts of insufficient size to provide
 - 3. Fit products together to integrate with other work.
 - 4. Provide openings for penetration of mechanical, electrical, and other services.
 - 5. Match work that has been cut to adjacent work.
 - 6. Repair areas adjacent to cuts to required condition.
 - 7. Repair new work damaged by subsequent work.
 - 8. Remove samples of installed work for testing when requested.
 - 9. Remove and replace defective and non-conforming work.
- D. Execute work by methods that avoid damage to other work and that will provide appropriate surfaces to receive patching and finishing. In existing work, minimize damage and restore to original condition.
- E. Employ original installer to perform cutting for weather exposed and moisture resistant elements, and sight exposed surfaces.
- F. Cut rigid materials using masonry saw or core drill. Pneumatic tools not allowed without prior approval.
- G. Restore work with new products in accordance with requirements of Contract Documents.
- H. Fit work air tight to pipes, sleeves, ducts, conduit, and other penetrations through surfaces.
- I. Patching:
 - 1. Finish patched surfaces to match finish that existed prior to patching. On continuous surfaces, refinish to nearest intersection or natural break. For an assembly, refinish entire unit.
 - 2. Match color, texture, and appearance.
 - 3. Repair patched surfaces that are damaged, lifted, discolored, or showing other imperfections due to patching work. If defects are due to condition of substrate, repair substrate prior to repairing finish.

3.7 PROGRESS CLEANING

- A. Maintain areas free of waste materials, debris, and rubbish. Maintain site in a clean and orderly condition. Broom sweep work areas at the end of each day.

- B. Remove debris and rubbish from pipe chases, plenums, attics, crawl spaces, and other closed or remote spaces, prior to enclosing the space.
- C. Broom and vacuum clean interior areas prior to start of surface finishing, and continue cleaning to eliminate dust.
- D. Clean parking areas daily, including street parking used by workers.
- E. Sweep parking areas, driveways and streets used for the work. Removal of oil and other stains left by equipment or worker vehicles.
- F. Collect and remove waste materials, debris, and trash/rubbish from work area daily and dispose off-site weekly; do not burn or bury.

3.8 PROTECTION OF INSTALLED WORK

- A. Protect installed work from damage by construction operations.
- B. Provide special protection where specified in individual specification sections.
- C. Provide temporary and removable protection for installed products. Control activity in immediate work area to prevent damage.
- D. Provide protective coverings at walls, projections, jambs, sills, and soffits of openings.
- E. Protect finished floors, stairs, and other surfaces from traffic, dirt, wear, damage, or movement of heavy objects, by protecting with durable sheet materials.
- F. Prohibit traffic or storage upon waterproofed or roofed surfaces. If traffic or activity is necessary, obtain recommendations for protection from waterproofing or roofing material manufacturer.
- G. Remove protective coverings when no longer needed; reuse or recycle plastic coverings if possible.

3.9 ADJUSTING

- A. Adjust operating products and equipment to ensure smooth and unhindered operation.
- B. Test and balance HVAC systems affected by the work.

3.10 FINAL CLEANING

- A. Use cleaning materials that are nonhazardous.
- B. Clean interior and exterior glass, surfaces exposed to view; remove temporary labels, stains and foreign substances, polish transparent and glossy surfaces, vacuum carpeted and soft surfaces.
- C. Remove all labels that are not permanent. Do not paint or otherwise cover fire test labels or nameplates on mechanical and electrical equipment.
- D. Clean equipment and fixtures to a sanitary condition with cleaning materials appropriate to the surface and material being cleaned.
- E. Clean filters of operating equipment.

- F. Remove waste, surplus materials, trash/rubbish, and construction facilities from the site; dispose of in legal manner; do not burn or bury.

3.11 CLOSEOUT PROCEDURES

- A. Make submittals that are required by Division of the State Architect or other authorities.
 - 1. Complete DSA Form 155 at each phase of the work indicated on the DSA Inspection Card, Form 152.
- B. Notify Architect when work is considered ready for Substantial Completion.
- C. Submit written certification that Contract Documents have been reviewed, work has been inspected, and that work is complete in accordance with Contract Documents and ready for Architect's review.
- D. Correct items of work listed in executed Certificates of Substantial Completion and comply with requirements for access to Owner-occupied areas.
- E. Notify Architect when work is considered finally complete.
- F. Complete items of work determined by Architect's final inspection.

END OF SECTION

FIELD ENGINEERING

PART 1 - GENERAL

1.01 RELATED DOCUMENTS AND PROVISIONS

All Contract Documents should be reviewed for applicable provisions related to the provisions in this document, including without limitation:

- A. Drawings and general provisions of Contract, including General and Supplementary Conditions and Division-1 Specification Documents, apply to work of this document.

1.02 SUMMARY

- A. General: This Document specifies administrative and procedural requirements for field engineering services, including, but not necessarily limited to, the following:

1. Layout of the Project
2. Land Survey Work
3. Shoring and Bracing Engineering
4. Construction Equipment
5. Support from Structure
6. Stormwater Runoff Protection Plan
7. Other Field Engineering

- B. Except for engineering work to be provided by the owner relative to existing conditions, all grade lines, levels and bench marks shall be established and maintained by the Contractor.

1.03 SUBMITTALS

- A. Certificates: Submit a certificate signed by the Land Surveyor or Professional Engineer certifying that the location and elevation of improvements comply with the Contract Documents.
- B. Final Property Survey: Submit 10 copies of the final property survey.
- C. Project Record Documents: Submit a record of Work performed and record survey data as required under provisions of Documents "Submittals" and "Project Closeout."

1.04 QUALITY ASSURANCE

- A. Surveyor: Engage a Registered Land Surveyor registered with the State of California and approved by the Architect to perform land surveying and layout services required.

PART 2 -PRODUCTS Not Used

PART 3 -EXECUTION

3.01 EXAMINATION

- A. The Owner will identify existing control points and property line corner stakes.
- B. Verify layout information shown on the Drawings, in relation to the property survey and existing benchmarks before proceeding to layout the Work. Locate and protect existing benchmarks and control points. Preserve permanent reference points during construction.
- C. Do not change or relocate benchmarks or control points without prior written approval. Promptly report lost or destroyed reference points, or requirements to relocate reference points because of necessary changes in grades or locations.
- D. Promptly replace lost or destroyed project control points. Base replacements on the original survey control points.
- E. Establish and maintain a minimum of two permanent benchmarks on the site, referenced to data established by survey control points.
- F. Record benchmark locations, with horizontal and vertical data, on Project Record Documents.
- G. Existing Utilities and Equipment: The existence and location of underground and other utilities and construction indicated as existing are not guaranteed. Before beginning sitework, investigate and verify the existence and location of underground utilities and other construction. Contact utility companies, including USA, for on-site location services.
- H. Prior to construction, verify the location and invert elevation at points of connection of sanitary sewer, storm sewer, water service piping and gas. Verify locations of underground electrical line. It is the responsibility of the Contractor to use all means possible to locate underground utilities.

3.02 PERFORMANCE

- A. Working from lines and levels established by the property survey, establish benchmarks and markers to set lines and levels at each story of construction and elsewhere as needed to properly locate each element of the Project. Calculate and measure required dimensions within indicated or recognized tolerances. Do not scale Drawings to determine dimensions.
- B. Advise entities engaged in construction activities, of marked lines and levels provided for their use.
- C. As construction proceeds, check every major element for line, level and plumb.
- D. Surveyor's Log: Maintain a surveyor's log of control and other survey Work. Make this log available for reference.
 - 1. Record deviations from required lines and levels, and advise the Architect when deviations that exceed indicated or recognized tolerances are detected. On Project Record Drawings, record deviations that are accepted and not corrected.
 - 2. On completion of major site improvements, and other Work requiring field engineering services, prepare a certified survey showing dimensions, locations, angles and elevations of construction and sitework.
- E. Site Improvements: Locate and lay out site improvements, including pavements, stakes for grading, fill and topsoil placement, utility slopes and invert elevations by instrumentation and similar appropriate means.
- F. Existing Utilities: Furnish information necessary to adjust, move or relocate existing structures, utility poles, lines, services or other appurtenances located in, or affected by construction. Coordinate with local authorities having jurisdiction.
- G. Final Property Survey: Before Substantial Completion, prepare a final property survey showing significant features (real property) for the Project. Include on the survey a certification, signed by the Surveyor, to the effect that principal metes, bounds, lines and levels of the Project are accurately positioned as shown on the survey.
 - 1. Provide survey both on reproducible Mylar and an electronic copy compatible with AutoCAD V-14.
- H. Shoring and Bracing:
 - 1. Design of Shoring and Bracing for support of formwork, scaffolding, or other temporary construction supports, shall be the responsibility of

the Contractor. If requested, supply engineering calculations and data regarding proposed shoring and bracing.

- I. Construction Equipment: Engineering for cranes, temporary hoists, or other hoisting equipment requiring structural loading during construction shall be the responsibility of the Contractor. If requested, supply engineering calculations and data regarding proposed construction equipment. The structural system of the building is not intended to support hoisting systems unless specifically noted, and all such equipment shall be designed to be structurally independent of the building.
- J. Storm water Runoff Protection Plan (SWRPP)
1. It shall be the responsibility of the Contractor to obtain all permits required by the EPA or their designated authority regarding control of Storm water at construction sites. It shall also be the responsibility of the Contractor to bring the construction activities for this project into compliance with the requirements of the State Water Resources Control Board General Construction Activity Storm Water Permit of April 17, 1997, to discharge storm water associated with construction activities, to be in full compliance with the San Jose Environmental Services Department Standards, and the National Pollutant Discharge Elimination (NPDES) Permit.
 2. The Contractor shall engage a Civil Engineer as necessary to prepare an Erosion Control and SWRPP, and shall fully implement the recommendations of the Plan on the Project Site, including a Post-Construction Storm Water Management Plan.
 3. The Contractor shall file a Notice of Intent to comply with the terms of the General Permit to discharge storm water associated with construction activity (WQ Order No. 92-08-DWQ). The Notice of Intent must be sent to the following address along with the appropriate payment (warrant to be furnished by the Owner upon request by the Contractor, allow normal warrant processing time) California State Water Resources Control Board, Division of Water Quality Storm Water Permit Unit, P.O. Box 1977, 901 "P" Street, Sacramento, California 95812-1977; (916) 657-0919. The Notice of Intent shall be filed prior to the start of any construction activity.
- K. Other Field Engineering: Other field engineering affecting means and methods of construction, or engineering of specific building components as required by Specification, or demolition shall be the responsibility of the Contractor.

END OF DOCUMENT

03/01/18

DOCUMENT 01 77 00
CLOSE OUT PROCEDURES

PART 1 GENERAL

1.1 SUMMARY

A. Document Includes:

1. Description of Contract closeout procedures including:
 - a. Removal of Temporary Construction Facilities
 - b. Substantial Completion
 - c. Final Completion
 - d. Project Record Documents
 - e. Project Guarantee
 - f. Warranties
 - g. Turn-In
 - h. Release of Claims
 - i. Fire Inspection Coordination
 - j. Building Inspection Coordination

1.2 REMOVAL OF TEMPORARY CONSTRUCTION FACILITIES

- A. Remove temporary materials, equipment, services, and construction prior to Substantial Completion inspection.
- B. Clean and repair damage caused by installation or use of temporary facilities.
- C. Restore permanent facilities used during construction to specified condition.
- D. Comply with Document 01 50 00 (Temporary Facilities and Controls).

1.3 SUBSTANTIAL COMPLETION

- A. When Contractor considers Work or designated portion of the Work as Substantially Complete, submit written notice to District, with list of items remaining to be completed or corrected.
- B. Within reasonable time, District will inspect to determine status of completion.
- C. Should District determine that Work is not Substantially Complete, District will promptly notify Contractor in writing, listing all defects and omissions.

- D. Remedy deficiencies and send a second written notice of Substantial Completion. District will re-inspect the Work. If deficiencies previously noted are not corrected on re-inspection, then pay the cost of the re-inspection.
- E. When District concurs that Work is Substantially Complete, District will issue a Certificate of Substantial Completion, accompanied by Contractor's list of items to be completed or corrected as verified by District.
- F. Manufactured units, equipment and systems that require startup must have been started up and run for periods prescribed by District before a Certificate of Substantial Completion will be issued.
- G. A punch list examination will be performed upon Substantial Completion. One follow-up review of punch list items for each discipline will be provided. If further Site visits are required to review punch list items due to incompleteness of the Work by Contractor, Contractor will reimburse District for costs associated with these visits.

1.4 FINAL COMPLETION

- A. Final Completion occurs when Work meets requirements for District's Final Acceptance. When Contractor considers Work is Finally Complete, submit written certification that:
 - 1. Contractor has inspected Work for compliance with Contract Documents, and all requirements for Final Acceptance have been met.
 - 2. Except for Contractor maintenance after Final Acceptance, Work has been completed in accordance with Contract Documents and deficiencies listed with Certificate of Substantial Completion have been corrected. Equipment and systems have been tested in the presence of District, and are operative.
 - 3. Work is complete and ready for final inspection.
- B. In addition to submittals required by Contract Documents, provide submittals required by governing authorities and submit final statement of accounting giving total adjusted Contract Sum, previous payments, and sum remaining due.
- C. When District finds Work is acceptable and final closeout submittals are complete, District will issue final Change Order reflecting approved adjustments to Contract Sum not previously made by Change Order. Should District determine that Work is incomplete or Defective:
 - 1. District promptly will so notify Contractor, in writing, listing the incomplete or Defective items.

2. Promptly remedy the deficiencies and notify the District when it is ready for re-inspection.
3. When District determines that the Work is acceptable under the Contract Documents, District will request Contractor to make closeout submittals.

D. Final adjustments of accounts:

1. Submit a final statement of accounting to District, showing all adjustments to the Contract Sum and complete and execute Document 00 88 00 (Agreement and Release of Any and All Claims).
2. If so required, District shall prepare a final Change Order for submittal to Contractor, showing adjustments to the Contract Sum that were not previously made into a Contract Modification.

1.5 PROJECT RECORD DOCUMENTS

- A. Contract Documents will not be closed out and final payment will not be made until completion and submittal of Project Record Documents described in Document 01 78 39 (Project Record Documents).

1.6 PROJECT GUARANTEE

- A. Requirements for Contractor's guarantee of completed Work are included in Document 00 72 00 (General Conditions). Guarantee Work done under Contract against failures, leaks, or breaks or other unsatisfactory conditions due to defective equipment, materials, or workmanship, and perform repair work or replacement required, at Contractor's sole expense, for period of one year from date of Final Acceptance.
- B. Neither recordation of Final Acceptance nor final certificate for payment nor provision of the Contract nor partial or entire use or occupancy of premises by District shall constitute acceptance of Work not done in accordance with Contract Documents nor relieve Contractor of liability in respect to express warranties or responsibility for faulty materials or workmanship.
- C. District may make repairs to Defective Work as set forth in Document 00 72 00 (General Conditions).
- D. If, after installation, operation, or use of materials or equipment to be provided under Contract proves to be unsatisfactory to District, District shall have right to operate and use materials or equipment until said materials and equipment can, without damage to District, be taken out of service for correction or replacement. Period of use of Defective materials or equipment pending correction or replacement shall in no way decrease guarantee period required for acceptable corrected or replaced items of materials or equipment.

- E. Nothing in this Document 01 77 00 shall be construed to limit, relieve, or release Contractor's, Subcontractors', and equipment suppliers' liability to District for damages sustained as result of latent defects in equipment caused by negligence of suppliers' agents, employees, or Subcontractors. Stated in another manner, warranty contained in the Contract Documents shall not amount to, nor shall it be deemed to be, waiver by District of any rights or remedies (or time limits in which to enforce such rights or remedies) it may have for Defective workmanship or Defective materials under laws of this State pertaining to acts of negligence.

1.7 WARRANTIES

- A. Execute Contractor's Submittals and assemble warranty documents, and Installation, Operation, and Maintenance Manuals described in Document 01 33 00 (Submittal Procedures), executed or supplied by Subcontractors, suppliers, and manufacturers.
 - 1. Provide table of contents and assemble in 8½ inches by 11 inches three-ring binder with durable plastic cover, appropriately separated and organized.
 - 2. Assemble in Specification Document order.
- B. Submit material prior to final Application for Payment.
 - 1. For equipment put into use with District's permission during construction, submit within 14 Days after first operation.
 - 2. For items of Work delayed materially beyond Date of Substantial Completion, provide updated Submittal within 14 Days after acceptance, listing date of acceptance as start of warranty period.
- C. Warranties are intended to protect District against failure of Work and against deficient, Defective, and faulty materials and workmanship, regardless of sources.
- D. Limitations: Warranties are not intended to cover failures that result from the following:
 - 1. Unusual or abnormal phenomena of the elements
 - 2. Vandalism after Substantial Completion
 - 3. Insurrection or acts of aggression including war
- E. Related Damages and Losses: Remove and replace Work which is damaged as result of Defective Work, or which must be removed and replaced to provide access for correction of warranted Work.

- F. Warranty Reinstatement: After correction of warranted Work, reinstate warranty for corrected Work to date of original warranty expiration or to a date not less than one year after corrected Work was done, whichever is later.
- G. Replacement Cost: Replace or restore failing warranted items without regard to anticipated useful service lives.
- H. Warranty Forms: Submit drafts to District for approval prior to execution. Forms shall not detract from or confuse requirements or interpretations of Contract Documents.
1. Warranty shall be countersigned by manufacturers.
 2. Where specified, warranty shall be countersigned by Subcontractors and installers.
- I. Rejection of Warranties: District reserves right to reject unsolicited and coincidental product warranties that detract from or confuse requirements or interpretations of Contract Documents.
- J. Term of Warranties: For materials, equipment, systems, and workmanship, warranty period shall be one year minimum from date of Final Completion of entire Work except where:
1. Detailed Specifications for certain materials, equipment or systems require longer warranty periods.
 2. Materials, equipment or systems are put into beneficial use of District prior to Final Completion as agreed to in writing by District.
- K. Warranty of Title: No material, supplies, or equipment for Work under Contract shall be purchased subject to any chattel mortgage, security agreement, or under a conditional sale or other agreement by which an interest therein or any part thereof is retained by seller or supplier. Contractor warrants good title to all material, supplies, and equipment installed or incorporated in Work and agrees upon completion of all Work to deliver premises, together with improvements and appurtenances constructed or placed thereon by Contractor, to District free from any claim, liens, security interest, or charges, and further agrees that neither Contractor nor any person, firm, or corporation furnishing any materials or labor for any Work covered by Contract shall have right to lien upon premises or improvement or appurtenances thereon. Nothing contained in this paragraph, however, shall defeat or impair right of persons furnishing materials or labor under bond given by Contractor for their protection or any rights under law permitting persons to look to funds due Contractor in hands of District.

1.8 TURN-IN

A. Contract Documents will not be closed out and final payment will not be made until all keys issued to Contractor during prosecution of Work and letters from property owners are turned in to District.

1.9 RELEASE OF CLAIMS

A. Contract Documents will not be closed out and final payment will not be made until Document 00 88 00 (Agreement and Release of Any and All Claims) is completed and executed by Contractor and District.

1.10 FIRE INSPECTION COORDINATION

A. Coordinate fire inspection and secure sufficient notice to District to permit convenient scheduling (if applicable).

1.11 BUILDING INSPECTION COORDINATION

A. Coordinate with District a final inspection for the purpose of obtaining an occupancy certificate (if applicable).

PART 2 PRODUCTS – NOT USED

PART 3 EXECUTION – NOT USED

END OF DOCUMENT

**SECTION 01 78 00
CLOSEOUT SUBMITTALS**

PART 1 GENERAL

1.1 SECTION INCLUDES

- A. Project Record Documents.
- B. Operation and Maintenance Data.
- C. Warranties and bonds.
- D. DSA forms

1.2 RELATED REQUIREMENTS

- A. Section 01 3000 - Administrative Requirements: Submittals procedures, shop drawings, product data, and samples.
- B. Section 01 7000 - Execution and Closeout Requirements: Contract closeout procedures.
- C. Individual Product Sections: Specific requirements for operation and maintenance data.
- D. Individual Product Sections: Warranties required for specific products or Work.

1.3 SUBMITTALS

- A. Project Record Documents: Submit documents to Architect with claim for final Application for Payment.
- B. Operation and Maintenance Data:
 - 1. For equipment, or component parts of equipment put into service during construction and operated by Owner, submit completed documents within ten days after acceptance.
 - 2. Submit one copy of completed documents 15 days prior to final inspection. This copy will be reviewed and returned after final inspection, with Architect comments. Revise content of all document sets as required prior to final submission.
 - 3. Submit one set of revised final documents in electronic form within 10 days after final inspection.
- C. Warranties and Bonds:
 - 1. For equipment or component parts of equipment put into service during construction with Owner's permission, submit documents within 10 days after acceptance.
 - 2. Make other submittals within 10 days after Date of Substantial Completion, prior to final Application for Payment.
 - 3. For items of Work for which acceptance is delayed beyond Date of Substantial Completion, submit within 10 days after acceptance, listing the date of acceptance as

the beginning of the warranty period.

D. DSA Forms

1. Complete form DSA 6-C at completion of the work.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION

3.1 PROJECT RECORD DOCUMENTS

- A. Maintain on site one set of the following record documents; record actual revisions to the Work:
 1. Drawings.
 2. Addenda.
 3. Change Orders and other modifications to the Contract.
- B. Ensure entries are complete and accurate, enabling future reference by Owner.
- C. Store record documents separate from documents used for construction.
- D. Record information concurrent with construction progress.
- E. Record Drawings : Legibly mark each item to record actual construction including:
 1. Field changes of dimension and detail.
 2. Details not on original Contract drawings.

3.2 OPERATION AND MAINTENANCE DATA

- A. Source Data: For each product or system, list names, addresses and telephone numbers of Subcontractors and suppliers, including local source of supplies and replacement parts.
- B. Product Data: Mark each sheet to clearly identify specific products and component parts, and data applicable to installation. Delete inapplicable information.
- C. Drawings: Supplement product data to illustrate relations of component parts of equipment and systems, to show control and flow diagrams. Do not use Project Record Documents as maintenance drawings.
- D. Typed Text: As required to supplement product data. Provide logical sequence of instructions for each procedure, incorporating manufacturer's instructions.

3.3 WARRANTIES AND BONDS

- A. Obtain warranties and bonds, executed in duplicate by responsible Subcontractors, suppliers, and manufacturers, within 10 days after completion of the applicable item of work. Except for items put into use with Owner's permission, leave date of beginning of time of warranty until the Date of Substantial completion is determined.
- B. Verify that documents are in proper form, contain full information, and are notarized.

- C. Co-execute submittals when required.
- D. Retain warranties and bonds until time specified for submittal.

END OF SECTION



MORRILL MIDDLE SCHOOL SHADE STRUCTURES

1970 MORRILL AVE. SAN JOSE
BERRYESSA UNION SCHOOL DISTRICT

DSA FILE NUMBER 43-7
DSA APPLICATION NUMBER 01-118969
PROJECT TRACKING NUMBER 69377-109

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 01-118969 INC:
REVIEWED FOR
SS FLS ACS
DATE: 09/16/2020



GENERAL NOTES

PRE-BID SITE VISIT
CONTRACTOR SHALL VISIT THE PROJECT AREA IN ORDER TO BECOME FAMILIAR WITH EXISTING CONDITIONS AND THE REQUIREMENTS OF THE PROJECT. THE CONTRACTOR MAY CONTACT THE ARCHITECT DURING THE BIDDING PHASE REGARDING CLARIFICATIONS AND PROJECT REQUIREMENTS.

SAFETY
IN ACCORDANCE WITH GENERALLY ACCEPTED CONSTRUCTION PRACTICES, THE CONTRACTOR WILL BE SOLELY AND COMPLETELY RESPONSIBLE FOR CONDITIONS OF THE JOB SITE INCLUDING SAFETY OF ALL PERSONS AND PROPERTY DURING PERFORMANCE OF THE WORK. THIS REQUIREMENT WILL APPLY CONTINUOUSLY AND NOT BE LIMITED TO NORMAL WORKING HOURS.

DAMAGE TO STRUCTURE OR SYSTEMS TO REMAIN
CONTRACTOR SHALL REIMBURSE THE OWNER FOR REPAIR AND REPLACEMENT, INCLUDING ARCHITECT'S FEES, FOR ANY DAMAGE CAUSED TO STRUCTURES, LANDSCAPE, SITE WORK, OR EXISTING SYSTEMS TO REMAIN, AS THE RESULT OF CONSTRUCTION OPERATIONS.

EXISTING CONDITIONS
ALL EXISTING CONDITIONS ARE SHOWN BASED ON THE BEST INFORMATION AVAILABLE AT THE TIME, BUT WITHOUT GUARANTEE OF ACCURACY. THE CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS, DIMENSIONS, AND BUILDING DATA AT THE JOB SITE. ANY DISCREPANCIES REQUIRING MODIFICATION TO THE CONSTRUCTION DOCUMENTS SHALL BE REPORTED TO THE ARCHITECT IMMEDIATELY. NO MODIFICATIONS SHALL BE MADE BY THE CONTRACTOR WITHOUT PRIOR APPROVAL FROM THE ARCHITECT.

CONTRACTOR'S EQUIPMENT
COORDINATE WITH OWNER'S REPRESENTATIVE FOR APPROVED LOCATION OF JOB SITE ACCESS, PARKING, AND LOCATION OF CONTRACTOR'S EQUIPMENT AND MATERIAL STORAGE AREA. SEE SITE PLAN FOR ADDITIONAL NOTES.

UTILITY SHUT-DOWNS AND CONNECTIONS
ALL REQUIRED UTILITY SHUT DOWNS SHALL HAVE PRIOR APPROVAL FROM THE OWNER'S REPRESENTATIVE. REQUEST SHALL BE SUBMITTED WITH ADEQUATE ADVANCE NOTICE PER PROJECT REQUIREMENTS.

ASBESTOS AND ASBESTOS PRODUCTS
THE OWNER/OPERATOR AND CONTRACTOR SHALL BE AWARE THAT BUILDINGS CONSTRUCTED PRIOR TO 1978 (OR THEREABOUT) POSSIBLY CONTAIN ASBESTOS IN SOME EXISTING CONSTRUCTION MATERIALS, AND WILL LIKELY BE ENCOUNTERED DURING ALTERATIONS OR REMODELING.

UNDER CALIFORNIA TITLE 8, THE OWNER AND CONTRACTOR BOTH HAVE RESPONSIBILITIES TO DETERMINE THE EXISTENCE OF ASBESTOS CONTAINING MATERIALS IN AREAS TO BE ALTERED OR REMODELED PRIOR TO COMMENCEMENT OF WORK AND TO TAKE APPROPRIATE MEASURES TO PROTECT PERSONNEL. CAL-OSHA HAS JURISDICTION OVER ASBESTOS RELATED WORK. ASBESTOS RELATED WORK SHALL BE DONE IN ACCORDANCE WITH CALIFORNIA GENERAL INDUSTRIAL SAFETY ORDERS, TITLE 8, SECTION 341.6 THROUGH 341.14. ASBESTOS IN THE WORK ENVIRONMENT IS REGULATED BY TITLE 8, SECTION 5208.

THE BAY AREA AIR QUALITY MANAGEMENT DISTRICT AND DISTRICT REGULATION 11-2-401.3 REQUIRES EVERY RENOVATION INVOLVING THE REMOVAL OF 100 SQ. FT., LN. FT., OR GREATER OF REGULATED ASBESTOS CONTAINING MATERIAL, AND FOR EVERY DEMOLITION (EVEN WHEN NO ASBESTOS IS PRESENT), A NOTIFICATION MUST BE SENT TO THE BAAQMD AT LEAST 10 WORKING DAYS PRIOR TO COMMENCEMENT OF DEMOLITION/RENOVATION.

ALL BUILDING MATERIALS MUST BE ASBESTOS FREE.
THESE DOCUMENTS DO NOT ADDRESS CONTAINMENT FOR EXISTING AREAS OF ASBESTOS WHICH MAY BE DISCOVERED DURING CONSTRUCTION. THE OWNER'S ABATEMENT SUBCONTRACTOR IS SOLELY RESPONSIBLE FOR THE DETECTION, REMOVAL, AND THE DISPOSAL OF ANY EXISTING ASBESTOS MATERIAL, ARCHITECTURAL AND ENGINEERING FEES FOR AN EFFORT TO OBTAIN STATE APPROVALS, AS WELL AS THE COST OF ANY REPAIRS, FOR DAMAGE CAUSED OR REPLACEMENT OF EXISTING SYSTEMS TO REMAIN, DUE TO WORK PERFORMED BY THE ASBESTOS ABATEMENT SUBCONTRACTOR, SHALL BE THE RESPONSIBILITY OF SAID SUBCONTRACTOR.

CONSTRUCTION SCHEDULING
CONTRACTOR SHALL COORDINATE ALL CONSTRUCTION OPERATIONS WITH OWNER'S REPRESENTATIVE PRIOR TO SCHEDULING AND START OF THE WORK. CONTRACTOR SHALL PROVIDE PROTECTION TO ALL EXISTING SPACES AND SYSTEMS WHICH ARE IN USE, ADJOINING THE PROJECT, AND NOT PART OF THE PROJECT.

INTERIOR FINISHES
CONFORM TO CCR TITLE 24, PART 2, CHAPTER 6.

TITLE 24 COMPLIANCE
THE INTENT OF THESE DRAWINGS AND SPECIFICATIONS IS THAT THE WORK OF THE ALTERATION, REHABILITATION, OR RECONSTRUCTION IS TO BE IN ACCORDANCE WITH TITLE 24, CALIFORNIA CODE OF REGULATIONS (2016 CBC), SHOULD ANY EXISTING CONDITIONS BE DISCOVERED NOT COVERED BY THE CONTRACT DOCUMENTS WHERE IN THE FINISHED WORK DOES NOT COMPLY WITH 2016 CBC. A CONSTRUCTION CHANGE DOCUMENT OR A SEPARATE SET OF PLANS AND SPECIFICATIONS, DETAILING AND SPECIFYING THE REQUIRED WORK, SHALL BE SUBMITTED TO AND APPROVED BY THE DSA BEFORE PROCEEDING WITH THE WORK.

ADMINISTRATIVE REQUIREMENTS FROM PART 1, TITLE 24, C.C.R.
(B) AND 4-342
- INSPECTOR APPROVED BY DSA
- INSPECTOR AND CONTINUOUS INSPECTION OF WORK PER SECTION 4-333 (B) AND 4-342
- TESTS AND TESTING LABORATORY PER SECTION 4-335 (OWNER SHALL PAY THE TESTING LABORATORY)
- SPECIAL INSPECTION PER SECTION 4-333 (C)
- CONTRACTOR SHALL SUBMIT VERIFIED REPORT OR SECTION 4-336 & 4-343 (C)
- ADMINISTRATION OR CONSTRUCTION PER PART 1, TITLE 24, C.C.R. DUTIES OF ARCHITECT, STRUCTURAL ENGINEER, OR PROFESSIONAL ENGINEER PER SECTION 4-333 (A) AND 4-341
- DUTIES OF CONTRACTOR PER SECTION 4-343
- VERIFIED REPORTS PER SECTION 4-343 AND 4-336
- A COPY OF PARTS 1 TO 5 OF TITLE 24 SHALL BE KEPT AND AVAILABLE IN THE FIELD DURING CONSTRUCTION
- DSA SHALL BE NOTIFIED AT START OF CONSTRUCTION AND PRIOR TO PLACEMENT OF CONCRETE PER SECTION 4-334
- SUPERVISION BY DSA PER SECTION 4-334
- DSA IS NOT SUBJECT TO ARBITRATION

PIPES, DUCTS AND CONDUIT - SUPPORT AND BRACING
PIPES, DUCTS, AND CONDUITS SHALL BE SUPPORTED AND BRACED PER THE SMACNA "GUIDELINES FOR SEISMIC RESTRAINTS OF MECHANICAL SYSTEMS AND PLUMBING PIPING SYSTEMS", OPM 0032-13 SEISMIC BRACING AND SUPPORT SYSTEMS.

DRILLED-IN EXPANSION ANCHORS
WHEN INSTALLING DRILLED-IN ANCHORS AND/OR POWDER DRIVEN PINS IN EXISTING NON-PRESTRESSED REINFORCED CONCRETE, USE CARE AND CAUTION TO AVOID CUTTING OR DAMAGING THE EXISTING REINFORCING BARS. WHEN INSTALLING THEM INTO EXISTING PRESTRESSED CONCRETE (PRE-OR POST-TENSIONED), LOCATE THE PRESTRESSED TENDONS BY USING A NON-DESTRUCTIVE METHOD PRIOR TO INSTALLATION. EXERCISE EXTREME CARE AND CAUTION TO AVOID CUTTING OR DAMAGING THE TENDONS DURING INSTALLATION. MAINTAIN A MINIMUM CLEARANCE OF ONE INCH BETWEEN THE REINFORCEMENT AND THE DRILLED-IN ANCHOR AND/OR PIN.

GENERAL NOTES

ADMINISTRATIVE REQUIREMENTS
- ADDENDA MUST BE SIGNED BY ARCHITECT AND APPROVED BY DSA
- NO CHANGES OR REVISIONS SHALL BE MADE FOLLOWING WRITTEN APPROVAL WHICH AFFECTS ACCESS COMPLIANCE ITEM UNLESS SUCH CHANGES TO REVISIONS ARE SUBMITTED TO DSA FOR APPROVAL. SUBSTITUTIONS AFFECTING DSA REGULATED ITEMS SHALL BE SUBMITTED AS A CONSTRUCTION CHANGE DOCUMENT OR ADDENDA, AND SHALL BE APPROVED BY DSA PRIOR TO FABRICATION AND INSTALLATION
- CONSTRUCTION CHANGE DOCUMENTS MUST BE SIGNED BY THE FOLLOWING:
- ARCHITECT OR ENGINEER OF RECORD
- STRUCTURAL ENGINEER (WHEN APPLICABLE)
- DELEGATED PROFESSIONAL ENGINEER
- DSA
- MATERIALS AND THEIR INSTALLATIONS SHALL COMPLY WITH APPLICABLE CODES.
- PER CBC 11B-104.1 ALL DIMENSIONS ARE SUBJECT TO CONVENTIONAL INDUSTRY TOLERANCES EXCEPT WHERE THE REQUIREMENT IS STATED AS A RANGE WITH SPECIFIC MINIMUM AND MAXIMUM END POINTS.

SOILS AND GEOTECHNICAL: A GEOTECHNICAL INVESTIGATION MUST BE CONDUCTED IN ACCORDANCE WITH CBC SECTION 1803A AND REPORTED AS REQUIRED IN SECTION 1803A.7 (SEE EXCEPTION IN APPENDIX A, ITEM C3). THE DESIGN ARCHITECT OR STRUCTURAL ENGINEER IN GENERAL RESPONSIBLE CHARGE MUST VERIFY THAT THE GEOTECHNICAL REPORT INDICATES THAT ALL SOILS RELATED PARAMETERS EXCEED THE MINIMUM DESIGN REQUIREMENTS IDENTIFIED ON THE PC DRAWINGS INCLUDING BUT NOT LIMITED TO ALLOWABLE SOIL PRESSURES, SURCHARGE, DOWN-DRAW, AND EFFECTS DUE TO HIGH-WATER TABLE, ETC., AS APPLICABLE.

GEOHAZARD REPORT (ENGINEERING GEOLOGIC REPORT): A GEOLOGIC HAZARDS INVESTIGATION MUST BE CONDUCTED IN ACCORDANCE WITH CBC SECTION 1803A.8 AND IR 4-4. GEOHAZARD REPORT REQUIREMENTS. THE DESIGN ARCHITECT OR STRUCTURAL ENGINEER IN GENERAL RESPONSIBLE CHARGE MUST VERIFY THAT THE GEOLOGIC HAZARDS WHICH WOULD PRECLUDE THE USE OF THE PC DESIGN AT THE SITE, INCLUDING BUT NOT LIMITED TO LIQUEFACTION POTENTIAL, LANDSLIDE, FLOODING, EARTHQUAKE FAULTING, ETC.

ABBREVIATIONS

(REFER TO CONSULTANT DRAWINGS FOR ADDITIONAL ABBREVIATIONS)

A.F.F.	ABOVE FINISHED FLOOR	LAM.	LAMINATE
A.P.	ACCESS PANEL	LAV.	LAVATORY
ACT	ACOUSTIC TILE	M.B.	MACHINE BOLT
ADJ.	ADJUSTABLE	M.S.	MACHINE SCREW
ALUM.	ALUMINUM	M.H.	MANHOLE
A.B.	ANCHOR BOLT	MFG.	MANUFACTURER
APPROX.	APPROXIMATELY	M.B.	MARKER BOARD
ARCH.	ARCHITECT	MATL.	MATERIAL
AC	ASPHALTIC CONCRETE	MAX.	MAXIMUM
B	BENCH MARK	MECH.	MECHANICAL
BLKG.	BLOCKING	MIN.	MINIMUM
BD.	BOTH WAYS	MISC.	MISCELLANEOUS
BOT.	BOTTOM	MTD.	MOUNTED
BUILDG.	BUILDING	(N)	NEW
B.U.R.	BUILT-UP ROOFING	NOM.	NOMINAL
C.B.	CATCH BASIN	N.I.C.	NOT IN CONTRACT
CEL.	CEILING	N.T.S.	NOT TO SCALE
CEM.	CEMENT	NO. or #	NUMBER
C.C. or O.C.	CENTER TO CENTER	OCC.	OCCUPANT(Y)
CER.	CERAMIC TILE	O.C.	ON CENTER
CLEANOUT	CLEANOUT	OPNG.	OPENING
C.T.G.	CLEANOUT TO GRADE	OPP.	OPPOSITE
CLR.	CLEAR	O.H.	OPPOSITE HAND
C.H.R.	CLEAR ALL HEART REDWOOD	O.H.S.	OUTSIDE FACE OF STUD
C.W.	COLD WATER	O.H.W.S.	OVAL HEAD WOOD SCREW
COL.	COLUMN	O.D.	OVERFLOW DRAIN and/or OUTSIDE DIAMETER
COM.	COMMON	O.F.C.I.	OWNER FURNISHED and CONTRACTOR INSTALLED
CONC.	CONCRETE	PR.	PARTITION
CONST.	CONSTRUCTION	PART.	PARTITION
C.H.	CONSTRUCTION HEART	PL.	PLATE
C.J.	CONSTRUCTION JOINT	P.	PENNY (NAILS)
CONT.	CONTINUOUS	PLAS.	PLASTER
CONTR.	CONTRACTOR	PLYWD.	PLYWOOD
CNT.	COUNTER	P.V.C.	POLY VINYL CHLORIDE
CTR.	COUNTER SUNK	P.T.	PRESSURE TREATED
DET.	DETAIL	P.L.	PROPERTY LINE
DIA.	DIAMETER	R. or RAD.	RADIUS
DIM.	DIMENSION	R.W.L.	RAIN WATER LEADER
D.A.	DISABLED ACCESS	RWD./R.W.	REDWOOD
DR.	DOOR	REINF.	REINFORCING
D.S.	DOWNSPOUT	REINFORC.	REINFORCING
DWG.	DRAWING	R.A.G.	RETURN AIR GRILLE
D.F.	DRINKING FOUNTAIN and/or DOUGLAS FIR	R.E.	RM ELEVATION
EA.	EACH	RDR.	ROOM DRAIN
E.W.	EACH WAY	R.O.	ROUGH OPENING
ELEC.	ELECTRIC	R.O.P.	ROUGH OPENING
EL. or ELEV.	ELEVATION	R.H.M.S.	ROUND HEAD METAL SCREW
ENCL.	ENCLOSURE and/or ENCLOSURE	R.H.W.S.	ROUND HEAD WOOD SCREW
EQ.	EQUAL	SSD.	SEE STRUCTURAL DRAWINGS
EQUIP.	EQUIPMENT	S.T.S.M.S.	SELF TAPPING SHEET METAL SCREW
(E)	EXISTING	SHEATH.	SHEATHING
EX.	EXPANSION	S.M.	SHEET METAL
E.J.	EXPANSION JOINT	S.M.S.	SHEET METAL SCREW
EXT.	EXTERIOR	S.O.V.	SHUT OFF VALVE
F.O.C.	FACE OF CONCRETE	S.	SIMILAR
F.O.M.	FACE OF MASONRY	S.C.	SOLID CORE
F.O.S.	FACE OF STUD	SPEC.	SPECIFICATION
F.O.F.	FACE OF FINISH	SQ.	SQUARE
F.F.	FINISH FLOOR	S.F.	SQUARE FEET
F.S.	FINISH SLAB	STAG.	STAGGERED
F.E.	FIRE EXTINGUISHER	STD.	STANDARD
F.E.C.	FIRE EXTINGUISHER CABINET	STL.	STAINLESS STEEL
F.H.	FIRE HYDRANT	STR.	STEEL
F.H.M.S.	FLAT HEAD METAL SCREW	STOR.	STORAGE
F.H.W.S.	FLAT HEAD WOOD SCREW	STRUC.	STRUCTURAL
FL. or FLR.	FLOOR	S.A.G.	SUPPLY AIR GRILLE
F.D.	FLOOR DRAIN	THRES.	THRESHOLD
FTG.	FOOTING	T&G.	TONGUE & GROOVE
F.C.	FOUNDATION	T.J.	TOOLED JOINT
GALV.	GALVANIZED	T.O.B.	TOP OF BEAM
G.I.	GALVANIZED IRON	T.O.C.	TOP OF CURB OR CONCRETE
GA.	GAUGE	T.O.S.	TOP OF STEEL OR SHEATHING
GLU-LAM	GLUE-LAMINATED	T.O.W.	TOP OF WALK
GRD.	GRADE	TYP.	TYPICAL
GYP. BD.	GYPSUM BOARD	U.O.N.	UNLESS OTHERWISE NOTED
HDW.	HARDWARE	U.O.S.	UNLESS OTHERWISE SHOWN
H.T.	HEIGHT	U.V.R.	UNTIL THROUGH ROOF
H.C.	HOLLOW CORE	VERT.	VERTICAL
H.M.	HOLLOW METAL	V.G.	VERTICAL GRAIN
HORIZ.	HORIZONTAL	V.H.	VERIFY IN FIELD
H.B.	HOLE BORE	V.C.T.	VINYL COMPOSITION TILE
I.D.	INSIDE DIAMETER	V.V.C.	VINYL WALL COVERING
INSUL.	INSULATION	V.O.I.P.	VOICE OVER INTERNET PROTOCOL
INT.	INTERIOR	W.C.	WATER CLOSET
INVT.	INVERT	W.H.	WATER HEATER
JT.	JOINT	W.P.	WATERPROOF
J.H.	JOIST HANGER	W.R.	WATER RESISTANT
K.D.	KILN DRIED	W.W.M.	WELDED WIRE MESH
		W.D.	WINDOW DIMENSION
		W.	WITH
		W/O.	WITHOUT
		WD.	WOOD

BUILDING CODES AND STANDARDS:

2016	CALIFORNIA ADMINISTRATIVE CODE, PART 1, TITLE 24, C.C.R.	2016 EDITION
2016	CALIFORNIA BUILDING CODE (CBC), PART 2, TITLE 24, C.C.R.	2016 EDITION
2016	CALIFORNIA INTERNATIONAL BUILDING CODE, VOLUMES 1 AND 2, WITH 2016 CALIFORNIA AMENDMENTS.	2016 EDITION
2016	CALIFORNIA ELECTRIC CODE (CEC), PART 3, TITLE 24, C.C.R.	2016 EDITION
2016	(2014 NATIONAL ELECTRIC CODE WITH 2016 CALIFORNIA AMENDMENTS).	2016 EDITION
2016	CALIFORNIA MECHANICAL CODE (CMC), PART 4, TITLE 24, C.C.R.	2016 EDITION
2016	(2015 UNIFORM MECHANICAL CODE WITH 2016 CALIFORNIA AMENDMENTS).	2016 EDITION
2016	CALIFORNIA PLUMBING CODE (CPC), PART 5, TITLE 24, C.C.R.	2016 EDITION
2016	(2015 UNIFORM PLUMBING CODE WITH 2016 CALIFORNIA AMENDMENTS).	2016 EDITION
2016	CALIFORNIA FIRE CODE (CFC), PART 9, TITLE 24, C.C.R.	2016 EDITION
2016	(2015 INTERNATIONAL FIRE CODE WITH 2016 CALIFORNIA AMENDMENTS).	2016 EDITION
2016	CALIFORNIA GREEN BUILDING STANDARDS CODE, PART 11, TITLE 24, C.C.R.	2016 EDITION
2016	CALIFORNIA REFERENCED STANDARDS, PART 12, TITLE 24, C.C.R.	2016 EDITION
2013	ASME A17.1 (W/17.1) (ASCSA B44-08 ADDENDA) SAFETY CODE FOR ELEVATORS AND ESCALATORS	2013 EDITION
2010	ADA STANDARDS FOR ACCESSIBLE DESIGN (28 CFR PART 36 FOR TITLE II ENTITIES)	2010 EDITION
CCR TITLE-19,	PUBLIC SAFETY, STATE FIRE MARSHAL REGULATIONS.	
NFPA 13	INSTALLATION OF SPRINKLER SYSTEMS (CA AMENDED)	2016 EDITION
NFPA 14	INSTALLATION OF STANDPIPE & HOSE SYSTEMS (CA AMENDED)	2016 EDITION
NFPA 17	DRY CHEMICAL EXTINGUISHING SYSTEMS	2013 EDITION
NFPA 17A	WET CHEMICAL EXTINGUISHING SYSTEM	2013 EDITION
NFPA 20	STATIONARY FIRE PUMPS FOR FIRE PROTECTION	2016 EDITION
NFPA 22	WATER TANKS FOR PRIVATE FIRE PROTECTION	2013 EDITION
NFPA 24	PRIVATE FIRE SERVICE MAINS (CA AMENDED)	2016 EDITION
NFPA 25	INSPECTION, TESTING AND MAINTENANCE OF WATER BASED FIRE PROTECTION SYSTEMS (CA AMENDED)	2013 CALIFORNIA EDITION
NFPA 72	NATIONAL FIRE ALARM CODE (CA AMENDED)	2016 EDITION
NFPA 80	SMOKE DETECTOR AND OTHER OPENING PROTECTIVES	2016 EDITION
NFPA 92	STANDARD FOR SMOKE CONTROL SYSTEMS	2012 EDITION
NFPA 110	EMERGENCY AND STANDBY POWER SYSTEMS	2016 EDITION
NFPA 170	STANDARD FOR FIRE SAFETY AND EMERGENCY SIGNALING SYSTEMS	2015 EDITION
NFPA 253	CRITICAL RADIANT FLUX OF FLOOR COVERING SYSTEMS	2006 EDITION
NFPA 2001	CLEAN AGENT FIRE EXTINGUISHING SYSTEMS	2015 EDITION
ICC 300	STANDARDS FOR BLEACHERS, FOLDING AND TELESCOPIC SEATING, AND GRANDSTANDS	2012 EDITION
SFM 12-10-1	POWER OPERATED EXIT DOORS	1999/2005 EDITION
SFM 12-10-2	SINGLE POINT LATCHING OR LOCKING DEVICES	2009 EDITION
SFM 12-10-3	EMERGENCY EXIT & PANIC HARDWARE	2005 (R2010)
UL 38	MANUAL OPERATING SIGNAL BOXES	1999/2005 EDITION
UL 268A	SMOKE DETECTORS FOR FIRE PROTECTIVE SIGNALING SYSTEMS	1998/2003 EDITION
UL 500	SMOKE DETECTORS DUCT APPLICATIONS	2005 (R2010)
UL 305	FIRE TESTING OF FIRE EXTINGUISHING SYSTEMS FOR PROTECTION OF COMMERCIAL COOKING EQUIPMENT	2012 EDITION
UL 464	PANIC HARDWARE	2003 EDITION
UL 521	AUDIBLE SIGNALING DEVICES FOR FIRE ALARM AND SIGNALING SYSTEMS, AND ACCESSORIES	1999 EDITION
UL 864	HEAT DETECTORS FOR FIRE PROTECTIVE SIGNALING SYSTEMS	2003 EDITION
UL 1971	CONTROL UNITS FOR FIRE PROTECTIVE SIGNALING SYSTEMS (W/ REVISIONS THROUGH JULY 14, 2005)	2002 EDITION
	SIGNALING DEVICES FOR THE HEARING IMPAIRED	2002 EDITION
	COMPLIANCE WITH CFC CHAPTER 33, FIRE SAFETY DURING CONSTRUCTION AND DEMOLITION AND CBC CHAPTER 33, SAFETY DURING CONSTRUCTION WILL BE ENFORCED.	

SYMBOLS LEGEND

1	SECTION / EXTERIOR ELEVATION
A8.1	SECTION IDENTIFICATION SHEET WHERE SECTION IS DRAWN
4	DETAIL
A8.1	DETAIL IDENTIFICATION SHEET WHERE DETAIL IS DRAWN
1	INTERIOR ELEVATION
A7.1	INDICATES ELEVATION SHOWN SHEET WHERE ELEVATION IS DRAWN
CLASSROOM	ROOM IDENTIFICATION
102	ROOM NUMBER
3	SPECIFIC NOTE
102A	DOOR DESIGNATION
A	WINDOW DESIGNATION
ADDENDUM	ADDENDUM REVISION
CDD	CDD REVISION
127	FINISH NUMBER
A	EQUIPMENT LETTER
48'-0"	CEILING HEIGHT
1	WALL TYPE
18'-0"	ELEV. HEIGHT
F.O.S., U.O.N.	
FACE OF FINISH	

PROJECT SUMMARY

INSTALLATION OF FIVE (5) NEW METAL SHADE STRUCTURES 3280 SQ. FT. TOTAL AREA PC #04-117117 AND ASSOCIATED SITE WORK.

THERE ARE NO DEFERRED SUBMITTALS FOR THIS PROJECT.


DESIGN TEAM

ARCHITECT
SUGIMURA FINNEY ARCHITECTS
2155 SOUTH BASCOM AVENUE SUITE 200
CAMPBELL, CALIFORNIA 95008
(408) 879-0600
(408) 377-6066 FAX
ATTN: MARK FINNEY MARK@SUGIMURA.COM

DRAWING INDEX

T1	TITLE SHEET
T2	SITE PLAN - FIRE LIFE SAFETY & ACCESS COMPLIANCE WORK
ARCHITECTURAL	
A0.1	ENLARGED DEMOLITION SITE PLAN
A0.2	NEW ENLARGED SITE PLAN
A0.4	SITE DETAILS
SHADE STRUCTURE MANUFACTURER'S DRAWINGS DSA #04-117117	
S-1	COVER SHEET
S-2	GENERAL DATA
S-3	GENERAL NOTES
S-4	SAMPLE DSA 103 FORMS
S-5	SECTIONS PROPERTIES & REBAR DETAILS
S-6	VC 14, VC 18, & VC 20 FRAMING PLAN & ELEVATIONS
S-7	VC 14, VC 18, & VC 20 FRAMING SCHEDULES
S-8	VC 140, VC 180, & VC 200 FRAMING PLAN & ELEVATIONS
S-9	VC 140, VC 180, & VC 200 FRAMING SCHEDULES
S-10	PIER FOUNDATION AND SPREAD FOOTINGS SCHEDULES
S-11	STANDARD DETAILS 1
S-12	STANDARD DETAILS 2
S-13	SAMPLE ARCHITECTURAL ELEVATIONS
TOTAL NUMBER OF SHEETS = 18 SHEETS	

VICINITY MAP

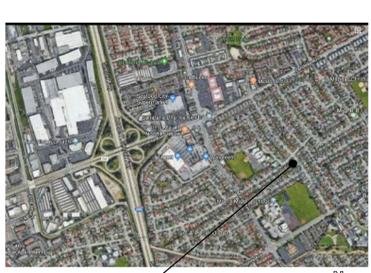

PROJECT LOCATION



STATEMENT OF GENERAL CONFORMANCE

FOR ARCHITECTS / ENGINEERS WHO UTILIZE PLANS, INCLUDING BUT NOT LIMITED TO SHOP DRAWINGS, PREPARED BY OTHER LICENSED DESIGN PROFESSIONALS AND / OR OTHER CONSULTANTS

APPLICATION NO: 01-118969 FILE NO: 43-7
 THE DRAWINGS OR SHEETS LISTED ON THE COVER OR INDEX SHEET (*)
 THIS DRAWING, PAGE OF SPECIFICATIONS / CALCULATIONS

I HAVE BEEN PREPARED BY OTHER DESIGN PROFESSIONALS OR CONSULTANTS WHO ARE LICENSED AND / OR AUTHORIZED TO PREPARE SUCH DRAWINGS IN THIS STATE. IT HAS BEEN EXAMINED BY ME FOR:

1) DESIGN INTENT AND APPEARS TO MEET THE APPROPRIATE REQUIREMENTS OF TITLE 24, CALIFORNIA CODE OF REGULATIONS AND THE PROJECT SPECIFICATIONS PREPARED BY ME, AND
2) COORDINATION WITH MY PLANS AND SPECIFICATIONS AND IS ACCEPTABLE FOR INCORPORATION INTO THE CONSTRUCTION OF THIS PROJECT.

THE STATEMENT OF GENERAL CONFORMANCE SHALL NOT BE CONSTRUED AS RELIEVING ME OF MY RIGHTS, DUTIES, AND RESPONSIBILITIES UNDER SECTIONS 17302 AND 81138 OF THE EDUCATION CODE AND SECTIONS 4-336, 4-341 AND 4-344 OF TITLE 24, PART 1, (TITLE 24, PART 1, SECTION 4-317) BND


I FIND THAT:
 ALL DRAWINGS OR SHEETS LISTED ON THE COVER OR INDEX SHEET
 THIS DRAWING OR PAGE
 IS / ARE IN GENERAL CONFORMANCE WITH THE PROJECT DESIGN, AND
 HAS / HAVE BEEN COORDINATED WITH THE PROJECT PLANS AND SPECIFICATIONS.

DRAWN BY: MARK FINNEY DATE: 04/14/2020
CHECKED BY: MJ DATE: 9/30/2021
SFA JOB NO: 19064 DATE: 06/17/2019
LICENSE NUMBER: C-24673 EXPIRATION DATE:

T1

TITLE SHEET
SHADE STRUCTURES
MORRILL MIDDLE SCHOOL
1970 MORRILL AVE., SAN JOSE, CA 95132
BERRYESSA UNION SCHOOL DISTRICT

REVISIONS	NO.	ITEM	DATE

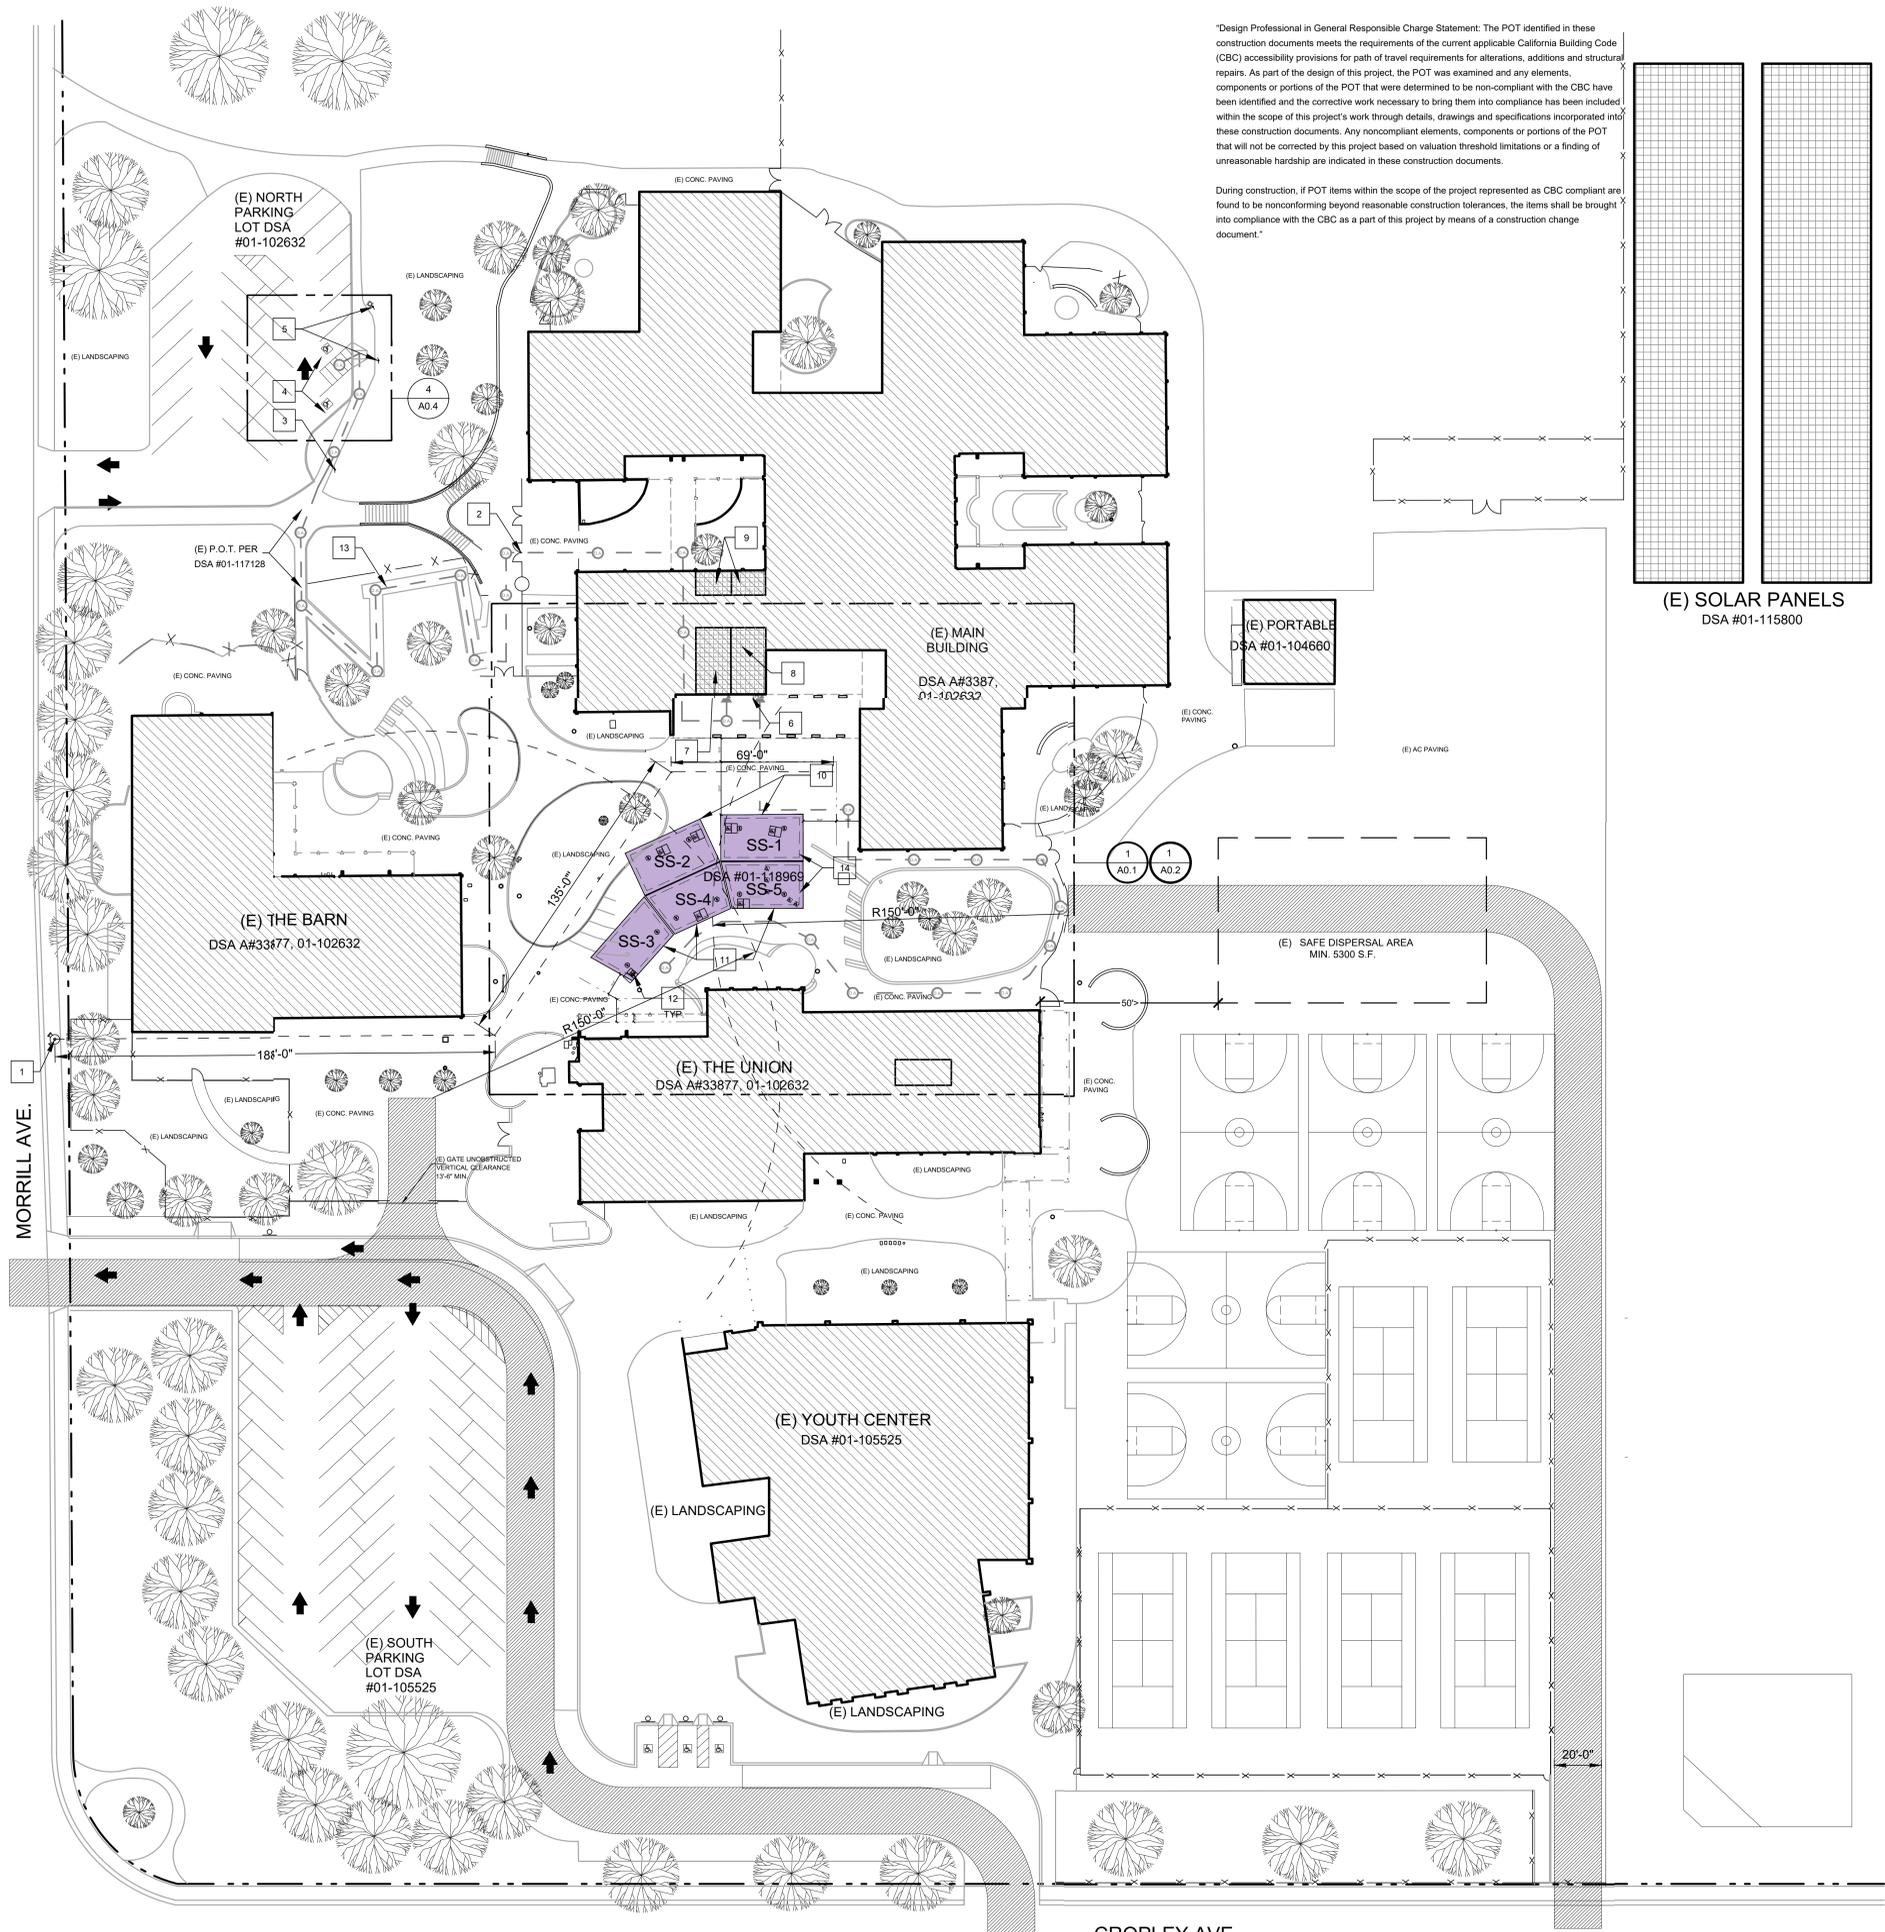

*Design Professional in General Responsible Charge Statement: The POT identified in these construction documents meets the requirements of the current applicable California Building Code (CBC) accessibility provisions for path of travel requirements for alterations, additions and structural repairs. As part of the design of this project, the POT was examined and any elements, components or portions of the POT that were determined to be non-compliant with the CBC have been identified and the corrective work necessary to bring them into compliance has been included within the scope of this project's work through details, drawings and specifications incorporated into these construction documents. Any noncompliant elements, components or portions of the POT that will not be corrected by this project based on valuation thresholds limitations or a finding of unreasonable hardship are indicated in these construction documents.

During construction, if POT items within the scope of the project represented as CBC compliant are found to be nonconforming beyond reasonable construction tolerances, the items shall be brought into compliance with the CBC as a part of this project by means of a construction change document.*

PROJECT SUMMARY
 INSTALLATION OF (2) NEW METAL SHADE STRUCTURES PC #04-117117 AND ASSOCIATED SITE WORK.

- GENERAL NOTES**
- THIS SHEET IS FOR ACCESS COMPLIANCE & FIRE LIFE SAFETY CODE RELATED ITEMS. FOR SCOPE OF WORK SEE SHEETS A0.1 AND A0.2.
 - REFER TO P.C. DRAWINGS FOR EXTENT OF P.C. WORK.
 - ACCESSIBLE PATH OF TRAVEL (P.O.T.), AS INDICATED, IS A COMMON BARRIER FREE ACCESS ROUTE WITHOUT ANY ABRUPT VERTICAL CHANGES EXCEEDING A 1/2" BEVELED AT 1:2 MAXIMUM SLOPE, EXCEPT THAT LEVEL CHANGES DO NOT EXCEED 1/4" VERTICAL AND AT LEAST 48" WIDE. THE PATH SURFACE IS SLIP RESISTANT, STABLE, FIRM, AND SMOOTH. PASSING SPACES (119-403.5.3) AT LEAST 60" WIDE ARE LOCATED NOT MORE THAN 200' APART. PARTS OF P.O.T WITH CONTINUOUS GRADIENTS HAVE 40' LEVEL AREAS (119-403.7) NOT MORE THAN 400' APART. THE CROSS SLOPE DOES NOT EXCEED 2% AND SLOPE IN THE DIRECTION OF TRAVEL AND IS LESS THAN 5% UNLESS OTHERWISE INDICATED. P.O.T. SHALL BE MAINTAINED FREE OF OVERHANGING OBSTRUCTIONS TO 80" MINIMUM (119-307.4) AND PROTRUDING OBJECTS GREATER THAN 4" PROJECTION FROM WALL AND ABOVE 27" AND LESS THAN 80" (119-307.2). ARCHITECT SHALL VERIFY THAT THERE ARE NO BARRIERS IN THE PATH OF TRAVEL.
 - GATES IN THE PATH OF TRAVEL SHALL MEET DOOR REQUIREMENTS PER CBC SECTION 11B-404. ALL GATES TO HAVE ACCESSIBLE HARDWARE AND 10" MIN. SMOOTH BOTTOM OR KICK PLATES. PANIC HARDWARE AND EXIT SIGN MAY BE REQUIRED. COORDINATE WITH FIRE AND LIFE SAFETY.
 - CONTRACTOR TO VERIFY ALL BARRIERS IN P.O.T. HAVE BEEN REMOVED.
 - ALL EXTERIOR ENTRANCES AND EXITS IDENTIFIED WITH A TRIANGULAR SYMBOL ON THIS PLAN ARE ACCESSIBLE AND COMPLY WITH CBC 11B-401 AND INCLUDE A 32" CLEAR OPENING, THE REQUIRED STRIKE EDGE CLEARANCE AT PULL SIDE OF DOOR, LEVEL LANDINGS WITH A 2% MAX. SLOPE, AND AN ACCESSIBLE THRESHOLD, HARDWARE, CLOSER AND KICK PLATE.

SITE PLAN - FIRE LIFE SAFETY & ACCESS COMPLIANCE NOTES

- EXISTING FIRE HYDRANT.
- EXISTING GATE WITH PANIC HARDWARE PER DSA #01-117128
- EXISTING TOW AWAY SIGN PER DSA #01-117128
- (E) DA PARKING STALL, PER DSA #01-117128
- (E) DA PARKING SIGN, PER DSA #01-117128
- (E) ACCESSIBLE DRINKING FOUNTAIN PER DSA #01-117128
- (E) ACCESSIBLE BOYS RESTROOM PER DSA #01-117128
- (E) ACCESSIBLE GIRLS RESTROOM PER DSA #01-117128
- (E) ACCESSIBLE STAFF RESTROOMS PER DSA #01-117128
- (N) UPPER LEVEL (N) METAL SHADE STRUCTURE PC #04-117117, SEE MANUFACTURER'S DRAWINGS.
- (N) AMPHITHEATER (N) METAL SHADE STRUCTURE PC #04-117117, SEE MANUFACTURER'S DRAWINGS.
- (N) WHEELCHAIR SPACES WITH COMPANION SEAT PER CBC 11B-221 ASSEMBLY AREA
- (E) CONC. ACCESSIBLE RAMP PER DSA #01-117128
- (N) DESIGNATED ISLE HANDICAPPED SEAT. SEE DETAIL 4/A.0.4

DSA 810
FIRE & LIFE SAFETY SITE CONDITIONS SUBMITTAL

To facilitate the Division of the State Architect's (DSA) fire and life safety plan review of project site conditions, DSA requires the design professional to provide the following information at time of project submittal for projects consisting of construction of a new campus, construction of new buildings, additions to existing buildings, and for site alternate design means for fire department emergency vehicle access, and fire suppression water supply.

Information associated with compliance items 1-3 below is to be provided for all project types indicated above. Information associated with items 4-7 is to be completed when an alternate means is utilized. Acknowledgement by the school district and signature from the local fire authority (LFA) is only required when an alternate design means is being requested.

Page 1 of the completed form must be imaged onto the fire access site plan. When an alternate design/means is proposed, completed pages 1 and 2 are to be imaged on the fire access site plan.

For additional information refer to the instructions at the end of this form and [DSA Policy 09-01](#).

PROJECT INFORMATION		
School District/Owner:	MORRILL ELEMENTARY SCHOOL SHADE STRUCTURES	
Project Name/School:	1970 MORRILL AVE., SAN JOSE, CA 95132	
Project Address:		

FIRE & LIFE SAFETY INFORMATION		
1. Has a fire hydrant flow test been performed within the past 12 months? (If yes, provide a copy of the test data.)	Yes <input type="checkbox"/>	No <input type="checkbox"/>
2. Was the fire hydrant water flow test performed as part of this LFA review?	Yes <input type="checkbox"/>	No <input type="checkbox"/>
3. Is the project located within a designated fire hazard severity zone as established by Cal-Fire? (If yes, indicate fire hazard zone classification below) Refer to the following fire hazard zone locations: www.fires.ca.gov/fire_prevention/fire_prevention_wildland_zones_maps	Moderate <input type="checkbox"/>	High <input type="checkbox"/> Very High <input type="checkbox"/>
Wildland Interface Area (WIFA) (If any designations are checked, project design must meet the requirements of CBC Chapter 7A.)	WIFA <input type="checkbox"/>	

CONDITION MEANS AND METHODS RESOLUTION	ALTERNATE ACCEPTED		
	Yes	No	N/A / N/R
4. Emergency vehicle access roadways do not meet CFC requirements.			X
4a. Acceptable Alternate: Emergency vehicle and personnel access as proposed by the project architect is acceptable for providing fire suppression and protection of life and property.			X
5. Fire Hydrants: Number and spacing does not meet CFC requirements.			X
5a. Acceptable Alternate: Number of fire hydrants and spacing as proposed by the project architect is acceptable for fire suppression and protection of life and property.			X
6. Fire Hydrants: Water flow and pressure are less than CFC minimum.			X
6a. Acceptable Alternate: The available flow and pressure is acceptable for providing fire suppression and protection of life and property.			X
7. Location of fire department connection(s) serving fire sprinkler systems or standpipe systems does not meet CFC requirements.			X
7a. Acceptable Alternate: The location of fire department connection serving the fire sprinkler system and/or standpipe system is acceptable for providing fire suppression and protection of life and property.			X

DSA 810 (rev 10-22-18) DIVISION OF THE STATE ARCHITECT DEPARTMENT OF GENERAL SERVICES STATE OF CALIFORNIA Page 1 of 4


PARKING COUNT		(E) THE BARN	
(E) NORTH PARKING LOT	27	DSA #: 3877, 01-102632, 01-117128	Type of Construction: V-B
TOTAL (E) PARKING SPACES (INCLUDING ALL ACCESSIBLE PARKING SPACES) = 27		Occupancy: E	Fire sprinkler: No
(E) ACCESSIBLE PARKING SPACES REQUIRED = 2		Stories: One	Area: 13,020 sf
(E) VAN ACCESSIBLE STALLS = 1		PER CBC TABLE 11B-206.2 (2) ACCESSIBLE STALLS ARE REQUIRED, OF WHICH (1) SHALL BE VAN ACCESSIBLE. THEREFORE IS OK.	Allowable Area: Per 2016 CBC Table 506.2, Occupancy E and Type V-B (non-sprinklered) 9,500sf
(E) SOUTH PARKING LOT	57		Frontage Increase Equation 5-5: (358565 - 0.25) 30' 30' = 38
TOTAL (E) PARKING SPACES (INCLUDING ALL ACCESSIBLE PARKING SPACES) = 57			0.38 x 9500sf = 3611
(E) ACCESSIBLE PARKING SPACES REQUIRED = 3			9500sf + 3611sf = 13111sf
(E) VAN ACCESSIBLE STALLS = 1			13020sf < 13111sf = OK

BUILDING	OCCUPANCY TYPE	CONSTRUCTION TYPE	AREA (SQ. FT.)	ALLOWABLE (SQ. FT.)		# OF STORIES	MAIN BUILDING
				A3 = 7210	A3 = 14000		
(E) MAIN BUILDING	A3 / B / E	III-A	5960	B = 28500	E = 41,125'	1	* A3: 7210 / 14000 = 0.51 < 1 OK E: 27930 / 41,125' = 0.68 < 1 OK B: 5960 / 28500 = 0.2 < 1 OK ** 506.3.3 FRONTAGE INCREASE: W=(441 LF*30 + 371 LF*30 + 449 LF*30)/1,261 = 30
(E) THE BARN BUILDING	E	V-B	13,020	9,500		1	IF = (F/P - 0.25) W / 30 IF = (1,261 LF / 1,261 LF - 0.25) 30 / 30 IF = 0.750 E: 23500 X 1.75 = 41,125 SF 27930 SF < 41,125 SF THEREFORE OK
(E) THE UNION BUILDING	A-2	V-A	12,820	9,500		1	MULTI-PURPOSE YOUTH CENTER * A3: 7210 / 14000 = 0.51 < 1 OK ** 506.3.3 FRONTAGE INCREASE: W=(441 LF*30 + 371 LF*30 + 449 LF*30)/1,261 = 30
(E) MULTI-PURPOSE BUILDING	EIA3	III-A	18,560'	A3 = 24500	E = 41,125'	1	IF = (F/P - 0.25) W / 30 IF = (693 LF / 693 LF - 0.25) 30 / 30 IF = 0.750 A3: 14000 X 1.75 = 24,500 SF 18,560 SF < 24,500 SF THEREFORE OK
(E) RELOCATABLE BUILDING	E	V-B	1,365	9,500		1	
(N) SHADE STRUCTURE UPPER LEVEL: SS-1 + SS-2 & (N) SHADE STRUCTURE AMPHITHEATER: SS-3 + SS-4 + SS-5	A3	II-B	700+700+607+422+650+3280	6,000		1	IF = (F/P - 0.25) W / 30 IF = (693 LF / 693 LF - 0.25) 30 / 30 IF = 0.750 A3: 14000 X 1.75 = 24,500 SF 18,560 SF < 24,500 SF THEREFORE OK

GRAPHIC KEY

—	EXISTING PROPERTY LINE	—	FIRE DEPARTMENT ACCESS.
- - -	ASSUMED PROPERTY LINE	—	FIRE DEPARTMENT ACCESS IS 30" WIDE AND NOTED FOR 90.000 LBS.
—	ACCESSIBLE PATH OF TRAVEL	—	(E) DRY STAND PIPE
—	ROOF OVERHANG	—	(E) FIRE HYDRANT
—	CHAIN LINK FENCE	—	DRINKING FOUNTAIN
—	WOOD FENCE	—	(E) SIGN
—	DECORATIVE FENCE	—	NEW BUILDING
—		—	EXISTING BUILDING

1 SITE PLAN - FIRE LIFE SAFETY & ACCESS COMPLIANCE



IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP: 01-118969 INC.
 REVIEWED FOR
 SS FLS ACS
 DATE: 09/16/2020

SUGIMURA FINNEY ARCHITECTS
SFA
 ARCHITECTS INTERIORS PLANNING
 2185 SOUTH BASCOM AVE.
 SUITE 215
 CAMPBELL, CA 95008
 PHONE: 408.279.6000
 FAX: 408.277.6000




SITE PLAN - FIRE LIFE SAFETY & ACCESS COMPLIANCE
 SHADE STRUCTURES
 MORRILL MIDDLE SCHOOL
 1970 MORRILL AVE., SAN JOSE, CA 95132
 BERRYESSA UNION SCHOOL DISTRICT

REVISIONS	NO.	ITEM	DATE

DRAWN BY: MK
 CHECKED BY: NJ
 SFA JOB NO: 19064
 DATE: 06/17/2019

T2

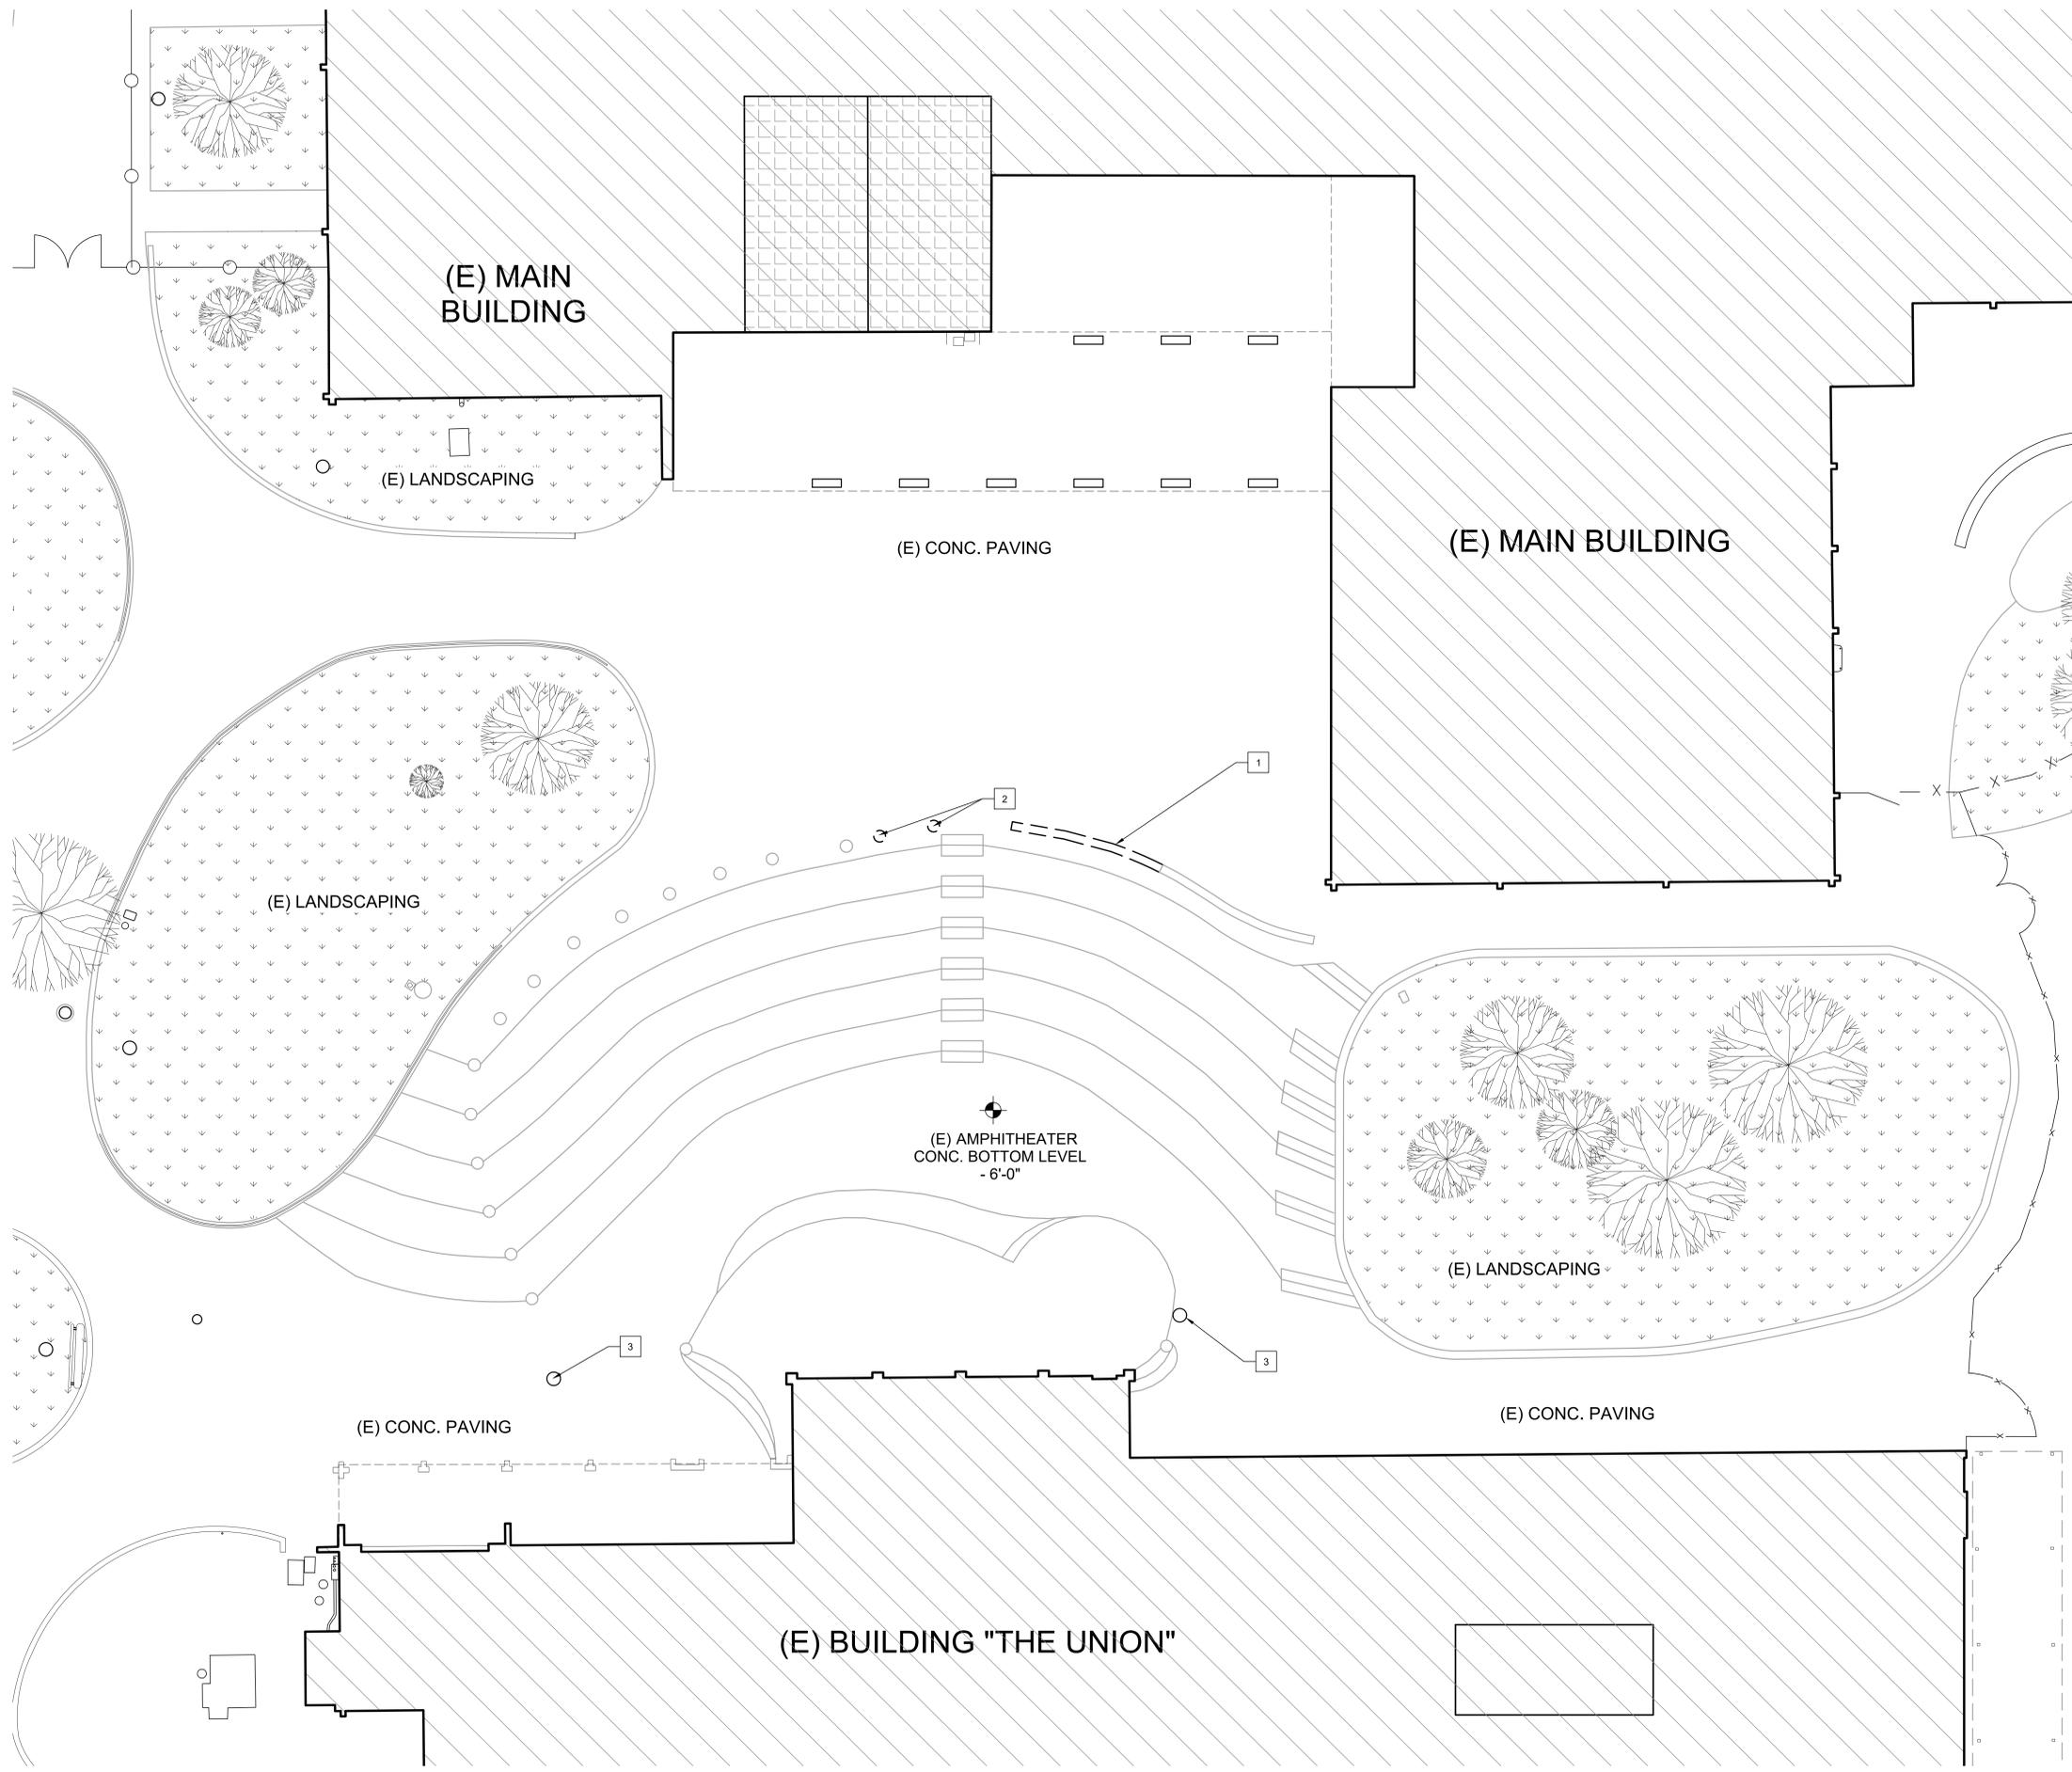

- GENERAL NOTES**
- CONTRACTOR TO VERIFY ALL BARRIERS IN P.O.T. HAVE BEEN REMOVED.
 - GENERAL CONTRACTOR SHALL SURVEY THE AREA OF NEW CONSTRUCTION FOR UNDERGROUND UTILITIES PRIOR TO THE BEGINNING OF CONSTRUCTION, AND REROUTE/CAP ALL EXISTING UTILITIES RUNNING BELOW THE AREA OF THE NEW SHADE STRUCTURES IF IT CONFLICTS WITH NEW SHADE STRUCTURE FOOTING.
 - ALL UTILITIES TO BE ABANDONED SHALL BE REMOVED IN THEIR ENTIRETY, AND WIRING PULLED BACK TO SOURCE.
 - REQUIRED UTILITY SHUTDOWNS SHALL BE REQUESTED 72 HOURS IN ADVANCE WITH ARCHITECT AND OWNER.
 - CONTRACTOR TO PROVIDE AND MAINTAIN IN PROPER CONDITION TEMPORARY FENCING PER DETAIL 1/A0.4 PRIOR TO START OF THE CONSTRUCTION AND DURING ALL THE CONSTRUCTION TIME. TEMPORARY FENCING TO BE INSTALLED ALONG THE PERIMETER OF WORK AREA.
 - DEMOLITION WORK SHALL CONFORM TO CALIFORNIA GREEN CODE SECTION 5.408.3 & 5.408.4, AND LOCAL CONSTRUCTION WASTE MANAGEMENT REQUIREMENTS.
 - PROVIDE TEMPORARY FENCING DURING CONSTRUCTION. SEE DETAIL 1/A0.4

- DEMOLITION SITE PLAN NOTES**
- DEMOLISH PORTION OF (E) CONC. WALL TO ACCOMMODATE SHADE STRUCTURE COLUMN. PATCH PAVING TO MATCH EXISTING.
 - DEMOLISH (E) CONC. COLUMN. PATCH PAVING TO MATCH EXISTING.
 - (E) CLEAN OUT. VERIFY EXACT LOCATION IN FIELD.

- GRAPHIC KEY**
- - - - - EXISTING PROPERTY LINE
 - - - - - ROOF OVERHANG
 - - - - - CHAINLINK FENCE
 - - - - - WOOD FENCE
 - - - - - DECORATIVE FENCE
 - [Hatched Box] EXISTING BUILDING
 - [Grid Box] EXISTING RESTROOMS
 - (O) (E) DRY STAND PIPE
 - (F) (E) DRINKING FOUNTAIN
 - (H) (E) FIRE HYDRANT
 - (S) (E) SIGN
 - (M) (E) MENS TOILET ROOM
 - (W) (E) WOMENS TOILET ROOM
 - (G) (E) GIRLS TOILET ROOM
 - (B) (E) BOYS TOILET ROOM
 - (U) (E) UNISEX TOILET ROOM
 - (K) (E) KINDERGARTEN TOILET ROOM

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP: 01-118969 INC.
 REVIEWED FOR
 SS FLS ACS
 DATE: 09/16/2020

SUGIMURA FINNEY ARCHITECTS
SFA
 ARCHITECTURE INTERIORS PLANNING
 2105 SOUTH BASCOM AVE.
 SUITE 200
 CAMPBELL, CA 95008
 PHONE: 408-578-8000
 FAX: 408-377-0500




DEMOLITION SITE PLAN ENLARGED
 SHADE STRUCTURES
 MORRILL MIDDLE SCHOOL
 1970 MORRILL AVE., SAN JOSE, CA 95132
 BERRYESSA UNION SCHOOL DISTRICT


REVISIONS NO.	ITEM	DATE

DRAWN BY: MK
 CHECKED BY: NJ
 SFA JOB NO: 19064 DATE: 06/17/2019

A0.1

1 DEMOLITION SITE PLAN ENLARGED



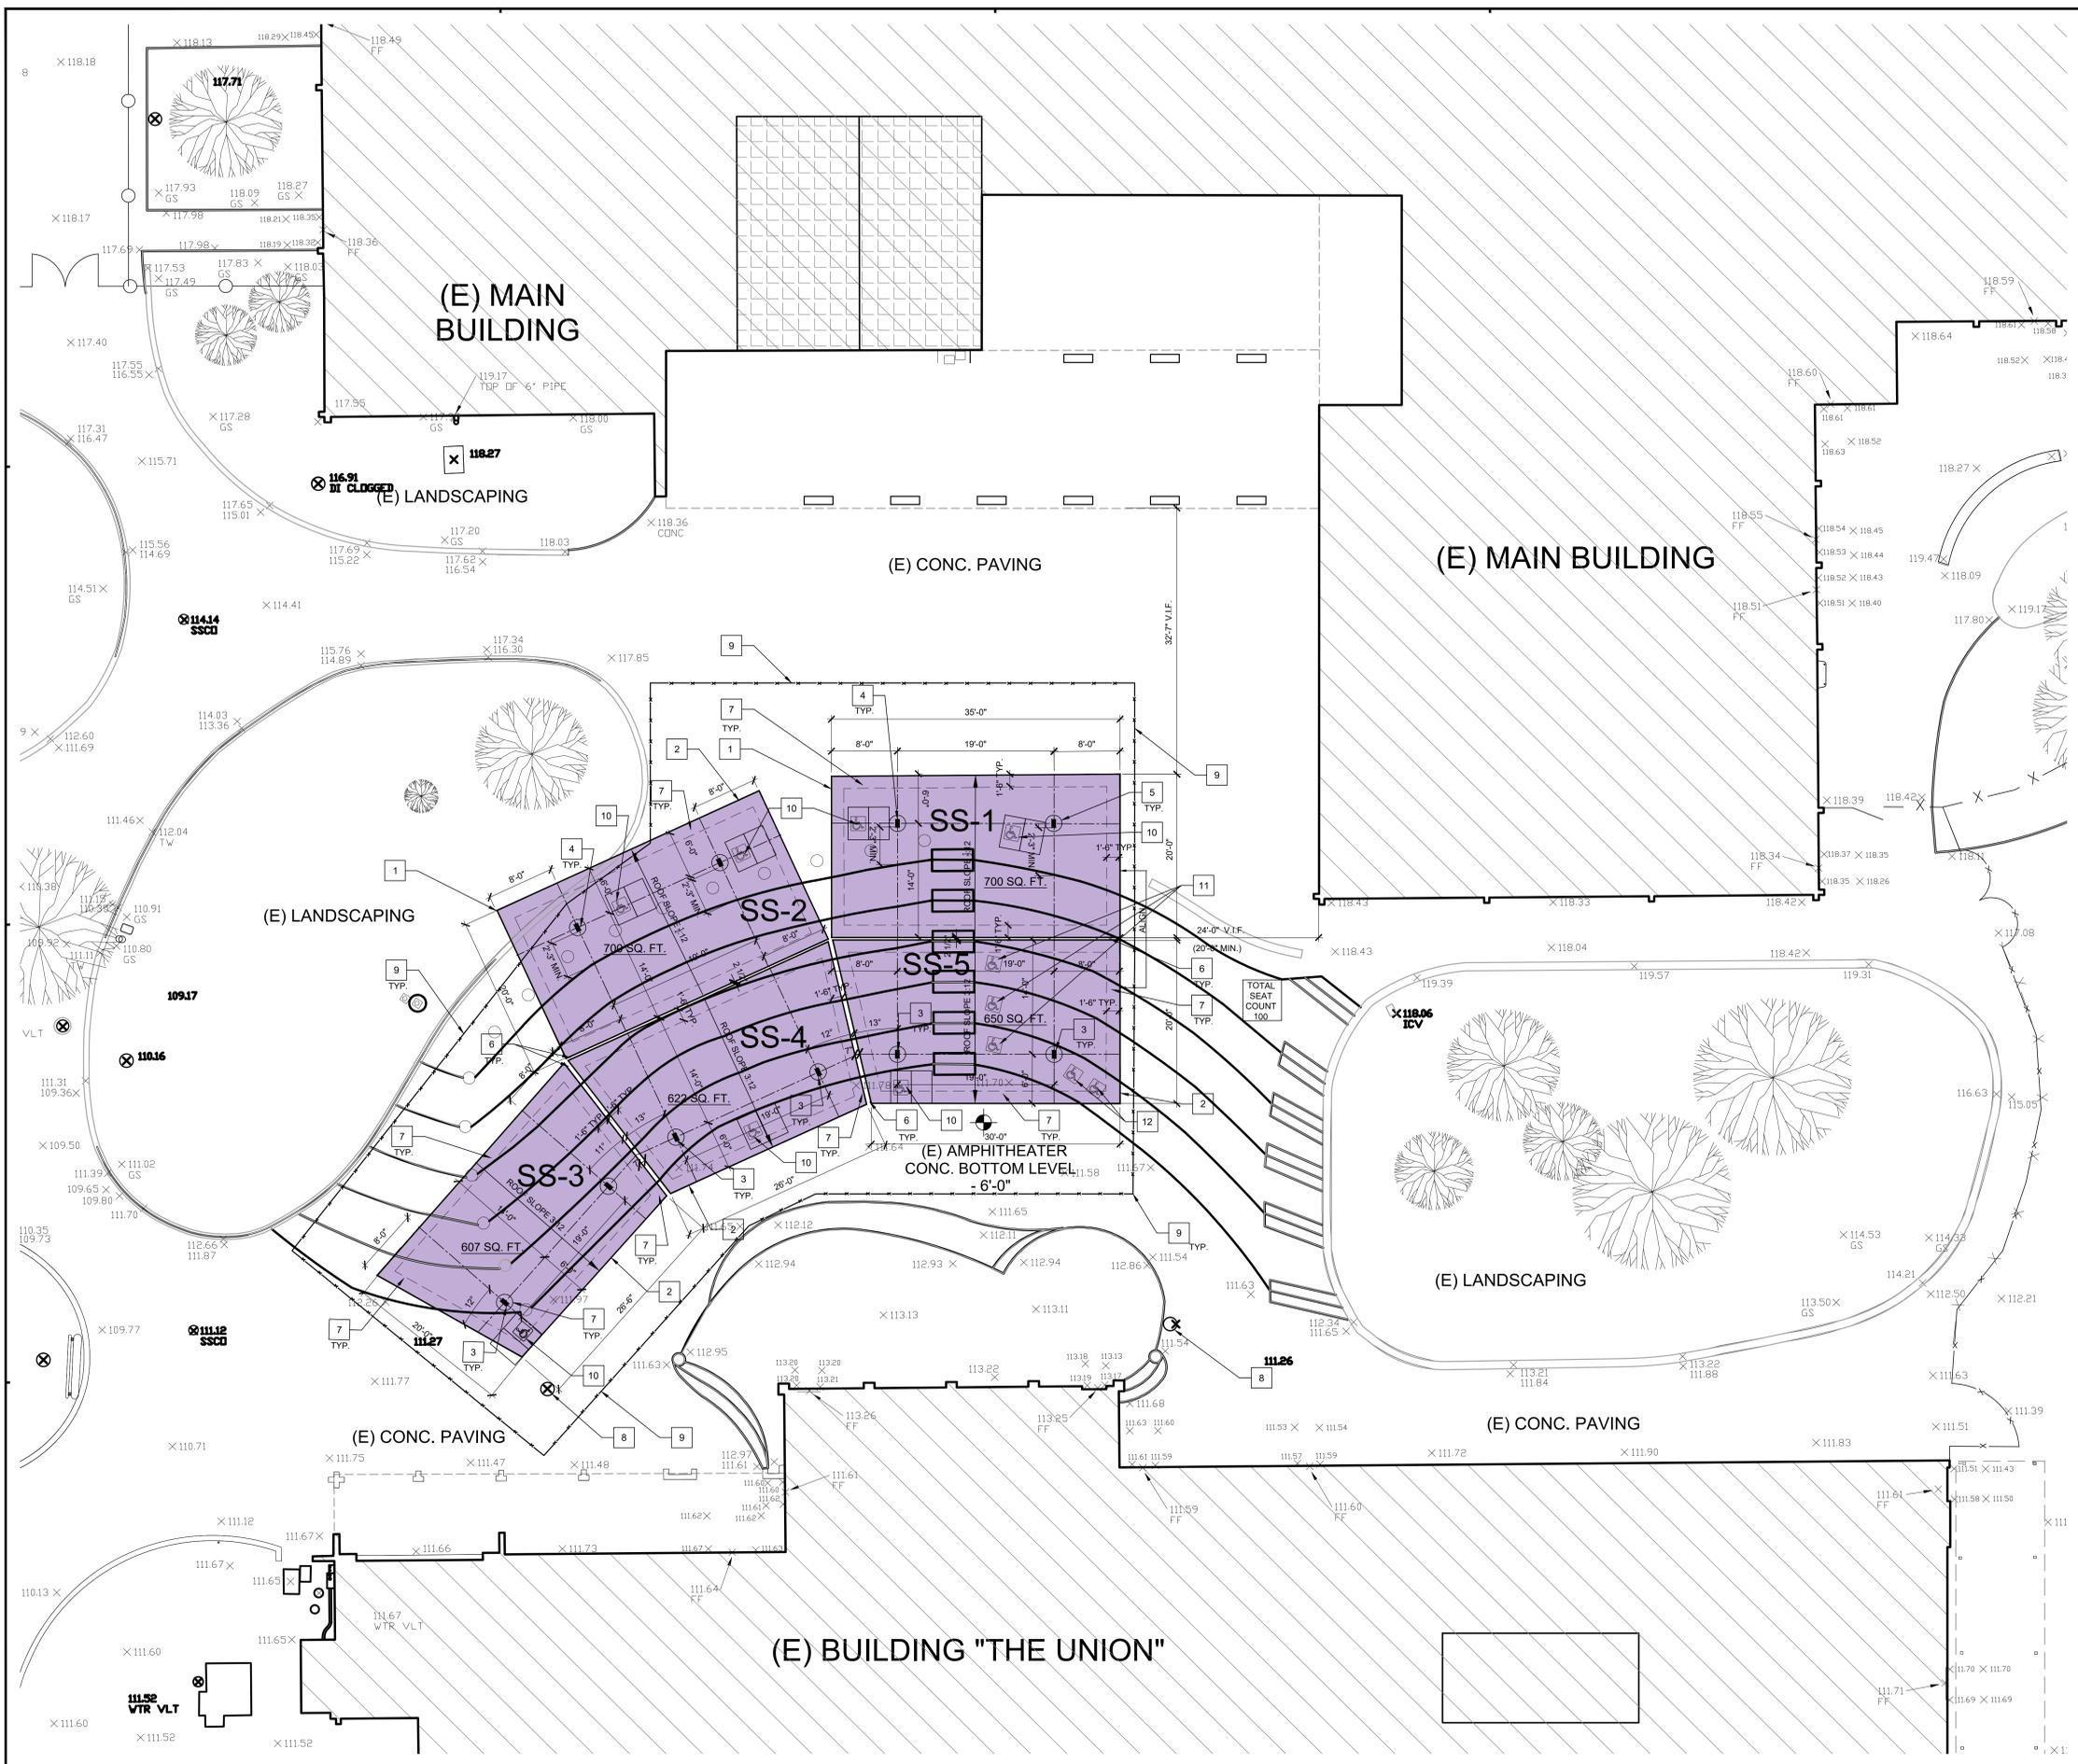

- GENERAL NOTES**
- CONTRACTOR TO VERIFY ALL BARRIERS IN P.O.T. HAVE BEEN REMOVED.
 - GENERAL CONTRACTOR SHALL SURVEY THE AREA OF NEW CONSTRUCTION FOR UNDERGROUND UTILITIES PRIOR TO THE BEGINNING OF CONSTRUCTION, AND REROUTE/CAP ALL EXISTING UTILITIES RUNNING BELOW THE AREA OF THE NEW SHADE STRUCTURES IF CONFLICTS WITH NEW SHADE STRUCTURE FOOTING.
 - REFER TO SHADE STRUCTURES MANUFACTURER'S DRAWINGS FOR CONC. FOOTINGS DESIGN REQUIREMENTS.
 - SHADE STRUCTURES & MARQUEE SIGN O.F.C.I.
 - CONTRACTOR TO BACKFILL TRENCHES AND PATCH DAMAGED PAVING AS REQUIRED TO MATCH EXISTING.
 - PROVIDE TEMPORARY FENCING DURING CONSTRUCTION. SEE DETAIL 1/A0.4
 - TIE IN (N) SHADE STRUCTURE DOWNSPOUTS TO THE NEAREST STORM DRAIN.

- NEW SITE PLAN NOTES**
- (N) UPPER LEVEL SHADE STRUCTURE PC # 04-117117 OPTION VC20. SEE MANUFACTURER'S DRAWINGS.
 - AMPHITHEATER NEW SHADE STRUCTURE PC # 04-117117 OPTION VC20. SEE MANUFACTURER'S DRAWINGS.
 - (N) SHADE STRUCTURE COLUMN 13'-0" HEIGHT. SEE 2/S-7, 2/S-5
 - (N) SHADE STRUCTURE COLUMN 11'-0" HEIGHT, TYP. V.I.F. SEE 2/S-7, 2/S-5
 - (N) SHADE STRUCTURE COLUMN FOOTING, TYP. SEE 1 & 3/S-10
 - SEISMIC GAP PER S-2, TYP.
 - ROOF DECK CANTILEVER, TYP. PER DET. 3/S6, 3/S5, 5/S11
 - (E) STORM DRAIN INLET, VERIFY EXACT LOCATION IN FIELD.
 - TEMPORARY FENCING, SEE DET. 1/A0.4
 - (N) WHEELCHAIR SPACES WITH COMPANION SEAT PER CBC 11B-221 ASSEMBLY AREA
 - DESIGNATED ISLE PROVIDE SIGNAGE PER DETAIL 4/A0.4
 - SEMI-AMBULANT SEAT, TYP.

GRAPHIC KEY

- EXISTING PROPERTY LINE
- ROOF OVERHANG
- CHAINLINK FENCE
- WOOD FENCE
- DECORATIVE FENCE
- NEW SHADE STRUCTURE
- EXISTING BUILDING
- EXISTING RESTROOMS
- (E) DRY STAND PIPE
- DRINKING FOUNTAIN
- (E) FIRE HYDRANT
- (E) SIGN
- M** (E) MENS TOILET ROOM
- W** (E) WOMENS TOILET ROOM
- G** (E) GIRLS TOILET ROOM
- B** (E) BOYS TOILET ROOM
- U** (E) UNISEX TOILET ROOM
- K** (E) KINDERGARTEN TOILET ROOM

1 NEW ENLARGED SITE PLAN

1/8" = 1'-0"

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP: 01-118969 INC.
 REVIEWED FOR
 SS FLS ACS
 DATE: 09/16/2020

SFA
 ARCHITECTURE INTERIORS PLUMBING
 2155 SOUTH RASCOM AVE.
 SUITE 200
 CAMPBELL, CA 95008
 PHONE: 408-574-6500
 FAX: 408-577-6505




NEW ENLARGED SITE PLAN

SHADE STRUCTURES
 MORRILL MIDDLE SCHOOL
 1970 MORRILL AVE., SAN JOSE, CA 95132
 BERRYESSA UNION SCHOOL DISTRICT


NO.	ITEM	DATE

DRAWN BY: MK
 CHECKED BY: NJ
 SFA JOB NO: 19064 DATE: 06/17/2019

COPYRIGHT © 2019

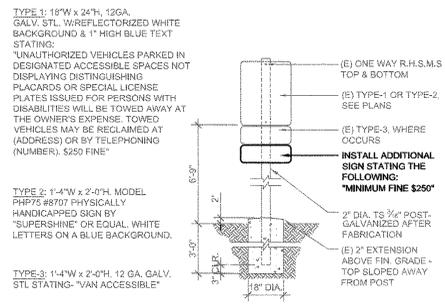


4 (E) PARKING SIGNAGE (FOR REFERENCE ONLY DSA #01-117128 SHEET A-12-2) WITH ADDED FINE SIGNAGE N.T.S.

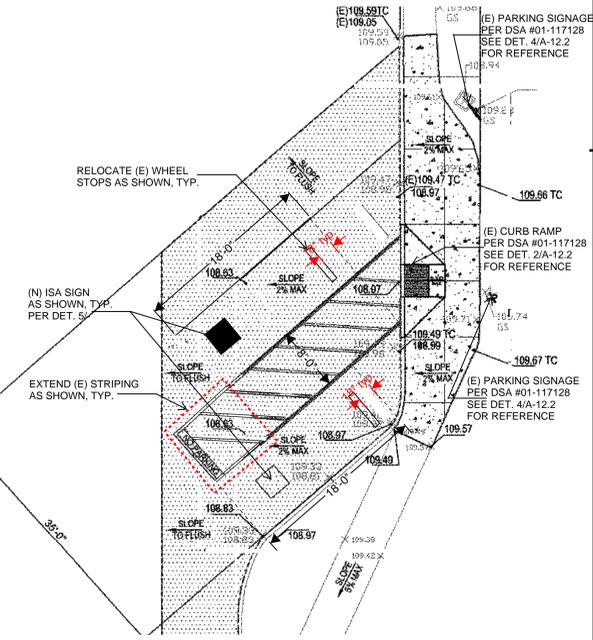


3 ACCESSIBLE STALLS DETAIL


3 TOW AWAY PARKING SIGNAGE (FOR REFERENCE ONLY DSA #01-117128 SHEET A 12-2) N.T.S.

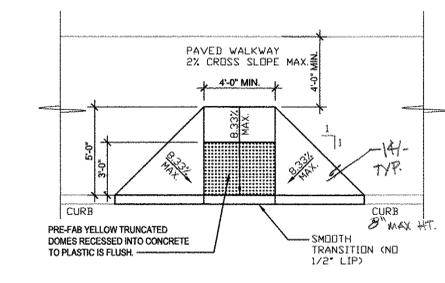

2 ACCESSIBLE CURB RAMP (FOR REFERENCE ONLY DSA #01-117128 SHEET A-12-2) 1/4" = 1'-0"

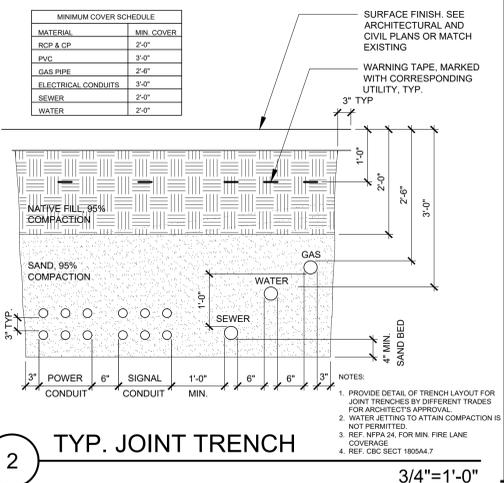


2 TYP. JOINT TRENCH 3/4" = 1'-0"

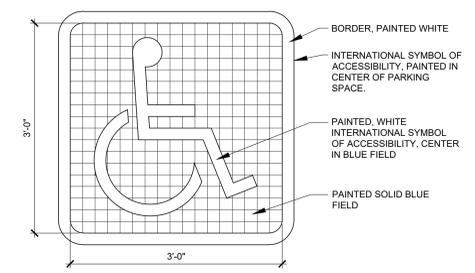


NOTES:
 1. GRID LINES ARE SHOWN FOR PROPORTION ONLY AND ARE NOT TO APPEAR AS PART OF SYMBOL.
 2. DA SIGNAGE SHALL COMPLY WITH THE CALIFORNIA BUILDING CODE.
 3. SYMBOL SHALL BE LOCATED SO THAT IT IS VISIBLE TO A TRAFFIC ENFORCEMENT OFFICER WHEN A VEHICLE IS PARKED IN THE SPACE.
 4. PAINT TO BE TRAFFIC PAINT
 5. SYMBOL PROPORTIONS SHALL MATCH CBC FIGURE 11B-703.7.2.1.

5 INTERNATIONAL SYMBOL FOR ACCESSIBILITY (I.S.A.) 1" = 1'-0"

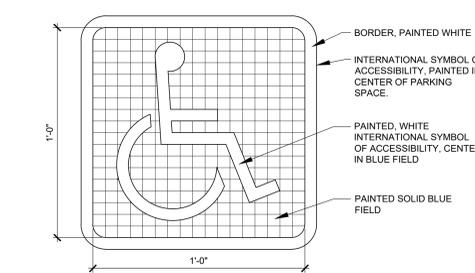

NOTES:
 1. GRID LINES ARE SHOWN FOR PROPORTION ONLY AND ARE NOT TO APPEAR AS PART OF SYMBOL.
 2. DA SIGNAGE SHALL COMPLY WITH THE CALIFORNIA BUILDING CODE.
 5. SYMBOL PROPORTIONS SHALL MATCH CBC FIGURE 11B-703.7.2.1.

4 INTERNATIONAL SYMBOL FOR ACCESSIBILITY (I.S.A.) 1" = 1'-0"

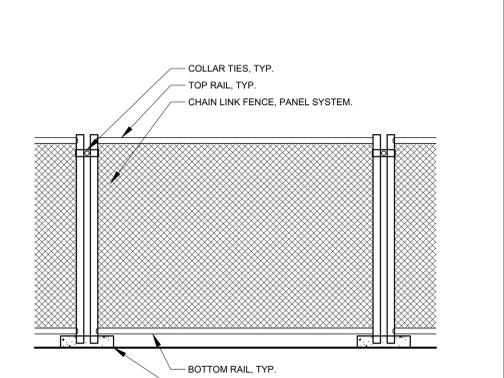

1 REQ'D TEMPORARY FENCING CONSTRUCTION FENCING 1/2" = 1'-0"

SITE DETAILS
 SHADE STRUCTURES
 MORRILL MIDDLE SCHOOL
 1970 MORRILL AVE., SAN JOSE, CA 95132
 BERRYESSA UNION SCHOOL DISTRICT

REVISIONS

NO.	ITEM	DATE

DRAWN BY: MK
 CHECKED BY: NJ
 SFA JOB NO: 19064
 DATE: 06/17/2019

M BAR C VERSA-CANOPY

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 01-118969 INC.
REVIEWED FOR
SS FLS ACS
DATE: 09/16/2020

ENGINEER'S
APPROVAL



DATE SIGNED
11/28/2018

SITE SPECIFIC
DSA APPROVAL

FILE NUMBER: PC-119
IDENTIFICATION STAMP
DIVISION OF THE STATE ARCHITECT
APP. NO: 04 - 117117 INCR
AC DF FLS DS SS DP
DATE: 12/05/2018

PRE-CHECK (PC) DOCUMENT
CODE: 2016 CBC
A SEPARATE PROJECT APPLICATION FOR
CONSTRUCTION IS REQUIRED

M BAR C
CONSTRUCTION
INC.
674 RANCHEROS DR
SAN MARCOS, CA
92069
PHONE: (760) 744-4131
FAX: (760) 744-4449
GREGJ@MBARCONLINE.COM
LIC # 869960
B AND C51
(775) 787-8845

4STEL
STRUCTURAL ENGINEERING
26030 A CHERO, SUITE 200
MISSION VIEJO, CA 92691
PHONE: (949) 305-1150
FAX: (949) 305-1420

VERSA
CANOPY
COVER SHEET

DRAWN
GM
CHECKED
KS
DATE
11/28/2018
4STEL JOB NO.
MC03-01
SHEET
S-1
1 OF 13 SHEETS

PC OWNERSHIP - STRUCTURAL STEEL CONTRACTOR



M BAR C
CONSTRUCTION
INC.

674 RANCHEROS DR
SAN MARCOS, CA. 92069

PHONE: (760) 744-4131
FAX: (760) 744-4449

LIC # 869960
B AND C51

POINT OF CONTACT: GREG JONES
GREGJ@MBARCONLINE.COM
(775) 787-8845

LEGAL INFORMATION

- USE OF THE PC WITHOUT WRITTEN CONSENT FROM M BAR C CONSTRUCTION, INC. IS STRICTLY PROHIBITED.
- ALL INFORMATION HEREIN IS PROPRIETARY INFORMATION AND UNDER THE OWNERSHIP OF M BAR C CONSTRUCTION, INC.

STANDARD NOTES FOR PC USE

- 4 S.T.E.L. ENGINEERING, INC. IS AVAILABLE TO BID THE GENERATION OF THE FULL DSA SUBMITTAL PACKAGE ACTING AS THE DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE (DPGRC) OR TO SUPPORT THE DPGRC AS THE SITE SPECIFIC STRUCTURAL ENGINEER OF RECORD (SEOR). CONTACT DUSTIN ROSEPINK AT 4 S.T.E.L. ENGINEERING, INC FOR A PROPOSAL FOR SERVICES AT (949) 305-1150, DKRPINK@4STELENG.COM
- FOR CONSTRUCTION COST INFORMATION, CONTACT M BAR C CONSTRUCTION, INC.
- CUSTOM SIZES AND LOADINGS REQUIRE SUPPLEMENTARY SHOP DRAWINGS AND CALCULATIONS.

DSA OTC PLAN REVIEWER AND DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE NOTES

1. THE PC STRUCTURAL MEMBERS ARE DESIGNED TO THE FOLLOWING ASCE 7-10 SEISMIC CRITERIA: $S_s = 3.2$, $S_1 = 1.39$, $R = 1.25$.
2. THE DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE TO VERIFY SITE SPECIFIC DESIGN PARAMETERS COMPLY WITH DESIGN PARAMETERS FOR THE PC SHOWN ON SHEET S-2.
3. THE DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE IS RESPONSIBLE FOR VERIFYING SITE-SPECIFIC WIND PARAMETERS AT ANY AND ALL SITES WHERE THIS PC IS USED. THIS PC DESIGN IS BASED ON WIND SPEED 110 MPH FOR RISK CATEGORY II TYPE STRUCTURES UTILIZING EXPOSURE TYPE C PER ASCE 7-10. SEE DESIGN PARAMETER NOTE 1 ON SHEET S-2.
4. A SITE SPECIFIC GEOTECHNICAL REPORT SHALL BE SUBMITTED JUSTIFYING SOILS VALUES SELECTED IF GREATER THAN 100 PCF FOR LATERAL BEARING AND/OR 1,500 PSF FOR VERTICAL BEARING. SEE FOUNDATION NOTES ON SHEET S-3.
5. SITE SPECIFIC DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE TO SELECT SOILS CLASS FOR SITE SPECIFIC USE.
6. WET STAMPED & SIGNED COPIES OF PC PLANS ARE NOT REQUIRED FOR SITE SPECIFIC PC USE.
7. DUSTIN ROSEPINK IS NOT ACTING AS SITE SPECIFIC SEOR UNLESS HE IS THE DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE OR A SIGNED LETTER HAS BEEN SUBMITTED WITH DSA-1 FORM STATING HE ACCEPTS THE RESPONSIBILITY AS THE SEOR FOR THE SITE. REFER TO DSA IR A-18.
8. DUSTIN ROSEPINK WILL NOT SIGN ANY DSA FORMS (e.g. DSA-5, DSA-6, etc.), REVIEW OR APPROVE ANY SUBMITTALS (e.g. CONCRETE MIX DESIGNS, SHOP DRAWINGS, etc.) FOR THE SITE SPECIFIC PROJECT UNLESS HE IS ACTING AS THE DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE OR THE SITE SPECIFIC STRUCTURAL ENGINEER OF RECORD. REFER TO DSA IR A-18.
9. CUSTOM SIZES & LOADINGS REQUIRE SUPPLEMENTARY SHOP DRAWINGS & CALCULATIONS.

DESIGN PARAMETER CHECK LIST

1. VERIFY THE MAXIMUM WIND SPEED AT THE SITE DOES NOT EXCEED 110 MPH EXPOSURE C.
2. VERIFY THE MAXIMUM SEISMIC S_s AT THE SITE DOES NOT EXCEED $S_s = 3.2$.
3. VERIFY THE SITE SPECIFIC SNOW LOAD AND ENSURE ALL SITE SPECIFIC PC SELECTIONS MEET OR EXCEED THE SITE SPECIFIC SNOW LOAD. THIS PC HAS OPTIONS FOR NO SNOW AND 20 PSF SNOW LOAD. VERIFY THE SITE SPECIFIC DESIGN PROFESSIONAL HAS PROVIDED THE PROPER SITE SPECIFIC VALUES FOR P_g , P_f , P_s , C_e , I_c .
4. REVIEW THE SITE SPECIFIC GEOTECHNICAL REPORT AND ENSURE ALL SITE SPECIFIC PC SELECTIONS MEET WITH THE GEOTECHNICAL REPORT REQUIREMENTS. IF NO GEOTECHNICAL REPORT IS SUPPLIED VERIFY SOILS CLASS V IS SELECTED.
 - SITES NOT LOCATED IN STATE OR LOCAL GEOHAZARD ZONES UTILIZING THIS PC WITH STRUCTURES NOT EXCEEDING 4,000 SQ FT DO NOT REQUIRE CGS APPROVAL OF THE GEOTECHNICAL REPORT. STRUCTURES MAY BE BROKEN UP INTO MULTIPLE 4,000 SQ FT STRUCTURES WITH SEISMIC BREAKS PER SEISMIC GAPS ON S-2.
5. VERIFY THE SITE SPECIFIC FOUNDATION LOCATIONS MEET WITH SOILS NOTE 8 ON S-3 FOR SET BACK FROM TOP OF SLOPES OR THAT THE GEOTECHNICAL REPORT HAS ALLOWED A SMALLER DISTANCE.
6. VERIFY THE SITE SPECIFIC PLANS PROVIDE THE APPROPRIATE OCCUPANCY AND OCCUPANCY LOAD FACTOR FOR THE SITE. SEE BUILDING DATA ON S-2 FOR SAMPLE ACCEPTABLE OCCUPANCIES AND OCCUPANCY LOAD FACTORS.
7. VERIFY THE SITE SPECIFIC PLANS UTILIZE A RISK CATEGORY II STRUCTURE. RISK CATEGORY II STRUCTURES SHALL NOT PROVIDE SHELTER FOR EMERGENCY VEHICLES OR EQUIPMENT, OR PROVIDE REQUIRED ACCESS TO, REQUIRED EGRESS FROM, OR SHARE A LIFE SAFETY COMPONENT WITH A RISK CATEGORY III OR IV STRUCTURE.
8. VERIFY SELECTION OF USE AND OCCUPANCY CLASSIFICATION PER CBC CHAPTER 3; OCCUPANT LOAD FACTOR PER CBC TABLE 1004.1.2; RISK CATEGORY PER CBC TABLE 1604A.5; TO BE COMPLETED BY DESIGN PROFESSIONAL AT TIME OF DSA OTC OR PROJECT DSA SUBMITTAL.
9. VERIFY APPROPRIATE SEISMIC SEPARATION PER SEISMIC GAPS ON S-2.
10. VERIFY THE SITE SPECIFIC DESIGN PROFESSIONAL HAS APPROPRIATELY ADDRESSED FIRE SEPARATION AND PROPERTY LINE SETBACKS.
11. VERIFY THE SITE SPECIFIC SOLAR PANEL LAYOUT IS PROVIDED WITH DIMENSIONS THAT DO NOT EXCEED THE PC MAXIMUMS. THE MAXIMUM DIMENSIONS SHALL BE TO THE OUTSIDE EDGES OF THE SOLAR PANEL OR THE STRUCTURAL STEEL, WHICH EVER IS GREATER.
12. VERIFY STEEL SELECTIONS HAVE BEEN PROPERLY COORDINATED WITH BEAM/COLUMN SCHEDULES. REFER TO 2/S-8 & 2/S-9.
13. VERIFY SITE SPECIFIC PURLIN CANTILEVERS HAVE BEEN PROPERLY COORDINATED WITH PURLIN SCHEDULES. REFER TO 1/S-8 & 1/S-9.
14. WET STAMPED & SIGNED COPIES OF PC PLANS ARE NOT REQUIRED FOR SITE SPECIFIC PC USE.

SHEET INDEX

S-1.....COVER SHEET
S-2.....GENERAL DATA
S-3.....GENERAL NOTES
S-4.....SAMPLE DSA-103 FORMS
S-5.....SECTION PROPERTIES & REBAR DETAILS
S-6.....VC14, VC18 & VC20 FRAMING PLAN & ELEVATIONS
S-7.....VC14, VC18 & VC20 FRAMING SCHEDULES
S-8.....VC140, VC180 & VC200 FRAMING PLAN & ELEVATIONS
S-9.....VC140, VC180 & VC200 FRAMING SCHEDULES
S-10.....PIER FOUNDATION & SPREAD FOOTING SCHEDULES
S-11.....STANDARD DETAILS 1
S-12.....STANDARD DETAILS 2
S-13.....SAMPLE ARCHITECTURAL ELEVATIONS
13 SHEETS

BID INFORMATION

THE STEEL STRUCTURES IN THIS PC ARE
PROPRIETARY TO M BAR C CONSTRUCTION, INC.
THE STEEL WORK SHALL NOT GO OUT TO BID.

PRE-CHECK (PC) DOCUMENT

CODE: 2016 CBC
A SEPARATE PROJECT APPLICATION
FOR CONSTRUCTION IS REQUIRED



ABBREVIATIONS

&	AND
@	AT
⊕	CENTER LINE
A.B.	ANCHOR BOLT
ACI	AMERICAN CONCRETE INSTITUTE
AISC	AMERICAN INSTITUTE OF STEEL CONSTRUCTION
AISI	AMERICAN IRON AND STEEL INSTITUTE
ANSI	AMERICAN NATIONAL STANDARDS INSTITUTE
ASTM	AMERICAN SOCIETY FOR TESTING MATERIALS
AWS	AMERICAN WELDING SOCIETY
BLDG	BUILDING
BLK'G	BLOCKING
BM	BEAM
BOTT. OR (B)	BOTTOM
CBC	CALIFORNIA BUILDING CODE
CCD	CONSTRUCTION CHANGE DOCUMENT (DSA)
CCR	CALIFORNIA CODE OF REGULATIONS
CFS	COLD FORMED STEEL
C.J.	CONTROL JOINT
CJP	COMPLETE JOINT PENETRATION
CLR	CLEAR
CMU	CONCRETE MASONRY UNIT
COL.	COLUMN
CONC.	CONCRETE
CONT.	CONTINUOUS
CS	CFS C SECTION WITH FLANGE STIFFENING LIPS
DIA., Ø	DIAMETER
DPRC	DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE
DSA	DIVISION OF THE STATE ARCHITECT
DWG	DRAWING
(E)	EXISTING
EA.	EACH
E.F.	EACH FACE
E.W.	EACH WAY
EXT.	EXTERIOR
FDN	FOUNDATION
FIN.	FINISH
FLR	FLOOR
FLS	FIRE LIFE SAFETY (DSA)
F.O.C.	FACE OF CONCRETE
F.S.	FAR SIDE
FTG.	FOOTING
GA.	GAUGE
GALV.	GALVANIZED
H.S.B.	HIGH STRENGTH BOLT (ASTM A325 U.N.O.)
HORIZ.	HORIZONTAL
HT.	HEIGHT
IAMPO	INTERNATIONAL ASSOCIATION OF MECHANICAL AND PLUMBING OFFICIALS
ICC	INTERNATIONAL CODE COUNCIL
INT.	INTERIOR
IOR	INSPECTOR OF RECORD
IR	INTERPRETATION OF REGULATIONS (DSA)
JT	JOINT
LG.	LONG
LLH	LONG LEG HORIZONTAL
LLV	LONG LEG VERTICAL
M.B.	MACHINE BOLT (ASTM A307 U.N.O.)
MAX.	MAXIMUM
MFR.	MANUFACTURER
MIN.	MINIMUM
MISC.	MISCELLANEOUS
(N)	NEW
NFPA	NATIONAL FIRE PROTECTION ASSOCIATION
NOM.	NOMINAL
N.S.	NEAR SIDE
NTS	NOT TO SCALE
O.C.	ON CENTER
OTC	OVER THE COUNTER (DSA)
O.H.	OPPOSITE HAND
⊕ OR PL	PLATE
PJP	PARTIAL JOINT PENETRATION
PC	PRE-CHECK (DSA)
PT	PRESSURE TREATED
PV	PHOTOVOLTAIC
REINF.	REINFORCEMENT
REQ'D	REQUIRED
SC	SLIP-CRITICAL JOINT PER ASTM SPECS
SCHED.	SCHEDULE
SEOR	STRUCTURAL ENGINEER OF RECORD
SH'TG	SHEATHING
SIM.	SIMILAR
S.M.S.	SHEET METAL SCREW
SQ.	SQUARE
SS	STAINLESS STEEL
ST	SNUG-TIGHTENED JOINT PER ASTM SPECS
STD	STANDARD
(T)	TOP
T&B	TOP AND BOTTOM
T.O.C.	TOP OF CONCRETE
T.O.S.	TOP OF STEEL
TYP.	TYPICAL
U.N.O.	UNLESS NOTED OTHERWISE
VERT.	VERTICAL
W/-	WITH
W/O	WITHOUT
WHS	WELDED HEADED STUD (ASTM A108 U.N.O.)
W.P.	WORK POINT
WT.	WEIGHT
WTS	WELDED THREADED STUD (ASTM A108 U.N.O.)

GENERAL NOTES

- ALL WORK SHALL CONFORM TO TITLE 24, CALIFORNIA CODE OF REGULATIONS (CCR)
- CHANGES TO THE APPROVED DRAWINGS AND SPECIFICATIONS SHALL BE MADE BY ADDENDA OR CONSTRUCTION CHANGE DOCUMENTS APPROVED BY THE DIVISION OF THE STATE ARCHITECT, AS REQUIRED BY SECTION 4-338, PART 1, TITLE 24, CCR.
- A 'DSA CERTIFIED' PROJECT INSPECTOR EMPLOYED BY THE DISTRICT (OWNER) AND APPROVED BY THE DIVISION OF THE STATE ARCHITECT SHALL PROVIDE CONTINUOUS INSPECTION OF THE WORK. THE DUTIES OF THE INSPECTOR ARE DEFINED IN SECTION 4-342, CALIFORNIA BUILDING STANDARDS ADMINISTRATIVE CODE (PART 1, TITLE 24, CCR).
- A 'DSA CERTIFIED' INSPECTOR WITH CLASS 2 CERTIFICATION IS REQUIRED FOR THIS PROJECT.
- A DSA ACCEPTED TESTING LABORATORY DIRECTLY EMPLOYED BY THE SCHOOL BOARD SHALL CONDUCT ALL THE REQUIRED TESTS AND INSPECTIONS FOR THE PROJECT.
- GRADING PLANS, DRAINAGE IMPROVEMENTS, ROAD AND ACCESS REQUIREMENTS AND ENVIRONMENTAL HEALTH CONSIDERATIONS SHALL COMPLY WITH ALL LOCAL ORDINANCES.
- IF THE PROJECT IS DIVIDED INTO INCREMENTS: THE SCOPE OF WORK FOR EACH INCREMENT MUST BE CLEARLY SPECIFIED ON THE TITLE SHEET OF ALL INCREMENTS SUBMITTED.


CONSTRUCTION OPTIONS

- ALL CONSTRUCTION OPTIONS INCLUDE OPTIONS FOR CONCRETE DRILLED PIERS AND/OR SPREAD FOOTINGS.

- 14'-0" MAX WIDTH, 3:12 MAX ROOF SLOPE, 17'-0" MAX COLUMN HEIGHT, 0 psf GROUND SNOW
- 18'-0" MAX WIDTH, 3:12 MAX ROOF SLOPE, 17'-9" MAX COLUMN HEIGHT, 0 psf GROUND SNOW
- 20'-0" MAX WIDTH, 3:12 MAX ROOF SLOPE, 17'-0" MAX COLUMN HEIGHT, 0 psf GROUND SNOW
- 14'-0" MAX WIDTH, 3:12 MAX ROOF SLOPE, 17'-5" MAX COLUMN HEIGHT, 20 psf GROUND SNOW
- 18'-0" MAX WIDTH, 3:12 MAX ROOF SLOPE, 16'-6" MAX COLUMN HEIGHT, 20 psf GROUND SNOW
- 20'-0" MAX WIDTH, 3:12 MAX ROOF SLOPE, 16'-9" MAX COLUMN HEIGHT, 20 psf GROUND SNOW

SEISMIC GAPS

OPTION	MAX COLUMN HEIGHT	GAP X	GAP Y
VC14	17'-0"	2 1/2"	7"
VC18	17'-9"	3"	8 1/2"
VC20	17'-0"	2 1/2"	7"
VC16	17'-5"	3 1/2"	9"
VC180	16'-6"	3"	8 1/2"
VC200	16'-9"	3"	8"

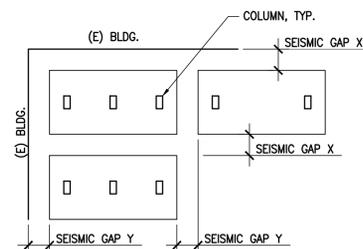

- NOTE
- SEISMIC GAPS LISTED ARE THE MINIMUM GAPS BETWEEN ANY TWO STRUCTURES (I.E. CANOPIES, BUILDINGS) AND DO NOT NEED TO BE COMBINED OR DOUBLED.
 - DIMENSIONS, QUANTITIES, AND LOCATIONS OF STRUCTURES AND COLUMNS SHOWN ABOVE ARE FOR ILLUSTRATIVE PURPOSES ONLY. SEE SITE-SPECIFIC SHEETS FOR LAYOUTS AND QUANTITIES.

STRUCTURAL DATA

LATERAL RESISTING SYSTEM..... STEEL ORDINARY CANTILEVER COLUMN
 FOUNDATION CONCRETE DRILLED PIERS AND SPREAD FOOTINGS
 TESTING AND INSPECTION LIST..... SEE SHEETS S-3 & S-4

DESIGN PARAMETERS

RISK CATEGORY II
 ROOF LIVE LOAD (L_p):
 DECK ONLY 20 psf
 POINT LOAD 300 lb
 SNOW LOAD:
 MAX. DRIFT SNOW LOAD..... 0 psf, 20 psf (SEE CONSTRUCTION OPTIONS)
 MAXIMUM DEAD LOAD:
 ROOF DECK..... 0.89 psf
 WIND: ASCE 7-10 METHOD 2 - ANALYTICAL PROCEDURE
 BASIC WIND SPEED..... 110 mph⁽¹⁾
 WIND EXPOSURE C⁽¹⁾
 INTERNAL PRESSURE N/A (OPEN STRUCTURE)
 WIND DIRECTIONALITY FACTOR K_d = 0.85
 VELOCITY PRESSURE COEFFICIENT..... K_e = 0.90
 TOPOGRAPHIC FACTOR K_{zt} = 1.00
 SEISMIC: ASCE 7-10
 SEISMIC IMPORTANCE FACTOR I = 1.0
 RESPONSE MODIFICATION FACTOR..... R = 1.25
 MAPPED SPECTRAL RESPONSE S_s = 3.22⁽²⁾
 ACCELERATION S₁ = 1.39
 SITE CLASS D
 DESIGN SPECTRAL RESPONSE S_{DS} = 2.133
 S₁₁ = 1.390
 SEISMIC DESIGN CATEGORY D (E WITH GROUND MOTION ANALYSIS)
 SEISMIC FORCE RESISTING SYSTEM STEEL ORDINARY CANTILEVER COLUMN
 SEISMIC RESPONSE COEFFICIENT C_s = 1.707
 ANALYSIS PROCEDURE EQUIVALENT LATERAL FORCE

- NOTES:
- THE PC COMPONENTS & CLADDING AND MAIN WIND FORCE RESISTING SYSTEM DESIGN WIND PRESSURE q_s = 23.7 psf DETERMINED FROM THE CRITERIA LISTED ABOVE. (EXPOSURE C, K_e=0.960, K_{zt}=1.0, K_d = 0.85).
 THE PC MAY BE USED FOR RISK CATEGORY II TYPE STRUCTURES IN ANY WIND ZONE WHERE q_s ≤ 23.7 psf.
 EXAMPLE:
 SITE BASIC WIND SPEED, V = 120 mph
 RISK CATEGORY II
 WIND: EXPOSURE B
 K_d = 0.85
 K_e = 0.701
 K_{zt} = 1.00
 q_s = 22.0 psf < 23.7 psf
 THE PC MAY BE USED AT THIS SITE, PENDING DSA SITE SPECIFIC APPROVAL.
 - THE PC SEISMIC FORCE RESISTING SYSTEM IS GOVERNED BY C_s = 1.707 FROM THE CRITERIA LISTED ABOVE. (R = 1.25, S_s = 3.2, I_e = 1.00).
 THE PC MAY BE USED FOR RISK CATEGORY II STRUCTURES AT ANY SITE WHERE THE SITE SPECIFIC SEISMIC PARAMETER S_s AND R = 1.25 RESULT IN A VALUE C_s ≤ 1.707.
 EXAMPLE:
 RISK CATEGORY II
 SOIL: SITE CLASS A
 S_s = 3.4
 S₁ = 1.8
 R = 1.25
 I = 1.00
 S_{DS} = 1.813
 C_s = 1.451 < 1.707
 THE PC MAY BE USED AT THIS SITE, PENDING DSA SITE SPECIFIC APPROVAL.

BUILDING DATA

TYPE OF CONSTRUCTION..... IIB
 OCCUPANCY..... VARIES - SEE EXAMPLES
 NUMBER OF STORIES..... 1
 BUILDING AREAS..... VARY DUE TO OCCUPANCY - SEE EXAMPLES
 MODULE SIZES..... VARY WITH OPTIONS
 BUILDING LENGTH:
 ALL WIDTHS..... MAX. 500'-0" LENGTH
 NOTE: NO SEISMIC AND/OR THERMAL EXPANSION JOINTS REQUIRED ALONG THE LENGTH OF THE STRUCTURES. (ALL JOINTS ARE INTERNAL)

OCCUPANCY AND BUILDING AREA EXAMPLES:
 ALL STRUCTURES SHALL BE BASED ON RISK CATEGORY II STRUCTURE.
 A OCCUPANCY:
 EXAMPLE 1:
 STRUCTURES LOCATED OVER LUNCH AREA WITHOUT FIXED SEATING
 OCCUPANCY: A-2
 OCCUPANCY LOAD: 15 sf/person - MAX 300 FOR RISK II
 MAX SQ FT: 4,500 sq ft
 EXAMPLE 2:
 STRUCTURES LOCATED OVER LUNCH AREA WITH FIXED SEATING
 OCCUPANCY: A-2
 OCCUPANCY LOAD: 18"/person ALONG LINEAR BENCH - MAX 300 FOR RISK II
 MAX SQ FT: 5,400 LINEAR INCHES OF FIXED SEATING UNDER THE STRUCTURE
 EXAMPLE 3:
 STRUCTURES LOCATED OVER AN AREA DESIGNATED FOR ASSEMBLY (TYPICALLY AMPHITHEATER, OR OTHER SPACE WITH FIXED SEATING OR DESIGNATED AS A STANDING ASSEMBLY AREA)
 OCCUPANCY: A
 OCCUPANCY LOAD: 7 sf/person - MAX 300 FOR RISK II
 MAX SQ FT: 2,100 sq ft
 SHADE STRUCTURE
 EXAMPLE 1:
 STRUCTURES LOCATED OVER A FIELD, BLACKTOP, PLAYGROUND EQUIPMENT,OR OTHER NON DESIGNATED USE SPACES
 OCCUPANCY: E
 OCCUPANCY LOAD: 20 sf/person - MAX 250 FOR RISK II
 MAX SQ FT: 5,000 sq ft
 PARKING
 EXAMPLE 1:
 STRUCTURES LOCATED OVER PARKING
 OCCUPANCY: S-2
 OCCUPANCY LOAD: 200 sf/person
 MAX SQ FT: UNLIMITED PER CBC 406.5.4 AND 406.5.5

CODES

- TITLE 24, CCR CODES:
- 2016 CALIFORNIA ADMINISTRATIVE CODE (CAC) (PART 1, TITLE 24, CCR)
 - 2016 CALIFORNIA BUILDING CODE (CBC), VOLUMES 1 AND 2 (PART 2, TITLE 24, CCR) (2015 INTERNATIONAL BUILDING CODE WITH 2016 CALIFORNIA AMENDMENTS)
 - 2016 CALIFORNIA ELECTRICAL CODE (PART 3, TITLE 24, CCR) (2014 NATIONAL ELECTRICAL CODE WITH 2016 CALIFORNIA AMENDMENTS)
 - 2016 CALIFORNIA MECHANICAL CODE (CMC) (PART 4, TITLE 24, CCR) (2015 UNIFORM MECHANICAL CODE WITH 2016 CALIFORNIA AMENDMENTS)
 - 2016 CALIFORNIA PLUMBING CODE (CPC) (PART 5, TITLE 24, CCR) (2015 UNIFORM PLUMBING CODE WITH 2016 CALIFORNIA AMENDMENTS)
 - 2016 CALIFORNIA ENERGY CODE (PART 6, TITLE 24, CCR) (2016 EDITION CALIFORNIA ENERGY COMMISSION BUILDING ENERGY EFFICIENCY STANDARDS)
 - 2016 CALIFORNIA FIRE CODE (CFC) (PART 9, TITLE 24, CCR) (2015 INTERNATIONAL FIRE CODE WITH 2016 CALIFORNIA AMENDMENTS)
 - 2016 CALIFORNIA GREEN BUILDING STANDARDS CODE (PART 11, TITLE 24, CCR)
 - 2016 CALIFORNIA REFERENCED STANDARDS CODE (PART 12, TITLE 24, CCR) NFPA 13 - 2016 NFPA 72 - 2016
- REFERENCE CODE SECTIONS FOR APPLICABLE STANDARDS:
 2016 CBC, CHAPTER 35
 2016 CFC, CHAPTER 80

FIRE LIFE SAFETY

AUTOMATIC FIRE SPRINKLERS REQUIRED? (Y/N)..... N

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP: 01-118969 INC:
 REVIEWED FOR
 SS FLS ACS
 DATE: 09/16/2020

ENGINEER'S APPROVAL

DATE SIGNED
 11/28/2018

SITE SPECIFIC DSA APPROVAL

FILE NUMBER: PC-119
 IDENTIFICATION STAMP
 DIVISION OF THE STATE ARCHITECT
 APP. NO: 04 - 117117 INCR
 AC DF FLS DS SS DP
 DATE 12/05/2018

PRE-CHECK (PC) DOCUMENT
 CODE: 2016 CBC
 A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED

MBARC CONSTRUCTION INC.
 674 RANCHEROS DR
 SAN MARCOS, CA 92069
 PHONE: (760) 744-4131
 FAX: (760) 744-4449
 GREGJ@MBARCONLINE.COM (775) 787-8845


ASTEL ENGINEERING
 STRUCTURAL ENGINEERING
 26030 ACHERO, SUITE 200
 MISSION VIEJO, CA 92691
 PHONE: (949) 305-1150
 FAX: (949) 305-1420

VERSA CANOPY GENERAL DATA

DRAWN GM
 CHECKED KS
 DATE 11/28/2018
 4STEL JOB NO. MC03-01
 SHEET S-2
 2 OF 13 SHEETS

SOILS NOTES

- IF NO GEOTECHNICAL REPORT IS SUPPLIED AT THE TIME OF DSA REVIEW ADDRESSING SITE-SPECIFIC PARAMETERS, FOUNDATION SELECTIONS SHALL BE BASED ON CLASS W SOILS (SOIL CLASS 5 OF CBC TABLE 1806A.2 WITH DOUBLING OF LATERAL BEARING PRESSURE FOR STRUCTURES NOT ADVERSELY AFFECTED BY 1/2" MOTION AT GROUND SURFACE) IN THE SOIL CLASS TABLE BELOW.
- WHEN A GEOTECHNICAL REPORT IS SUPPLIED THE GEOTECHNICAL ENGINEER SHALL REVIEW THE SITE CONDITIONS, TESTING RESULTS, AND ALL ALLOWABLE INCREASES AND SUPPLY THE FINAL SOIL CLASS TO BE USED FROM THE BELOW TABLE. THE GEOTECHNICAL ENGINEER SHALL PROVIDE IN THE GEOTECHNICAL REPORT THE FOLLOWING BASE VALUES WITHOUT INCREASE FOR 24" DIAMETER PIERS: THE ALLOWABLE VERTICAL END BEARING, ALLOWABLE LATERAL BEARING, ALLOWABLE DOWNWARD SKIN FRICTION, ALLOWABLE SKIN FRICTION TO RESIST UPLIFT. THE GEOTECHNICAL ENGINEER SHALL ALSO PROVIDE ANY ALLOWABLE INCREASES TO THE BASE VALUES. ALLOWABLE INCREASES ARE TYPICALLY DUE TO BUT NOT EXCLUSIVE TO: DOUBLE VALUES DUE TO ISOLATED FOUNDATIONS, DOUBLE VALUES DUE TO THE STRUCTURE NOT BEING ADVERSELY AFFECTED BY 1/2" DEFLECTION AT THE SURFACE, A 4/3 INCREASE DUE TO SHORT TERM LOADING, AND ANY OTHER ALLOWABLE INCREASES. THE GEOTECHNICAL ENGINEER SHALL MAKE RECOMMENDATION OF THE SOIL CLASS TO BE USED AFTER ALL INCREASES HAVE BEEN APPLIED. ALL FOUNDATIONS HAVE BEEN DESIGN BASED ON THE VALUES PRESENTED IN THE BELOW TABLE. THE GEOTECHNICAL REPORT SHALL ADDRESS IF THE USE OF STEEL CASING THAT IS TWISTED INTO PLACE AND LEFT INSTALLED AFFECTS ANY ALLOWABLE VALUES.
- THE GEOTECHNICAL ENGINEER MAY SPECIFY DIFFERENT SOILS CLASSES TO BE USED FOR THE DIFFERENT STRUCTURE TYPES (VC14 OR VC20), DIFFERENT AREAS OF THE SITE (I.E. NORTH LOT OR WEST LOT), OR THE ENGINEER MAY SPECIFY ONE SOILS CLASS TO BE USED FOR THE ENTIRE SITE.
- THE GEOTECHNICAL ENGINEER SHALL ADDRESS IN THE REPORT ANY CONCRETE DURABILITY REQUIREMENTS IN ACCORDANCE WITH ACI 318-11 CHAPTER 4.
- THE GEOTECHNICAL REPORT SHALL BE SPECIFIC TO THE LOCATION OF THE STRUCTURES. BORING(S) SHALL BE DONE AT THE SPECIFIC LOCATION(S) WHERE THE STRUCTURES ARE TO OCCUR. THE GEOTECHNICAL REPORT SHALL CONFORM TO 2016 CBC SECTION 1803A.
- A COPY OF THE GEOTECHNICAL REPORT SHALL BE PROVIDED AT THE TIME OF PLAN REVIEW.
- AT THE TIME OF PLAN REVIEW, THE DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE SHALL SELECT A SOILS CLASS ON THE SITE-SPECIFIC PLANS BASED ON THE GEOTECHNICAL REPORT (OR NOTE 1 ABOVE). HOLES MAY BE LEFT OPEN FOR ANY AMOUNT OF TIME AS LONG AS THEY ARE PROPERLY COVERED FOR OSHA STANDARDS.
- FOUNDATIONS ADJACENT TO SLOPED GROUND SURFACES SHALL BE SET BACK PER THE FOLLOWING FIGURE UNLESS OTHERWISE RECOMMENDED BY A SITE SPECIFIC GEOTECHNICAL REPORT.

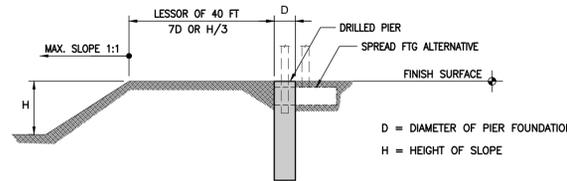

DESIGN SOIL VERTICAL AND LATERAL BEARING VALUES					
SOIL CLASS	VERTICAL BEARING PRESSURE (psf)	LATERAL BEARING PRESSURE (psf/ft)	MAXIMUM LATERAL BEARING (psf)	MIN. DOWNWARD SKIN FRICTION (psf)	MIN. UPWARD SKIN FRICTION (psf)
CLASS Y	1,500	150	2,000	175	50
CLASS W	1,500	267	4,000	225	50
CLASS X	2,000	400	6,000	250	75
CLASS Y	2,000	533	8,000	275	75
CLASS 7	3,000	800	12,000	325	100

SPECIAL INSPECTION

- SOILS:
 - VERIFY THE SITE HAS BEEN PREPARED PROPERLY PRIOR TO PLACEMENT OF CONTROLLED FILL AND/OR EXCAVATIONS FOR FOUNDATIONS.
 - VERIFY THAT THE FOUNDATION EXCAVATIONS ARE EXTENDED TO PROPER DEPTH AND HAVE REACHED PROPER MATERIAL.
 - VERIFY THAT MATERIALS BELOW FOOTINGS ARE ADEQUATE TO ACHIEVE THE DESIGN BEARING CAPACITY.
- PIER FOUNDATIONS:
 - INSPECT DRILLING OPERATIONS AND MAINTAIN COMPLETE AND ACCURATE RECORDS FOR EACH PIER.
 - VERIFY LOCATIONS OF PIERS.
- CONCRETE:
 - VERIFY USE OF REQUIRED DESIGN MIX, DETERMINE THE TEMPERATURE OF THE CONCRETE, AND (WHERE REQUIRED) PERFORM AIR CONTENT TEST.
 - TEST CONCRETE (COMPRESSION TEST).
 - INSPECT PLACEMENT OF FORMWORK, REINFORCING STEEL, EMBEDDED ITEMS, AND CONCRETE. INSPECT CURING AND FORM REMOVAL.
 - SLUMP TEST SHALL BE PERFORMED PER SITE SPECIFIC DSA-103.
- STEEL:
 - VERIFY THAT ALL MATERIALS ARE APPROPRIATELY MARKED AND THAT:
 - MILL CERTIFICATES INDICATE MATERIAL PROPERTIES THAT COMPLY WITH REQUIREMENTS.
 - MATERIAL SIZES, TYPES AND GRADES COMPLY WITH REQUIREMENTS.
 - TEST UNIDENTIFIED MATERIALS.
 - VERIFY MEMBER LOCATIONS, BRACING AND ALL DETAILS CONSTRUCTED IN THE FIELD.
 - VERIFY STIFFENER LOCATIONS, CONNECTION TAB LOCATIONS, AND ALL CONSTRUCTION DETAILS FABRICATED IN THE SHOP.
 - HIGH STRENGTH SLIP CRITICAL BOLTING.
- SHOP FABRICATION:
 - VERIFY FABRICATOR'S FABRICATION AND QUALITY CONTROL PROCEDURES.
 - VERIFY ALL ASPECTS OF SHOP FABRICATION INCLUDING MEMBER LOCATIONS, DIMENSIONAL LAYOUT OF ALL PARTS AND PIECES, BOLTING, ETC.
- SEE DSA APPROVED 103 FOR ADDITIONAL REQUIREMENTS.

GENERAL NOTES

- DESIGN PER 2016 C.B.C. AND ITS PRESCRIBED LOADING AND MATERIAL SPECIFICATIONS:
 - ASCE 7-10
 - 14TH EDITION AISC STEEL CONSTRUCTION MANUAL
 - 2012 AISI COLD FORMED STEEL STANDARD
 - ACI 318-14
- THESE STRUCTURES ARE NOT DESIGNED TO BE, NOR SHALL THEY BE, ENCLOSED.
- ALL DIMENSIONS, CONDITIONS, AND ELEVATIONS ARE TO BE FIELD VERIFIED BY THE CONTRACTOR PRIOR TO COMMENCING WORK OR FABRICATION. IF ANY DISCREPANCIES ARE FOUND OR IF ANY CONDITION EXISTS NOT AS SHOWN ON THE DRAWINGS THE DESIGN PROFESSIONAL IN RESPONSIBLE CHARGE SHALL BE NOTIFIED IMMEDIATELY.
- IF THE SNOW LOAD OPTION IS USED THEN THE SITE-SPECIFIC MAX GROUND SNOW LOADING INCLUDING DRIFT MUST BE LESS THAN OR EQUAL TO 20 PSF.
- ALL SCREWS TO BE ITW BUILD EX TEK SCREWS PER ICC ESR-1976 OR ELCO DRILL SCREW PER ICC ESR-3294.
- OWNER TO SIGN AUTHORIZATION TO PROCEED PRIOR TO DRILLING.



674 Rancheros Drive
San Marcos, CA 92069
PH: 760.744.4131
FAX: 760.744.4449
CA LIC #869980

Authorization to Proceed

Project Name: _____ Foreman: _____
Site Name: _____ Contractor: _____

As an authorized representative of Contractor listed above, I, _____ agree to the following statements below:

_____(initial) LAYOUT: The onsite layout for installation of structural steel for carports and canopies has been inspected and is approved as is.

_____(initial) ARRAY ORIENTATION/CONCRETE POUR: The tilt and direction of the canopies have been verified and are approved as is.

ARRAYS:

It is understood that additional costs will apply due to the following delays: re-layout not due to M Bar C, underground site conflicts (unmarked utility lines, including but not limited to water, sewer, fire, irrigation, electrical); encountered underground water; change in soils condition, including but not limited to hard drilling, caving soils, obstructions).

BY: _____ DATE: _____
(signature)

www.mbaronline.com

STEEL NOTES

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 01-118969 INC:
REVIEWED FOR
SS FLS ACS
DATE: 09/16/2020

ENGINEER'S APPROVAL



DATE SIGNED
11/28/2018

SITE SPECIFIC
DSA APPROVAL

FILE NUMBER: PC-119
IDENTIFICATION STAMP
DIVISION OF THE STATE ARCHITECT
APP. NO: 04 - 117117 INCR
AC DF _____ FLS _____ SS _____
DATE 12/05/2018
PRE-CHECK (PC) DOCUMENT
CODE: 2016 CBC
A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED

- COLD FORMED STEEL SIZES ARE BASED ON BARE STEEL THICKNESS.
- STRUCTURAL PURLIN, BEAM & COLUMN MEMBERS SHALL HAVE MINIMUM STEEL YIELD STRENGTH AS SHOWN ON DRAWINGS.
- STRUCTURAL STEEL SHALL BE HOT-DIP GALVANIZED (MINIMUM ASTM A123 OR A153, CLASS 1) WITH ZINC-RICH PRIMER, UNDERCOAT, AND FINISH COAT; OR EQUIVALENT PAINT SYSTEM. COLD FORMED STEEL MEMBERS SHALL BE 55% ALUMINUM-ZINC ALLOY COATED PER ASTM A792/A792M STANDARD IN ACCORDANCE TO AISI S200 TABLE A4-1, CP 90 COATING DESIGNATION.
- ALL EXPOSED STEEL FASTENERS, INCLUDING CAST IN PLACE ANCHOR BOLTS/RODS, SHALL BE STAINLESS STEEL (TYPE 304 MINIMUM), HOT-DIP GALVANIZED (ASTM A153, CLASS D MINIMUM OR ASTM F2329), OR PROTECTED WITH CORROSION-PREVENTIVE COATING THAT DEMONSTRATED NO MORE THAN 2% OF RED RUST IN MINIMUM 1,000 HOURS OF EXPOSURE IN SALT SPRAY TEST PER ASTM B117. ZINC-PLATED FASTENERS DO NOT COMPLY WITH THIS REQUIREMENT. (EXAMPLE PROPRIETARY COATINGS THAT COMPLY WITH THE 1000 HOUR REQUIREMENT INCLUDE BUT ARE NOT NECESSARILY LIMITED TO: QUIK GUARD BY SIMPSON, KWIK-COTE BY HILTI, STALGARD BY ELOCO, VISTA-CORR BY SFS INTEC, ETC.)
- STEEL FABRICATION SHALL COMPLY WITH LATEST AISC SPECIFICATIONS.
- HOLLOW STRUCTURAL STEEL (HSS) MEMBERS SHALL BE ASTM A1085 GR. 50 U.N.O. ASTM A1085 STEEL HAS THE SAME OR BETTER PROPERTIES AND WELDABILITY THAN ASTM A500 GR. B.
- COLD FORMED STEEL (CFS) MEMBERS SHALL BE ASTM A653 SS GR. 55 (F_y = 55 ksi, F_u = 70 ksi) OR ASTM A1011 SS GR. 55 (F_y = 55 ksi, F_u = 70 ksi).
- ZINC COATING OF STRUCTURAL STEEL SHALL CONFORM WITH G90 STANDARD OR BETTER. COLD FORMED STEEL (CFS) MEMBERS TO BE GALVANIZED IN ACCORDANCE WITH ASTM A653 G90 STANDARD. HOLLOW STRUCTURAL STEEL (HSS) MEMBERS SHALL BE GALVANIZED IN ACCORDANCE WITH ASTM A123, UNLESS NOTED OTHERWISE.
- ALL STEEL MEMBERS TO BE GALVANIZED OR PAINTED WITH ZINC-RICH PRIMER, UNDERCOAT AND FINISH COAT OR EQUIVALENT PAINT SYSTEM. CONTRACT DOCUMENTS SHALL SPECIFY THE TYPE OF SSPC CORROSION RESISTING SYSTEM TO BE UTILIZED AND THE SSPC GRADE FOR CLEANING, MINIMUM SSPC GRADE SP2.
- BOLTS SHALL CONFORM TO THE ASTM A307 SPECIFICATIONS UNLESS NOTED OTHERWISE. INSPECTION OF A307 BOLTING IS NOT REQUIRED.
- ASTM A307 BOLTS MAY BE SUBSTITUTED WITH THE SAME NUMBER AND SIZE OF SAE J429 GRADE 2 BOLTS.
- BOLTS SHALL BE TIGHTENED TO SNUG-TIGHT CONDITION UNLESS NOTED OTHERWISE EXCEPT FOR A325-SC HIGH STRENGTH BOLTS USED IN THE BEAM TO COLUMN CONNECTION.
- A325-SC BOLTS SHALL BE PRE-TENSIONED PER AISC SPECIFICATIONS USING APPROVED LOAD INDICATOR METHODS INCLUDING BUT NOT LIMITED TO TURN-OF-THE-NUT WITH MATCH MARKING, TWIST OFF TENSION CONTROL OR DIRECT TENSION INDICATOR BOLT, NUT AND WASHER ASSEMBLIES.
- ASTM A307 BOLTS SHALL HAVE STANDARD WASHERS UNDER THE NUT & BOLT HEAD (F436 WASHERS ARE NOT REQUIRED). STANDARD WASHERS DO NOT REQUIRE HARDNESS TEST.
- BOLT HOLES FOR 1/2" BOLTS SHALL BE AS FOLLOWS:
STANDARD HOLES: 3/8"

CONCRETE NOTES

- CONCRETE MIN. 4,500 PSI AT 28 DAYS UNLESS A SOILS REPORT IS PROVIDED THAT ALLOWS FOR A LOWER STRENGTH (3,000 PSI MIN.). BATCH PLANT INSPECTION NOT REQUIRED.
- CONCRETE SHALL MEET THE FOLLOWING MINIMUM REQUIREMENTS BASED ON EXPOSURE CLASS IN ACCORDANCE WITH ACI 318-14 TABLE 19.3.2.1 WHEN DETERMINED BY A SITE-SPECIFIC GEOTECHNICAL REPORT.

REQUIREMENTS FOR CONCRETE BASED ON EXPOSURE CLASS			
EXPOSURE CLASS ACI TABLE 19.3.2.1	MINIMUM CONCRETE STRENGTH F _c	CEMENT TYPE ASTM C150	MAX. WATER/CEMENT RATIO W/M
NOT DETERMINED	4,500 PSI	TYPE IV	0.45
FO, SO, PO, CO, C1	3,000 PSI	TYPE II	N/A
S1, P1	4,000 PSI	TYPE II	0.50
ALL OTHER	4,500 PSI	TYPE V	0.45

- CONCRETE EXPOSED TO THAW AND FREEZE CYCLE SHALL BE AIR ENTRAINED PER ACI 318-14 TABLE 19.3.1.1.
- CONCRETE TO ATTAIN 1000 PSI PRIOR TO REMOVAL OF SHORING AND/OR INSTALLATION OF BEAMS AND PURLINS. (NOTE: A HIGHER COMPRESSIVE CONCRETE MAY BE USED TO ACHIEVE 1000 PSI SOONER. SUBMIT CONCRETE MIX DESIGN PREPARED BY A QUALIFIED LICENSED PROFESSIONAL ENGINEER FOR APPROVAL BY THE DESIGN PROFESSIONAL IN RESPONSIBLE CHARGE PRIOR TO BEING PLACED.)
- CONCRETE TO REACH 3000 PSI PRIOR TO INSTALLATION OF ROOF DECK. (NOTE: A HIGHER COMPRESSIVE CONCRETE MAY BE USED TO ACHIEVE 3000 PSI SOONER. SUBMIT CONCRETE MIX DESIGN PREPARED BY A QUALIFIED LICENSED PROFESSIONAL ENGINEER FOR APPROVAL BY THE DESIGN PROFESSIONAL IN RESPONSIBLE CHARGE PRIOR TO BEING PLACED.)
- REINFORCEMENT BARS SHALL BE ASTM A615, GR60 TYPICAL, U.N.O.
- MINIMUM CONCRETE COVER SHALL BE 2 1/2" TO EARTH (DRILLED PIER FOUNDATIONS ONLY), 3" TO EARTH ALL OTHER CONCRETE, 2" TO EXPOSED SURFACES PER CBC TABLE 1808A.8.2
- ALL REINFORCING STEEL AND OTHER EMBEDDED ITEMS SHALL BE SECURELY POSITIONED PRIOR TO THE POURING OF CONCRETE.
- ALL CONCRETE WORK SHALL COMPLY WITH ACI 301 & 318 STANDARDS.
- AGGREGATE GRADATION AND QUALITY SHALL BE IN ACCORDANCE WITH ACI 302-R.
- COLD JOINTS SHALL HAVE A ROUGHENED SURFACE. BONDING AGENT SHALL COMPLY WITH ASTM C1059. A SUBMITTAL FOR CONCRETE BONDING AGENT SHALL BE APPROVED BY DESIGN PROFESSIONAL IN RESPONSIBLE CHARGE PRIOR TO INSTALLATION. DSA INSPECTOR OF RECORD TO PERIODICALLY INSPECT INSTALLATION OF BONDING AGENT.
- BATCH PLANT INSPECTION NOT REQUIRED PER CBC 1705A3.3.2. SUBJECT TO:
 - A LICENSED WEIGHMASTER SHALL POSITIVELY IDENTIFY QUANTITY OF MATERIALS AND CERTIFY EACH LOAD BY A BATCH TICKET.
 - BATCH TICKETS, INCLUDING MATERIAL QUANTITIES AND WEIGHTS SHALL ACCOMPANY THE LOAD, SHALL BE TRANSMITTED TO THE INSPECTOR OF RECORD BY THE TRUCK DRIVER WITH LOAD IDENTIFIED THEREON. THE LOAD SHALL NOT BE PLACED WITHOUT A BATCH TICKET IDENTIFYING THE MIX. THE INSPECTOR OF RECORD SHALL KEEP A DAILY RECORD OF PLACEMENTS, IDENTIFYING EACH TRUCK, ITS LOAD, AND TIME OF RECEIPT AT THE JOBSITE, AND APPROXIMATE LOCATION OF DEPOSIT IN THE STRUCTURE AND SHALL MAINTAIN A COPY OF THE DAILY RECORD AS REQUIRED BY THE ENFORCEMENT AGENCY.
- CONCRETE MAY BE PUMPED, POURED, TAILGATED, OR OTHER SUCH METHODS INTO PLACE. CONCRETE SHALL BE ALLOWED TO FREE FALL THE ENTIRE DEPTH OF THE FOUNDATION. PLACEMENT OF ANY FREE-FALL CONCRETE SHALL BE SUCH THAT THE CONCRETE DOES NOT ALTER THE EMBEDMENT DEPTH OR THE CLEARANCE OF THE REINFORCING BAR CAGE OR OTHER EMBEDDED MATERIALS.


MBARC CONSTRUCTION INC.
674 RANCHEROS DR SAN MARCOS, CA 92069
PHONE: (760) 744-4131
FAX: (760) 744-4449
GREGJ@MBARCONLINE.COM (775) 787-8845

ASTEL ENGINEERING STRUCTURAL ENGINEERING
26030 ACHERO, SUITE 200 MISSION VIEJO, CA 92691
PHONE: (949) 305-1150
FAX: (949) 305-1420

VERSACANOPY GENERAL NOTES

DRAWN GM
CHECKED KS
DATE 11/28/2018
4STEL JOB NO. MC03-01
SHEET S-3
3 OF 13 SHEETS

ROOF DECK SPECIFICATIONS						
SECTION PROPERTIES			TOP IN COMPRESSION		BOTTOM IN COMPRESSION	
GA	F _y (ksi)	WEIGHT (psf)	k _t (in. ² /ft.)	S _x (in. ³ /ft.)	k _b (in. ² /ft.)	S _y (in. ³ /ft.)
26	80	0.89	0.0840	0.0762	0.0817	0.0623

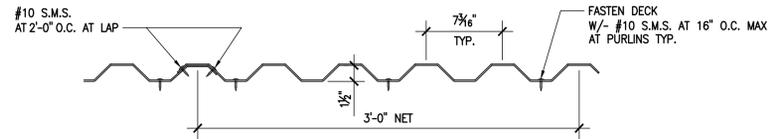


NOTES:

1. MATERIAL AND SECTION PROPERTIES LISTED ABOVE ARE MINIMUM REQUIRED VALUES FOR METAL DECK BASED ON AEP HR-36 26 GA.
2. METAL ROOF DECK SHALL BE CLASS A PER CBC CHAPTERS 7A AND 15.

3 DECK DETAIL

N.T.S.

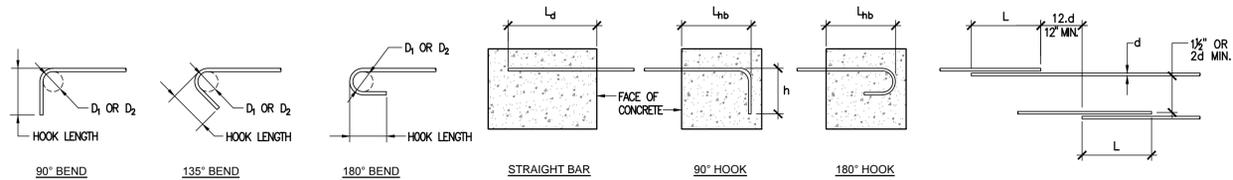

BAR SIZE	D ₁	D ₂
#3	1 1/2"	2 1/4"
#4	2"	3"
#5	2 1/2"	3 3/4"
#6, #7, #8	6"	6"

D₁ - FINISHED BEND DIA. FOR STIRRUP & TIE HOOKS.
D₂ - BEND DIA. FOR STD HOOKS.
d' - BAR DIAMETER

BAR SIZE	MAIN REINFT.		STIRRUP & TIE HOOKS	
	90°	180°	90°	180°
#3	6"	4"	3 1/2"	4 1/2"
#4	8"	4 1/2"	4 1/2"	4 1/2"
#5	10"	5"	5"	6"
#6	12"	6"	12"	7 1/2"
#7	14"	7"	14"	9"
#8	16"	8"	16"	10"

REINFORCEMENT DEVELOPMENT LENGTHS				
CONCRETE STRENGTH				
F _c = 3,000 PSI				
NOMINAL BAR SIZE	h	L _d		L _{hb}
		TOP BARS	OTHER BARS	
#3	6"	1'-10"	1'-5"	9"
#4	8"	2'-5"	1'-10"	11"
#5	10"	3'-0"	2'-4"	1'-2"
#6	12"	3'-7"	2'-9"	1'-5"
#7	14"	5'-3"	4'-0"	1'-7"
#8	16"	6'-0"	4'-7"	1'-10"

- NOTES:**
1. TOP BARS ARE HORIZONTAL BARS WITH MORE THAN 12 INCHES OF CONCRETE CAST BELOW.

REINFORCEMENT LAP SPLICE LENGTH 'L'		
CONCRETE STRENGTH		
F _c = 3,000 PSI		
NOMINAL BAR SIZE	TOP BARS	
	OTHER BARS	OTHER BARS
#3	2'-4"	1'-10"
#4	3'-2"	2'-5"
#5	3'-11"	3'-0"
#6	4'-8"	3'-7"
#7	6'-9"	5'-3"
#8	7'-9"	6'-0"

- NOTES:**
1. LAP SPLICE SHALL BE INCREASED 50% WHERE CLEAR SPACE BETWEEN BARS IS LESS THAN 2 BAR DIAMETERS AND/OR THE CLEAR COVER IS LESS THAN ONE BAR DIAMETER.

A STANDARD HOOKS

B DEVELOPMENT LENGTHS

C OFFSETS AND LAP SPLICES


4 TYPICAL REINFORCEMENT BAR BENDS AND LAPS

N.T.S.

SECTION NAME	D (in)	B (in)	L (in)	GA	WT (lb/ft)	A (in ²)	AXIS X-X			AXIS Y-Y		
							I _x (in ⁴)	S _x (in ³)	r _x (in)	I _y (in ⁴)	S _y (in ³)	r _y (in)
CS12 x 4 x 0.102 (12 GA)	12	4.0	1.0	12	7.35	2.16	46.87	6.76	4.66	4.38	1.53	1.42
CS12 x 4 x 0.124 (10 GA)	12	4.0	1.0	10	8.91	2.62	56.37	8.59	4.64	5.20	1.82	1.41
CS14 x 4 x 0.102 (12 GA)	14	4.0	1.0	12	8.04	2.36	67.42	8.22	5.34	4.57	1.55	1.39

NOTES:

1. ALL PURLIN SECTIONS ARE ASTM A653, GR 55, F_y=55 ksi
2. ALL LIGHT GAGE STEEL DESIGNED USING 2012 AISI COLD-FORMED STEEL DESIGN MANUAL.
3. PROPERTIES PER AEP STANDARD SIZES.
4. ACTUAL MANUFACTURER'S PROPERTIES MUST MEET OR EXCEED AEP STANDARD PROPERTIES.

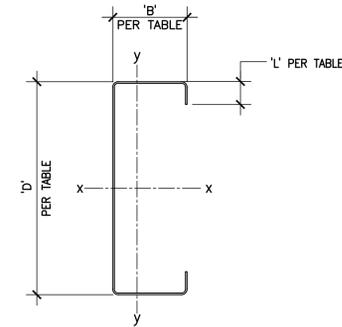


1 PURLIN & BEAM COLD FORMED C-SECTION

N.T.S.

SECTION NAME	D (in)	B (in)	t (in)	WT (lb/ft)	A (in ²)	AXIS X-X			AXIS Y-Y		
						I _x (in ⁴)	S _x (in ³)	r _x (in)	I _y (in ⁴)	S _y (in ³)	r _y (in)
HSS 12 x 6 x 1/4	12	6	1/4	29.23	8.59	161.00	26.80	4.33	55.20	18.40	2.53

NOTES:

1. ALL COLUMNS SHALL BE ASTM A1085 GR. 50 (F_y=50 ksi)

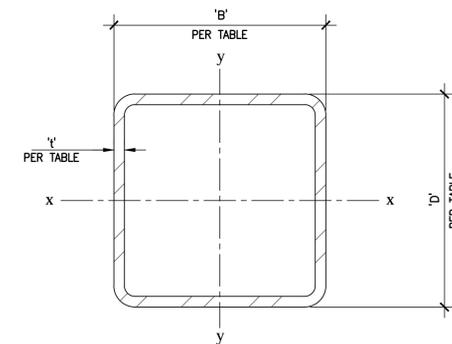

2 HSS COLUMN

N.T.S.

ENGINEER'S APPROVAL
IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 01-118969 INC:
REVIEWED FOR:
SS FLS ACS
DATE: 09/16/2020
5885

DATE SIGNED
11/28/2018

SITE SPECIFIC DSA APPROVAL

FILE NUMBER: PC-119
IDENTIFICATION STAMP
DIVISION OF THE STATE ARCHITECT
APP. NO: 04 - 117117 INCR
AC DF FLS DS SS DP
DATE 12/05/2018

PRE-CHECK (PC) DOCUMENT
CODE: 2016 CBC
A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED


MBARC CONSTRUCTION INC.
PHONE: (760) 744-4131
SAN MARCOS, CA
FAX: (760) 744-4449
GREGJ@MBARCONLINE.COM (775) 787-8845

4STEL ENGINEERING
STRUCTURAL ENGINEERING
PHONE: (949) 305-1150
MISSION VIEJO, CA 92691
FAX: (949) 305-1420


VERSA CANOPY SECTION PROPERTIES & REBAR DETAILS

DRAWN GM
CHECKED KS
DATE 11/28/2018
4STEL JOB NO. MC03-01
SHEET


S-5
5 OF 13 SHEETS

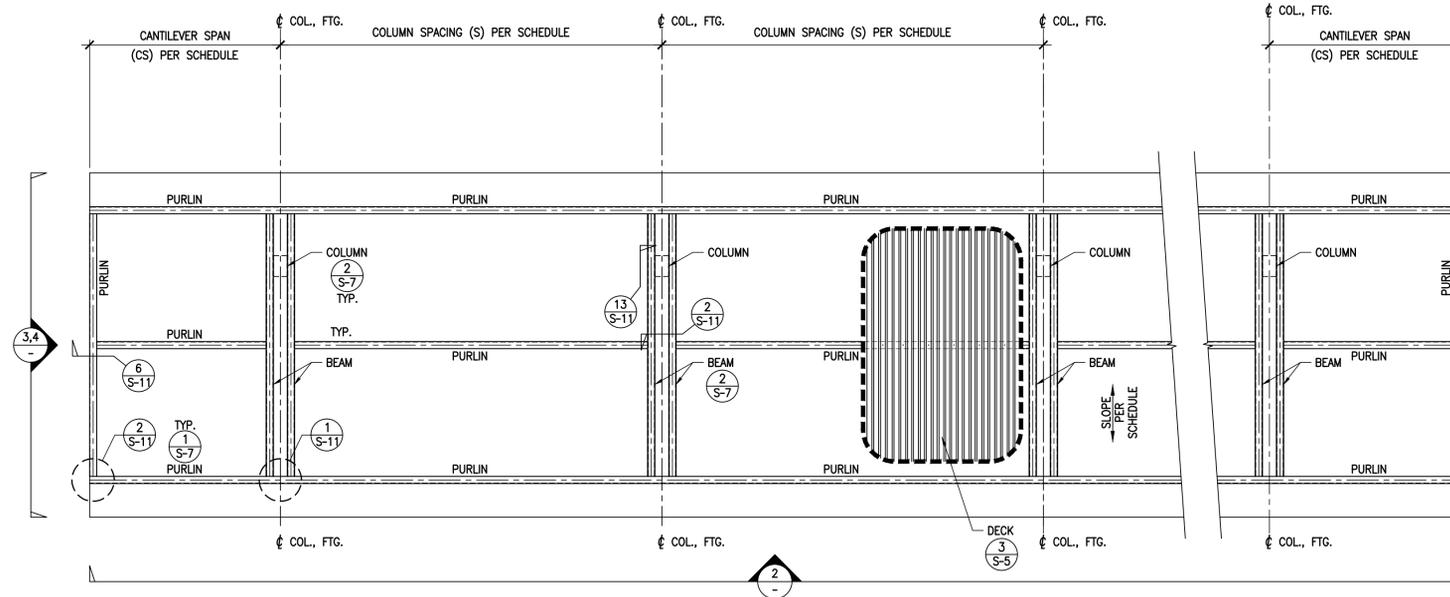


1 VC14, VC18 & VC20
 TYPICAL PLAN VIEW
 1/4"=1'-0"

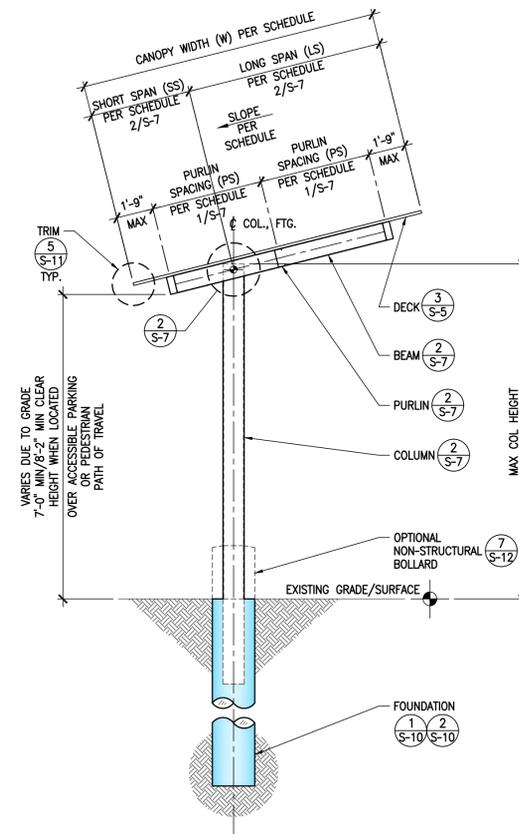

3 VC14, VC18 & VC20
 TYPICAL SIDE ELEVATION 1
 1/4"=1'-0"

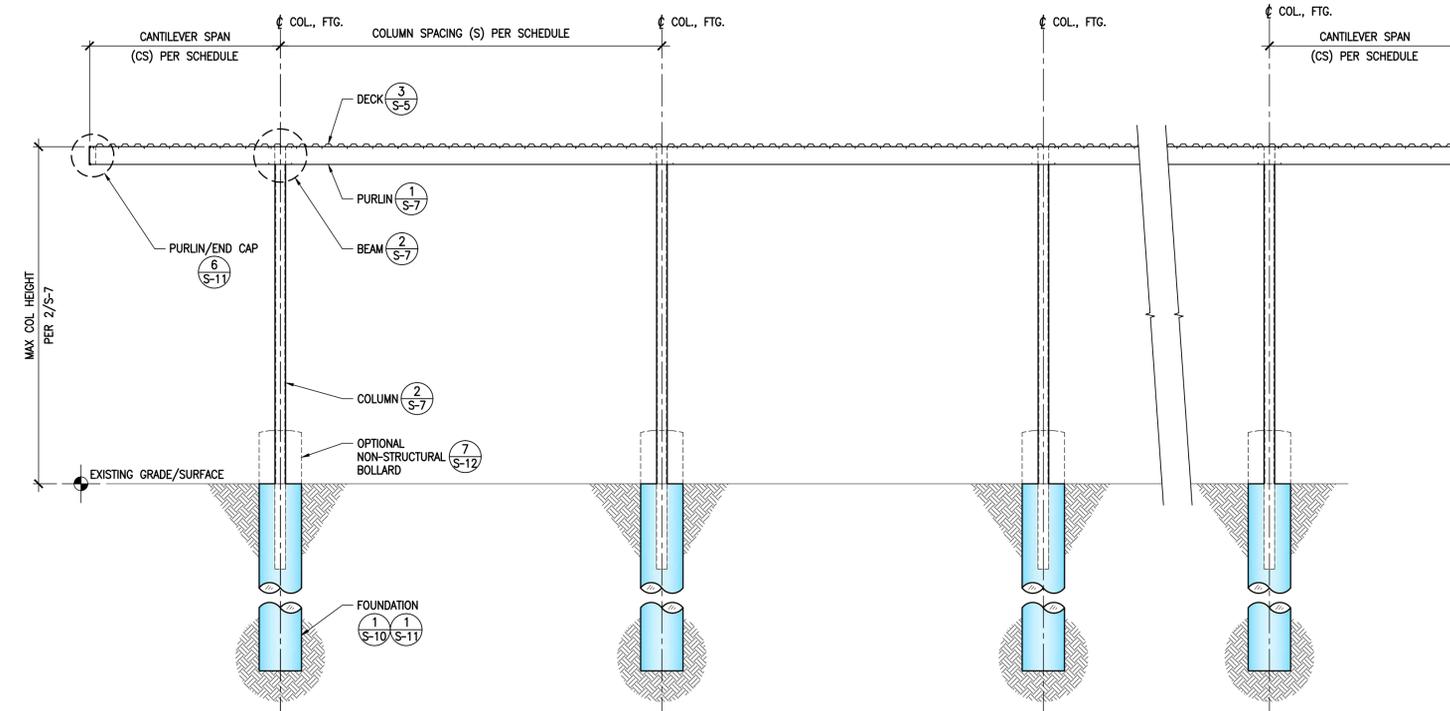

2 VC14, VC18 & VC20
 TYPICAL FRONT ELEVATION
 1/4"=1'-0"

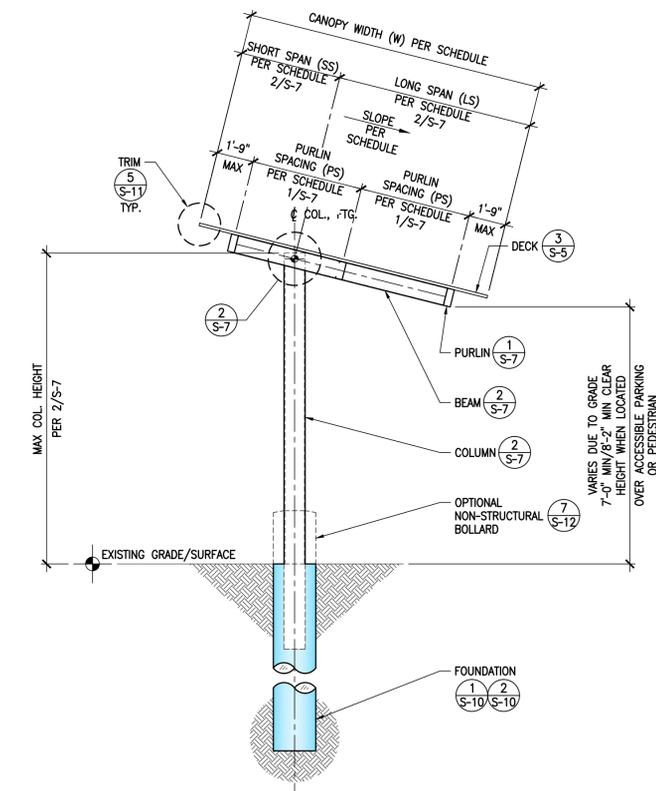

4 VC14, VC18 & VC20
 TYPICAL SIDE ELEVATION 2
 1/4"=1'-0"

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP: 01-118969 INC.
 REVIEWED FOR
 SS FLS ACS
 DATE: 09/16/2020

ENGINEER'S APPROVAL
 DATE SIGNED
 11/28/2018

SITE SPECIFIC DSA APPROVAL

FILE NUMBER: PC-119
 IDENTIFICATION STAMP
 DIVISION OF THE STATE ARCHITECT
 APP. NO: 04 - 117117 INCR
 AC DF FLS DS SS DP
 DATE 12/05/2018
 PRE-CHECK (PC) DOCUMENT
 CODE: 2016 CBC
 A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED

MBARC CONSTRUCTION INC.
 674 RANCHEROS DR
 SAN MARCOS, CA 92069
 PHONE: (760) 744-4131
 FAX: (760) 744-4449
 GREGJ@MBARCONLINE.COM (775) 787-8845

4STEL ENGINEERING
 STRUCTURAL ENGINEERING
 26030 ACHERO, SUITE 200
 MISSION VIEJO, CA 92691
 PHONE: (949) 305-1150
 FAX: (949) 305-1420

VERSA CANOPY VC14, VC18 & VC20 FRAMING PLAN & ELEVATIONS

DRAWN
 GM
 CHECKED
 KS
 DATE
 11/28/2018
 4STEL JOB NO.
 MC03-01
 SHEET
S-6
 6 OF 13 SHEETS

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP: 01-118969 INC:
 REVIEWED FOR
 SS FLS ACS
 DATE: 09/16/2020

ENGINEER'S
 APPROVAL



DATE SIGNED
 11/28/2018

SITE SPECIFIC
 DSA APPROVAL

FILE NUMBER: PC-119
 IDENTIFICATION STAMP
 DIVISION OF THE STATE ARCHITECT
 APP. NO: 04 - 117117 INCR
 AC DF FLS DS SS DP
 DATE 12/05/2018

PRE-CHECK (PC) DOCUMENT
 CODE: 2016 CBC
 A SEPARATE PROJECT APPLICATION FOR
 CONSTRUCTION IS REQUIRED

MBARC CONSTRUCTION INC.
 IIC # 869960
 B AND C51
 PHONE: (760) 744-4131
 (760) 744-4449
 FAX: @MBARCONLINE.COM (775) 787-8845
 674 RANCHEROS DR
 SAN MARCOS, CA
 GREG JONES

4STEL ENGINEERING
 STRUCTURAL ENGINEERING
 PHONE: (949) 305-1150
 26030 A CHERO SUITE 200
 MISSION VIEJO, CA 92691 FAX: (949) 305-1420

VERSA
 CANOPY
 VC14, VC18
 & VC20
 FRAMING
 SCHEDULES

DRAWN
 GM
 CHECKED
 KS
 DATE
 11/28/2018
 4STEL JOB NO.
 MC03-01
 SHEET

S-7

7 OF 13 SHEETS

VC14, VC18 & VC20 PURLIN SCHEDULE

I.D. #	MAX GROUND SNOW LOAD	MAX PURLIN SPACING (PS)	MAX COLUMN SPACING (S)	MAX CANTILEVER SPAN (CS)	PURLIN	
					SECTION	DETAIL
VC14	0 psf	62"	27'-0"	10'-0"	CS12 x 4 x 0.102 (12 GA)	(1) S-5
VC18	0 psf	87"	27'-0"	10'-0"	CS12 x 4 x 0.124 (10 GA)	(1) S-5
VC20	0 psf	99"	19'-0"	8'-0"	CS14 x 4 x 0.102 (12 GA)	(1) S-5

- NOTES:
- REFER TO SHEET 'S-2' FOR CONSTRUCTION OPTIONS.
 - REFER TO DETAIL '4/S-12' FOR ALLOWABLE PURLIN PENETRATIONS.
 - MULTIPLE STRUCTURE ID'S MAY BE SELECTED WITHIN THE SAME SITE.
 - WHEN UTILIZING A STRUCTURE ID READ FROM WITHIN THAT ID'S ROW ONLY.


1 VC14, VC18 & VC20
 - TYPICAL PURLIN SCHEDULE

VC14, VC18 & VC20 BEAM/COLUMN SCHEDULE


I.D. #	MAX GROUND SNOW LOAD	MAX WIDTH (W)	BEAM SHORT SPAN MIN (SS)	BEAM LONG SPAN MAX (LS)	MAX COLUMN SPACING (S)	ROOF SLOPE	BEAM		COLUMN		MAX COLUMN HEIGHT	
							SECTION	DETAIL	SECTION	DETAIL		
							VC14	0 psf	14'-0"	4'-2"		9'-9"
VC18	0 psf	18'-0"	7'-0"	10'-3"	27'-0"	3:12 MAX	CS12 x 4 x 0.102 (12 GA)	(1) S-5	(13) S-11	HSS 12 x 6 x 1/4	(2) S-5	17'-9"
VC20	0 psf	20'-0"	5'-9"	14'-3"	19'-0"	3:12 MAX	CS14 x 4 x 0.124 (10 GA)	(1) S-5	(13) S-11	HSS 12 x 6 x 1/4	(2) S-5	17'-0"

- NOTES:
- MULTIPLE STRUCTURE ID'S MAY BE SELECTED WITHIN THE SAME SITE.
 - WHEN UTILIZING A STRUCTURE ID READ FROM WITHIN THAT ID ROW ONLY.
 - THE SHORT SPAN AND LONG SPANS MAY BE ADJUSTED WITH THE FOLLOWING REQUIREMENT:
 THE OVERALL CANOPY WIDTH IS NOT EXCEEDED, NEITHER SPAN IS LESS THAN THE MIN SHORT SPAN & NEITHER SPAN EXCEEDS THE MAX LONG SPAN.


2 VC14, VC18 & VC20
 - TYPICAL BEAM/COLUMN SCHEDULE

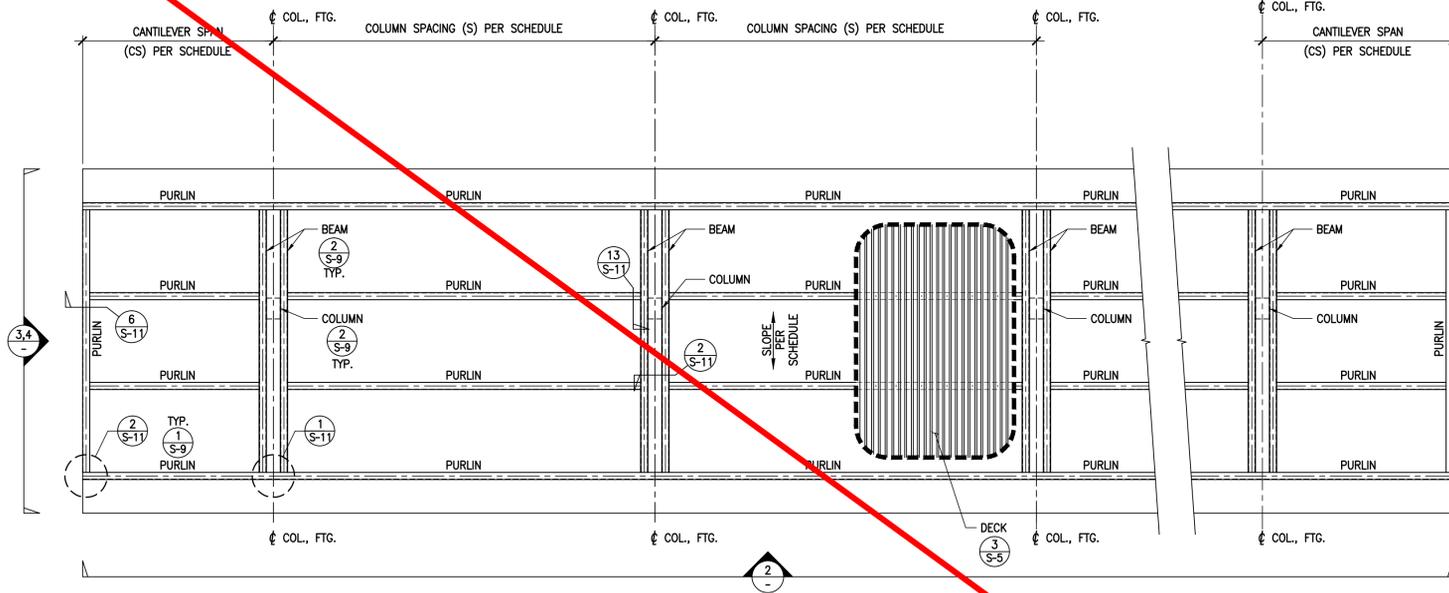


1 VC140, VC180 & VC200
 TYPICAL PLAN VIEW
 1/4"=1'-0"

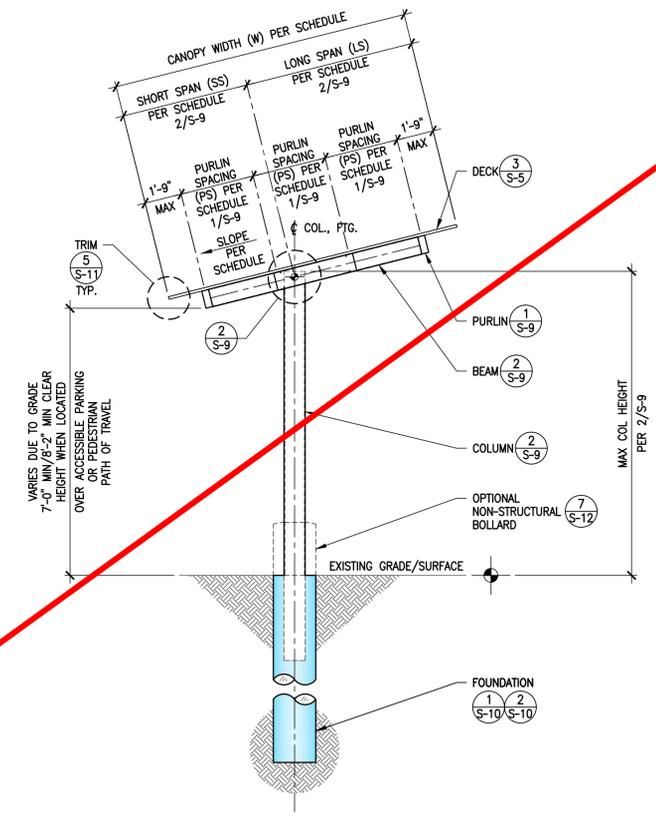

3 VC140, VC180 & VC200
 TYPICAL SIDE ELEVATION 1
 1/4"=1'-0"

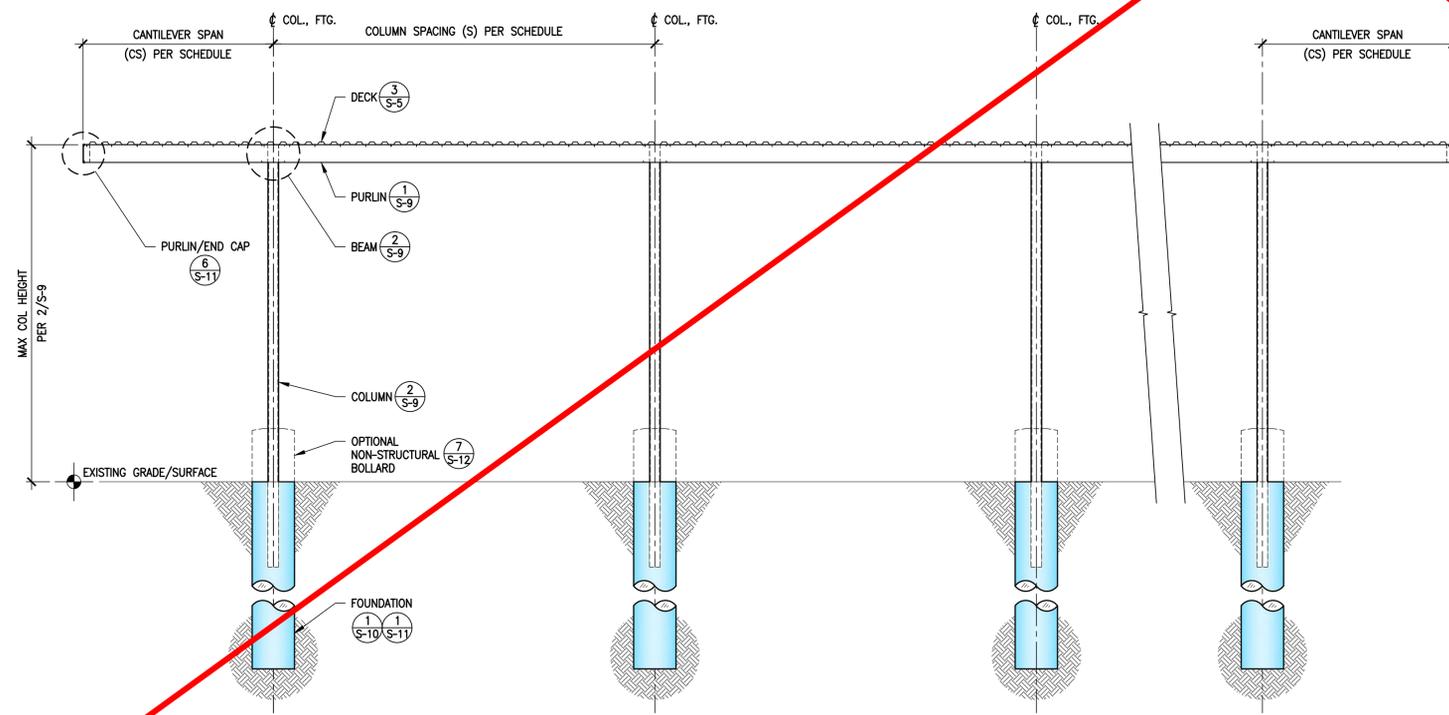

2 VC140, VC180 & VC200
 TYPICAL FRONT ELEVATION
 1/4"=1'-0"

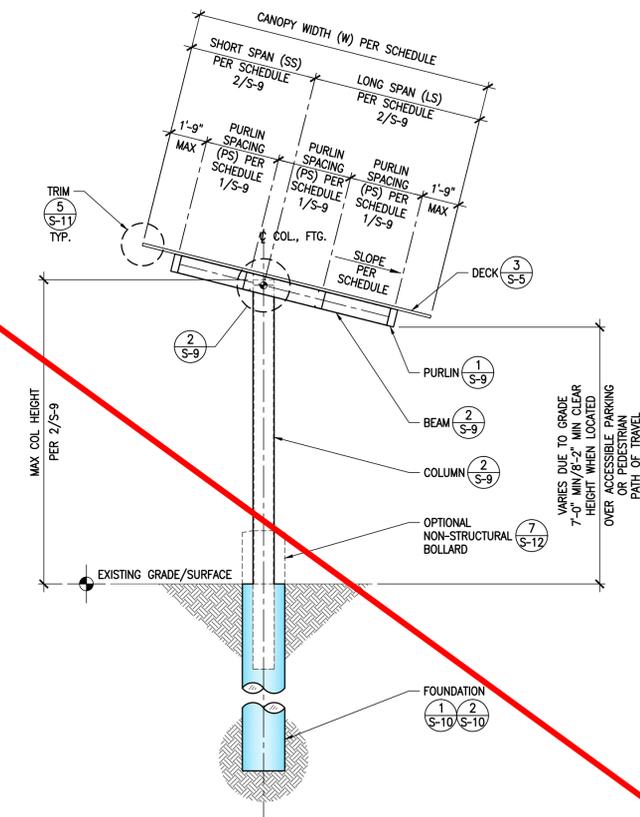

4 VC140, VC180 & VC200
 TYPICAL SIDE ELEVATION 2
 1/4"=1'-0"

ENGINEER'S APPROVAL



DATE SIGNED
 11/28/2018

SITE SPECIFIC
 DSA APPROVAL

FILE NUMBER: PC-119
 IDENTIFICATION STAMP
 DIVISION OF THE STATE ARCHITECT
 APP. NO. 04 - 117117 INCR
 AC DF FLS DS SS DP
 DATE 12/05/2018

PRE-CHECK (PC) DOCUMENT
 CODE: 2016 CBC
 A SEPARATE PROJECT APPLICATION FOR
 CONSTRUCTION IS REQUIRED

MBARC CONSTRUCTION INC.
 IIC # 869980
 B AND C 51
 PHONE: (760) 744-4131
 (760) 744-4449
 FAX: (760) 744-4449
 GREGJ@MBARCONLINE.COM (775) 787-8845
 674 RANCHEROS DR
 SAN MARCOS, CA
 92069
 GREG JONES

4STEL ENGINEERING
 STRUCTURAL ENGINEERING
 26030 ACHERO, SUITE 200
 MISSION VIEJO, CA 92691
 PHONE: (949) 305-1150
 (949) 305-1420
 FAX: (949) 305-1420

VERSA
 CANOPY
 VC140, VC180
 & VC200
 FRAMING PLAN
 & ELEVATIONS

DRAWN
 GM
 CHECKED
 KS
 DATE
 11/28/2018
 4STEL JOB NO.
 MC03-01
 SHEET

S-8

8 OF 13 SHEETS

VC140, VC180 & VC200 PURLIN SCHEDULE

I.D. #	MAX GROUND SNOW LOAD	MAX PURLIN SPACING (PS)	MAX COLUMN SPACING (S)	MAX CANTILEVER SPAN (CS)	PURLIN	
					SECTION	DETAIL
VC140	20 psf	42"	27'-0"	9'-0"	CS12 x 4 x 0.102 (12 GA)	① S-5
VC180	20 psf	58"	27'-0"	8'-6"	CS14 x 4 x 0.102 (12 GA)	① S-5
VC200	20 psf	66"	19'-0"	7'-9"	CS14 x 4 x 0.102 (12 GA)	① S-5

- NOTES:**
- REFER TO SHEET 'S-2' FOR CONSTRUCTION OPTIONS.
 - REFER TO DETAIL '4/S-12' FOR ALLOWABLE PURLIN PENETRATIONS.
 - MULTIPLE STRUCTURE ID'S MAY BE SELECTED WITHIN THE SAME SITE.
 - WHEN UTILIZING A STRUCTURE ID READ FROM WITHIN THAT ID'S ROW ONLY.
 - PURLIN SPACING MAY BE INCREASED BEYOND THE MAXIMUMS GIVEN IN THE CHART ABOVE AS LONG AS THE TRIBUTARY WIDTH TO THE PURLIN DOES NOT EXCEED 'PS'.

1 VC140, VC180 & VC200
- TYPICAL PURLIN SCHEDULE

VC140, VC180 & VC200 BEAM/COLUMN SCHEDULE

I.D. #	MAX GROUND SNOW LOAD	MAX WIDTH (W)	BEAM SHORT SPAN MIN (SS)	BEAM LONG SPAN MAX (LS)	MAX COLUMN SPACING (S)	ROOF SLOPE	BEAM		BEAM TO COLUMN DETAIL	COLUMN		MAX COLUMN HEIGHT
							SECTION	DETAIL		SECTION	DETAIL	
VC140	20 psf	14'-0"	5'-3"	8'-9"	27'-0"	3:12 MAX	CS12 x 4 x 0.102 (12 GA)	① S-5	⑬ S-11	HSS 12 x 6 x 1/4	② S-5	17'-5"
VC180	20 psf	18'-0"	8'-0"	10'-0"	27'-0"	3:12 MAX	CS14 x 4 x 0.102 (12 GA)	① S-5	⑬ S-11	HSS 12 x 6 x 1/4	② S-5	16'-6"
VC200	20 psf	20'-0"	6'-9"	13'-3"	19'-0"	3:12 MAX	CS14 x 4 x 0.124 (10 GA)	① S-5	⑬ S-11	HSS 12 x 6 x 1/4	② S-5	16'-9"

- NOTES:**
- MULTIPLE STRUCTURE ID'S MAY BE SELECTED WITHIN THE SAME SITE.
 - WHEN UTILIZING A STRUCTURE ID READ FROM WITHIN THAT ID ROW ONLY.
 - THE SHORT SPAN AND LONG SPANS MAY BE ADJUSTED WITH THE FOLLOWING REQUIREMENT:
THE OVERALL CANOPY WIDTH IS NOT EXCEEDED, NEITHER SPAN IS LESS THAN THE MIN SHORT SPAN & NEITHER SPAN EXCEEDS THE MAX LONG SPAN.

2 VC140, VC180 & VC200
TYPICAL BEAM/COLUMN SCHEDULE

ENGINEER'S APPROVAL



DATE SIGNED
11/28/2018

SITE SPECIFIC
DSA APPROVAL

FILE NUMBER: PC-119
IDENTIFICATION STAMP
DIVISION OF THE STATE ARCHITECT
APP. NO: 04 - 117117 INCR
AC DF FL DS SS DP
DATE 12/05/2018

PRE-CHECK (PC) DOCUMENT
CODE: 2016 CBC
A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED

MBARC CONSTRUCTION INC.
 674 RANCHEROS DR
 SAN MARCOS, CA 92069
 PHONE: (760) 744-4131
 FAX: (760) 744-4449
 IIC # 869960
 B AND C51
 GREGJ@MBARCONLINE.COM | (775) 787-8845

4STEL ENGINEERING
 STRUCTURAL ENGINEERING
 26030 ACHERO, SUITE 200
 MISSION VIEJO, CA 92691
 PHONE: (949) 305-1150
 FAX: (949) 305-1420

VERSA CANOPY
VC140, VC180 & VC200
FRAMING SCHEDULES

DRAWN GM
CHECKED KS
DATE 11/28/2018
4STEL JOB NO. MC03-01
SHEET

S-9
9 OF 13 SHEETS

NON-CONSTRAINED PIER FOUNDATION SCHEDULE

I.D. #	MAX GROUND SNOW LOAD	FOUNDATION LONGITUDINAL REINFORCEMENT	FOUNDATION DIAMETER (D)	MIN COLUMN EMBEDMENT (CE)	MAX TIE SPACING AT TOP (TS)	FOUNDATION DETAIL	PIER FOUNDATION MINIMUM DEPTH (SEE SOIL NOTES ON S-3)				
							SOIL CLASS V	SOIL CLASS W	SOIL CLASS X	SOIL CLASS Y	SOIL CLASS Z
VC14	0 psf	4 - #8	2'-0"	3'-6"	6"	3	14'-0"	11'-0"	9'-6"	8'-9"	7'-6"
VC18	0 psf	4 - #8	2'-0"	3'-6"	6"	3	14'-9"	11'-6"	10'-0"	9'-0"	8'-0"
VC20	0 psf	4 - #8	2'-0"	3'-6"	6"	3	15'-0"	11'-9"	10'-3"	9'-3"	8'-0"
VC140	20 psf	4 - #8	2'-0"	3'-6"	6"	3	15'-0"	11'-6"	9'-9"	8'-9"	7'-6"
VC180	20 psf	4 - #8	2'-0"	3'-6"	6"	3	15'-3"	11'-9"	10'-0"	9'-0"	7'-9"
VC200	20 psf	4 - #8	2'-0"	3'-6"	6"	3	15'-3"	12'-0"	10'-3"	9'-3"	8'-3"

- NOTES:**
- MULTIPLE STRUCTURE ID'S MAY BE SELECTED WITHIN THE SAME SITE.
 - WHEN UTILIZING A STRUCTURE ID READ FROM WITHIN THAT ID ROW ONLY.
 - SEE SOILS NOTES ON SHEET S-3 FOR INFORMATION ON SOILS CLASS SELECTION.
 - FOR SITUATIONS WHERE WATER MITIGATION IS NECESSARY, OR FOR OTHER CONDITIONS REQUIRING MITIGATION, REFER TO DETAIL 2/- FOR SLEEVED FOUNDATION OPTION.


1 PIER FOUNDATION SCHEDULE

SPREAD FOOTING SCHEDULE


I.D. #	MAX GROUND SNOW LOAD	FOUNDATION DETAIL	SPREAD FOOTING MINIMUM DIMENSIONS FOR SOIL CLASS V (SOILS NOTES S-3)
VC14	0 psf	4	9'-6" (SQ.) x 2'-6" DEEP
VC18	0 psf	4	10'-3" (SQ.) x 2'-6" DEEP
VC20	0 psf	4	10'-0" (SQ.) x 2'-6" DEEP
VC140	20 psf	4	9'-3" (SQ.) x 2'-6" DEEP
VC180	20 psf	4	10'-0" (SQ.) x 2'-6" DEEP
VC200	20 psf	4	9'-9" (SQ.) x 2'-6" DEEP

- NOTES:**
- MULTIPLE STRUCTURE ID'S MAY BE SELECTED WITHIN THE SAME SITE.
 - WHEN UTILIZING A STRUCTURE ID READ FROM WITHIN THAT ID ROW ONLY.
 - SEE SOILS NOTES ON SHEET S-3 FOR INFORMATION ON SOILS CLASS SELECTION.

2 SPREAD FOOTING SCHEDULE

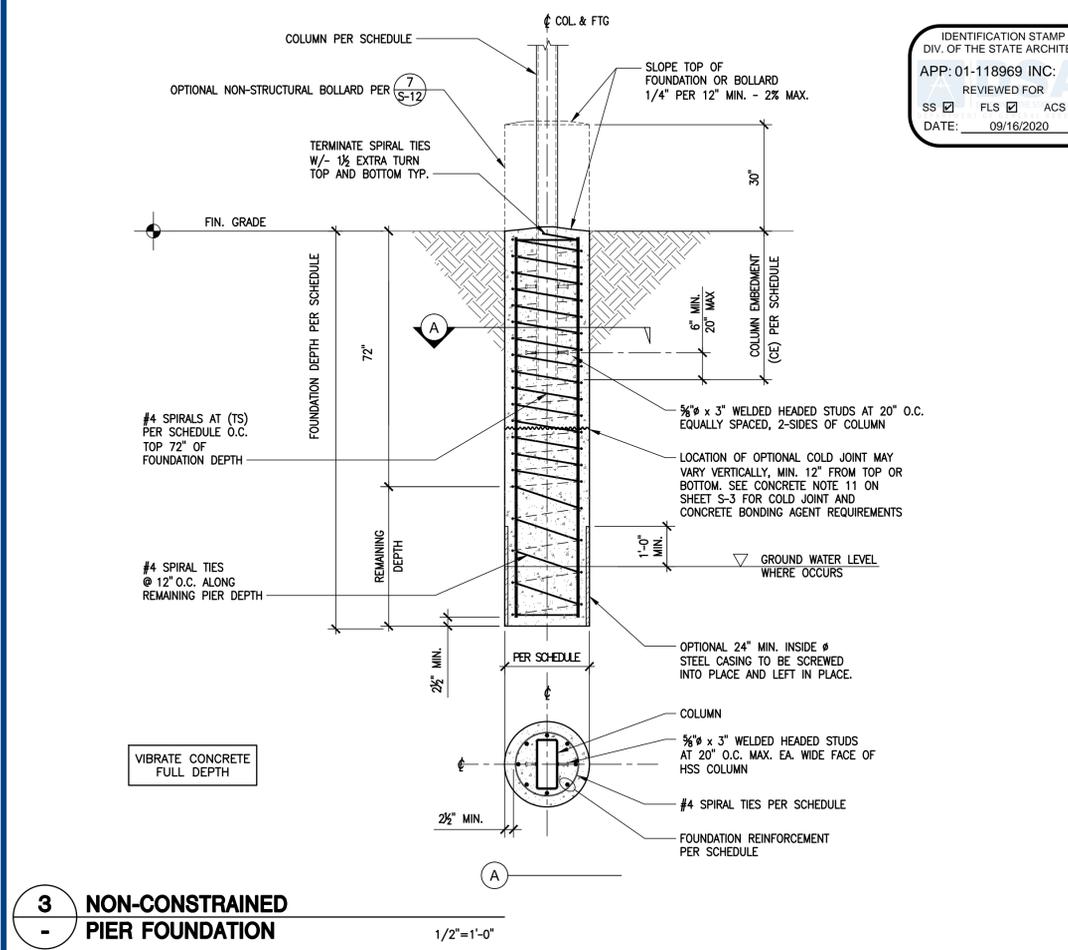

3 NON-CONSTRAINED PIER FOUNDATION

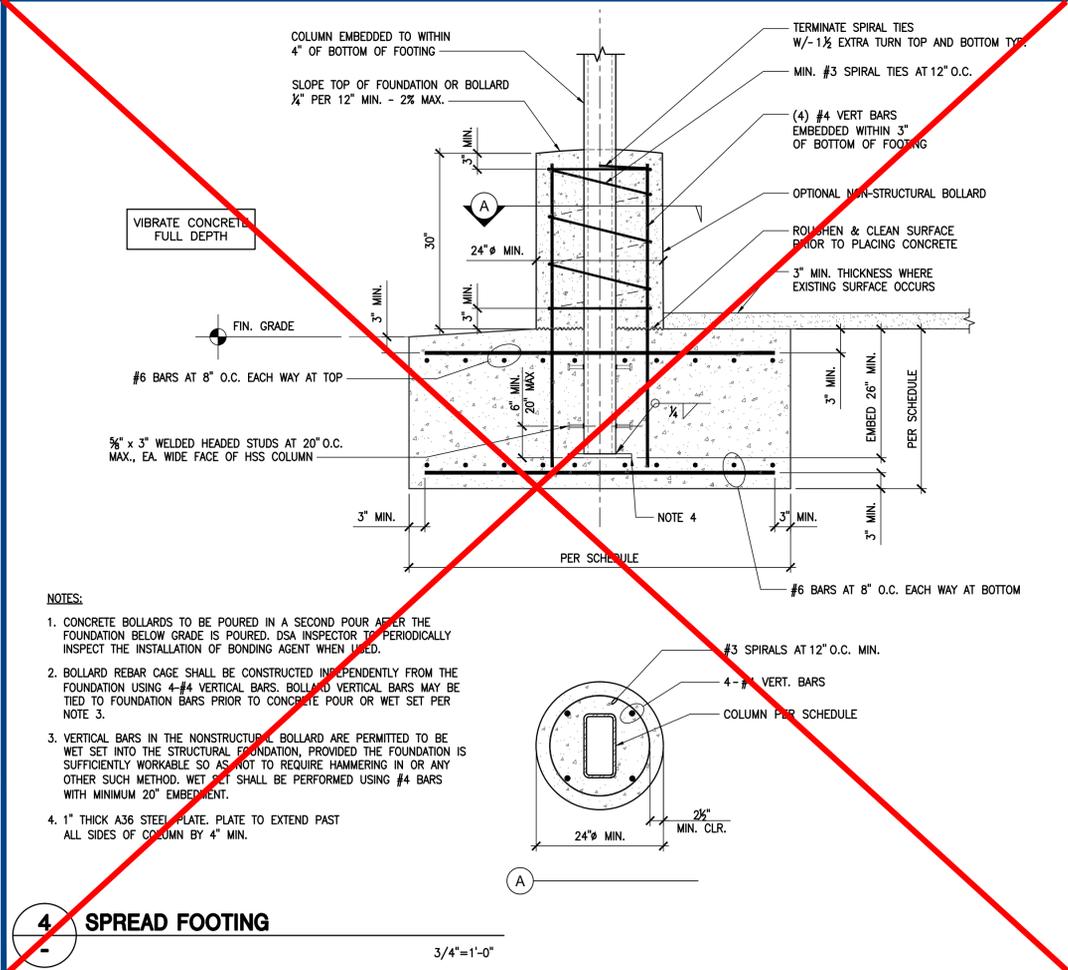

- NOTES:**
- CONCRETE BOLLARDS TO BE POURED IN A SECOND POUR AFTER THE FOUNDATION BELOW GRADE IS POURED. DSA INSPECTOR TO PERIODICALLY INSPECT THE INSTALLATION OF BONDING AGENT WHEN USED.
 - BOLLARD REBAR CAGE SHALL BE CONSTRUCTED INDEPENDENTLY FROM THE FOUNDATION USING 4-#4 VERTICAL BARS. BOLLARD VERTICAL BARS MAY BE TIED TO FOUNDATION BARS PRIOR TO CONCRETE POUR OR WET SET PER NOTE 3.
 - VERTICAL BARS IN THE NONSTRUCTURAL BOLLARD ARE PERMITTED TO BE WET SET INTO THE STRUCTURAL FOUNDATION, PROVIDED THE FOUNDATION IS SUFFICIENTLY WORKABLE SO AS NOT TO REQUIRE HAMMERING IN OR ANY OTHER SUCH METHOD. WET SET SHALL BE PERFORMED USING #4 BARS WITH MINIMUM 20" EMBEDMENT.
 - 1" THICK A36 STEEL PLATE. PLATE TO EXTEND PAST ALL SIDES OF COLUMN BY 4" MIN.

4 SPREAD FOOTING

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 01-118969 INC.
REVIEWED FOR
SS FLS ACS
DATE: 09/16/2020

ENGINEER'S APPROVAL
DATE SIGNED
11/28/2018

SITE SPECIFIC DSA APPROVAL


FILE NUMBER: PC-119
IDENTIFICATION STAMP
DIVISION OF THE STATE ARCHITECT
APP. NO: 04 - 117117 INCR
AC DF FLS DS SS DP
DATE 12/05/2018
PRE-CHECK (PC) DOCUMENT
CODE: 2016 CBC
A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED

MBARC CONSTRUCTION INC.
PHONE: (760) 744-4131
FAX: (760) 744-4449
GREGJ@MBARCONLINE.COM (775) 787-8845
674 RANCHEROS DR
SAN MARCOS, CA 92069
GREG JONES


ASTEL ENGINEERING STRUCTURAL ENGINEERING
PHONE: (949) 305-1150
FAX: (949) 305-1420
26030 ACHERO, SUITE 200
MISSION VIEJO, CA 92691

VERSA CANOPY FOUNDATION SCHEDULES


DRAWN GM
CHECKED KS
DATE 11/28/2018
4STEL JOB NO. MC03-01
SHEET
S-10
10 OF 13 SHEETS

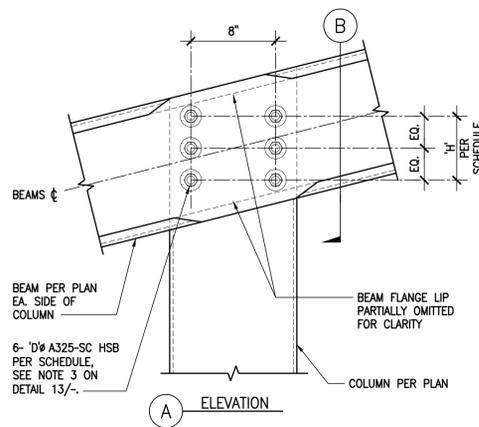


12 BEAM TO COLUMN - 6 BOLT
3'-1'-0"

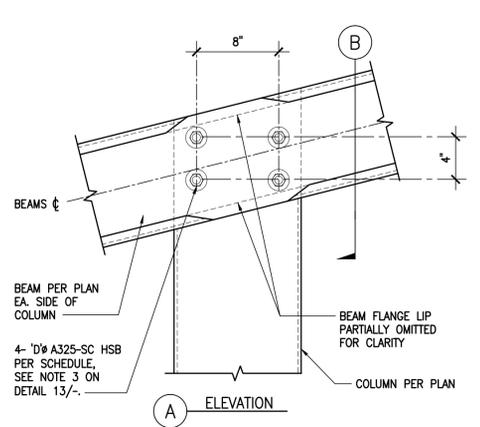

11 BEAM TO COLUMN - 4 BOLT
1-1/2'-1'-0"

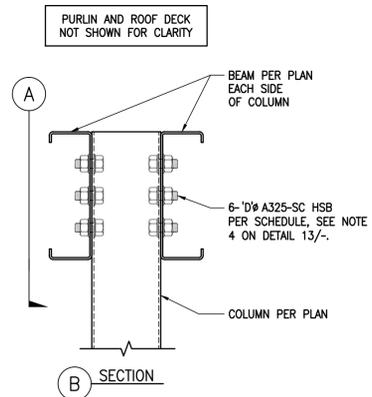

12 BEAM TO COLUMN - 6 BOLT
3'-1'-0"

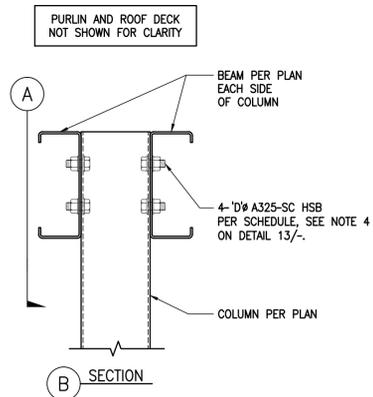


11 BEAM TO COLUMN - 4 BOLT
1-1/2'-1'-0"

BEAM TO COLUMN CONNECTION SCHEDULE					
I.D. #	MAX GROUND SNOW LOAD	# OF BOLTS (n)	BOLTED CONNECTION DETAIL	BOLT DIAMETER (D) ASTM A325-SC	BOLT PATTERN (B x H)
VC14	0 psf	4	11	1"	8" x 6"
VC18	0 psf	6	12	7/8"	8" x 6"
VC20	0 psf	6	12	7/8"	8" x 8"
VC140	20 psf	4	11	1"	8" x 6"
VC180	20 psf	6	12	7/8"	8" x 8"
VC200	20 psf	6	12	7/8"	8" x 8"


NOTES:
 1. MULTIPLE STRUCTURE ID'S MAY BE SELECTED WITHIN THE SAME SITE.
 2. WHEN UTILIZING A STRUCTURE ID READ FROM WITHIN THAT ID ROW ONLY.
 3. BOLTS SHALL BE PRETENSIONED A325-SC (SLIP-CRITICAL) TYPE N (THREADS NOT EXCLUDED FROM SHEAR PLANE) CLASS A FAYING SURFACE WITH STANDARD NUTS PER ASTM A563 AND WASHERS PER ASTM F436 TYPICAL U.N.O.
 4. BOLTS, NUTS AND WASHERS SHALL BE GALVANIZED.

13 BEAM TO COLUMN SCHEDULE
N.T.S.

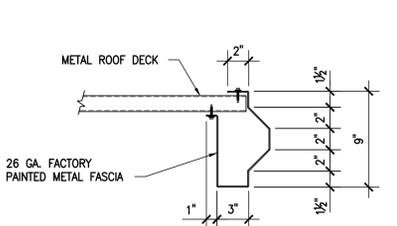


NOTES:
 1. #10 TEK SCREWS W/- WATER PROOF WASHER TOP & BOT. AT 3'-0" O.C. +/-.
 2. PROVIDE 3/8" WEEP HOLES AT 1'-6" O.C.


7 ROOF DECK TRIM DETAIL (OPTIONAL)
3'-1'-0"

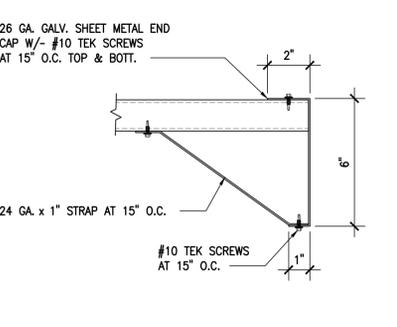


8 ROOF DECK TRIM DETAIL (OPTIONAL)
1-1/2'-1'-0"

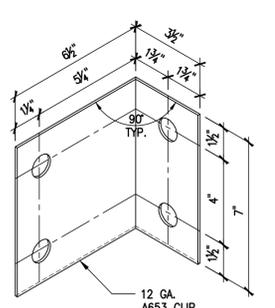


3 L-CLIP INTERIOR PURLIN TO BEAM
3'-1'-0"

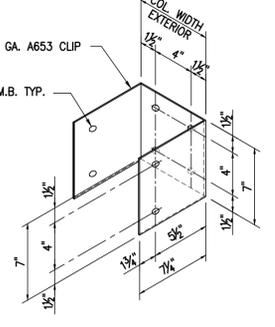


4 U-CLIP EXTERIOR PURLIN TO BEAM
1-1/2'-1'-0"

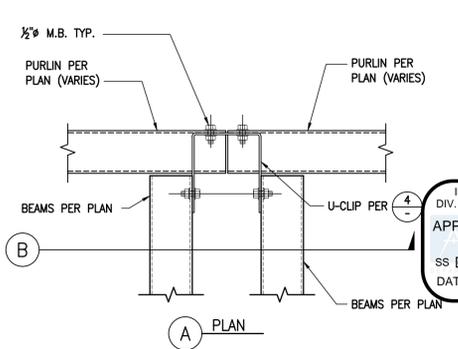


NOTES:
 1. ROOF DECK NOT SHOWN FOR CLARITY.
 2. PURLINS AT CANTILEVER SHALL BE CONTINUOUS.

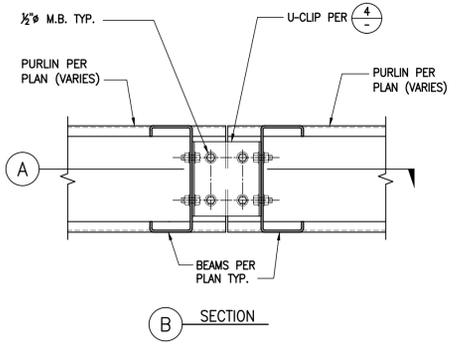


1 EXTERIOR PURLIN TO BEAM
1-1/2'-1'-0"

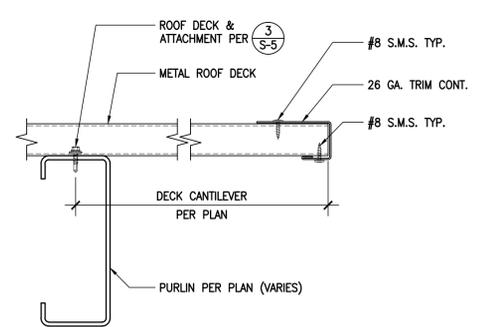


5 ROOF DECK TRIM DETAIL
3'-1'-0"

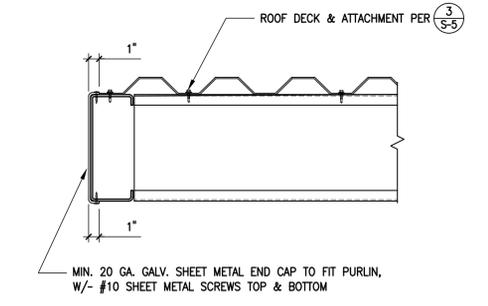


6 END ENCLOSURE DETAIL
1-1/2'-1'-0"

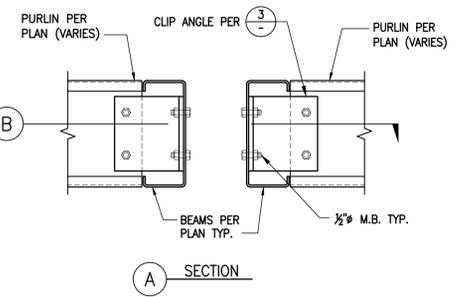

NOTES:
 1. ROOF DECK NOT SHOWN FOR CLARITY.

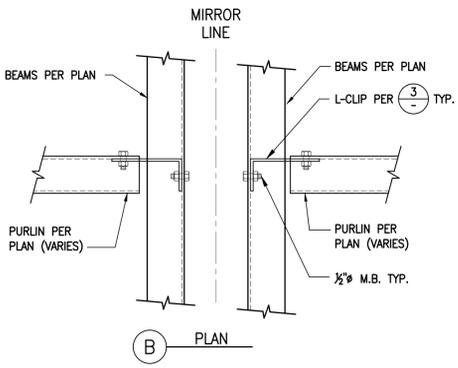

2 INTERIOR PURLIN TO BEAM
1-1/2'-1'-0"

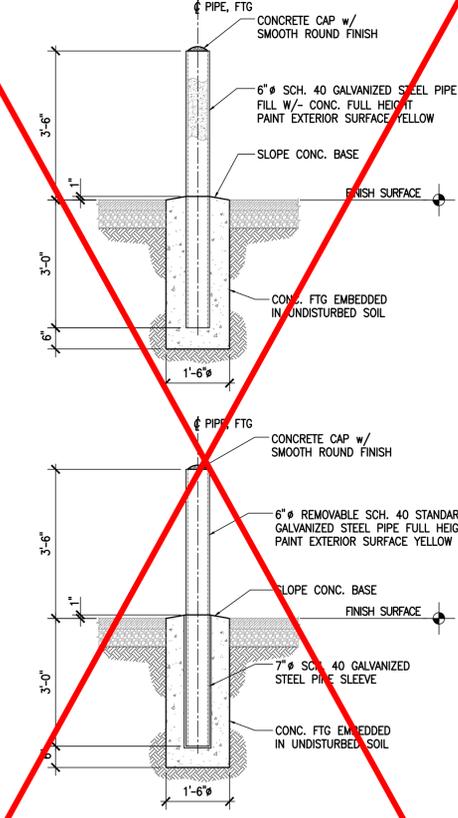

10 TYPICAL BOLLARD
1/2'-1'-0"

ENGINEER'S APPROVAL
 IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP: 01-118969 INC.
 REVIEWED FOR:
 SS FLS ACS
 DATE: 09/16/2020

SITE SPECIFIC DSA APPROVAL

FILE NUMBER: PC-119
 IDENTIFICATION STAMP
 DIVISION OF THE STATE ARCHITECT
 APP. NO: 04 - 117117 INCR
 AC DF FLS DS SS DP
 DATE 12/05/2018
 PRE-CHECK (PC) DOCUMENT
 CODE: 2016 CBC
 A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED


MBARC CONSTRUCTION INC.
 674 RANCHEROS DR
 SAN MARCOS, CA 92069
 PHONE: (760) 744-4131
 FAX: (760) 744-4449
 GREGJ@MBARCONLINE.COM (775) 787-8845

4STEL ENGINEERING
 STRUCTURAL ENGINEERING
 26030 ACHERO, SUITE 200
 MISSION VIEJO, CA 92691
 PHONE: (949) 305-1150
 FAX: (949) 305-1420


VERSA CANOPY STANDARD DETAILS 1

DRAWN GM
 CHECKED KS
 DATE 11/28/2018
 4STEL JOB NO. MC03-01
 SHEET

- NOTES:**
1. CONCRETE BOLLARDS TO BE POURED IN A SECOND POUR AFTER THE FOUNDATION BELOW GRADE IS POURED. DSA INSPECTOR TO PERIODICALLY INSPECT THE INSTALLATION OF BONDING AGENT WHEN USED.
 2. BOLLARD REBAR CAGE SHALL BE CONSTRUCTED INDEPENDENTLY FROM THE FOUNDATION USING 4-#4 VERTICAL BARS UNLESS WET SET PERFORMED PER NOTE 3 OR CONTINUOUS FOUNDATION BARS ARE USED PER NOTE 4.
 3. VERTICAL BARS IN THE NONSTRUCTURAL BOLLARD ARE PERMITTED TO BE WET SET INTO THE STRUCTURAL FOUNDATION, PROVIDED THE FOUNDATION IS SUFFICIENTLY WORKABLE SO AS NOT TO REQUIRE HAMMERING IN OR ANY OTHER SUCH METHOD. WET SET SHALL BE PERFORMED USING #4 BARS WITH MINIMUM 20' EMBEDMENT.
 4. BOLLARD REINFORCING IS PERMITTED TO USE MIN. (4) FOUNDATION VERT. BARS CONTINUOUS TO 3' BELOW TOP OF BOLLARD IN LIEU OF 4-#4 BARS.

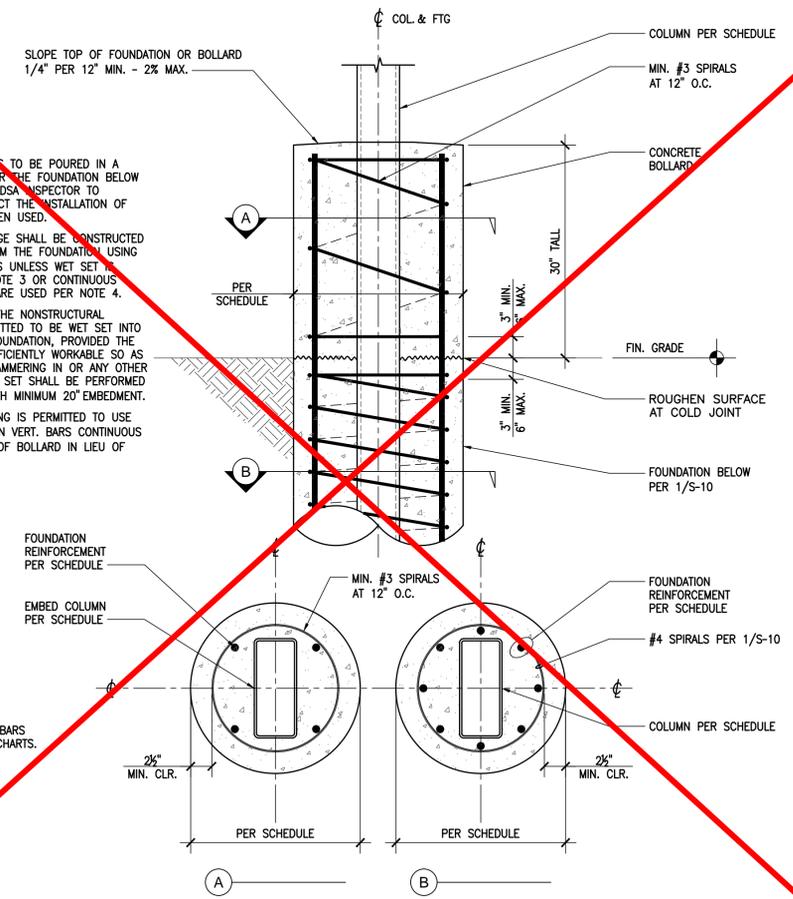


7 OPTIONAL CONCRETE BOLLARD
1"=1'-0"

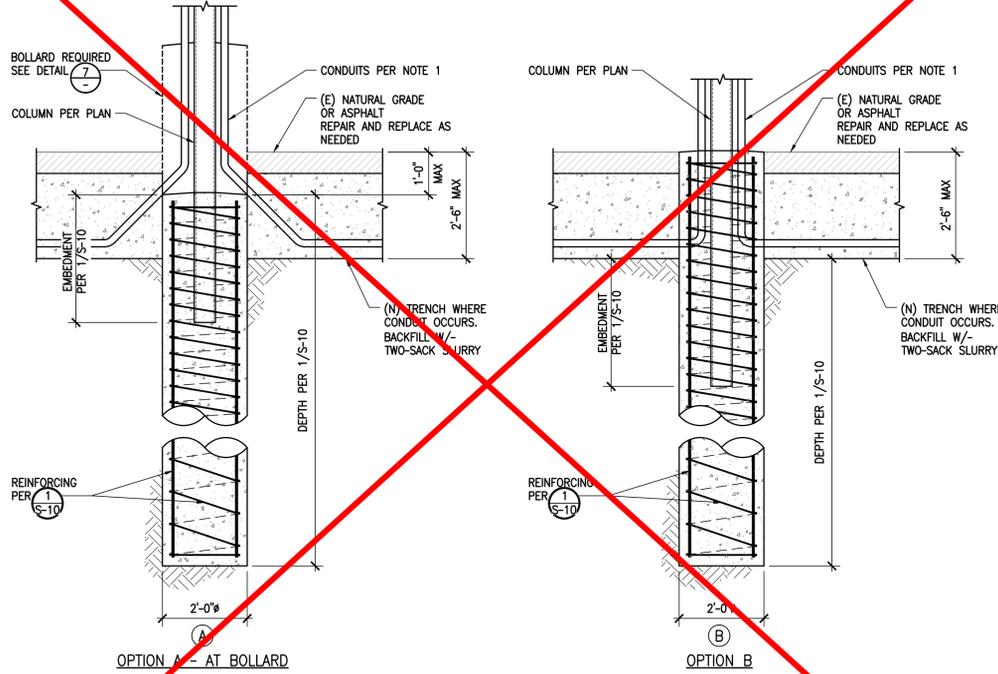


8 CONDUIT AT DRILLED PIER
1"=1'-0"

- NOTE:**
1. CONDUIT IN FOUNDATION SHALL NOT EXCEED (1) 2" MAX Ø CONDUIT OR (2) 1 1/2" MAX Ø CONDUIT. WHEN (2) CONDUITS ARE USED IN THE SAME FOUNDATION, THE CONDUIT MAY ENTER THE FOUNDATION FROM EITHER SIDE.
 2. CONDUIT TRENCH SHALL BE FILLED WITH MIN 2-SACK SLURRY.

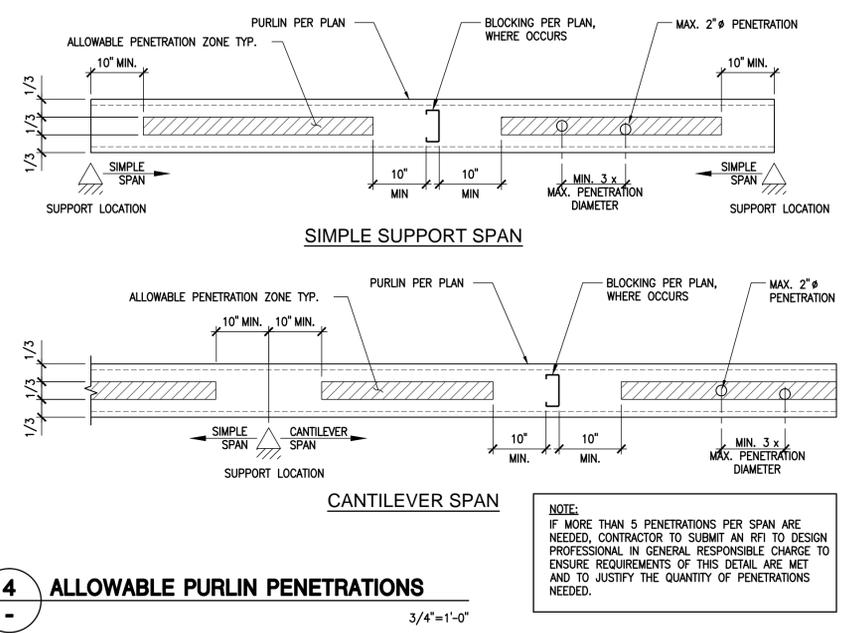


4 ALLOWABLE PURLIN PENETRATIONS
3/4"=1'-0"


- NOTE:**
IF MORE THAN 5 PENETRATIONS PER SPAN ARE NEEDED, CONTRACTOR TO SUBMIT AN RFI TO DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE TO ENSURE REQUIREMENTS OF THIS DETAIL ARE MET AND TO JUSTIFY THE QUANTITY OF PENETRATIONS NEEDED.

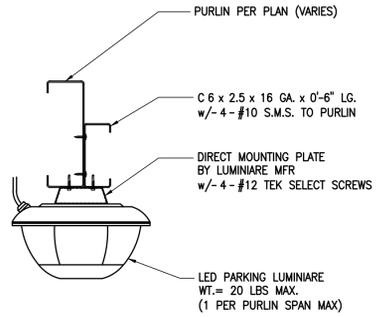

5 TYPICAL PARKING LUMINAIRE AT PURLIN
1 1/2"=1'-0"

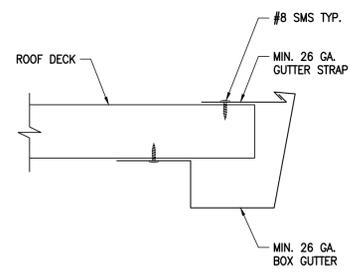


6 GUTTER DETAIL
3"=1'-0"

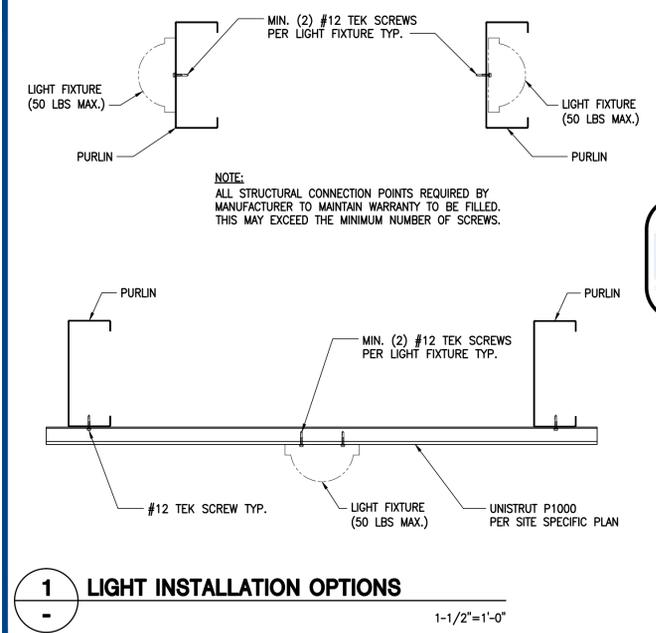


1 LIGHT INSTALLATION OPTIONS
1-1/2"=1'-0"

- NOTE:**
ALL STRUCTURAL CONNECTION POINTS REQUIRED BY MANUFACTURER TO MAINTAIN WARRANTY TO BE FILLED. THIS MAY EXCEED THE MINIMUM NUMBER OF SCREWS.

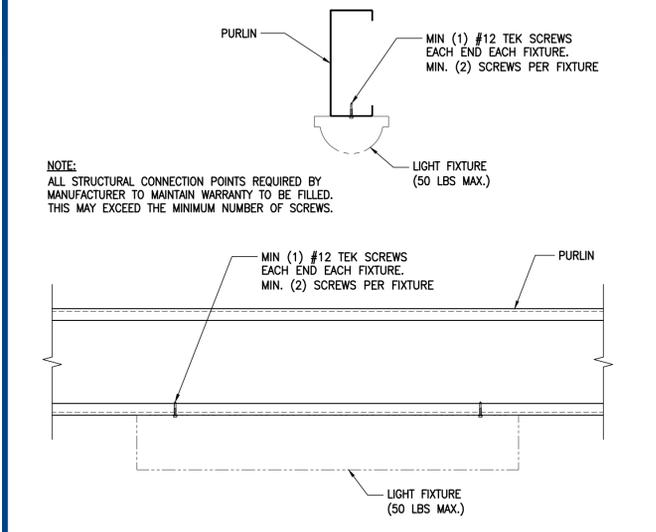

2 ALTERNATE LIGHT INSTALLATION OPTIONS
1-1/2"=1'-0"

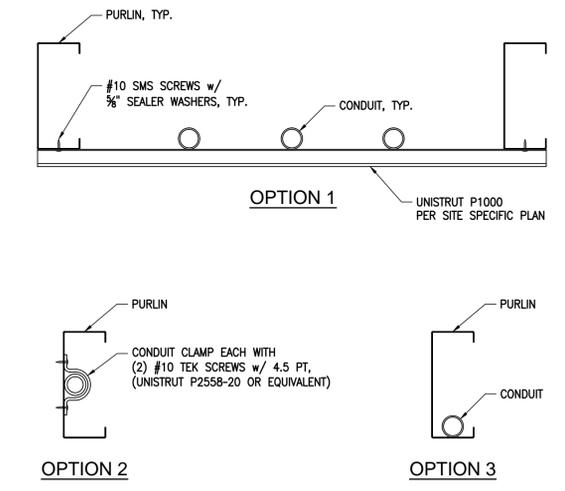

3 CONDUIT SUPPORT/ LOCATION OPTIONS
1-1/2"=1'-0"

ENGINEER'S APPROVAL
REGISTERED PROFESSIONAL ENGINEER
DAVID K. ROSENTHAL
S 5885
STRUCTURAL
STATE OF CALIFORNIA

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 01-118969 INC:
REVIEWED FOR
SS FLS ACS
DATE: 09/16/2020

SITE SPECIFIC DSA APPROVAL

FILE NUMBER: PC-119
IDENTIFICATION STAMP
DIVISION OF THE STATE ARCHITECT
APP. NO: 04 - 117117 INCR
AC DF FL DS SS DP
DATE 12/05/2018

PRE-CHECK (PC) DOCUMENT
CODE: 2016 CBC
A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED












MBARC CONSTRUCTION INC.
PHONE: (760) 744-4131
FAX: (760) 744-4449
GREGJ@MBARCONLINE.COM (775) 787-8845
674 RANCHEROS DR
SAN MARCOS, CA 92069
GREG JONES

4STEL ENGINEERING
STRUCTURAL ENGINEERING
PHONE: (949) 305-1150
FAX: (949) 305-1420
26030 ACHERO, SUITE 200
MISSION VIEJO, CA 92691

VERSA CANOPY STANDARD DETAILS 2

DRAWN GM
CHECKED KS
DATE 11/28/2018
4STEL JOB NO. MC03-01
SHEET

S-12
12 OF 13 SHEETS

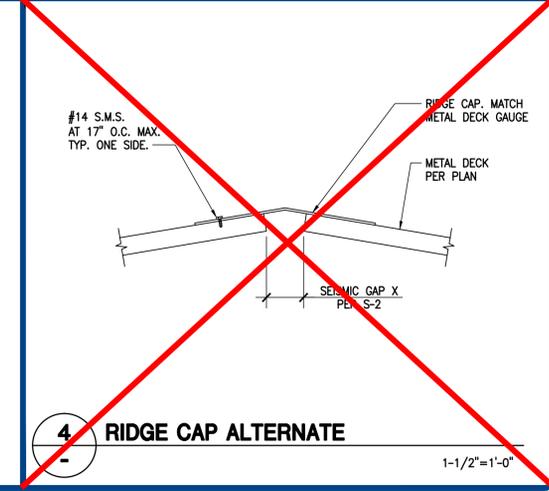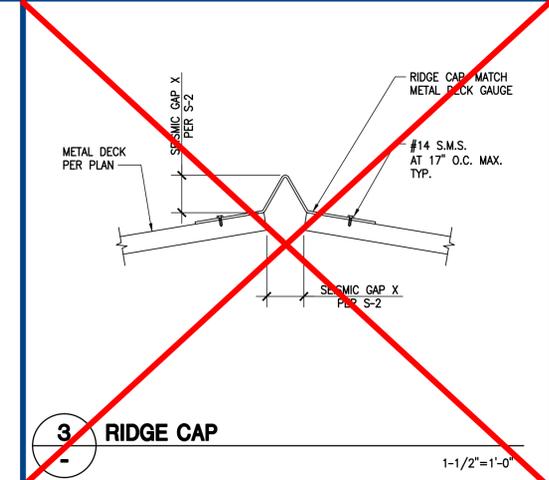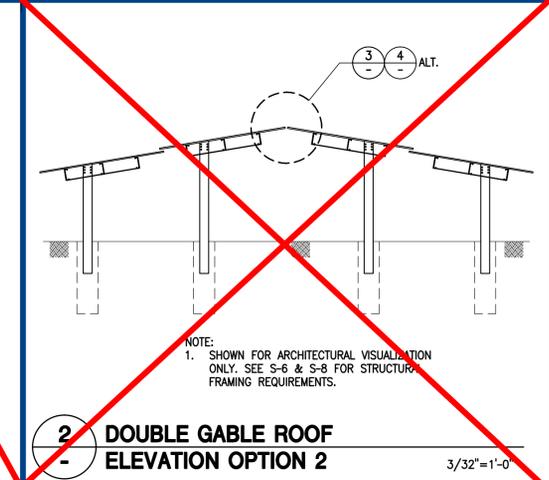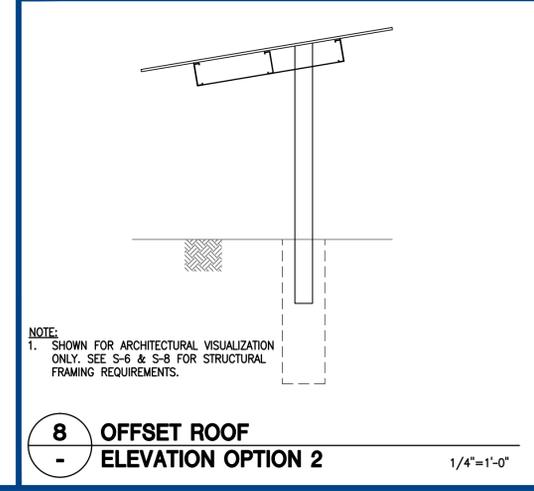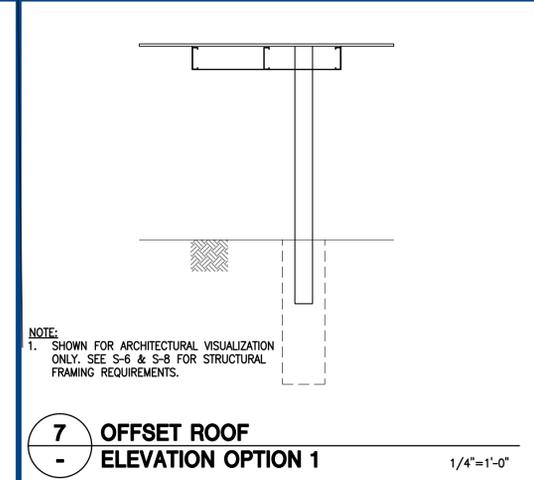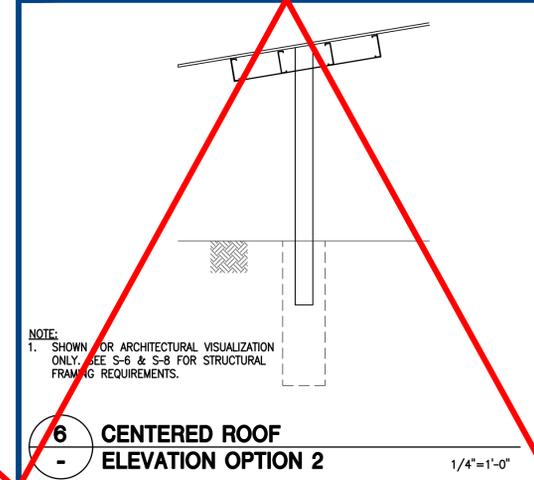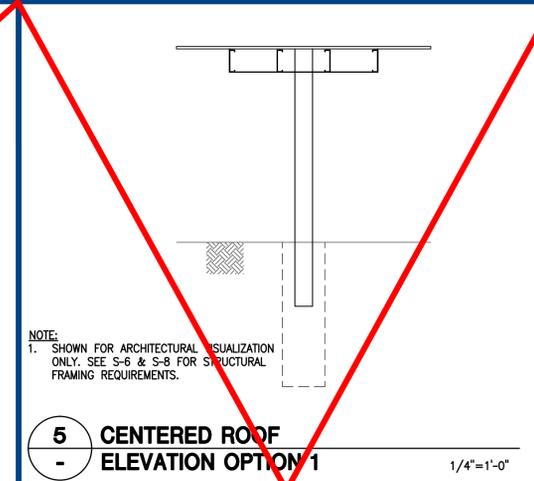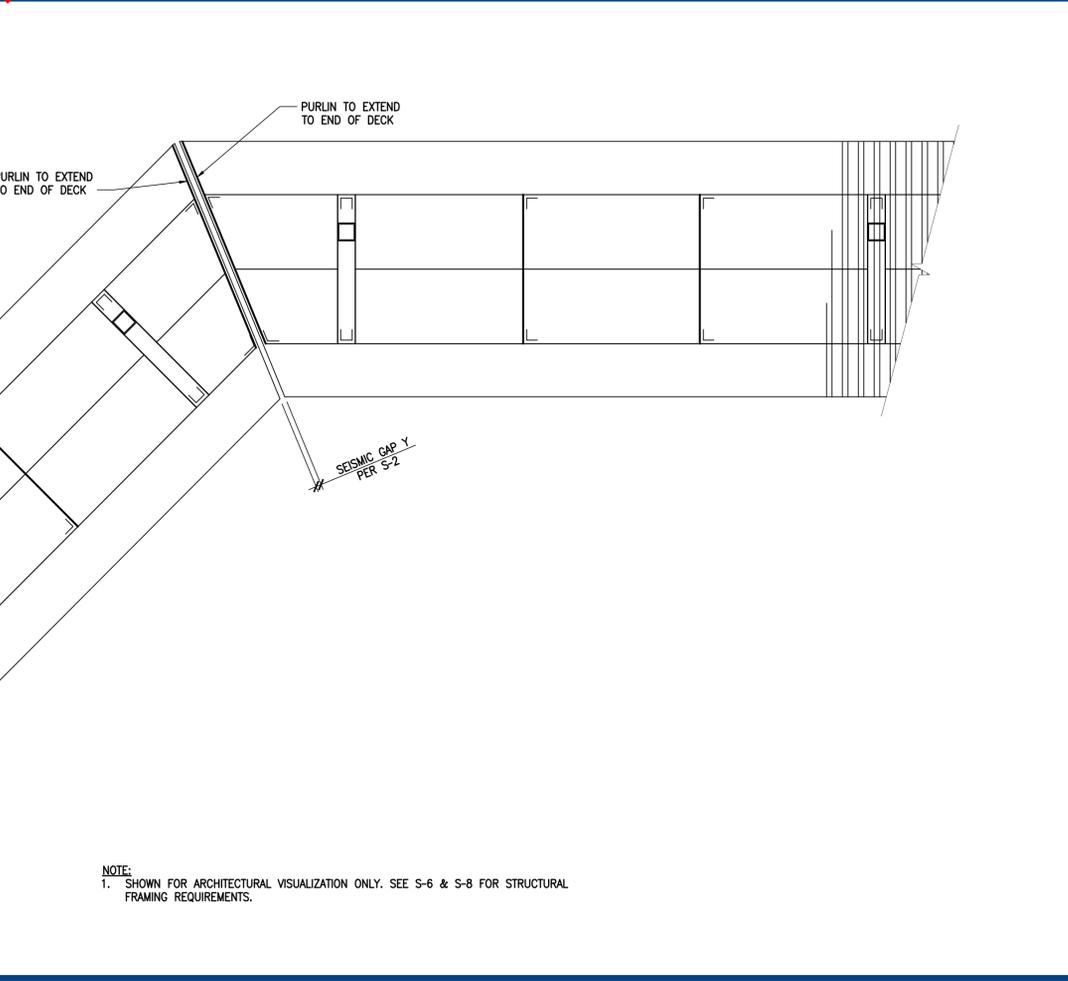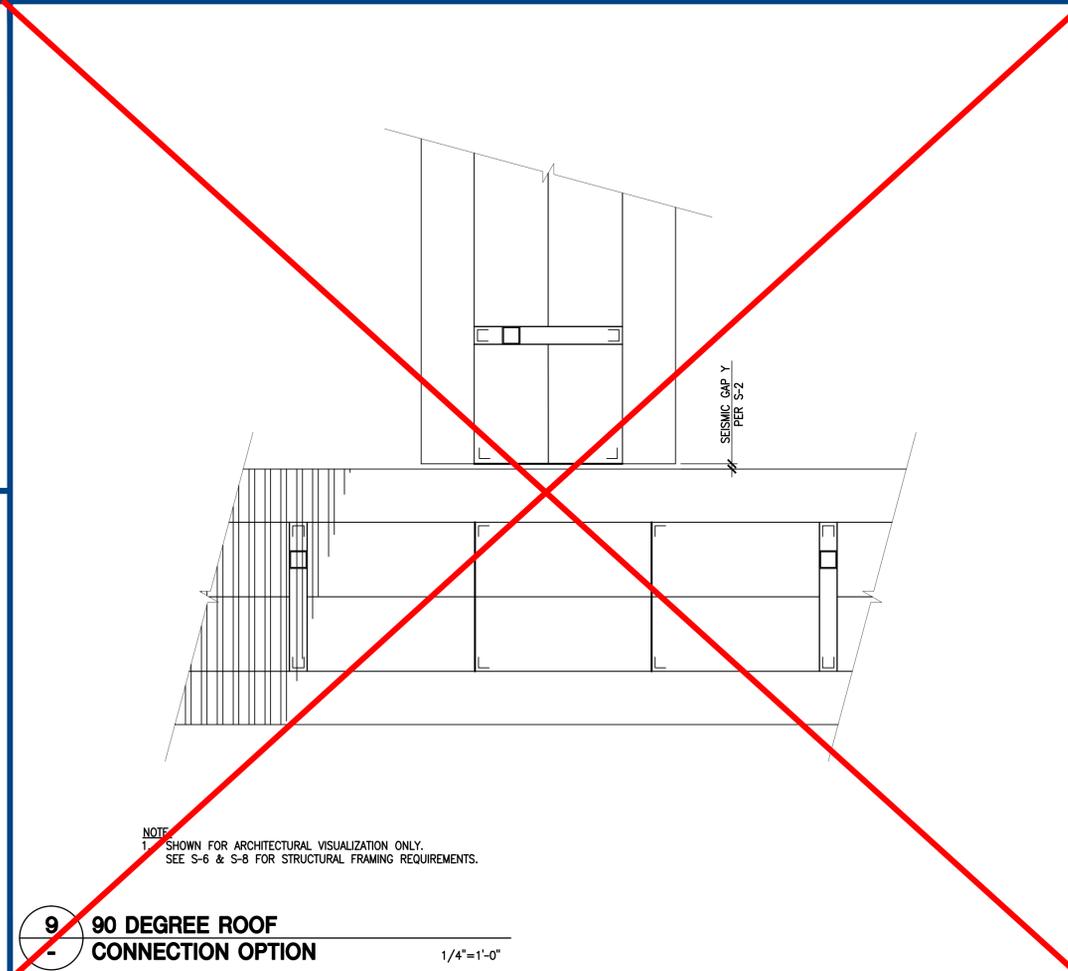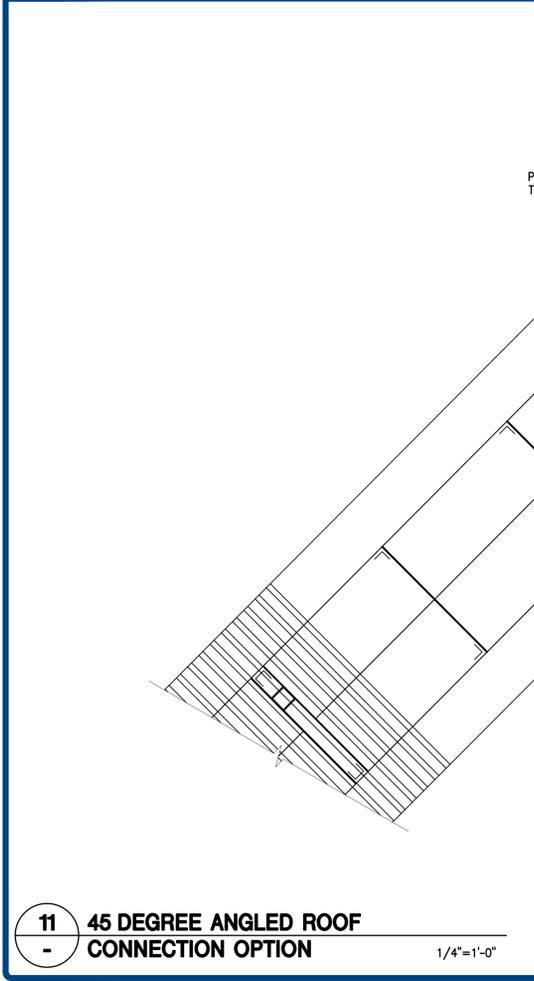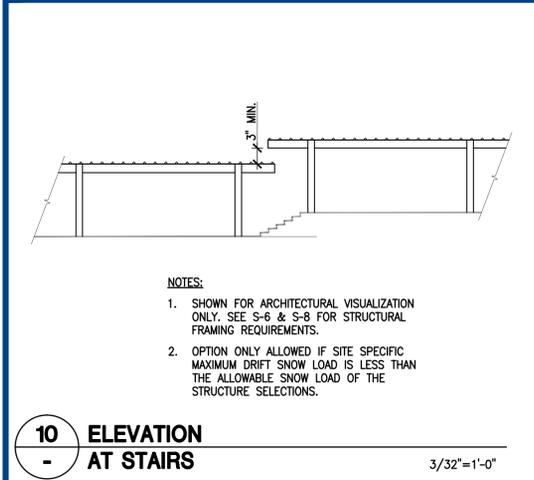

ENGINEER'S APPROVAL

REGISTERED PROFESSIONAL ENGINEER
 DUSTIN K. ROSENTHAL
 S 5885
 STRUCTURAL ENGINEER - CALIFORNIA

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP: 01-118969 INC:
 REVIEWED FOR
 SS FLS ACS
 DATE: 09/16/2020

DESIGNED
 18

SITE SPECIFIC DSA APPROVAL

FILE NUMBER: PC-119
 IDENTIFICATION STAMP
 DIVISION OF THE STATE ARCHITECT
 APP. NO: 04 - 117117 INCR
 AC DF FL DS SS DP
 DATE 12/05/2018

PRE-CHECK (PC) DOCUMENT
 CODE: 2016 CBC
 A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED

MBARC CONSTRUCTION INC.

674 RANCHEROS DR
 SAN MARCOS, CA 92069
 PHONE: (760) 744-4131
 FAX: (760) 744-4449
 GREGJ@MBARCONLINE.COM (775) 787-8845
 GREG JONES

4STEL ENGINEERING
 STRUCTURAL ENGINEERING

26030 ACHERO, SUITE 200
 MISSION VIEJO, CA 92691
 PHONE: (949) 305-1150
 FAX: (949) 305-1420

VERSA CANOPY
 STANDARD DETAILS 3

DRAWN
 GM
CHECKED
 KS
DATE
 11/28/2018
4STEL JOB NO.
 MC03-01
SHEET
S-13
 13 OF 13 SHEETS

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS

Application Number: 01-118969

School Name: Morrill Middle School

School District: Berryessa Union School
District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/15/2020

IMPORTANT: This form is only a summary list of structural tests and some of the special inspections required for the project. Generally, the structural tests and special inspections noted on this form are those that will be performed by the Geotechnical Engineer of Record, Laboratory of Record, or Special Inspector. The actual complete test and inspection program must be performed as detailed on the DSA approved documents. The appendix at the bottom of this form identifies work NOT subject to DSA requirements for special inspection or structural testing. The project inspector is responsible for providing inspection of all facets of construction, including but not limited to, special inspections not listed on this form such as structural wood framing, high-load wood diaphragms, cold-formed steel framing, anchorage of non-structural components, etc., per Title 24, Part 2, Chapter 17A.

KEY TO COLUMNS

1. TYPE	2. PERFORMED BY
<p>Continuous – Indicates that a continuous special inspection is required</p> <p>Periodic – Indicates that a periodic special inspection is required</p> <p>Test – Indicates that a test is required</p>	<p>GE – Indicates that the special inspection shall be performed by a registered geotechnical engineer or his or her authorized representative.</p> <p>LOR – Indicates that the test or special inspection shall be performed by a testing laboratory accepted in the DSA Laboratory Evaluation and Acceptance (LEA) Program. See CAC Section 4-335.</p> <p>PI – Indicates that the special inspection may be performed by a project inspector when specifically approved by DSA.</p> <p>SI – Indicates that the special inspection shall be performed by an appropriately qualified/approved special inspector.</p>

****NOTE:** Undefined section and table references found in this document are from the CBC, or California Building Code.

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (SOILS)

Application Number: 01-118969

School Name: Morrill Middle School

School District: Berryessa Union School District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted 04/15/2020

Geotechnical Reports: Project does NOT have and does NOT require a geotechnical report

1. GENERAL:		Table 1705A.6		
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/>	a. Verify that: <ul style="list-style-type: none"> • Site has been prepared properly prior to placement of controlled fill and/or excavations for foundations. • Foundation excavations are extended to proper depth and have reached proper material. • Materials below footings are adequate to achieve the design bearing capacity. 	See Notes	PI	Refer to specific items identified in the Appendix listing exemptions for limitations. Placement of controlled fill exceeding 12" depth under foundations is not permitted without a geotechnical report.

2. SOIL COMPACTION AND FILL:		Table 1705A.6		
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>	a. Verify use of proper materials, densities and inspect lift thicknesses, placement and compaction during placement of fill.	Continuous	LOR*	* Under the supervision of a geotechnical engineer or LOR's engineering manager. Refer to specific items identified in the Appendix listing exemptions for limitations.
<input type="checkbox"/>	b. Compaction testing.	Test	LOR*	* Under the supervision of a geotechnical engineer or LOR's engineering manager. Refer to specific items identified in the Appendix listing exemptions for limitations.

3. DRIVEN DEEP FOUNDATIONS (PILES):		Table 1705A.7		
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>	a. Verify pile materials, sizes and lengths comply with the requirements.	Continuous	GE*	* By geotechnical engineer or his or her qualified representative.

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (SOILS)

Application Number: 01-118969

School Name: Morrill Middle School

School District: Berryessa Union School District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/15/2020

<input type="checkbox"/>	b. Determine capacities of test piles and conduct additional load tests as required.	Test	LOR*	* Under the supervision of the geotechnical engineer.
<input type="checkbox"/>	c. Inspect driving operations and maintain complete and accurate records for each pile.	Continuous	GE*	* By geotechnical engineer or his or her qualified representative.
<input type="checkbox"/>	d. Verify locations of piles and their plumbness, confirm type and size of hammer, record number of blows per foot of penetration, determine required penetrations to achieve design capacity, record tip and butt elevations and record any pile damage.	Continuous	GE*	* By geotechnical engineer or his or her qualified representative.

3. DRIVEN DEEP FOUNDATIONS (PILES):		Table 1705A.7		
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>	e. Steel piles.	Provide tests and inspections per STEEL section below.		
<input type="checkbox"/>	f. Concrete piles and concrete filled piles.	Provide tests and inspections per CONCRETE section below.		
<input type="checkbox"/>	g. For specialty piles, perform additional inspections as determined by the registered design professional in responsible charge.	*	*	* As defined on drawings or specifications.

4. CAST-IN-PLACE DEEP FOUNDATIONS (PIERS):		Table 1705A.8		
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/>	a. Inspect drilling operations and maintain complete and accurate records for each pier.	Continuous	PI	Continuous inspection to be provided by project inspector. Refer to specific items identified in the Appendix listing exemptions for limitations.
<input checked="" type="checkbox"/>	b. Verify pier locations, diameters, plumbness and lengths. Record concrete or grout volumes.	Continuous	PI	Continuous inspection to be provided by project inspector. Refer to specific items identified in the Appendix listing exemptions for limitations.
<input checked="" type="checkbox"/>	c. Concrete piers.	Provide tests and inspections per CONCRETE section below.		

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (SOILS)

Application Number: 01-118969

School Name: Morrill Middle School

School District: Berryessa Union School District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/15/2020

5. RETAINING WALLS:				
<input type="checkbox"/>	a. Segmental retaining walls; inspect placement of units, dowels, connectors, etc.	Continuous	GE*	* By geotechnical engineer or his or her qualified representative. See DSA IR 16-3.
<input type="checkbox"/>	b. Placement of soil reinforcement, drainage devices and/or backfill.	Continuous	GE*	Placement, compaction and inspection of backfill per Section 1705A.6.1 for fills supporting foundations (Section 2 above). * By geotechnical engineer or his or her qualified representative.
<input type="checkbox"/>	c. Concrete retaining walls.	Provide tests and inspections per CONCRETE section below.		
<input type="checkbox"/>	d. Masonry retaining walls.	Provide tests and inspections per MASONRY section below.		

6. OTHER SOILS:				
<input type="checkbox"/>	a. Soil Improvements	Test	GE*	Submit a comprehensive report documenting final soil improvements constructed, construction observation and the results of the confirmation testing and analysis to CGS for final acceptance. * By geotechnical engineer or his or her qualified representative.
<input type="checkbox"/>	b. Inspection of Soil Improvements	Continuous	GE*	* By geotechnical engineer or his or her qualified representative.
<input type="checkbox"/>				

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (Concrete)

Table 1705A.3; ACI 318-14 Sections 26.12 & 26.13

Application Number: 01-118969

School Name: Morrill Middle School

School District: Berryessa Union School District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/15/2020

7. CAST-IN-PLACE CONCRETE				
Material Verification and Testing:				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/>	a. Verify use of required design mix.	Periodic	SI	Table 1705A.3 Item 5, 1910A.1.
<input checked="" type="checkbox"/>	b. Identify, sample, and test reinforcing steel.	Test	LOR	1910A.2; ACI 318-14 Section 26.6.1.2; DSA IR 17-10. (See Appendix for exemptions.)
<input checked="" type="checkbox"/>	c. During concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.	Test	LOR	Table 1705A.3 Item 6; ACI 318-14 Sections 26.5 & 26.12.
<input checked="" type="checkbox"/>	d. Test concrete (f_c).	Test	LOR	1905A.1.15; ACI 318-14 Section 26.12.
Inspection:				
<input checked="" type="checkbox"/>	e. Batch plant inspection: Continuous	See Notes	SI	Default of ' Continuous ' per 1705A.3.3. If approved by DSA, batch plant inspection may be reduced to ' Periodic ' subject to requirements in Section 1705A.3.3.1, or eliminated per 1705A.3.3.2. (See Appendix for exemptions.)
<input checked="" type="checkbox"/>	f. Welding of reinforcing steel.	Provide special inspection per STEEL, Category 19.1(d) & (e) and/or 19.2(g) & (h) below.		

8. PRESTRESSED / POST-TENSIONED CONCRETE (in addition to Cast-in-Place Concrete tests and inspections):				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>	a. Sample and test prestressing tendons and anchorages.	Test	LOR	1705A.3.4, 1910A.3
<input type="checkbox"/>	b. Inspect placement of prestressing tendons.	Periodic	SI	1705A.3.4, Table 1705A.3 Items 1 & 9.

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (Concrete)

Table 1705A.3; ACI 318-14 Sections 26.12 & 26.13

Application Number: 01-118969	School Name: Morrill Middle School	School District: Berryessa Union School District
DSA File Number: 43-7	Increment Number: N/A	Date Submitted: 04/15/2020

<input type="checkbox"/>	c. Verify in-situ concrete strength prior to stressing of post-tensioning tendons.	Periodic	SI	Table 1705A.3 Item 11. Special inspector to verify specified concrete strength test prior to stressing.
<input type="checkbox"/>	d. Inspect application of post-tensioning or prestressing forces and grouting of bonded prestressing tendons.	Continuous	SI	1705A.3.4, Table 1705A.3 Item 9; ACI 318-14 Section 26.13

9. PRECAST CONCRETE (in addition to Cast-in-Place Concrete tests and inspections):

	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>	a. Inspect fabrication of precast concrete members.	Continuous	SI	ACI 318-14 Section 26.13.
<input type="checkbox"/>	b. Inspect erection of precast concrete members.	Periodic	SI*	Table 1705A.3 Item 10. * May be performed by PI when specifically approved by DSA.

10. SHOTCRETE (in addition to Cast-in-Place Concrete tests and inspections):

	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>	a. Inspect shotcrete placement for proper application techniques.	Continuous	SI	1705A.19, Table 1705A.3 Item 7, 1908A.6, 1908A.7, 1908A.8, 1908A.9, 1908A.11, 1908A.12. See ACI 506.2-13 Section 3.4, ACI 506R-16.
<input type="checkbox"/>	b. Sample and test shotcrete (f'_c).	Test	LOR	1908A.5, 1908A.10.

11. POST-INSTALLED ANCHORS:

	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>	a. Inspect installation of post-installed anchors	See Notes	SI*	1617A.1.19, Table 1705A.3 Item 4a (Continuous) & 4b (Periodic), 1705A.3.8 (See Appendix for exemptions). ACI 318-14

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (Concrete)

Table 1705A.3; ACI 318-14 Sections 26.12 & 26.13

Application Number: 01-118969	School Name: Morrill Middle School	School District: Berryessa Union School District
DSA File Number: 43-7	Increment Number: N/A	Date Submitted: 04/15/2020

<input type="checkbox"/>				Sections 17.8 & 26.13. * May be performed by the project inspector when specifically approved by DSA.
<input type="checkbox"/>	b. Test post-installed anchors.	Test	LOR	1910A.5. (See Appendix for exemptions.)

12. OTHER CONCRETE:				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>				

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (Steel and Aluminum)

1705A.2.1, Table 1705A.2.1; AISC 303-16, AISC 341-16, AISC 358-16, AISC 360-16; AISI S100-16

Application Number: 01-118969

School Name: Morrill Middle School

School District: Berryessa Union School

District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/15/2020

17. STRUCTURAL STEEL, COLD-FORMED STEEL AND ALUMINUM USED FOR STRUCTURAL PURPOSES				
Material Verification and Testing:				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/>	a. Verify identification of all materials and: <ul style="list-style-type: none"> • Mill certificates indicate material properties that comply with requirements. • Material sizes, types and grades comply with requirements. 	Periodic	*	Table 1705A.2.1 Item 3a–3c. 2202A.1; AISI S100-16 Section A3.1 & A3.2, AISI S240-15 Section A3 & A5, AISI S220-15 Sections A4 & A6. * By special inspector or qualified technician when performed off-site.
<input checked="" type="checkbox"/>	b. Test unidentified materials	Test	LOR	2202A.1.
<input checked="" type="checkbox"/>	c. Examine seam welds of HSS shapes	Periodic	SI	DSA IR 17-3.
Inspection:				
<input checked="" type="checkbox"/>	d. Verify and document steel fabrication per DSA-approved construction documents.	Periodic	SI	Not applicable to cold-formed steel light-frame construction, except for trusses (1705A.2.4).

18. HIGH-STRENGTH BOLTS: RCSC 2014				
Material Verification and Testing of High-Strength Bolts, Nuts and Washers:				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/>	a. Verify identification markings and manufacturer's certificates of compliance conform to ASTM standards specified in the DSA-approved documents.	Periodic	SI	Table 1705A.2.1 Items 1a & 1b, 2202A.1; AISC 360-16 Section A3.3, J3.1, and N3.2; RCSC 2014 Section 1.5 & 2.1; DSA IR 17-8 & DSA IR 17-9.
<input checked="" type="checkbox"/>	b. Test high-strength bolts, nuts and washers.	Test	LOR	Table 1705A.2.1 Item 1c, 2213A.1; RCSC 2014 Section 7.2; DSA IR 17-8.
Inspection of High-Strength Bolt Installation:				

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (Steel and Aluminum)

1705A.2.1, Table 1705A.2.1; AISC 303-16, AISC 341-16, AISC 358-16, AISC 360-16; AISI S100-16

Application Number: 01-118969

School Name: Morrill Middle School

School District: Berryessa Union School

District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/15/2020

<input type="checkbox"/>	c. Bearing-type ("snug tight") connections.	Periodic	SI	Table 1705A.2.1 Item 2a, 1705A.2.6, 2204A.2; AISC 360-16 J3.1, J3.2, M2.5 & N5.6; RCSC 2014 Section 9.1; DSA IR 17-9.
<input checked="" type="checkbox"/>	d. Pretensioned and slip-critical connections.	*	SI	Table 1705A.2.1 Items 2b & 2c, 1705A.2.6, 2204A.2; AISC 360-16 J3.1, J3.2, M2.5 & N5.6; RCSC 2014 Sections 9.2 & 9.3; DSA IR 17-9. * "Continuous" or "Periodic" depends on the tightening method used.

19. WELDING:	1705A.2.5, Table 1705A.2.1 Items 4 & 5; AWS D1.1 and AWS D1.8 for structural steel; AWS D1.2 for Aluminum; AWS D1.3 for cold-formed steel; AWS D1.4 for reinforcing steel; DSA IR 17-3 (See Appendix for exemptions.)
---------------------	--

Verification of Materials, Equipment, Welders, etc.:

	Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/>	a. Verify weld filler material identification markings per AWS designation listed on the DSA-approved documents and the WPS.	Periodic	SI	DSA IR 17-3.
<input checked="" type="checkbox"/>	b. Verify weld filler material manufacturer's certificate of compliance.	Periodic	SI	DSA IR 17-3.
<input checked="" type="checkbox"/>	c. Verify WPS, welder qualifications and equipment.	Periodic	SI	DSA IR 17-3.

19.1 SHOP WELDING:

	Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/>	a. Inspect groove welds, multi-pass fillet welds, single pass fillet welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Items 5a.1-4; AISC 360-16 (and AISC 341-16 as applicable); DSA IR 17-3.
<input type="checkbox"/>	b. Inspect single-pass fillet welds ≤ 5/16", floor and roof deck welds.	Periodic	SI	1705A.2.2, Table 1705A.2.1 Items 5a.5 & 5a.6; AISC 360-16 (and AISC 341-16 as applicable); DSA IR 17-3.
<input type="checkbox"/>	c. Inspect welding of stairs and railing systems.	Periodic	SI	1705A.2.1; AISC 360-16 (and AISC 341-16 as applicable); AWS D1.1 & D1.3; DSA IR 17-3.

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (Steel and Aluminum)

1705A.2.1, Table 1705A.2.1; AISC 303-16, AISC 341-16, AISC 358-16, AISC 360-16; AISI S100-16

Application Number: 01-118969

School Name: Morrill Middle School

School District: Berryessa Union School

District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/15/2020

<input type="checkbox"/>	d. Verification of reinforcing steel weldability other than ASTM A706.	Periodic	SI	1705A.3.1 ; AWS D1.4; DSA IR 17-3. Verify carbon equivalent reported on mill certificates.
<input type="checkbox"/>	e. Inspect welding of reinforcing steel.	Continuous	SI	Table 1705A.2.1 Item 5b, 1705A.3.1, Table 1705A.3 Item 2, 1903A.8 ; AWS D1.4; DSA IR 17-3.
19.2 FIELD WELDING:				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>	a. Inspect groove welds, multi-pass fillet welds, single pass fillet welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Items 5a.1–4 ; AISC 360-16 (AISC 341-16 as applicable); DSA IR 17-3.
<input type="checkbox"/>	b. Inspect single-pass fillet welds ≤ 5/16".	Periodic	SI	Table 1705A.2.1 Item 5a.5 ; AISC 360-16 (AISC 341-16 as applicable); DSA IR 17-3.
<input type="checkbox"/>	c. Inspect end-welded studs (ASTM A-108) installation (including bend test).	Periodic	SI	2213A.2 ; AISC 360-16 (AISC 341-16 as applicable); AWS D1.1; DSA IR 17-3.
<input type="checkbox"/>	d. Inspect floor and roof deck welds.	Periodic	SI	1705A.2.2, Table 1705A.2.1 Item 5a.6 ; AISC 360-16 (AISC 341-16 as applicable); AWS D1.3; DSA IR 17-3.
<input type="checkbox"/>	e. Inspect welding of structural cold-formed steel.	Periodic	SI*	1705A.2.5; AWS D1.3; DSA IR 17-3. The quality control provisions of AISI S240-15 Chapter D shall also apply. * May be performed by the project inspector when specifically approved by DSA.
<input type="checkbox"/>	f. Inspect welding of stairs and railing systems.	Periodic	SI*	1705A.2.1 ; AISC 360-16 (AISC 341-16 as applicable); AWS D1.1 & D1.3; DSA IR 17-3. * May be performed by the project inspector when specifically approved by DSA.
<input type="checkbox"/>	g. Verification of reinforcing steel weldability.	Periodic	SI	1705A.3.1 ; AWS D1.4; DSA IR 17-3. Verify carbon equivalent reported on mill certificates.
<input type="checkbox"/>	h. Inspect welding of reinforcing steel.	Continuous	SI	Table 1705A.2.1 Item 5b, 1705A.3.1, Table 1705A.3 Item 2, 1903A.8 ; AWS D1.4; DSA IR 17-3.

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (Steel and Aluminum)

1705A.2.1, Table 1705A.2.1; AISC 303-16, AISC 341-16, AISC 358-16, AISC 360-16; AISI S100-16

Application Number: 01-118969

School Name: Morrill Middle School

School District: Berryessa Union School

District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/15/2020

20. NONDESTRUCTIVE TESTING: 1705A.2.1, Table 1705A.2.1; AISC 303-16, AISC 341-16, AISC 358-16, AISC 360-16; AISI S100-16				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>	a. Ultrasonic	Test	LOR	1705A.2.1, 1705A.2.5; AISC 341-16 J6.2, AISC 360-16 N5.5; ANSI/ASNT CP-189, SNT-TC-1A; AWS D1.1, AWS D1.8; DSA IR 17-2.
<input type="checkbox"/>	b. Magnetic Particle	Test	LOR	1705A.2.1, 1705A.2.5; AISC 341-16 J6.2, AISC 360-16 N5.5; ANSI/ASNT CP-189, SNT-TC-1A; AWS D1.1, AWS D1.8; DSA IR 17-2.
<input type="checkbox"/>				

21. STEEL JOISTS AND TRUSSES: 1705A.2.1, Table 1705A.2.1; AISC 303-16, AISC 341-16, AISC 358-16, AISC 360-16; AISI S100-16				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>	a. Verify size, type and grade for all chord and web members as well as connectors and weld filler material; verify joist profile, dimensions and camber (if applicable); verify all weld locations, lengths and profiles; mark or tag each joist.	Continuous	SI	1705A.2.3, Table 1705A.2.3; AWS D1.1; DSA IR 22-3 for steel joists only. 1705A.2.4; AWS D1.3 for cold-formed steel trusses.

22. SPRAY APPLIED FIRE-PROOFING: 1705A.2.1, Table 1705A.2.1; AISC 303-16, AISC 341-16, AISC 358-16, AISC 360-16; AISI S100-16				
	Test or Special Inspection	Type	Performed By	Code References and Notes

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (Steel and Aluminum)

1705A.2.1, Table 1705A.2.1; AISC 303-16, AISC 341-16, AISC 358-16, AISC 360-16; AISI S100-16

Application Number: 01-118969

School Name: Morrill Middle School

School District: Berryessa Union School

District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/15/2020

<input type="checkbox"/>	a. Examine structural steel surface conditions, inspect application, take samples, measure thickness and verify compliance of all aspects of application with DSA-approved documents.	Periodic	SI	1705A.14.
<input type="checkbox"/>	b. Test bond strength.	Test	LOR	1705A.14.6.
<input type="checkbox"/>	c. Test density.	Test	LOR	1705A.14.5.

23. ANCHOR BOLTS AND ANCHOR RODS:				
<input type="checkbox"/>	a. Anchor Bolts and Anchor Rods	Test	LOR	Sample and test anchor bolts and anchor rods not readily identifiable per procedures noted in DSA IR 17-11.
<input type="checkbox"/>	b. Threaded rod not used for foundation anchorage.	Test	LOR	Sample and test threaded rods not readily identifiable per procedures noted in DSA IR 17-11.

23.1 OTHER STEEL:				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>				

Appendix: Work Exempt from DSA Requirements for Structural Tests / Special Inspections

Application Number: 01-118969

School Name: Morrill Middle School

School District: Berryessa Union School
District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/15/2020

Exempt items given in DSA IR A-22 or the 2019 CBC (including DSA amendments) and those items identified below with an "X" by the design professional are NOT subject to DSA requirements for the structural tests / special inspections noted. **Items marked as exempt shall be identified on the approved construction documents.** The project inspector shall verify all construction complies with the approved construction documents.

	SOILS:
<input type="checkbox"/>	1. Deep foundations acting as a cantilever footing designed based on minimum allowable pressures per CBC Table 1806A.2 and having no geotechnical report for the following cases: A) free standing sign or scoreboard, B) cell or antenna towers and poles less than 35'-0" tall (e.g., lighting poles, flag poles, poles supporting open mesh fences, etc.), C) single-story structure with dead load less than 5 psf (e.g., open fabric shade structure), or D) covered walkway structure with an apex height less than 10'-0" above adjacent grade.
<input type="checkbox"/>	2. Shallow foundations, etc. are exempt from special inspections and testing by a Geotechnical Engineer for the following cases: A) buildings without a geotechnical report and meeting the exception Item #1 criteria in CBC Section 1803A.2 supported by native soil (any excavation depth) or fill soil (not exceeding 12" depth per CBC, Section 1804A.6), B) soil scarification/recompaction not exceeding 12" depth, C) native or fill soil supporting exterior non-structural flatwork (e.g., sidewalks, site concrete ramps, site stairs, parking lots, driveways, etc.), D) unpaved landscaping and playground areas, or E) utility trench backfill.

	CONCRETE/MASONRY:
<input type="checkbox"/>	1. Post-installed anchors for the following: A) exempt non-structural components (e.g., mechanical, electrical, plumbing equipment - see Item 7 for "Welding") given in CBC Section 1617A.1.18 (which replaces ASCE 7-16, Section 13.1.4) or B) interior nonstructural wall partitions meeting criteria listed in exempt Item 3 for "Welding."
<input type="checkbox"/>	2. Concrete batch plant inspection is not required for items given in CBC Section 1705A.3.3.2 subject to the requirements and limitations in that section.
<input type="checkbox"/>	3. Non-bearing non-shear masonry walls may be exempt from certain DSA masonry testing and special inspection items as allowed per DSA IR 21-1. Refer to construction documents for specific exemptions accordingly for each applicable wall condition.
<input type="checkbox"/>	4. Epoxy shear dowels in site flatwork and/or other non-structural concrete.
<input type="checkbox"/>	5. Testing of reinforcing bars is not required for items given in CBC Section 1910A.2 subject to the requirements and limitations in that section.

Appendix: Work Exempt from DSA Requirements for Structural Tests / Special Inspections

Application Number: 01-118969

School Name: Morrill Middle School

School District: Berryessa Union School
District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/15/2020

	Welding:
<input type="checkbox"/>	1. Solid-clad and open-mesh gates with maximum leaf span or rolling section for rolling gates of 10' and apex height less than 8'-0" above lowest adjacent grade. When located above circulation or occupied space below, these gates are not located within 1.5x gate/fence height (max 8'-0") to the edge of floor or roof.
<input type="checkbox"/>	2. Handrails, guardrails and modular or relocatable ramps associated with walking surfaces less than 30" above adjacent grade (excluding post base connections per the 'Exception' language in Section 1705A.2.1); fillet welds shall not be ground flush.
<input type="checkbox"/>	3. Non-structural interior cold-formed steel framing spanning less than 15'-0", such as in interior partitions, interior soffits, etc. supporting only self weight and light-weight finishes or adhered tile, masonry, stone, or terra cotta veneer no more than 5/8" thickness and apex less than 20'-0" in height and not over an exit way. Maximum tributary load to a member shall not exceed the equivalent of that occurring from a 10'x10' opening in a 15' tall wall for a header or king stud.
<input type="checkbox"/>	4. Manufactured support frames and curbs using hot rolled or cold-formed steel (i.e., light gauge) for mechanical, electrical, or plumbing equipment weighing less than 2000# (equipment only) (connections of such frames to superstructure elements using welding will require special inspection as noted in selected item(s) for Sections 19, 19.1 and/or 19.2 of listing above).
<input type="checkbox"/>	5. Manufactured components (e.g., Tolco, B-Line, Afcon, etc.) for mechanical, electrical, or plumbing hanger support and bracing (connections of such components to superstructure elements using welding will require special inspection as noted in selected item(s) for Sections 19, 19.1 and/or 19.2 of listing above).
<input type="checkbox"/>	6. TV Brackets, projector mounts with a valid listing (see DSA IR A-5) and recreational equipment (e.g., playground structures, basketball backstops, etc.) (connections of such elements to superstructure elements using welding will require special inspection as noted in selected item(s) for section 19, 19.1 and/or 19.2 located in the Steel/Aluminum category).
<input type="checkbox"/>	7. Any support for exempt non-structural components given in CBC Section 1617A.1.18 (which replaces ASCE 7-16, Section 13.1.4) meeting the following: A) when supported on a floor/roof, <400# and resulting composite center of mass (including component's center of mass) ≤4' above supporting floor/roof, B) when hung from a wall or roof/floor, <20# for discrete units or <5 plf for distributed systems.

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (SIGNATURE)

Application Number: 01-118969

School Name: Morrill Middle School

School District: Berryessa Union School

District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/15/2020

Name of Architect or Engineer in general responsible charge: Mark C. Finney	
Name of Structural Engineer (When structural design has been delegated):	
Signature of Architect or Structural Engineer:	Date: 03/03/2020



Note: Do not use secured electronic or digital signatures preventing DSA mark-ups.

DSA STAMP
IDENTIFICATION STAMP DIV. OF THE STATE ARCHITECT
APP: 01-118969 INC:
REVIEWED FOR
SS <input checked="" type="checkbox"/> FLS <input type="checkbox"/> ACS <input type="checkbox"/>
DATE: 09/16/2020

DSA 103: LIST OF REQUIRED VERIFIED REPORTS

Application Number: 01-118969	School Name: Morrill Middle School	School District: Berryessa Union School District
DSA File Number: 43-7	Increment Number: N/A	Date Submitted: 04/15/2020

1. Structural Testing and Inspection: Laboratory Verified Report Form DSA 291
 2. Concrete Batch Plant Inspection: Laboratory Verified Report Form DSA 291
 3. Shop Welding Inspection: Laboratory Verified Report Form DSA 291, or, for independently contracting SI, Special Inspection Verified Report Form DSA 292
 4. High-Strength Bolt Installation Inspection: Laboratory Verified Report Form DSA 291, or, for independently contracting SI, Special Inspection Verified Report Form DSA 292
-



PIEDMONT MIDDLE SCHOOL SHADE STRUCTURES, ENTRY CANOPY & MARQUEE SIGN

955 PIEDMONT RD. SAN JOSE, CA 95132
BERRYESSA UNION SCHOOL DISTRICT

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 01-118984 INC.
REVIEWED FOR
SS FLS ACS
DATE: 09/13/2020
(DSA STAMP AREA)

SUGIMURA FINNEY ARCHITECTS
SFA
ARCHITECTURE INTERIORS PLANNING
2155 SOUTH BASCOM AVE.
SUITE 200
CAMPBELL, CA 95008
PHONE: 408.271.9209
FAX: 408.377.6666



GENERAL NOTES

PRE-BID SITE VISIT
CONTRACTOR SHALL VISIT THE PROJECT AREA IN ORDER TO BECOME FAMILIAR WITH EXISTING CONDITIONS AND THE REQUIREMENTS OF THE PROJECT. THE CONTRACTOR MAY CONTACT THE ARCHITECT DURING THE BIDDING PHASE REGARDING CLARIFICATIONS AND PROJECT REQUIREMENTS.

SAFETY
IN ACCORDANCE WITH GENERALLY ACCEPTED CONSTRUCTION PRACTICES, THE CONTRACTOR WILL BE SOLELY AND COMPLETELY RESPONSIBLE FOR CONDITIONS OF THE JOB SITE INCLUDING SAFETY OF ALL PERSONS AND PROPERTY DURING PERFORMANCE OF THE WORK. THIS REQUIREMENT WILL APPLY CONTINUOUSLY AND NOT BE LIMITED TO NORMAL WORKING HOURS.

DAMAGE TO STRUCTURE OR SYSTEMS TO REMAIN
CONTRACTOR SHALL REIMBURSE THE OWNER FOR REPAIR AND REPLACEMENT, INCLUDING ARCHITECT'S FEES, FOR ANY DAMAGE CAUSED TO STRUCTURES, LANDSCAPE, SITE WORK, OR EXISTING SYSTEMS TO REMAIN, AS THE RESULT OF CONSTRUCTION OPERATIONS.

EXISTING CONDITIONS
ALL EXISTING CONDITIONS ARE SHOWN BASED ON THE BEST INFORMATION AVAILABLE AT THE TIME, BUT WITHOUT GUARANTEE OF ACCURACY. THE CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS, DIMENSIONS, AND BUILDING DATA AT THE JOB SITE. ANY DISCREPANCIES REQUIRING MODIFICATION TO THE CONSTRUCTION DOCUMENTS SHALL BE REPORTED TO THE ARCHITECT IMMEDIATELY. NO MODIFICATIONS SHALL BE MADE BY THE CONTRACTOR WITHOUT PRIOR APPROVAL FROM THE ARCHITECT.

CONTRACTOR'S EQUIPMENT
COORDINATE WITH OWNER'S REPRESENTATIVE FOR APPROVED LOCATION OF JOB SITE ACCESS, PARKING, AND LOCATION OF CONTRACTOR'S EQUIPMENT AND MATERIAL STORAGE AREA. SEE SITE PLAN FOR ADDITIONAL NOTES.

UTILITY SHUT-DOWNS AND CONNECTIONS
ALL REQUIRED UTILITY SHUT DOWNS SHALL HAVE PRIOR APPROVAL FROM THE OWNER'S REPRESENTATIVE. REQUEST SHALL BE SUBMITTED WITH ADEQUATE ADVANCE NOTICE PER PROJECT REQUIREMENTS.

ASBESTOS AND ASBESTOS PRODUCTS
THE OWNER/OPERATOR AND CONTRACTOR SHALL BE AWARE THAT BUILDINGS CONSTRUCTED PRIOR TO 1978 (OR THEREABOUTS) POSSIBLY CONTAIN ASBESTOS IN SOME EXISTING CONSTRUCTION MATERIALS, AND WILL LIKELY BE ENCOUNTERED DURING ALTERATIONS OR REMODELING.

UNDER CALIFORNIA TITLE 8, THE OWNER AND CONTRACTOR BOTH HAVE RESPONSIBILITIES TO DETERMINE THE EXISTENCE OF ASBESTOS CONTAINING MATERIALS IN AREAS TO BE ALTERED OR REMODELED PRIOR TO COMMENCEMENT OF WORK AND TO TAKE APPROPRIATE MEASURES TO PROTECT PERSONNEL. CAL-OSHA HAS JURISDICTION OVER ASBESTOS RELATED WORK. ASBESTOS RELATED WORK SHALL BE DONE IN ACCORDANCE WITH CALIFORNIA GENERAL INDUSTRIAL SAFETY ORDERS, TITLE 8, SECTION 341.6 THROUGH 341.14. ASBESTOS IN THE WORK ENVIRONMENT IS REGULATED BY TITLE 8, SECTION 5208.

THE BAY AREA AIR QUALITY MANAGEMENT DISTRICT AND DISTRICT REGULATION 11-2-401.3 REQUIRES EVERY RENOVATION INVOLVING THE REMOVAL OF 100 SQ. FT., LN.F.T. OR GREATER OF REGULATED ASBESTOS CONTAINING MATERIAL, AND FOR EVERY DEMOLITION (EVEN WHEN NO ASBESTOS IS PRESENT), A NOTIFICATION MUST BE SENT TO THE BAAQMD AT LEAST 10 WORKING DAYS PRIOR TO COMMENCEMENT OF DEMOLITION/RENOVATION.

ALL BUILDING MATERIALS MUST BE ASBESTOS FREE.
THESE DOCUMENTS DO NOT ADDRESS CONTAINMENT FOR EXISTING AREAS OF ASBESTOS WHICH MAY BE DISCOVERED DURING CONSTRUCTION. THE OWNER'S ABATEMENT SUBCONTRACTOR IS SOLELY RESPONSIBLE FOR THE DETECTION, REMOVAL, AND THE DISPOSAL OF ANY EXISTING ASBESTOS MATERIAL, ARCHITECTURAL AND ENGINEERING FEES FOR ADDITIONAL WORK TO OBTAIN STATE APPROVALS, AS WELL AS THE COST OF ANY REPAIRS, FOR DAMAGE CAUSED OR REPLACEMENT OF EXISTING SYSTEMS TO REMAIN, DUE TO WORK PERFORMED BY THE ASBESTOS ABATEMENT SUBCONTRACTOR, SHALL BE THE RESPONSIBILITY OF SAID SUBCONTRACTOR.

CONSTRUCTION SCHEDULING
CONTRACTOR SHALL COORDINATE ALL CONSTRUCTION OPERATIONS WITH OWNER'S REPRESENTATIVE PRIOR TO SCHEDULING AND START OF THE WORK. CONTRACTOR SHALL PROVIDE PROTECTION TO ALL EXISTING SPACES AND SYSTEMS WHICH ARE IN USE, ADJOINING THE PROJECT, AND NOT PART OF THE PROJECT.

INTERIOR FINISHES
INTERIOR FINISHES AND ALL WALL COVERING MATERIAL SHALL CONFORM TO CCR TITLE 24, PART 2, CHAPTER 6.

TITLE 24 COMPLIANCE
THE INTENT OF THESE DRAWINGS AND SPECIFICATIONS IS THAT THE WORK OF THE ALTERATION, REHABILITATION, OR RECONSTRUCTION IS TO BE IN ACCORDANCE WITH TITLE 24, CALIFORNIA CODE OF REGULATIONS (2019 CBC), SHOULD ANY EXISTING CONDITIONS BE DISCOVERED NOT COVERED BY THE CONTRACT DOCUMENTS WHERE IN THE FINISHED WORK DOES NOT COMPLY WITH 2019 CBC. A CONSTRUCTION CHANGE DOCUMENT OR A SEPARATE SET OF PLANS AND SPECIFICATIONS, DETAILING AND SPECIFYING THE REQUIRED WORK, SHALL BE SUBMITTED TO AND APPROVED BY THE DSA BEFORE PROCEEDING WITH THE WORK.

ADMINISTRATIVE REQUIREMENTS FROM PART 1, TITLE 24, C.C.R.
- ADDENDA AND CHANGES AS PER SECTION 4-338
- INSPECTOR APPROVED BY DSA
- INSPECTOR AND CONTINUOUS INSPECTION OF WORK PER SECTION 4-333 (B) AND 4-342
- TESTS AND TESTING LABORATORY PER SECTION 4-335 (OWNER SHALL PAY THE TESTING LABORATORY)
- SPECIAL INSPECTION PER SECTION 4-333 (C)
- CONTRACTOR SHALL SUBMIT VERIFIED REPORT OR SECTION 4-336 & 4-343 (C)
- ADMINISTRATION OR CONSTRUCTION PER PART 1, TITLE 24, C.C.R. DUTIES OF ARCHITECT, STRUCTURAL ENGINEER, OR PROFESSIONAL ENGINEER PER SECTION 4-333 (A) AND 4-341
- DUTIES OF CONTRACTOR PER SECTION 4-343
- VERIFIED REPORTS PER SECTION 4-343 AND 4-336
- A COPY OF PARTS 1 TO 5 OF TITLE 24 SHALL BE KEPT AND AVAILABLE IN THE FIELD DURING CONSTRUCTION
- DSA SHALL BE NOTIFIED AT START OF CONSTRUCTION AND PRIOR TO PLACEMENT OF CONCRETE PER SECTION 4-331
- SUPERVISION BY DSA PER SECTION 4-334
- DSA IS NOT SUBJECT TO ARBITRATION

PIPES, DUCTS AND CONDUIT - SUPPORT AND BRACING
PIPES, DUCTS, AND CONDUITS SHALL BE SUPPORTED AND BRACED PER THE SMACNA "GUIDELINES" FOR SEISMIC RESTRAINTS OF MECHANICAL SYSTEMS AND PLUMBING PIPING SYSTEMS", OPM 0062-13 SEISMIC BRACING AND SUPPORT SYSTEMS.

DRILLED-IN EXPANSION ANCHORS
WHEN INSTALLING DRILLED-IN ANCHORS AND/OR POWDER DRIVEN PINS IN EXISTING NON-PRESTRESSED REINFORCED CONCRETE, USE CARE AND CAUTION TO AVOID CUTTING OR DAMAGING THE EXISTING REINFORCING BARS. WHEN INSTALLING THEM INTO EXISTING PRESTRESSED CONCRETE (PRE-OR POST-TENSIONED), LOCATE THE PRESTRESSED TENDONS BY USING A NON-DESTRUCTIVE METHOD PRIOR TO INSTALLATION. EXERCISE EXTREME CARE AND CAUTION TO AVOID CUTTING OR DAMAGING THE TENDONS DURING INSTALLATION. MAINTAIN A MINIMUM CLEARANCE OF ONE INCH BETWEEN THE REINFORCEMENT AND THE DRILLED-IN ANCHOR AND/OR PIN.

GENERAL NOTES

ADMINISTRATIVE REQUIREMENTS
- ADDENDA MUST BE SIGNED BY ARCHITECT AND APPROVED BY DSA
- NO CHANGES OR REVISIONS SHALL BE MADE FOLLOWING WRITTEN APPROVAL WHICH AFFECTS ACCESS COMPLIANCE ITEM UNLESS SUCH CHANGES TO REVISIONS ARE SUBMITTED TO DSA FOR APPROVAL. SUBSTITUTIONS AFFECTING DSA REGULATED ITEMS SHALL BE SUBMITTED AS A CONSTRUCTION CHANGE DOCUMENT OR ADDENDA, AND SHALL BE APPROVED BY DSA PRIOR TO FABRICATION AND INSTALLATION
- CONSTRUCTION CHANGE DOCUMENTS MUST BE SIGNED BY THE FOLLOWING:
- ARCHITECT OR ENGINEER OF RECORD
- STRUCTURAL ENGINEER (WHEN APPLICABLE)
- DELEGATED PROFESSIONAL ENGINEER
- DSA
- MATERIALS AND THEIR INSTALLATIONS SHALL COMPLY WITH APPLICABLE CODES.
- PER CBC 11B-104.1 ALL DIMENSIONS ARE SUBJECT TO CONVENTIONAL INDUSTRY TOLERANCES EXCEPT WHERE THE REQUIREMENT IS STATED AS A RANGE WITH SPECIFIC MINIMUM AND MAXIMUM END POINTS.

SOILS AND GEOTECHNICAL: A GEOTECHNICAL INVESTIGATION MUST BE CONDUCTED IN ACCORDANCE WITH CBC SECTION 1803A AND REPORTED AS REQUIRED IN SECTION 1803A.7 (SEE EXCEPTION IN APPENDIX A ITEM C3). THE DESIGN ARCHITECT OR STRUCTURAL ENGINEER IN GENERAL RESPONSIBLE CHARGE MUST VERIFY THAT THE GEOTECHNICAL REPORT INDICATES THAT ALL SOILS RELATED PARAMETERS EXCEED THE MINIMUM DESIGN REQUIREMENTS IDENTIFIED ON THE PC DRAWINGS INCLUDING BUT NOT LIMITED TO ALLOWABLE SOIL PRESSURES, SURCHARGE, DOWN-DRAW, AND EFFECTS DUE TO HIGH-WATER TABLE, ETC., AS APPLICABLE.

GEHAZARD REPORT (ENGINEERING GEOLOGIC REPORT): A GEOLOGIC HAZARDS INVESTIGATION MUST BE CONDUCTED IN ACCORDANCE WITH CBC SECTION 1803A.8 AND IR 4-4. GEHAZARD REPORT REQUIREMENTS. THE DESIGN ARCHITECT OR STRUCTURAL ENGINEER IN GENERAL RESPONSIBLE CHARGE MUST VERIFY THAT THE GEOLOGIC HAZARDS WHICH WOULD PRECLUDE THE USE OF THE PC DESIGN AT THE SITE, INCLUDING BUT NOT LIMITED TO LIQUEFACTION POTENTIAL, LANDSLIDE, FLOODING, EARTHQUAKE FAULTING, ETC.

ABBREVIATIONS

(REFER TO CONSULTANT DRAWINGS FOR ADDITIONAL ABBREVIATIONS)

A.F.F.	ABOVE FINISHED FLOOR	LAM.	LAMINATE
A.P.	ACCESS PANEL	LAV.	LAVATORY
ACT	ACOUSTIC TILE	M.B.	MACHINE BOLT
ADJ.	ADJUSTABLE	M.S.	MACHINE SCREW
ALUM.	ALUMINUM	M.H.	MANHOLE
AB	ANCHOR BOLT	MFG.	MANUFACTURER
APPROX.	APPROXIMATELY	M.B.	MARKER BOARD
ARCH.	ARCHITECT	MATL.	MATERIAL
AC	ASPHALTIC CONCRETE	MAX.	MAXIMUM
B	BENCH MARK	MECH.	MECHANICAL
B.M.	BLOCKING	MIN.	MINIMUM
BLKG.	BOARD	MISC.	MISCELLANEOUS
B.W.	BOTH WAYS	MTD.	MOUNTED
BOT.	BOTTOM	(N)	NEW
BLDG.	BUILDING	NOM.	NOMINAL
B.U.R.	BUILT-UP ROOFING	N.I.C.	NOT IN CONTRACT
C.B.	CATCH BASIN	N.T.S.	NOT TO SCALE
C.E.	CEILING	NO. or #	NUMBER
C.M.	CEMENT	OCC.	OCCUPANT(CY)
C.C. or O.C.	CENTER TO CENTER	OPN.	OPENING
CER.	CERAMIC TILE	OPP.	OPPOSITE
C.O.	CLEANOUT	O.S.H.	OPPOSITE HAND
C.O.T.G.	CLEANOUT TO GRADE	O.S.	OUTSIDE FACE OF STUD
CLR.	CLEAR	O.H.W.S.	OVAL HEAD WOOD SCREW
C.A.H.R.	CLEAR ALL HEART REDWOOD	O.D.	OVERFLOW DRAIN and/or OUTSIDE DIAMETER
C.W.	COLD WATER	O.F.C.I.	OWNER FURNISHED and CONTRACTOR INSTALLED
COL.	COLUMN	PAR.	PARTITION
COM.	COMMON	PL	PLATE
CONC.	CONCRETE	P	PENNY (NAILS)
CONST.	CONSTRUCTION	PLAS.	PLASTER
C.H.	CONSTRUCTION HEART	PLYWD.	PLYWOOD
C.J.	CONSTRUCTION JOINT	P.V.C.	POLY VINYL CHLORIDE
CONT.	CONTINUOUS	PT.	PRESSURE TREATED
CONTR.	CONTRACTOR	P.L.	PROPERTY LINE
COUNTER.	COUNTER	R or RAD.	RADIUS
C.TSK.	COUNTER SUNK	R.W.L.	RAIN WATER LEADER
DET.	DETAIL	RWD/R.W.	REDWOOD
DIAM.	DIAMETER	REIN.	REINFORCING
DIM.	DIMENSION	R.F.	REINFORCING REQUIRED
D.A.	DISABLED ACCESS	R.A.G.	RETURN AIR GRILLE
DR.	DOOR	R.E.	RAIN ELEVATION
D.S.	DOWNSPOUT	R.D.R.	RAIN DRAIN
DWG.	DRAWING	R.M.	ROOM
D.F.	DRINKING FOUNTAIN and/or DRINKING FIR	R.O.	ROUGH OPENING
EA.	EACH	R.O.	ROUGH OPENING
E.W.	EACH WAY	SSD.	SEE STRUCTURAL DRAWINGS
ELEC.	ELECTRIC	S.T.S.M.S.	SELF TAPPING SHEET METAL SCREW
EL or ELEV.	ELEVATION	SHEATH.	SHEATHING
ENCL.	ENCLOSURE and/or ENCLOSURE	S.M.	SHEET METAL
EQ.	EQUAL	S.O.V.	SHUT OFF VALVE
EQUIP.	EQUIPMENT	S.C.	SOLID CORE
(E)	EXISTING	SPEC.	SPECIFICATION
EX.	EXPANSION	S.Q.	SQUARE
E.J.	EXPANSION JOINT	S.F.	SQUARE FEET
EXP.	EXPOSED	STAG.	STAGGERED
F.O.C.	FACE OF CONCRETE	STD.	STANDARD
F.O.M.	FACE OF MASONRY	STL.	STEEL
F.O.S.	FACE OF STUD	STR.	STRUCTURAL
F.O.F.	FACE OF FINISH	S.A.G.	SUPPLY AIR GRILLE
FIN.	FINISH	THRES.	THRESHOLD
F.F.	FINISHED FLOOR	T&G	TONGUE & GROOVE
F.S.	FINISH SLAB	T.J.	TOOLED JOINT
F.E.	FIRE EXTINGUISHER	T.O.B.	TOP OF BEAM
F.E.C.	FIRE EXTINGUISHER CABINET	T.O.C.	TOP OF CURB OR CONCRETE
F.H.	FIRE HYDRANT	T.O.S.	TOP OF STEEL OR SHEATHING
F.H.M.S.	FLAT HEAD METAL SCREW	T.O.W.	TOP OF WALK
F.H.W.S.	FLAT HEAD WOOD SCREW	TYP.	TYPICAL
FL. or FLR.	FLOOR	U.O.N.	UNLESS OTHERWISE NOTED
F.D.	FLOOR DRAIN	U.O.S.	UNLESS OTHERWISE SHOWN
FTG.	FOOTING	U.S.	UNITS
FND.	FOUNDATION	V.R.	VENT THROUGH ROOF
GALV.	GALVANIZED	VERT.	VERTICAL
G.I.	GALVANIZED IRON	V.G.	VERTICAL GRAIN
GA.	GAUGE	V.I.E.	VERIFY IN FIELD
GLU-LAM	GLUE-LAMINATED	V.C.T.	VINYL COMPOSITION TILE
GRD.	GRADE	V.V.	VINYL WALL COVERING
GYP. BD.	GYP. BOARD	V.O.I.P.	VOICE OVER INTERNET PROTOCOL
HDW.	HARDWARE	W.C.	WATER CLOSET
HT.	HEIGHT	W.H.	WATER HEATER
H.C.	HOLLOW CORE	W.P.	WATERPROOF
H.M.	HOLLOW METAL	W.R.	WATER RESISTANT
HORIZ.	HORIZONTAL	W.W.M.	WELDED WIRE MESH
INT.	INTERIOR	W.D.	WINDOW DIMENSION
INSUL.	INSULATION	W.	WITH
INV.	INVERT	W/O.	WITHOUT
JT.	JOINT	WD.	WOOD
J.H.	JOIST HANGER		
K.D.	KILN DRIED		



BUILDING CODES AND STANDARDS:

2019	CALIFORNIA ADMINISTRATIVE CODE, PART 1, TITLE 24, C.C.R.	
2019	CALIFORNIA BUILDING CODE (CBC), PART 2, TITLE 24, C.C.R.	
2019	(2018 INTERNATIONAL BUILDING CODE, VOLUMES 1 AND 2, WITH 2019 CALIFORNIA AMENDMENTS.)	
2019	CALIFORNIA ELECTRIC CODE (CEC), PART 3, TITLE 24, C.C.R.	
2019	(2018 NATIONAL ELECTRIC CODE WITH 2019 CALIFORNIA AMENDMENTS.)	
2019	CALIFORNIA MECHANICAL CODE (CMC), PART 4, TITLE 24, C.C.R.	
2019	(2018 UNIFORM MECHANICAL CODE WITH 2019 CALIFORNIA AMENDMENTS.)	
2019	CALIFORNIA PLUMBING CODE (CPC), PART 5, TITLE 24, C.C.R.	
2019	(2018 UNIFORM PLUMBING CODE WITH 2019 CALIFORNIA AMENDMENTS.)	
2019	CALIFORNIA ENERGY CODE (CEC), PART 6, TITLE 24, C.C.R.	
2019	(2018 NATIONAL ENERGY CODE WITH 2019 CALIFORNIA AMENDMENTS.)	
2019	CALIFORNIA FIRE CODE (CFC), PART 9, TITLE 24, C.C.R.	
2019	(2018 INTERNATIONAL FIRE CODE WITH 2019 CALIFORNIA AMENDMENTS.)	
2019	CALIFORNIA GREEN BUILDING STANDARDS CODE, PART 11, TITLE 24, C.C.R.	
2019	CALIFORNIA REFERENCED STANDARDS, PART 12, TITLE 24, C.C.R.	
2019	ASME A17.1 (W/17) IACSA B44a-08 ADDENDA) SAFETY CODE FOR ELEVATORS AND ESCALATORS	
2010	AIA STANDARDS FOR ACCESSIBLE DESIGN (2008 IBC PART 305 FOR TITLE II ENTITIES)	
CCR TITLE-19	PUBLIC SAFETY, STATE FIRE MARSHAL REGULATIONS.	
NFPA 13	INSTALLATION OF SPRINKLER SYSTEMS (CA AMENDED)	2016 EDITION
NFPA 14	INSTALLATION OF STANDPIPE & HOSE SYSTEMS (CA AMENDED)	2016 EDITION
NFPA 17	DRY CHEMICAL EXTINGUISHING SYSTEMS	2017 EDITION
NFPA 17A	WET CHEMICAL EXTINGUISHING SYSTEM	2017 EDITION
NFPA 20	STATIONARY FIRE PUMPS TO FIRE PROTECTION	2016 EDITION
NFPA 22	WATER TANKS FOR PRIVATE FIRE PROTECTION	2013 EDITION
NFPA 24	PRIVATE FIRE SERVICE MAINS (CA AMENDED)	2016 EDITION
NFPA 25	INSPECTION, TESTING AND MAINTENANCE OF WATER BASED FIRE PROTECTION SYSTEMS (CA AMENDED)	2013 CALIFORNIA EDITION
NFPA 72	NATIONAL FIRE ALARM CODE (CA AMENDED)	2016 EDITION
NFPA 80	STANDARD FOR OTHER OPENING PROTECTIVES	2016 EDITION
NFPA 92	STANDARD FOR SMOKE CONTROL SYSTEMS	2015 EDITION
NFPA 110	EMERGENCY AND STANDBY POWER SYSTEMS	2016 EDITION
NFPA 170	STANDARD FOR FIRE SAFETY AND EMERGENCY SYMBOLS	2018 EDITION
NFPA 253	CRITICAL RADIANT FLUX OF FLOOR COVERING SYSTEMS	2015 EDITION
NFPA 2001	CLEAN AGENT FIRE EXTINGUISHING SYSTEMS	2015 EDITION
ICC 300	STANDARDS FOR BLEACHERS, FOLDING AND TELESCOPIC SEATING, AND GRANDSTANDS	2017 EDITION
SFM 12-10-1	POWER OPERATED EXIT DOORS	1999/2005 EDITION
SFM 12-10-2	SINGLE POINT LATCHING OR LOCKING DEVICES	2009 EDITION
SFM 12-10-3	EMERGENCY EXIT & PANIC HARDWARE	
UL 38	MANUAL OPERATING SIGNAL BOXES	1999/2005 EDITION
UL 268	SMOKE DETECTORS FOR FIRE PROTECTIVE SIGNALING SYSTEMS	2009 EDITION
UL 268A	SMOKE DETECTORS DUCT APPLICATIONS	1998/2003 EDITION
UL 500	FIRE TESTING OF FIRE EXTINGUISHING SYSTEMS FOR PROTECTION OF COMMERCIAL COOKING EQUIPMENT	2005 (R2010)
UL 305	PANIC HARDWARE	2012 EDITION
UL 464	AUDIBLE SIGNALING DEVICES FOR FIRE ALARM AND SIGNALING SYSTEMS, AND ACCESSORIES	2003 EDITION
UL 521	HEAT DETECTORS FOR FIRE PROTECTIVE SIGNALING SYSTEMS	1999 EDITION
UL 864	CONTROL UNITS FOR FIRE PROTECTIVE SIGNALING SYSTEMS	2003 EDITION
UL 1971	(W/ REVISIONS THROUGH DEC. 2014) SIGNALING DEVICES FOR THE HEARING IMPAIRED	2002 EDITION

SYMBOLS LEGEND

	SECTION / EXTERIOR ELEVATION
	SECTION IDENTIFICATION SHEET WHERE SECTION IS DRAWN
	DETAIL
	DETAIL IDENTIFICATION SHEET WHERE DETAIL IS DRAWN
	INTERIOR ELEVATION
	INDICATES ELEVATION SHOWN SHEET WHERE ELEVATION IS DRAWN
	CLASSROOM
	ROOM IDENTIFICATION
	ROOM NUMBER
	SPECIFIC NOTE
	DOOR DESIGNATION
	WINDOW DESIGNATION
	ADDENDUM REVISION
	CLOUD AROUND REVISION
	CCD REVISION
	CLOUD AROUND REVISION
	FINISH NUMBER
	SEE SPECS AND I.E. DWGS.
	EQUIPMENT LETTER
	SEE EQUIPMENT SCHEDULE
	CEILING HEIGHT
	WALL TYPE
	MATCH LINE
	ELEV. HEIGHT
	F.O.S., U.O.N.
	FACE OF FINISH

PROJECT SUMMARY

INSTALLATION OF NEW PC STRUCTURES:
- METAL LUNCH SHADE STRUCTURES PC #04-117117:
TOTAL AREA 3,825 SQ.FT.
- ENTRY CANOPY PC #04-117117:
TOTAL AREA 100 SQ.FT.
- MARQUEE SIGN PC #04-116862: TOTAL AREA 15 SQ.FT.
- ASSOCIATED SITE WORK.

THESE ARE NO DEFERRED SUBMITTALS FOR THIS PROJECT.

DRAWING INDEX

T1	TITLE SHEET
T2	SITE PLAN - FIRE LIFE SAFETY & ACCESS COMPLIANCE
ARCHITECTURAL	
A0.1	DEMOLITION SITE PLAN
A0.2	NEW ENLARGED SITE PLAN - SHADE STRUCTURES AT AMPHITHEATER
A0.2.1	NEW SHADE STRUCTURES ELEVATION
A0.3	NEW ENLARGED SITE PLAN - ADMIN BUILDING ENTRY CANOPY - PEDESTRIAN WALKWAY
A0.4	NEW ENLARGED SITE PLAN - NEW MARQUEE SIGN
A0.5	SITE DETAILS
(ENTRY CANOPY) SHADE STRUCTURE, UPPER LEVEL SHADE STRUCTURE, AMPHITHEATER SHADE STRUCTURE, MANUFACTURER'S DRAWINGS DSA #04-117117	
S-1	COVER SHEET
S-2	GENERAL DATA
S-3	GENERAL NOTES
S-4	SAMPLE DSA 103 FORMS
S-5	SECTIONS PROPERTIES & REBAR DETAILS
S-6	VC 14, VC 18, & VC 20 FRAMING PLAN & ELEVATIONS
S-7	VC 14, VC 18, & VC 20 FRAMING SCHEDULES
S-8	VC 140, VC 180, & VC 200 FRAMING PLAN & ELEVATIONS
S-9	VC 140, VC 180, & VC 200 FRAMING SCHEDULES
S-10	PIER FOUNDATION AND SPREAD FOOTINGS SCHEDULES
S-11	STANDARD DETAILS 1
S-12	STANDARD DETAILS 2
S-13	SAMPLE ARCHITECTURAL ELEVATIONS

VICINITY MAP



PROJECT LOCATION

STATEMENT OF GENERAL CONFORMANCE

FOR ARCHITECTS / ENGINEERS WHO UTILIZE PLANS, INCLUDING BUT NOT LIMITED TO SHOP DRAWINGS, PREPARED BY OTHER LICENSED DESIGN PROFESSIONALS AND / OR OTHER CONSULTANTS

APPLICATION NO.: 01-118984 FILE NO.: 43-7

THE DRAWINGS OR SHEETS LISTED ON THE COVER OR INDEX SHEET
 THIS DRAWING, PAGE OF SPECIFICATIONS / CALCULATIONS

HAVE BEEN PREPARED BY OTHER DESIGN PROFESSIONALS OR CONSULTANTS WHO ARE LICENSED AND / OR AUTHORIZED TO PREPARE SUCH DRAWINGS IN THIS STATE. IT HAS BEEN EXAMINED BY ME FOR:

1) DESIGN INTENT AND APPEARS TO MEET THE APPROPRIATE REQUIREMENTS OF TITLE 24, CALIFORNIA CODE OF REGULATIONS AND THE PROJECT SPECIFICATIONS PREPARED BY ME, AND

2) COORDINATION WITH MY PLANS AND SPECIFICATIONS AND IS ACCEPTABLE FOR INCORPORATION INTO THE CONSTRUCTION OF THIS PROJECT.

THE STATEMENT OF GENERAL CONFORMANCE "SHALL NOT BE CONSTRUED AS RELIEVING ME OF MY RIGHTS, DUTIES, AND RESPONSIBILITIES UNDER SECTIONS 17002 AND 81109 OF THE EDUCATION CODE AND SECTIONS 4-336, 4-341 AND 4-344" OF TITLE 24, PART 1, (TITLE 24, PART 1, SECTION 4-317(B))

I FIND THAT:
 ALL DRAWINGS OR SHEETS LISTED ON THE COVER OR INDEX SHEET
 THIS DRAWING OR PAGE
 IS / ARE IN GENERAL CONFORMANCE WITH THE PROJECT DESIGN, AND
 HAS / HAVE BEEN COORDINATED WITH THE PROJECT PLANS AND SPECIFICATIONS.

MARK FINNEY 03/09/2020 DATE
C-24673 9/30/2021 DATE
LICENSE NUMBER EXPIRATION DATE

REVISIONS		
NO.	ITEM	DATE

TITLE SHEET
SHADE STRUCTURES
PIEDMONT MIDDLE SCHOOL
955 PIEDMONT RD., SAN JOSE, CA 95132
BERRYESSA UNION SCHOOL DISTRICT

DRAWN BY: MK
CHECKED BY: NJ
SFA JOB NO.: DATE
19063 06/17/2019

T1

SAFE DISPERSAL AREA
 TOTAL 'E' OCCUPANCY BUILDINGS WITH OCCUPANTS = 18,912
 18,912 SF @ 20 SF/OCC = 945 OCCUPANTS
 TOTAL 'B' OCCUPANCY BUILDINGS WITH OCCUPANTS = 9,028
 9,028 SF @ 100 SF/OCC = 90 OCCUPANTS
 TOTAL 'F-1' OCCUPANCY BUILDINGS WITH OCCUPANTS = 5,154
 5,154 SF @ 300 SF/OCC = 17 OCCUPANTS
 TOTAL OCCUPANTS = 945 + 90 + 17 = 1,052
 MINIMUM DISPERSAL AREA REQUIRED: OCCUPANTS x 5 SF/OCC
 1,052 x 5 SF = 5,260 SF
 AREA PROVIDED = 5,300 SF THEREFORE OK.

DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE STATEMENT:

THE PATH OF TRAVEL IDENTIFIED IN THESE CONSTRUCTION DOCUMENTS IS COMPLIANT WITH THE CURRENT APPLICABLE CALIFORNIA BUILDING CODE ACCESSIBILITY PROVISIONS FOR PATH OF TRAVEL REQUIREMENT FOR ALTERATIONS. ADDITIONS AND STRUCTURAL REPAIRS, AS PART OF THE DESIGN OF THIS PROJECT, THE P.O.T. WAS EXAMINED AND ANY ELEMENTS, COMPONENTS OR PORTIONS OF THE P.O.T. THAT WERE DETERMINED TO BE NONCOMPLIANT 1) HAVE BEEN IDENTIFIED AND 2) THE CORRECTIVE WORK NECESSARY TO BRING THEM INTO COMPLIANCE HAS BEEN INCLUDED WITHIN THE SCOPE OF THIS PROJECT'S WORK THROUGH DETAILS, DRAWINGS, AND SPECIFICATIONS INCORPORATED INTO THESE CONSTRUCTION DOCUMENTS. ANY NONCOMPLIANT ELEMENTS, COMPONENTS OR PORTIONS OF THE P.O.T. THAT WILL NOT BE CORRECTED BY THIS PROJECT BASED ON VALUATION THRESHOLD LIMITATIONS OR A FINDING OF UNREASONABLE HARSHNESS ARE INDICATED IN THESE CONSTRUCTION DOCUMENTS.
 DURING CONSTRUCTION, IF P.O.T. ITEMS WITHIN THE SCOPE OF THIS PROJECT REPRESENTED AS CODE COMPLIANT ARE FOUND TO BE NONCOMPLYING BEYOND REASONABLE CONSTRUCTION TOLERANCES, THEY SHALL BE BROUGHT INTO COMPLIANCE WITH THE CBC AS A PART OF THIS PROJECT BY MEANS OF A CONSTRUCTION CHANGE DOCUMENT.

PROJECT SUMMARY

INSTALLATION OF (2) NEW METAL LUNCH SHADE STRUCTURES, (1) ENTRY CANOPY, (1) MARQUEE SIGN, AND ASSOCIATED SITE WORK.

GENERAL NOTES

- A. THIS SHEET IS FOR ACCESS & FIRE LIFE SAFETY COMPLIANCE CODE RELATED ITEMS. FOR SCOPE OF WORK SEE SHEETS A0.1 AND A0.2, A0.3 & A0.4.
- B. REFER TO P.C. DRAWINGS FOR EXTENT OF P.C. WORK.
- C. ACCESSIBLE PATH OF TRAVEL (P.O.T.), AS INDICATED, IS A COMMON BARRIER FREE ACCESS ROUTE WITHOUT ANY ABRUPT VERTICAL CHANGES EXCEEDING A 1/2" BEVELED AT 1:2 MAXIMUM SLOPE, EXCEPT THAT LEVEL CHANGES DO NOT EXCEED 1/4" VERTICAL AND AT LEAST 48" WIDE. THE PATH SURFACE IS SLIP RESISTANT, STABLE, FIRM, AND SMOOTH. PASSING SPACES (11B-403.5.3) AT LEAST 60"x60" ARE LOCATED NOT MORE THAN 200' APART. PARTS OF P.O.T. WITH CONTINUOUS GRADIENTS HAVE 60" LEVEL AREAS (11B-403.7) NOT MORE THAN 400' APART. THE CROSS SLOPE DOES NOT EXCEED 2% AND SLOPE IN THE DIRECTION OF TRAVEL AND IS LESS THAN 5% UNLESS OTHERWISE INDICATED. P.O.T. SHALL BE MAINTAINED FREE OF OVERHANGING OBSTRUCTIONS TO 80" MINIMUM (11B-307.4) AND PROTRUDING OBJECTS GREATER THAN 4" PROJECTION FROM WALL AND ABOVE 27" AND LESS THAN 80" (11B-307.2).
- D. GATES IN THE PATH OF TRAVEL SHALL MEET DOOR REQUIREMENTS PER CBC SECTION 11B-404. ALL GATES HAVE ACCESSIBLE HARDWARE AND 10" MIN. SMOOTH BOTTOM OR KICK PLATES. PANIC HARDWARE AND EXIT SIGN MAY BE REQUIRED. COORDINATE WITH FIRE AND LIFE SAFETY.
- E. CONTRACTOR TO VERIFY ALL BARRIERS IN P.O.T. HAVE BEEN REMOVED.
- F. ALL EXTERIOR ENTRANCES AND EXITS IDENTIFIED WITH A TRIANGULAR SYMBOL ON THIS PLAN ARE ACCESSIBLE AND COMPLY WITH CBC 11B-401 AND INCLUDE A 32" CLEAR OPENING, THE REQUIRED STRIKE EDGE CLEARANCE AT PULL SIDE OF DOOR, LEVEL LANDINGS WITH A 2% MAX. SLOPE, AND AN ACCESSIBLE THRESHOLD, HARDWARE, CLOSER AND KICK PLATE.
- G. A 'DSA CERTIFIED' PROJECT INSPECTOR EMPLOYED BY THE DISTRICT (OWNER) AND APPROVED BY THE DSA SHALL PROVIDE CONTINUOUS INSPECTION OF THE WORK. THE DUTIES OF THE INSPECTOR ARE DEFINED IN SECTION 4-342, PART 1, TITLE 24, CCR.
- H. DSA ACCEPTED TESTING LABORATORY DIRECTLY EMPLOYED BY THE DISTRICT (OWNER) SHALL CONDUCT ALL THE REQUIRED TESTS AND INSPECTIONS FOR THE PROJECT.
- I. GRADING PLANS, DRAINAGE IMPROVEMENTS, ROAD AND ACCESS REQUIREMENTS AND ENVIRONMENTAL HEALTH CONSIDERATIONS SHALL COMPLY WITH ALL LOCAL ORDINANCES.

SITE PLAN - FIRE LIFE SAFETY & ACCESS COMPLIANCE NOTES

1. EXISTING FIRE HYDRANT
2. (N) PEDESTRIAN ACCESS GATE WITH PANIC HARDWARE. SEE DETAIL 9/A0.5
3. EXISTING TOW AWAY SIGN PER DSA #01-117027
4. (E) DA PARKING STALLS PER DSA #01-117160
5. (E) DA PARKING SIGN PER DSA #01-117160
6. (E) ACCESSIBLE DRINKING FOUNTAIN PER DSA #01-117027
7. (E) ACCESSIBLE BOYS RESTROOMS PER DSA #01-117027. SEE REFERENCE DRAWINGS
8. (E) ACCESSIBLE GIRLS RESTROOMS PER DSA #01-117027. SEE REFERENCE DRAWINGS
9. (N) METAL SHADE STRUCTURE PC #04-117117. SEE MANUFACTURER'S DRAWINGS.
10. (N) METAL SHADE STRUCTURE PC #04-117117. SEE MANUFACTURER'S DRAWINGS.
11. (N) ENTRY CANOPY PC #04-117117. IN COMPLIANCE WITH CBC SECTION 3105. SEE MANUFACTURER'S DRAWINGS. S2 DESIGN PARAMETERS, BUILDING DATA & S3 GENERAL NOTES, STEEL NOTES, CONCRETE NOTES SECTIONS.
12. (N) MARQUEE SIGN. SEE MANUFACTURER DRAWING PC#04-118682
13. (E) BACKFLOW PREVENTOR
14. (E) STREET LIGHT
15. (E) ACCESSIBLE RAMP PER 01-117027
16. (E) STAFF RESTROOM PER DSA #01-117027
17. (N) FIRE APPARATUS ACCESS GATE 22'-0" WIDE. SEE DETAIL 11/A0.5

DSA 810

FIRE & LIFE SAFETY SITE CONDITIONS SUBMITTAL

Division of the State Architect (DSA) documents referenced within this publication are available on the DSA Forms or DSA Publications webpages.
 To facilitate the Division of the State Architect's (DSA) fire and life safety plan review of project site conditions, DSA requires the design professional to provide the following information at time of project submittal for projects consisting of construction of a new campus, construction of new building(s), additions to existing buildings, and for site alternate design means for fire department emergency vehicle access, and fire suppression water supply. Information associated with compliance items 1 through 3 below is to be provided for all project types indicated above. Information associated with items 4 through 7 is to be completed when an alternate means is utilized. Acknowledgment by the school district and signature from the Local Fire Authority (LFA) is only required when an alternate design means is being requested.

The Project Information and Fire & Life Safety Information sections are to be completed for all projects and imaged onto the fire access site plan. When an alternate design/means is proposed, all sections on pages 1 and 2 are to be completed and imaged on the fire access site plan.

For additional information refer to the instructions at the end of this form and DSA Policy PL 09-01: Fire Flow for Buildings.

PROJECT INFORMATION

School District/Owner: BERRYESSA UNION SCHOOL DISTRICT
 Project Name/School: PIEDMONT MIDDLE SCHOOL SHADE STRUCTURES, ENTRY CANOPY, AND MARQUEE
 Project Address: 955 PIEDMONT ROAD, SAN JOSE, CA 95132

FIRE & LIFE SAFETY INFORMATION

1. Has a fire hydrant flow test been performed within the past 12 months? <i>(If yes, provide a copy of the test data.)</i>	Yes <input type="checkbox"/>	No <input checked="" type="checkbox"/>
2. Was the fire hydrant water flow test performed as part of this LFA review?	Yes <input type="checkbox"/>	No <input checked="" type="checkbox"/>
3. Is the project located within a designated fire hazard severity zone (FHSZ) as established by Cal-Fire? <i>(If yes, indicate FHSZ classification below.)</i>	Yes <input type="checkbox"/>	No <input checked="" type="checkbox"/>
Refer to the following website for FHSZ locations: http://egis.fire.ca.gov/FHSZ/	Moderate <input type="checkbox"/>	High <input type="checkbox"/> Very High <input type="checkbox"/>
Wildland Interface Area (WIFA) <i>(If any designations are checked, project design must meet the requirements.)</i>	Yes <input type="checkbox"/>	WIFA <input type="checkbox"/>

CONDITION MEANS AND METHODS RESOLUTION

	ALTERNATE ACCEPTED	
	Yes	No
4. Emergency vehicle access roadways do not meet CFC requirements.	<input type="checkbox"/>	<input checked="" type="checkbox"/>
4a. Acceptable Alternate: Emergency vehicle and personnel access as proposed by the project architect is acceptable for providing fire suppression and protection of life and property.	<input type="checkbox"/>	<input checked="" type="checkbox"/>
5. Fire Hydrants: Number and spacing does not meet CFC requirements.	<input type="checkbox"/>	<input checked="" type="checkbox"/>
5a. Acceptable Alternate: Number of fire hydrants and spacing as proposed by the project architect is acceptable for fire suppression and protection of life and property.	<input type="checkbox"/>	<input checked="" type="checkbox"/>
6. Fire Hydrants: Water flow and pressure are less than CFC minimum.	<input type="checkbox"/>	<input checked="" type="checkbox"/>
6a. Acceptable Alternate: The available flow and pressure is acceptable for providing fire suppression and protection of life and property.	<input type="checkbox"/>	<input checked="" type="checkbox"/>
7. Location of fire department connection(s) serving fire sprinkler systems or standpipe systems does not meet CFC requirements.	<input type="checkbox"/>	<input checked="" type="checkbox"/>
7a. Acceptable Alternate: The location of fire department connection serving the fire sprinkler system and/or standpipe system is acceptable for providing fire suppression and protection of life and property.	<input type="checkbox"/>	<input checked="" type="checkbox"/>

School District Acceptance of Acceptable Design Alternates

By signing this form, the school district acknowledges and accepts the proposed design as an alternative to California Building Code (CBC) and California Fire Code (CFC) minimum requirements, as indicated by one or more of the conditions indicated at items 4a, 5a, 6a or 7a, for providing fire and life safety protection of life and property.

Accepted by: _____ Title: _____
 Signature: _____ Date: _____

LOCAL FIRE AUTHORITY (LFA) INFORMATION

LFA Agency Name: SJFD - Bureau of Fire Prevention
 LFA Review Official: Gordana Sabatelli
 Title: Associate Engineer
 Work Phone: (408) 535-5886
 Work Email: gordana.sabatelli@sanjosca.gov

LFA Reviewer's Signature: _____ Date: _____

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP: 01-118984 INC.
 REVIEWED FOR
 SS FLS ACS
 DATE: 08/13/2020
 (DSA STAMP AREA)

SUGIMURA FINNEY ARCHITECTS
SFA
 ARCHITECTURE INTERIORS PLANNING
 2195 SOUTH BASCOM AVE
 SUITE 200
 CAMPBELL, CA 95008
 PHONE: 408.274.0000
 FAX: 408.274.0066



GRAPHIC KEY

- - - - - EXISTING PROPERTY LINE
- - - - - ASSUMED PROPERTY LINE
- - - - - ACCESSIBLE PATH OF TRAVEL
- - - - - ROOF OVERHANG
- - - - - CHAIN LINK FENCE
- - - - - WOOD FENCE
- - - - - DECORATIVE FENCE
- ▨ FIRE DEPARTMENT ACCESS. FIRE DEPARTMENT ACCESS IS 20' WIDE AND RATED FOR 90,000 LBS.
- (E) DRY STAND PIPE
- (E) FIRE HYDRANT
- DRINKING FOUNTAIN
- (E) SIGN
- NEW BUILDING
- ▨ EXISTING BUILDING

PARKING COUNT

PER 2016 CBC, TABLE 11B-208.2

(E) PARKING LOT

TOTAL PARKING SPACES (INCLUDING ALL ACCESSIBLE PARKING SPACES) = 73
 MINIMUM ACCESSIBLE PARKING SPACES REQUIRED = 3
 TOTAL STANDARD ACCESSIBLE SPACES + TOTAL VAN ACCESSIBLE SPACES PROVIDED = 1 + 3 = 4 THEREFORE, OKAY.
 * FOR EVERY SIX STANDARD ACCESSIBLE SPACES REQUIRED, AT LEAST ONE SHALL BE A VAN PARKING SPACE.

BUILDING CODE ANALYSIS


BUILDING	CONSTRUCTION TYPE	AREA (SQ.FT.)	ALLOWABLE (SQ.FT.)	# OF STORIES
(N) SHADE STRUCTURE	II-B / A3	3,825	6000	1

OCCUPANT LOAD ANALYSIS:

(N) SHADE STRUCTURE: (A3) ASSEMBLY UNCONCENTRATED: 3.825 SQ.FT./175 = 21.85 PERSONS. SPRINKLERS NOT REQUIRED.

1 SITE PLAN - FIRE LIFE SAFETY & ACCESS COMPLIANCE

2 EXISTING STAFF RESTROOM BLDG. J SEE NOTE 16

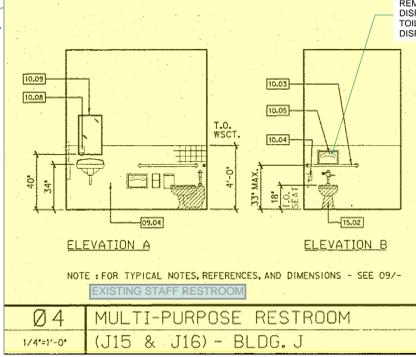


REVIEWED
 By Nicasio Lagman Date 8/1/2020
 SAN JOSE FIRE PREVENTION BUREAU

**SITE PLAN
 FIRE LIFE SAFETY & ACCESS COMPLIANCE**
 SHADE STRUCTURES
 PIEDMONT MIDDLE SCHOOL
 955 PIEDMONT RD. SAN JOSE, CA 95132
 BERRYESSA UNION SCHOOL DISTRICT

REVISIONS

NO.	ITEM	DATE

DRAWN BY: MK
 CHECKED BY: NJ
 SFA JOB NO: DATE:
 19063 06/17/2019

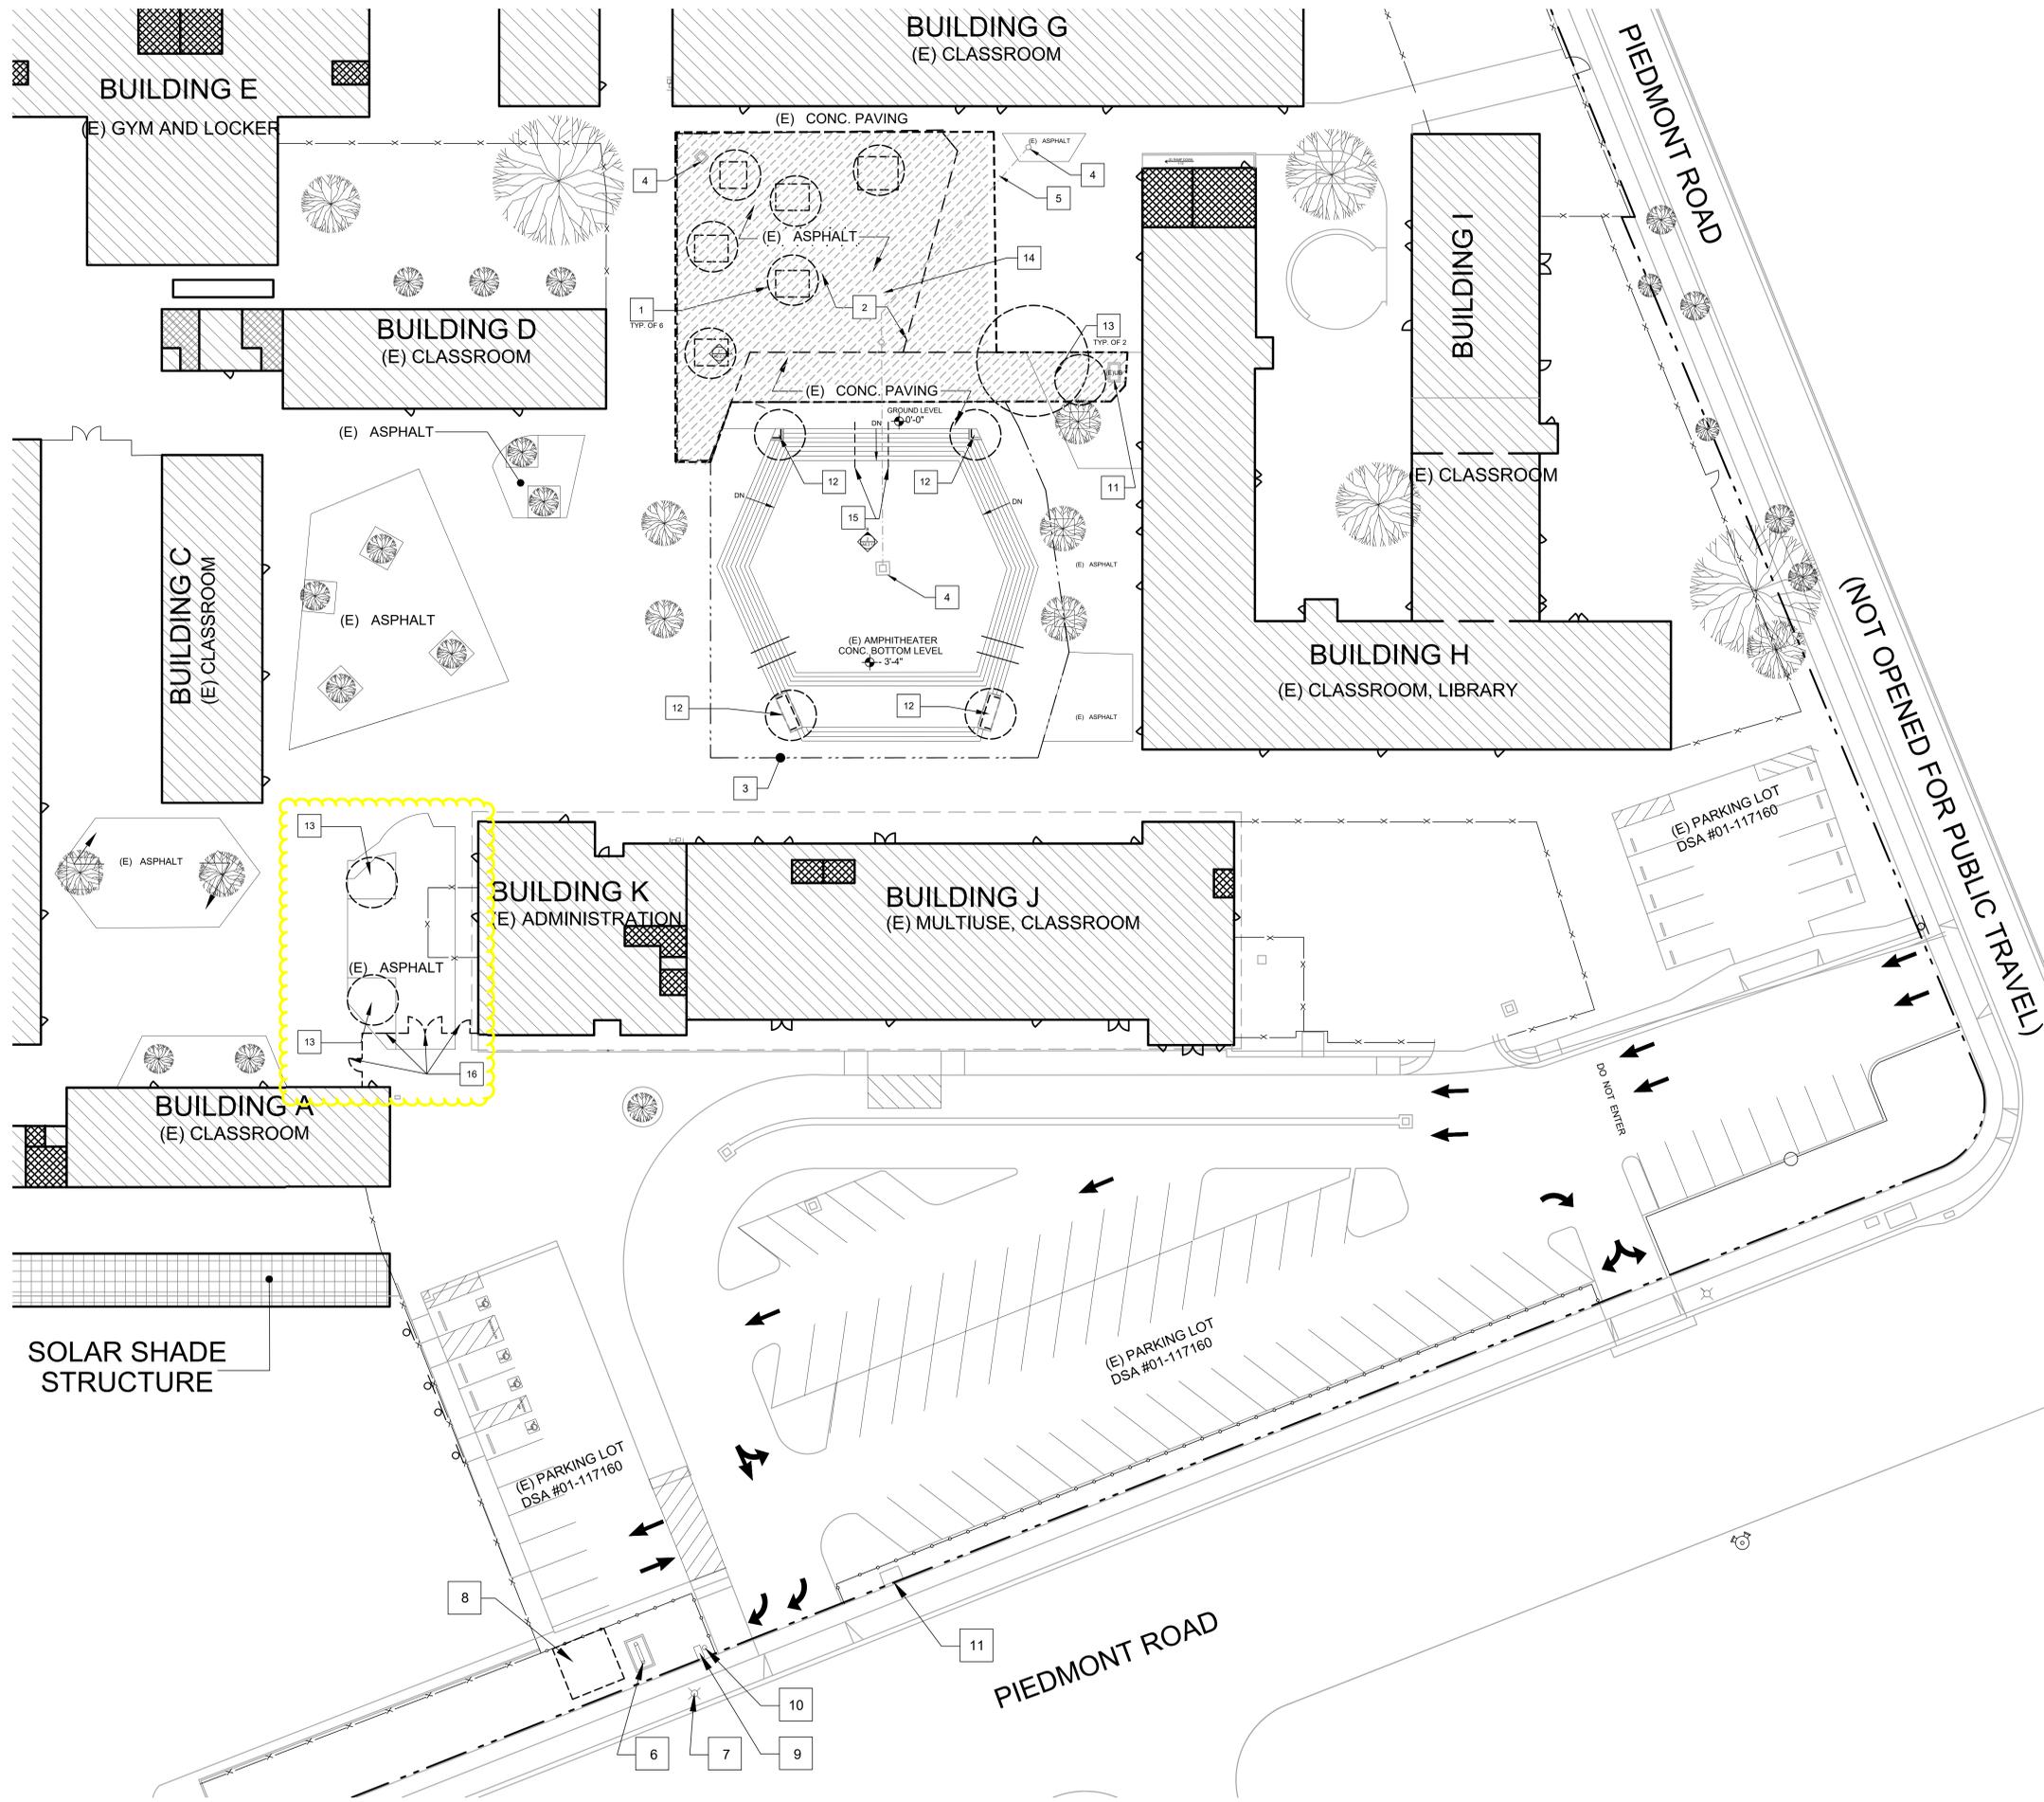

GENERAL NOTES

- A. CONTRACTOR TO VERIFY ALL BARRIERS IN P.O.T. HAVE BEEN REMOVED.
- B. CONTRACTOR TO REMOVE ALL EXISTING ITEMS TO ALLOW THE NEW WORK, INCLUDING BUT NOT LIMITED TO TREES, SHRUBS, ASPHALT PAVING, FENCING, STRIPING.
- C. GENERAL CONTRACTOR SHALL SURVEY THE AREA OF NEW CONSTRUCTION FOR UNDERGROUND UTILITIES PRIOR TO THE BEGINNING OF CONSTRUCTION, AND REROUTE/CAP ALL EXISTING UTILITIES RUNNING BELOW THE AREA OF THE NEW SHADE STRUCTURES IF IT CONFLICTS WITH NEW SHADE STRUCTURE FOOTINGS.
- D. THE CONTRACTOR SHALL VERIFY ALL UNDERGROUND UTILITIES WITH A LOCATING SERVICE PRIOR TO STARTING CONSTRUCTION.
- E. ALL UTILITIES TO BE ABANDONED SHALL BE REMOVED IN THEIR ENTIRETY, AND WIRING PULLED BACK TO SOURCE.
- F. REQUIRED UTILITY SHUTDOWNS SHALL BE REQUESTED 72 HOURS IN ADVANCE WITH ARCHITECT AND OWNER.
- G. CONTRACTOR TO PROVIDE AND MAINTAIN IN PROPER CONDITION TEMPORARY FENCING PER DETAIL 11A0.4 PRIOR TO START OF THE CONSTRUCTION AND DURING ALL THE CONSTRUCTION TIME. TEMPORARY FENCING TO BE INSTALLED ALONG THE PERIMETER OF WORK AREA.
- H. DEMOLITION WORK SHALL CONFORM TO CALIFORNIA GREEN CODE SECTION 5.408.3 & 5.408.4, AND LOCAL CONSTRUCTION WASTE MANAGEMENT REQUIREMENTS.
- J. CONTRACTOR TO REPLACE IN REPAVED ARE ALL (E) UTILITY BOXES WITH NEW INCLUDING LIDS. SEE NEW BOX TO MATCH (N) GRADE.
- K. PROVIDE TEMPORARY FENCING DURING CONSTRUCTION. SEE DETAIL 11A0.4

DEMOLITION SITE PLAN NOTES

- 1. DEMOLISH (E) TREE, STUMP AND ROOTS. FILL THE TRENCH WITH 95% COMPACTED SOIL. PREPARE FOR (N)AC PAVING.
- 2. DEMOLISH (E) PAVEMENT, GRADE AND PREPARE FOR (N) AC PAVING. REFER TO NEW PLAN FOR LIMITS OF WORK.
- 3. CONTRACTOR TO POWER WASH (E) CONCRETE PAVING AREA AT (E) AMPHITHEATER.
- 4. APPROXIMATE LOCATION OF (E) CATCH BASIN.
- 5. APPROXIMATE DIRECTION OF STORM DRAIN LINE, V.I.F.
- 6. (E) BACK FLOW PREVENTER ON CONCRETE PAD
- 7. (E) STREET LIGHT TO REMAIN
- 8. CLEAN AND PREPARE AREA FOR THE INSTALLATION OF A NEW MARQUE WITH CONCRETE FOOTINGS. SEE ENLARGED PLAN A0.4.
- 9. (E) UTILITY BOX CABLE COVER
- 10. (E) UTILITY BOX WATER LINE COVER
- 11. (E) UTILITY BOX
- 12. DEMOLISH (E) TREE, STUMP, ROOTS, BRICK PLANTER WALLS, AND SOIL. PREPARE FOR CONCRETE INFILL.
- 13. DEMOLISH (E) TREES, REMOVE STUMP AND ROOTS, FILL THE TRENCH WITH 95% COMPACTED SOIL. PREPARE FOR NEW AC PAVING.
- 14. (E) SEWER CLEAN OUT.
- 15. REMOVE EXISTING HANDRAILS.
- 16. REMOVE (E) CHAIN LINK FENCE AND GATES. RETURN GATES TO THE DISTRICT.

GRAPHIC KEY

- - - - - EXISTING PROPERTY LINE
- - - - - ROOF OVERHANG
- - - - - CHAINLINK FENCE
- - - - - DECORATIVE FENCE
- [Hatched Box] EXISTING BUILDING
- [Grid Box] EXISTING RESTROOMS
- [Dashed Box] AREA OF (E) PAVING DEMOLITION TO REPLACE WITH (N) AC PAVING. SEE A0.3
- [Dotted Box] AREA OF POWER WASH
- (E) DRY STAND PIPE
- ⊕ (E) DRINKING FOUNTAIN
- ⊕ (E) FIRE HYDRANT
- ⊕ (E) SIGN
- M (E) MENS TOILET ROOM
- W (E) WOMENS TOILET ROOM
- G (E) GIRLS TOILET ROOM
- B (E) BOYS TOILET ROOM
- U (E) UNISEX TOILET ROOM
- K (E) KINDERGARTEN TOILET ROOM

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP: 01-118984 INC.
 REVIEWED FOR
 SS FLS ACS
 DATE: 08/13/2020
 (DSA STAMP AREA)

SUGIMURA FINNEY ARCHITECTS
SFA
 ARCHITECTURE INTERIORS PLANNING
 2105 SOUTH BASCOM AVE.
 SUITE 200
 CAMPBELL, CA 95008
 PHONE: 408-578-6000
 FAX: 408-577-6000

REGISTERED ARCHITECT
 MARK C FINNEY
 NO. C-24673
 STATE OF CALIFORNIA

DEMOLITION SITE PLAN
 SHADE STRUCTURES
 PIEDMONT MIDDLE SCHOOL
 955 PIEDMONT RD. SAN JOSE, CA 95132
 BERRYESSA UNION SCHOOL DISTRICT

REVISIONS NO.	ITEM	DATE

DRAWN BY: MK
 CHECKED BY: NJ
 SFA JOB NO: 19063 DATE: 06/17/2019

A0.1

COPYRIGHT © 2019

1 DEMOLITION SITE PLAN

1" = 20'-0"
 0 5' 10' 20' 40' 80'

BUILDING F
(E) CLASSROOM

BUILDING G
(E) CLASSROOM

(E) CONC. WALKWAY

(E) AC PAVING

(E) CONC. PAVING

BUILDING H
(E) CLASSROOM

BUILDING D
(E) CLASSROOM

(E) CONC. WALKWAY

(E) AC PAVING

(E) AMPHITHEATER
CONC. BOTTOM LEVEL
- 3'-4"

CANTELEVER 10" MAX.
FOR VC-14 MODEL,
TYP. BOTH SIDES

GENERAL NOTES

- CONTRACTOR TO VERIFY ALL BARRIERS IN P.O.T. HAVE BEEN REMOVED.
- CONTRACTOR TO REMOVE ALL EXISTING ITEMS TO ALLOW THE NEW WORK, INCLUDING BUT NOT LIMITED TO TREES, SHRUBS, ASPHALT PAVING, FENCING.
- GENERAL CONTRACTOR SHALL SURVEY THE AREA OF NEW CONSTRUCTION FOR UNDERGROUND UTILITIES PRIOR TO THE BEGINNING OF CONSTRUCTION, AND REROUTE/CAP ALL EXISTING UTILITIES RUNNING BELOW THE AREA OF THE NEW SHADE STRUCTURES IF IT CONFLICTS WITH NEW SHADE STRUCTURE FOOTINGS.
- REFER TO SHADE STRUCTURES MANUFACTURER'S DRAWINGS FOR CONC. FOOTINGS DESIGN REQUIREMENTS.
- SHADE STRUCTURES & MARQUEE SIGN O.F.C.I.
- CONTRACTOR TO BACKFILL TRENCHES AND PATCH AC PAVING AS REQUIRED PER DET. 2/A0.4 & 4/A0.4
- PROVIDE TEMPORARY FENCING DURING CONSTRUCTION, SEE DETAIL 1/A0.4
- TIE IN (N) SHADE STRUCTURE DOWNSPOUTS TO THE NEAREST CLEAN OUT.

NEW SITE PLAN NOTES

- (N) UPPER SHADE STRUCTURE PC # 04-117117 SEE MANUFACTURER'S DRAWINGS.
- (N) SHADE STRUCTURE AT (E) AMPHITHEATER, PC # 04-117117 SEE MANUFACTURER'S DRAWINGS.
- APPROXIMATE LOCATION OF (E) STORM DRAIN INLET.
- APPROXIMATE DIRECTION OF (E) STORM DRAIN LINE
- (N) AC PAVING, 2% MIN. SLOPE IN ALL DIRECTIONS, SEE DET. 2/A05
- (N) CONC INFILL, SEE DET. 5/A05
- (N) SHADE STRUCTURE COLUMN 10' HEIGHT, TYP.
- (N) SHADE STRUCTURE COLUMN 12'-0" HEIGHT, TYP. SEE 2/S-7, 2/S-5
- (N) SHADE STRUCTURE COLUMN FOOTING, TYP. SEE 1 & 3/S-10
- SEISMIC GAP PER S-2, TYP.
- ROOF DECK CANTILEVER, TYP. PER DET. 3/S6, 3/S5, 5/S11

GRAPHIC KEY

- - - - - EXISTING PROPERTY LINE
- - - - - ROOF OVERHANG
- - - - - CHAINLINK FENCE
- - - - - DECORATIVE FENCE
- NEW SHADE STRUCTURE
- ▨ EXISTING BUILDING
- ▤ EXISTING RESTROOMS
- ▥ NEW AC PAVING
- (E) DRY STAND PIPE
- ⊕ (E) DRINKING FOUNTAIN
- ⊕ (E) FIRE HYDRANT
- ⊕ (E) SIGN
- M (E) MENS TOILET ROOM
- W (E) WOMENS TOILET ROOM
- G (E) GIRLS TOILET ROOM
- B (E) BOYS TOILET ROOM
- U (E) UNISEX TOILET ROOM
- K (E) KINDERGARTEN TOILET ROOM

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 01-118984 INC.
REVIEWED FOR
SS FLS ACS
DATE: 08/13/2020
(DSA STAMP AREA)

SUGIMURA
FINNEY
ARCHITECTS
SFA
ARCHITECTS INTERIORS PLANNING
2155 SOUTH BASCOM AVE.
SUITE 200
CAMPBELL, CA 95008
PHONE: 408-879-6800
FAX: 408-377-6066



NEW ENLARGED SITE PLAN - SHADE STRUCTURES
AT AMPHITHEATER

SHADE STRUCTURES
PIEDMONT MIDDLE SCHOOL
955 PIEDMONT RD. SAN JOSE, CA 95132
BERRYESSA UNION SCHOOL DISTRICT

REVISIONS NO.	ITEM	DATE


DRAWN BY: MK
CHECKED BY: NJ
SFA JOB NO: 19063 DATE: 06/17/2019

A0.2

1 NEW ENLARGED SITE PLAN - SHADE STRUCTURES AT AMPHITHEATER

1/8" = 1'-0"
0 2' 4' 8' 16' 24'


COPYRIGHT © 2019

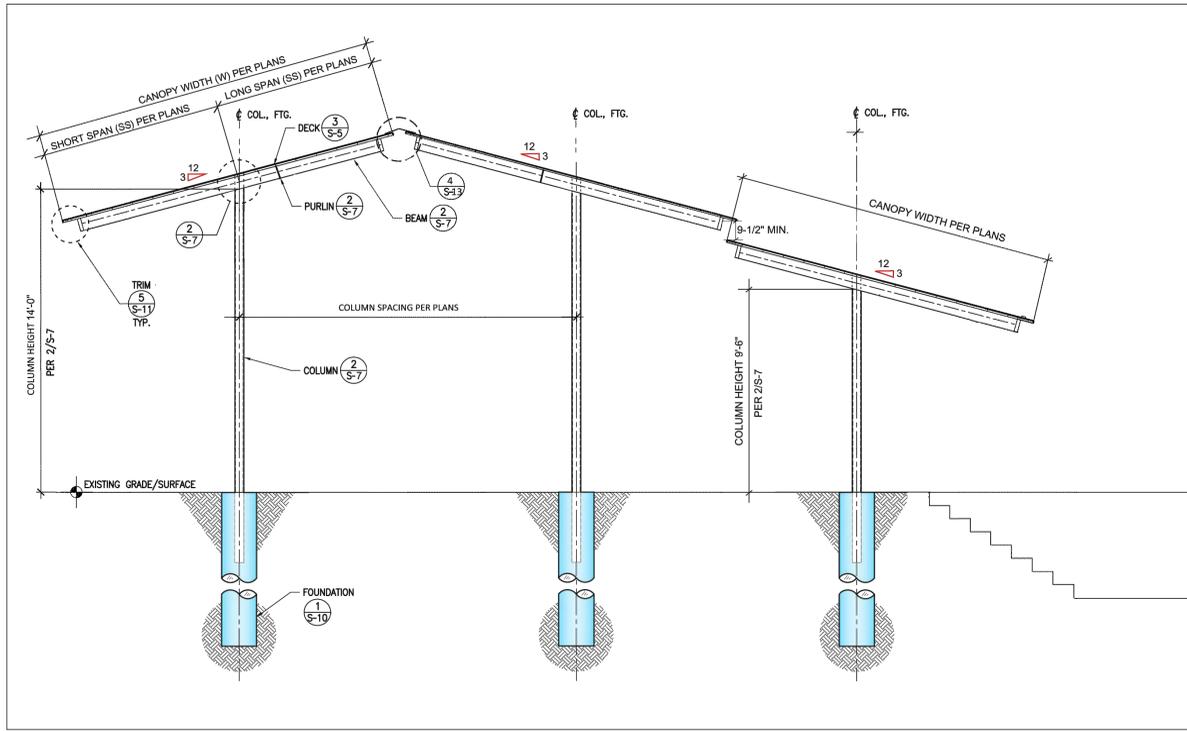

NOTE:
ELEVATIONS ARE SHOWN DIAGRAMMATICALLY.
DO NOT SCALE. REFER TO MANUFACTURER'S
DRAWING FOR DETAILS.

1 NEW SHADE STRUCTURES ELEVATION A

N.T.S.

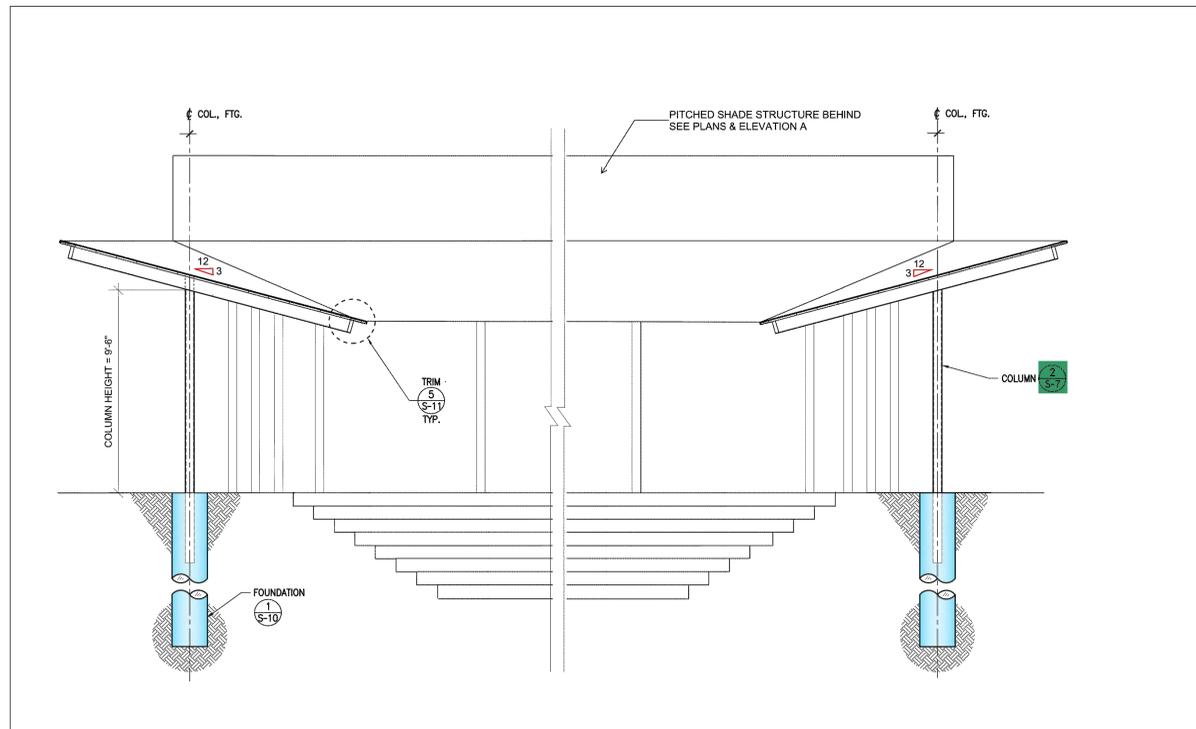

2 NEW SHADE STRUCTURES ELEVATION B

N.T.S.

- GENERAL NOTES**
- CONTRACTOR TO VERIFY ALL BARRIERS IN P.O.T. HAVE BEEN REMOVED.
 - CONTRACTOR TO REMOVE ALL EXISTING ITEMS TO ALLOW THE NEW WORK, INCLUDING BUT NOT LIMITED TO TREES, SHRUBS, ASPHALT PAVING, FENCING.
 - GENERAL CONTRACTOR SHALL SURVEY THE AREA OF NEW CONSTRUCTION FOR UNDERGROUND UTILITIES PRIOR TO THE BEGINNING OF CONSTRUCTION, AND REROUTE/CAP ALL EXISTING UTILITIES RUNNING BELOW THE AREA OF THE NEW SHADE STRUCTURES IF IT CONFLICTS WITH NEW SHADE STRUCTURE FOOTINGS.
 - REFER TO SHADE STRUCTURES MANUFACTURER'S DRAWINGS FOR CONC. FOOTINGS DESIGN REQUIREMENTS.
 - SHADE STRUCTURES & MARQUEE SIGN O.F.C.I.
 - CONTRACTOR TO BACKFILL TRENCHES AND PATCH AC PAVING AS REQUIRED PER DET. 2/A0.4 & 4/A0.4
 - PROVIDE TEMPORARY FENCING DURING CONSTRUCTION. SEE DETAIL 1/A0.4
 - TIE IN (N) SHADE STRUCTURE DOWNSPOUTS TO THE NEAREST CLEAN OUT.

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 01-118984 INC.
REVIEWED FOR
SS FLS ACS
DATE: 08/13/2020
(DSA STAMP AREA)

SUGIMURA FINNEY ARCHITECTS
SFA
ARCHITECTURE INTERIORS PLANNING
2155 SOUTH BASCOM AVE.
SUITE 200
CAMPBELL, CA 95005
PHONE: 408.879.2609
FAX: 408.577.4966




NEW SHADE STRUCTURES ELEVATIONS
SHADE STRUCTURES
PIEDMONT MIDDLE SCHOOL
955 PIEDMONT RD. SAN JOSE, CA 95132
BERRYESSA UNION SCHOOL DISTRICT



NO.	ITEM	DATE

DRAWN BY: MK
CHECKED BY: NJ
SFA JOB NO: 19063
DATE: 06/17/2019



A0.2.1

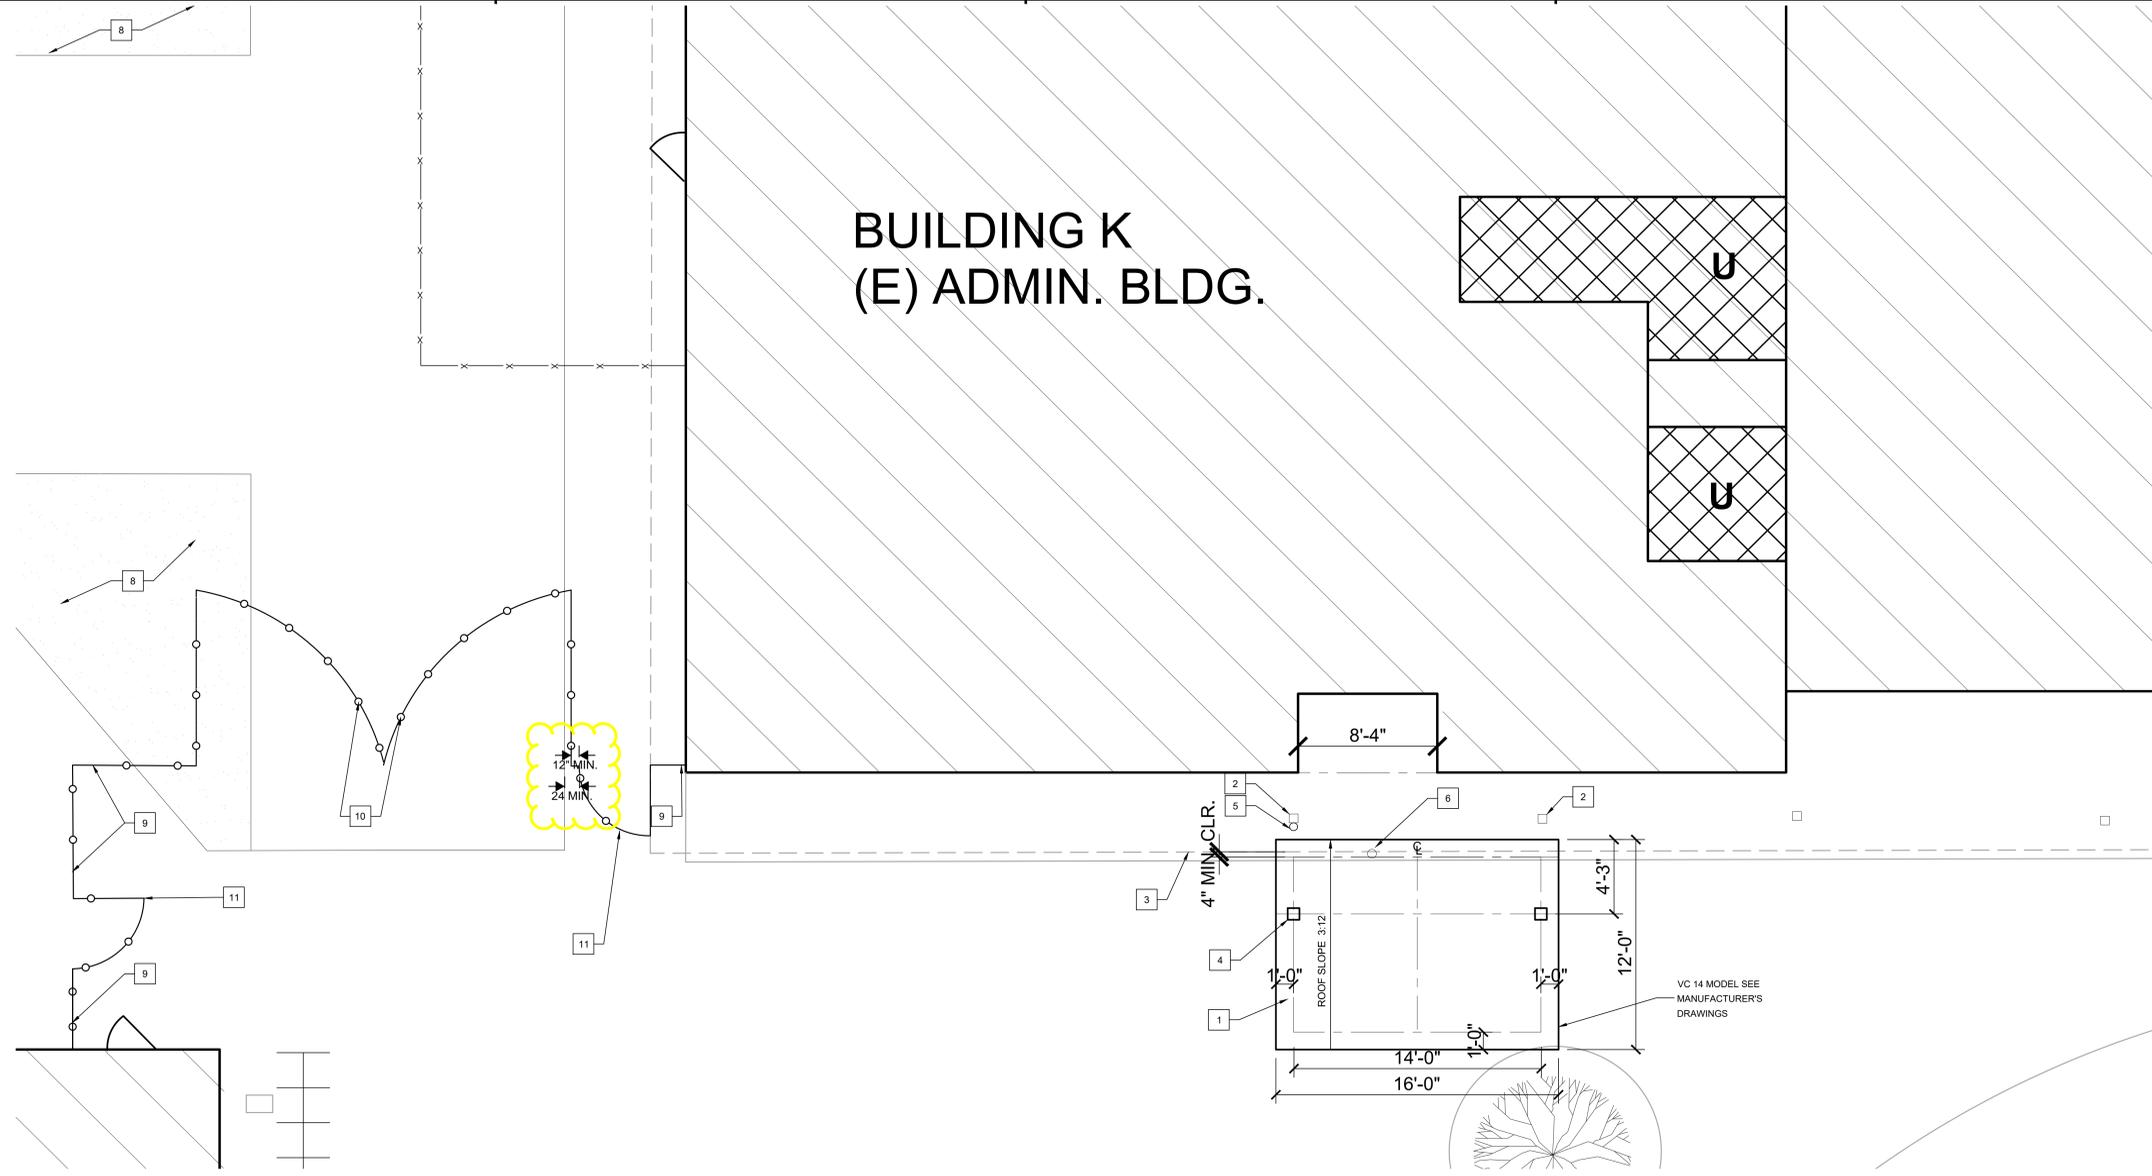


1 NEW ENLARGED SITE PLAN - ADMIN BUILDING ENTRY CANOPY - PEDESTRIAN WALKWAY

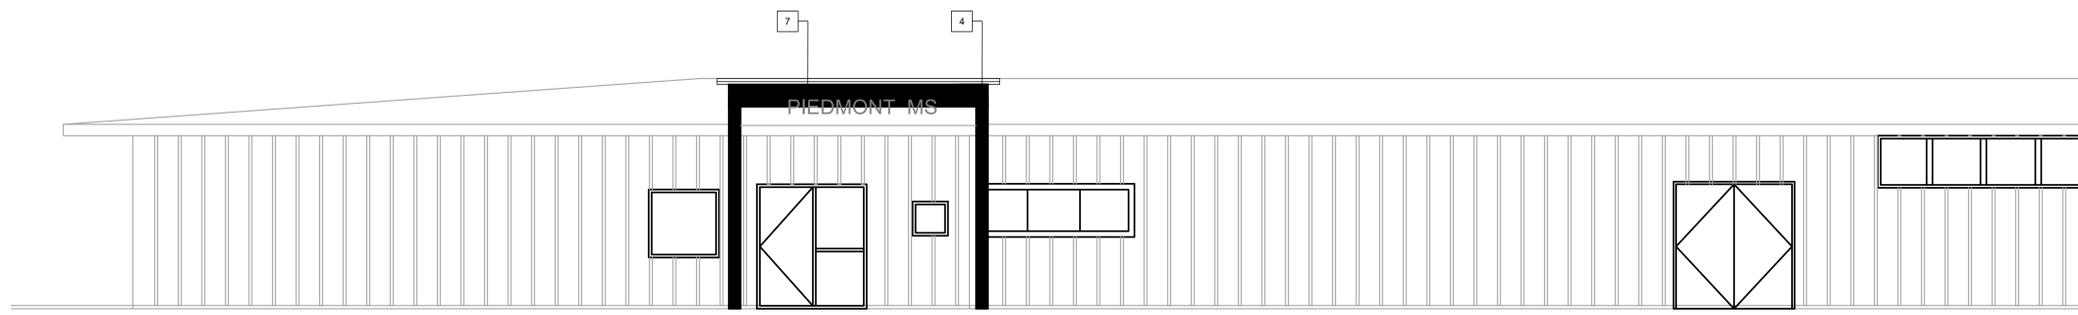

2 EXTERIOR ELEVATION - ENTRY CANOPY - PEDESTRIAN WALKWAY AT (E) ADMIN. BUILDING

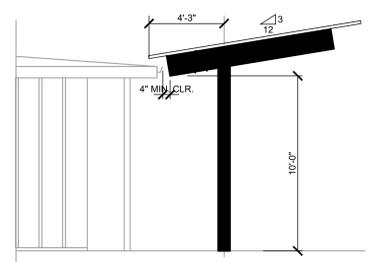

3 EXTERIOR SIDE ELEVATION - ENTRY CANOPY AT (E) ADMIN. BUILDING



GENERAL NOTES

- A. CONTRACTOR TO REMOVE ALL EXISTING ITEMS TO ALLOW THE NEW WORK, INCLUDING BUT NOT LIMITED TO TREES, SHRUBS, ASPHALT PAVING, FENCINGS.
- B. GENERAL CONTRACTOR SHALL SURVEY FOR UNDERGROUND UTILITIES IN THE AREA OF NEW WORK. CONTRACTOR TO REROUTE/CAAP ALL EXISTING UTILITIES RUNNING BELOW THE AREA OF THE NEW SHADE STRUCTURES IF IT CONFLICTS WITH NEW SHADE STRUCTURE FOOTINGS.
- C. REFER TO SHADE STRUCTURES MANUFACTURER'S DRAWINGS FOR CONC. FOOTINGS DESIGN REQUIREMENTS.
- D. SHADE STRUCTURE IS O.F.C.I.
- E. CONTRACTOR TO BACKFILL TRENCHES AND PATCH AC PAVING AS REQUIRED PER DETAILS SEE SHEET A0.4.
- F. LOCATION OF ALL (E) UTILITIES ARE SHOWN DIAGRAMMATICALLY. CONTRACTOR SHALL VERIFY EXACT LOCATIONS IN FIELD PRIOR TO INSTALLATION OF NEW STRUCTURES.
- G. THE IN (N) SHADE STRUCTURE DOWNSPOUTS TO THE NEAREST CLEAN OUT.
- H. PAINT THE CANOPY STRUCTURE FRAMING, GUTTERS, AND DOWNSPOUTS, COORDINATE COLORS IN FIELD WITH DISTRICT.

NEW SITE PLAN NOTES

1. NEW ENTRY CANOPY PC # 04-117117, SEE MANUFACTURER'S DRAWINGS.
2. (E) BUILDING COLUMN, PAINTED (TYP. OF 2).
3. (E) BUILDING ROOF OVERHANG/GUTTER, TYP.
4. NEW ENTRY CANOPY COLUMNS (2), PAINTED, PATCH (E) CONC. PAVING.
5. (E) DOWNSPOUT, PAINTED TYP.
6. (E) UTILITY BOX.
7. NEW SCHOOL SIGN, 10 INCH ALUMINUM 3D LETTERS, COLOR AND FONT TO BE SELECTED BY ARCHITECT, SEE DET. A0.5
8. (N) AC PAVING, SEE DET. 2/A0.5
9. (N) 6'-0" HEIGHT DECORATIVE FENCE MERCHANTS METAL - MONROE WROUGHT IRON ORNAMENTAL, SEE DET. 14/A0.5, 13/A0.5 & 10/A0.5
10. (N) FIRE APPARATUS ACCESS GATE 22'-0" WIDTH DECORATIVE FENCE MERCHANTS METAL - MONROE WROUGHT IRON ORNAMENTAL, SEE DET. 11/A0.5
11. (N) PEDESTRIAN ACCESS GATE W/PANIC HARDWARE DECORATIVE FENCE MERCHANTS METAL - MONROE WROUGHT IRON ORNAMENTAL, SEE DET. 9/A0.5

GRAPHIC KEY

- - - - - EXISTING PROPERTY LINE
- - - - - ROOF OVERHANG
- - - - - CHAINLINK FENCE
- - - - - DECORATIVE FENCE
- [] NEW BUILDING
- [] EXISTING BUILDING
- [] EXISTING RESTROOMS
- ◇ (E) DRY STAND PIPE
- ⊕ (E) DRINKING FOUNTAIN
- ⊕ (E) FIRE HYDRANT
- ⊕ (E) SIGN
- M** (E) MENS TOILET ROOM
- W** (E) WOMENS TOILET ROOM
- G** (E) GIRLS TOILET ROOM
- B** (E) BOYS TOILET ROOM
- U** (E) UNISEX TOILET ROOM
- K** (E) KINDERGARTEN TOILET ROOM

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 01-118984 INC.
REVIEWED FOR:
SS FLS ACS
DATE: 08/13/2020
(DCA STAMP AREA)

SUGIMURA FINNEY ARCHITECTS
SFA
ARCHITECTURE INTERIORS PLANNING
2155 SOUTH EASCOM AVE.
SUITE 200
CAMPBELL, CA 95005
PHONE: 408.379.8009
FAX: 408.377.4966


REGISTERED ARCHITECT
MARK C. FINNEY
NO. C-24673
STATE OF CALIFORNIA
9-30-2019

NEW ENLARGED SITE PLAN - ADMIN BUILDING
ENTRY CANOPY - PEDESTRIAN WALKWAY
SHADE STRUCTURES
PIEDMONT MIDDLE SCHOOL
955 PIEDMONT RD., SAN JOSE, CA 95132
BERRYESSA UNION SCHOOL DISTRICT

REVISIONS		
NO.	ITEM	DATE

DRAWN BY: MK
CHECKED BY: NJ
SFA JOB NO: 19063
DATE: 06/17/2019



A0.3

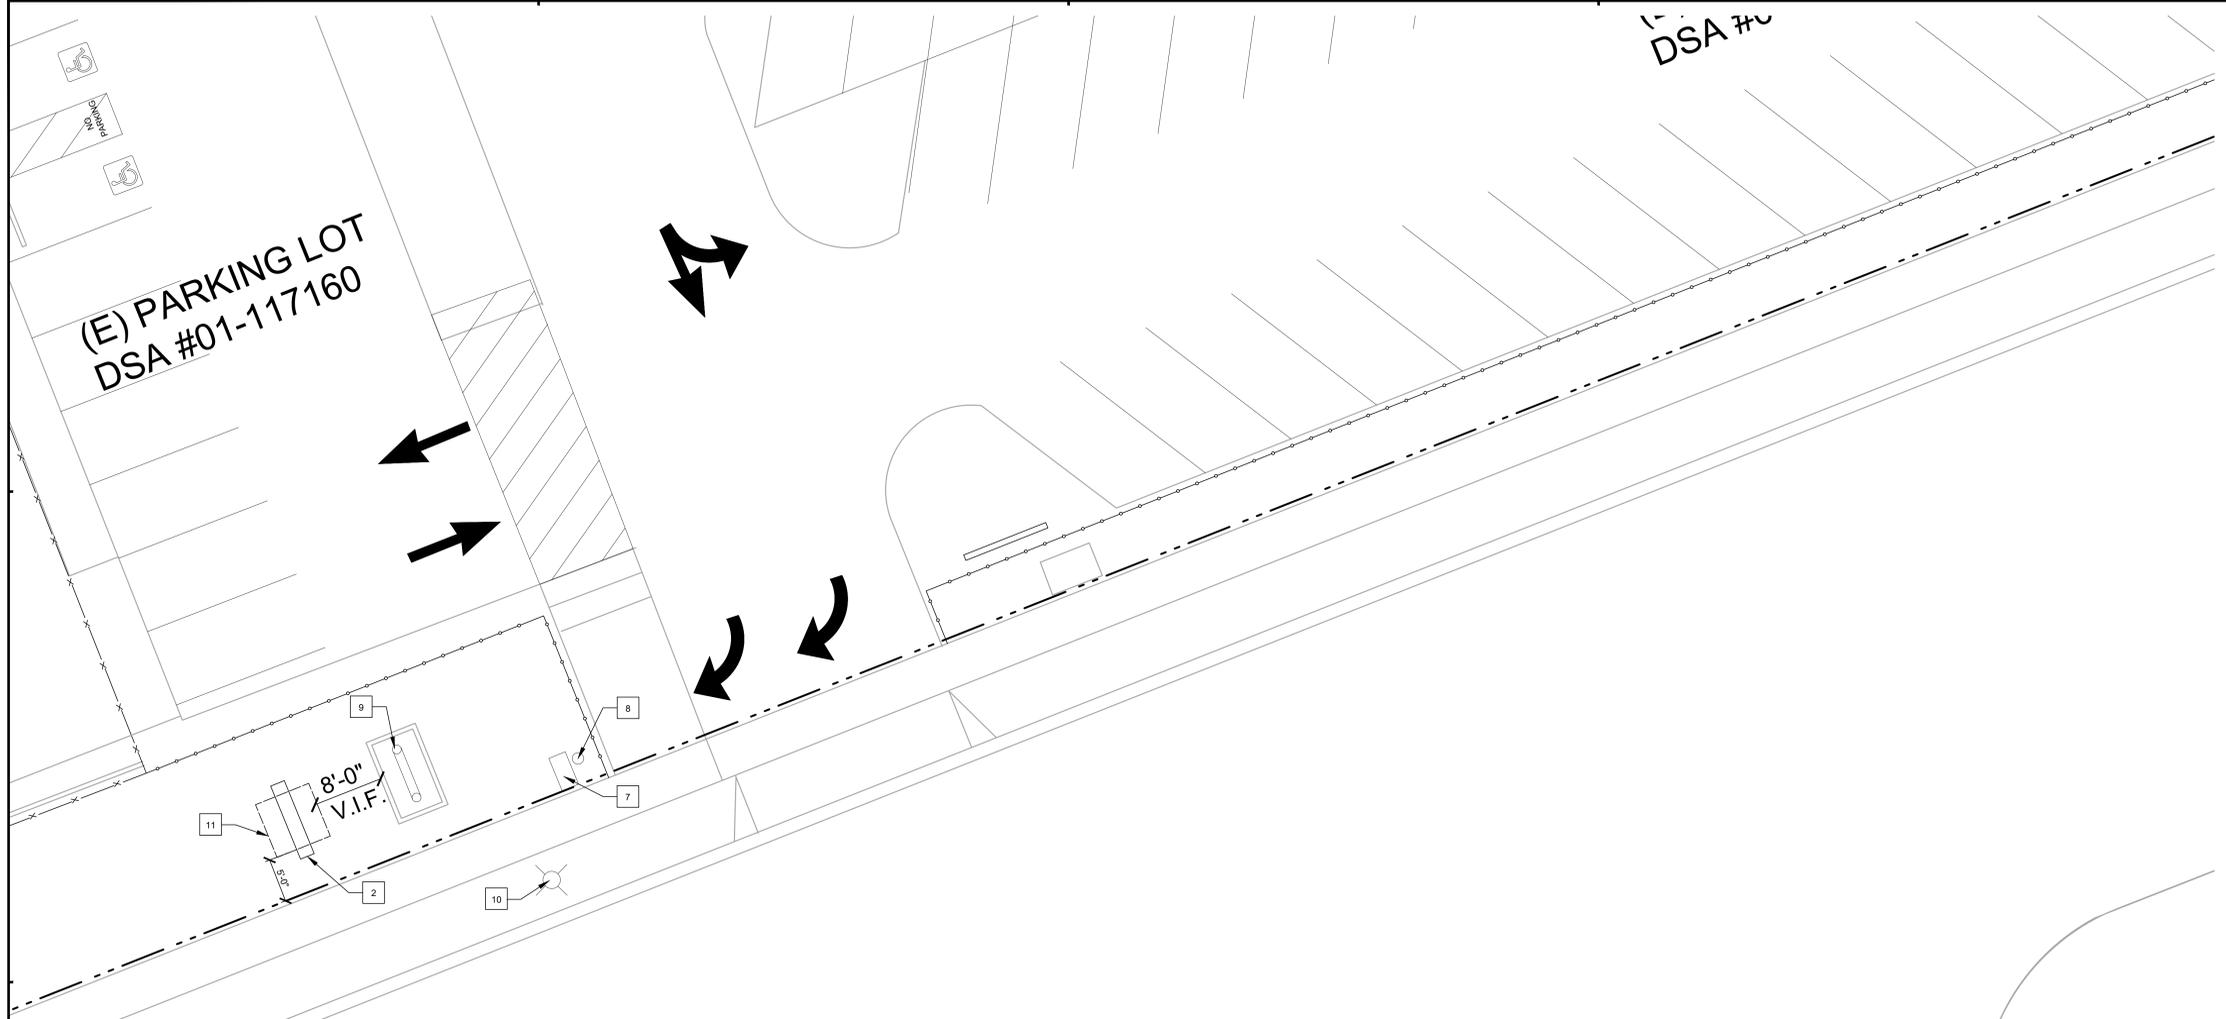

(E) PARKING LOT
DSA #01-117160

DSA #0

1 NEW ENLARGED SITE PLAN - NEW MARQUEE SIGN

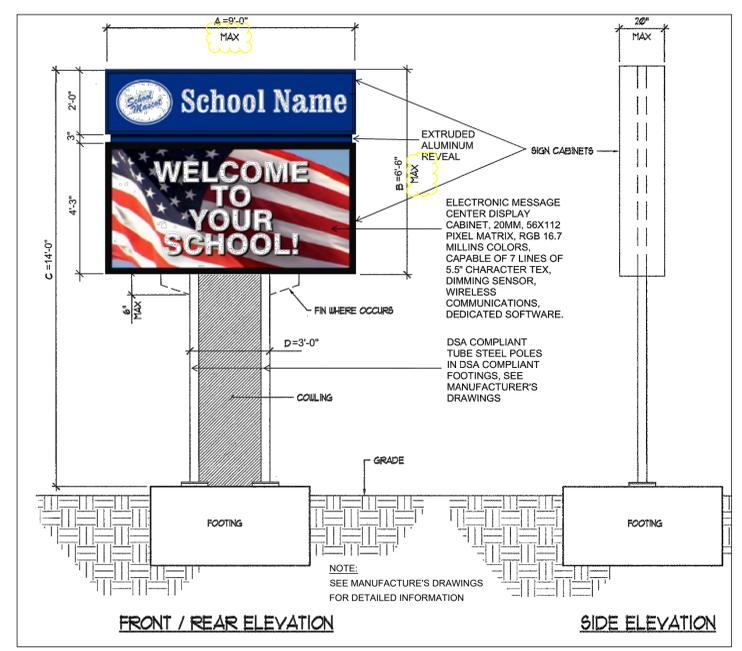

2 NEW MARQUEE SIGN ELEVATIONS

N.T.S

GENERAL NOTES

- A. CONTRACTOR TO REMOVE ALL EXISTING ITEMS TO ALLOW THE NEW WORK, INCLUDING BUT NOT LIMITED TO TREES, SHRUBS, ASPHALT PAVING, FENCING.
- B. GENERAL CONTRACTOR SHALL SURVEY FOR UNDERGROUND UTILITIES IN THE AREA OF NEW WORK. CONTRACTOR TO REROUTE/CAP ALL EXISTING UTILITIES RUNNING BELOW THE AREA OF THE NEW STRUCTURE IF IT CONFLICTS WITH NEW STRUCTURE SIGN FOOTING.
- C. REFER TO MANUFACTURER'S DRAWINGS FOR CONC. FOOTINGS DESIGN REQUIREMENTS.
- D. NEW MARQUEE SIGN IS O.F.C.I.
- E. CONTRACTOR TO BACKFILL TRENCHES AND PATCH AC PAVING AS REQUIRED PER SHEET A0.5.
- F. LOCATION OF ALL (E) UTILITIES ARE SHOWN DIAGMATICALLY. CONTRACTOR SHALL VERIFY EXACT LOCATIONS IN FIELD PRIOR TO INSTALLATION OF THE NEW STRUCTURE.

NEW SITE PLAN NOTES


- 1 (N) ENTRY CANOPY (SHADE STRUCTURE) PC # 04-117117 SEE MANUFACTURER'S DRAWINGS.
- 2 (N) MARQUEE SIGN PC # 04-116862, SEE DET. 2/- & MANUFACTURER'S DRAWINGS.
- 3 (E) BUILDING ROOF OVERHANG.
- 4 (E) BUILDING ROOF OVERHANG SUPPORTING COLUMN, TYP.
- 5 (E) BUILDING DOWNSPOUT, TYP.
- 6 (E) CLEAN OUT
- 7 (E) CABLE UTILITY SURFACE BOX
- 8 (E) WATER LINE SURFACE BOX
- 9 (E) BACKFLOW PREVENTOR
- 10 (E) STREET LIGHT
- 11 OUTLINE OF (N) CONC. 6'-6" x 6'-6" MARQUEE FOOTING

GRAPHIC KEY

- - - - - EXISTING PROPERTY LINE
- - - - - ROOF OVERHANG
- - - - - CHAINLINK FENCE
- - - - - DECORATIVE FENCE
- (E) DRY STAND PIPE
- ⊕ (E) DRINKING FOUNTAIN
- ⊕ (E) FIRE HYDRANT
- (E) SIGN

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 01-118984 INC:
REVIEWED FOR
SS FLS ACS
DATE: 08/13/2020
(DSA STAMP AREA)

SUGIMURA FINNEY ARCHITECTS
SFA
ARCHITECTURE INTERIORS PLANNING
2155 SOUTH BASCOM AVE.
SUITE 200
CAMPBELL, CA 95005
PHONE: 408-379-8009
FAX: 408-377-4966




NEW ENLARGED SITE PLAN - NEW MARQUEE SIGN


SHADE STRUCTURES
PIEDMONT MIDDLE SCHOOL
955 PIEDMONT RD. SAN JOSE, CA 95132
BERRYESSA UNION SCHOOL DISTRICT

REVISIONS NO.	ITEM	DATE


DRAWN BY: MK
CHECKED BY: NJ
SFA JOB NO: 19063
DATE: 06/17/2019

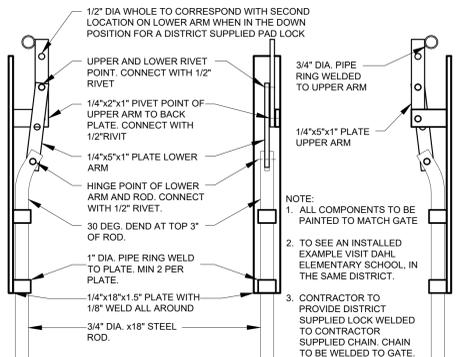


16 CANE BOLT
3\"/>

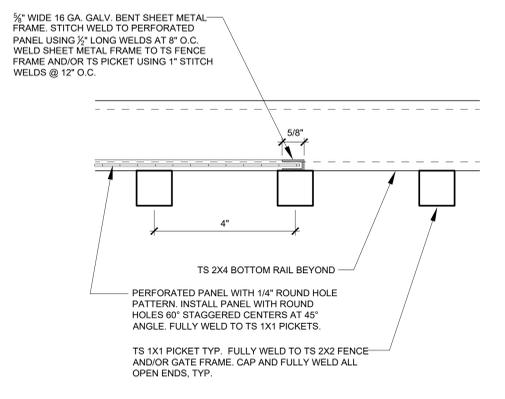


15 SECTION @ PICKETS & PANEL FRAME
SCALE: 6\"/>

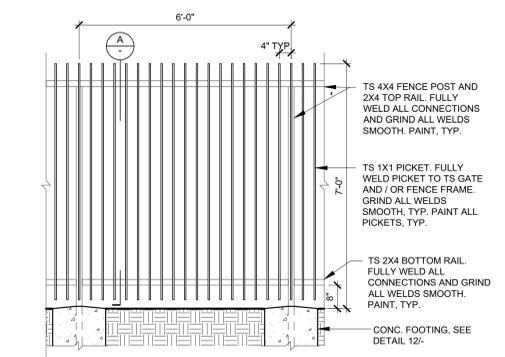


14 TYP. FENCE PANEL ELEVATION EXTERIOR
1/2\"/>

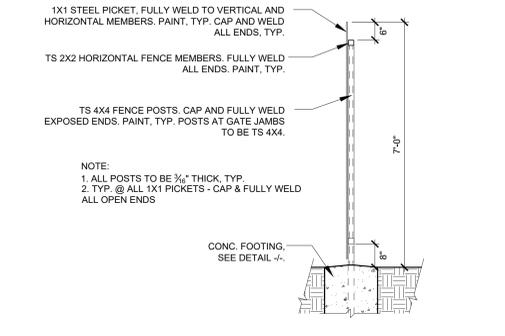


13 TYP. FENCE PANEL SECTION
1/2\"/>

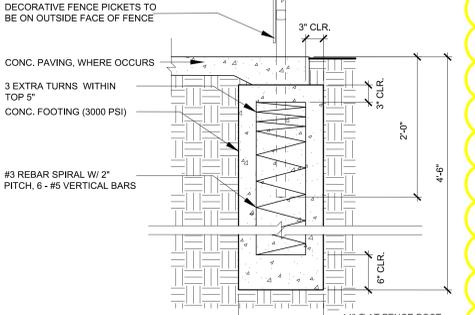


12 TYP. FOOTING
NTS

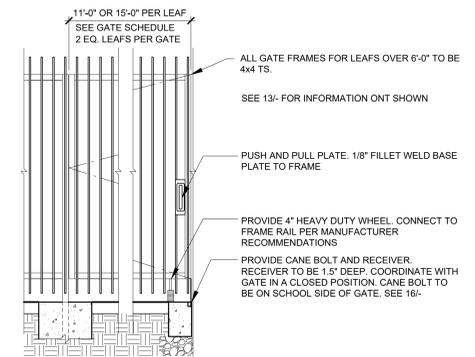


11 DOUBLE GATE ELEVATION VEHICLE GATE
1/2\"/>

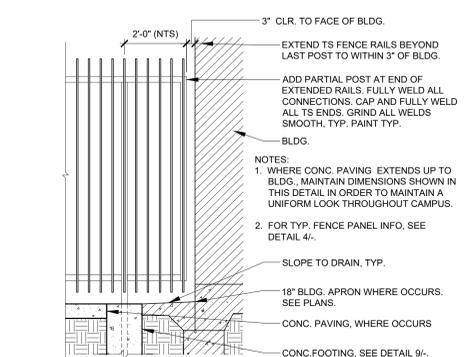


10 FENCE ELEVATION AT BUILDING EXTERIOR
1/2\"/>

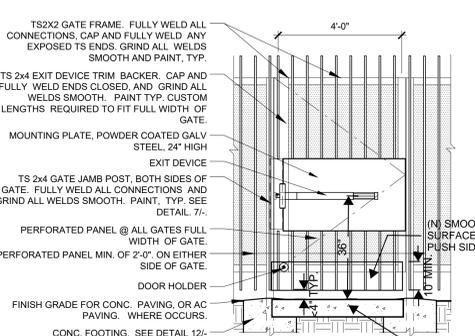


9 SINGLE GATE WITH PANIC H.W. INTERIOR SIDE
1/2\"/>

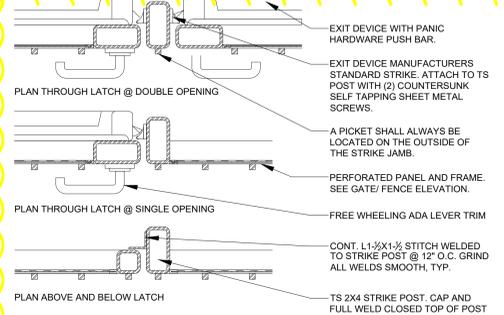


8 STRIKE DETAIL

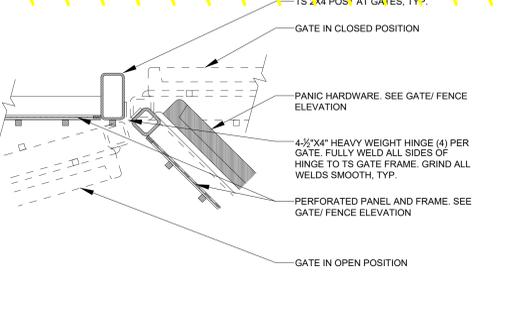


7 JAMB DETAIL

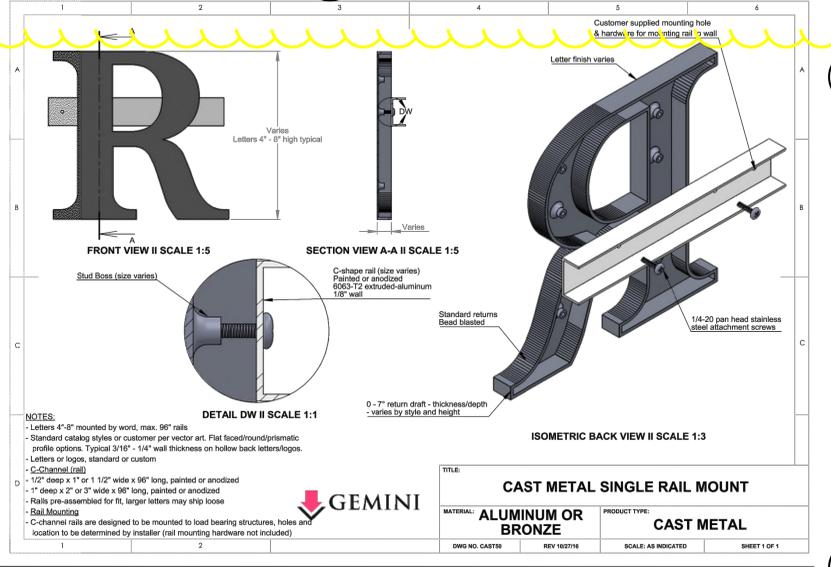


6 CAST METAL SINGLE RAIL MOUNT
ALUMINUM OR BRONZE
CAST METAL

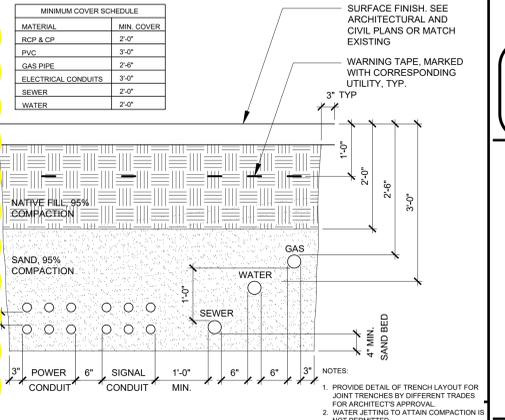


4 TYP. JOINT TRENCH
3/4\"/>

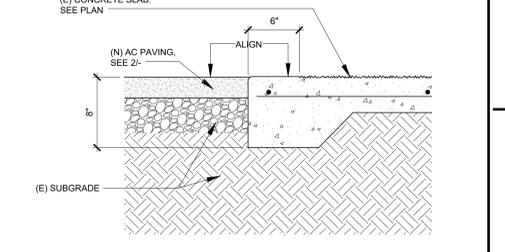


3 ASPHALT / CONCRETE JOINT
1-1/2\"/>

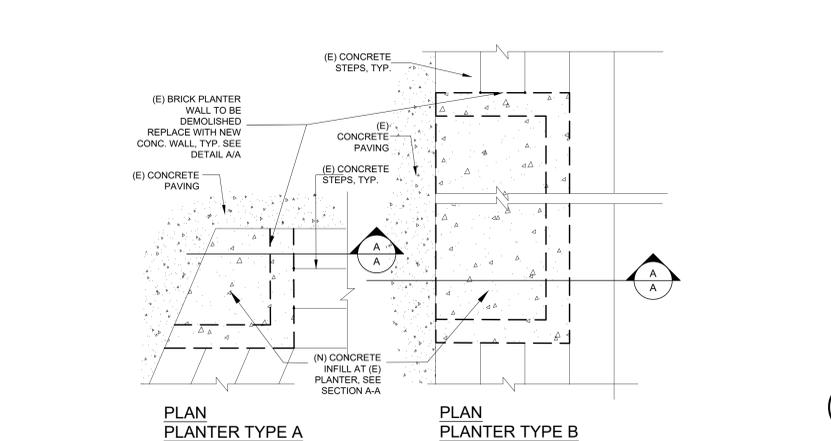

5 (N) CONC. INFILL & WALL @ (E) PLANTER
1\"/>

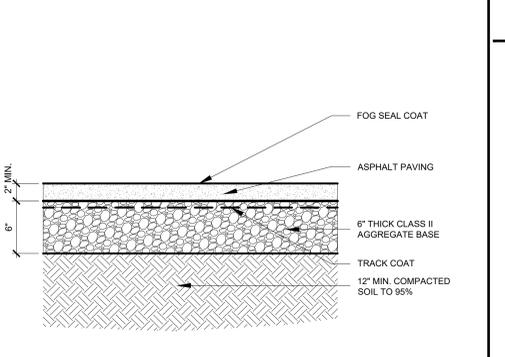

2 (N) ASPHALT PAVING
1-1/2\"/>

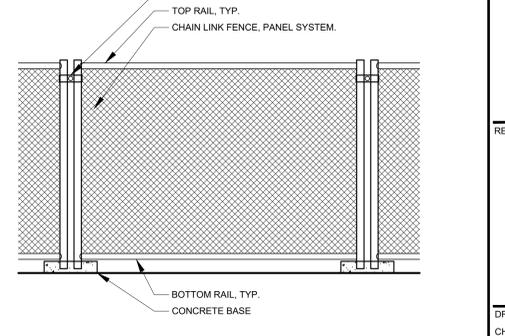

1 REQ'D TEMPORARY FENCING CONSTRUCTION FENCING
1/2\"/>

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 01-118984 INC.
REVIEWED FOR
DATE: 08/13/2020

SUGIMURA FINNEY ARCHITECTS
SFA
2155 SOUTH BASCOM AVE
SUITE 210
CAMPBELL, CA 95008
PHONE: 408-378-6699
FAX: 408-377-6596

REGISTERED ARCHITECT
MARK C. FINNEY
NO. C-24873
STATE OF CALIFORNIA

SITE DETAILS
SHADE STRUCTURES
PIEDMONT MIDDLE SCHOOL
955 PIEDMONT RD., SAN JOSE, CA 95132
BERRYESSA UNION SCHOOL DISTRICT

NO.	ITEM	DATE

DRAWN BY: MK
CHECKED BY: NJ
SFA JOB NO.: 19063
DATE: 06/17/2019

A0.5

M BAR C VERSA-CANOPY

ENGINEER'S APPROVAL
 IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP: 01-118984 INC:
 REVIEWED FOR
 SS FLS ACS
 DATE: 08/13/2020

DATE SIGNED
 11/28/2018

SITE SPECIFIC DSA APPROVAL

~~FILE NUMBER: PC-119
 IDENTIFICATION STAMP
 DIVISION OF THE STATE ARCHITECT
 APP. NO: 04 117111 INCR
 AC DF DES DS SS DP
 DATE: 12/05/2018~~

PRE-CHECK (PC) DOCUMENT
 CODE: 2016 CBC
 A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED

M BAR C CONSTRUCTION INC.
 674 RANCHEROS DR
 SAN MARCOS, CA 92069
 PHONE: (760) 744-4131
 FAX: (760) 744-4449
 LIC # 869960
 B AND C51
 GREGJ@MBARCONLINE.COM (775) 787-8845

4STEL ENGINEERING
 STRUCTURAL ENGINEERING
 26030 A CHERO, SUITE 200
 MISSION VIEJO, CA 92691
 PHONE: (949) 305-1150
 FAX: (949) 305-1420

VERSA CANOPY COVER SHEET

DRAWN GM
CHECKED KS
DATE 11/28/2018
4STEL JOB NO. MC03-01
SHEET S-1
1 OF 13 SHEETS

PC OWNERSHIP - STRUCTURAL STEEL CONTRACTOR



M BAR C CONSTRUCTION INC.

674 RANCHEROS DR
 SAN MARCOS, CA. 92069
 PHONE: (760) 744-4131
 FAX: (760) 744-4449
 LIC # 869960
 B AND C51

POINT OF CONTACT: GREG JONES
 GREGJ@MBARCONLINE.COM
 (775) 787-8845

LEGAL INFORMATION

- USE OF THE PC WITHOUT WRITTEN CONSENT FROM M BAR C CONSTRUCTION, INC. IS STRICTLY PROHIBITED.
- ALL INFORMATION HEREIN IS PROPRIETARY INFORMATION AND UNDER THE OWNERSHIP OF M BAR C CONSTRUCTION, INC.

STANDARD NOTES FOR PC USE

- 4 S.T.E.L. ENGINEERING, INC. IS AVAILABLE TO BID THE GENERATION OF THE FULL DSA SUBMITTAL PACKAGE ACTING AS THE DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE (DPGRC) OR TO SUPPORT THE DPGRC AS THE SITE SPECIFIC STRUCTURAL ENGINEER OF RECORD (SEOR). CONTACT DUSTIN ROSEPINK AT 4 S.T.E.L. ENGINEERING, INC FOR A PROPOSAL FOR SERVICES AT (949) 305-1150, DKRPINK@4STELENG.COM
- FOR CONSTRUCTION COST INFORMATION, CONTACT M BAR C CONSTRUCTION, INC.
- CUSTOM SIZES AND LOADINGS REQUIRE SUPPLEMENTARY SHOP DRAWINGS AND CALCULATIONS.

DSA OTC PLAN REVIEWER AND DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE NOTES

1. THE PC STRUCTURAL MEMBERS ARE DESIGNED TO THE FOLLOWING ASCE 7-10 SEISMIC CRITERIA: $S_s = 3.2$, $S_1 = 1.39$, $R = 1.25$.
2. THE DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE TO VERIFY SITE SPECIFIC DESIGN PARAMETERS COMPLY WITH DESIGN PARAMETERS FOR THE PC SHOWN ON SHEET S-2.
3. THE DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE IS RESPONSIBLE FOR VERIFYING SITE-SPECIFIC WIND PARAMETERS AT ANY AND ALL SITES WHERE THIS PC IS USED. THIS PC DESIGN IS BASED ON WIND SPEED 110 MPH FOR RISK CATEGORY II TYPE STRUCTURES UTILIZING EXPOSURE TYPE C PER ASCE 7-10. SEE DESIGN PARAMETER NOTE 1 ON SHEET S-2.
4. A SITE SPECIFIC GEOTECHNICAL REPORT SHALL BE SUBMITTED JUSTIFYING SOILS VALUES SELECTED IF GREATER THAN 100 PCF FOR LATERAL BEARING AND/OR 1,500 PSF FOR VERTICAL BEARING. SEE FOUNDATION NOTES ON SHEET S-3.
5. SITE SPECIFIC DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE TO SELECT SOILS CLASS FOR SITE SPECIFIC USE.
6. WET STAMPED & SIGNED COPIES OF PC PLANS ARE NOT REQUIRED FOR SITE SPECIFIC PC USE.
7. DUSTIN ROSEPINK IS NOT ACTING AS SITE SPECIFIC SEOR UNLESS HE IS THE DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE OR A SIGNED LETTER HAS BEEN SUBMITTED WITH DSA-1 FORM STATING HE ACCEPTS THE RESPONSIBILITY AS THE SEOR FOR THE SITE. REFER TO DSA IR A-18.
8. DUSTIN ROSEPINK WILL NOT SIGN ANY DSA FORMS (e.g. DSA-5, DSA-6, etc.), REVIEW OR APPROVE ANY SUBMITTALS (e.g. CONCRETE MIX DESIGNS, SHOP DRAWINGS, etc.) FOR THE SITE SPECIFIC PROJECT UNLESS HE IS ACTING AS THE DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE OR THE SITE SPECIFIC STRUCTURAL ENGINEER OF RECORD. REFER TO DSA IR A-18.
9. CUSTOM SIZES & LOADINGS REQUIRE SUPPLEMENTARY SHOP DRAWINGS & CALCULATIONS.

DESIGN PARAMETER CHECK LIST

1. VERIFY THE MAXIMUM WIND SPEED AT THE SITE DOES NOT EXCEED 110 MPH EXPOSURE C.
2. VERIFY THE MAXIMUM SEISMIC S_s AT THE SITE DOES NOT EXCEED $S_s = 3.2$.
3. VERIFY THE SITE SPECIFIC SNOW LOAD AND ENSURE ALL SITE SPECIFIC PC SELECTIONS MEET OR EXCEED THE SITE SPECIFIC SNOW LOAD. THIS PC HAS OPTIONS FOR NO SNOW AND 20 PSF SNOW LOAD. VERIFY THE SITE SPECIFIC DESIGN PROFESSIONAL HAS PROVIDED THE PROPER SITE SPECIFIC VALUES FOR P_g , P_f , P_s , C_e , I_c .
4. REVIEW THE SITE SPECIFIC GEOTECHNICAL REPORT AND ENSURE ALL SITE SPECIFIC PC SELECTIONS MEET WITH THE GEOTECHNICAL REPORT REQUIREMENTS. IF NO GEOTECHNICAL REPORT IS SUPPLIED VERIFY SOILS CLASS V IS SELECTED.
 - SITES NOT LOCATED IN STATE OR LOCAL GEOHAZARD ZONES UTILIZING THIS PC WITH STRUCTURES NOT EXCEEDING 4,000 SQ FT DO NOT REQUIRE CGS APPROVAL OF THE GEOTECHNICAL REPORT. STRUCTURES MAY BE BROKEN UP INTO MULTIPLE 4,000 SQ FT STRUCTURES WITH SEISMIC BREAKS PER SEISMIC GAPS ON S-2.
5. VERIFY THE SITE SPECIFIC FOUNDATION LOCATIONS MEET WITH SOILS NOTE 8 ON S-3 FOR SET BACK FROM TOP OF SLOPES OR THAT THE GEOTECHNICAL REPORT HAS ALLOWED A SMALLER DISTANCE.
6. VERIFY THE SITE SPECIFIC PLANS PROVIDE THE APPROPRIATE OCCUPANCY AND OCCUPANCY LOAD FACTOR FOR THE SITE. SEE BUILDING DATA ON S-2 FOR SAMPLE ACCEPTABLE OCCUPANCIES AND OCCUPANCY LOAD FACTORS.
7. VERIFY THE SITE SPECIFIC PLANS UTILIZE A RISK CATEGORY II STRUCTURE. RISK CATEGORY II STRUCTURES SHALL NOT PROVIDE SHELTER FOR EMERGENCY VEHICLES OR EQUIPMENT, OR PROVIDE REQUIRED ACCESS TO, REQUIRED EGRESS FROM, OR SHARE A LIFE SAFETY COMPONENT WITH A RISK CATEGORY III OR IV STRUCTURE.
8. VERIFY SELECTION OF USE AND OCCUPANCY CLASSIFICATION PER CBC CHAPTER 3; OCCUPANT LOAD FACTOR PER CBC TABLE 1004.1.2; RISK CATEGORY PER CBC TABLE 1604A.5; TO BE COMPLETED BY DESIGN PROFESSIONAL AT TIME OF DSA OTC OR PROJECT DSA SUBMITTAL.
9. VERIFY APPROPRIATE SEISMIC SEPARATION PER SEISMIC GAPS ON S-2.
10. VERIFY THE SITE SPECIFIC DESIGN PROFESSIONAL HAS APPROPRIATELY ADDRESSED FIRE SEPARATION AND PROPERTY LINE SETBACKS.
11. VERIFY THE SITE SPECIFIC SOLAR PANEL LAYOUT IS PROVIDED WITH DIMENSIONS THAT DO NOT EXCEED THE PC MAXIMUMS. THE MAXIMUM DIMENSIONS SHALL BE TO THE OUTSIDE EDGES OF THE SOLAR PANEL OR THE STRUCTURAL STEEL, WHICH EVER IS GREATER.
12. VERIFY STEEL SELECTIONS HAVE BEEN PROPERLY COORDINATED WITH BEAM/COLUMN SCHEDULES. REFER TO 2/S-8 & 2/S-9.
13. VERIFY SITE SPECIFIC PURLIN CANTILEVERS HAVE BEEN PROPERLY COORDINATED WITH PURLIN SCHEDULES. REFER TO 1/S-8 & 1/S-9.
14. WET STAMPED & SIGNED COPIES OF PC PLANS ARE NOT REQUIRED FOR SITE SPECIFIC PC USE.

SHEET INDEX

- S-1.....COVER SHEET
 - S-2.....GENERAL DATA
 - S-3.....GENERAL NOTES
 - S-4.....SAMPLE DSA-103 FORMS
 - S-5.....SECTION PROPERTIES & REBAR DETAILS
 - S-6.....VC14, VC18 & VC20 FRAMING PLAN & ELEVATIONS
 - S-7.....VC14, VC18 & VC20 FRAMING SCHEDULES
 - S-8.....VC140, VC180 & VC200 FRAMING PLAN & ELEVATIONS
 - S-9.....VC140, VC180 & VC200 FRAMING SCHEDULES
 - S-10.....PIER FOUNDATION & SPREAD FOOTING SCHEDULES
 - S-11.....STANDARD DETAILS 1
 - S-12.....STANDARD DETAILS 2
 - S-13.....SAMPLE ARCHITECTURAL ELEVATIONS
- 13 SHEETS

BID INFORMATION

THE STEEL STRUCTURES IN THIS PC ARE PROPRIETARY TO M BAR C CONSTRUCTION, INC. THE STEEL WORK SHALL NOT GO OUT TO BID.

PRE-CHECK (PC) DOCUMENT

CODE: 2016 CBC
 A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED



ABBREVIATIONS

&	AND
@	AT
⊕	CENTER LINE
A.B.	ANCHOR BOLT
ACI	AMERICAN CONCRETE INSTITUTE
AISC	AMERICAN INSTITUTE OF STEEL CONSTRUCTION
AISI	AMERICAN IRON AND STEEL INSTITUTE
ANSI	AMERICAN NATIONAL STANDARDS INSTITUTE
ASTM	AMERICAN SOCIETY FOR TESTING MATERIALS
AWS	AMERICAN WELDING SOCIETY
BLDG	BUILDING
BLK'G	BLOCKING
BM	BEAM
BOTT. OR (B)	BOTTOM
CBC	CALIFORNIA BUILDING CODE
CCD	CONSTRUCTION CHANGE DOCUMENT (DSA)
CCR	CALIFORNIA CODE OF REGULATIONS
CFS	COLD FORMED STEEL
C.J.	CONTROL JOINT
CJP	COMPLETE JOINT PENETRATION
CLR	CLEAR
CMU	CONCRETE MASONRY UNIT
COL.	COLUMN
CONC.	CONCRETE
CONT.	CONTINUOUS
CS	CFS C SECTION WITH FLANGE STIFFENING LIPS
DIA., Ø	DIAMETER
DPGR	DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE
DSA	DIVISION OF THE STATE ARCHITECT
DWG	DRAWING
(E)	EXISTING
EA.	EACH
E.F.	EACH FACE
E.W.	EACH WAY
EXT.	EXTERIOR
FDN	FOUNDATION
FIN.	FINISH
FLR	FLOOR
FLS	FIRE LIFE SAFETY (DSA)
F.O.C.	FACE OF CONCRETE
F.S.	FAR SIDE
FTG.	FOOTING
GA.	GAUGE
GALV.	GALVANIZED
H.S.B.	HIGH STRENGTH BOLT (ASTM A325 U.N.O.)
HORIZ.	HORIZONTAL
HT.	HEIGHT
IAMPO	INTERNATIONAL ASSOCIATION OF MECHANICAL AND PLUMBING OFFICIALS
ICC	INTERNATIONAL CODE COUNCIL
INT.	INTERIOR
IOR	INSPECTOR OF RECORD
IR	INTERPRETATION OF REGULATIONS (DSA)
JT	JOINT
LG.	LONG
LLH	LONG LEG HORIZONTAL
LLV	LONG LEG VERTICAL
M.B.	MACHINE BOLT (ASTM A307 U.N.O.)
MAX.	MAXIMUM
MFR.	MANUFACTURER
MIN.	MINIMUM
MISC.	MISCELLANEOUS
(N)	NEW
NFPA	NATIONAL FIRE PROTECTION ASSOCIATION
NOM.	NOMINAL
N.S.	NEAR SIDE
NTS	NOT TO SCALE
O.C.	ON CENTER
OTC	OVER THE COUNTER (DSA)
O.H.	OPPOSITE HAND
⊕ OR PL	PLATE
PJP	PARTIAL JOINT PENETRATION
PC	PRE-CHECK (DSA)
PT	PRESSURE TREATED
PV	PHOTOVOLTAIC
REINFT.	REINFORCEMENT
REQ'D	REQUIRED
SC	SLIP-CRITICAL JOINT PER ASTM SPECS
SCHED.	SCHEDULE
SEOR	STRUCTURAL ENGINEER OF RECORD
SHT'G	SHEATHING
SIM.	SIMILAR
S.M.S.	SHEET METAL SCREW
SQ.	SQUARE
SS	STAINLESS STEEL
ST	SNUG-TIGHTENED JOINT PER ASTM SPECS
STD	STANDARD
(T)	TOP
T&B	TOP AND BOTTOM
T.O.C.	TOP OF CONCRETE
T.O.S.	TOP OF STEEL
TYP.	TYPICAL
U.N.O.	UNLESS NOTED OTHERWISE
VERT.	VERTICAL
W/-	WITH
W/O	WITHOUT
WHS	WELDED HEADED STUD (ASTM A108 U.N.O.)
W.P.	WORK POINT
WT.	WEIGHT
WTS	WELDED THREADED STUD (ASTM A108 U.N.O.)

GENERAL NOTES

- ALL WORK SHALL CONFORM TO TITLE 24, CALIFORNIA CODE OF REGULATIONS (CCR)
- CHANGES TO THE APPROVED DRAWINGS AND SPECIFICATIONS SHALL BE MADE BY ADDENDA OR CONSTRUCTION CHANGE DOCUMENTS APPROVED BY THE DIVISION OF THE STATE ARCHITECT, AS REQUIRED BY SECTION 4-338, PART 1, TITLE 24, CCR.
- A 'DSA CERTIFIED' PROJECT INSPECTOR EMPLOYED BY THE DISTRICT (OWNER) AND APPROVED BY THE DIVISION OF THE STATE ARCHITECT SHALL PROVIDE CONTINUOUS INSPECTION OF THE WORK. THE DUTIES OF THE INSPECTOR ARE DEFINED IN SECTION 4-342, CALIFORNIA BUILDING STANDARDS ADMINISTRATIVE CODE (PART 1, TITLE 24, CCR).
- A 'DSA CERTIFIED' INSPECTOR WITH CLASS 2 CERTIFICATION IS REQUIRED FOR THIS PROJECT.
- A DSA ACCEPTED TESTING LABORATORY DIRECTLY EMPLOYED BY THE SCHOOL BOARD SHALL CONDUCT ALL THE REQUIRED TESTS AND INSPECTIONS FOR THE PROJECT.
- GRADING PLANS, DRAINAGE IMPROVEMENTS, ROAD AND ACCESS REQUIREMENTS AND ENVIRONMENTAL HEALTH CONSIDERATIONS SHALL COMPLY WITH ALL LOCAL ORDINANCES.
- IF THE PROJECT IS DIVIDED INTO INCREMENTS: THE SCOPE OF WORK FOR EACH INCREMENT MUST BE CLEARLY SPECIFIED ON THE TITLE SHEET OF ALL INCREMENTS SUBMITTED.


CONSTRUCTION OPTIONS

* ALL CONSTRUCTION OPTIONS INCLUDE OPTIONS FOR CONCRETE DRILLED PIERS AND/OR SPREAD FOOTINGS.

- 14'-0" MAX WIDTH, 3:12 MAX ROOF SLOPE, 17'-0" MAX COLUMN HEIGHT, 0 psf GROUND SNOW
- 18'-0" MAX WIDTH, 3:12 MAX ROOF SLOPE, 17'-9" MAX COLUMN HEIGHT, 0 psf GROUND SNOW
- 20'-0" MAX WIDTH, 3:12 MAX ROOF SLOPE, 17'-0" MAX COLUMN HEIGHT, 0 psf GROUND SNOW
- 14'-0" MAX WIDTH, 3:12 MAX ROOF SLOPE, 17'-5" MAX COLUMN HEIGHT, 20 psf GROUND SNOW
- 18'-0" MAX WIDTH, 3:12 MAX ROOF SLOPE, 16'-6" MAX COLUMN HEIGHT, 20 psf GROUND SNOW
- 20'-0" MAX WIDTH, 3:12 MAX ROOF SLOPE, 16'-9" MAX COLUMN HEIGHT, 20 psf GROUND SNOW

SEISMIC GAPS

OPTION	MAX COLUMN HEIGHT	GAP X	GAP Y
VC14	17'-0"	2 1/2"	7"
VC18	17'-9"	3 1/2"	9 1/2"
VC20	17'-0"	2 1/2"	7"
VC140	17'-5"	3 1/2"	9"
VC180	16'-6"	3"	8 1/2"
VC200	16'-9"	3"	8"

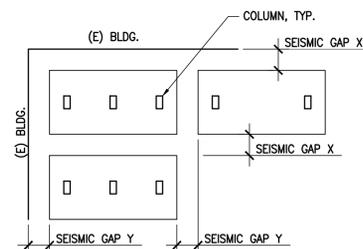

- NOTE
- SEISMIC GAPS LISTED ARE THE MINIMUM GAPS BETWEEN ANY TWO STRUCTURES (I.E. CANOPIES, BUILDINGS) AND DO NOT NEED TO BE COMBINED OR DOUBLED.
 - DIMENSIONS, QUANTITIES, AND LOCATIONS OF STRUCTURES AND COLUMNS SHOWN ABOVE ARE FOR ILLUSTRATIVE PURPOSES ONLY. SEE SITE-SPECIFIC SHEETS FOR LAYOUTS AND QUANTITIES.

STRUCTURAL DATA

LATERAL RESISTING SYSTEM..... STEEL ORDINARY CANTILEVER COLUMN
 FOUNDATION CONCRETE DRILLED PIERS AND SPREAD FOOTINGS
 TESTING AND INSPECTION LIST..... SEE SHEETS S-3 & S-4

DESIGN PARAMETERS

RISK CATEGORY II
 ROOF LIVE LOAD (Lp):
 DECK ONLY 20 psf
 POINT LOAD 300 lb
 SNOW LOAD:
 MAX. DRIFT SNOW LOAD..... 0 psf, 20 psf (SEE CONSTRUCTION OPTIONS)
 MAXIMUM DEAD LOAD:
 ROOF DECK..... 0.89 psf
 WIND: ASCE 7-10 METHOD 2 - ANALYTICAL PROCEDURE
 BASIC WIND SPEED..... 110 mph⁽¹⁾
 WIND EXPOSURE C⁽¹⁾
 INTERNAL PRESSURE N/A (OPEN STRUCTURE)
 WIND DIRECTIONALITY FACTOR K_d = 0.85
 VELOCITY PRESSURE COEFFICIENT..... K_e = 0.90
 TOPOGRAPHIC FACTOR K_{zt} = 1.00
 SEISMIC: ASCE 7-10
 SEISMIC IMPORTANCE FACTOR I = 1.0
 RESPONSE MODIFICATION FACTOR..... R = 1.25
 MAPPED SPECTRAL RESPONSE S_s = 3.22⁽²⁾
 ACCELERATION S_i = 1.39
 SITE CLASS D
 DESIGN SPECTRAL RESPONSE S_{DS} = 2.133
 S₁ = 1.390
 SEISMIC DESIGN CATEGORY D (E WITH GROUND MOTION ANALYSIS)
 SEISMIC FORCE RESISTING SYSTEM STEEL ORDINARY CANTILEVER COLUMN
 SEISMIC RESPONSE COEFFICIENT C_s = 1.707
 ANALYSIS PROCEDURE EQUIVALENT LATERAL FORCE

- NOTES:
- THE PC COMPONENTS & CLADDING AND MAIN WIND FORCE RESISTING SYSTEM DESIGN WIND PRESSURE q_s = 23.7 psf DETERMINED FROM THE CRITERIA LISTED ABOVE. (EXPOSURE C, K_e=0.960, K_{zt}=1.0, K_d = 0.85).
 THE PC MAY BE USED FOR RISK CATEGORY II TYPE STRUCTURES IN ANY WIND ZONE WHERE q_s ≤ 23.7 psf.
 EXAMPLE:
 SITE BASIC WIND SPEED, V = 120 mph
 RISK CATEGORY II
 WIND: EXPOSURE B
 K_d = 0.85
 K_e = 0.701
 K_{zt} = 1.00
 q_s = 22.0 psf < 23.7 psf
 THE PC MAY BE USED AT THIS SITE, PENDING DSA SITE SPECIFIC APPROVAL.
 - THE PC SEISMIC FORCE RESISTING SYSTEM IS GOVERNED BY C_s = 1.707 FROM THE CRITERIA LISTED ABOVE. (R = 1.25, S_s = 3.2, I = 1.00).
 THE PC MAY BE USED FOR RISK CATEGORY II STRUCTURES AT ANY SITE WHERE THE SITE SPECIFIC SEISMIC PARAMETER S_s AND R = 1.25 RESULT IN A VALUE C_s ≤ 1.707.
 EXAMPLE:
 RISK CATEGORY II
 SOIL: SITE CLASS A
 S_s = 3.4
 S_i = 1.8
 R = 1.25
 I = 1.00
 S_{DS} = 1.813
 C_s = 1.451 < 1.707
 THE PC MAY BE USED AT THIS SITE, PENDING DSA SITE SPECIFIC APPROVAL.

BUILDING DATA

TYPE OF CONSTRUCTION..... IIB
 OCCUPANCY..... VARIES - SEE EXAMPLES
 NUMBER OF STORIES..... 1
 BUILDING AREAS..... VARY DUE TO OCCUPANCY - SEE EXAMPLES
 MODULE SIZES..... VARY WITH OPTIONS
 BUILDING LENGTH:
 ALL WIDTHS..... MAX. 500'-0" LENGTH
 NOTE: NO SEISMIC AND/OR THERMAL EXPANSION JOINTS REQUIRED ALONG THE LENGTH OF THE STRUCTURES. (ALL JOINTS ARE INTERNAL)
 OCCUPANCY AND BUILDING AREA EXAMPLES:
 ALL STRUCTURES SHALL BE BASED ON RISK CATEGORY II STRUCTURE.
 A. OCCUPANCY:
 EXAMPLE 1:
 STRUCTURES LOCATED OVER LUNCH AREA WITHOUT FIXED SEATING
 OCCUPANCY: A-2
 OCCUPANCY LOAD: 15 sf/person - MAX 300 FOR RISK II
 MAX SQ FT: 4,500 sq ft
 EXAMPLE 2:
 STRUCTURES LOCATED OVER LUNCH AREA WITH FIXED SEATING
 OCCUPANCY: A-2
 OCCUPANCY LOAD: 18"/person ALONG LINEAR BENCH - MAX 300 FOR RISK II
 MAX SQ FT: 5,400 LINEAR INCHES OF FIXED SEATING UNDER THE STRUCTURE
 EXAMPLE 3:
 STRUCTURES LOCATED OVER AN AREA DESIGNATED FOR ASSEMBLY (TYPICALLY AMPHITHEATER, OR OTHER SPACE WITH FIXED SEATING OR DESIGNATED AS A STANDING ASSEMBLY AREA)
 OCCUPANCY: A
 OCCUPANCY LOAD: 7 sf/person - MAX 300 FOR RISK II
 MAX SQ FT: 2,100 sq ft
 SHADE STRUCTURE
 EXAMPLE 1:
 STRUCTURES LOCATED OVER A FIELD, BLACKTOP, PLAYGROUND EQUIPMENT,OR OTHER NON DESIGNATED USE SPACES
 OCCUPANCY: E
 OCCUPANCY LOAD: 20 sf/person - MAX 250 FOR RISK II
 MAX SQ FT: 5,000 sq ft
 PARKING
 EXAMPLE 1:
 STRUCTURES LOCATED OVER PARKING
 OCCUPANCY: S-2
 OCCUPANCY LOAD: 200 sf/person
 MAX SQ FT: UNLIMITED PER CBC 406.5.4 AND 406.5.5

CODES

- TITLE 24, CCR CODES:
- 2016 CALIFORNIA ADMINISTRATIVE CODE (CAC) (PART 1, TITLE 24, CCR)
 - 2016 CALIFORNIA BUILDING CODE (CBC), VOLUMES 1 AND 2 (PART 2, TITLE 24, CCR) (2015 INTERNATIONAL BUILDING CODE WITH 2016 CALIFORNIA AMENDMENTS)
 - 2016 CALIFORNIA ELECTRICAL CODE (PART 3, TITLE 24, CCR) (2014 NATIONAL ELECTRICAL CODE WITH 2016 CALIFORNIA AMENDMENTS)
 - 2016 CALIFORNIA MECHANICAL CODE (CMC) (PART 4, TITLE 24, CCR) (2015 UNIFORM MECHANICAL CODE WITH 2016 CALIFORNIA AMENDMENTS)
 - 2016 CALIFORNIA PLUMBING CODE (CPC) (PART 5, TITLE 24, CCR) (2015 UNIFORM PLUMBING CODE WITH 2016 CALIFORNIA AMENDMENTS)
 - 2016 CALIFORNIA ENERGY CODE (PART 6, TITLE 24, CCR) (2016 EDITION CALIFORNIA ENERGY COMMISSION BUILDING ENERGY EFFICIENCY STANDARDS)
 - 2016 CALIFORNIA FIRE CODE (CFC) (PART 9, TITLE 24, CCR) (2015 INTERNATIONAL FIRE CODE WITH 2016 CALIFORNIA AMENDMENTS)
 - 2016 CALIFORNIA GREEN BUILDING STANDARDS CODE (PART 11, TITLE 24, CCR)
 - 2016 CALIFORNIA REFERENCED STANDARDS CODE (PART 12, TITLE 24, CCR) NFPA 13 - 2016 NFPA 72 - 2016
- REFERENCE CODE SECTIONS FOR APPLICABLE STANDARDS:
 2016 CBC, CHAPTER 35
 2016 CFC, CHAPTER 80

FIRE LIFE SAFETY

AUTOMATIC FIRE SPRINKLERS REQUIRED? (Y/N)..... N

ENGINEER'S APPROVAL

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP: 01-118984 INC:
 REVIEWED FOR
 SS FLS ACS
 DATE: 08/13/2020

DATE SIGNED
 11/28/2018



SITE SPECIFIC DSA APPROVAL

FILE NUMBER: PC-119
 IDENTIFICATION STAMP
 DIVISION OF THE STATE ARCHITECT
 APP. NO: 04 117111 INCR
 AC DF DS DS DS DS DP
 DATE: 12/05/2018

PRE-CHECK (PC) DOCUMENT

MBARC CONSTRUCTION INC.
 674 RANCHEROS DR SAN MARCOS, CA 92069
 PHONE: (760) 744-4131
 FAX: (760) 744-4449
 GREGJ@MBARCONLINE.COM (775) 787-8845
 IJC # 869980
 B AND C 51


ASTEL ENGINEERING
 STRUCTURAL ENGINEERING
 26030 ACHERO, SUITE 200 MISSION VIEJO, CA 92691
 PHONE: (949) 305-1150
 FAX: (949) 305-1420

VERSA CANOPY GENERAL DATA

DRAWN GM
 CHECKED KS
 DATE 11/28/2018
 4STEL JOB NO. MC03-01
 SHEET S-2
 2 OF 13 SHEETS

SOILS NOTES

- IF NO GEOTECHNICAL REPORT IS SUPPLIED AT THE TIME OF DSA REVIEW ADDRESSING SITE-SPECIFIC PARAMETERS, FOUNDATION SELECTIONS SHALL BE BASED ON CLASS W SOILS (SOIL CLASS 5 OF CBC TABLE 1806A.2 WITH DOUBLING OF LATERAL BEARING PRESSURE FOR STRUCTURES NOT ADVERSELY AFFECTED BY 1/2" MOTION AT GROUND SURFACE) IN THE SOIL CLASS TABLE BELOW.
- WHEN A GEOTECHNICAL REPORT IS SUPPLIED THE GEOTECHNICAL ENGINEER SHALL REVIEW THE SITE CONDITIONS, TESTING RESULTS, AND ALL ALLOWABLE INCREASES AND SUPPLY THE FINAL SOIL CLASS TO BE USED FROM THE BELOW TABLE. THE GEOTECHNICAL ENGINEER SHALL PROVIDE IN THE GEOTECHNICAL REPORT THE FOLLOWING BASE VALUES WITHOUT INCREASE FOR 24" DIAMETER PIERS: THE ALLOWABLE VERTICAL END BEARING, ALLOWABLE LATERAL BEARING, ALLOWABLE DOWNWARD SKIN FRICTION, ALLOWABLE SKIN FRICTION TO RESIST UPLIFT. THE GEOTECHNICAL ENGINEER SHALL ALSO PROVIDE ANY ALLOWABLE INCREASES TO THE BASE VALUES. ALLOWABLE INCREASES ARE TYPICALLY DUE TO BUT NOT EXCLUSIVE TO: DOUBLE VALUES DUE TO ISOLATED FOUNDATIONS, DOUBLE VALUES DUE TO THE STRUCTURE NOT BEING ADVERSELY AFFECTED BY 1/2" DEFLECTION AT THE SURFACE, A 4/3 INCREASE DUE TO SHORT TERM LOADING, AND ANY OTHER ALLOWABLE INCREASES. THE GEOTECHNICAL ENGINEER SHALL MAKE RECOMMENDATION OF THE SOIL CLASS TO BE USED AFTER ALL INCREASES HAVE BEEN APPLIED. ALL FOUNDATIONS HAVE BEEN DESIGN BASED ON THE VALUES PRESENTED IN THE BELOW TABLE. THE GEOTECHNICAL REPORT SHALL ADDRESS IF THE USE OF STEEL CASING THAT IS TWISTED INTO PLACE AND LEFT INSTALLED AFFECTS ANY ALLOWABLE VALUES.
- THE GEOTECHNICAL ENGINEER MAY SPECIFY DIFFERENT SOILS CLASSES TO BE USED FOR THE DIFFERENT STRUCTURE TYPES (VC14 OR VC20), DIFFERENT AREAS OF THE SITE (I.E. NORTH LOT OR WEST LOT), OR THE ENGINEER MAY SPECIFY ONE SOILS CLASS TO BE USED FOR THE ENTIRE SITE.
- THE GEOTECHNICAL ENGINEER SHALL ADDRESS IN THE REPORT ANY CONCRETE DURABILITY REQUIREMENTS IN ACCORDANCE WITH ACI 318-11 CHAPTER 4.
- THE GEOTECHNICAL REPORT SHALL BE SPECIFIC TO THE LOCATION OF THE STRUCTURES. BORING(S) SHALL BE DONE AT THE SPECIFIC LOCATION(S) WHERE THE STRUCTURES ARE TO OCCUR. THE GEOTECHNICAL REPORT SHALL CONFORM TO 2016 CBC SECTION 1803A.
- A COPY OF THE GEOTECHNICAL REPORT SHALL BE PROVIDED AT THE TIME OF PLAN REVIEW.
- AT THE TIME OF PLAN REVIEW, THE DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE SHALL SELECT A SOILS CLASS ON THE SITE-SPECIFIC PLANS BASED ON THE GEOTECHNICAL REPORT (OR NOTE 1 ABOVE). HOLES MAY BE LEFT OPEN FOR ANY AMOUNT OF TIME AS LONG AS THEY ARE PROPERLY COVERED FOR OSHA STANDARDS.
- FOUNDATIONS ADJACENT TO SLOPED GROUND SURFACES SHALL BE SET BACK PER THE FOLLOWING FIGURE UNLESS OTHERWISE RECOMMENDED BY A SITE SPECIFIC GEOTECHNICAL REPORT.

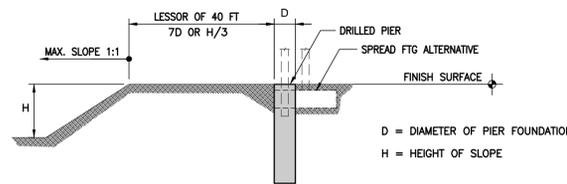

DESIGN SOIL VERTICAL AND LATERAL BEARING VALUES					
SOIL CLASS	VERTICAL BEARING PRESSURE (psf)	LATERAL BEARING PRESSURE (psf/ft)	MAXIMUM LATERAL BEARING (psf)	MIN. DOWNWARD SKIN FRICTION (psf)	MIN. UPWARD SKIN FRICTION (psf)
CLASS Y	1,300	135	2,000	175	30
CLASS W	1,500	267	4,000	225	50
CLASS A	2,000	400	6,000	250	75
CLASS Y	2,000	533	8,000	275	75
CLASS Z	3,000	800	12,000	325	100

SPECIAL INSPECTION

- SOILS:**
 - VERIFY THE SITE HAS BEEN PREPARED PROPERLY PRIOR TO PLACEMENT OF CONTROLLED FILL AND/OR EXCAVATIONS FOR FOUNDATIONS.
 - VERIFY THAT THE FOUNDATION EXCAVATIONS ARE EXTENDED TO PROPER DEPTH AND HAVE REACHED PROPER MATERIAL.
 - VERIFY THAT MATERIALS BELOW FOOTINGS ARE ADEQUATE TO ACHIEVE THE DESIGN BEARING CAPACITY.
- PIER FOUNDATIONS:**
 - INSPECT DRILLING OPERATIONS AND MAINTAIN COMPLETE AND ACCURATE RECORDS FOR EACH PIER.
 - VERIFY LOCATIONS OF PIERS.
- CONCRETE:**
 - VERIFY USE OF REQUIRED DESIGN MIX, DETERMINE THE TEMPERATURE OF THE CONCRETE, AND (WHERE REQUIRED) PERFORM AIR CONTENT TEST.
 - TEST CONCRETE (COMPRESSION TEST).
 - INSPECT PLACEMENT OF FORMWORK, REINFORCING STEEL, EMBEDDED ITEMS, AND CONCRETE. INSPECT CURING AND FORM REMOVAL.
 - SLUMP TEST SHALL BE PERFORMED PER SITE SPECIFIC DSA-103.
- STEEL:**
 - VERIFY THAT ALL MATERIALS ARE APPROPRIATELY MARKED AND THAT:
 - MILL CERTIFICATES INDICATE MATERIAL PROPERTIES THAT COMPLY WITH REQUIREMENTS.
 - MATERIAL SIZES, TYPES AND GRADES COMPLY WITH REQUIREMENTS.
 - TEST UNIDENTIFIED MATERIALS.
 - VERIFY MEMBER LOCATIONS, BRACING AND ALL DETAILS CONSTRUCTED IN THE FIELD.
 - VERIFY STIFFENER LOCATIONS, CONNECTION TAB LOCATIONS, AND ALL CONSTRUCTION DETAILS FABRICATED IN THE SHOP.
 - HIGH STRENGTH SLIP CRITICAL BOLTING.
- SHOP FABRICATION:**
 - VERIFY FABRICATOR'S FABRICATION AND QUALITY CONTROL PROCEDURES.
 - VERIFY ALL ASPECTS OF SHOP FABRICATION INCLUDING MEMBER LOCATIONS, DIMENSIONAL LAYOUT OF ALL PARTS AND PIECES, BOLTING, ETC.
- SEE DSA APPROVED 103 FOR ADDITIONAL REQUIREMENTS.

GENERAL NOTES

- DESIGN PER 2016 C.B.C. AND ITS PRESCRIBED LOADING AND MATERIAL SPECIFICATIONS:
 - ASCE 7-10
 - 14TH EDITION AISC STEEL CONSTRUCTION MANUAL
 - 2012 AISI COLD FORMED STEEL STANDARD
 - ACI 318-14
- THESE STRUCTURES ARE NOT DESIGNED TO BE, NOR SHALL THEY BE, ENCLOSED.
- ALL DIMENSIONS, CONDITIONS, AND ELEVATIONS ARE TO BE FIELD VERIFIED BY THE CONTRACTOR PRIOR TO COMMENCING WORK OR FABRICATION. IF ANY DISCREPANCIES ARE FOUND OR IF ANY CONDITION EXISTS NOT AS SHOWN ON THE DRAWINGS THE DESIGN PROFESSIONAL IN RESPONSIBLE CHARGE SHALL BE NOTIFIED IMMEDIATELY.
- IF THE SNOW LOAD OPTION IS USED THEN THE SITE-SPECIFIC MAX GROUND SNOW LOADING INCLUDING DRIFT MUST BE LESS THAN OR EQUAL TO 20 PSF.
- ALL SCREWS TO BE ITW BUILDEX TEK SCREWS PER ICC ESR-1976 OR ELCO DRILL SCREW PER ICC ESR-3294.
- OWNER TO SIGN AUTHORIZATION TO PROCEED PRIOR TO DRILLING.

674 Rancheros Drive
San Marcos, CA 92069
PH: 760.744.4131
FAX: 760.744.4449
CA LIC #869980

Authorization to Proceed

Project Name: _____ Foreman: _____
 Site Name: _____ Contractor: _____

As an authorized representative of Contractor listed above, I, _____ agree to the following statements below:

_____(initial) **LAYOUT:** The onsite layout for installation of structural steel for carports and canopies has been inspected and is approved as is.

_____(initial) **ARRAY ORIENTATION/CONCRETE POUR:** The tilt and direction of the canopies have been verified and are approved as is.

ARRAYS:

It is understood that additional costs will apply due to the following delays: re-layout not due to M Bar C, underground site conflicts (unmarked utility lines, including but not limited to water, sewer, fire, irrigation, electrical); encountered underground water; change in soils condition, including but not limited to hard drilling, caving soils, obstructions).

BY: _____ DATE: _____
 (signature) _____

www.mbarconline.com

STEEL NOTES

- COLD FORMED STEEL SIZES ARE BASED ON BARE STEEL THICKNESS.
- STRUCTURAL PURLIN, BEAM & COLUMN MEMBERS SHALL HAVE MINIMUM STEEL YIELD STRENGTHS AS INDICATED.
- STRUCTURAL STEEL SHALL BE HOT-DIP GALVANIZED (MINIMUM ASTM A123 OR A153, CLASS D) OR PAINTED WITH ZINC-RICH PRIMER, UNDERCOAT, AND FINISH COAT; OR EQUIVALENT PAINT SYSTEM. COLD-FORMED STEEL MEMBERS SHALL BE 55% ALUMINUM-ZINC ALLOY COATED PER ASTM A792/A792M STANDARD IN ACCORDANCE TO AISI S200 TABLE A4-1, CP 90 COATING DESIGNATION.
- ALL EXPOSED STEEL FASTENERS, INCLUDING CAST IN PLACE ANCHOR BOLTS/RODS, SHALL BE STAINLESS STEEL (TYPE 304 MINIMUM), HOT-DIP GALVANIZED (ASTM A153, CLASS D MINIMUM OR ASTM F2329), OR PROTECTED WITH CORROSION-PREVENTIVE COATING THAT DEMONSTRATED NO MORE THAN 2% OF RED RUST IN MINIMUM 1,000 HOURS OF EXPOSURE IN SALT SPRAY TEST PER ASTM B117. ZINC-PLATED FASTENERS DO NOT COMPLY WITH THIS REQUIREMENT. (EXAMPLE PROPRIETARY COATINGS THAT COMPLY WITH THE 1000 HOUR REQUIREMENT INCLUDE BUT ARE NOT NECESSARILY LIMITED TO: QUIK GUARD BY SIMPSON, KWIK-COTE BY HILTI, STALGARD BY ELOCO, VISTA-CORR BY SFS INTEC, ETC.)
- STEEL FABRICATION SHALL COMPLY WITH LATEST AISC SPECIFICATIONS.
- HOLLOW STRUCTURAL STEEL (HSS) MEMBERS SHALL BE ASTM A1085 GR. 50 U.N.O. ASTM A1085 STEEL HAS THE SAME OR BETTER PROPERTIES AND WELDABILITY THAN ASTM A500 GR. B.
- COLD FORMED STEEL (CFS) MEMBERS SHALL BE ASTM A653 SS GR. 55 (F_y = 55 ksi, F_u = 70 ksi) OR ASTM A1011 SS GR. 55 (F_y = 55 ksi, F_u = 70 ksi).
- ZINC COATING OF STRUCTURAL STEEL SHALL CONFORM WITH G90 STANDARD OR BETTER. COLD FORMED STEEL (CFS) MEMBERS TO BE GALVANIZED IN ACCORDANCE WITH ASTM A653 G90 STANDARD. HOLLOW STRUCTURAL STEEL (HSS) MEMBERS SHALL BE GALVANIZED IN ACCORDANCE WITH ASTM A123, UNLESS NOTED OTHERWISE.
- ALL STEEL MEMBERS TO BE GALVANIZED OR PAINTED WITH ZINC-RICH PRIMER, UNDERCOAT AND FINISH COAT OR EQUIVALENT PAINT SYSTEM. CONTRACT DOCUMENTS SHALL SPECIFY THE TYPE OF SSPC CORROSION RESISTING SYSTEM TO BE UTILIZED AND THE SSPC GRADE FOR CLEANING, MINIMUM SSPC GRADE SP2.
- BOLTS SHALL CONFORM TO THE ASTM A307 SPECIFICATIONS UNLESS NOTED OTHERWISE. INSPECTION OF A307 BOLTING IS NOT REQUIRED.
- ASTM A307 BOLTS MAY BE SUBSTITUTED WITH THE SAME NUMBER AND SIZE OF SAE J429 GRADE 2 BOLTS.
- BOLTS SHALL BE TIGHTENED TO SNUG-TIGHT CONDITION UNLESS NOTED OTHERWISE EXCEPT FOR A325-SC HIGH STRENGTH BOLTS USED IN THE BEAM TO COLUMN CONNECTION.
- A325-SC BOLTS SHALL BE PRE-TENSIONED PER AISC SPECIFICATIONS USING APPROVED LOAD INDICATOR METHODS INCLUDING BUT NOT LIMITED TO TURN-OF-THE-NUT WITH MATCH MARKING, TWIST OFF TENSION CONTROL OR DIRECT TENSION INDICATOR BOLT, NUT AND WASHER ASSEMBLIES.
- ASTM A307 BOLTS SHALL HAVE STANDARD WASHERS UNDER THE NUT & BOLT HEAD (F436 WASHERS ARE NOT REQUIRED). STANDARD WASHERS DO NOT REQUIRE HARDNESS TEST.
- BOLT HOLES FOR 1/2" BOLTS SHALL BE AS FOLLOWS:
STANDARD HOLES: 3/8"

CONCRETE NOTES

- CONCRETE MIN. 4,500 PSI AT 28 DAYS UNLESS A SOILS REPORT IS PROVIDED THAT ALLOWS FOR A LOWER STRENGTH (3,000 PSI MIN.). BATCH PLANT INSPECTION NOT REQUIRED.
 - CONCRETE SHALL MEET THE FOLLOWING MINIMUM REQUIREMENTS BASED ON EXPOSURE CLASS IN ACCORDANCE WITH ACI 318-14 TABLE 19.3.2.1 WHEN DETERMINED BY A SITE-SPECIFIC GEOTECHNICAL REPORT.
- | REQUIREMENTS FOR CONCRETE BASED ON EXPOSURE CLASS | | | |
|---|--|-----------------------|-----------------------------|
| EXPOSURE CLASS ACI TABLE 19.3.2.1 | MINIMUM CONCRETE STRENGTH F _c | CEMENT TYPE ASTM C150 | MAX. WATER/CEMENT RATIO W/M |
| NOT DETERMINED | 4,500 PSI | TYPE IV | 0.45 |
| FO, SO, PO, CO, C1 | 3,000 PSI | TYPE II | N/A |
| S1, P1 | 4,000 PSI | TYPE II | 0.50 |
| ALL OTHER | 4,500 PSI | TYPE V | 0.45 |
- CONCRETE EXPOSED TO THAW AND FREEZE CYCLE SHALL BE AIR ENTRAINED PER ACI 318-14 TABLE 19.3.1.1.
 - CONCRETE TO ATTAIN 1000 PSI PRIOR TO REMOVAL OF SHORING AND/OR INSTALLATION OF BEAMS AND PURLINS. (NOTE: A HIGHER COMPRESSIVE CONCRETE MAY BE USED TO ACHIEVE 1000 PSI SOONER. SUBMIT CONCRETE MIX DESIGN PREPARED BY A QUALIFIED LICENSED PROFESSIONAL ENGINEER FOR APPROVAL BY THE DESIGN PROFESSIONAL IN RESPONSIBLE CHARGE PRIOR TO BEING PLACED.)
 - CONCRETE TO REACH 3000 PSI PRIOR TO INSTALLATION OF ROOF DECK. (NOTE: A HIGHER COMPRESSIVE CONCRETE MAY BE USED TO ACHIEVE 3000 PSI SOONER. SUBMIT CONCRETE MIX DESIGN PREPARED BY A QUALIFIED LICENSED PROFESSIONAL ENGINEER FOR APPROVAL BY THE DESIGN PROFESSIONAL IN RESPONSIBLE CHARGE PRIOR TO BEING PLACED.)
 - REINFORCEMENT BARS SHALL BE ASTM A615, GR60 TYPICAL, U.N.O.
 - MINIMUM CONCRETE COVER SHALL BE 2 1/2" TO EARTH (DRILLED PIER FOUNDATIONS ONLY), 3" TO EARTH ALL OTHER CONCRETE, 2" TO EXPOSED SURFACES PER CBC TABLE 1808A.8.2
 - ALL REINFORCING STEEL AND OTHER EMBEDDED ITEMS SHALL BE SECURELY POSITIONED PRIOR TO THE POURING OF CONCRETE.
 - ALL CONCRETE WORK SHALL COMPLY WITH ACI 301 & 318 STANDARDS.
 - AGGREGATE GRADATION AND QUALITY SHALL BE IN ACCORDANCE WITH ACI 302-R.
 - COLD JOINTS SHALL HAVE A ROUGHENED SURFACE. BONDING AGENT SHALL COMPLY WITH ASTM C1059. A SUBMITTAL FOR CONCRETE BONDING AGENT SHALL BE APPROVED BY DESIGN PROFESSIONAL IN RESPONSIBLE CHARGE PRIOR TO INSTALLATION. DSA INSPECTOR OF RECORD TO PERIODICALLY INSPECT INSTALLATION OF BONDING AGENT.
 - BATCH PLANT INSPECTION NOT REQUIRED PER CBC 1705A3.3.2. SUBJECT TO:
 - A LICENSED WEIGHMASTER SHALL POSITIVELY IDENTIFY QUANTITY OF MATERIALS AND CERTIFY EACH LOAD BY A BATCH TICKET.
 - BATCH TICKETS, INCLUDING MATERIAL QUANTITIES AND WEIGHTS SHALL ACCOMPANY THE LOAD, SHALL BE TRANSMITTED TO THE INSPECTOR OF RECORD BY THE TRUCK DRIVER WITH LOAD IDENTIFIED THEREON. THE LOAD SHALL NOT BE PLACED WITHOUT A BATCH TICKET IDENTIFYING THE MIX. THE INSPECTOR OF RECORD SHALL KEEP A DAILY RECORD OF PLACEMENTS, IDENTIFYING EACH TRUCK, ITS LOAD, AND TIME OF RECEIPT AT THE JOBSITE, AND APPROXIMATE LOCATION OF DEPOSIT IN THE STRUCTURE AND SHALL MAINTAIN A COPY OF THE DAILY RECORD AS REQUIRED BY THE ENFORCEMENT AGENCY.
 - CONCRETE MAY BE PUMPED, POURED, TAILGATED, OR OTHER SUCH METHODS INTO PLACE. CONCRETE SHALL BE ALLOWED TO FREE FALL THE ENTIRE DEPTH OF THE FOUNDATION. PLACEMENT OF ANY FREE-FALL CONCRETE SHALL BE SUCH THAT THE CONCRETE DOES NOT ALTER THE EMBEDMENT DEPTH OR THE CLEARANCE OF THE REINFORCING BAR CAGE OR OTHER EMBEDDED MATERIALS.

ENGINEER'S APPROVAL

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 01-118984 INC:
REVIEWED FOR
SS FLS ACS
DATE: 08/13/2020

DATE SIGNED
11/28/2018



SITE SPECIFIC DSA APPROVAL

FILE NUMBER: PC-119
IDENTIFICATION STAMP
DIVISION OF THE STATE ARCHITECT
APP. NO: 04 117111 INCR
AC DF DS OS DP
DATE: 12/05/2018
PRE-CHECK (PC) DOCUMENT
CODE: 2016 CBC
A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED

MBARC CONSTRUCTION INC.
 674 RANCHEROS DR SAN MARCOS, CA 92069
 PHONE: (760) 744-4131 FAX: (760) 744-4449
 LIC # 869980 B AND C S1
 GREGJ@MBARCONLINE.COM (775) 787-8845

4STEL ENGINEERING
 STRUCTURAL ENGINEERING
 26030 A CHERO, SUITE 200 MISSION VIEJO, CA 92691
 PHONE: (949) 305-1150 FAX: (949) 305-1420

VERSA CANOPY GENERAL NOTES

DRAWN GM
CHECKED KS
DATE 11/28/2018
4STEL JOB NO. MC03-01
SHEET
S-3
3 OF 13 SHEETS

DSA DSA-103 Issued 9/10/17
List of Required Structural Tests & Special Inspections - 2016 CBC

INCREMENT # _____ DSA File No.: PC-119
 Application No.: SA-117117
 Date Submitted: _____ Reviewed: _____

Sheet Name: Spread Footings without post installed anchors (Name)


IMPORTANT: This form is only a summary list of structural tests and some of the special inspections required for the project. Generally, the structural tests and special inspections noted on this form are those that will be performed by the Geotechnical Engineer of Record, Laboratory of Record, or Special Inspector. The actual complete test and inspection program must be performed as detailed on the DSA approved documents. The appendices at the bottom of this form identify work NOT subject to DSA requirements for special inspection or structural testing. The project inspector is responsible for providing inspection of all tests of construction including but not limited to, special inspections not listed on this form such as structural wood framing, high-strength wood diaphragms, cold-formed steel framing, anchorage of non-structural components, etc., per Title 24, Part 2, Chapter 17A. NOTE: This form is also available for projects submitted for review under the 2007, 2010, and 2013 CBC.

INSTRUCTIONS: Click a plus sign (+) before any category or subcategory to reveal additional tests and special inspections. A shaded box indicates a test or special inspection that may be required, depending on the scope of the construction and other issues. A shaded box can be checked indicating your selection of that test. Note: A minus (-) on a category or subcategory heading indicates that it can be collapsed. However, any selection you may have made will be cleared. Click on the "COMPLI" button to show only the tests and inspections fully selected. For more information on use of this form, see DSA-103.INSTR.

Note: References are to the 2016 edition of the California Building Code (CBC) unless otherwise noted.

TEST OR SPECIAL INSPECTION	TEST	PERIODIC	CONTINUOUS	CODE REFERENCE AND NOTES
SOILS				
1. GENERAL:				Table 1705A.6
a. Verify that:				
- all test pits have been properly prepared prior to placement of controlled fill and/or excavations for foundations.				
- foundation excavations are extended to proper depth and have reached proper materials.				
- materials below footings are adequate to achieve the design bearing capacity.				
b. Verify that:				
- foundation excavations are extended to proper depth and have reached proper materials.				
- materials below footings are adequate to achieve the design bearing capacity.				
4. CAST-IN-PLACE DEEP FOUNDATIONS (PIERS):				Table 1705A.8
a. Inspect drilling operations and methods, logs and records:				
- records for each pier.				
b. Verify pier location, dimensions, planimetry, and elevations (if applicable), length, and embedment into bedrock (if applicable). Report concrete or grout volumes.				
c. Confirm adequate and strata bearing capacity.				
d. Concrete piles:				
- Provide tests and inspections for CONCRETE section below.				
7. CAST IN PLACE CONCRETE				Table 1705A.3, ACI 318-14 Sections 26.12 & 26.13
Material Verification and Testing:				
a. Verify use of required design mix.				
b. Identify, sample, and test reinforcing steel.				
c. During concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.				
b. Verify use of required design mix.				
c. Verify concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
d. Test concrete (f _c).				
Inspection:				
a. Verify use of required design mix.</				


ROOF DECK SPECIFICATIONS						
SECTION PROPERTIES			TOP IN COMPRESSION		BOTTOM IN COMPRESSION	
GA	F _y (ksi)	WEIGHT (psf)	k _t (in. ² /ft.)	S _x (in. ³ /ft.)	k _b (in. ² /ft.)	S _y (in. ³ /ft.)
26	80	0.89	0.0840	0.0762	0.0817	0.0623

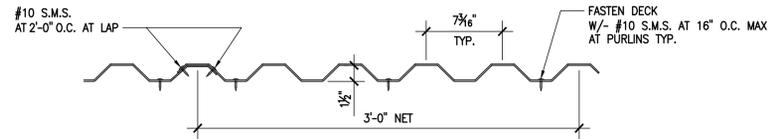

- NOTES:**
- MATERIAL AND SECTION PROPERTIES LISTED ABOVE ARE MINIMUM REQUIRED VALUES FOR METAL DECK BASED ON AEP HR-36 26 GA.
 - METAL ROOF DECK SHALL BE CLASS A PER CBC CHAPTERS 7A AND 15.

3 DECK DETAIL

N.T.S.

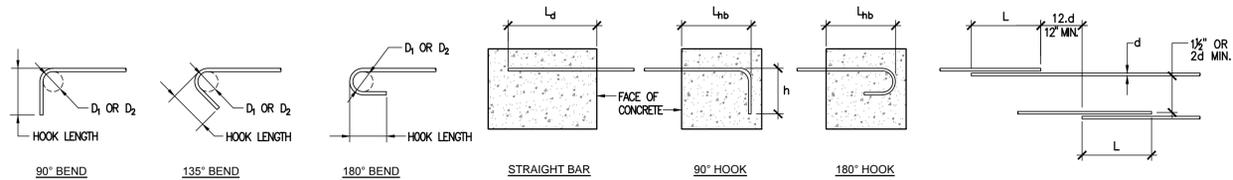

BAR SIZE	D ₁	D ₂
#3	1 1/2"	2 1/4"
#4	2"	3"
#5	2 1/2"	3 3/4"
#6, #7, #8	6x	6x

D₁ - FINISHED BEND DIA. FOR STIRRUP & TIE HOOKS.
 D₂ - BEND DIA. FOR STD HOOKS.
 'd' - BAR DIAMETER

BAR SIZE	MAIN REINF.		STIRRUP & TIE HOOKS	
	90°	180°	90°	180°
#3	6"	4"	3 1/2"	4 1/2"
#4	8"	4 1/2"	4 1/2"	4 1/2"
#5	10"	5"	5"	6"
#6	12"	6"	12"	7 1/2"
#7	14"	7"	14"	9"
#8	16"	8"	16"	10"

REINFORCEMENT DEVELOPMENT LENGTHS				
CONCRETE STRENGTH				
F _c = 3,000 PSI				
NOMINAL BAR SIZE	h	L _d		L _{hb}
		TOP BARS	OTHER BARS	
#3	6"	1'-10"	1'-5"	9"
#4	8"	2'-5"	1'-10"	11"
#5	10"	3'-0"	2'-4"	1'-2"
#6	12"	3'-7"	2'-9"	1'-5"
#7	14"	5'-3"	4'-0"	1'-7"
#8	16"	6'-0"	4'-7"	1'-10"

- NOTES:**
- TOP BARS ARE HORIZONTAL BARS WITH MORE THAN 12 INCHES OF CONCRETE CAST BELOW.

REINFORCEMENT LAP SPLICE LENGTH 'L'		
CONCRETE STRENGTH		
F _c =3,000 PSI		
NOMINAL BAR SIZE	TOP BARS	
	OTHER BARS	
#3	2'-4"	1'-10"
#4	3'-2"	2'-5"
#5	3'-11"	3'-0"
#6	4'-8"	3'-7"
#7	6'-9"	5'-3"
#8	7'-9"	6'-0"

- NOTES:**
- LAP SPLICE SHALL BE INCREASED 50% WHERE CLEAR SPACE BETWEEN BARS IS LESS THAN 2 BAR DIAMETERS AND/OR THE CLEAR COVER IS LESS THAN ONE BAR DIAMETER.

A STANDARD HOOKS

B DEVELOPMENT LENGTHS


C OFFSETS AND LAP SPLICES

4 TYPICAL REINFORCEMENT BAR BENDS AND LAPS

N.T.S.

SECTION NAME	D (in)	B (in)	L (in)	GA	WT (lb/ft)	A (in ²)	AXIS X-X			AXIS Y-Y		
							I _x (in ⁴)	S _x (in ³)	r _x (in)	I _y (in ⁴)	S _y (in ³)	r _y (in)
CS12 x 4 x 0.102 (12 GA)	12	4.0	1.0	12	7.35	2.16	46.87	6.76	4.66	4.38	1.53	1.42
CS12 x 4 x 0.124 (10 GA)	12	4.0	1.0	10	8.91	2.62	56.37	8.59	4.64	5.20	1.82	1.41
CS14 x 4 x 0.102 (12 GA)	14	4.0	1.0	12	8.04	2.36	67.42	8.22	5.34	4.57	1.55	1.39

- NOTES:**
- ALL PURLIN SECTIONS ARE ASTM A653, GR 55, F_y=55 ksi
 - ALL LIGHT GAGE STEEL DESIGNED USING 2012 AISI COLD-FORMED STEEL DESIGN MANUAL.
 - PROPERTIES PER AEP STANDARD SIZES.
 - ACTUAL MANUFACTURER'S PROPERTIES MUST MEET OR EXCEED AEP STANDARD PROPERTIES.

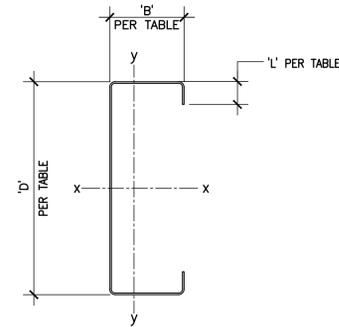


1 PURLIN & BEAM COLD FORMED C-SECTION

N.T.S.

SECTION NAME	D (in)	B (in)	t (in)	WT (lb/ft)	A (in ²)	AXIS X-X			AXIS Y-Y		
						I _x (in ⁴)	S _x (in ³)	r _x (in)	I _y (in ⁴)	S _y (in ³)	r _y (in)
HSS 12 x 6 x 1/4	12	6	1/4	29.23	8.59	161.00	26.80	4.33	55.20	18.40	2.53

- NOTES:**
- ALL COLUMNS SHALL BE ASTM A1085 GR. 50 (F_y=50 ksi)

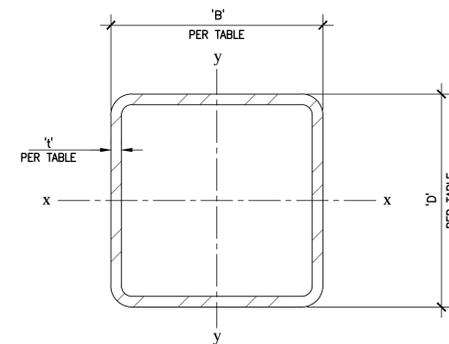

2 HSS COLUMN

N.T.S.

ENGINEER'S APPROVAL

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP: 01-118984 INC:
 REVIEWED FOR
 SS FLS ACS
 DATE: 08/13/2020

DATE SIGNED
 11/28/2018



SITE SPECIFIC DSA APPROVAL

FILE NUMBER: PC-119
 IDENTIFICATION STAMP
 DIVISION OF THE STATE ARCHITECT
 APP. NO: 04 117111 INCR
 AC DF DS DS SS DP
 DATE: 12/05/2018

PRE-CHECK (PC) DOCUMENT
 CODE: 2016 CBC
 A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED

MBARC CONSTRUCTION INC.
 IIC # 869980
 B AND C 51
 PHONE: (760) 744-4131
 (760) 744-4449
 FAX: (760) 744-4449
 GREGJ@MBARCONLINE.COM
 (775) 787-8845
 674 RANCHEROS DR
 SAN MARCOS, CA
 92069
 GREG JONES

4STEL ENGINEERING
 STRUCTURAL ENGINEERING
 26030 ACHERO, SUITE 200
 MISSION VIEJO, CA 92691
 PHONE: (949) 305-1150
 (949) 305-1420
 FAX: (949) 305-1420

VERSA CANOPY SECTION PROPERTIES & REBAR DETAILS

DRAWN GM
CHECKED KS
 DATE 11/28/2018
 4STEL JOB NO. MC03-01
 SHEET S-5

ENGINEER'S APPROVAL

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 01-118984 INC:
REVIEWED FOR
SS FLS ACS
DATE: 08/13/2020

DATE SIGNED
11/28/2018



SITE SPECIFIC DSA APPROVAL

FILE NUMBER: PC-119
IDENTIFICATION STAMP
DIVISION OF THE STATE ARCHITECT
APP. NO: 04-117111 INC:
AC. DF. DS. DS. DS. DS. DS.
DATE: 12/05/2018
PRE-CHECK (PC) DOCUMENT
CODE: 2016 CBC
A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED

MBARC CONSTRUCTION INC.
PHONE: (760) 744-4131 IIC # 869960
SAN MARCOS, CA FAX: (760) 744-4449 B AND C51
GREGJ@MBARCONLINE.COM (775) 787-8845
674 RANCHEROS DR
SAN MARCOS, CA 92069
GREG JONES

4STEL ENGINEERING STRUCTURAL ENGINEERING
PHONE: (949) 305-1150
26030 A CHERO, SUITE 200 MISSION VIEJO, CA 92691 FAX: (949) 305-1420

VERSA CANOPY VC14, VC18 & VC20 FRAMING SCHEDULES

DRAWN GM
CHECKED KS
DATE 11/28/2018
4STEL JOB NO. MC03-01
SHEET S-7
7 OF 13 SHEETS

VC14, VC18 & VC20 PURLIN SCHEDULE

I.D. #	MAX GROUND SNOW LOAD	MAX PURLIN SPACING (PS)	MAX COLUMN SPACING (S)	MAX CANTILEVER SPAN (CS)	PURLIN	
					SECTION	DETAIL
VC14	0 psf	63"	27'-0"	10'-0"	CS12 x 4 x 0.102 (12 GA)	1 S-5
VC18	0 psf	87"	27'-0"	10'-0"	CS12 x 4 x 0.124 (10 GA)	1 S-5
VC20	0 psf	99"	27'-0"	10'-0"	CS14 x 4 x 0.102 (12 GA)	1 S-5

- NOTES:**
- REFER TO SHEET 'S-2' FOR CONSTRUCTION OPTIONS.
 - REFER TO DETAIL '4/S-12' FOR ALLOWABLE PURLIN PENETRATIONS.
 - MULTIPLE STRUCTURE ID'S MAY BE SELECTED WITHIN THE SAME SITE.
 - WHEN UTILIZING A STRUCTURE ID READ FROM WITHIN THAT ID'S ROW ONLY.


1 VC14, VC18 & VC20
- TYPICAL PURLIN SCHEDULE

VC14, VC18 & VC20 BEAM/COLUMN SCHEDULE


I.D. #	MAX GROUND SNOW LOAD	MAX WIDTH (W)	BEAM SHORT SPAN MIN (SS)	BEAM LONG SPAN MAX (LS)	MAX COLUMN SPACING (S)	ROOF SLOPE	BEAM		BEAM TO COLUMN DETAIL	COLUMN		MAX COLUMN HEIGHT
							SECTION	DETAIL		SECTION	DETAIL	
							VC14	0 psf		14'-0"	4'-3"	
VC18	0 psf	18'-0"	7'-9"	10'-3"	27'-0"	3:12 MAX	CS12 x 4 x 0.102 (12 GA)	1 S-5	13 S-11	HSS 12 x 6 x 1/4	2 S-5	17'-9"
VC20	0 psf	20'-0"	5'-9"	14'-3"	27'-0"	3:12 MAX	CS14 x 4 x 0.102 (12 GA)	1 S-5	13 S-11	HSS 12 x 6 x 1/4	2 S-5	17'-0"

- NOTES:**
- MULTIPLE STRUCTURE ID'S MAY BE SELECTED WITHIN THE SAME SITE.
 - WHEN UTILIZING A STRUCTURE ID READ FROM WITHIN THAT ID ROW ONLY.
 - THE SHORT SPAN AND LONG SPANS MAY BE ADJUSTED WITH THE FOLLOWING REQUIREMENT:
THE OVERALL CANOPY WIDTH IS NOT EXCEEDED, NEITHER SPAN IS LESS THAN THE MIN SHORT SPAN & NEITHER SPAN EXCEEDS THE MAX LONG SPAN.


2 VC14, VC18 & VC20
- TYPICAL BEAM/COLUMN SCHEDULE

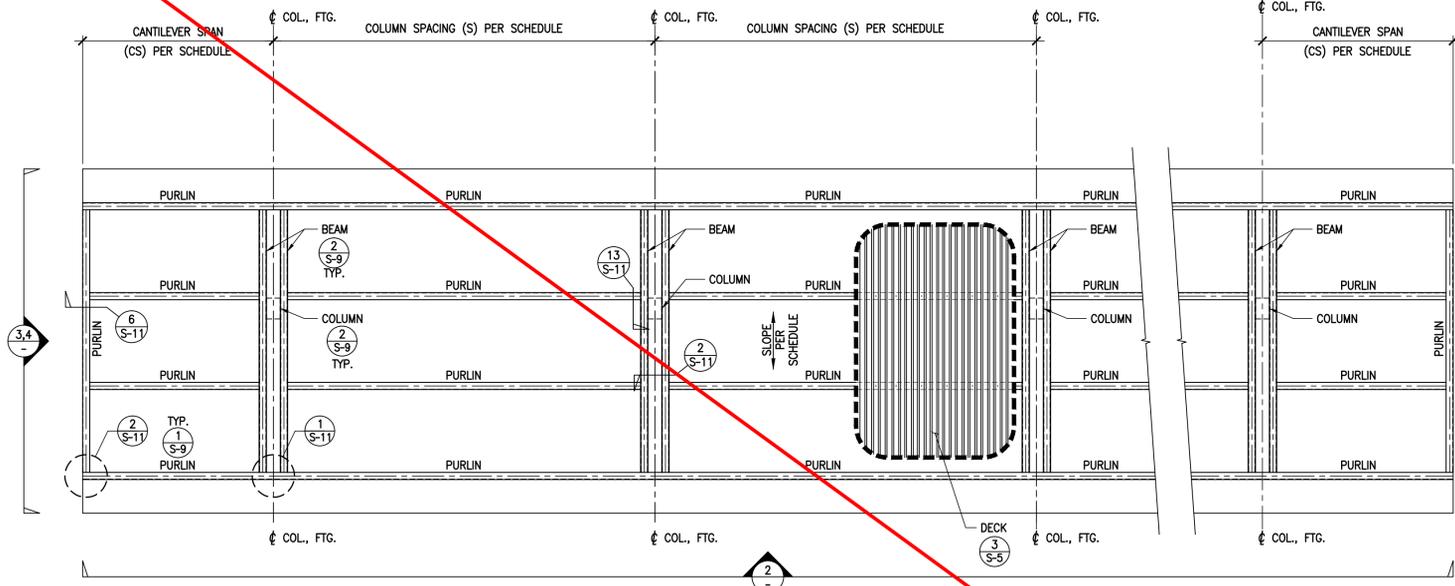


1 VC140, VC180 & VC200
 TYPICAL PLAN VIEW
 1/4"=1'-0"

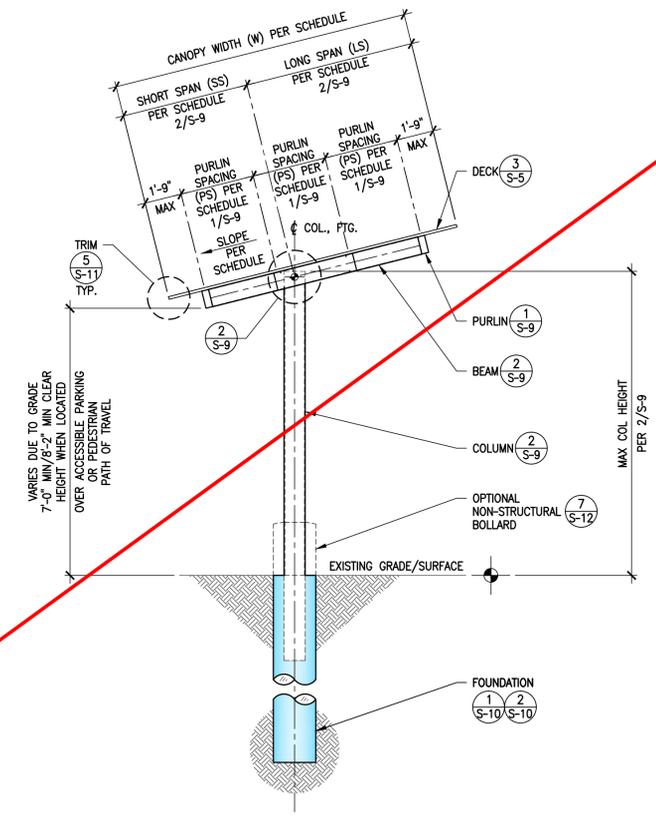

3 VC140, VC180 & VC200
 TYPICAL SIDE ELEVATION 1
 1/4"=1'-0"

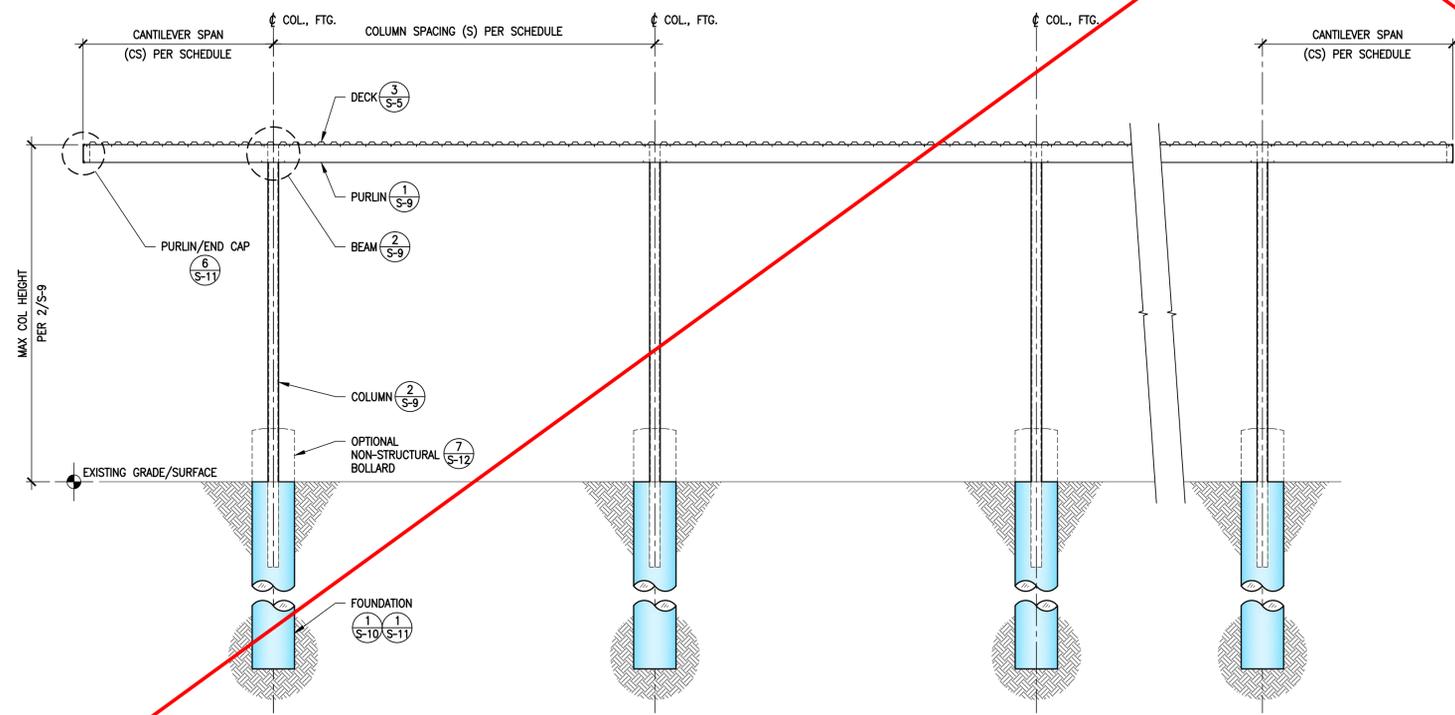

2 VC140, VC180 & VC200
 TYPICAL FRONT ELEVATION
 1/4"=1'-0"

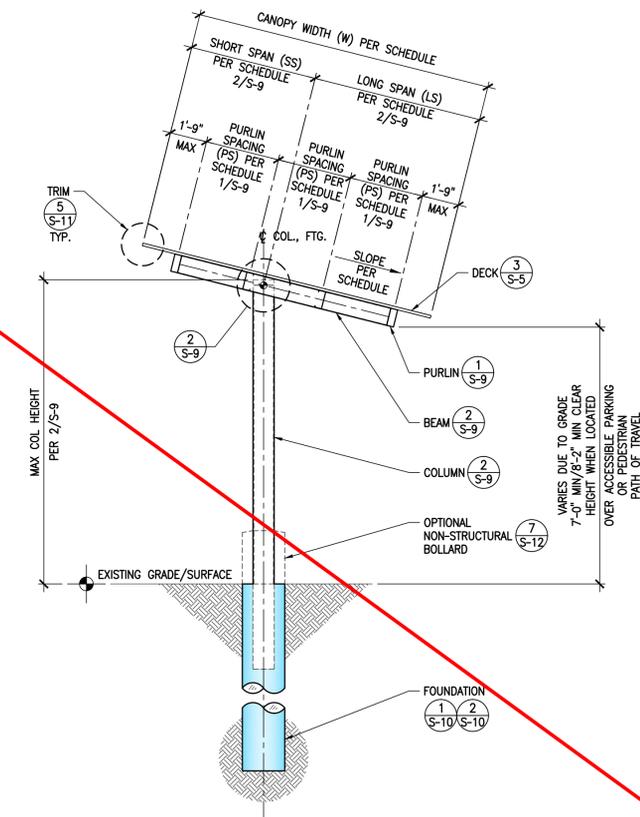

4 VC140, VC180 & VC200
 TYPICAL SIDE ELEVATION 2
 1/4"=1'-0"

ENGINEER'S APPROVAL
 IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP: 01-118984 INC:
 REVIEWED FOR
 SS FLS ACS
 DATE: 08/13/2020

DATE SIGNED
 11/28/2018

SITE SPECIFIC DSA APPROVAL

PRE-CHECK (PC) DOCUMENT
 CODE: 2016 CBC
 A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED

MBARC CONSTRUCTION INC.
 IIC # 869980
 B AND C51
 (760) 744-4449
 GREGJ@MBARCONLINE.COM (775) 787-8845
 674 RANCHEROS DR
 SAN MARCOS, CA
 PHONE: (760) 744-4131
 FAX: (760) 744-4449
 GREG JONES

4STEL ENGINEERING
 STRUCTURAL ENGINEERING
 26030 ACHERO, SUITE 200
 MISSION VIEJO, CA 92691
 PHONE: (949) 305-1150
 FAX: (949) 305-1420

VERSA CANOPY
 VC140, VC180 & VC200
 FRAMING PLAN & ELEVATIONS

DRAWN GM
CHECKED KS
 DATE 11/28/2018
 4STEL JOB NO. MC03-01
 SHEET

S-8
 8 OF 13 SHEETS

ENGINEER'S APPROVAL

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP: 01-118984 INC:
 REVIEWED FOR
 SS FLS ACS
 DATE: 08/13/2020

DATE SIGNED
 11/28/2018



SITE SPECIFIC DSA APPROVAL

~~FILE NUMBER: PC-119
 IDENTIFICATION STAMP
 DIVISION OF THE STATE ARCHITECT
 APP. NO: 04 117117 INCR
 AC DF FL PS DS SS DP
 DATE: 12/05/2018~~

~~PRE-CHECK (PC) DOCUMENT
 CODE: 2016 CBC
 A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED~~

MBARC CONSTRUCTION INC.
 IIC # 869960
 R AND C 51
 PHONE: (760) 744-4131
 FAX: (760) 744-4449
 GREGJ@MBARCONLINE.COM | (775) 787-8845
 674 RANCHEROS DR
 SAN MARCOS, CA 92069
 GREG JONES

4STEL ENGINEERING
 STRUCTURAL ENGINEERING
 26030 A CHERO, SUITE 200
 MISSION VIEJO, CA 92691
 PHONE: (949) 305-1150
 FAX: (949) 305-1420

VERSA CANOPY
 VC140, VC180 & VC200
 FRAMING SCHEDULES

DRAWN GM
 CHECKED KS
 DATE 11/28/2018
 4STEL JOB NO. MC03-01
 SHEET S-9
 9 OF 13 SHEETS

VC140, VC180 & VC200 PURLIN SCHEDULE

I.D. #	MAX GROUND SNOW LOAD	MAX PURLIN SPACING (PS)	MAX COLUMN SPACING (S)	MAX CANTILEVER SPAN (CS)	PURLIN	
					SECTION	DETAIL
VC140	20 psf	42"	27'-0"	9'-0"	CS12 x 4 x 0.102 (12 GA)	1 S-5
VC180	20 psf	58"	27'-0"	8'-6"	CS14 x 4 x 0.102 (12 GA)	1 S-5
VC200	20 psf	66"	19'-0"	7'-9"	CS14 x 4 x 0.102 (12 GA)	1 S-5

- NOTES:**
- REFER TO SHEET 'S-2' FOR CONSTRUCTION OPTIONS.
 - REFER TO DETAIL '4/S-12' FOR ALLOWABLE PURLIN PENETRATIONS.
 - MULTIPLE STRUCTURE ID'S MAY BE SELECTED WITHIN THE SAME SITE.
 - WHEN UTILIZING A STRUCTURE ID READ FROM WITHIN THAT ID'S ROW ONLY.
 - PURLIN SPACING MAY BE INCREASED BEYOND THE MAXIMUMS GIVEN IN THE CHART ABOVE AS LONG AS THE TRIBUTARY WIDTH TO THE PURLIN DOES NOT EXCEED 'PS'.

1 VC140, VC180 & VC200
 - TYPICAL PURLIN SCHEDULE

VC140, VC180 & VC200 BEAM/COLUMN SCHEDULE

I.D. #	MAX GROUND SNOW LOAD	MAX WIDTH (W)	BEAM SHORT SPAN MIN (SS)	BEAM LONG SPAN MAX (LS)	MAX COLUMN SPACING (S)	ROOF SLOPE	BEAM		BEAM TO COLUMN DETAIL	COLUMN		MAX COLUMN HEIGHT
							SECTION	DETAIL		SECTION	DETAIL	
VC180	20 psf	18'-0"	8'-0"	10'-0"	27'-0"	3:12 MAX	CS14 x 4 x 0.102 (12 GA)	1 S-5	13 S-11	HSS 12 x 6 x 1/4	2 S-5	16'-6"
VC200	20 psf	20'-0"	6'-9"	13'-3"	19'-0"	3:12 MAX	CS14 x 4 x 0.124 (10 GA)	1 S-5	13 S-11	HSS 12 x 6 x 1/4	2 S-5	16'-9"

- NOTES:**
- MULTIPLE STRUCTURE ID'S MAY BE SELECTED WITHIN THE SAME SITE.
 - WHEN UTILIZING A STRUCTURE ID READ FROM WITHIN THAT ID ROW ONLY.
 - THE SHORT SPAN AND LONG SPANS MAY BE ADJUSTED WITH THE FOLLOWING REQUIREMENT:
 THE OVERALL CANOPY WIDTH IS NOT EXCEEDED, NEITHER SPAN IS LESS THAN THE MIN SHORT SPAN & NEITHER SPAN EXCEEDS THE MAX LONG SPAN.

2 VC140, VC180 & VC200
 - TYPICAL BEAM/COLUMN SCHEDULE

NON-CONSTRAINED PIER FOUNDATION SCHEDULE

I.D. #	MAX GROUND SNOW LOAD	FOUNDATION LONGITUDINAL REINFORCEMENT	FOUNDATION DIAMETER (D)	MIN COLUMN EMBEDMENT (CE)	MAX TIE SPACING AT TOP (TS)	FOUNDATION DETAIL	PIER FOUNDATION MINIMUM DEPTH (SEE SOIL NOTES ON S-3)				
							SOIL CLASS V	SOIL CLASS W	SOIL CLASS X	SOIL CLASS Y	SOIL CLASS Z
VC14	0 psf	4 - #8	2'-0"	3'-6"	6"	(3)	14'-0"	11'-0"	9'-6"	8'-9"	7'-6"
VC18	0 psf	4 - #8	2'-0"	3'-6"	6"	(3)	14'-9"	11'-6"	10'-0"	9'-0"	8'-0"
VC20	0 psf	4 - #8	2'-0"	3'-6"	6"	(3)	15'-0"	11'-9"	10'-3"	9'-3"	8'-0"
VC140	20 psf	4 - #8	2'-0"	3'-6"	6"	(3)	15'-0"	11'-6"	9'-9"	8'-9"	7'-6"
VC180	20 psf	4 - #8	2'-0"	3'-6"	6"	(3)	15'-3"	11'-9"	10'-0"	9'-0"	7'-9"
VC200	20 psf	4 - #8	2'-0"	3'-6"	6"	(3)	15'-3"	12'-0"	10'-3"	9'-3"	8'-3"

- NOTES:**
- MULTIPLE STRUCTURE ID'S MAY BE SELECTED WITHIN THE SAME SITE.
 - WHEN UTILIZING A STRUCTURE ID READ FROM WITHIN THAT ID ROW ONLY.
 - SEE SOILS NOTES ON SHEET S-3 FOR INFORMATION ON SOILS CLASS SELECTION.
 - FOR SITUATIONS WHERE WATER MITIGATION IS NECESSARY, OR FOR OTHER CONDITIONS REQUIRING MITIGATION, REFER TO DETAIL 2/- FOR SLEEVED FOUNDATION OPTION.


1 PIER FOUNDATION SCHEDULE

SPREAD FOOTING SCHEDULE


I.D. #	MAX GROUND SNOW LOAD	FOUNDATION DETAIL	SPREAD FOOTING MINIMUM DIMENSIONS FOR SOIL CLASS V (SOILS NOTES S-3)
VC14	0 psf	(4)	9'-6" (SQ.) x 2'-6" DEEP
VC18	0 psf	(4)	10'-3" (SQ.) x 2'-6" DEEP
VC20	0 psf	(4)	10'-0" (SQ.) x 2'-6" DEEP
VC140	20 psf	(4)	9'-3" (SQ.) x 2'-6" DEEP
VC180	20 psf	(4)	10'-0" (SQ.) x 2'-6" DEEP
VC200	20 psf	(4)	9'-9" (SQ.) x 2'-6" DEEP

- NOTES:**
- MULTIPLE STRUCTURE ID'S MAY BE SELECTED WITHIN THE SAME SITE.
 - WHEN UTILIZING A STRUCTURE ID READ FROM WITHIN THAT ID ROW ONLY.
 - SEE SOILS NOTES ON SHEET S-3 FOR INFORMATION ON SOILS CLASS SELECTION.

2 SPREAD FOOTING SCHEDULE

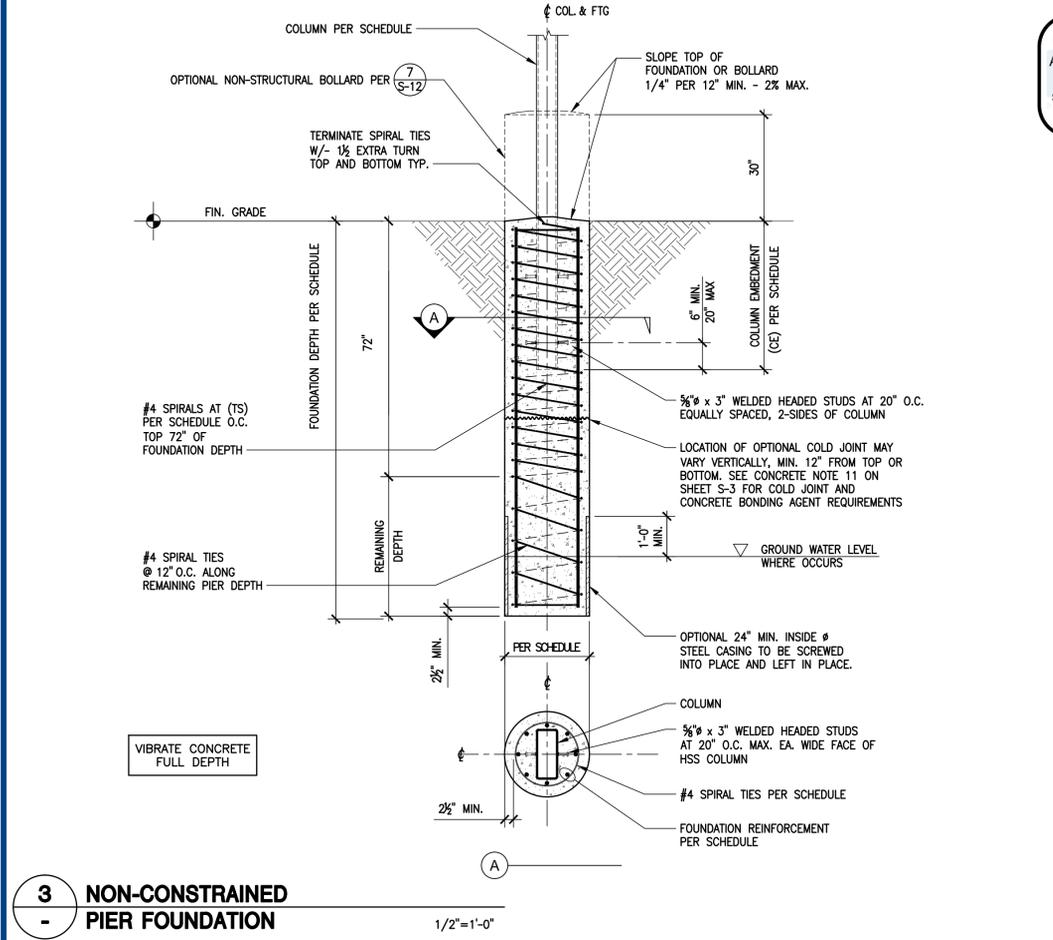

3 NON-CONSTRAINED PIER FOUNDATION

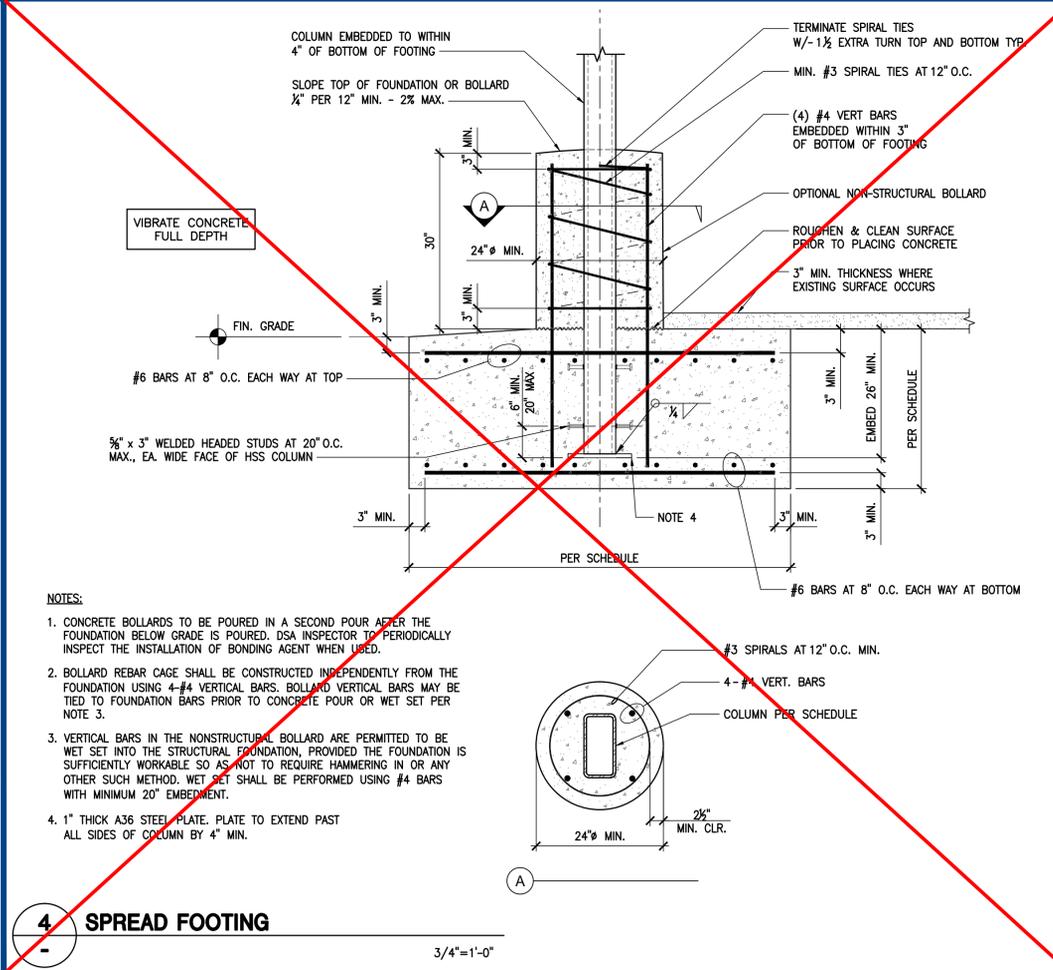

- NOTES:**
- CONCRETE BOLLARDS TO BE POURED IN A SECOND POUR AFTER THE FOUNDATION BELOW GRADE IS POURED. DSA INSPECTOR TO PERIODICALLY INSPECT THE INSTALLATION OF BONDING AGENT WHEN USED.
 - BOLLARD REBAR CAGE SHALL BE CONSTRUCTED INDEPENDENTLY FROM THE FOUNDATION USING 4-#4 VERTICAL BARS. BOLLARD VERTICAL BARS MAY BE TIED TO FOUNDATION BARS PRIOR TO CONCRETE POUR OR WET SET PER NOTE 3.
 - VERTICAL BARS IN THE NONSTRUCTURAL BOLLARD ARE PERMITTED TO BE WET SET INTO THE STRUCTURAL FOUNDATION, PROVIDED THE FOUNDATION IS SUFFICIENTLY WORKABLE SO AS NOT TO REQUIRE HAMMERING IN OR ANY OTHER SUCH METHOD. WET SET SHALL BE PERFORMED USING #4 BARS WITH MINIMUM 20" EMBEDMENT.
 - 1" THICK A36 STEEL PLATE. PLATE TO EXTEND PAST ALL SIDES OF COLUMN BY 4" MIN.

4 SPREAD FOOTING

ENGINEER'S APPROVAL

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT

APP: 01-118984 INC:
REVIEWED FOR
SS FLS ACS
DATE: 08/13/2020

DATE SIGNED
11/28/2018



SITE SPECIFIC DSA APPROVAL

FILE NUMBER: PC-119

IDENTIFICATION STAMP
DIVISION OF THE STATE ARCHITECT

APP. NO. 04 117111 INCR

AC DF DS DS DS DS DP

DATE: 12/05/2018

PRE-CHECK (PC) DOCUMENT
CODE: 2016 CBC
A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED

MBARC CONSTRUCTION INC.

674 RANCHEROS DR
SAN MARCOS, CA 92069
PHONE: (760) 744-4131
FAX: (760) 744-4449
GREGJ@MBARCONLINE.COM (775) 787-8845

IC # 869960
B AND C51

4STEL ENGINEERING
STRUCTURAL ENGINEERING


26030 A CHERO, SUITE 200
MISSION VIEJO, CA 92691
PHONE: (949) 305-1150
FAX: (949) 305-1420

VERSA CANOPY FOUNDATION SCHEDULES

DRAWN GM
CHECKED KS
DATE 11/28/2018
4STEL JOB NO. MC03-01
SHEET S-10
10 OF 13 SHEETS

NOTES:


1. CONCRETE BOLLARDS TO BE POURED IN A SECOND POUR AFTER THE FOUNDATION BELOW GRADE IS POURED. DSA INSPECTOR TO PERIODICALLY INSPECT THE INSTALLATION OF BONDING AGENT WHEN USED.
2. BOLLARD REBAR CAGE SHALL BE CONSTRUCTED INDEPENDENTLY FROM THE FOUNDATION USING 4-#4 VERTICAL BARS UNLESS WET SET IS PERFORMED PER NOTE 3 OR CONTINUOUS FOUNDATION BARS ARE USED PER NOTE 4.
3. VERTICAL BARS IN THE NONSTRUCTURAL BOLLARD ARE PERMITTED TO BE WET SET INTO THE STRUCTURAL FOUNDATION, PROVIDED THE FOUNDATION IS SUFFICIENTLY WORKABLE SO AS NOT TO REQUIRE HAMMERING IN OR ANY OTHER SUCH METHOD. WET SET SHALL BE PERFORMED USING #4 BARS WITH MINIMUM 20" EMBEDMENT.
4. BOLLARD REINFORCING IS PERMITTED TO USE MIN. (4) FOUNDATION VERT. BARS CONTINUOUS TO 3" BELOW TOP OF BOLLARD IN LIEU OF 4-#4 BARS.

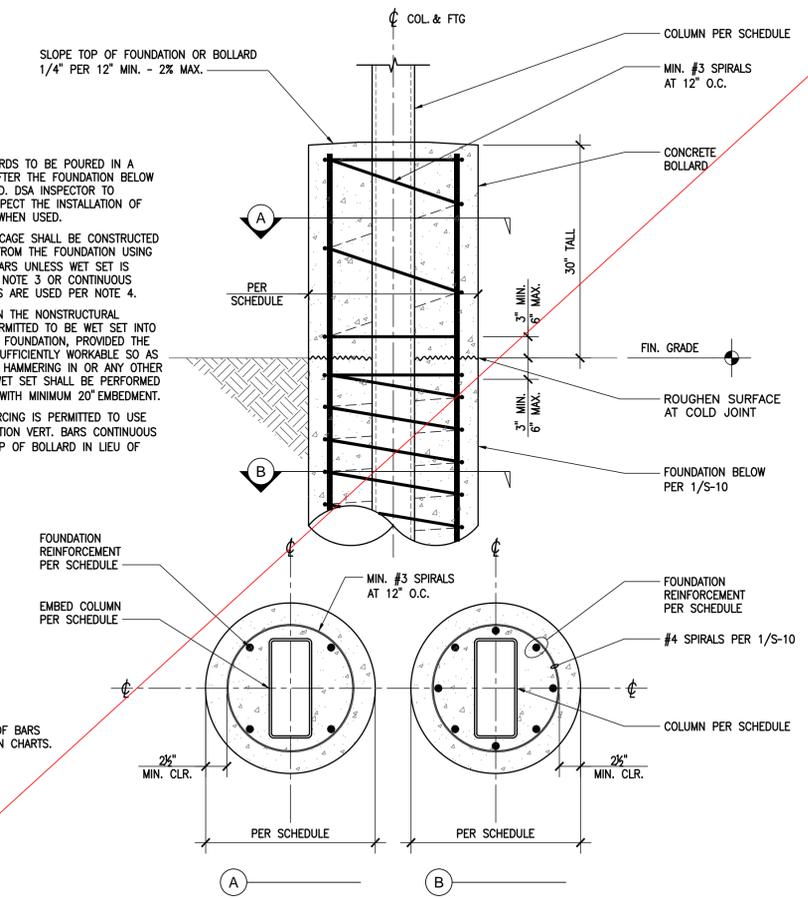

NOTE:


NUMBER AND SIZES OF BARS VARY SEE FOUNDATION CHARTS.

7 OPTIONAL CONCRETE BOLLARD
1"=1'-0"

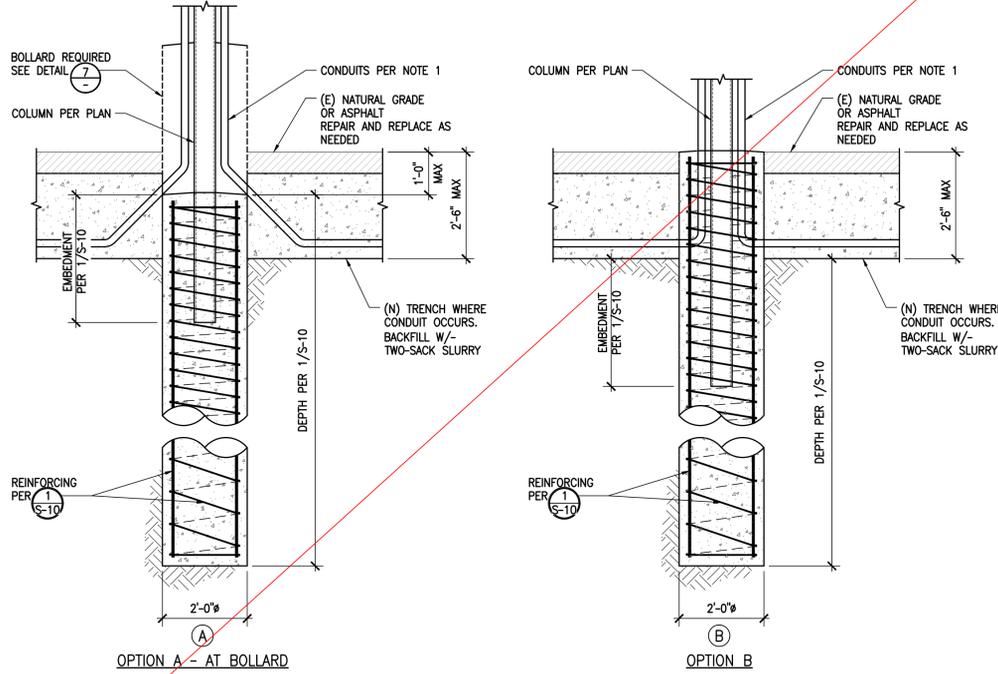


- NOTE:**
1. CONDUIT IN FOUNDATION SHALL NOT EXCEED (1) 2" MAX Ø CONDUIT OR (2) 1 1/2" MAX Ø CONDUIT. WHEN (2) CONDUIT ARE USED IN THE SAME FOUNDATION, THE CONDUIT MAY ENTER THE FOUNDATION FROM EITHER SIDE.
 2. CONDUIT TRENCH SHALL BE FILLED WITH MIN 2-SACK SLURRY.

8 CONDUIT AT DRILLED PIER
1"=1'-0"

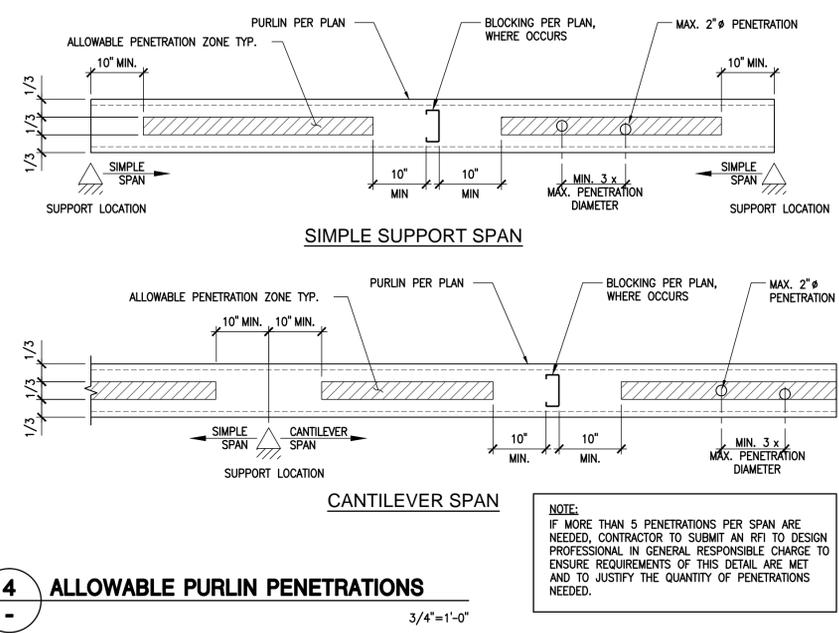


4 ALLOWABLE PURLIN PENETRATIONS
3/4"=1'-0"


NOTE:
IF MORE THAN 5 PENETRATIONS PER SPAN ARE NEEDED, CONTRACTOR TO SUBMIT AN RFI TO DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE TO ENSURE REQUIREMENTS OF THIS DETAIL ARE MET AND TO JUSTIFY THE QUANTITY OF PENETRATIONS NEEDED.

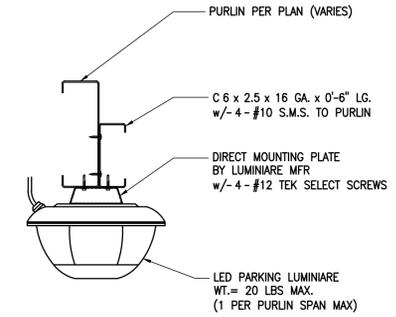


5 TYPICAL PARKING LUMINAIRE AT PURLIN
1 1/2"=1'-0"

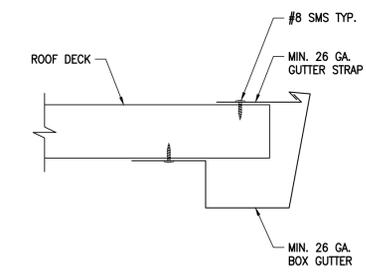


6 GUTTER DETAIL
3"=1'-0"

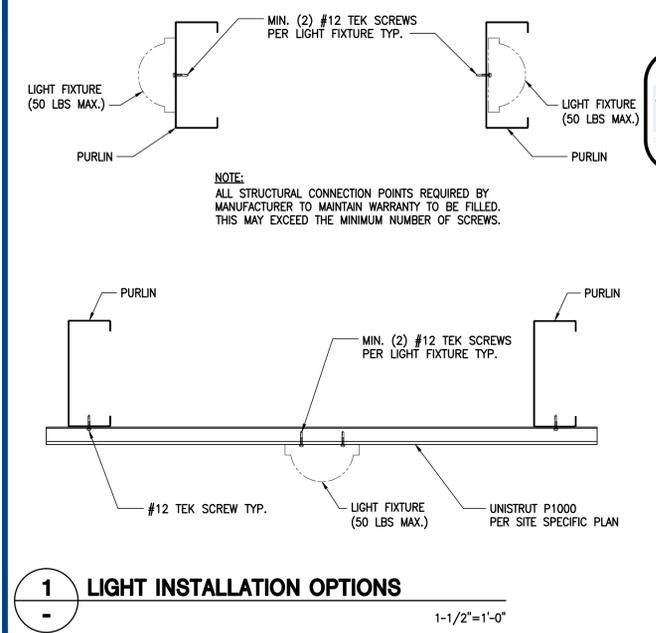

1 LIGHT INSTALLATION OPTIONS
1-1/2"=1'-0"

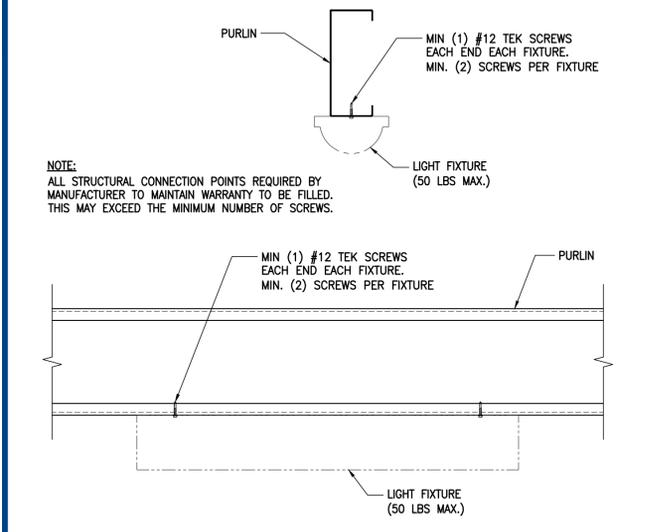

2 ALTERNATE LIGHT INSTALLATION OPTIONS
1-1/2"=1'-0"

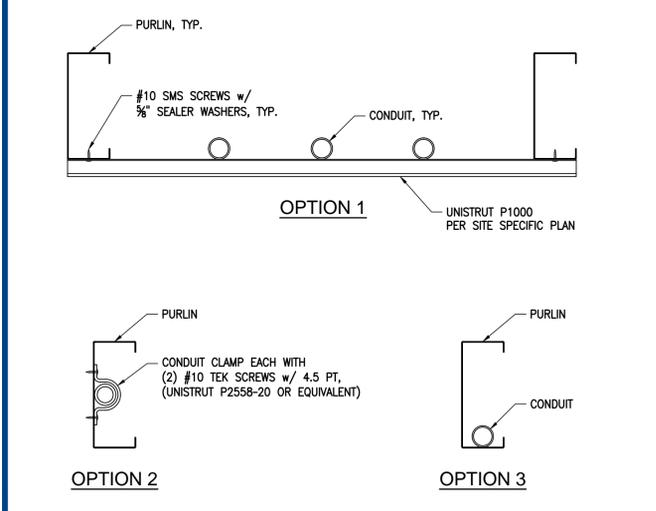

3 CONDUIT SUPPORT/ LOCATION OPTIONS
1-1/2"=1'-0"

ENGINEER'S APPROVAL

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 01-118984 INC:
REVIEWED FOR
SS FLS ACS
DATE: 08/13/2020

DATE SIGNED
11/28/2018



SITE SPECIFIC DSA APPROVAL

~~FILE NUMBER: PC-119
IDENTIFICATION STAMP
DIVISION OF THE STATE ARCHITECT
APP. NO: 04-117111-1NCR
AC DF DS DS DS DS DP
DATE: 12/05/2018
PRE-CHECK (PC) DOCUMENT
CODE: 2016 CBC
A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED~~


MBARC CONSTRUCTION INC.
674 RANCHEROS DR
SAN MARCOS, CA 92069
PHONE: (760) 744-4131
FAX: (760) 744-4449
GREGJ@MBARCONLINE.COM (775) 787-8845
IIC # 869980
B AND C 51
GREG JONES

4STEL ENGINEERING
26030 ACHERO, SUITE 200
MISSION VIEJO, CA 92691
PHONE: (949) 305-1150
FAX: (949) 305-1420


VERSA CANOPY STANDARD DETAILS 2

**DRAWN GM
CHECKED KS
DATE 11/28/2018
4STEL JOB NO. MC03-01
SHEET**


S-12
12 OF 13 SHEETS

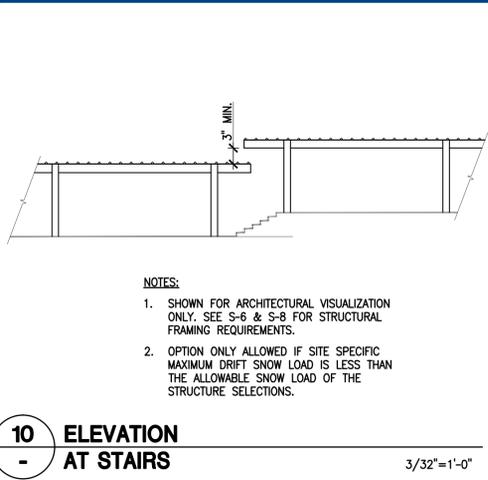


10 ELEVATION AT STAIRS
 3/32"=1'-0"

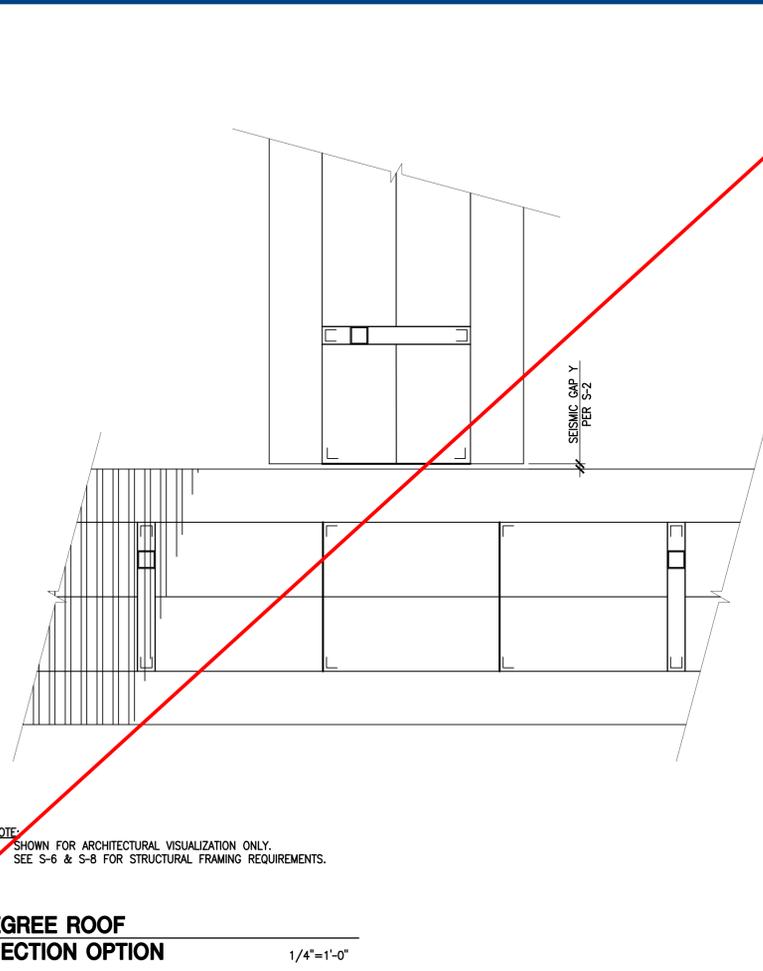


9 90 DEGREE ROOF CONNECTION OPTION
 1/4"=1'-0"

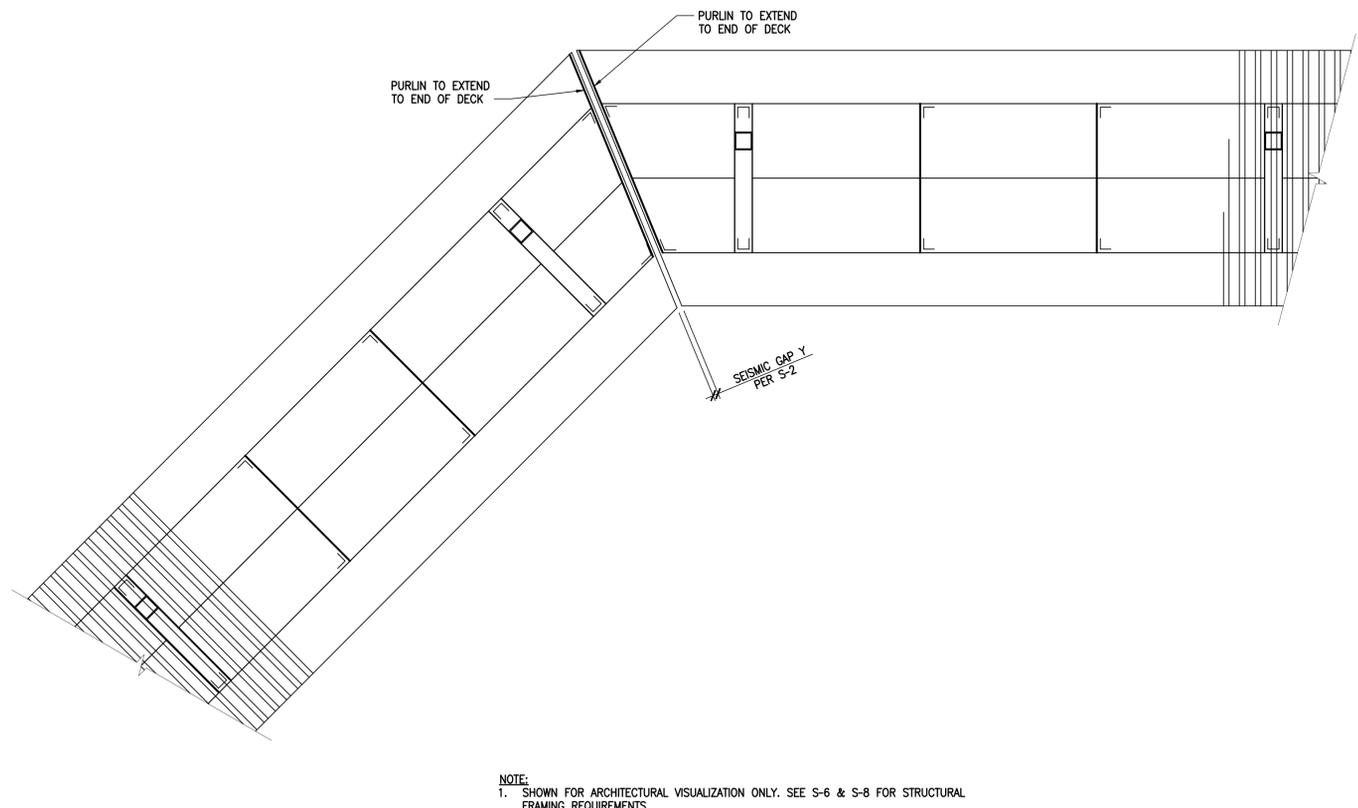


11 45 DEGREE ANGLED ROOF CONNECTION OPTION
 1/4"=1'-0"

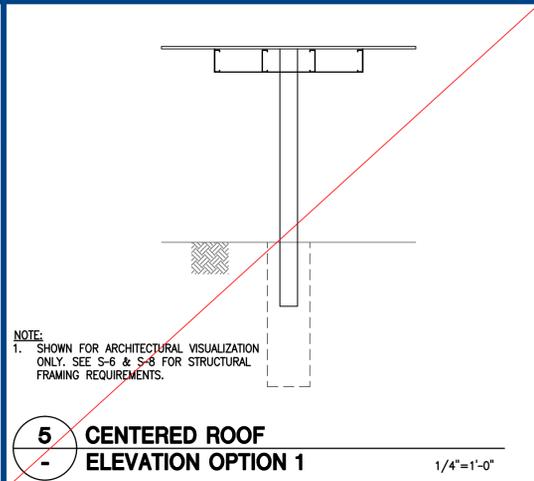


5 CENTERED ROOF ELEVATION OPTION 1
 1/4"=1'-0"

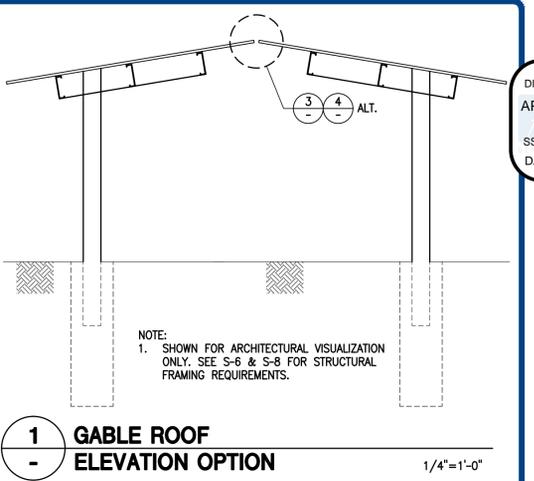


1 GABLE ROOF ELEVATION OPTION
 1/4"=1'-0"

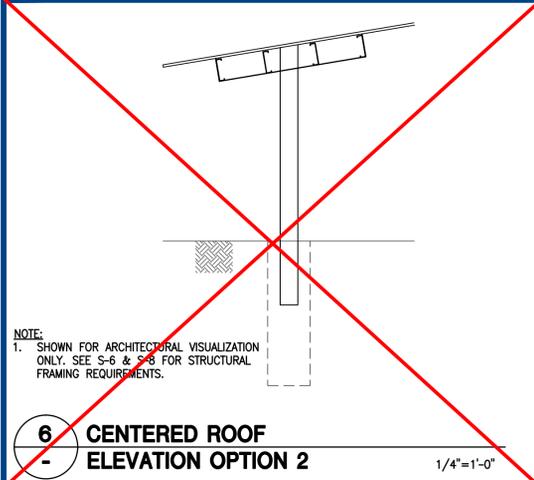


6 CENTERED ROOF ELEVATION OPTION 2
 1/4"=1'-0"

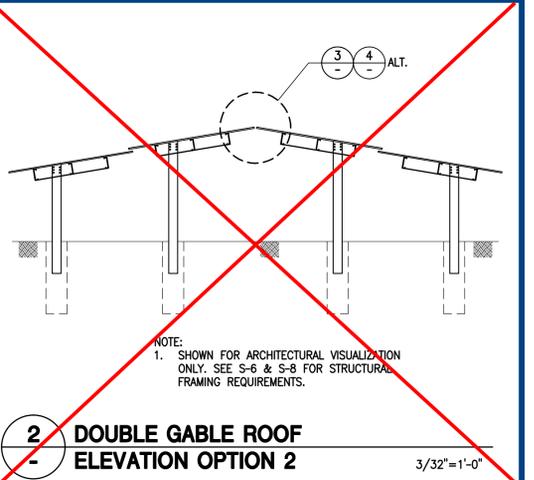


2 DOUBLE GABLE ROOF ELEVATION OPTION 2
 3/32"=1'-0"

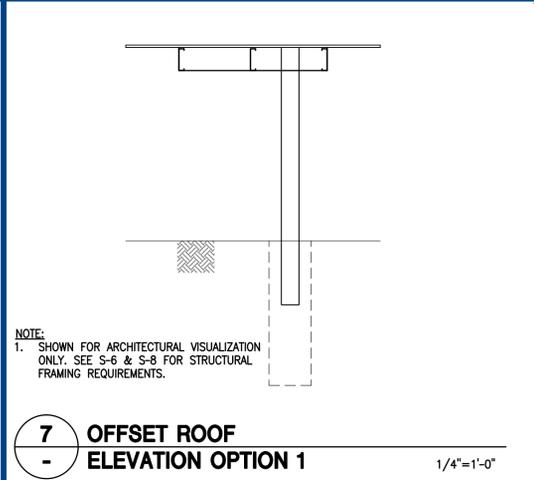


7 OFFSET ROOF ELEVATION OPTION 1
 1/4"=1'-0"

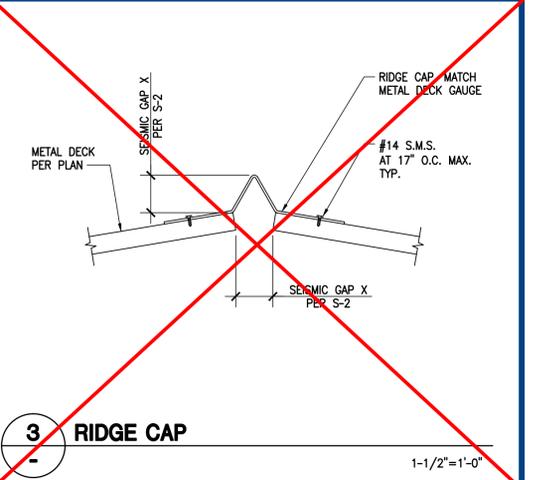

3 RIDGE CAP
 1-1/2"=1'-0"

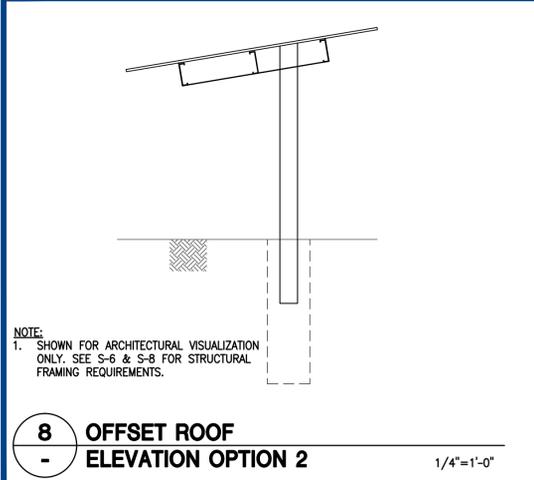

8 OFFSET ROOF ELEVATION OPTION 2
 1/4"=1'-0"

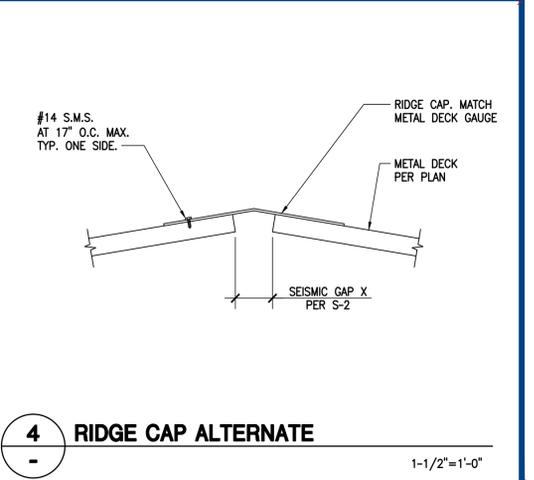

4 RIDGE CAP ALTERNATE
 1-1/2"=1'-0"

ENGINEER'S APPROVAL
 IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP: 01-118984 INC.
 REVIEWED FOR
 SS FLS ACS
 DATE: 08/13/2020

DATE SIGNED
 11/28/2018



SITE SPECIFIC DSA APPROVAL

FILE NUMBER: PC-119
 IDENTIFICATION STAMP
 DIVISION OF THE STATE ARCHITECT
 APP. NO: 04 11711 INCR
 AC DF DS DS SS DP
 DATE: 12/05/2018
PRE-CHECK (PC) DOCUMENT
 CODE: 2016 CBC
 A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED



MBARC CONSTRUCTION INC.
 IIC # 869960
 B AND C51
 GREGJ@MBARCONLINE.COM (775) 787-8845
 PHONE: (760) 744-4131
 FAX: (760) 744-4449
 674 RANCHEROS DR
 SAN MARCOS, CA 92069
 GREG JONES

4STEL ENGINEERING
 STRUCTURAL ENGINEERING
 26030 ACHERO, SUITE 200
 MISSION VIEJO, CA 92691
 PHONE: (949) 305-1150
 FAX: (949) 305-1420


VERSA CANOPY STANDARD DETAILS 3

DRAWN GM
CHECKED KS
 DATE 11/28/2018
 4STEL JOB NO. MC03-01
 SHEET

S-13
 13 OF 13 SHEETS

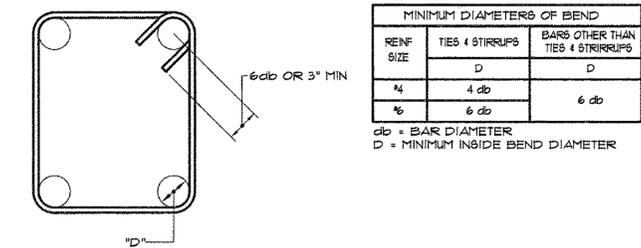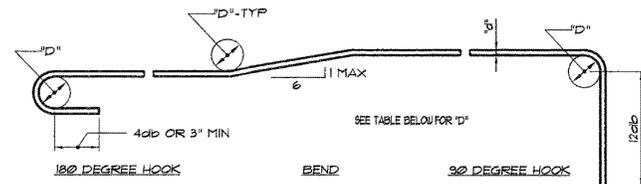

1
S1.1
REINFORCING BENDS
DETAIL
NO SCALE

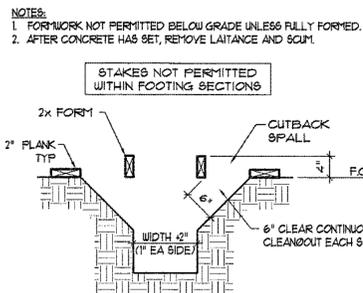


2
S1.1
FOUNDATION FORMING
DETAIL
NO SCALE

NOTES:
1. FORMWORK NOT PERMITTED BELOW GRADE UNLESS FULLY FORMED.
2. AFTER CONCRETE HAS SET, REMOVE LAITANCE AND SCUM.


FOUNDATIONS: MANDATORY MINIMUM FRAMEWORK (UNLESS FULLY FORMED)

FOUNDATION CONCRETE MAY BE PLACED DIRECTLY INTO NEAR EXCAVATIONS PROVIDED THE FOUNDATION TRENCH WALLS ARE STABLE AS DETERMINED BY THE ARCHITECT (STRUCTURAL ENGINEER) SUBJECT TO THE DIVISION OF THE STATE ARCHITECT. IN SUCH CASE THE MINIMUM FORMWORK SHOWN ON THE DRAWINGS IS MANDATORY TO INSURE CLEAN EXCAVATIONS IMMEDIATELY PRIOR TO AND DURING THE PLACING OF THE CONCRETE.

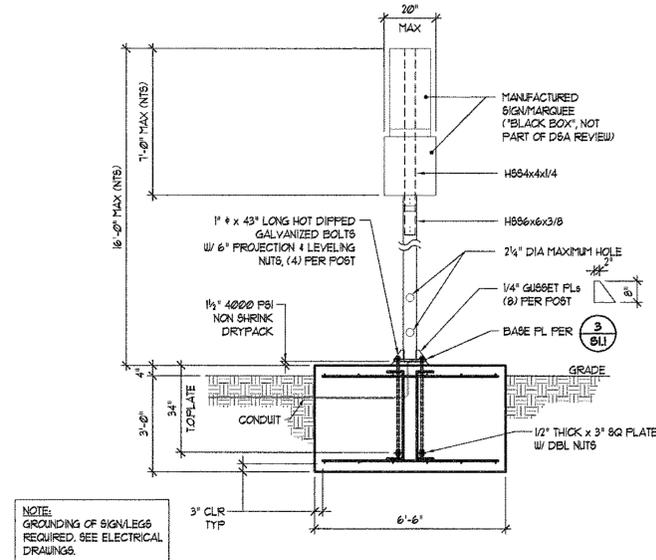


NOTE: GROUNDING OF SIGN LEGS REQUIRED. SEE ELECTRICAL DRAWINGS.


B
S1.1
FRAME & LAMP SIDE
ELEVATION
3/8" = 1'-0"

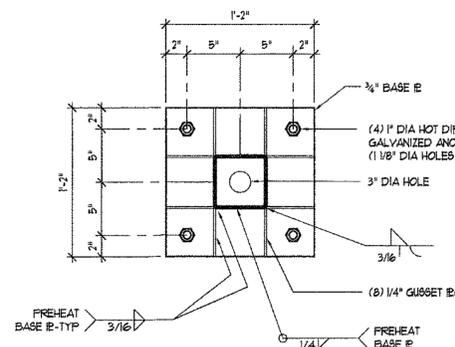

3
S1.1
BASE PLATE PLAN
DETAIL
1/4" = 1'-0"

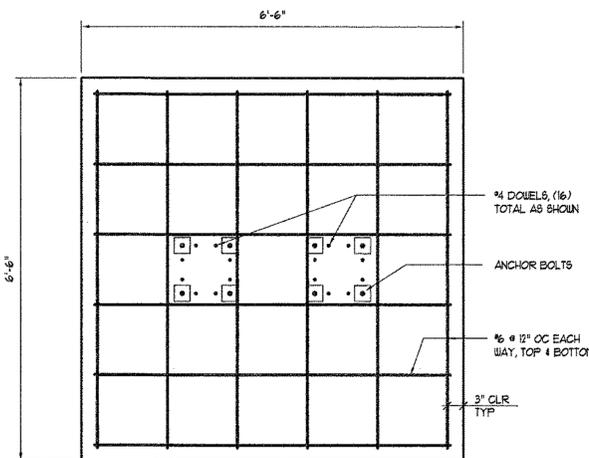


4
S1.1
FOOTING PLAN
3/4" = 1'-0"

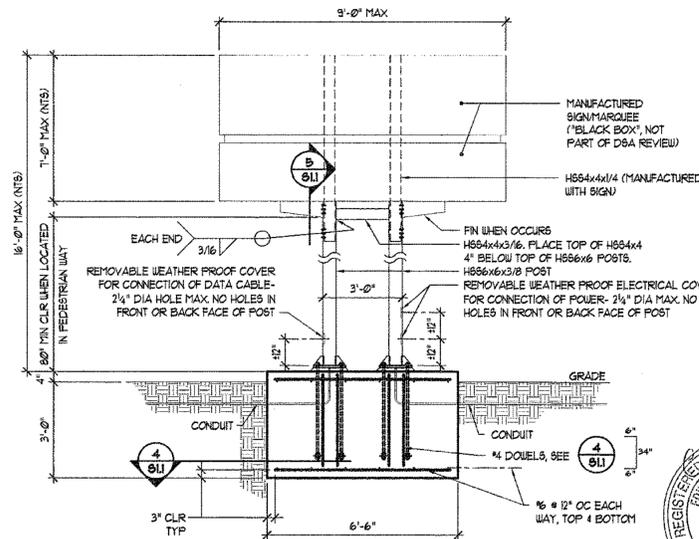

NOTE: CONDUIT CAN BE RUN BETWEEN ANCHOR BOLTS ON EITHER SIDE. MAXIMUM CONDUIT SIZE IS 1 1/2". MAXIMUM NUMBER OF CONDUITS IS 3.

A
S1.1
FRAME & LAMP FRONT
ELEVATION
3/8" = 1'-0"

A STEWART SIGN TEMPLATE MUST BE USED TO SET ANCHOR BOLTS INTO CONCRETE.
SIGN CABINETS ARE FACTORY MATCHED WITH LEGS. DO NOT MIX PIECES FROM DIFFERENT SITES. THERE IS A LEFT AND RIGHT LEG, SEE INSTALLATION INSTRUCTIONS / CONTACT STEWART SIGNS

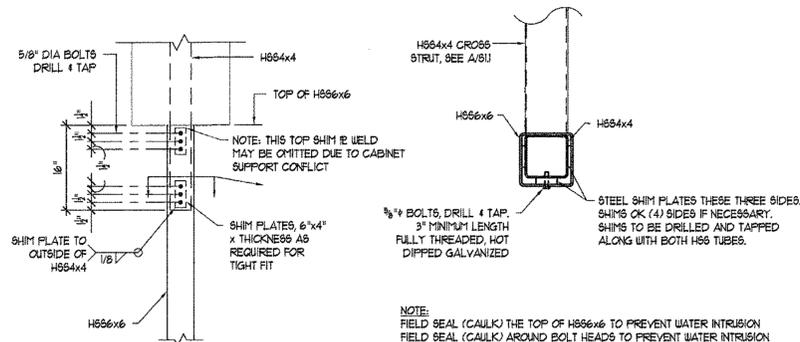

5
S1.1
H66 SLEEVE
DETAIL
3/4" = 1'-0"

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 01-118984 INC.
REVIEWED FOR
SS FLS ACS
DATE: 08/13/2020

PRE-CHECK (PC) DOCUMENT
Code: 2016 CBC
A separate project application for Construction is required.

THIS DOCUMENT IS FURNISHED FOR THE PERMITTING, BIDDING OR CONSTRUCTION OF MARQUEE SIGNS MANUFACTURED BY STEWART SIGNS AND SHALL NOT BE USED FOR ANY OTHER PURPOSE OR RELEASED TO ANY OTHER PARTY WITHOUT THE WRITTEN CONSENT OF STEWART SIGNS AND EJNSE INC. INFORMATION CONTAINED HEREIN IS AN INSTRUMENT OF PROFESSIONAL SERVICES AND SHALL REMAIN THE PROPERTY OF STEWART SIGNS AND EJNSE INC. © COPYRIGHT BY STEWART SIGNS AND EJNSE INC. ALL RIGHTS RESERVED.

REVISIONS	BY

STRUCTURAL ENGINEER
EJNSE INC.
9716 FAIR OAKS BLVD., SUITE A
FAIR OAKS, CA. 94628
Tel: (916) 966-6400
Contact: Ed Nicholson S.E.
Email: ed@ejnse.com

CLIENT
STEWART SIGNS
2201 CANTU CT. #215
SARASOTA, FL. 34232



PC-MARQUEE SIGNS
STEWART SIGNS
SIGN TYPE 1

TYPE 1 SIGN
STRUCTURAL ELEVATIONS
AND DETAILS

DRAWN
KDT
CHECKED
EJN
DATE
FEBRUARY 14, 2018
SCALE
AS NOTED
JOB NO.
2017-13
SHEET

S1.1


OF 4 SHEETS

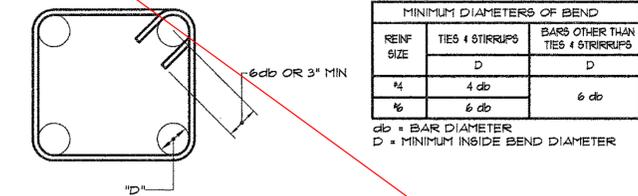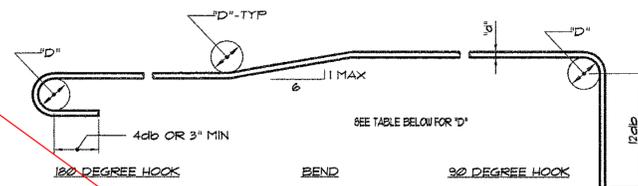


1 REINFORCING BENDS DETAIL
NO SCALE

REINFORCING BEND SIZE	MINIMUM DIAMETERS OF BEND	
	TIES & STIRRUPS	BAR OTHER THAN TIES & STIRRUPS
#4	4 db	D
#6	6 db	D


db = BAR DIAMETER
D = MINIMUM INSIDE BEND DIAMETER

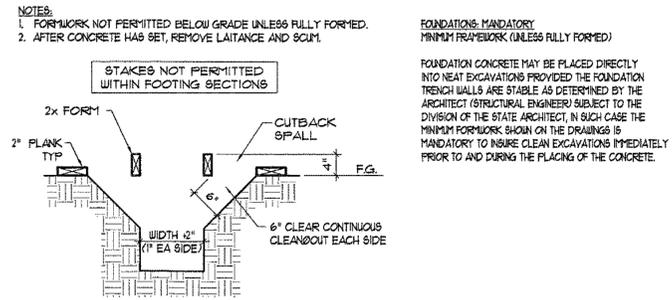


2 FOUNDATION FORMING DETAIL
NO SCALE

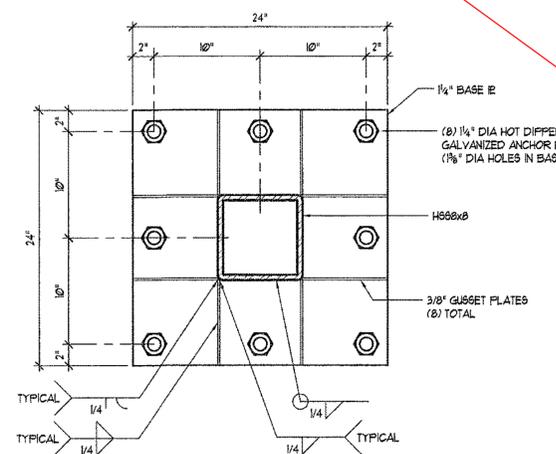


3 BASE PLATE PLAN DETAIL
1/2" = 1'-0"

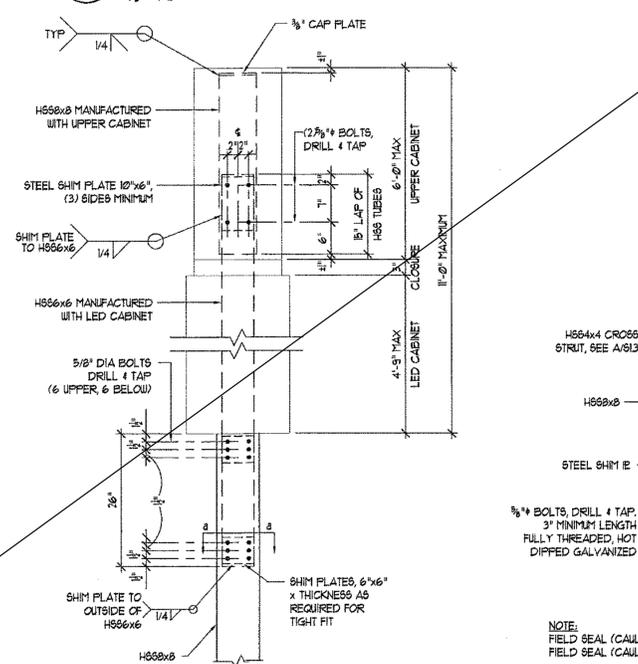


5 H66 SLEEVE DETAIL
3/4" = 1'-0"

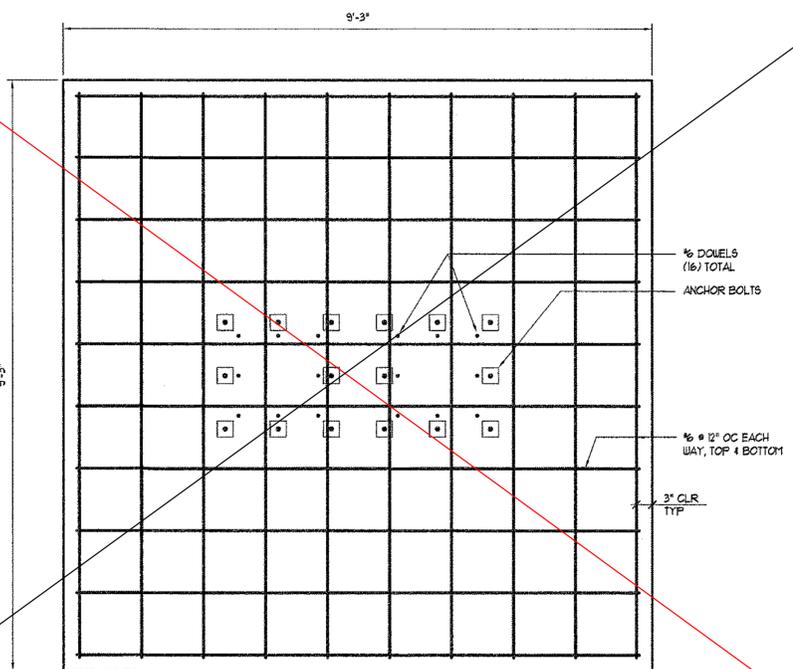


4 FOOTING PLAN
3/4" = 1'-0"

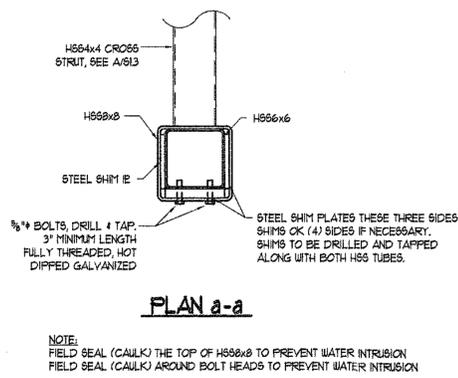

PLAN a-a

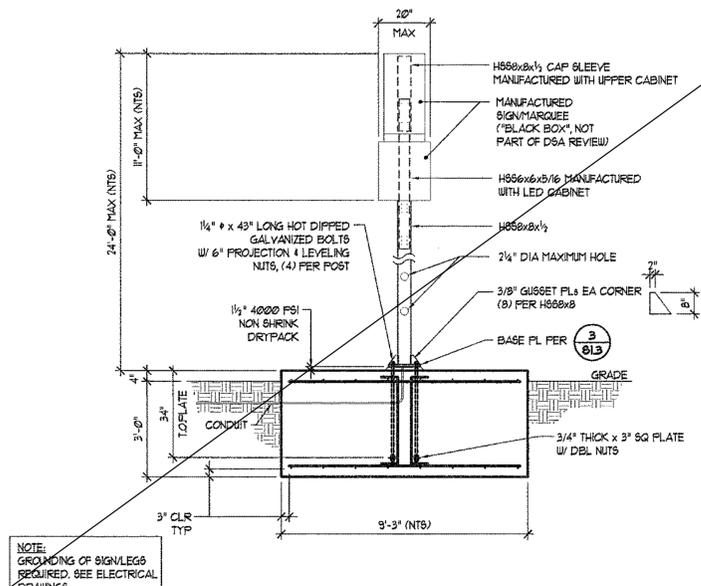

B FRAME & LAMP SIDE ELEVATION
3/8" = 1'-0"

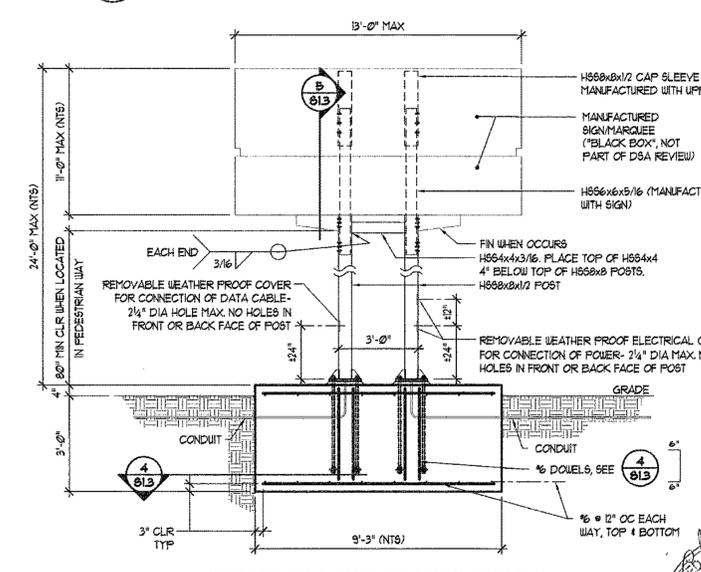

A FRAME & LAMP FRONT ELEVATION
3/8" = 1'-0"

A STEWART SIGN TEMPLATE MUST BE USED TO SET ANCHOR BOLTS INTO CONCRETE.
SIGN CABINETS ARE FACTORY MATCHED WITH LEGS. DO NOT MIX PIECES FROM DIFFERENT SITES. THERE IS A LEFT AND RIGHT LEG, SEE INSTALLATION INSTRUCTIONS / CONTACT STEWART SIGNS

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 01-118984 INC.
REVIEWED FOR
SS FLS ACS
DATE: 2/27/2018

PRE-CHECK (PC) DOCUMENT
Code: 2016 CBC
A separate project application for Construction is required.

THIS DOCUMENT IS FURNISHED FOR PERMITTING, BIDDING OR CONSTRUCTION OF MARQUEE SIGNS MANUFACTURED BY STEWART SIGNS AND SHALL NOT BE USED FOR ANY OTHER PURPOSE OR RELEASED TO ANY OTHER PARTY WITHOUT THE WRITTEN CONSENT OF STEWART SIGNS AND EJNSE INC. INFORMATION CONTAINED HEREIN IS AN INSTRUMENT OF PROFESSIONAL SERVICES AND SHALL REMAIN THE PROPERTY OF STEWART SIGNS AND EJNSE INC. © COPYRIGHT BY STEWART SIGNS AND EJNSE INC. ALL RIGHTS RESERVED.

REVISIONS	BY

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 01-118984 INC.
REVIEWED FOR
SS FLS ACS
DATE: 08/13/2020

STRUCTURAL ENGINEER
EJNSE INC.
9718 FAIR OAKS BLVD., SUITE A
FAIR OAKS, CA 94628
Tel: (916)866-6400
Contact: Ed Nicholson S.E.
Email: ed@ejnse.com

CLIENT
STEWART SIGNS
2201 CANTU CT. #215
SARASOTA, FL 34232

**PC-MARQUEE SIGNS
STEWART SIGNS
SIGN TYPE 3**

TYPE 3 SIGN
STRUCTURAL ELEVATIONS
AND DETAILS

DRAWN
KDT
CHECKED
EJN
DATE
FEBRUARY 14, 2018
SCALE
AS NOTED
JOB NO.
2017-13
SHEET

S1.3
OF 4 SHEETS



McKenzie & Associates, LLC
 Electrical Engineering & Design
 831.234.3946
 mckenzieassociates@comcast.net




ELECTRICAL SITE PLAN
SHADE STRUCTURES
PIEDMONT MIDDLE SCHOOL
 955 PIEDMONT RD., SAN JOSE, CA 95132
 BERRYESSA UNION SCHOOL DISTRICT

REVISIONS


NO.	ITEM	DATE

DRAWN BY: MM
 CHECKED BY:
 JOB NO: DATE: 7/12/2020

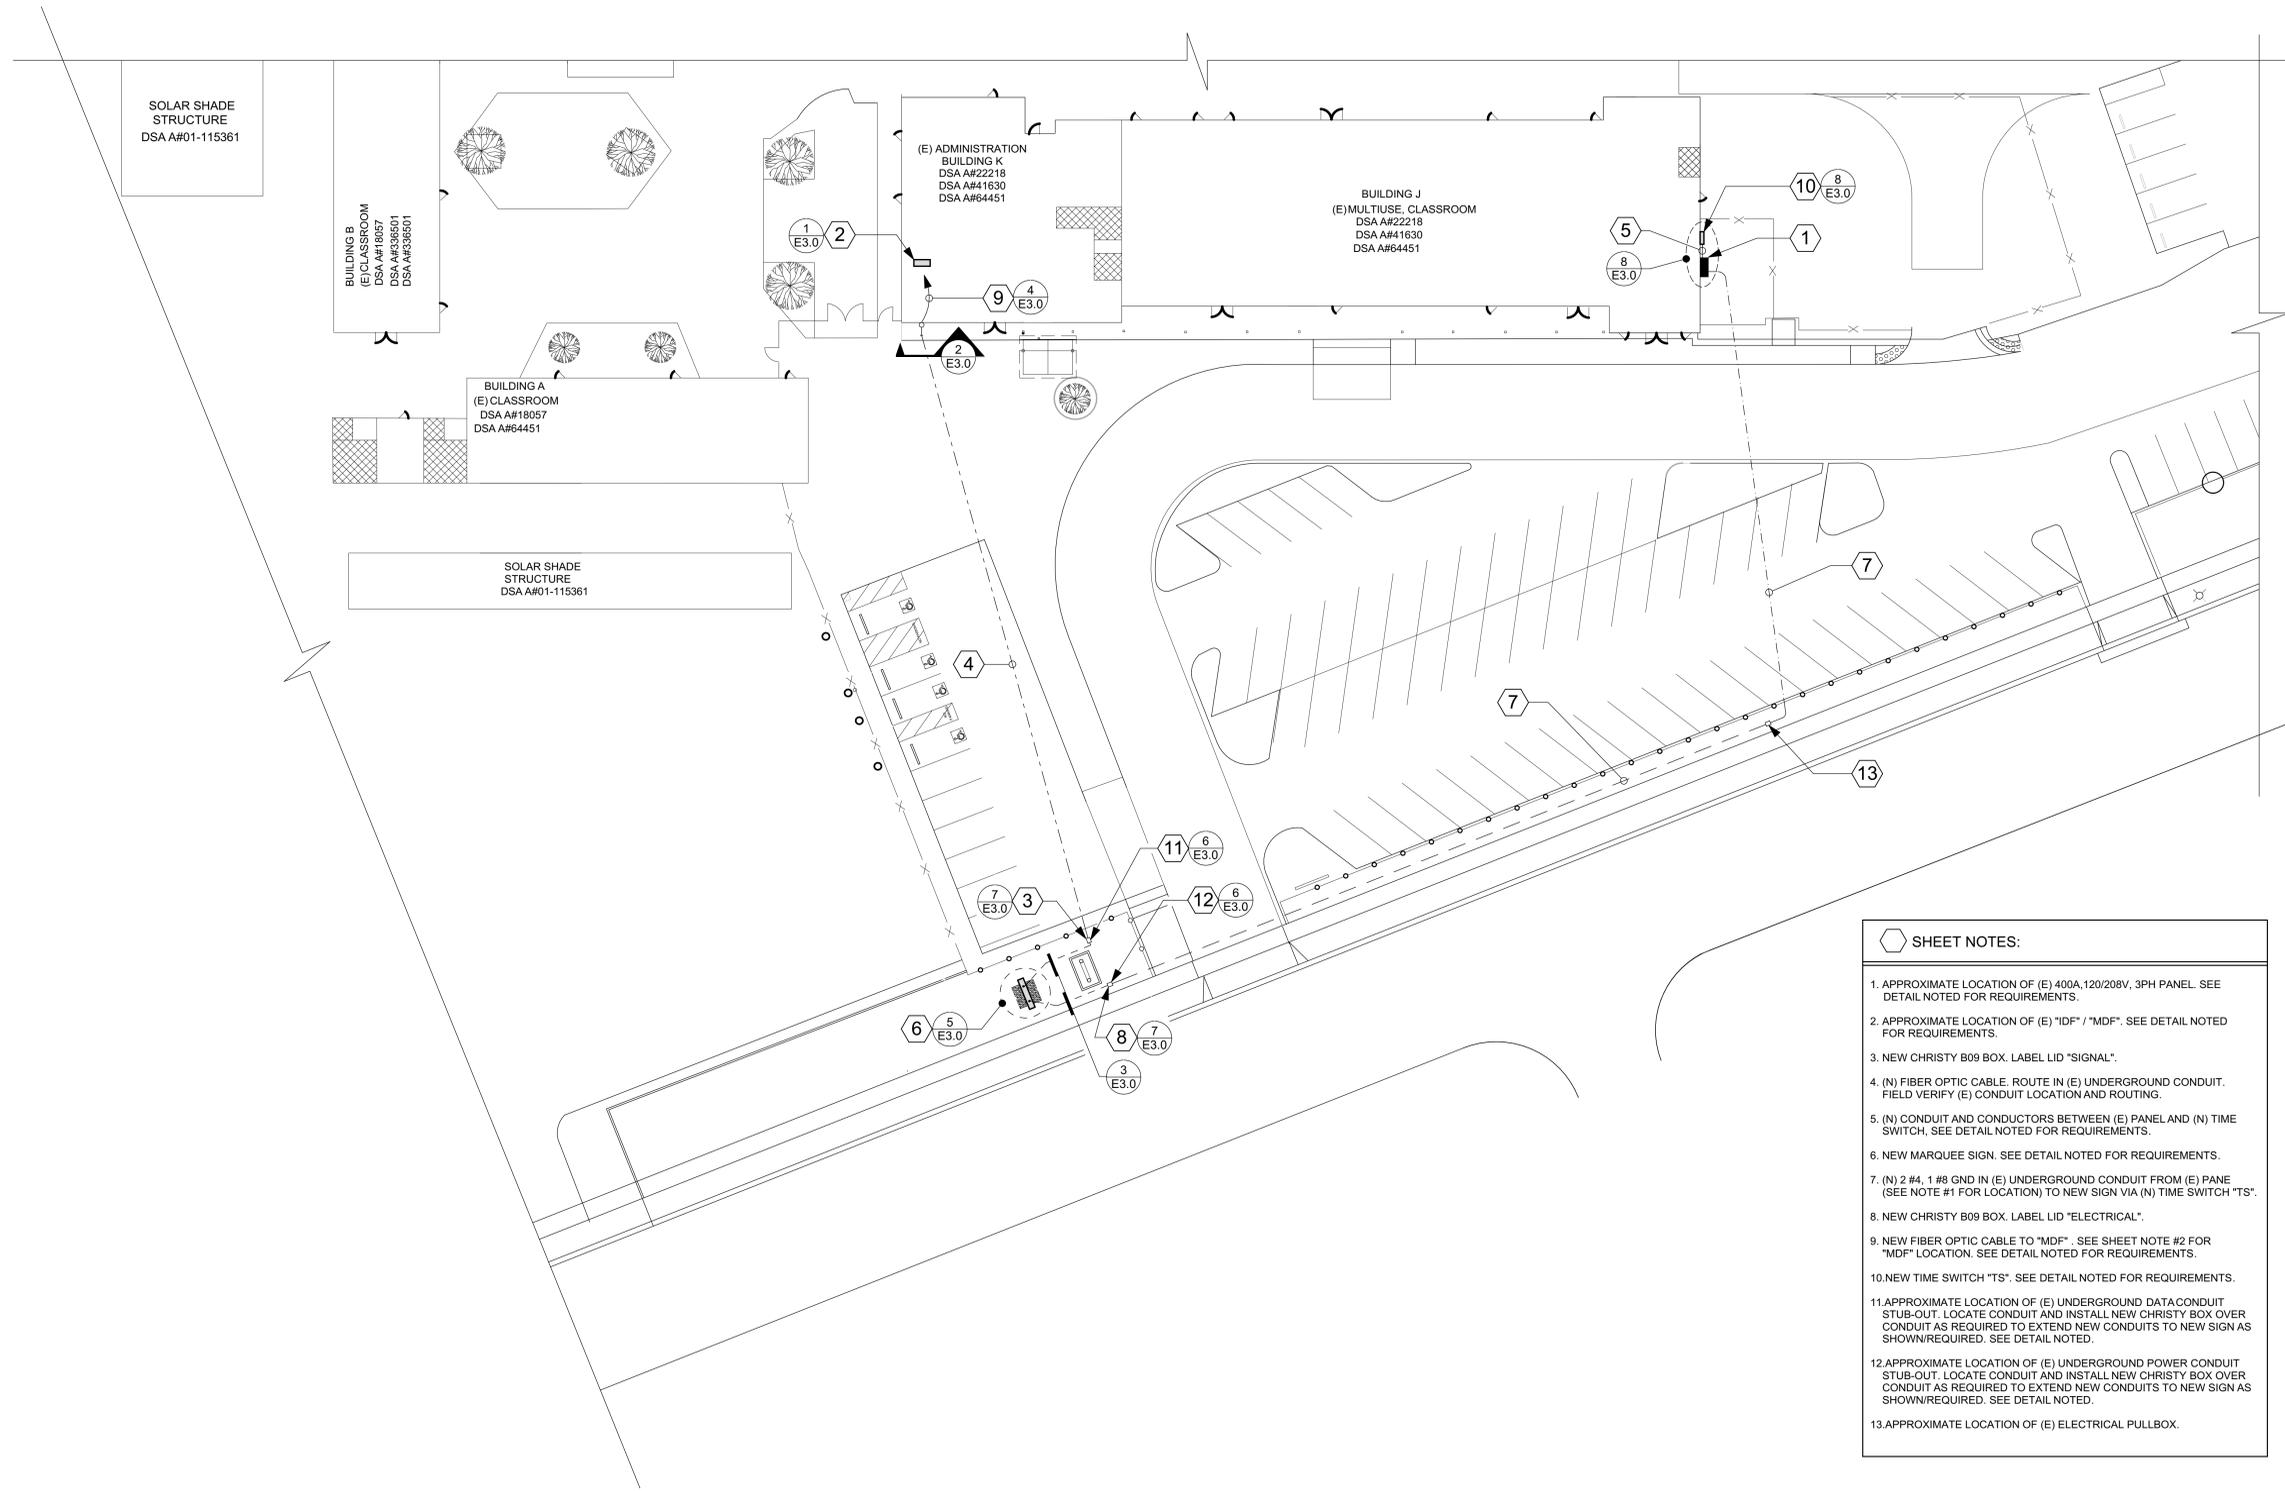


- SHEET NOTES:**
- APPROXIMATE LOCATION OF (E) 400A, 120/208V, 3PH PANEL. SEE DETAIL NOTED FOR REQUIREMENTS.
 - APPROXIMATE LOCATION OF (E) "IDF" / "MDF". SEE DETAIL NOTED FOR REQUIREMENTS.
 - NEW CHRISTY B09 BOX. LABEL LID "SIGNAL".
 - (N) FIBER OPTIC CABLE. ROUTE IN (E) UNDERGROUND CONDUIT. FIELD VERIFY (E) CONDUIT LOCATION AND ROUTING.
 - (N) CONDUIT AND CONDUCTORS BETWEEN (E) PANEL AND (N) TIME SWITCH. SEE DETAIL NOTED FOR REQUIREMENTS.
 - NEW MARQUEE SIGN. SEE DETAIL NOTED FOR REQUIREMENTS.
 - (N) 2 #4, 1 #8 GND IN (E) UNDERGROUND CONDUIT FROM (E) PANE (SEE NOTE #1 FOR LOCATION) TO NEW SIGN VIA (N) TIME SWITCH "TS".
 - NEW CHRISTY B09 BOX. LABEL LID "ELECTRICAL".
 - NEW FIBER OPTIC CABLE TO "MDF". SEE SHEET NOTE #2 FOR "MDF" LOCATION. SEE DETAIL NOTED FOR REQUIREMENTS.
 - NEW TIME SWITCH "TS". SEE DETAIL NOTED FOR REQUIREMENTS.
 - APPROXIMATE LOCATION OF (E) UNDERGROUND DATA CONDUIT STUB-OUT. LOCATE CONDUIT AND INSTALL NEW CHRISTY BOX OVER CONDUIT AS REQUIRED TO EXTEND NEW CONDUITS TO NEW SIGN AS SHOWN/REQUIRED. SEE DETAIL NOTED.
 - APPROXIMATE LOCATION OF (E) UNDERGROUND POWER CONDUIT STUB-OUT. LOCATE CONDUIT AND INSTALL NEW CHRISTY BOX OVER CONDUIT AS REQUIRED TO EXTEND NEW CONDUITS TO NEW SIGN AS SHOWN/REQUIRED. SEE DETAIL NOTED.
 - APPROXIMATE LOCATION OF (E) ELECTRICAL PULLBOX.


1 SITE PLAN
 SCALE: 1" = 20'

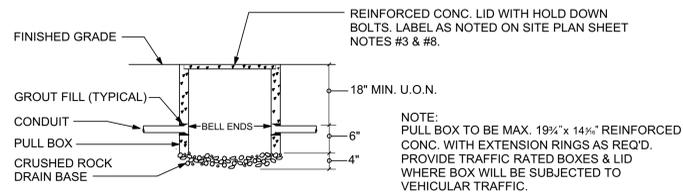


7 PULLBOX DETAIL
NOT TO SCALE

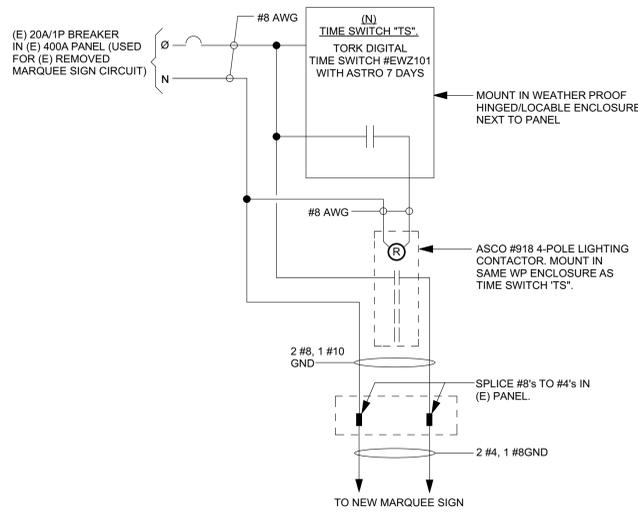


8 EXTERIOR LIGHTING CONTROL "ELC"
NOT TO SCALE

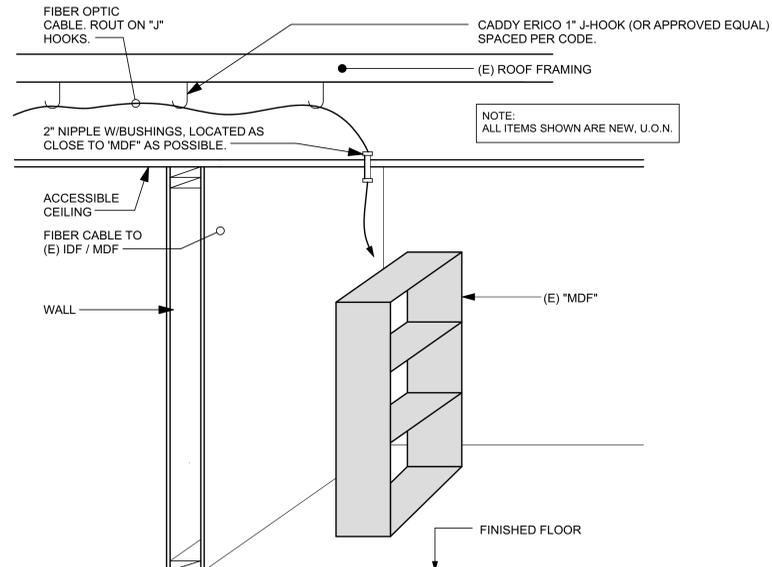


4 RACEWAY@ BUILDING INTERIOR
NOT TO SCALE

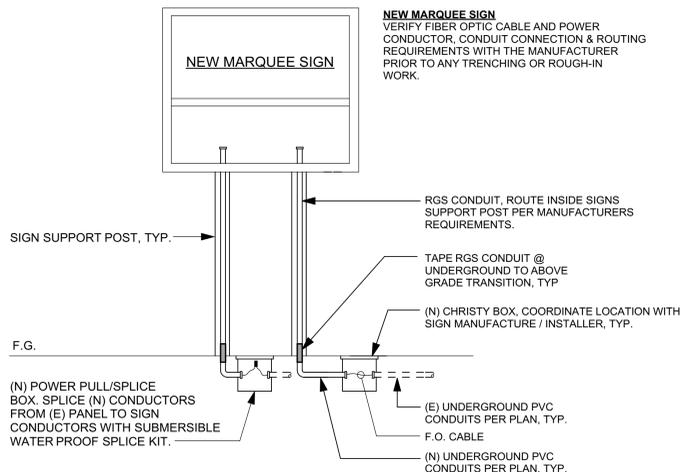

5 MARQUEE SIGN CONNECTION DETAIL
NOT TO SCALE

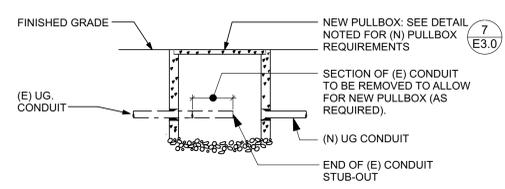


6 (E) UNDERGROUND CONDUIT DETAIL
NOT TO SCALE

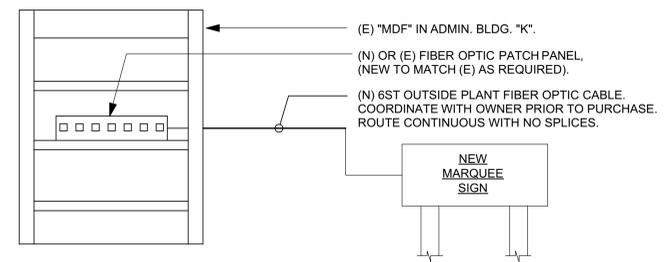


(E) IDF OR MDF
(SEE SITE PLAN FOR LOCATION)
PROVIDE NEW FIBER OPTIC PATCH PANEL AS REQUIRED FOR THE NEW MARQUEE SIGN. NEW PATCH PANEL TO MATCH SCHOOL STANDARD. CONNECT FIBER CABLE AS REQUIRED. COORDINATE REQUIREMENTS WITH SIGN MANUFACTURER / INSTALLER.

NEW MARQUEE SIGN
CONNECT (N) FIBER OPTIC CABLE AS REQUIRED PER MANUFACTURERS DIRECTION.

1 SIGNAL RISER DIAGRAM
NOT TO SCALE

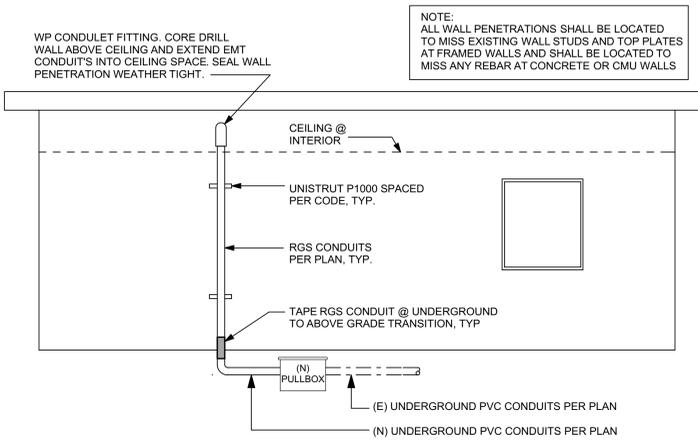

2 CONDUITS @ BUILDING EXTERIOR
NOT TO SCALE

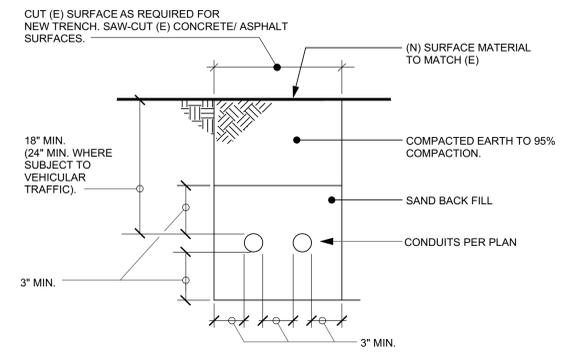

3 TRENCH DETAIL
NOT TO SCALE

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 01-118984 INC.
REVIEWED FOR:
SS FLS ACS
DATE: 08/13/2020

REGISTERED ARCHITECT
MARK C. FINNEY
NO. C-24873
EXPIRES 9-30-2025
STATE OF CALIFORNIA

McKenzie & Associates, LLC
Electrical Engineering & Design
831.234.3946
mcaassociates@comcast.net

REGISTERED ARCHITECT
MARK C. FINNEY
NO. C-24873
EXPIRES 9-30-2025
STATE OF CALIFORNIA

DETAILS

SHADE STRUCTURES
PIEDMONT MIDDLE SCHOOL
958 PIEDMONT RD. SAN JOSE, CA 95132
BERRYESSA UNION SCHOOL DISTRICT

REVISIONS		
NO.	ITEM	DATE

DRAWN BY: MM
CHECKED BY:
JOB NO: DATE: 7/12/2020

DSA 103-19: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS, 2019 CBC

Application Number: 01-118984

School Name: Piedmont HS

School District: Berryessa

DSA File Number: 043-7

Increment Number:

Date Submitted: 7/6/2020

2019 CBC

IMPORTANT: This form is only a summary list of structural tests and some of the special inspections required for the project. Generally, the structural tests and special inspections noted on this form are those that will be performed by the Geotechnical Engineer of Record, Laboratory of Record, or Special Inspector. The actual complete test and inspection program must be performed as detailed on the DSA approved documents. The appendix at the bottom of this form identifies work NOT subject to DSA requirements for special inspection or structural testing. The project inspector is responsible for providing inspection of all facets of construction, including but not limited to, special inspections not listed on this form such as structural wood framing, high-load wood diaphragms, cold-formed steel framing, anchorage of non-structural components, etc., per Title 24, Part 2, Chapter 17A (2019 CBC).

****NOTE:** Undefined section and table references found in this document are from the CBC, or California Building Code.

KEY TO COLUMNS

1. TYPE	2. PERFORMED BY
<p>Continuous – Indicates that a continuous special inspection is required</p> <p>Periodic – Indicates that a periodic special inspection is required</p> <p>Test – Indicates that a test is required</p>	<p>GE – Indicates that the special inspection shall be performed by a registered geotechnical engineer or his or her authorized representative.</p> <p>LOR – Indicates that the test or special inspection shall be performed by a testing laboratory accepted in the DSA Laboratory Evaluation and Acceptance (LEA) Program. See CAC Section 4-335.</p> <p>PI – Indicates that the special inspection may be performed by a project inspector when specifically approved by DSA.</p> <p>SI – Indicates that the special inspection shall be performed by an appropriately qualified/approved special inspector.</p>

DSA 103-19: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (SOILS), 2019 CBC

Application Number: 01-118984

School Name: Piedmont HS

School District: Berryessa

DSA File Number: 043-7

Increment Number:

Date Submitted: 7/6/2020

Geotechnical Reports: Project does NOT have and does NOT require a geotechnical report

1. GENERAL:		Table 1705A.6		
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/>	a. Verify that: <ul style="list-style-type: none"> • Site has been prepared properly prior to placement of controlled fill and/or excavations for foundations. • Foundation excavations are extended to proper depth and have reached proper material. • Materials below footings are adequate to achieve the design bearing capacity. 	See Notes	PI	Refer to specific items identified in the Appendix listing exemptions for limitations. Placement of controlled fill exceeding 12" depth under foundations is not permitted without a geotechnical report.
2. SOIL COMPACTION AND FILL:				
Test or Special Inspection		Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/>	a. Verify use of proper materials, densities and inspect lift thicknesses, placement and compaction during placement of fill.	Continuous	LOR*	* Under the supervision of a geotechnical engineer or LOR's engineering manager. Refer to specific items identified in the Appendix listing exemptions for limitations.
<input checked="" type="checkbox"/>	b. Compaction testing.	Test	LOR*	* Under the supervision of a geotechnical engineer or LOR's engineering manager. Refer to specific items identified in the Appendix listing exemptions for limitations.
3. DRIVEN DEEP FOUNDATIONS (PILES):				
Test or Special Inspection		Type	Performed By	Code References and Notes
<input type="checkbox"/>	a. Verify pile materials, sizes and lengths comply with the requirements.	Continuous	GE*	* By geotechnical engineer or his or her qualified representative.

DSA 103-19: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (SOILS), 2019 CBC

Application Number: 01-118984

School Name: Piedmont HS

School District: Berryessa

DSA File Number: 043-7

Increment Number:

Date Submitted: 7/6/2020

<input type="checkbox"/>	b. Determine capacities of test piles and conduct additional load tests as required.	Test	LOR*	* Under the supervision of the geotechnical engineer.
<input type="checkbox"/>	c. Inspect driving operations and maintain complete and accurate records for each pile.	Continuous	GE*	* By geotechnical engineer or his or her qualified representative.
<input type="checkbox"/>	d. Verify locations of piles and their plumbness, confirm type and size of hammer, record number of blows per foot of penetration, determine required penetrations to achieve design capacity, record tip and butt elevations and record any pile damage.	Continuous	GE*	* By geotechnical engineer or his or her qualified representative.

3. DRIVEN DEEP FOUNDATIONS (PILES):		Table 1705A.7		
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>	e. Steel piles.	Provide tests and inspections per STEEL section below.		
<input type="checkbox"/>	f. Concrete piles and concrete filled piles.	Provide tests and inspections per CONCRETE section below.		
<input type="checkbox"/>	g. For specialty piles, perform additional inspections as determined by the registered design professional in responsible charge.	*	*	* As defined on drawings or specifications.

4. CAST-IN-PLACE DEEP FOUNDATIONS (PIERS):		Table 1705A.8		
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/>	a. Inspect drilling operations and maintain complete and accurate records for each pier.	Continuous	PI	Continuous inspection to be provided by project inspector. Refer to specific items identified in the Appendix listing exemptions for limitations.
<input checked="" type="checkbox"/>	b. Verify pier locations, diameters, plumbness and lengths. Record concrete or grout volumes.	Continuous	PI	Continuous inspection to be provided by project inspector. Refer to specific items identified in the Appendix listing exemptions for limitations.
<input checked="" type="checkbox"/>	c. Concrete piers.	Provide tests and inspections per CONCRETE section below.		
<input checked="" type="checkbox"/>	d. Confirm adequate end strata bearing capacity per sheet S4	Continuous	GE*	* By geotechnical engineer or his or her qualified representative. (See Appendix for exemptions)

DSA 103-19: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (SOILS), 2019 CBC

Application Number: 01-118984

School Name: Piedmont HS

School District: Berryessa

DSA File Number: 043-7

Increment Number:

Date Submitted: 7/6/2020

<input type="checkbox"/>	a. Segmental retaining walls; inspect placement of units, dowels, connectors, etc.	Continuous	GE*	* By geotechnical engineer or his or her qualified representative. See DSA IR 16-3.
<input type="checkbox"/>	b. Placement of soil reinforcement, drainage devices and/or backfill.	Continuous	GE*	Placement, compaction and inspection of backfill per Section 1705A.6.1 for fills supporting foundations (Section 2 above). * By geotechnical engineer or his or her qualified representative.
<input type="checkbox"/>	c. Concrete retaining walls.	Provide tests and inspections per CONCRETE section below.		
<input type="checkbox"/>	d. Masonry retaining walls.	Provide tests and inspections per MASONRY section below.		
	6. OTHER SOILS:			
<input type="checkbox"/>	a. Soil Improvements	Test	GE*	Submit a comprehensive report documenting final soil improvements constructed, construction observation and the results of the confirmation testing and analysis to CGS for final acceptance. * By geotechnical engineer or his or her qualified representative.
<input type="checkbox"/>	b. Inspection of Soil Improvements	Continuous	GE*	* By geotechnical engineer or his or her qualified representative.
<input type="checkbox"/>				

DSA 103-19: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (Concrete), 2019 CBC

Table 1705A.3; ACI 318-14 Sections 26.12 & 26.13

Application Number: 01-118984	School Name: Piedmont HS	School District: Berryessa
DSA File Number: 043-7	Increment Number:	Date Submitted: 7/6/2020

7. CAST-IN-PLACE CONCRETE				
Material Verification and Testing:				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/>	a. Verify use of required design mix.	Periodic	SI	Table 1705A.3 Item 5, 1910A.1.
<input checked="" type="checkbox"/>	b. Identify, sample, and test reinforcing steel.	Test	LOR	1910A.2; ACI 318-14 Section 26.6.1.2; DSA IR 17-10. (See Appendix for exemptions.)
<input checked="" type="checkbox"/>	c. During concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.	Test	LOR	Table 1705A.3 Item 6; ACI 318-14 Sections 26.5 & 26.12.
<input checked="" type="checkbox"/>	d. Test concrete (f_c).	Test	LOR	1905A.1.15; ACI 318-14 Section 26.12.
Inspection:				
<input checked="" type="checkbox"/>	e. Batch plant inspection: Continuous	See Notes	SI	Default of ' Continuous ' per 1705A.3.3 . If approved by DSA, batch plant inspection may be reduced to ' Periodic ' subject to requirements in Section 1705A.3.3.1 , or eliminated per 1705A.3.3.2 . (See Appendix for exemptions.)
<input type="checkbox"/>	f. Welding of reinforcing steel.	Provide special inspection per STEEL, Category 19.1(d) & (e) and/or 19.2(g) & (h) below.		

8. PRESTRESSED / POST-TENSIONED CONCRETE (in addition to Cast-in-Place Concrete tests and inspections):				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>	a. Sample and test prestressing tendons and anchorages.	Test	LOR	1705A.3.4, 1910A.3
<input type="checkbox"/>	b. Inspect placement of prestressing tendons.	Periodic	SI	1705A.3.4, Table 1705A.3 Items 1 & 9.
<input type="checkbox"/>	c. Verify in-situ concrete strength prior to stressing of post-tensioning tendons.	Periodic	SI	Table 1705A.3 Item 11. Special inspector to verify specified concrete strength test prior to stressing.

DSA 103-19: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (Concrete), 2019 CBC

Table 1705A.3; ACI 318-14 Sections 26.12 & 26.13

Application Number: 01-118984	School Name: Piedmont HS	School District: Berryessa
DSA File Number: 043-7	Increment Number:	Date Submitted: 7/6/2020

<input type="checkbox"/>	d. Inspect application of post-tensioning or prestressing forces and grouting of bonded prestressing tendons.	Continuous	SI	1705A.3.4, Table 1705A.3 Item 9; ACI 318-14 Section 26.13
--------------------------	--	-------------------	-----------	--

9. PRECAST CONCRETE (in addition to Cast-in-Place Concrete tests and inspections):				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>	a. Inspect fabrication of precast concrete members.	Continuous	SI	ACI 318-14 Section 26.13.
<input type="checkbox"/>	b. Inspect erection of precast concrete members.	Periodic	SI*	Table 1705A.3 Item 10. * May be performed by PI when specifically approved by DSA.

10. SHOTCRETE (in addition to Cast-in-Place Concrete tests and inspections):				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>	a. Inspect shotcrete placement for proper application techniques.	Continuous	SI	1705A.19, Table 1705A.3 Item 7, 1908A.6, 1908A.7, 1908A.8, 1908A.9, 1908A.11, 1908A.12. See ACI 506.2-13 Section 3.4, ACI 506R-16.
<input type="checkbox"/>	b. Sample and test shotcrete (f'_c).	Test	LOR	1908A.5, 1908A.10.

11. POST-INSTALLED ANCHORS:				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>	a. Inspect installation of post-installed anchors	See Notes	SI*	1617A.1.19, Table 1705A.3 Item 4a (Continuous) & 4b (Periodic), 1705A.3.8 (See Appendix for exemptions). ACI 318-14 Sections 17.8 & 26.13. * May be performed by the project inspector when specifically approved by DSA.
<input type="checkbox"/>	b. Test post-installed anchors.	Test	LOR	1910A.5. (See Appendix for exemptions.)

DSA 103-19: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (Concrete), 2019 CBC

Table 1705A.3; ACI 318-14 Sections 26.12 & 26.13

Application Number: 01-118984

School Name: Piedmont HS

School District: Berryessa

DSA File Number: 043-7

Increment Number:

Date Submitted: 7/6/2020

12. OTHER CONCRETE:			
Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>			

DSA 103-19: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (Steel and Aluminum), 2019 CBC

1705A.2.1, Table 1705A.2.1; AISC 303-16, AISC 341-16, AISC 358-16, AISC 360-16; AISI S100-16

Application Number: 01-118984

School Name: Piedmont HS

School District: Berryessa

DSA File Number: 043-7

Increment Number:

Date Submitted: 7/6/2020

17. STRUCTURAL STEEL, COLD-FORMED STEEL AND ALUMINUM USED FOR STRUCTURAL PURPOSES				
Material Verification and Testing:				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/>	a. Verify identification of all materials and: <ul style="list-style-type: none"> • Mill certificates indicate material properties that comply with requirements. • Material sizes, types and grades comply with requirements. 	Periodic	*	Table 1705A.2.1 Item 3a–3c. 2202A.1; AISI S100-16 Section A3.1 & A3.2, AISI S240-15 Section A3 & A5, AISI S220-15 Sections A4 & A6. * By special inspector or qualified technician when performed off-site.
<input checked="" type="checkbox"/>	b. Test unidentified materials	Test	LOR	2202A.1.
<input checked="" type="checkbox"/>	c. Examine seam welds of HSS shapes	Periodic	SI	DSA IR 17-3.
Inspection:				
<input checked="" type="checkbox"/>	d. Verify and document steel fabrication per DSA-approved construction documents.	Periodic	SI	Not applicable to cold-formed steel light-frame construction, except for trusses (1705A.2.4).

18. HIGH-STRENGTH BOLTS: RCSC 2014				
Material Verification and Testing of High-Strength Bolts, Nuts and Washers:				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>	a. Verify identification markings and manufacturer's certificates of compliance conform to ASTM standards specified in the DSA-approved documents.	Periodic	SI	Table 1705A.2.1 Items 1a & 1b, 2202A.1; AISC 360-16 Section A3.3, J3.1, and N3.2; RCSC 2014 Section 1.5 & 2.1; DSA IR 17-8 & DSA IR 17-9.
<input type="checkbox"/>	b. Test high-strength bolts, nuts and washers.	Test	LOR	Table 1705A.2.1 Item 1c, 2213A.1; RCSC 2014 Section 7.2; DSA IR 17-8.
Inspection of High-Strength Bolt Installation:				
<input type="checkbox"/>	c. Bearing-type ("snug tight") connections.	Periodic	SI	Table 1705A.2.1 Item 2a, 1705A.2.6, 2204A.2; AISC 360-16 J3.1, J3.2, M2.5 & N5.6; RCSC 2014 Section 9.1; DSA IR 17-9.

DSA 103-19: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (Steel and Aluminum), 2019 CBC

1705A.2.1, Table 1705A.2.1; AISC 303-16, AISC 341-16, AISC 358-16, AISC 360-16; AISI S100-16

Application Number: 01-118984

School Name: Piedmont HS

School District: Berryessa

DSA File Number: 043-7

Increment Number:

Date Submitted: 7/6/2020

<input type="checkbox"/>	d. Pretensioned and slip-critical connections.	*	SI	Table 1705A.2.1 Items 2b & 2c, 1705A.2.6, 2204A.2; AISC 360-16 J3.1, J3.2, M2.5 & N5.6; RCSC 2014 Sections 9.2 & 9.3; DSA IR 17-9. * "Continuous" or "Periodic" depends on the tightening method used.
--------------------------	---	--------------	---------------	---

19. WELDING:	1705A.2.5, Table 1705A.2.1 Items 4 & 5; AWS D1.1 and AWS D1.8 for structural steel; AWS D1.2 for Aluminum; AWS D1.3 for cold-formed steel; AWS D1.4 for reinforcing steel; DSA IR 17-3 (See Appendix for exemptions.)
---------------------	--

Verification of Materials, Equipment, Welders, etc.:

	Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/>	a. Verify weld filler material identification markings per AWS designation listed on the DSA-approved documents and the WPS.	Periodic	SI	DSA IR 17-3.
<input checked="" type="checkbox"/>	b. Verify weld filler material manufacturer's certificate of compliance.	Periodic	SI	DSA IR 17-3.
<input checked="" type="checkbox"/>	c. Verify WPS, welder qualifications and equipment.	Periodic	SI	DSA IR 17-3.

19.1 SHOP WELDING:

	Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/>	a. Inspect groove welds, multi-pass fillet welds, single pass fillet welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Items 5a.1–4; AISC 360-16 (and AISC 341-16 as applicable); DSA IR 17-3.
<input checked="" type="checkbox"/>	b. Inspect single-pass fillet welds ≤ 5/16", floor and roof deck welds.	Periodic	SI	1705A.2.2, Table 1705A.2.1 Items 5a.5 & 5a.6; AISC 360-16 (and AISC 341-16 as applicable); DSA IR 17-3.
<input type="checkbox"/>	c. Inspect welding of stairs and railing systems.	Periodic	SI	1705A.2.1; AISC 360-16 (and AISC 341-16 as applicable); AWS D1.1 & D1.3; DSA IR 17-3.
<input type="checkbox"/>	d. Verification of reinforcing steel weldability other than ASTM A706.	Periodic	SI	1705A.3.1; AWS D1.4; DSA IR 17-3. Verify carbon equivalent reported on mill certificates.
<input type="checkbox"/>	e. Inspect welding of reinforcing steel.	Continuous	SI	Table 1705A.2.1 Item 5b, 1705A.3.1, Table 1705A.3 Item 2, 1903A.8; AWS D1.4; DSA IR 17-3.

DSA 103-19: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (Steel and Aluminum), 2019 CBC

1705A.2.1, Table 1705A.2.1; AISC 303-16, AISC 341-16, AISC 358-16, AISC 360-16; AISI S100-16

Application Number: 01-118984

School Name: Piedmont HS

School District: Berryessa

DSA File Number: 043-7

Increment Number:

Date Submitted: 7/6/2020

19.2 FIELD WELDING:				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/>	a. Inspect groove welds, multi-pass fillet welds, single pass fillet welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Items 5a.1–4; AISC 360-16 (AISC 341-16 as applicable); DSA IR 17-3.
<input checked="" type="checkbox"/>	b. Inspect single-pass fillet welds ≤ 5/16".	Periodic	SI	Table 1705A.2.1 Item 5a.5; AISC 360-16 (AISC 341-16 as applicable); DSA IR 17-3.
<input type="checkbox"/>	c. Inspect end-welded studs (ASTM A-108) installation (including bend test).	Periodic	SI	2213A.2; AISC 360-16 (AISC 341-16 as applicable); AWS D1.1; DSA IR 17-3.
<input type="checkbox"/>	d. Inspect floor and roof deck welds.	Periodic	SI	1705A.2.2, Table 1705A.2.1 Item 5a.6; AISC 360-16 (AISC 341-16 as applicable); AWS D1.3; DSA IR 17-3.
<input type="checkbox"/>	e. Inspect welding of structural cold-formed steel.	Periodic	SI*	1705A.2.5; AWS D1.3; DSA IR 17-3. The quality control provisions of AISI S240-15 Chapter D shall also apply. * May be performed by the project inspector when specifically approved by DSA.
<input type="checkbox"/>	f. Inspect welding of stairs and railing systems.	Periodic	SI*	1705A.2.1; AISC 360-16 (AISC 341-16 as applicable); AWS D1.1 & D1.3; DSA IR 17-3. * May be performed by the project inspector when specifically approved by DSA.
<input type="checkbox"/>	g. Verification of reinforcing steel weldability.	Periodic	SI	1705A.3.1; AWS D1.4; DSA IR 17-3. Verify carbon equivalent reported on mill certificates.
<input type="checkbox"/>	h. Inspect welding of reinforcing steel.	Continuous	SI	Table 1705A.2.1 Item 5b, 1705A.3.1, Table 1705A.3 Item 2, 1903A.8; AWS D1.4; DSA IR 17-3.

20. NONDESTRUCTIVE TESTING:				
1705A.2.1, Table 1705A.2.1; AISC 303-16, AISC 341-16, AISC 358-16, AISC 360-16; AISI S100-16				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>	a. Ultrasonic	Test	LOR	1705A.2.1, 1705A.2.5; AISC 341-16 J6.2, AISC 360-16 N5.5; ANSI/ASNT CP-189, SNT TC-1A; AWS D1.1, AWS D1.8; DSA IR 17-2.

DSA 103-19: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (Steel and Aluminum), 2019 CBC

1705A.2.1, Table 1705A.2.1; AISC 303-16, AISC 341-16, AISC 358-16, AISC 360-16; AISI S100-16

Application Number: 01-118984

School Name: Piedmont HS

School District: Berryessa

DSA File Number: 043-7

Increment Number:

Date Submitted: 7/6/2020

<input type="checkbox"/>	b. Magnetic Particle	Test	LOR	1705A.2.1, 1705A.2.5; AISC 341-16 J6.2, AISC 360-16 N5.5; ANSI/ASNT CP-189, SNT-TC-1A; AWS D1.1, AWS D1.8; DSA IR 17-2.
<input type="checkbox"/>				

21. STEEL JOISTS AND TRUSSES: 1705A.2.1, Table 1705A.2.1; AISC 303-16, AISC 341-16, AISC 358-16, AISC 360-16; AISI S100-16				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>	a. Verify size, type and grade for all chord and web members as well as connectors and weld filler material; verify joist profile, dimensions and camber (if applicable); verify all weld locations, lengths and profiles; mark or tag each joist.	Continuous	SI	1705A.2.3, Table 1705A.2.3; AWS D1.1; DSA IR 22-3 for steel joists only. 1705A.2.4; AWS D1.3 for cold-formed steel trusses.

22. SPRAY APPLIED FIRE-PROOFING: 1705A.2.1, Table 1705A.2.1; AISC 303-16, AISC 341-16, AISC 358-16, AISC 360-16; AISI S100-16				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>	a. Examine structural steel surface conditions, inspect application, take samples, measure thickness and verify compliance of all aspects of application with DSA-approved documents.	Periodic	SI	1705A.14.
<input type="checkbox"/>	b. Test bond strength.	Test	LOR	1705A.14.6.
<input type="checkbox"/>	c. Test density.	Test	LOR	1705A.14.5.

DSA 103-19: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (Steel and Aluminum), 2019 CBC

1705A.2.1, Table 1705A.2.1; AISC 303-16, AISC 341-16, AISC 358-16, AISC 360-16; AISI S100-16

Application Number: 01-118984**School Name:** Piedmont HS**School District:** Berryessa**DSA File Number:** 043-7**Increment Number:****Date Submitted:** 7/6/2020

23. ANCHOR BOLTS AND ANCHOR RODS:				
<input checked="" type="checkbox"/>	a. Anchor Bolts and Anchor Rods	Test	LOR	Sample and test anchor bolts and anchor rods not readily identifiable per procedures noted in DSA IR 17-11.
<input type="checkbox"/>	b. Threaded rod not used for foundation anchorage.	Test	LOR	Sample and test threaded rods not readily identifiable per procedures noted in DSA IR 17-11.

23.1 OTHER STEEL:				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>				

DSA 103-19: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (Other), 2019 CBC

Application Number: 01-118984

School Name: Piedmont HS

School District: Berryessa

DSA File Number: 043-7

Increment Number:

Date Submitted: 7/6/2020

27. OTHER:				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>	a. Load test for identified product(s):	Test	LOR	1709A.2, 1709A.3. Testing is not required for: 1) a product with a valid evaluation service report per DSA IR A-5, or 2) a product that can be justified by structural calculation.
<input type="checkbox"/>	b. Installation torque for non-HS bolts	Continuous	SI*	Applicable to communication towers identified as Essential Service Facility Projects (ESFP). Calibrated wrench use required, verified by SI during installation. DSA Policy PL 18-01: Communication Towers, Poles and Buildings Utilized by State Agencies for Essential Services Communications.*EXCEPTION: Non-ESFP may use PI without need for notification to DSA.
<input checked="" type="checkbox"/>	c. Electrical Rod	Test	IOR	

Appendix: Work Exempt from DSA Requirements for Structural Tests / Special Inspections

Application Number: 01-118984

School Name: Piedmont HS

School District: Berryessa

DSA File Number: 043-7

Increment Number:

Date Submitted: 7/6/2020

Exempt items given in DSA IR A-22 or the 2019 CBC (including DSA amendments) and those items identified below with an "X" by the design professional are NOT subject to DSA requirements for the structural tests / special inspections noted. **Items marked as exempt shall be identified on the approved construction documents.** The project inspector shall verify all construction complies with the approved construction documents.

	SOILS:
<input checked="" type="checkbox"/>	1. Deep foundations acting as a cantilever footing designed based on minimum allowable pressures per CBC Table 1806A.2 and having no geotechnical report for the following cases: A) free standing sign or scoreboard, B) cell or antenna towers and poles less than 35'-0" tall (e.g., lighting poles, flag poles, poles supporting open mesh fences, etc.), C) single-story structure with dead load less than 5 psf (e.g., open fabric shade structure), or D) covered walkway structure with an apex height less than 10'-0" above adjacent grade.
<input checked="" type="checkbox"/>	2. Shallow foundations, etc. are exempt from special inspections and testing by a Geotechnical Engineer for the following cases: A) buildings without a geotechnical report and meeting the exception Item #1 criteria in CBC Section 1803A.2 supported by native soil (any excavation depth) or fill soil (not exceeding 12" depth per CBC, Section 1804A.6), B) soil scarification/recompaction not exceeding 12" depth, C) native or fill soil supporting exterior non-structural flatwork (e.g., sidewalks, site concrete ramps, site stairs, parking lots, driveways, etc.), D) unpaved landscaping and playground areas, or E) utility trench backfill.

	CONCRETE/MASONRY:
<input checked="" type="checkbox"/>	1. Post-installed anchors for the following: A) exempt non-structural components (e.g., mechanical, electrical, plumbing equipment - see Item 7 for "Welding") given in CBC Section 1617A.1.18 (which replaces ASCE 7-16, Section 13.1.4) or B) interior nonstructural wall partitions meeting criteria listed in exempt Item 3 for "Welding."
<input checked="" type="checkbox"/>	2. Concrete batch plant inspection is not required for items given in CBC Section 1705A.3.3.2 subject to the requirements and limitations in that section.
<input checked="" type="checkbox"/>	3. Non-bearing non-shear masonry walls may be exempt from certain DSA masonry testing and special inspection items as allowed per DSA IR 21-1. Refer to construction documents for specific exemptions accordingly for each applicable wall condition.
<input type="checkbox"/>	4. Epoxy shear dowels in site flatwork and/or other non-structural concrete.
<input type="checkbox"/>	5. Testing of reinforcing bars is not required for items given in CBC Section 1910A.2 subject to the requirements and limitations in that section.

Appendix: Work Exempt from DSA Requirements for Structural Tests / Special Inspections

Application Number: 01-118984

School Name: Piedmont HS

School District: Berryessa

DSA File Number: 043-7

Increment Number:

Date Submitted: 7/6/2020

	Welding:
☑	1. Solid-clad and open-mesh gates with maximum leaf span or rolling section for rolling gates of 10' and apex height less than 8'-0" above lowest adjacent grade. When located above circulation or occupied space below, these gates are not located within 1.5x gate/fence height (max 8'-0") to the edge of floor or roof.
☑	2. Handrails, guardrails and modular or relocatable ramps associated with walking surfaces less than 30" above adjacent grade (excluding post base connections per the 'Exception' language in Section 1705A.2.1); fillet welds shall not be ground flush.
☑	3. Non-structural interior cold-formed steel framing spanning less than 15'-0", such as in interior partitions, interior soffits, etc. supporting only self weight and light-weight finishes or adhered tile, masonry, stone, or terra cotta veneer no more than 5/8" thickness and apex less than 20'-0" in height and not over an exit way. Maximum tributary load to a member shall not exceed the equivalent of that occurring from a 10'x10' opening in a 15' tall wall for a header or king stud.
☑	4. Manufactured support frames and curbs using hot rolled or cold-formed steel (i.e., light gauge) for mechanical, electrical, or plumbing equipment weighing less than 2000# (equipment only) (connections of such frames to superstructure elements using welding will require special inspection as noted in selected item(s) for Sections 19, 19.1 and/or 19.2 of listing above).
☑	5. Manufactured components (e.g., Tolco, B-Line, Afcon, etc.) for mechanical, electrical, or plumbing hanger support and bracing (connections of such components to superstructure elements using welding will require special inspection as noted in selected item(s) for Sections 19, 19.1 and/or 19.2 of listing above).
☑	6. TV Brackets, projector mounts with a valid listing (see DSA IR A-5) and recreational equipment (e.g., playground structures, basketball backstops, etc.) (connections of such elements to superstructure elements using welding will require special inspection as noted in selected item(s) for section 19, 19.1 and/or 19.2 located in the Steel/Aluminum category).
☑	7. Any support for exempt non-structural components given in CBC Section 1617A.1.18 (which replaces ASCE 7-16, Section 13.1.4) meeting the following: A) when supported on a floor/roof, <400# and resulting composite center of mass (including component's center of mass) ≤4' above supporting floor/roof, B) when hung from a wall or roof/floor, <20# for discrete units or <5 plf for distributed systems.

DSA 103-19: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (SIGNATURE), 2019 CBC

Application Number: 01-118984


School Name: Piedmont HS

School District: Berryessa

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 07/06/20

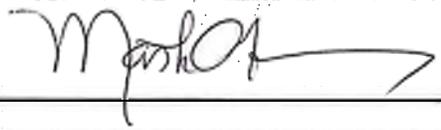Name of Architect or Engineer in general responsible charge: Mark C. Finney	
Name of Structural Engineer (When structural design has been delegated): 	
Signature of Architect or Structural Engineer:	Date: 07/06/20



Note: To facilitate DSA electronic mark-ups and identification stamp application, DSA recommends against using secured electronic or digital signatures.

DSA STAMP
IDENTIFICATION STAMP DIV. OF THE STATE ARCHITECT
APP: 01-118984 INC:
REVIEWED FOR
SS <input checked="" type="checkbox"/> FLS <input checked="" type="checkbox"/> ACS <input checked="" type="checkbox"/>
DATE: 08/13/2020

DSA 103-19: LIST OF REQUIRED VERIFIED REPORTS, 2019 CBC

Application Number: 01-118984

School Name: Piedmont HS

School District: Berryessa

DSA File Number: 043-7

Increment Number:

Date Submitted: 7/6/2020

1. Structural Testing and Inspection: Laboratory Verified Report Form DSA 291
 2. Concrete Batch Plant Inspection: Laboratory Verified Report Form DSA 291
 3. Shop Welding Inspection: Laboratory Verified Report Form DSA 291, or, for independently contracting SI, Special Inspection Verified Report Form DSA 292
 4. Field Welding Inspection: Laboratory Verified Report Form DSA 291, or, for independently contracting SI, Special Inspection Verified Report Form DSA 292
-

NOBLE ELEMENTARY SCHOOL SHADE STRUCTURE

3466 GROSSMONT DR. SAN JOSE
BERRYESSA UNION SCHOOL DISTRICT

DSA FILE NUMBER 43-7
DSA APPLICATION NUMBER 01-118981
PROJECT TRACKING NUMBER 69377-111



GENERAL NOTES

PRE-BID SITE VISIT
CONTRACTOR SHALL VISIT THE PROJECT AREA IN ORDER TO BECOME FAMILIAR WITH EXISTING CONDITIONS AND THE REQUIREMENTS OF THE PROJECT. THE CONTRACTOR MAY CONTACT THE ARCHITECT DURING THE BIDDING PHASE REGARDING CLARIFICATIONS AND PROJECT REQUIREMENTS.

SAFETY
IN ACCORDANCE WITH GENERALLY ACCEPTED CONSTRUCTION PRACTICES, THE CONTRACTOR WILL BE SOLELY AND COMPLETELY RESPONSIBLE FOR CONDITIONS OF THE JOB SITE INCLUDING SAFETY OF ALL PERSONS AND PROPERTY DURING PERFORMANCE OF THE WORK. THIS REQUIREMENT WILL APPLY CONTINUOUSLY AND NOT BE LIMITED TO NORMAL WORKING HOURS.

DAMAGE TO STRUCTURE OR SYSTEMS TO REMAIN
CONTRACTOR SHALL REIMBURSE THE OWNER FOR REPAIR AND REPLACEMENT, INCLUDING ARCHITECT'S FEES, FOR ANY DAMAGE CAUSED TO STRUCTURES, LANDSCAPE, SITE WORK, OR EXISTING SYSTEMS TO REMAIN, AS THE RESULT OF CONSTRUCTION OPERATIONS.

EXISTING CONDITIONS
ALL EXISTING CONDITIONS ARE SHOWN BASED ON THE BEST INFORMATION AVAILABLE AT THE TIME, BUT WITHOUT GUARANTEE OF ACCURACY. THE CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS, DIMENSIONS, AND BUILDING DATA AT THE JOB SITE. ANY DISCREPANCIES REQUIRING MODIFICATION TO THE CONSTRUCTION DOCUMENTS SHALL BE REPORTED TO THE ARCHITECT IMMEDIATELY. NO MODIFICATIONS SHALL BE MADE BY THE CONTRACTOR WITHOUT PRIOR APPROVAL FROM THE ARCHITECT.

CONTRACTOR'S EQUIPMENT
COORDINATE WITH OWNER'S REPRESENTATIVE FOR APPROVED LOCATION OF JOB SITE ACCESS, PARKING, AND LOCATION OF CONTRACTOR'S EQUIPMENT AND MATERIAL STORAGE AREA. SEE SITE PLAN FOR ADDITIONAL NOTES.

UTILITY SHUT-DOWNS AND CONNECTIONS
ALL REQUIRED UTILITY SHUT DOWNS SHALL HAVE PRIOR APPROVAL FROM THE OWNER'S REPRESENTATIVE. REQUEST SHALL BE SUBMITTED WITH ADEQUATE ADVANCE NOTICE PER PROJECT REQUIREMENTS.

ASBESTOS AND ASBESTOS PRODUCTS
THE OWNER/OPERATOR AND CONTRACTOR SHALL BE AWARE THAT BUILDINGS CONSTRUCTED PRIOR TO 1978 (OR THEREABOUTS) POSSIBLY CONTAIN ASBESTOS IN SOME EXISTING CONSTRUCTION MATERIALS, AND WILL LIKELY BE ENCOUNTERED DURING ALTERATIONS OR REMODELING.

UNDER CALIFORNIA TITLE 8, THE OWNER AND CONTRACTOR BOTH HAVE RESPONSIBILITIES TO DETERMINE THE EXISTENCE OF ASBESTOS CONTAINING MATERIALS IN AREAS TO BE ALTERED OR REMODELED PRIOR TO COMMENCEMENT OF WORK AND TO TAKE APPROPRIATE MEASURES TO PROTECT PERSONNEL. CAL-OSHA HAS JURISDICTION OVER ASBESTOS RELATED WORK. ASBESTOS RELATED WORK SHALL BE DONE IN ACCORDANCE WITH CALIFORNIA GENERAL INDUSTRIAL SAFETY ORDERS, TITLE 8, SECTION 341.6 THROUGH 341.14. ASBESTOS IN THE WORK ENVIRONMENT IS REGULATED BY TITLE 8, SECTION 5208.

THE BAY AREA AIR QUALITY MANAGEMENT DISTRICT AND DISTRICT REGULATION 11-2-401.3 REQUIRES EVERY RENOVATION INVOLVING THE REMOVAL OF 100 SQ. FT., LN.FT. OR GREATER OF REGULATED ASBESTOS CONTAINING MATERIAL, AND FOR EVERY DEMOLITION (EVEN WHEN NO ASBESTOS IS PRESENT), A NOTIFICATION MUST BE SENT TO THE BAAQMD AT LEAST 10 WORKING DAYS PRIOR TO COMMENCEMENT OF DEMOLITION/RENOVATION.

ALL BUILDING MATERIALS MUST BE ASBESTOS FREE.
THESE DOCUMENTS DO NOT ADDRESS CONTAINMENT FOR EXISTING AREAS OF ASBESTOS WHICH MAY BE DISCOVERED DURING CONSTRUCTION. THE OWNER'S ASBESTOS SUBCONTRACTOR IS SOLELY RESPONSIBLE FOR THE DETECTION, REMOVAL, AND THE DISPOSAL OF ANY EXISTING ASBESTOS MATERIAL. ARCHITECTURAL AND ENGINEERING FEES FOR ASBESTOS ABATEMENT TO OBTAIN STATE APPROVALS, AS WELL AS THE COST OF ANY REPAIRS, FOR DAMAGE CAUSED OR REPLACEMENT OF EXISTING SYSTEMS TO REMAIN, DUE TO WORK PERFORMED BY THE ASBESTOS ABATEMENT SUBCONTRACTOR, SHALL BE THE RESPONSIBILITY OF SAID SUBCONTRACTOR.

CONSTRUCTION SCHEDULING
CONTRACTOR SHALL COORDINATE ALL CONSTRUCTION OPERATIONS WITH OWNER'S REPRESENTATIVE PRIOR TO SCHEDULING AND START OF THE WORK. CONTRACTOR SHALL PROVIDE PROTECTION TO ALL EXISTING SPACES AND SYSTEMS WHICH ARE IN USE, ADJOINING THE PROJECT, AND NOT PART OF THE PROJECT.

INTERIOR FINISHES
INTERIOR FINISHES AND ALL WALL COVERING MATERIAL SHALL CONFORM TO CCR TITLE 24, PART 2, CHAPTER 6.

TITLE 24 COMPLIANCE
THE INTENT OF THESE DRAWINGS AND SPECIFICATIONS IS THAT THE WORK OF THE ALTERATION, REHABILITATION, OR RECONSTRUCTION IS TO BE IN ACCORDANCE WITH TITLE 24, CALIFORNIA CODE OF REGULATIONS (2019 CBC), SHOULD ANY EXISTING CONDITIONS BE DISCOVERED NOT COVERED BY THE CONTRACT DOCUMENTS WHERE IN THE FINISHED WORK DOES NOT COMPLY WITH 2019 CBC. A CONSTRUCTION CHANGE DOCUMENT OR A SEPARATE SET OF PLANS AND SPECIFICATIONS, DETAILING AND SPECIFYING THE REQUIRED WORK, SHALL BE SUBMITTED TO AND APPROVED BY THE DSA BEFORE PROCEEDING WITH THE WORK.

ADMINISTRATIVE REQUIREMENTS FROM PART 1, TITLE 24, C.C.R.
(B) AND 4-342
- ADDENDA AND CHANGES AS PER SECTION 4-338
- INSPECTOR APPROVED BY DSA
- INSPECTOR AND CONTINUOUS INSPECTION OF WORK PER SECTION 4-333 (C)
- TESTS AND TESTING LABORATORY PER SECTION 4-335 (OWNER SHALL PAY THE TESTING LABORATORY)
- SPECIAL INSPECTION PER SECTION 4-333 (C)
- CONTRACTOR SHALL SUBMIT VERIFIED REPORT OR SECTION 4-336 & 4-343 (C)
- ADMINISTRATION OR CONSTRUCTION PER PART 1, TITLE 24, C.C.R. DUTIES OF ARCHITECT, STRUCTURAL ENGINEER, OR PROFESSIONAL ENGINEER PER SECTION 4-333 (A) AND 4-341
- DUTIES OF CONTRACTOR PER SECTION 4-343
- VERIFIED REPORTS PER SECTION 4-343 AND 4-336
- A COPY OF PARTS 1 TO 5 OF TITLE 24 SHALL BE KEPT AND AVAILABLE IN THE FIELD DURING CONSTRUCTION
- DSA SHALL BE NOTIFIED AT START OF CONSTRUCTION AND PRIOR TO PLACEMENT OF CONCRETE PER SECTION 4-331
- SUPERVISION BY DSA PER SECTION 4-334
- DSA IS NOT SUBJECT TO ARBITRATION

PIPES, DUCTS AND CONDUIT - SUPPORT AND BRACING
PIPES, DUCTS, AND CONDUITS SHALL BE SUPPORTED AND BRACED PER THE SMACNA "GUIDELINES FOR SEISMIC RESTRAINTS OF MECHANICAL SYSTEMS AND PLUMBING PIPING SYSTEMS", OPM 0062-13 SEISMIC BRACING AND SUPPORT SYSTEMS.

DRILLED-IN EXPANSION ANCHORS
WHEN INSTALLING DRILLED-IN ANCHORS AND/OR POWDER DRIVEN PINS IN EXISTING NON-PRESTRESSED REINFORCED CONCRETE, USE CARE AND CAUTION TO AVOID CUTTING OR DAMAGING THE EXISTING REINFORCING BARS. WHEN INSTALLING THEM INTO EXISTING PRESTRESSED CONCRETE (PRE-OR POST-TENSIONED), LOCATE THE PRESTRESSED TENDONS BY USING A NON-DESTRUCTIVE METHOD PRIOR TO INSTALLATION. EXERCISE EXTREME CARE AND CAUTION TO AVOID CUTTING OR DAMAGING THE TENDONS DURING INSTALLATION. MAINTAIN A MINIMUM CLEARANCE OF ONE INCH BETWEEN THE REINFORCEMENT AND THE DRILLED-IN ANCHOR AND/OR PIN.

GENERAL NOTES

ADMINISTRATIVE REQUIREMENTS
- ADDENDA MUST BE SIGNED BY ARCHITECT AND APPROVED BY DSA
- NO CHANGES OR REVISIONS SHALL BE MADE FOLLOWING WRITTEN APPROVAL WHICH AFFECTS ACCESS COMPLIANCE ITEM UNLESS SUCH CHANGES TO REVISIONS ARE SUBMITTED TO DSA FOR APPROVAL. SUBSTITUTIONS AFFECTING DSA REGULATED ITEMS SHALL BE SUBMITTED AS A CONSTRUCTION CHANGE DOCUMENT OR ADDENDA, AND SHALL BE APPROVED BY DSA PRIOR TO FABRICATION AND INSTALLATION
- CONSTRUCTION CHANGE DOCUMENTS MUST BE SIGNED BY THE FOLLOWING:
- ARCHITECT OR ENGINEER OF RECORD
- STRUCTURAL ENGINEER (WHEN APPLICABLE)
- DELEGATED PROFESSIONAL ENGINEER
- DSA
- MATERIALS AND THEIR INSTALLATIONS SHALL COMPLY WITH APPLICABLE CODES.
- PER CBC 11B-104.1 "ALL DIMENSIONS ARE SUBJECT TO CONVENTIONAL INDUSTRY TOLERANCES EXCEPT WHERE THE REQUIREMENT IS STATED AS A RANGE WITH SPECIFIC MINIMUM AND MAXIMUM END POINTS."

SOILS AND GEOTECHNICAL: A GEOTECHNICAL INVESTIGATION MUST BE CONDUCTED IN ACCORDANCE WITH CBC SECTION 1803A AND REPORTED AS REQUIRED IN SECTION 1803A.7 (SEE EXCEPTION IN APPENDIX A ITEM C3). THE DESIGN ARCHITECT OR STRUCTURAL ENGINEER IN GENERAL RESPONSIBLE CHARGE MUST VERIFY THAT THE GEOTECHNICAL REPORT INDICATES THAT ALL SOILS RELATED PARAMETERS EXCEED THE MINIMUM DESIGN REQUIREMENTS IDENTIFIED ON THE PC DRAWINGS INCLUDING BUT NOT LIMITED TO ALLOWABLE SOIL PRESSURES, SURCHARGE, DOWN-DRAW, AND EFFECTS DUE TO HIGH-WATER TABLE, ETC., AS APPLICABLE.

GEOHAZARD REPORT (ENGINEERING GEOLOGIC REPORT): A GEOLOGIC HAZARDS INVESTIGATION MUST BE CONDUCTED IN ACCORDANCE WITH CBC SECTION 1803A.8 AND R 4-4. GEOHAZARD REPORT REQUIREMENTS. THE DESIGN ARCHITECT OR STRUCTURAL ENGINEER IN GENERAL RESPONSIBLE CHARGE MUST VERIFY THAT THE GEOLOGIC HAZARDS WHICH WOULD PRECLUDE THE USE OF THE PC DESIGN AT THE SITE, INCLUDING BUT NOT LIMITED TO LIQUEFACTION POTENTIAL, LANDSLIDE, FLOODING, EARTHQUAKE FAULTING, ETC.

ABBREVIATIONS

(REFER TO CONSULTANT DRAWINGS FOR ADDITIONAL ABBREVIATIONS)

A.F.F.	ABOVE FINISHED FLOOR	LAM.	LAMINATE
A.P.	ACCESS PANEL	LAV.	LAVATORY
ACT	ACOUSTIC TILE	M.B.	MACHINE BOLT
ADJ.	ADJUSTABLE	M.S.	MACHINE SCREW
ALUM.	ALUMINUM	M.H.	MANHOLE
A.B.	ANCHOR BOLT	MFG.	MANUFACTURER
APPROX.	APPROXIMATELY	M.B.	MARKER BOARD
ARCH.	ARCHITECT	MATL.	MATERIAL
AC	ASPHALTIC CONCRETE	MAX.	MAXIMUM
B	BENCH MARK	MECH.	MECHANICAL
B.M.	BENCH MARK	METAL	METAL
BLKG.	BLOCKING BOARD	MIN.	MINIMUM
BD.	BOTH WAYS	MISC.	MISCELLANEOUS
B.W.	BOTTOM	MTD.	MOUNTED
BOT.	BOTTOM	(N)	NEW
BLDG.	BUILDING	NOM.	NOMINAL
B.U.R.	BUILT-UP ROOFING	N.I.C.	NOT IN CONTRACT
C.B.	CATCH BASIN	N.T.S.	NOT TO SCALE
C.E.	CEILING	NO. or #	NUMBER
C.E.M.	CEMENT	OCC.	OCCUPANT(CY)
C.C. or O.C.	CENTER TO CENTER	O.C.	ON CENTER
		OPNG.	OPENING
CER. TILE	CERAMIC TILE	OPP.	OPPOSITE
CLEANOUT	CLEANOUT	O.P.H.	OPPOSITE HAND
C.O.T.G.	CLEANOUT TO GRADE	O.H.	OUTSIDE FACE OF STUD
CLR.	CLEAR	O.H.W.S.	OVAL HEAD WOOD SCREW
C.A.H.R.	CLEAR ALL HEART REDWOOD	O.D.	OVERFLOW DRAIN and/or OUTSIDE DIAMETER
C.W.	COLD WATER	O.F.C.I.	OWNER FURNISHED and CONTRACTOR INSTALLED
COL.	COLUMN	PR.	PARTITION
COM.	COMMON	PL	PLATE
CONC.	CONCRETE	#	PEN (NAILS)
CONST.	CONSTRUCTION	PLAS.	PLASTER
C.H.	CONSTRUCTION HEART	PLYWD.	PLYWOOD
C.J.	CONSTRUCTION JOINT	P.V.C.	POLY VINYL CHLORIDE
C.N.T.	CONTINUOUS	P.T.	PRESSURE TREATED
CONTR.	CONTRACTOR	P.L.	PROPERTY LINE
COUNTER	COUNTER	R or RAD.	RADIUS
COUNTER SUNK	COUNTER SUNK	R.W.L.	RAIN WATER LEADER
DET.	DETAIL	RWD./R.W.	REDWOOD
DIA. or Ø	DIAMETER	REINF.	REINFORCING
DIM.	DIMENSION	R.O.D.	ROUND ROD
D.A.	DISABLED ACCESS	R.A.G.	RETURN AIR GRILLE
DR.	DOOR	R.E.	RAIN ELEVATION
D.S.	DOWNSPOUT	R.O.D.R.	ROUND ROD
DWG.	DRAWING	R.M.	ROOM
D.F.	DRINKING FOUNTAIN and/or DRUGLAS FIR	R.O.	ROUGH OPENING
EA.	EACH	RND.	ROUND
E.W.	EACH WAY	R.H.M.S.	ROUND HEAD METAL SCREW
ELEC.	ELECTRIC	R.H.W.S.	ROUND HEAD WOOD SCREW
EL. or ELEV.	ELEVATION	SSD.	SEE STRUCTURAL DRAWINGS
ENCL.	ENCLOSE and/or ENCLOSURE	S.T.S.M.S.	SELF TAPPING SHEET METAL SCREW
EQ.	EQUAL	SHEATH.	SHEATHING
EQUIP.	EQUIPMENT	S.M.	SHEET METAL SCREW
(E)	EXISTING	S.O.V.	SHUT OFF VALVE
EX.	EXPANSION	SIM.	SIMILAR
EXP.	EXPANDED	S.C.	SOLID CORE
EXT.	EXTERIOR	SPEC.	SPECIFICATION
F.O.C.	FACE OF CONCRETE	SQ.	SQUARE
F.O.M.	FACE OF MASONRY	SQ. FEET	SQUARE FEET
F.O.S.	FACE OF STUD	STAG.	STAGGERED
F.O.F.	FACE OF FINISH	STD.	STANDARD
FIN.	FINISH	STAINLESS STEEL	STAINLESS STEEL
F.F.	FINISHED FLOOR	STL.	STEEL
F.S.	FINISH SLAB	STOR.	STORAGE
F.E.	FIRE EXTINGUISHER	STRUC.	STRUCTURAL
F.E.C.	FIRE EXTINGUISHER CABINET	S.A.G.	SUPPLY AIR GRILLE
F.H.S.	FIRE HYDRANT	THRES.	THRESHOLD
F.H.W.S.	FLAT HEAD METAL SCREW	T&G	TONGUE & GROOVE
FL. or FLR.	FLOOR	T.J.	TOOLED JOINT
F.D.	FLOOR DRAIN	T.O.B.	TOP OF BEAM
FTG.	FOOTING	T.O.C.	TOP OF CURB OR CONCRETE
G.A.	GAUGE	T.O.S.	TOP OF STEEL OR SHEATHING
GALV.	GALVANIZED	T.O.W.	TOP OF WALK
G.I.	GALVANIZED IRON	TYP.	TYPICAL
GL.	GLASS	U.O.N.	UNLESS OTHERWISE NOTED
GLU-LAM	GLUE-LAMINATED	U.O.S.	UNLESS OTHERWISE SHOWN
GRD.	GRADE	V.R.	VERTICAL THROUGH ROOF
GRD.	GRADE	VERT.	VERTICAL
GYP. BD.	GYP. BOARD	V.G.	VERTICAL GRAIN
HDW.	HARDWARE	V.I.F.	VERIFY IN FIELD
HT.	HEIGHT	V.C.T.	VINYL COMPOSITION TILE
H.C.	HOLLOW CORE	V.V.C.	VINYL WALL COVERING
H.M.	HOLLOW METAL	V.O.I.P.	VOICE OVER INTERNET PROTOCOL
HORIZ.	HORIZONTAL	W.C.	WATER CLOSET
H.B.	HOLE BORE	W.H.	WATER HEATER
I.D.	INSIDE DIAMETER	WP.	WATERPROOF
INSUL.	INSULATION	WR.	WATER RESISTANT
INT.	INTERIOR	W.W.M.	WELDED WIRE MESH
INV.	INVERT	W.D.	WINDOW DIMENSION
JT.	JOINT	W.	WITH
J.H.	JOIST HANGER	W/O.	WITHOUT
K.D.	KILN DRIED	WD.	WOOD

BUILDING CODES AND STANDARDS:

2019	CALIFORNIA ADMINISTRATIVE CODE, PART 1, TITLE 24, C.C.R.	
2019	CALIFORNIA BUILDING CODE (CBC), PART 2, TITLE 24, C.C.R.	
2019	INTERNATIONAL BUILDING CODE, VOLUMES 1 AND 2, WITH 2019 CALIFORNIA AMENDMENTS.	
2019	CALIFORNIA ELECTRIC CODE (CEC), PART 3, TITLE 24, C.C.R.	
2019	NATIONAL ELECTRIC CODE WITH 2019 CALIFORNIA AMENDMENTS.	
2019	CALIFORNIA MECHANICAL CODE (CMC), PART 4, TITLE 24, C.C.R.	
2019	UNIFORM MECHANICAL CODE WITH 2019 CALIFORNIA AMENDMENTS.	
2019	CALIFORNIA PLUMBING CODE (CPC), PART 5, TITLE 24, C.C.R.	
2019	UNIFORM PLUMBING CODE WITH 2019 CALIFORNIA AMENDMENTS.	
2019	CALIFORNIA FIRE CODE (CFC), PART 9, TITLE 24, C.C.R.	
2019	INTERNATIONAL FIRE CODE WITH 2019 CALIFORNIA AMENDMENTS.	
2019	CALIFORNIA GREEN BUILDING STANDARDS CODE, PART 11, TITLE 24, C.C.R.	
2019	CALIFORNIA REFERENCED STANDARDS, PART 12, TITLE 24, C.C.R.	
2019	ASME A17.1 (W/AT 1) (ASCSA B44a-09 ADDENDA) SAFETY CODE FOR ELEVATORS AND ESCALATORS	
2010	ADA STANDARDS FOR ACCESSIBLE DESIGN (28 CFR PART 36 FOR TITLE II ENTITIES)	
	CCR TITLE-19, PUBLIC SAFETY, STATE FIRE MARSHAL REGULATIONS.	
NFPA 13	INSTALLATION OF SPRINKLER SYSTEMS (CA AMENDED)	2017 EDITION
NFPA 14	INSTALLATION OF STANDPIPE & HOSE SYSTEMS (CA AMENDED)	2017 EDITION
NFPA 17	DRY CHEMICAL EXTINGUISHING SYSTEMS	2017 EDITION
NFPA 17A	WET CHEMICAL EXTINGUISHING SYSTEM	2017 EDITION
NFPA 20	STATIONARY FIRE PUMPS FOR FIRE PROTECTION	2016 EDITION
NFPA 22	WATER TANKS FOR PRIVATE FIRE PROTECTION	2013 EDITION
NFPA 24	PRIVATE FIRE SERVICE MAINS (CA AMENDED)	2016 EDITION
NFPA 25	INSPECTION, TESTING AND MAINTENANCE OF WATER BASED FIRE PROTECTION SYSTEMS (CA AMENDED)	2013 CALIFORNIA EDITION
NFPA 72	NATIONAL FIRE ALARM CODE (CA AMENDED)	2016 EDITION
NFPA 80	FIRE DOORS AND OTHER OPENING PROTECTIVES	2016 EDITION
NFPA 92	STANDARD FOR SMOKE CONTROL SYSTEMS	2012 EDITION
NFPA 110	EMERGENCY AND STANDBY POWER SYSTEMS	2016 EDITION
NFPA 170	STANDARD FOR FIRE SAFETY AND EMERGENCY SYMBOLS	2015 EDITION
NFPA 253	CRITICAL RADIANT FLUX OF FLOOR COVERING SYSTEMS	2006 EDITION
NFPA 2001	CLEAN AGENT FIRE EXTINGUISHING SYSTEMS	2015 EDITION
ICC 300	STANDARDS FOR BLEACHERS, FOLDING AND TELESCOPIC SEATING, AND GRANDSTANDS	2017 EDITION
SFM 12-10-1	POWER OPERATED EXIT DOORS	1999/2005 EDITION
SFM 12-10-2	SINGLE POINT LATCHING OR LOCKING DEVICES	2009 EDITION
SFM 12-10-3	EMERGENCY EXIT & PANIC HARDWARE	2005 (R2010)
UL 268A	SMOKE DETECTORS DUCT APPLICATIONS	1998/2003 EDITION
UL 500	FIRE TESTING OF FIRE EXTINGUISHING SYSTEMS FOR PROTECTION OF COMMERCIAL COOKING EQUIPMENT	2005 (R2010)
UL 305	PANIC HARDWARE	2012 EDITION
UL 464	AUDIBLE SIGNALING DEVICES FOR FIRE ALARM AND SIGNALING SYSTEMS, AND ACCESSORIES	2003 EDITION
UL 521	HEAT DETECTORS FOR FIRE PROTECTIVE SIGNALING SYSTEMS	1999 EDITION
UL 864	CONTROL UNITS FOR FIRE PROTECTIVE SIGNALING SYSTEMS	2003 EDITION
UL 1971	AVOID REVISIONS THROUGH JULY 14, 2005) SIGNALING DEVICES FOR THE HEARING IMPAIRED	2002 EDITION
	COMPLIANCE WITH CFC CHAPTER 33, FIRE SAFETY DURING CONSTRUCTION AND DEMOLITION AND CBC CHAPTER 33, SAFETY DURING CONSTRUCTION WILL BE ENFORCED.	

SYMBOLS LEGEND

	SECTION / EXTERIOR ELEVATION
	DETAIL IDENTIFICATION SHEET WHERE DETAIL IS DRAWN
	INTERIOR ELEVATION INDICATES ELEVATION SHOWN SHEET WHERE ELEVATION IS DRAWN
	CLASSROOM ROOM IDENTIFICATION ROOM NUMBER
	SPECIFIC NOTE
	DOOR DESIGNATION
	WINDOW DESIGNATION
	ADDENDUM REVISION CLOUD AROUND REVISION
	CCD REVISION CLOUD AROUND REVISION
	FINISH NUMBER SEE SPECS AND I.E. DWGS.
	EQUIPMENT LETTER SEE EQUIPMENT SCHEDULE
	CEILING HEIGHT
	WALL TYPE
	MATCH LINE
	ELEV. HEIGHT
	F.O.S., U.O.N.
	FACE OF FINISH

PROJECT SUMMARY

INSTALLATION OF A NEW (1) METAL SHADE STRUCTURE PC #04-117117, 1920 SQ. FT. TOTAL AREA, AND ASSOCIATED SITE WORK.

THERE ARE NO DEFERRED SUBMITTALS FOR THIS PROJECT.

DESIGN TEAM

ARCHITECT
SUGIMURA FINNEY ARCHITECTS
2155 SOUTH BASCOM AVENUE SUITE 200
CAMPBELL, CALIFORNIA 95008
(408) 879-0600
(408) 377-0606 FAX
ATTN: MARK FINNEY MARK@SUGIMURA.COM

DRAWING INDEX

T1	TITLE SHEET
T2	SITE PLAN - FIRE LIFE SAFETY & ACCESS COMPLIANCE WORK
ARCHITECTURAL	
A0.1	ENLARGED DEMOLITION SITE PLAN
A0.2	NEW ENLARGED SITE PLAN
A0.4	SITE DETAILS


SHADE STRUCTURE MANUFACTURER'S DRAWINGS DSA #04-117117

S-1	COVER SHEET
S-2	GENERAL DATA
S-3	GENERAL NOTES
S-4	SAMPLE DSA 103 FORMS
S-5	SECTIONS PROPERTIES & REBAR DETAILS
S-6	VC 14, VC 18, & VC 20 FRAMING PLAN & ELEVATIONS
S-7	VC 14, VC 18, & VC 20 FRAMING SCHEDULES
S-8	VC 140, VC 180, & VC 200 FRAMING PLAN & ELEVATIONS
S-9	VC 140, VC 180, & VC 200 FRAMING SCHEDULES
S-10	PIER FOUNDATION AND SPREAD FOOTINGS SCHEDULES
S-11	STANDARD DETAILS 1
S-12	STANDARD DETAILS 2
S-13	SAMPLE ARCHITECTURAL ELEVATIONS

ACCESS REFERENCE DRAWINGS

A105	BUILDING E & F FLOOR PLANS DSA #01-115309
A302	ENLARGED RESTROOM PLANS AND PHOTOS DSA #01-115309

VICINITY MAP

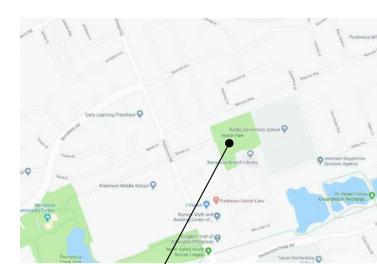

PROJECT LOCATION

STATEMENT OF GENERAL CONFORMANCE

FOR ARCHITECTS / ENGINEERS WHO UTILIZE PLANS, INCLUDING BUT NOT LIMITED TO SHOP DRAWINGS, PREPARED BY OTHER LICENSED DESIGN PROFESSIONALS AND / OR OTHER CONSULTANTS

APPLICATION NO.: 01-118981 FILE NO.: 43-7
 THE DRAWINGS OR SHEETS LISTED ON THE COVER OR INDEX SHEET (*)
 THIS DRAWING, PAGE OF SPECIFICATIONS / CALCULATIONS.

HAVE BEEN PREPARED BY OTHER DESIGN PROFESSIONALS OR CONSULTANTS WHO ARE LICENSED AND / OR AUTHORIZED TO PREPARE SUCH DRAWINGS IN THIS STATE. IT HAS BEEN EX

TOTAL 'E' OCCUPANCY BUILDINGS WITH OCCUPANTS = 18,912
18,912 SF @ 20 SF/OCC = 945 OCCUPANTS

TOTAL 'B' OCCUPANCY BUILDINGS WITH OCCUPANTS = 9,028
9,028 SF @ 100 SF/OCC = 90 OCCUPANTS

TOTAL 'F-1' OCCUPANCY BUILDINGS WITH OCCUPANTS = 5,154
5,154 SF @ 300 SF/OCC = 17 OCCUPANTS

TOTAL OCCUPANTS = 945 + 90 + 17 = 1,052

MINIMUM DISPERSAL AREA REQUIRED: OCCUPANTS x 5 SF/OCC
1,052 x 5 SF = 5,260 SF
AREA PROVIDED = 5,600 SF THEREFORE OK.

DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE STATEMENT:

THE PATH OF TRAVEL IDENTIFIED IN THESE CONSTRUCTION DOCUMENTS IS COMPLIANT WITH THE CURRENT APPLICABLE CALIFORNIA BUILDING CODE ACCESSIBILITY PROVISIONS FOR PATH OF TRAVEL REQUIREMENT FOR ALTERATIONS, ADDITIONS AND STRUCTURAL REPAIRS. AS PART OF THE DESIGN OF THIS PROJECT, THE P.O.T. WAS EXAMINED AND ANY ELEMENTS, COMPONENTS OR PORTIONS OF THE P.O.T. THAT WERE DETERMINED TO BE NONCOMPLIANT 1) HAVE BEEN IDENTIFIED AND 2) THE CORRECTIVE WORK NECESSARY TO BRING THEM INTO COMPLIANCE HAS BEEN INCLUDED WITHIN THE SCOPE OF THIS PROJECT'S WORK THROUGH DETAILS, DRAWINGS, AND SPECIFICATIONS INCORPORATED INTO THESE CONSTRUCTION DOCUMENTS. ANY NONCOMPLIANT ELEMENTS, COMPONENTS OR PORTIONS OF THE P.O.T. THAT WILL NOT BE CORRECTED BY THIS PROJECT BASED ON VALUATION THRESHOLD LIMITATIONS OR A FINDING OF UNREASONABLE HARDSHIP ARE SO INDICATED IN THESE CONSTRUCTION DOCUMENTS.

DURING CONSTRUCTION, IF P.O.T. ITEMS WITHIN THE SCOPE OF THIS PROJECT REPRESENTED AS CODE COMPLIANT ARE FOUND TO BE NONCONFORMING BEYOND REASONABLE CONSTRUCTION TOLERANCES, THEY SHALL BE BROUGHT INTO COMPLIANCE WITH THE CBC AS A PART OF THIS PROJECT BY MEANS OF A CONSTRUCTION CHANGE DOCUMENT.

PROJECT SUMMARY

INSTALLATION OF (1) NEW METAL SHADE STRUCTURE PC #04-117117 AND ASSOCIATED SITE WORK.

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 01-118971 INC.
REVIEWED FOR
DATE: 06/10/2020
(DSA STAMP AREA)

SUKHRIYA FINLEY ARCHITECTS
SFA
ARCHITECTS INTERIORS PLANNING
2155 SOUTH BASCOM AVE
SUITE 200
CAMPBELL, CA 95008
PHONE: 408-873-6600
FAX: 408-377-0668

REGISTERED ARCHITECT
SUKHRIYA FINLEY
NO. C24816
STATE OF CALIFORNIA

GENERAL NOTES

- A. THIS SHEET IS FOR ACCESS COMPLIANCE CODE RELATED ITEMS. FOR SCOPE OF WORK SEE SHEETS A0.1 AND A0.2.
- B. REFER TO P.C. DRAWINGS FOR EXTENT OF P.C. WORK.
- C. ACCESSIBLE PATH OF TRAVEL (P.O.T.), AS INDICATED, IS A COMMON BARRIER FREE ACCESS ROUTE WITHOUT ANY ABRUPT VERTICAL CHANGES EXCEEDING A 1/2" BEVELED AT 1:2 MAXIMUM SLOPE, EXCEPT THAT LEVEL CHANGES DO NOT EXCEED 1/4" VERTICAL AND AT LEAST 48" WIDE. THE PATH SURFACE IS SLIP RESISTANT, STABLE, FIRM, AND SMOOTH. PASSING SPACES (118-403.5.3) AT LEAST 60" WIDE ARE LOCATED NOT MORE THAN 200' APART. PARTS OF P.O.T. WITH CONTINUOUS GRADIENTS HAVE 60' LEVEL AREAS (118-403.7) NOT MORE THAN 400' APART. THE CROSS SLOPE DOES NOT EXCEED 2% AND SLOPE IN THE DIRECTION OF TRAVEL AND IS LESS THAN 5% UNLESS OTHERWISE INDICATED. P.O.T. SHALL BE MAINTAINED FREE OF OVERHANGING OBSTRUCTIONS TO 80" MINIMUM (118-307.4) AND PROTRUDING OBJECTS GREATER THAN 4" PROJECTION FROM WALL AND ABOVE 27" AND LESS THAN 80" (118-307.2).
- D. GATES IN THE PATH OF TRAVEL SHALL MEET DOOR REQUIREMENTS PER CBC SECTION 11B-404. ALL GATES TO HAVE ACCESSIBLE HARDWARE AND 10" MIN. SMOOTH BOTTOM OR KICK PLATES. PANIC HARDWARE AND EXIT SIGN MAY BE REQUIRED. COORDINATE WITH FIRE AND LIFE SAFETY.
- E. CONTRACTOR TO VERIFY ALL BARRIERS IN P.O.T. HAVE BEEN REMOVED.
- F. ALL EXTERIOR ENTRANCES AND EXITS IDENTIFIED WITH A TRIANGULAR SYMBOL ON THIS PLAN ARE ACCESSIBLE AND COMPLY WITH CBC 11B-401 AND INCLUDE A 32" CLEAR OPENING, THE REQUIRED STRIKE EDGE CLEARANCE AT PULL SIDE OF DOOR, LEVEL LANDINGS WITH A 2% MAX. SLOPE, AND AN ACCESSIBLE THRESHOLD, HARDWARE, CLOSER AND KICK PLATE.
- G. A DSA CERTIFIED PROJECT INSPECTOR EMPLOYED BY THE DISTRICT (OWNER) AND APPROVED BY THE DSA SHALL PROVIDE CONTINUOUS INSPECTION OF THE WORK. THE DUTIES OF THE INSPECTOR ARE DEFINED IN SECTION 4-342, PART 1, TITLE 24, CCR.
- H. A DSA ACCEPTED TESTING LABORATORY DIRECTLY EMPLOYED BY THE DISTRICT (OWNER) SHALL CONDUCT ALL THE REQUIRED TESTS AND INSPECTIONS FOR THE PROJECT.
- I. GRADING PLANS, DRAINAGE IMPROVEMENTS, ROAD AND ACCESS REQUIREMENTS AND ENVIRONMENTAL HEALTH CONSIDERATIONS SHALL COMPLY WITH ALL LOCAL ORDINANCES.

SITE PLAN - FIRE LIFE SAFETY & ACCESS COMPLIANCE NOTES

1. EXISTING FIRE HYDRANT.
2. EXISTING TOW AWAY SIGN PER DSA #01-115309
3. (E) DA PARKING STALLS PER DSA #01-115309
4. (E) DA PARKING SIGN PER DSA #01-115309
5. (E) ACCESSIBLE DRINKING FOUNTAIN PER DSA #01-115309
6. (E) ACCESSIBLE BOYS RESTROOMS PER DSA #01-115309, SEE REFERENCE DRAWINGS
7. (E) ACCESSIBLE GIRLS RESTROOMS PER DSA #01-115309, SEE REFERENCE DRAWINGS
8. (E) ACCESSIBLE MEN'S RESTROOMS PER DSA #01-115309, SEE REFERENCE DRAWINGS
9. (E) ACCESSIBLE WOMEN'S RESTROOMS PER DSA #01-115309, SEE REFERENCE DRAWINGS
10. (N) METAL SHADE STRUCTURE PC #04-117117, SEE MANUFACTURER'S DRAWINGS.

DSA 810 FIRE & LIFE SAFETY SITE CONDITIONS SUBMITTAL

To facilitate the Division of the State Architect's (DSA) fire and life safety plan review of project site conditions, DSA requires the design professional to provide the following information at time of project submittal for projects consisting of construction of a new campus, construction of new buildings(s), additions to existing buildings, and for site alternate design means for fire department emergency vehicle access, and fire suppression water supply.


Information associated with compliance items 1-3 below is to be provided for all project types indicated above. Information associated with items 4-7 is to be completed when an alternate means is utilized. Acknowledgement by the school district and signature from the local fire authority (LFA) is only required when an alternate design means is being requested.

Page 1 of the completed form must be imaged onto the fire access site plan. When an alternate design/means is proposed, completed pages 1 and 2 are to be imaged on the fire access site plan.

For additional information refer to the instructions at the end of this form and [DSA Policy 09-01](#).

PROJECT INFORMATION	
School District/Owner:	BERRYESSA UNION SCHOOL DISTRICT
Project Name/School:	NOBLE ELEMENTARY SCHOOL SHADE STRUCTURES
Project Address:	3466 GROSSMONT AVE., SAN JOSE, CA 95132
FIRE & LIFE SAFETY INFORMATION	
1. Has a fire hydrant flow test been performed within the past 12 months? (If yes, provide a copy of the test data.)	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>
2. Was the fire hydrant water flow test performed as part of this LFA review? (If yes, indicate fire hazard severity zone as established by Cal Fire? (If yes, indicate fire hazard zone classification below) Refer to the following for fire hazard zone locations: www.fire.ca.gov/fire_prevention/fire_prevention_wildland_zones_maps	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> Moderate <input type="checkbox"/> High <input type="checkbox"/> Very High <input type="checkbox"/>
Wildland Interface Area (WIFA) (If any designations are checked, project design must meet the requirements of CBC Chapter 7A.)	WIFA <input type="checkbox"/>
CONDITION MEANS AND METHODS RESOLUTION	
	ALTERNATE ACCEPTED Yes No N/A N/R
4. Emergency vehicle access roadways do not meet CFC requirements.	<input type="checkbox"/> <input type="checkbox"/> <input checked="" type="checkbox"/> <input type="checkbox"/>
4a. Acceptable Alternate: Emergency vehicle and personnel access as proposed by the project architect is acceptable for providing fire suppression and protection of life and property.	<input type="checkbox"/> <input type="checkbox"/> <input checked="" type="checkbox"/> <input type="checkbox"/>
5. Fire Hydrants: Number and spacing does not meet CFC requirements.	<input type="checkbox"/> <input type="checkbox"/> <input checked="" type="checkbox"/> <input type="checkbox"/>
5a. Acceptable Alternate: Number of fire hydrants and spacing as proposed by the project architect is acceptable for fire suppression and protection of life and property.	<input type="checkbox"/> <input type="checkbox"/> <input checked="" type="checkbox"/> <input type="checkbox"/>
6. Fire Hydrants: Water flow and pressure are less than CFC minimum.	<input type="checkbox"/> <input type="checkbox"/> <input checked="" type="checkbox"/> <input type="checkbox"/>
6a. Acceptable Alternate: The available flow and pressure is acceptable for providing fire suppression and protection of life and property.	<input type="checkbox"/> <input type="checkbox"/> <input checked="" type="checkbox"/> <input type="checkbox"/>
7. Location of fire department connection(s) serving fire sprinkler systems or standpipe systems does not meet CFC requirements.	<input type="checkbox"/> <input type="checkbox"/> <input checked="" type="checkbox"/> <input type="checkbox"/>
7a. Acceptable Alternate: The location of fire department connection serving the fire sprinkler system and/or standpipe system is acceptable for providing fire suppression and protection of life and property.	<input type="checkbox"/> <input type="checkbox"/> <input checked="" type="checkbox"/> <input type="checkbox"/>

DSA 810 (rev 10-22-18) Page 1 of 4
DIVISION OF THE STATE ARCHITECT DEPARTMENT OF GENERAL SERVICES STATE OF CALIFORNIA

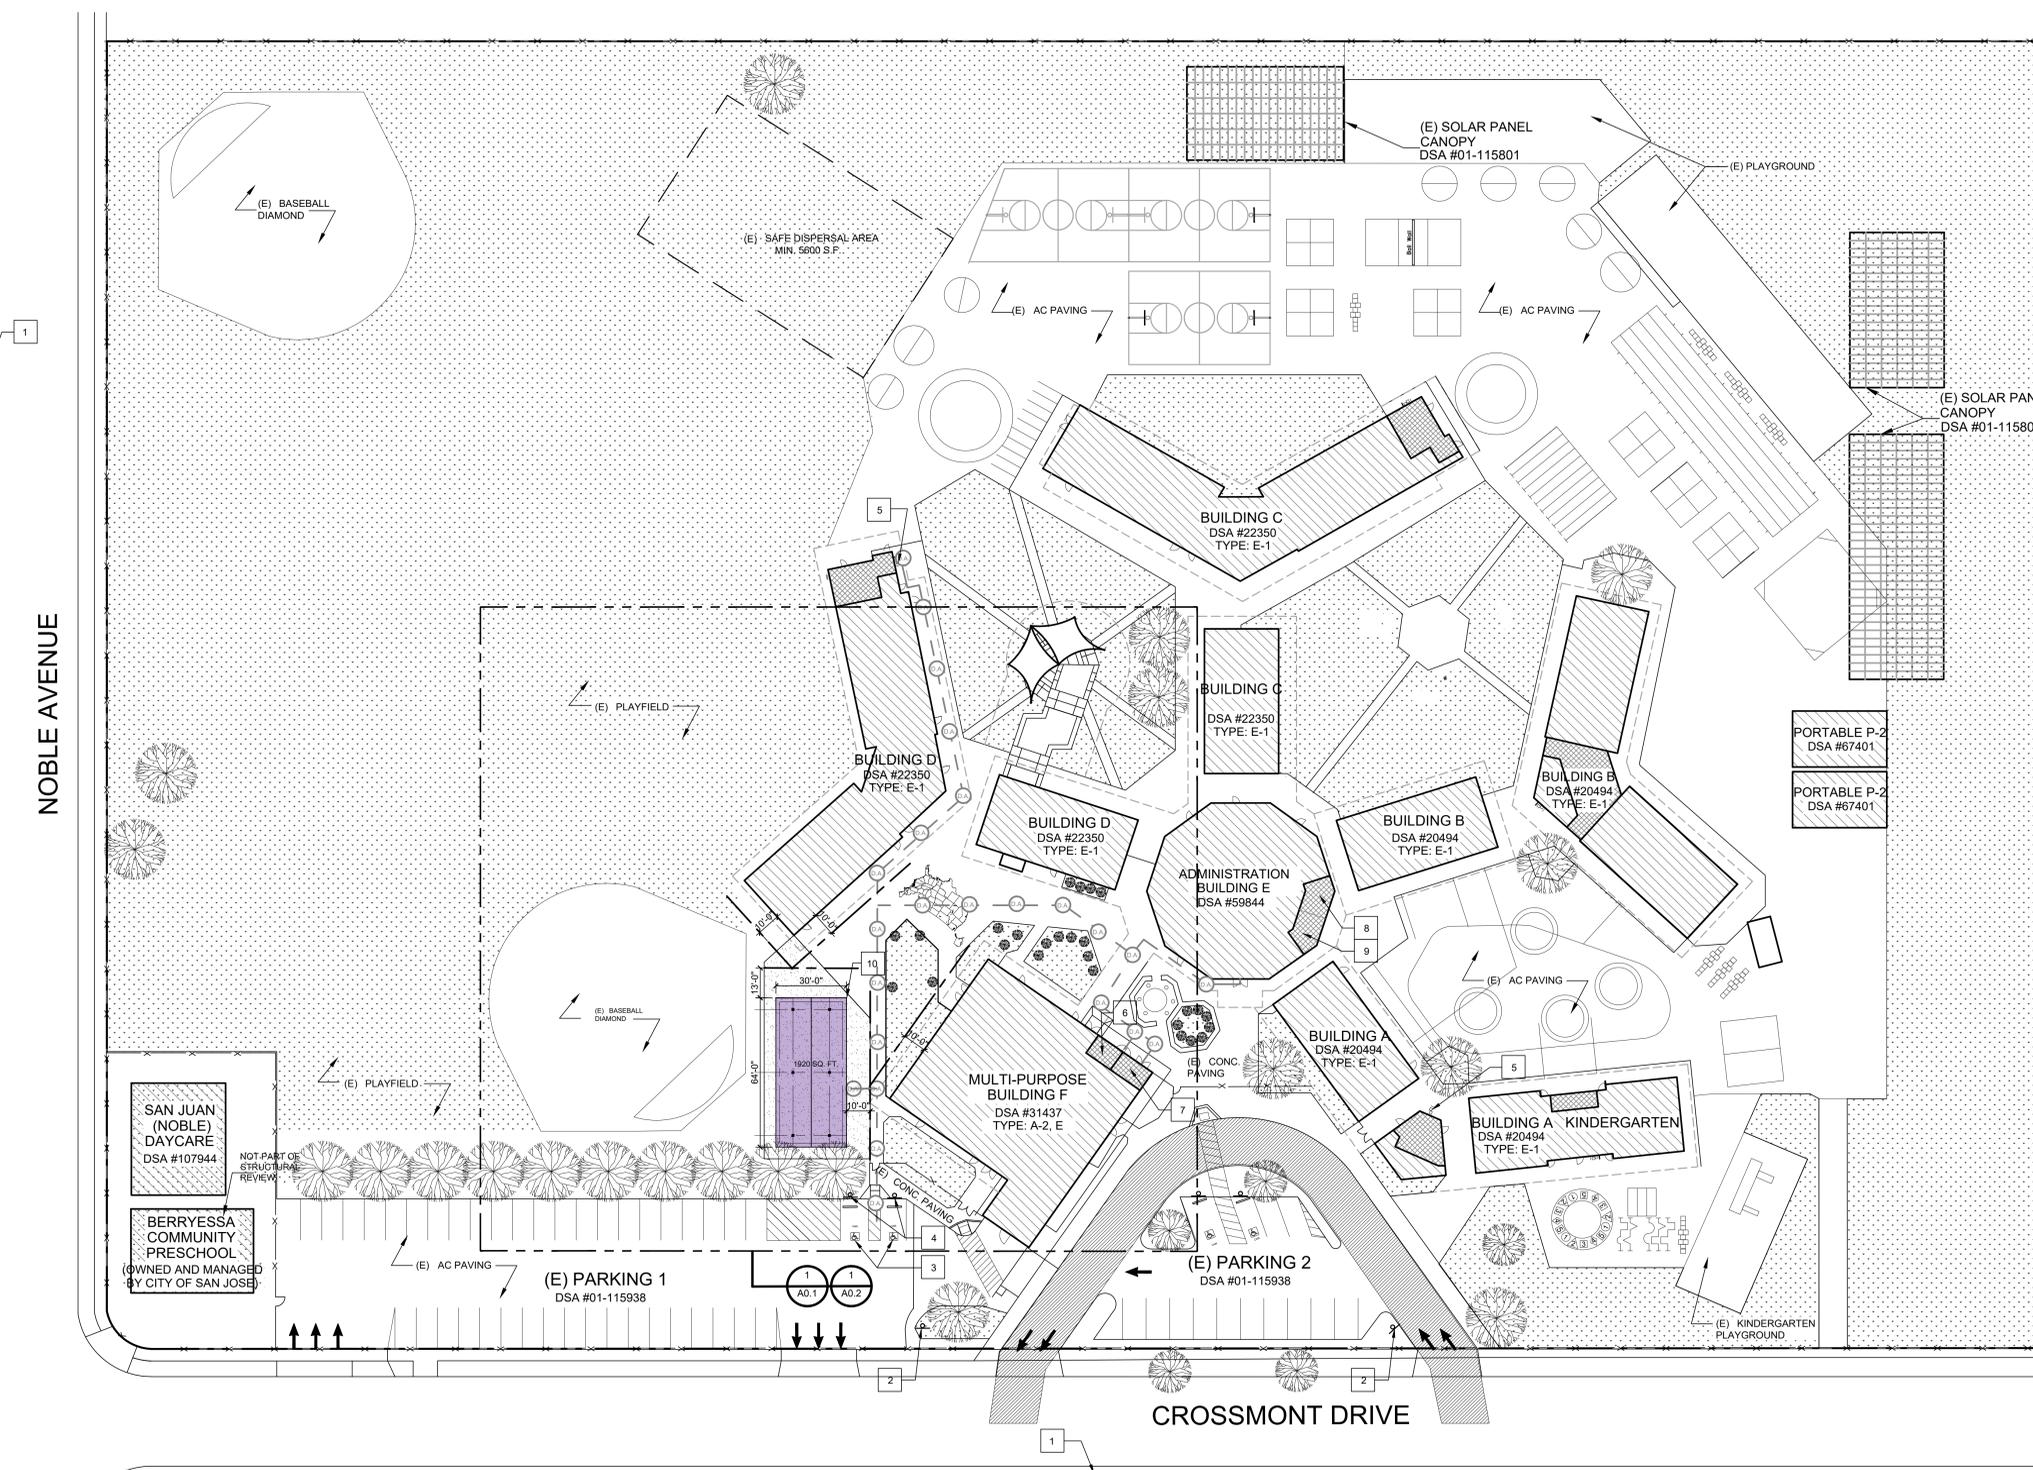


BUILDING CODE ANALYSIS

BUILDING	CONSTRUCTION TYPE OCCUPANCY TYPE	AREA (SQ.FT.)	ALLOWABLE (SQ.FT.)	# OF STORIES
CLASSROOM BUILDING A	V-B / E	5,202	9,500	1
CLASSROOM BUILDING B	V-B / E	6,707	9,500	1
CLASSROOM BUILDING C	V-B / E	5,372	9,500	1
CLASSROOM BUILDING D	V-B / E	7,246	9,500	1
CLASSROOM BUILDING E	V-B / E	4,430	9,500	1
MULTIPURPOSE BLDG. F	V-1 / E / A2	6,553	11,288	1
(N) SHADE STRUCTURE	IIB/A3	1,920	9,500	1

1 SITE PLAN - FIRE LIFE SAFETY & ACCESS COMPLIANCE

OCCUPANT LOAD ANALYSIS:
PER CBC 2019 SECTION 1004 TABLE 1004.5
MULTIPURPOSE BLDG. F: (E) EDUCATIONAL CLASSROOM AREA: 2,183 SQ. FT./20 = 109; (A2) ASSEMBLY WITHOUT FIXED SEATS: 4,370 SQ.FT./874 = 5.0; TOTAL 109 + 874 + 983. SEE REFERENCE DRAWINGS DSA # 01-31437 FOR SPRINKLER SYSTEM INSTALLED.

PARKING COUNT
PER 2019 CBC, TABLE 11B-208.2
(E) PARKING LOT
TOTAL PARKING SPACES (INCLUDING ALL ACCESSIBLE PARKING SPACES) = 73
MINIMUM ACCESSIBLE PARKING SPACES REQUIRED = 3
TOTAL STANDARD ACCESSIBLE SPACES + TOTAL VAN ACCESSIBLE SPACES* PROVIDED = 1 + 3 + 4 THEREFORE, OKAY.
* FOR EVERY SIX STANDARD ACCESSIBLE SPACES REQUIRED, AT LEAST ONE SHALL BE A VAN PARKING SPACE.



GRAPHIC KEY

---	EXISTING PROPERTY LINE	▨	FIRE DEPARTMENT ACCESS
- - -	ASSUMED PROPERTY LINE	▨	FIRE DEPARTMENT ACCESS 8' 20' WIDE AND RATED FOR 90,000 LBS.
○-○	ACCESSIBLE PATH OF TRAVEL	○	(E) DRY STAND PIPE
---	ROOF OVERHANG	⊕	(E) FIRE HYDRANT
---	CHAIN LINK FENCE	⊕	DRINKING FOUNTAIN
---	WOOD FENCE	○	(E) SIGN
---	DECORATIVE FENCE	▨	NEW SHADE STRUCTURE
▨	EXISTING BUILDING		


SITE PLAN
FIRE LIFE SAFETY & ACCESS COMPLIANCE
 SHADE STRUCTURE
 NOBLE ELEMENTARY SCHOOL
 3466 GROSSMONT DR., SAN JOSE, CA 95132
 BERRYESSA UNION SCHOOL DISTRICT

REVISIONS

NO.	ITEM	DATE

DRAWN BY: MK
CHECKED BY: NJ
SFA JOB NO: 19065
DATE: 06/17/2019

T2

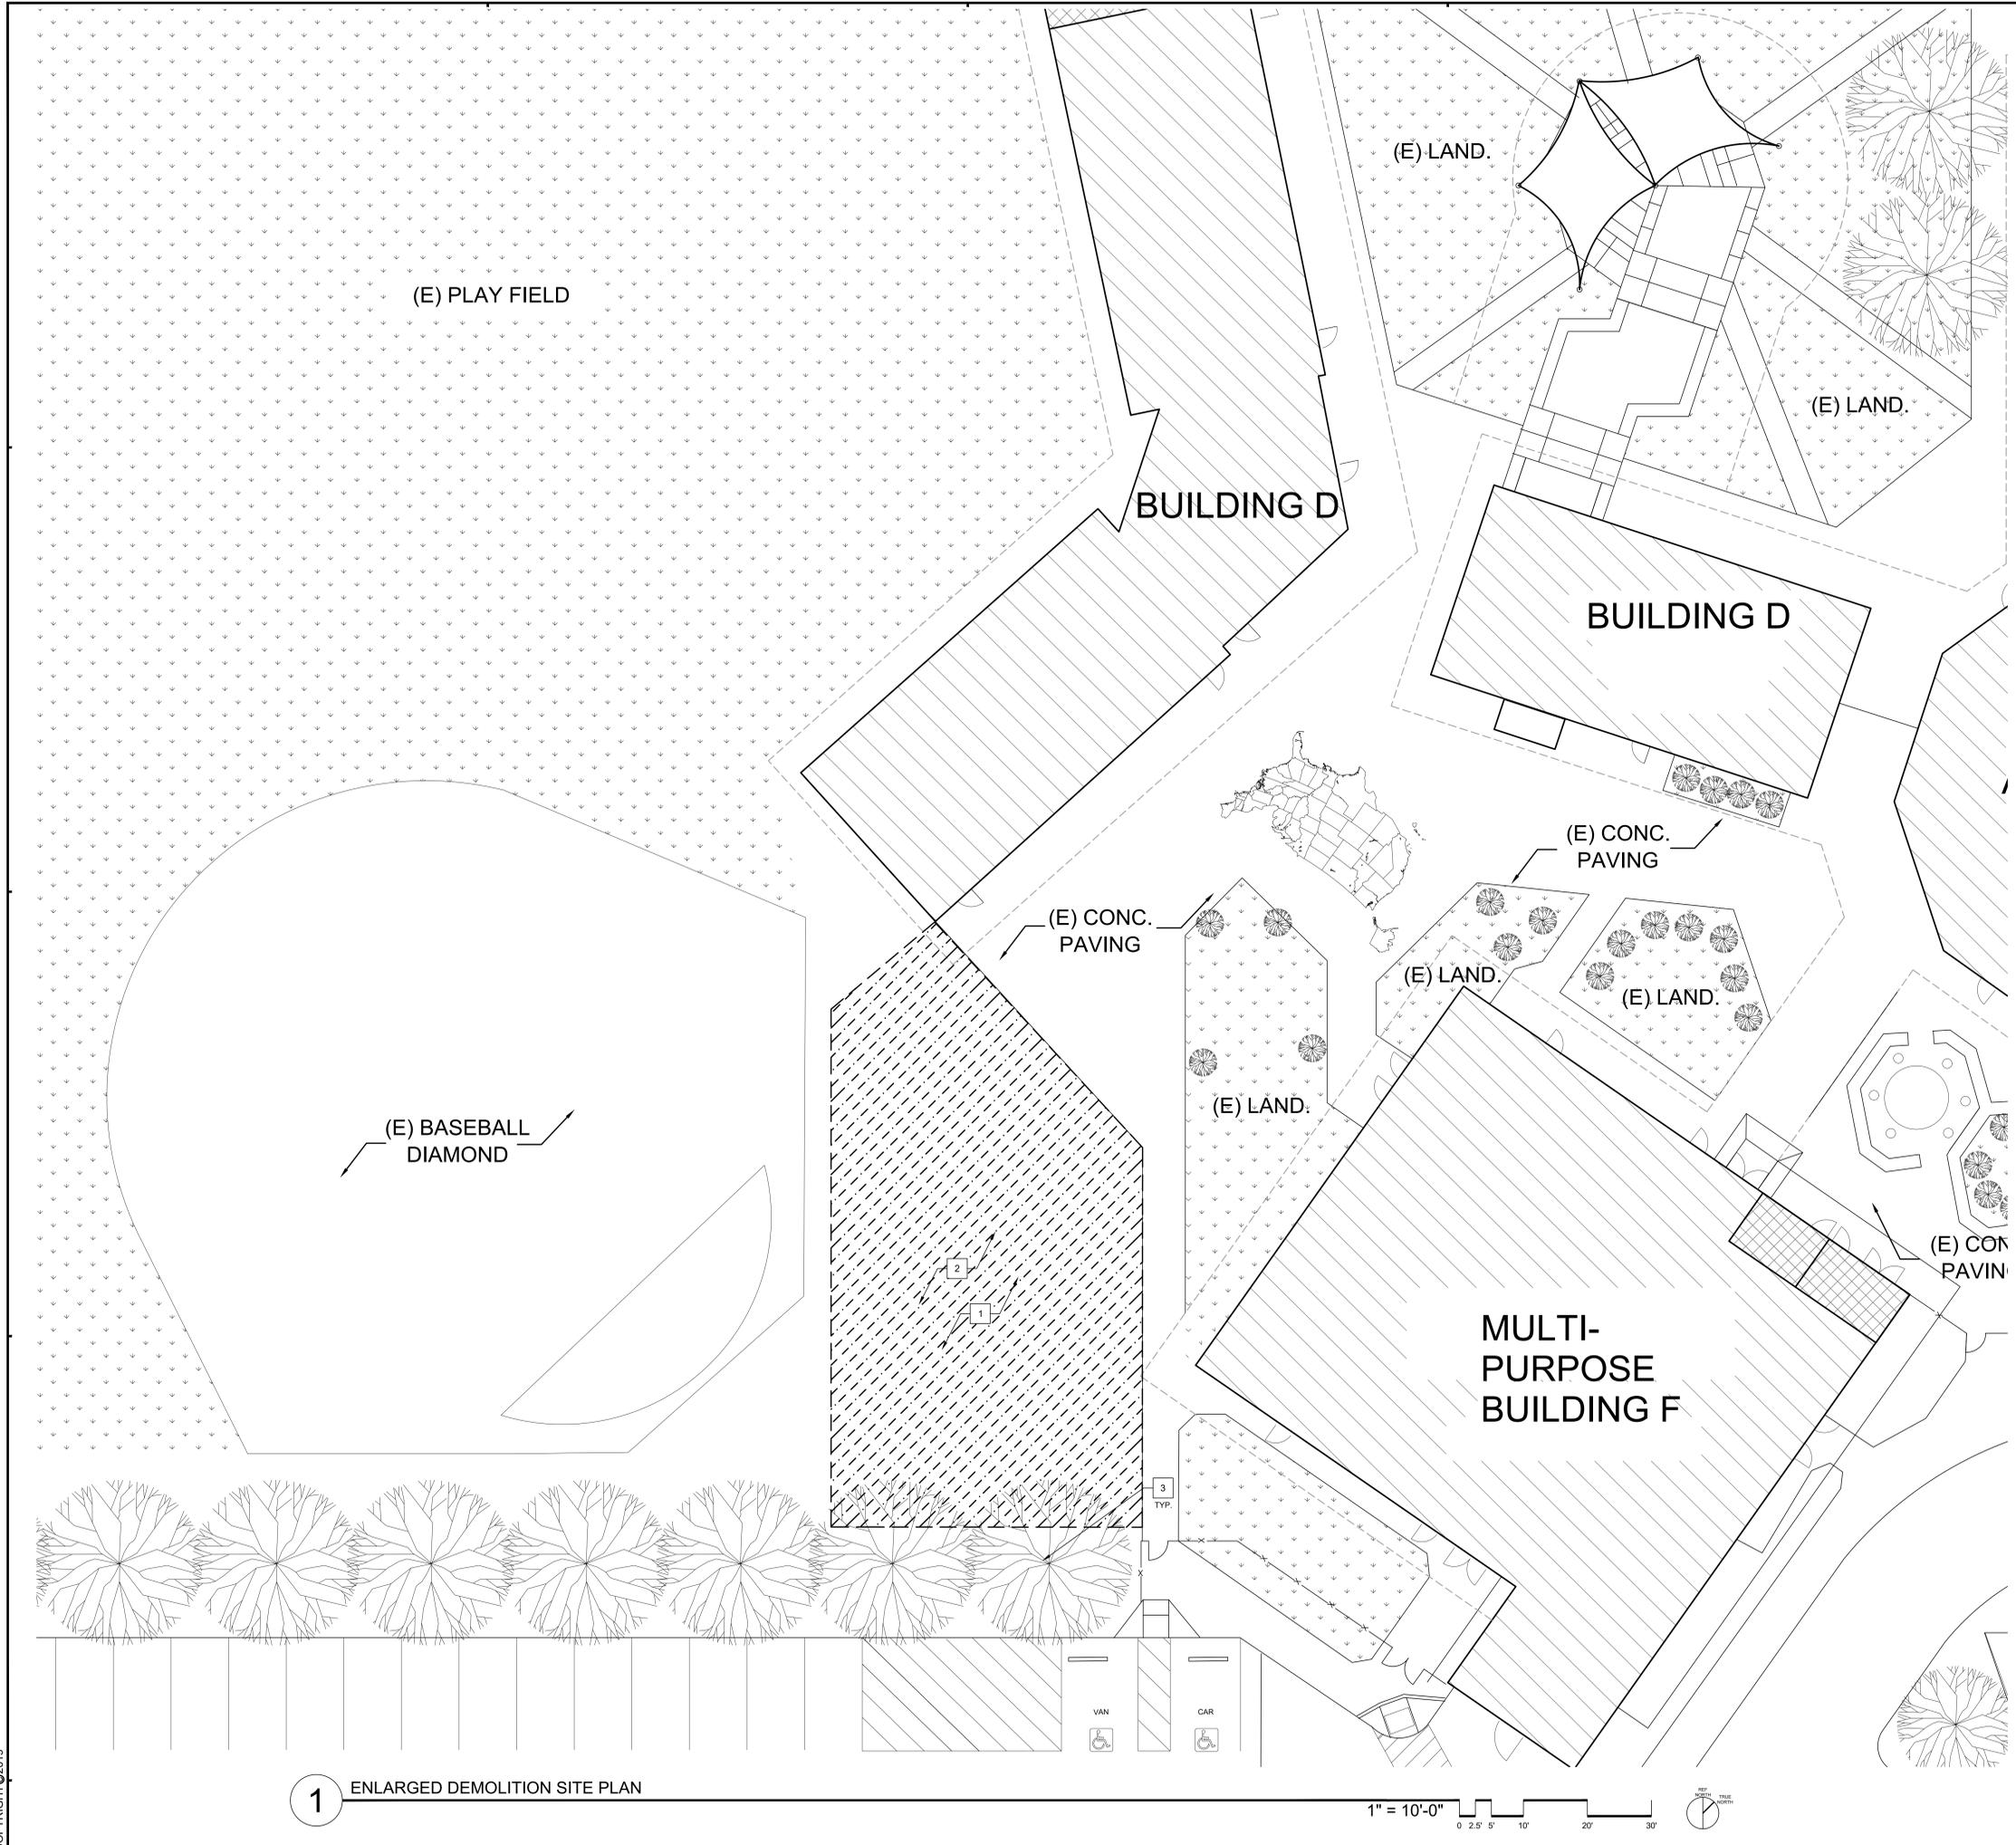

- GENERAL NOTES**
- CONTRACTOR TO REMOVE ALL EXISTING ITEMS TO ALLOW THE NEW WORK, INCLUDING BUT NOT LIMITED TO TREES, SHRUBS, ASPHALT PAVING, FENCING.
 - GENERAL CONTRACTOR SHALL SURVEY THE AREA OF NEW CONSTRUCTION FOR UNDERGROUND UTILITIES PRIOR TO THE BEGINNING OF CONSTRUCTION, AND REROUTE/CAP ALL EXISTING UTILITIES RUNNING BELOW THE AREA OF THE NEW SHADE STRUCTURES IF IT CONFLICTS WITH NEW SHADE STRUCTURE FOOTING.
 - THE CONTRACTOR SHALL EXPOSE AND VERIFY LOCATION AND ELEVATION OF EXISTING UTILITIES, INCLUDING SANITARY AND STORM SEWERS, AND WATER LINES PRIOR TO STARTING CONSTRUCTION.
 - ALL UTILITIES TO BE ABANDONED SHALL BE REMOVED IN THEIR ENTIRETY, AND WIRING PULLED BACK TO SOURCE.
 - REQUIRED UTILITY SHUTDOWNS SHALL BE REQUESTED 72 HOURS IN ADVANCE WITH ARCHITECT AND OWNER.
 - CONTRACTOR TO PROVIDE AND MAINTAIN IN PROPER CONDITION TEMPORARY FENCING PER DETAIL 1/A0.4 PRIOR TO START OF THE CONSTRUCTION AND DURING ALL THE CONSTRUCTION PERIOD. TEMPORARY FENCING TO BE INSTALLED ALONG THE PERIMETER OF WORK AREA.
 - DEMOLITION WORK SHALL CONFORM TO CALIFORNIA GREEN CODE SECTION 5.408.3 & 5.408.4, AND LOCAL CONSTRUCTION WASTE MANAGEMENT REQUIREMENTS.

- DEMOLITION SITE PLAN NOTES**
- CLEAR AND GRUB, PREPARE FOR NEW AC PAVING. REMOVE ANY (E) TREES OR SHRUBS, GRASS, TREE STUMP AND ROOTS, FILL TRENCH WITH DIRT, COMPACT SOIL, AND GRADE AS REQUIRED SEE SHEET A0.2 FOR SCOPE OF NEW ASPHALT PAVING LIMITS.
 - CONTRACTOR SHALL CAP/RELOCATE EXISTING IRRIGATION LINES WHERE NECESSARY SO THAT THE REMAINING IRRIGATION SYSTEM WILL CONTINUE TO BE OPERATIONAL FOR THE EXISTING LANDSCAPE TO REMAIN.
 - EXISTING TREES TO REMAIN.

GRAPHIC KEY

	EXISTING PROPERTY LINE
	ROOF OVERHANG
	CHAINLINK FENCE
	WOOD FENCE
	DECORATIVE FENCE
	EXISTING BUILDING
	EXISTING RESTROOMS
	AREA OF DEMOLITION- LANDSCAPING/PAVING TO BE REMOVED

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 01-118971 INC.
REVIEWED FOR
SS FLS ACS
DATE: 06/10/2020
(DSA STAMP AREA)

SUGIMURA FINNEY ARCHITECTS
SFA
ARCHITECTURE INTERIORS PLANNING
2105 SOUTH BASCOM AVE.
SUITE 209
CAMPBELL, CA 95008
PHONE: 408-878-6000
FAX: 408-377-6559



ENLARGED DEMOLITION SITE PLAN


SHADE STRUCTURE
NOBLE ELEMENTARY SCHOOL
3466 GROSSMONT DR., SAN JOSE, CA 95132
BERRYESSA UNION SCHOOL DISTRICT



REVISIONS NO.	ITEM	DATE

DRAWN BY: MK
CHECKED BY: NJ
SFA JOB NO: 19065
DATE: 06/17/2019


A0.1

1 ENLARGED DEMOLITION SITE PLAN




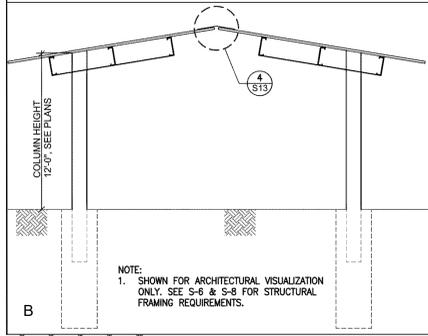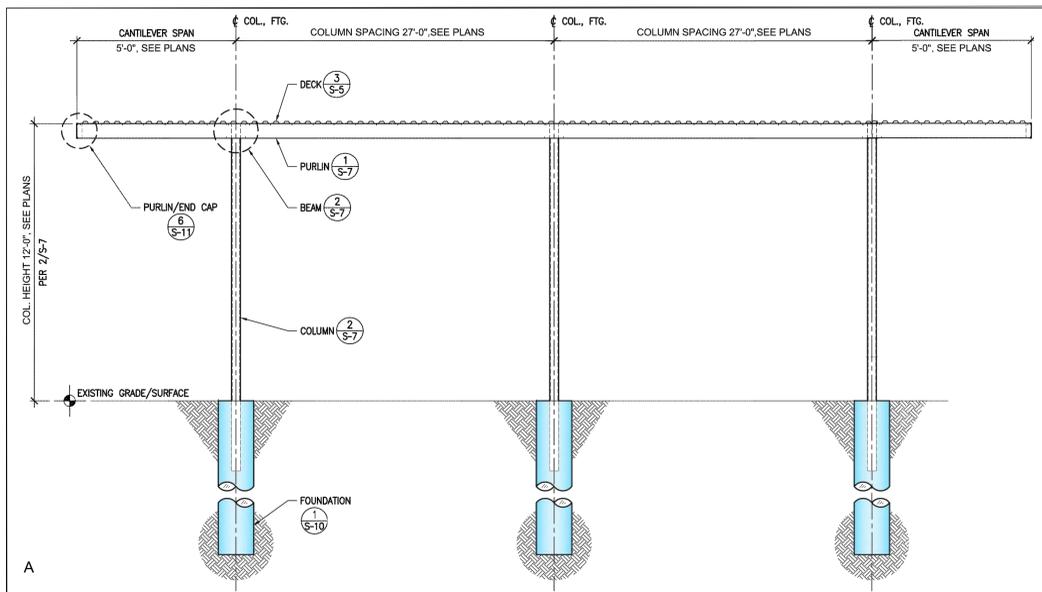

2 (N) SHADE STRUCTURE ELEVATIONS

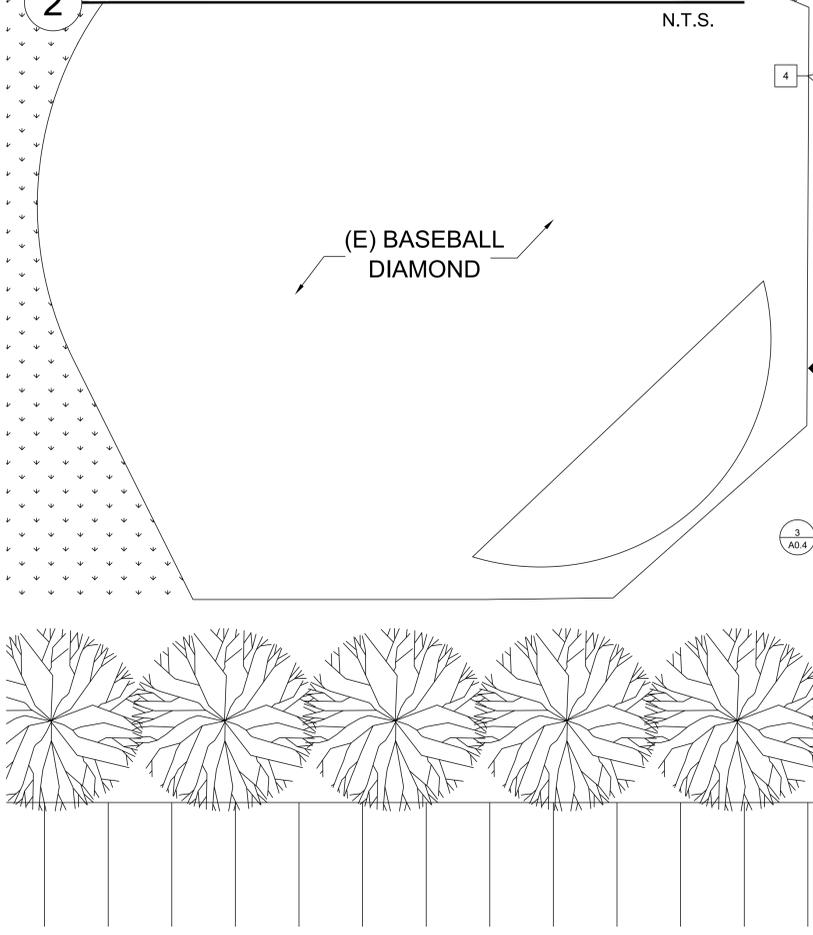

1 NEW ENLARGED SITE PLAN

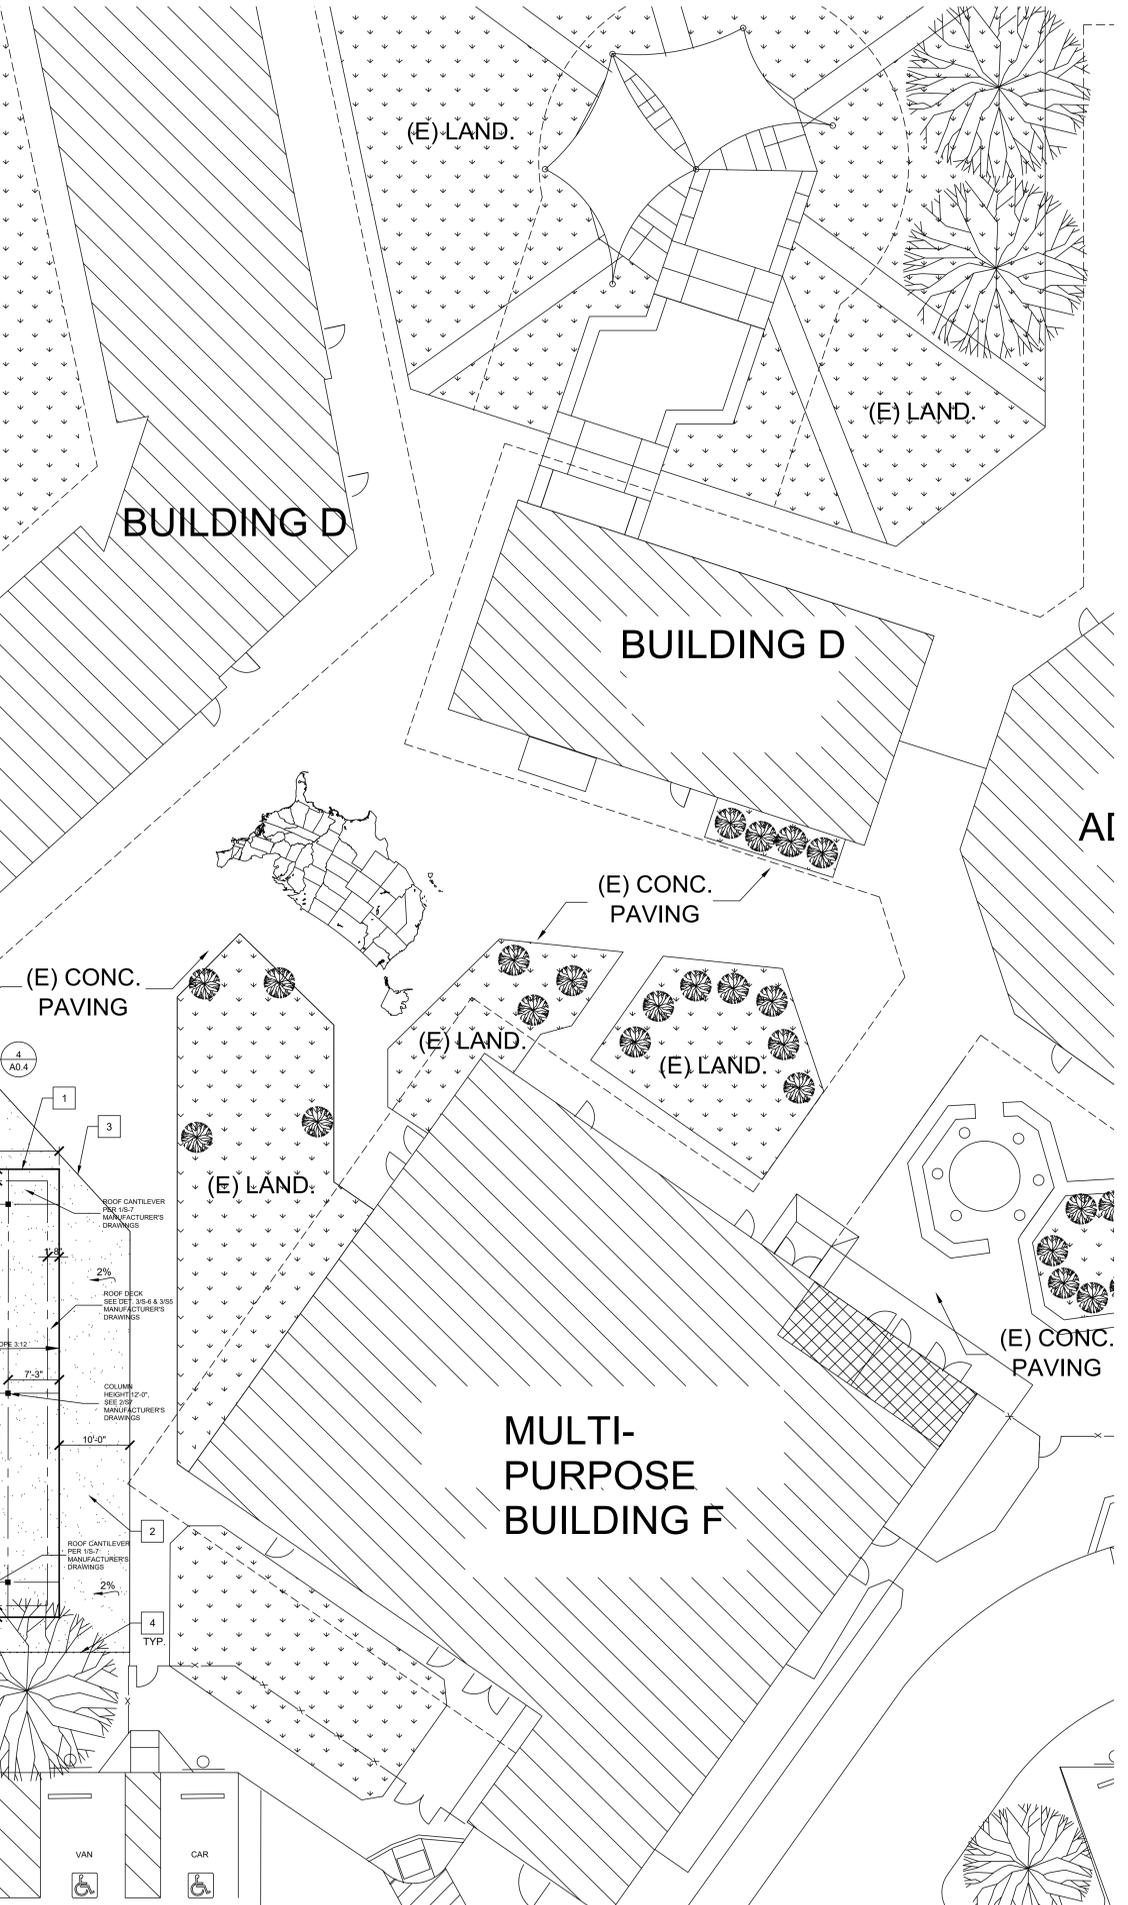

1" = 10'-0"

GENERAL NOTES

- A. CONTRACTOR TO VERIFY ALL BARRIERS IN P.O.T. HAVE BEEN REMOVED.
- B. GENERAL CONTRACTOR SHALL SURVEY THE AREA OF NEW CONSTRUCTION FOR UNDERGROUND UTILITIES PRIOR TO THE BEGINNING OF CONSTRUCTION, AND REROUTE/CAP ALL EXISTING UTILITIES RUNNING BELOW THE AREA OF THE NEW SHADE STRUCTURES IF IT CONFLICTS WITH NEW SHADE STRUCTURE FOOTING.
- C. REFER TO SHADE STRUCTURES MANUFACTURER'S DRAWINGS FOR CONC. FOOTINGS DESIGN REQUIREMENTS.
- D. NEW SHADE STRUCTURES IS O.F.C.I., GENERAL CONTRACTOR RESPONSIBLE FOR THE FOUNDATION AND INSTALLATION/COORDINATION OF THE PRE-MANUFACTURED SHADE STRUCTURE.
- E. CONTRACTOR TO BACKFILL TRENCHES AND PATCH (E) PAVING AS REQUIRED TO MATCH EXISTING PAVING.
- K. PROVIDE TEMPORARY FENCING DURING CONSTRUCTION, SEE DETAIL 1/A0.4.
- H. TIE IN (N) SHADE STRUCTURE DOWNSPOUTS TO THE NEAREST CLEAN OUT.

NEW SITE PLAN NOTES


- 1 NEW SHADE STRUCTURE PC # 04-117117 MANUFACTURER'S DRAWINGS.
- 2 NEW ASPHALT PAVING, SEE DETAIL 2/A0.4.
- 3 EDGE OF (E) CONCRETE PAVING TO CONFORM WITH ADJACENT (N) AC PAVING, SEE DETAIL 4/A0.4.
- 4 NEW HEADERBOARD PERIMETER, SEE DETAIL 3/A0.4.

GRAPHIC KEY

- - - - - EXISTING PROPERTY LINE
- - - - - ROOF OVERHANG
- - - - - CHAINLINK FENCE
- - - - - WOOD FENCE
- - - - - DECORATIVE FENCE
- [Symbol] NEW SHADE STRUCTURE
- [Symbol] NEW ASPHALT PAVING
- [Symbol] EXISTING BUILDING
- [Symbol] EXISTING RESTROOMS
- [Symbol] (E) DRY STAND PIPE
- [Symbol] DRINKING FOUNTAIN
- [Symbol] (E) FIRE HYDRANT
- [Symbol] (E) SIGN
- [Symbol] (E) MENS TOILET ROOM
- [Symbol] (E) WOMENS TOILET ROOM
- [Symbol] (E) GIRLS TOILET ROOM
- [Symbol] (E) BOYS TOILET ROOM
- [Symbol] (E) UNISEX TOILET ROOM
- [Symbol] (E) KINDERGARTEN TOILET ROOM

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 01-118971 INC.
REVIEWED FOR
SS FLS ACS
DATE: 06/10/2020
(SEA STAMP AREA)


SUGIMURA FINNEY ARCHITECTS
SFA
ARCHITECTURE INTERIORS PLANNING
2155 SOUTH BASCOM AVE.
SUITE 209
CAMPBELL, CA 95005
PHONE: 408.379.2609
FAX: 408.377.4966




NEW ENLARGED SITE PLAN
SHADE STRUCTURE
NOBLE ELEMENTARY SCHOOL
3466 GROSSMONT DR., SAN JOSE, CA 95132
BERRYESSA UNION SCHOOL DISTRICT

NO.	ITEM	DATE


DRAWN BY: MK
CHECKED BY: NJ
SFA JOB NO: 19065
DATE: 06/17/2019

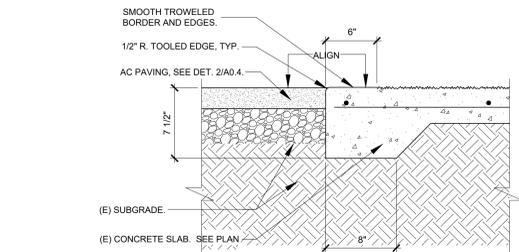


4 ASPHALT / CONCRETE JOINT
 1-1/2"=1'-0"

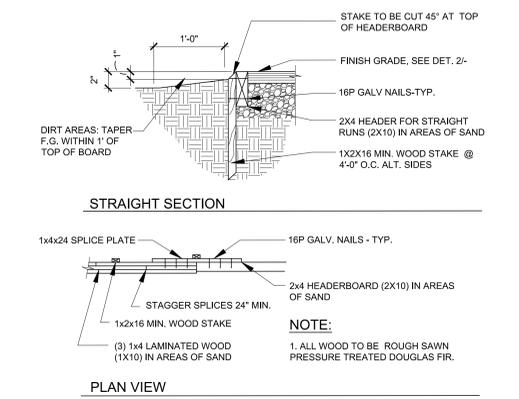


3 WOOD HEADERBOARD
 N.T.S

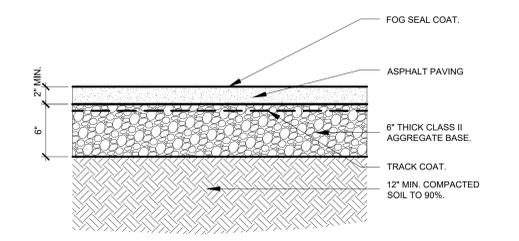


2 (N) ASPHALT PAVING
 1-1/2"=1'-0"

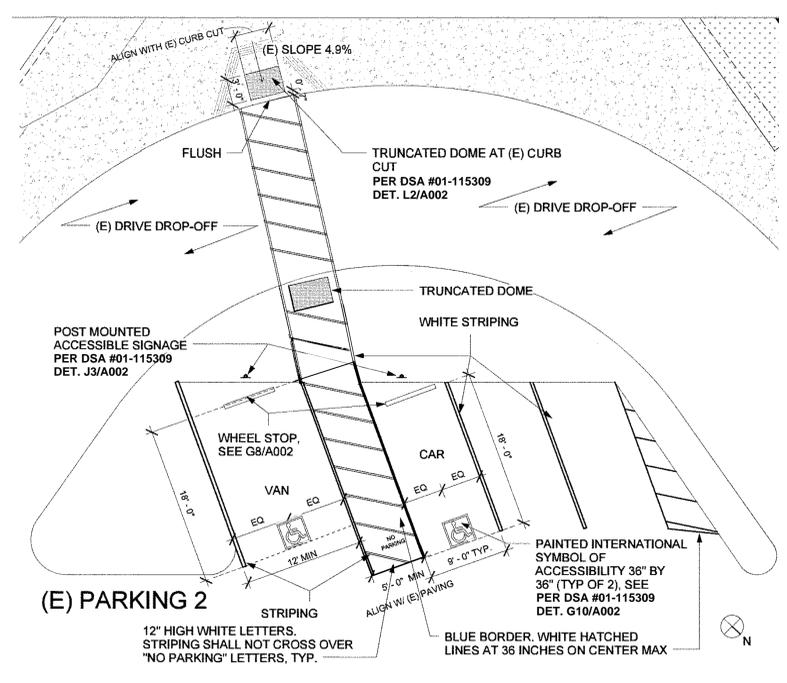

6 ENLARGED PLAN ACCESSIBLE PARKING 2

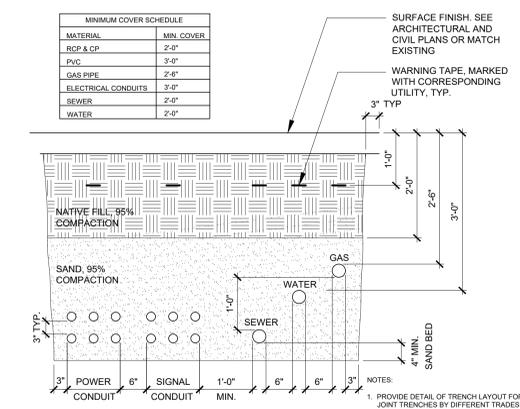

5 TYP. JOINT TRENCH
 3/4"=1'-0"

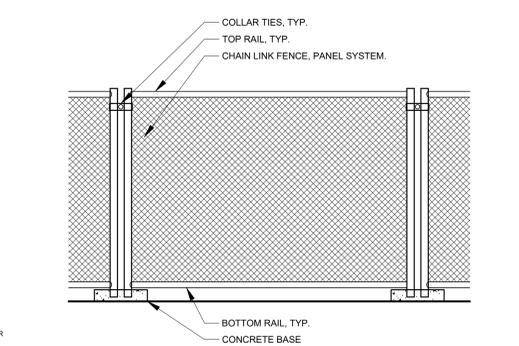

1 REQ'D TEMPORARY FENCING
 CONSTRUCTION FENCING
 1/2"=1'-0"

SITE DETAILS
 SHADE STRUCTURE
 NOBLE ELEMENTARY SCHOOL
 3466 GROSSMONT DR., SAN JOSE, CA 95132
 BERRYESSA UNION SCHOOL DISTRICT

REVISIONS NO.	ITEM	DATE

DRAWN BY: MK
 CHECKED BY: NJ
 SFA JOB NO: 19065
 DATE: 06/17/2019

M BAR C VERSA-CANOPY

ENGINEER'S APPROVAL
 IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP: 01-118971 INC:
 REVIEWED FOR
 SS FLS ACS
 DATE: 06/10/2020

DATE SIGNED
 11/28/2018



SITE SPECIFIC DSA APPROVAL

~~FILE NUMBER: PC-119
 IDENTIFICATION STAMP
 DIVISION OF THE STATE ARCHITECT
 APP. NO: 04-117117 INCR
 AC DF DS DS PS DP
 DATE: 12/05/2018~~

PRE-CHECK (PC) DOCUMENT
 CODE: 2016 CBC
 A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED

M BAR C CONSTRUCTION INC.
 LIC # 869960
 B AND C51
 GREGJ@MBARCONLINE.COM (775) 787-8845
 674 RANCHEROS DR
 SAN MARCOS, CA
 PHONE: (760) 744-4131
 FAX: (760) 744-4449
 GREGJ@MBARCONLINE.COM (775) 787-8845

4STEL ENGINEERING
 STRUCTURAL ENGINEERING
 26030 A CHERO, SUITE 200
 MISSION VIEJO, CA 92691
 PHONE: (949) 305-1150
 FAX: (949) 305-1420

VERSA CANOPY COVER SHEET

DRAWN GM
CHECKED KS
DATE 11/28/2018
4STEL JOB NO. MC03-01
SHEET S-1
1 OF 13 SHEETS

PC OWNERSHIP - STRUCTURAL STEEL CONTRACTOR



M BAR C CONSTRUCTION INC.

674 RANCHEROS DR
 SAN MARCOS, CA. 92069

PHONE: (760) 744-4131
 FAX: (760) 744-4449

LIC # 869960
 B AND C51

POINT OF CONTACT: GREG JONES
 GREGJ@MBARCONLINE.COM
 (775) 787-8845

LEGAL INFORMATION

- USE OF THE PC WITHOUT WRITTEN CONSENT FROM M BAR C CONSTRUCTION, INC. IS STRICTLY PROHIBITED.
- ALL INFORMATION HEREIN IS PROPRIETARY INFORMATION AND UNDER THE OWNERSHIP OF M BAR C CONSTRUCTION, INC.

STANDARD NOTES FOR PC USE

- 4 S.T.E.L. ENGINEERING, INC. IS AVAILABLE TO BID THE GENERATION OF THE FULL DSA SUBMITTAL PACKAGE ACTING AS THE DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE (DPGRC) OR TO SUPPORT THE DPGRC AS THE SITE SPECIFIC STRUCTURAL ENGINEER OF RECORD (SEOR). CONTACT DUSTIN ROSEPINK AT 4 S.T.E.L. ENGINEERING, INC FOR A PROPOSAL FOR SERVICES AT (949) 305-1150, DKRPINK@4STELENG.COM
- FOR CONSTRUCTION COST INFORMATION, CONTACT M BAR C CONSTRUCTION, INC.
- CUSTOM SIZES AND LOADINGS REQUIRE SUPPLEMENTARY SHOP DRAWINGS AND CALCULATIONS.

DSA OTC PLAN REVIEWER AND DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE NOTES

1. THE PC STRUCTURAL MEMBERS ARE DESIGNED TO THE FOLLOWING ASCE 7-10 SEISMIC CRITERIA: $S_s = 3.2$, $S_1 = 1.39$, $R = 1.25$.
2. THE DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE TO VERIFY SITE SPECIFIC DESIGN PARAMETERS COMPLY WITH DESIGN PARAMETERS FOR THE PC SHOWN ON SHEET S-2.
3. THE DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE IS RESPONSIBLE FOR VERIFYING SITE-SPECIFIC WIND PARAMETERS AT ANY AND ALL SITES WHERE THIS PC IS USED. THIS PC DESIGN IS BASED ON WIND SPEED 110 MPH FOR RISK CATEGORY II TYPE STRUCTURES UTILIZING EXPOSURE TYPE C PER ASCE 7-10. SEE DESIGN PARAMETER NOTE 1 ON SHEET S-2.
4. A SITE SPECIFIC GEOTECHNICAL REPORT SHALL BE SUBMITTED JUSTIFYING SOILS VALUES SELECTED IF GREATER THAN 100 PCF FOR LATERAL BEARING AND/OR 1,500 PSF FOR VERTICAL BEARING. SEE FOUNDATION NOTES ON SHEET S-3.
5. SITE SPECIFIC DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE TO SELECT SOILS CLASS FOR SITE SPECIFIC USE.
6. WET STAMPED & SIGNED COPIES OF PC PLANS ARE NOT REQUIRED FOR SITE SPECIFIC PC USE.
7. DUSTIN ROSEPINK IS NOT ACTING AS SITE SPECIFIC SEOR UNLESS HE IS THE DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE OR A SIGNED LETTER HAS BEEN SUBMITTED WITH DSA-1 FORM STATING HE ACCEPTS THE RESPONSIBILITY AS THE SEOR FOR THE SITE. REFER TO DSA IR A-18.
8. DUSTIN ROSEPINK WILL NOT SIGN ANY DSA FORMS (e.g. DSA-5, DSA-6, etc.), REVIEW OR APPROVE ANY SUBMITTALS (e.g. CONCRETE MIX DESIGNS, SHOP DRAWINGS, etc.) FOR THE SITE SPECIFIC PROJECT UNLESS HE IS ACTING AS THE DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE OR THE SITE SPECIFIC STRUCTURAL ENGINEER OF RECORD. REFER TO DSA IR A-18.
9. CUSTOM SIZES & LOADINGS REQUIRE SUPPLEMENTARY SHOP DRAWINGS & CALCULATIONS.

DESIGN PARAMETER CHECK LIST

1. VERIFY THE MAXIMUM WIND SPEED AT THE SITE DOES NOT EXCEED 110 MPH EXPOSURE C.
2. VERIFY THE MAXIMUM SEISMIC S_s AT THE SITE DOES NOT EXCEED $S_s = 3.2$.
3. VERIFY THE SITE SPECIFIC SNOW LOAD AND ENSURE ALL SITE SPECIFIC PC SELECTIONS MEET OR EXCEED THE SITE SPECIFIC SNOW LOAD. THIS PC HAS OPTIONS FOR NO SNOW AND 20 PSF SNOW LOAD. VERIFY THE SITE SPECIFIC DESIGN PROFESSIONAL HAS PROVIDED THE PROPER SITE SPECIFIC VALUES FOR P_g , P_f , P_s , C_e , I_c .
4. REVIEW THE SITE SPECIFIC GEOTECHNICAL REPORT AND ENSURE ALL SITE SPECIFIC PC SELECTIONS MEET WITH THE GEOTECHNICAL REPORT REQUIREMENTS. IF NO GEOTECHNICAL REPORT IS SUPPLIED VERIFY SOILS CLASS V IS SELECTED.
 - SITES NOT LOCATED IN STATE OR LOCAL GEOHAZARD ZONES UTILIZING THIS PC WITH STRUCTURES NOT EXCEEDING 4,000 SQ FT DO NOT REQUIRE CGS APPROVAL OF THE GEOTECHNICAL REPORT. STRUCTURES MAY BE BROKEN UP INTO MULTIPLE 4,000 SQ FT STRUCTURES WITH SEISMIC BREAKS PER SEISMIC GAPS ON S-2.
5. VERIFY THE SITE SPECIFIC FOUNDATION LOCATIONS MEET WITH SOILS NOTE 8 ON S-3 FOR SET BACK FROM TOP OF SLOPES OR THAT THE GEOTECHNICAL REPORT HAS ALLOWED A SMALLER DISTANCE.
6. VERIFY THE SITE SPECIFIC PLANS PROVIDE THE APPROPRIATE OCCUPANCY AND OCCUPANCY LOAD FACTOR FOR THE SITE. SEE BUILDING DATA ON S-2 FOR SAMPLE ACCEPTABLE OCCUPANCIES AND OCCUPANCY LOAD FACTORS.
7. VERIFY THE SITE SPECIFIC PLANS UTILIZE A RISK CATEGORY II STRUCTURE. RISK CATEGORY II STRUCTURES SHALL NOT PROVIDE SHELTER FOR EMERGENCY VEHICLES OR EQUIPMENT, OR PROVIDE REQUIRED ACCESS TO, REQUIRED EGRESS FROM, OR SHARE A LIFE SAFETY COMPONENT WITH A RISK CATEGORY III OR IV STRUCTURE.
8. VERIFY SELECTION OF USE AND OCCUPANCY CLASSIFICATION PER CBC CHAPTER 3; OCCUPANT LOAD FACTOR PER CBC TABLE 1004.1.2; RISK CATEGORY PER CBC TABLE 1604A.5; TO BE COMPLETED BY DESIGN PROFESSIONAL AT TIME OF DSA OTC OR PROJECT DSA SUBMITTAL.
9. VERIFY APPROPRIATE SEISMIC SEPARATION PER SEISMIC GAPS ON S-2.
10. VERIFY THE SITE SPECIFIC DESIGN PROFESSIONAL HAS APPROPRIATELY ADDRESSED FIRE SEPARATION AND PROPERTY LINE SETBACKS.
11. VERIFY THE SITE SPECIFIC SOLAR PANEL LAYOUT IS PROVIDED WITH DIMENSIONS THAT DO NOT EXCEED THE PC MAXIMUMS. THE MAXIMUM DIMENSIONS SHALL BE TO THE OUTSIDE EDGES OF THE SOLAR PANEL OR THE STRUCTURAL STEEL, WHICH EVER IS GREATER.
12. VERIFY STEEL SELECTIONS HAVE BEEN PROPERLY COORDINATED WITH BEAM/COLUMN SCHEDULES. REFER TO 2/S-8 & 2/S-9.
13. VERIFY SITE SPECIFIC PURLIN CANTILEVERS HAVE BEEN PROPERLY COORDINATED WITH PURLIN SCHEDULES. REFER TO 1/S-8 & 1/S-9.
14. WET STAMPED & SIGNED COPIES OF PC PLANS ARE NOT REQUIRED FOR SITE SPECIFIC PC USE.

SHEET INDEX

- S-1.....COVER SHEET
 - S-2.....GENERAL DATA
 - S-3.....GENERAL NOTES
 - S-4.....SAMPLE DSA-103 FORMS
 - S-5.....SECTION PROPERTIES & REBAR DETAILS
 - S-6.....VC14, VC18 & VC20 FRAMING PLAN & ELEVATIONS
 - S-7.....VC14, VC18 & VC20 FRAMING SCHEDULES
 - S-8.....VC140, VC180 & VC200 FRAMING PLAN & ELEVATIONS
 - S-9.....VC140, VC180 & VC200 FRAMING SCHEDULES
 - S-10.....PIER FOUNDATION & SPREAD FOOTING SCHEDULES
 - S-11.....STANDARD DETAILS 1
 - S-12.....STANDARD DETAILS 2
 - S-13.....SAMPLE ARCHITECTURAL ELEVATIONS
- 13 SHEETS

BID INFORMATION

THE STEEL STRUCTURES IN THIS PC ARE PROPRIETARY TO M BAR C CONSTRUCTION, INC. THE STEEL WORK SHALL NOT GO OUT TO BID.

PRE-CHECK (PC) DOCUMENT

CODE: 2016 CBC
 A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED



ABBREVIATIONS

&	AND
@	AT
⊕	CENTER LINE
A.B.	ANCHOR BOLT
ACI	AMERICAN CONCRETE INSTITUTE
AISC	AMERICAN INSTITUTE OF STEEL CONSTRUCTION
AISI	AMERICAN IRON AND STEEL INSTITUTE
ANSI	AMERICAN NATIONAL STANDARDS INSTITUTE
ASTM	AMERICAN SOCIETY FOR TESTING MATERIALS
AWS	AMERICAN WELDING SOCIETY
BLDG	BUILDING
BL'G	BLOCKING
BM	BEAM
BOTT. OR (B)	BOTTOM
CBC	CALIFORNIA BUILDING CODE
CCD	CONSTRUCTION CHANGE DOCUMENT (DSA)
CCR	CALIFORNIA CODE OF REGULATIONS
CFS	COLD FORMED STEEL
C.J.	CONTROL JOINT
CJP	COMPLETE JOINT PENETRATION
CLR	CLEAR
CMU	CONCRETE MASONRY UNIT
COL.	COLUMN
CONC.	CONCRETE
CONT.	CONTINUOUS
CS	CFS C SECTION WITH FLANGE STIFFENING LIPS
DIA., Ø	DIAMETER
DPRGC	DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE
DSA	DIVISION OF THE STATE ARCHITECT
DWG	DRAWING
(E)	EXISTING
EA.	EACH
E.F.	EACH FACE
E.W.	EACH WAY
EXT.	EXTERIOR
FDN	FOUNDATION
FIN.	FINISH
FLR	FLOOR
FLS	FIRE LIFE SAFETY (DSA)
F.O.C.	FACE OF CONCRETE
F.S.	FAR SIDE
FTG.	FOOTING
GA.	GAUGE
GALV.	GALVANIZED
H.S.B.	HIGH STRENGTH BOLT (ASTM A325 U.N.O.)
HORIZ.	HORIZONTAL
HT.	HEIGHT
IAMPO	INTERNATIONAL ASSOCIATION OF MECHANICAL AND PLUMBING OFFICIALS
ICC	INTERNATIONAL CODE COUNCIL
INT.	INTERIOR
IOR	INSPECTOR OF RECORD
IR	INTERPRETATION OF REGULATIONS (DSA)
JT	JOINT
LG.	LONG
LLH	LONG LEG HORIZONTAL
LLV	LONG LEG VERTICAL
M.B.	MACHINE BOLT (ASTM A307 U.N.O.)
MAX.	MAXIMUM
MFR.	MANUFACTURER
MIN.	MINIMUM
MISC.	MISCELLANEOUS
(N)	NEW
NFPA	NATIONAL FIRE PROTECTION ASSOCIATION
NOM.	NOMINAL
N.S.	NEAR SIDE
NTS	NOT TO SCALE
O.C.	ON CENTER
OTC	OVER THE COUNTER (DSA)
O.H.	OPPOSITE HAND
⊕ OR PL	PLATE
PJP	PARTIAL JOINT PENETRATION
PC	PRE-CHECK (DSA)
PT	PRESSURE TREATED
PV	PHOTOVOLTAIC
REINFT.	REINFORCEMENT
REQ'D	REQUIRED
SC	SLIP-CRITICAL JOINT PER ASTM SPECS
SCHED.	SCHEDULE
SEOR	STRUCTURAL ENGINEER OF RECORD
SHT'G	SHEATHING
SIM.	SIMILAR
S.M.S.	SHEET METAL SCREW
SQ.	SQUARE
SS	STAINLESS STEEL
ST	SNUG-TIGHTENED JOINT PER ASTM SPECS
STD	STANDARD
(T)	TOP
T&B	TOP AND BOTTOM
T.O.C.	TOP OF CONCRETE
T.O.S.	TOP OF STEEL
TYP.	TYPICAL
U.N.O.	UNLESS NOTED OTHERWISE
VERT.	VERTICAL
W/-	WITH
W/O	WITHOUT
WHS	WELDED HEADED STUD (ASTM A108 U.N.O.)
W.P.	WORK POINT
WT.	WEIGHT
WTS	WELDED THREADED STUD (ASTM A108 U.N.O.)

GENERAL NOTES

- ALL WORK SHALL CONFORM TO TITLE 24, CALIFORNIA CODE OF REGULATIONS (CCR)
- CHANGES TO THE APPROVED DRAWINGS AND SPECIFICATIONS SHALL BE MADE BY ADDENDA OR CONSTRUCTION CHANGE DOCUMENTS APPROVED BY THE DIVISION OF THE STATE ARCHITECT, AS REQUIRED BY SECTION 4-338, PART 1, TITLE 24, CCR.
- A 'DSA CERTIFIED' PROJECT INSPECTOR EMPLOYED BY THE DISTRICT (OWNER) AND APPROVED BY THE DIVISION OF THE STATE ARCHITECT SHALL PROVIDE CONTINUOUS INSPECTION OF THE WORK. THE DUTIES OF THE INSPECTOR ARE DEFINED IN SECTION 4-342, CALIFORNIA BUILDING STANDARDS ADMINISTRATIVE CODE (PART 1, TITLE 24, CCR).
- A 'DSA CERTIFIED' INSPECTOR WITH CLASS 2 CERTIFICATION IS REQUIRED FOR THIS PROJECT.
- A DSA ACCEPTED TESTING LABORATORY DIRECTLY EMPLOYED BY THE SCHOOL BOARD SHALL CONDUCT ALL THE REQUIRED TESTS AND INSPECTIONS FOR THE PROJECT.
- GRADING PLANS, DRAINAGE IMPROVEMENTS, ROAD AND ACCESS REQUIREMENTS AND ENVIRONMENTAL HEALTH CONSIDERATIONS SHALL COMPLY WITH ALL LOCAL ORDINANCES.
- IF THE PROJECT IS DIVIDED INTO INCREMENTS: THE SCOPE OF WORK FOR EACH INCREMENT MUST BE CLEARLY SPECIFIED ON THE TITLE SHEET OF ALL INCREMENTS SUBMITTED.


CONSTRUCTION OPTIONS

* ALL CONSTRUCTION OPTIONS INCLUDE OPTIONS FOR CONCRETE DRILLED PIERS AND/OR SPREAD FOOTINGS.

- ~~14'-0" MAX WIDTH, 3:12 MAX ROOF SLOPE, 17'-0" MAX COLUMN HEIGHT, 0 psf GROUND SNOW~~
- 18'-0" MAX WIDTH, 3:12 MAX ROOF SLOPE, 17'-9" MAX COLUMN HEIGHT, 0 psf GROUND SNOW
- ~~20'-0" MAX WIDTH, 3:12 MAX ROOF SLOPE, 17'-0" MAX COLUMN HEIGHT, 0 psf GROUND SNOW~~
- ~~14'-0" MAX WIDTH, 3:12 MAX ROOF SLOPE, 17'-5" MAX COLUMN HEIGHT, 20 psf GROUND SNOW~~
- ~~18'-0" MAX WIDTH, 3:12 MAX ROOF SLOPE, 16'-6" MAX COLUMN HEIGHT, 20 psf GROUND SNOW~~
- ~~20'-0" MAX WIDTH, 3:12 MAX ROOF SLOPE, 16'-9" MAX COLUMN HEIGHT, 20 psf GROUND SNOW~~

SEISMIC GAPS

OPTION	MAX COLUMN HEIGHT	GAP X	GAP Y
VC14	17'-0"	2 1/2"	7"
VC18	17'-9"	3 1/2"	9 1/2"
VC20	17'-0"	2 1/2"	7"
VC140	17'-5"	3 1/2"	9"
VC180	16'-6"	3"	8 1/2"
VC200	16'-9"	3"	8"

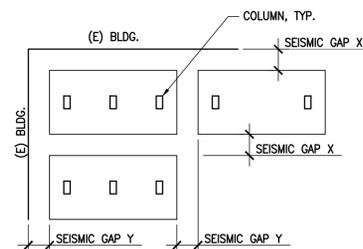

- NOTE
- SEISMIC GAPS LISTED ARE THE MINIMUM GAPS BETWEEN ANY TWO STRUCTURES (I.E. CANOPIES, BUILDINGS) AND DO NOT NEED TO BE COMBINED OR DOUBLED.
 - DIMENSIONS, QUANTITIES, AND LOCATIONS OF STRUCTURES AND COLUMNS SHOWN ABOVE ARE FOR ILLUSTRATIVE PURPOSES ONLY. SEE SITE-SPECIFIC SHEETS FOR LAYOUTS AND QUANTITIES.

STRUCTURAL DATA

LATERAL RESISTING SYSTEM..... STEEL ORDINARY CANTILEVER COLUMN
 FOUNDATION CONCRETE DRILLED PIERS AND SPREAD FOOTINGS
 TESTING AND INSPECTION LIST..... SEE SHEETS S-3 & S-4

DESIGN PARAMETERS

RISK CATEGORY II
 ROOF LIVE LOAD (L_p):
 DECK ONLY 20 psf
 POINT LOAD 300 lb
 SNOW LOAD :
 MAX. DRIFT SNOW LOAD..... 0 psf, 20 psf (SEE CONSTRUCTION OPTIONS)
 MAXIMUM DEAD LOAD:
 ROOF DECK..... 0.89 psf
 WIND: ASCE 7-10 METHOD 2 - ANALYTICAL PROCEDURE
 BASIC WIND SPEED..... 110 mph⁽¹⁾
 WIND EXPOSURE C⁽¹⁾
 INTERNAL PRESSURE N/A (OPEN STRUCTURE)
 WIND DIRECTIONALITY FACTOR K_d = 0.85
 VELOCITY PRESSURE COEFFICIENT..... K_e = 0.90
 TOPOGRAPHIC FACTOR K_{zt} = 1.00
 SEISMIC: ASCE 7-10
 SEISMIC IMPORTANCE FACTOR I = 1.0
 RESPONSE MODIFICATION FACTOR..... R = 1.25
 MAPPED SPECTRAL RESPONSE S_s = 3.22⁽²⁾
 ACCELERATION S₁ = 1.39
 SITE CLASS D
 DESIGN SPECTRAL RESPONSE S_{DS} = 2.133
 S₁₁ = 1.390
 SEISMIC DESIGN CATEGORY D (E WITH GROUND MOTION ANALYSIS)
 SEISMIC FORCE RESISTING SYSTEM STEEL ORDINARY CANTILEVER COLUMN
 SEISMIC RESPONSE COEFFICIENT C_s = 1.707
 ANALYSIS PROCEDURE EQUIVALENT LATERAL FORCE

NOTES:

- THE PC COMPONENTS & CLADDING AND MAIN WIND FORCE RESISTING SYSTEM DESIGN WIND PRESSURE q_s = 23.7 psf DETERMINED FROM THE CRITERIA LISTED ABOVE. (EXPOSURE C, K_e=0.960, K_{zt}=1.0, K_d = 0.85).
 THE PC MAY BE USED FOR RISK CATEGORY II TYPE STRUCTURES IN ANY WIND ZONE WHERE q_s ≤ 23.7 psf.
 EXAMPLE:
 SITE BASIC WIND SPEED, V = 120 mph
 RISK CATEGORY II
 WIND: EXPOSURE B
 K_d = 0.85
 K_e = 0.701
 K_{zt} = 1.00
 q_s = 22.0 psf < 23.7 psf
 THE PC MAY BE USED AT THIS SITE, PENDING DSA SITE SPECIFIC APPROVAL.
- THE PC SEISMIC FORCE RESISTING SYSTEM IS GOVERNED BY C_s = 1.707 FROM THE CRITERIA LISTED ABOVE. (R = 1.25, S_s = 3.2, I = 1.00).
 THE PC MAY BE USED FOR RISK CATEGORY II STRUCTURES AT ANY SITE WHERE THE SITE SPECIFIC SEISMIC PARAMETER S_s AND R = 1.25 RESULT IN A VALUE C_s ≤ 1.707.
 EXAMPLE:
 RISK CATEGORY II
 SOIL: SITE CLASS A
 S_s = 3.4
 S₁ = 1.8
 R = 1.25
 I = 1.00
 S_{DS} = 1.813
 C_s = 1.451 < 1.707
 THE PC MAY BE USED AT THIS SITE, PENDING DSA SITE SPECIFIC APPROVAL.

BUILDING DATA

TYPE OF CONSTRUCTION..... IIB
 OCCUPANCY..... VARIES - SEE EXAMPLES
 NUMBER OF STORIES..... 1
 BUILDING AREAS..... VARY DUE TO OCCUPANCY - SEE EXAMPLES
 MODULE SIZES..... VARY WITH OPTIONS
 BUILDING LENGTH:
 ALL WIDTHS..... MAX. 500'-0" LENGTH
 NOTE: NO SEISMIC AND/OR THERMAL EXPANSION JOINTS REQUIRED ALONG THE LENGTH OF THE STRUCTURES. (ALL JOINTS ARE INTERNAL)

OCCUPANCY AND BUILDING AREA EXAMPLES:
 ALL STRUCTURES SHALL BE BASED ON RISK CATEGORY II STRUCTURE.

A. OCCUPANCY:

- EXAMPLE 1:
 STRUCTURES LOCATED OVER LUNCH AREA WITHOUT FIXED SEATING
 OCCUPANCY: A-2
 OCCUPANCY LOAD: 15 sf/person - MAX 300 FOR RISK II
 MAX SQ FT: 4,500 sq ft
- EXAMPLE 2:
 STRUCTURES LOCATED OVER LUNCH AREA WITH FIXED SEATING
 OCCUPANCY: A-2
 OCCUPANCY LOAD: 18' /person ALONG LINEAR BENCH - MAX 300 FOR RISK II
 MAX SQ FT: 5,400 LINEAR INCHES OF FIXED SEATING UNDER THE STRUCTURE
- EXAMPLE 3:
 STRUCTURES LOCATED OVER AN AREA DESIGNATED FOR ASSEMBLY (TYPICALLY AMPHITHEATER, OR OTHER SPACE WITH FIXED SEATING OR DESIGNATED AS A STANDING ASSEMBLY AREA)
 OCCUPANCY: A
 OCCUPANCY LOAD: 7 sf/person - MAX 300 FOR RISK II
 MAX SQ FT: 2,100 sq ft

SHADE STRUCTURE

- EXAMPLE 1:
 STRUCTURES LOCATED OVER A FIELD, BLACKTOP, PLAYGROUND EQUIPMENT, OR OTHER NON DESIGNATED USE SPACES
 OCCUPANCY: E
 OCCUPANCY LOAD: 20 sf/person - MAX 250 FOR RISK II
 MAX SQ FT: 5,000 sq ft

PARKING

- EXAMPLE 1:
 STRUCTURES LOCATED OVER PARKING
 OCCUPANCY: S-2
 OCCUPANCY LOAD: 200 sf/person
 MAX SQ FT: UNLIMITED PER CBC 406.5.4 AND 406.5.5

CODES

TITLE 24, CCR CODES:

- 2016 CALIFORNIA ADMINISTRATIVE CODE (CAC) (PART 1, TITLE 24, CCR)
- 2016 CALIFORNIA BUILDING CODE (CBC), VOLUMES 1 AND 2..... (PART 2, TITLE 24, CCR) (2015 INTERNATIONAL BUILDING CODE WITH 2016 CALIFORNIA AMENDMENTS)
- 2016 CALIFORNIA ELECTRICAL CODE (PART 3, TITLE 24, CCR) (2014 NATIONAL ELECTRICAL CODE WITH 2016 CALIFORNIA AMENDMENTS)
- 2016 CALIFORNIA MECHANICAL CODE (CMC) (PART 4, TITLE 24, CCR) (2015 UNIFORM MECHANICAL CODE WITH 2016 CALIFORNIA AMENDMENTS)
- 2016 CALIFORNIA PLUMBING CODE (CPC) (PART 5, TITLE 24, CCR) (2015 UNIFORM PLUMBING CODE WITH 2016 CALIFORNIA AMENDMENTS)
- 2016 CALIFORNIA ENERGY CODE (PART 6, TITLE 24, CCR) (2016 EDITION CALIFORNIA ENERGY COMMISSION BUILDING ENERGY EFFICIENCY STANDARDS)
- 2016 CALIFORNIA FIRE CODE (CFC) (PART 9, TITLE 24, CCR) (2015 INTERNATIONAL FIRE CODE WITH 2016 CALIFORNIA AMENDMENTS)
- 2016 CALIFORNIA GREEN BUILDING STANDARDS CODE (PART 11, TITLE 24, CCR)
- 2016 CALIFORNIA REFERENCED STANDARDS CODE (PART 12, TITLE 24, CCR) NFPA 13 - 2016 NFPA 72 - 2016

REFERENCE CODE SECTIONS FOR APPLICABLE STANDARDS:

- 2016 CBC, CHAPTER 35
- 2016 CFC, CHAPTER 80

FIRE LIFE SAFETY

AUTOMATIC FIRE SPRINKLERS REQUIRED? (Y/N)..... N


ENGINEER'S APPROVAL

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP: 01-118971 INC:
 REVIEWED FOR
 SS FLS ACS
 DATE: 06/10/2020

DATE SIGNED
 11/28/2018



SITE SPECIFIC DSA APPROVAL



PRE-CHECK (PC) DOCUMENT

MBARC CONSTRUCTION INC.
 674 RANCHEROS DR SAN MARCOS, CA 92069
 PHONE: (760) 744-4131 FAX: (760) 744-4449
 IUC # 869980 B AND C 51 GREGJ@MBARCONLINE.COM (775) 787-8845


ASTEL ENGINEERING STRUCTURAL ENGINEERING
 26030 ACHERO, SUITE 200 MISSION VIEJO, CA 92691
 PHONE: (949) 305-1150 FAX: (949) 305-1420

VERSA CANOPY GENERAL DATA

DRAWN GM
 CHECKED KS
 DATE 11/28/2018
 4STEL JOB NO. MC03-01
 SHEET S-2
 2 OF 13 SHEETS

SOILS NOTES

- IF NO GEOTECHNICAL REPORT IS SUPPLIED AT THE TIME OF DSA REVIEW ADDRESSING SITE-SPECIFIC PARAMETERS, FOUNDATION SELECTIONS SHALL BE BASED ON CLASS W SOILS (SOIL CLASS 5 OF CBC TABLE 1806A.2 WITH DOUBLING OF LATERAL BEARING PRESSURE FOR STRUCTURES NOT ADVERSELY AFFECTED BY 1/2" MOTION AT GROUND SURFACE) IN THE SOIL CLASS TABLE BELOW.
- WHEN A GEOTECHNICAL REPORT IS SUPPLIED THE GEOTECHNICAL ENGINEER SHALL REVIEW THE SITE CONDITIONS, TESTING RESULTS, AND ALL ALLOWABLE INCREASES AND SUPPLY THE FINAL SOIL CLASS TO BE USED FROM THE BELOW TABLE. THE GEOTECHNICAL ENGINEER SHALL PROVIDE IN THE GEOTECHNICAL REPORT THE FOLLOWING BASE VALUES WITHOUT INCREASE FOR 24" DIAMETER PIERS: THE ALLOWABLE VERTICAL END BEARING, ALLOWABLE LATERAL BEARING, ALLOWABLE DOWNWARD SKIN FRICTION, ALLOWABLE SKIN FRICTION TO RESIST UPLIFT. THE GEOTECHNICAL ENGINEER SHALL ALSO PROVIDE ANY ALLOWABLE INCREASES TO THE BASE VALUES. ALLOWABLE INCREASES ARE TYPICALLY DUE TO BUT NOT EXCLUSIVE TO: DOUBLE VALUES DUE TO ISOLATED FOUNDATIONS, DOUBLE VALUES DUE TO THE STRUCTURE NOT BEING ADVERSELY AFFECTED BY 1/2" DEFLECTION AT THE SURFACE, A 4/3 INCREASE DUE TO SHORT TERM LOADING, AND ANY OTHER ALLOWABLE INCREASES. THE GEOTECHNICAL ENGINEER SHALL MAKE RECOMMENDATION OF THE SOIL CLASS TO BE USED AFTER ALL INCREASES HAVE BEEN APPLIED. ALL FOUNDATIONS HAVE BEEN DESIGN BASED ON THE VALUES PRESENTED IN THE BELOW TABLE. THE GEOTECHNICAL REPORT SHALL ADDRESS IF THE USE OF STEEL CASING THAT IS TWISTED INTO PLACE AND LEFT INSTALLED AFFECTS ANY ALLOWABLE VALUES.
- THE GEOTECHNICAL ENGINEER MAY SPECIFY DIFFERENT SOILS CLASSES TO BE USED FOR THE DIFFERENT STRUCTURE TYPES (VC14 OR VC20), DIFFERENT AREAS OF THE SITE (I.E. NORTH LOT OR WEST LOT), OR THE ENGINEER MAY SPECIFY ONE SOILS CLASS TO BE USED FOR THE ENTIRE SITE.
- THE GEOTECHNICAL ENGINEER SHALL ADDRESS IN THE REPORT ANY CONCRETE DURABILITY REQUIREMENTS IN ACCORDANCE WITH ACI 318-11 CHAPTER 4.
- THE GEOTECHNICAL REPORT SHALL BE SPECIFIC TO THE LOCATION OF THE STRUCTURES. BORING(S) SHALL BE DONE AT THE SPECIFIC LOCATION(S) WHERE THE STRUCTURES ARE TO OCCUR. THE GEOTECHNICAL REPORT SHALL CONFORM TO 2016 CBC SECTION 1803A.
- A COPY OF THE GEOTECHNICAL REPORT SHALL BE PROVIDED AT THE TIME OF PLAN REVIEW.
- AT THE TIME OF PLAN REVIEW, THE DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE SHALL SELECT A SOILS CLASS ON THE SITE-SPECIFIC PLANS BASED ON THE GEOTECHNICAL REPORT (OR NOTE 1 ABOVE). HOLES MAY BE LEFT OPEN FOR ANY AMOUNT OF TIME AS LONG AS THEY ARE PROPERLY COVERED FOR OSHA STANDARDS.
- FOUNDATIONS ADJACENT TO SLOPED GROUND SURFACES SHALL BE SET BACK PER THE FOLLOWING FIGURE UNLESS OTHERWISE RECOMMENDED BY A SITE SPECIFIC GEOTECHNICAL REPORT.

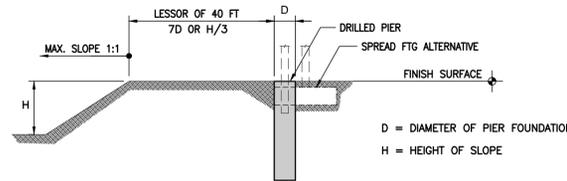

DESIGN SOIL VERTICAL AND LATERAL BEARING VALUES					
SOIL CLASS	VERTICAL BEARING PRESSURE (psf)	LATERAL BEARING PRESSURE (psf/ft)	MAXIMUM LATERAL BEARING (psf)	MIN. DOWNWARD SKIN FRICTION (psf)	MIN. UPWARD SKIN FRICTION (psf)
CLASS Y	1,500	133	2,000	175	30
CLASS W	1,500	267	4,000	225	50
CLASS X	2,000	400	6,000	250	75
CLASS Y	2,000	533	8,000	275	75
CLASS Z	3,000	800	12,000	325	100

SPECIAL INSPECTION

- SOILS:
 - VERIFY THE SITE HAS BEEN PREPARED PROPERLY PRIOR TO PLACEMENT OF CONTROLLED FILL AND/OR EXCAVATIONS FOR FOUNDATIONS.
 - VERIFY THAT THE FOUNDATION EXCAVATIONS ARE EXTENDED TO PROPER DEPTH AND HAVE REACHED PROPER MATERIAL.
 - VERIFY THAT MATERIALS BELOW FOOTINGS ARE ADEQUATE TO ACHIEVE THE DESIGN BEARING CAPACITY.
- PIER FOUNDATIONS:
 - INSPECT DRILLING OPERATIONS AND MAINTAIN COMPLETE AND ACCURATE RECORDS FOR EACH PIER.
 - VERIFY LOCATIONS OF PIERS.
- CONCRETE:
 - VERIFY USE OF REQUIRED DESIGN MIX, DETERMINE THE TEMPERATURE OF THE CONCRETE, AND (WHERE REQUIRED) PERFORM AIR CONTENT TEST.
 - TEST CONCRETE (COMPRESSION TEST).
 - INSPECT PLACEMENT OF FORMWORK, REINFORCING STEEL, EMBEDDED ITEMS, AND CONCRETE. INSPECT CURING AND FORM REMOVAL.
 - SLUMP TEST SHALL BE PERFORMED PER SITE SPECIFIC DSA-103.
- STEEL:
 - VERIFY THAT ALL MATERIALS ARE APPROPRIATELY MARKED AND THAT:
 - MILL CERTIFICATES INDICATE MATERIAL PROPERTIES THAT COMPLY WITH REQUIREMENTS.
 - MATERIAL SIZES, TYPES AND GRADES COMPLY WITH REQUIREMENTS.
 - TEST UNIDENTIFIED MATERIALS.
 - VERIFY MEMBER LOCATIONS, BRACING AND ALL DETAILS CONSTRUCTED IN THE FIELD.
 - VERIFY STIFFENER LOCATIONS, CONNECTION TAB LOCATIONS, AND ALL CONSTRUCTION DETAILS FABRICATED IN THE SHOP.
 - HIGH STRENGTH SLIP CRITICAL BOLTING.
- SHOP FABRICATION:
 - VERIFY FABRICATOR'S FABRICATION AND QUALITY CONTROL PROCEDURES.
 - VERIFY ALL ASPECTS OF SHOP FABRICATION INCLUDING MEMBER LOCATIONS, DIMENSIONAL LAYOUT OF ALL PARTS AND PIECES, BOLTING, ETC.
- SEE DSA APPROVED 103 FOR ADDITIONAL REQUIREMENTS.

GENERAL NOTES

- DESIGN PER 2016 C.B.C. AND ITS PRESCRIBED LOADING AND MATERIAL SPECIFICATIONS:
 - ASCE 7-10
 - 14TH EDITION AISC STEEL CONSTRUCTION MANUAL
 - 2012 AISI COLD FORMED STEEL STANDARD
 - ACI 318-14
- THESE STRUCTURES ARE NOT DESIGNED TO BE, NOR SHALL THEY BE, ENCLOSED.
- ALL DIMENSIONS, CONDITIONS, AND ELEVATIONS ARE TO BE FIELD VERIFIED BY THE CONTRACTOR PRIOR TO COMMENCING WORK OR FABRICATION. IF ANY DISCREPANCIES ARE FOUND OR IF ANY CONDITION EXISTS NOT AS SHOWN ON THE DRAWINGS THE DESIGN PROFESSIONAL IN RESPONSIBLE CHARGE SHALL BE NOTIFIED IMMEDIATELY.
- IF THE SNOW LOAD OPTION IS USED THEN THE SITE-SPECIFIC MAX GROUND SNOW LOADING INCLUDING DRIFT MUST BE LESS THAN OR EQUAL TO 20 PSF.
- ALL SCREWS TO BE ITW BUILDEX TEK SCREWS PER ICC ESR-1976 OR ELCO DRILL SCREW PER ICC ESR-3294.
- OWNER TO SIGN AUTHORIZATION TO PROCEED PRIOR TO DRILLING.
SEE SAMPLE BELOW:

674 Rancheros Drive
 San Marcos, CA 92069
 PH: 760.744.4131
 FAX: 760.744.4449
 CA LIC #869980

Authorization to Proceed

Project Name: _____ Foreman: _____
 Site Name: _____ Contractor: _____

As an authorized representative of Contractor listed above, I, _____ agree to the following statements below:

_____(initial) **LAYOUT:** The onsite layout for installation of structural steel for carports and canopies has been inspected and is approved as is.

_____(initial) **ARRAY ORIENTATION/CONCRETE POUR:** The tilt and direction of the canopies have been verified and are approved as is.

ARRAYS:

It is understood that additional costs will apply due to the following delays: re-layout not due to M Bar C, underground site conflicts (unmarked utility lines, including but not limited to water, sewer, fire, irrigation, electrical); encountered underground water; change in soils condition, including but not limited to hard drilling, caving soils, obstructions).

BY: _____ DATE: _____
 (signature) _____
www.mbarconline.com

STEEL NOTES

- COLD FORMED STEEL SIZES ARE BASED ON BARE STEEL THICKNESS.
- STRUCTURAL PURLIN, BEAM & COLUMN MEMBERS SHALL HAVE MINIMUM STEEL YIELD STRENGTHS AS INDICATED.
- STRUCTURAL STEEL SHALL BE HOT-DIP GALVANIZED (MINIMUM ASTM A123 OR A153, CLASS D) OR PAINTED WITH ZINC-RICH PRIMER, UNDERCOAT, AND FINISH COAT; OR EQUIVALENT PAINT SYSTEM. COLD-FORMED STEEL MEMBERS SHALL BE 55% ALUMINUM-ZINC ALLOY COATED PER ASTM A792/A792M STANDARD IN ACCORDANCE TO AISI S200 TABLE A4-1, CP 90 COATING DESIGNATION.
- ALL EXPOSED STEEL FASTENERS, INCLUDING CAST IN PLACE ANCHOR BOLTS/RODS, SHALL BE STAINLESS STEEL (TYPE 304 MINIMUM), HOT-DIP GALVANIZED (ASTM A153, CLASS D MINIMUM OR ASTM F2329), OR PROTECTED WITH CORROSION-PREVENTIVE COATING THAT DEMONSTRATED NO MORE THAN 2% OF RED RUST IN MINIMUM 1,000 HOURS OF EXPOSURE IN SALT SPRAY TEST PER ASTM B117. ZINC-PLATED FASTENERS DO NOT COMPLY WITH THIS REQUIREMENT. (EXAMPLE PROPRIETARY COATINGS THAT COMPLY WITH THE 1000 HOUR REQUIREMENT INCLUDE BUT ARE NOT NECESSARILY LIMITED TO: QUIK GUARD BY SIMPSON, KWIK-COTE BY HILTI, STALGARD BY ELOCO, VISTA-CORR BY SFS INTEC, ETC.)
- STEEL FABRICATION SHALL COMPLY WITH LATEST AISI SPECIFICATIONS.
- HOLLOW STRUCTURAL STEEL (HSS) MEMBERS SHALL BE ASTM A1085 GR. 50 U.N.O. ASTM A1085 STEEL HAS THE SAME OR BETTER PROPERTIES AND WELDABILITY THAN ASTM A500 GR. B.
- COLD FORMED STEEL (CFS) MEMBERS SHALL BE ASTM A653 SS GR. 55 (F_y = 55 ksi, F_u = 70 ksi) OR ASTM A1011 SS GR. 55 (F_y = 55 ksi, F_u = 70 ksi).
- ZINC COATING OF STRUCTURAL STEEL SHALL CONFORM WITH G90 STANDARD OR BETTER. COLD FORMED STEEL (CFS) MEMBERS TO BE GALVANIZED IN ACCORDANCE WITH ASTM A653 G90 STANDARD. HOLLOW STRUCTURAL STEEL (HSS) MEMBERS SHALL BE GALVANIZED IN ACCORDANCE WITH ASTM A123, UNLESS NOTED OTHERWISE.
- ALL STEEL MEMBERS TO BE GALVANIZED OR PAINTED WITH ZINC-RICH PRIMER, UNDERCOAT AND FINISH COAT OR EQUIVALENT PAINT SYSTEM. CONTRACT DOCUMENTS SHALL SPECIFY THE TYPE OF SSPC CORROSION RESISTING SYSTEM TO BE UTILIZED AND THE SSPC GRADE FOR CLEANING, MINIMUM SSPC GRADE SP2.
- BOLTS SHALL CONFORM TO THE ASTM A307 SPECIFICATIONS UNLESS NOTED OTHERWISE. INSPECTION OF A307 BOLTING IS NOT REQUIRED.
- ASTM A307 BOLTS MAY BE SUBSTITUTED WITH THE SAME NUMBER AND SIZE OF SAE J429 GRADE 2 BOLTS.
- BOLTS SHALL BE TIGHTENED TO SNUG-TIGHT CONDITION UNLESS NOTED OTHERWISE EXCEPT FOR A325-SC HIGH STRENGTH BOLTS USED IN THE BEAM TO COLUMN CONNECTION.
- A325-SC BOLTS SHALL BE PRE-TENSIONED PER AISC SPECIFICATIONS USING APPROVED LOAD INDICATOR METHODS INCLUDING BUT NOT LIMITED TO TURN-OF-THE-NUT WITH MATCH MARKING, TWIST OFF TENSION CONTROL OR DIRECT TENSION INDICATOR BOLT, NUT AND WASHER ASSEMBLIES.
- ASTM A307 BOLTS SHALL HAVE STANDARD WASHERS UNDER THE NUT & BOLT HEAD (F436 WASHERS ARE NOT REQUIRED). STANDARD WASHERS DO NOT REQUIRE HARDNESS TEST.
- BOLT HOLES FOR 1/2" BOLTS SHALL BE AS FOLLOWS:
STANDARD HOLES: 3/8"

CONCRETE NOTES

- CONCRETE MIN. 4,500 PSI AT 28 DAYS UNLESS A SOILS REPORT IS PROVIDED THAT ALLOWS FOR A LOWER STRENGTH (3,000 PSI MIN.). BATCH PLANT INSPECTION NOT REQUIRED.
- CONCRETE SHALL MEET THE FOLLOWING MINIMUM REQUIREMENTS BASED ON EXPOSURE CLASS IN ACCORDANCE WITH ACI 318-14 TABLE 19.3.2.1 WHEN DETERMINED BY A SITE-SPECIFIC GEOTECHNICAL REPORT.

REQUIREMENTS FOR CONCRETE BASED ON EXPOSURE CLASS			
EXPOSURE CLASS ACI TABLE 19.3.2.1	MINIMUM CONCRETE STRENGTH F _c	CEMENT TYPE ASTM C150	MAX. WATER/CEMENT RATIO W/M
NOT DETERMINED	4,500 PSI	TYPE IV	0.45
FO, SO, PO, CO, C1	3,000 PSI	TYPE II	N/A
S1, P1	4,000 PSI	TYPE II	0.50
ALL OTHER	4,500 PSI	TYPE V	0.45

- CONCRETE EXPOSED TO THAW AND FREEZE CYCLE SHALL BE AIR ENTRAINED PER ACI 318-14 TABLE 19.3.1.1.
- CONCRETE TO ATTAIN 1000 PSI PRIOR TO REMOVAL OF SHORING AND/OR INSTALLATION OF BEAMS AND PURLINS. (NOTE: A HIGHER COMPRESSIVE CONCRETE MAY BE USED TO ACHIEVE 1000 PSI SOONER. SUBMIT CONCRETE MIX DESIGN PREPARED BY A QUALIFIED LICENSED PROFESSIONAL ENGINEER FOR APPROVAL BY THE DESIGN PROFESSIONAL IN RESPONSIBLE CHARGE PRIOR TO BEING PLACED.)
- CONCRETE TO REACH 3000 PSI PRIOR TO INSTALLATION OF ROOF DECK. (NOTE: A HIGHER COMPRESSIVE CONCRETE MAY BE USED TO ACHIEVE 3000 PSI SOONER. SUBMIT CONCRETE MIX DESIGN PREPARED BY A QUALIFIED LICENSED PROFESSIONAL ENGINEER FOR APPROVAL BY THE DESIGN PROFESSIONAL IN RESPONSIBLE CHARGE PRIOR TO BEING PLACED.)
- REINFORCEMENT BARS SHALL BE ASTM A615, GR60 TYPICAL, U.N.O.
- MINIMUM CONCRETE COVER SHALL BE 2 1/2" TO EARTH (DRILLED PIER FOUNDATIONS ONLY), 3" TO EARTH ALL OTHER CONCRETE, 2" TO EXPOSED SURFACES PER CBC TABLE 1808A.8.2
- ALL REINFORCING STEEL AND OTHER EMBEDDED ITEMS SHALL BE SECURELY POSITIONED PRIOR TO THE POURING OF CONCRETE.
- ALL CONCRETE WORK SHALL COMPLY WITH ACI 301 & 318 STANDARDS.
- AGGREGATE GRADATION AND QUALITY SHALL BE IN ACCORDANCE WITH ACI 302-R.
- COLD JOINTS SHALL HAVE A ROUGHENED SURFACE. BONDING AGENT SHALL COMPLY WITH ASTM C1059. A SUBMITTAL FOR CONCRETE BONDING AGENT SHALL BE APPROVED BY DESIGN PROFESSIONAL IN RESPONSIBLE CHARGE PRIOR TO INSTALLATION. DSA INSPECTOR OF RECORD TO PERIODICALLY INSPECT INSTALLATION OF BONDING AGENT.
- BATCH PLANT INSPECTION NOT REQUIRED PER CBC 1705A3.3.2. SUBJECT TO:
 - A LICENSED WEIGHMASTER SHALL POSITIVELY IDENTIFY QUANTITY OF MATERIALS AND CERTIFY EACH LOAD BY A BATCH TICKET.
 - BATCH TICKETS, INCLUDING MATERIAL QUANTITIES AND WEIGHTS SHALL ACCOMPANY THE LOAD, SHALL BE TRANSMITTED TO THE INSPECTOR OF RECORD BY THE TRUCK DRIVER WITH LOAD IDENTIFIED THEREON. THE LOAD SHALL NOT BE PLACED WITHOUT A BATCH TICKET IDENTIFYING THE MIX. THE INSPECTOR OF RECORD SHALL KEEP A DAILY RECORD OF PLACEMENTS, IDENTIFYING EACH TRUCK, ITS LOAD, AND TIME OF RECEIPT AT THE JOBSITE, AND APPROXIMATE LOCATION OF DEPOSIT IN THE STRUCTURE AND SHALL MAINTAIN A COPY OF THE DAILY RECORD AS REQUIRED BY THE ENFORCEMENT AGENCY.
- CONCRETE MAY BE PUMPED, POURED, TAILGATED, OR OTHER SUCH METHODS INTO PLACE. CONCRETE SHALL BE ALLOWED TO FREE FALL THE ENTIRE DEPTH OF THE FOUNDATION. PLACEMENT OF ANY FREE-FALL CONCRETE SHALL BE SUCH THAT THE CONCRETE DOES NOT ALTER THE EMBEDMENT DEPTH OR THE CLEARANCE OF THE REINFORCING BAR CAGE OR OTHER EMBEDDED MATERIALS.

ENGINEER'S APPROVAL

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP: 01-118971 INC:
 REVIEWED FOR
 SS FLS ACS
 DATE: 06/10/2020

DATE SIGNED
 11/28/2018

SITE SPECIFIC
 DSA APPROVAL

PRE-CHECK (PC) DOCUMENT
 CODE: 2016 CBC
 A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED

MBARCONSTRUCTION INC.
 674 RANCHEROS DR SAN MARCOS, CA 92069
 PHONE: (760) 744-4131
 FAX: (760) 744-4449
 GREGJ@MBARCONLINE.COM (775) 787-8845

ASTEL ENGINEERING
 STRUCTURAL ENGINEERING
 26030 ACHERO, SUITE 200 MISSION VIEJO, CA 92691
 PHONE: (949) 305-1150
 FAX: (949) 305-1420

VERSACANOPY GENERAL NOTES

DRAWN GM
 CHECKED KS
 DATE 11/28/2018
 4STEL JOB NO. MC03-01
 SHEET S-3
 3 OF 13 SHEETS

DSA DSA-103 Issued 9/10/17
List of Required Structural Tests & Special Inspections - 2016 CBC

INCIDENT # _____ DSA File No.: PC-119
 Application No.: SA-117117
 Date Submitted: _____ Revisited: _____

Sheet Name: Spread Footings without post installed anchors Sheets: _____


IMPORTANT: This form is only a summary list of structural tests and some of the special inspections required for the project. Generally, the structural tests and special inspections noted on this form are those that will be performed by the Geotechnical Engineer of Record, Laboratory of Record, or Special Inspector. The actual complete test and inspection program must be performed as detailed on the DSA approved documents. The appendices at the bottom of this form identify work NOT subject to DSA requirements for special inspection or structural testing. The project inspector is responsible for providing inspection of all tests of construction including but not limited to, special inspections not listed on this form such as structural wood framing, high-load wood diagrams, cold-formed steel framing, anchorage of non-structural components, etc. per Title 24, Part 2, Chapter 17A. NOTE: This form is also available for projects submitted for review under the 2007, 2010, and 2013 CBC.

INSTRUCTIONS: Click a plus sign (+) before any category or subcategory to reveal additional tests and special inspections. A shaded box indicates a test or special inspection that may be required, depending on the scope of the construction and other issues. A shaded box can be checked indicating your selection of that test. Note: A minus (-) on a category or subcategory heading indicates that it can be collapsed. However, any selection you may have made will be cleared. Click on the "COMPLIANT" button to show only the tests and inspections fully selected. For more information on use of this form, see DSA-103.INSTR.

Note: References are to the 2016 edition of the California Building Code (CBC) unless otherwise noted.

TEST OR SPECIAL INSPECTION	TEST	PERIODIC	CONTINUOUS	CODE REFERENCE AND NOTES
SOILS				
1. GENERAL:				Table 1705A.6
a. Verify that:				
- site has been properly prepared prior to placement of controlled fill and/or excavations.				
- foundation excavations are extended to proper depth and have reached proper materials.				
- materials below footings are adequate to achieve the design bearing capacity.				
Periodic	GE*			* By geotechnical engineer or his or her qualified representative. (See Appendix for exemptions.)
7. CAST IN PLACE CONCRETE				Table 1705A.3, ACI 318-14 Sections 26.12 & 26.13
a. Verify use of required design mix.				
Periodic	SI*			* To be performed by qualified batch-plant inspector and concrete sampling technician.
b. Identify, sample, and test reinforcing steel.				
Test	LOR			Table 1705A.2.1, ACI 318-14 Section 26.6.1.2, DSA IR 17-10.16
c. During concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
Test	LOR			Table 1705A.3 Item 6, ACI 318-14 Sections 26.5 & 26.12
d. Test concrete (f _c).				
Test	LOR			Table 1705A.1.6 (1909.3.7), ACI 318-14 Section 26.12.
Inspection:				Table 1705A.3, ACI 318-14 Sections 26.12 & 26.13
Material Verification and Testing:				
x. Verify use of required design mix.				
Periodic	SI*			* To be performed by qualified batch-plant inspector and concrete sampling technician.
y. Identify, sample, and test reinforcing steel.				
Test	LOR			Table 1705A.2.1, ACI 318-14 Section 26.6.1.2, DSA IR 17-10.16
z. During concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
Test	LOR			Table 1705A.3 Item 6, ACI 318-14 Sections 26.5 & 26.12
aa. Test concrete (f _c).				
Test	LOR			Table 1705A.1.6 (1909.3.7), ACI 318-14 Section 26.12.
Inspection:				Table 1705A.3, ACI 318-14 Sections 26.12 & 26.13
Material Verification and Testing:				
x. Verify use of required design mix.				
Periodic	SI*			* To be performed by qualified batch-plant inspector and concrete sampling technician.
y. Identify, sample, and test reinforcing steel.				
Test	LOR			Table 1705A.2.1, ACI 318-14 Section 26.6.1.2, DSA IR 17-10.16
z. During concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
Test	LOR			Table 1705A.3 Item 6, ACI 318-14 Sections 26.5 & 26.12
aa. Test concrete (f _c).				
Test	LOR			Table 1705A.1.6 (1909.3.7), ACI 318-14 Section 26.12.
Inspection:				Table 1705A.3, ACI 318-14 Sections 26.12 & 26.13
Material Verification and Testing:				
x. Verify use of required design mix.				
Periodic	SI*			* To be performed by qualified batch-plant inspector and concrete sampling technician.
y. Identify, sample, and test reinforcing steel.				
Test	LOR			Table 1705A.2.1, ACI 318-14 Section 26.6.1.2, DSA IR 17-10.16
z. During concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
Test	LOR			Table 1705A.3 Item 6, ACI 318-14 Sections 26.5 & 26.12
aa. Test concrete (f _c).				
Test	LOR			Table 1705A.1.6 (1909.3.7), ACI 318-14 Section 26.12.
Inspection:				Table 1705A.3, ACI 318-14 Sections 26.12 & 26.13
Material Verification and Testing:				
x. Verify use of required design mix.				
Periodic	SI*			* To be performed by qualified batch-plant inspector and concrete sampling technician.
y. Identify, sample, and test reinforcing steel.				
Test	LOR			Table 1705A.2.1, ACI 318-14 Section 26.6.1.2, DSA IR 17-10.16
z. During concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
Test	LOR			Table 1705A.3 Item 6, ACI 318-14 Sections 26.5 & 26.12
aa. Test concrete (f _c).				
Test	LOR			Table 1705A.1.6 (1909.3.7), ACI 318-14 Section 26.12.
Inspection:				Table 1705A.3, ACI 318-14 Sections 26.12 & 26.13
Material Verification and Testing:				
x. Verify use of required design mix.				
Periodic	SI*			* To be performed by qualified batch-plant inspector and concrete sampling technician.
y. Identify, sample, and test reinforcing steel.				
Test	LOR			Table 1705A.2.1, ACI 318-14 Section 26.6.1.2, DSA IR 17-10.16
z. During concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
Test	LOR			Table 1705A.3 Item 6, ACI 318-14 Sections 26.5 & 26.12
aa. Test concrete (f _c).				
Test	LOR			Table 1705A.1.6 (1909.3.7), ACI 318-14 Section 26.12.
Inspection:				Table 1705A.3, ACI 318-14 Sections 26.12 & 26.13
Material Verification and Testing:				
x. Verify use of required design mix.				
Periodic	SI*			* To be performed by qualified batch-plant inspector and concrete sampling technician.
y. Identify, sample, and test reinforcing steel.				
Test	LOR			Table 1705A.2.1, ACI 318-14 Section 26.6.1.2, DSA IR 17-10.16
z. During concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
Test	LOR			Table 1705A.3 Item 6, ACI 318-14 Sections 26.5 & 26.12
aa. Test concrete (f _c).				
Test	LOR			Table 1705A.1.6 (1909.3.7), ACI 318-14 Section 26.12.
Inspection:				Table 1705A.3, ACI 318-14 Sections 26.12 & 26.13
Material Verification and Testing:				
x. Verify use of required design mix.				
Periodic	SI*			* To be performed by qualified batch-plant inspector and concrete sampling technician.
y. Identify, sample, and test reinforcing steel.				
Test	LOR			Table 1705A.2.1, ACI 318-14 Section 26.6.1.2, DSA IR 17-10.16
z. During concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
Test	LOR			Table 1705A.3 Item 6, ACI 318-14 Sections 26.5 & 26.12
aa. Test concrete (f _c).				
Test	LOR			Table 1705A.1.6 (1909.3.7), ACI 318-14 Section 26.12.
Inspection:				Table 1705A.3, ACI 318-14 Sections 26.12 & 26.13
Material Verification and Testing:				
x. Verify use of required design mix.				
Periodic	SI*			* To be performed by qualified batch-plant inspector and concrete sampling technician.
y. Identify, sample, and test reinforcing steel.				
Test	LOR			Table 1705A.2.1, ACI 318-14 Section 26.6.1.2, DSA IR 17-10.16
z. During concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
Test	LOR			Table 1705A.3 Item 6, ACI 318-14 Sections 26.5 & 26.12
aa. Test concrete (f _c).				
Test	LOR			Table 1705A.1.6 (1909.3.7), ACI 318-14 Section 26.12.
Inspection:				Table 1705A.3, ACI 318-14 Sections 26.12 & 26.13
Material Verification and Testing:				
x. Verify use of required design mix.				
Periodic	SI*			* To be performed by qualified batch-plant inspector and concrete sampling technician.
y. Identify, sample, and test reinforcing steel.				
Test	LOR			Table 1705A.2.1, ACI 318-14 Section 26.6.1.2, DSA IR 17-10.16
z. During concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
Test	LOR			Table 1705A.3 Item 6, ACI 318-14 Sections 26.5 & 26.12
aa. Test concrete (f _c).				
Test	LOR			Table 1705A.1.6 (1909.3.7), ACI 318-14 Section 26.12.
Inspection:				Table 1705A.3, ACI 318-14 Sections 26.12 & 26.13
Material Verification and Testing:				
x. Verify use of required design mix.				
Periodic	SI*			* To be performed by qualified batch-plant inspector and concrete sampling technician.
y. Identify, sample, and test reinforcing steel.				
Test	LOR			Table 1705A.2.1, ACI 318-14 Section 26.6.1.2, DSA IR 17-10.16
z. During concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
Test	LOR			Table 1705A.3 Item 6, ACI 318-14 Sections 26.5 & 26.12
aa. Test concrete (f _c).				
Test	LOR			Table 1705A.1.6 (1909.3.7), ACI 318-14 Section 26.12.
Inspection:				Table 1705A.3, ACI 318-14 Sections 26.12 & 26.13
Material Verification and Testing:				
x. Verify use of required design mix.				
Periodic	SI*			* To be performed by qualified batch-plant inspector and concrete sampling technician.
y. Identify, sample, and test reinforcing steel.				
Test	LOR			Table 1705A.2.1, ACI 318-14 Section 26.6.1.2, DSA IR 17-10.16
z. During concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
Test	LOR			Table 1705A.3 Item 6, ACI 318-14 Sections 26.5 & 26.12
aa. Test concrete (f _c).				
Test	LOR			Table 1705A.1.6 (1909.3.7), ACI 318-14 Section 26.12.
Inspection:				Table 1705A.3, ACI 318-14 Sections 26.12 & 26.13
Material Verification and Testing:				
x. Verify use of required design mix.				
Periodic	SI*			* To be performed by qualified batch-plant inspector and concrete sampling technician.
y. Identify, sample, and test reinforcing steel.				
Test	LOR			Table 1705A.2.1, ACI 318-14 Section 26.6.1.2, DSA IR 17-10.16
z. During concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
Test	LOR			Table 1705A.3 Item 6, ACI 318-14 Sections 26.5 & 26.12
aa. Test concrete (f _c).				
Test	LOR			Table 1705A.1.6 (1909.3.7), ACI 318-14 Section 26.12.
Inspection:				Table 1705A.3, ACI 318-14 Sections 26.12 & 26.13
Material Verification and Testing:				
x. Verify use of required design mix.				
Periodic	SI*			* To be performed by qualified batch-plant inspector and concrete sampling technician.
y. Identify, sample, and test reinforcing steel.				
Test	LOR			Table 1705A.2.1, ACI 318-14 Section 26.6.1.2, DSA IR 17-10.16
z. During concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
Test	LOR			Table 1705A.3 Item 6, ACI 318-14 Sections 26.5 & 26.12
aa. Test concrete (f _c).				
Test	LOR			Table 1705A.1.6 (1909.3.7), ACI 318-14 Section 26.12.
Inspection:				Table 1705A.3, ACI 318-14 Sections 26.12 & 26.13
Material Verification and Testing:				
x. Verify use of required design mix.				
Periodic	SI*			* To be performed by qualified batch-plant inspector and concrete sampling technician.
y. Identify, sample, and test reinforcing steel.				
Test	LOR			Table 1705A.2.1, ACI 318-14 Section 26.6.1.2, DSA IR 17-10.16
z. During concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
Test	LOR			Table 1705A.3 Item 6, ACI 318-14 Sections 26.5 & 26.12
aa. Test concrete (f _c).				
Test	LOR			Table 1705A.1.6 (1909.3.7), ACI 318-14 Section 26.12.
Inspection:				Table 1705A.3, ACI 318-14 Sections 26.12 & 26.13
Material Verification and Testing:				
x. Verify use of required design mix.				
Periodic	SI*			* To be performed by qualified batch-plant inspector and concrete sampling technician.
y. Identify, sample, and test reinforcing steel.				
Test	LOR			Table 1705A.2.1, ACI 318-14 Section 26.6.1.2, DSA IR 17-10.16
z. During concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
Test	LOR			Table 1705A.3 Item 6, ACI 318-14 Sections 26.5 & 26.12
aa. Test concrete (f _c).				
Test	LOR			Table 1705A.1.6 (1909.3.7), ACI 318-14 Section 26.12.
Inspection:				Table 1705A.3, ACI 318-14 Sections 26.12 & 26.13
Material Verification and Testing:				
x. Verify use of required design mix.				
Periodic	SI*			* To be performed by qualified batch-plant inspector and concrete sampling technician.
y. Identify, sample, and test reinforcing steel.				
Test	LOR			Table 1705A.2.1, ACI 318-14 Section 26.6.1.2, DSA IR 17-10.16
z. During concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
Test	LOR			Table 1705A.3 Item 6, ACI 318-14 Sections 26.5 & 26.12
aa. Test concrete (f _c).				
Test	LOR			Table 1705A.1.6 (1909.3.7), ACI 318-14 Section 26.12.
Inspection:				Table 1705A.3, ACI 318-14 Sections 26.12 & 26.13
Material Verification and Testing:				
x. Verify use of required design mix.				
Periodic	SI*			* To be performed by qualified batch-plant inspector and concrete sampling technician.
y. Identify, sample, and test reinforcing steel.				
Test	LOR			Table 1705A.2.1, ACI 318-14 Section 26.6.1.2, DSA IR 17-10.16
z. During concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
Test	LOR			Table 1705A.3 Item 6, ACI 318-14 Sections 26.5 & 26.12
aa. Test concrete (f _c).				
Test	LOR			Table 1705A.1.6 (1909.3.7), ACI 318-14 Section 26.12.
Inspection:				Table 1705A.3, ACI 318-14 Sections 26.12 & 26.13
Material Verification and Testing:				
x. Verify use of required design mix.				
Periodic	SI*			* To be performed by qualified batch-plant inspector and concrete sampling technician.
y. Identify, sample, and test reinforcing steel.				
Test	LOR			Table 1705A.2.1, ACI 318-14 Section 26.6.1.2, DSA IR 17-10.16
z. During concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
Test	LOR			Table 1705A.3 Item 6, ACI 318-14 Sections 26.5 & 26.12
aa. Test concrete (f _c).				
Test	LOR			Table 1705A.1.6 (1909.3.7), ACI 318-14 Section 26.12.
Inspection:				Table 1705A.3, ACI 318-14 Sections 26.12 & 26.13
Material Verification and Testing:				
x. Verify use of required design mix.				
Periodic	SI*			* To be performed by qualified batch-plant inspector and concrete sampling technician.
y. Identify, sample, and test reinforcing steel.				
Test	LOR			Table 1705A.2.1, ACI 318-14 Section 26.6.1.2, DSA IR 17-10.16
z. During concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.				
Test	LOR			Table 1705A.3 Item 6, ACI 318-14 Sections 26.5 & 26.12
aa. Test concrete (f _c).				
Test	LOR			Table 1705A.


ROOF DECK SPECIFICATIONS						
SECTION PROPERTIES			TOP IN COMPRESSION		BOTTOM IN COMPRESSION	
GA	F _y (ksi)	WEIGHT (psf)	k _t (in. ² /ft.)	S _x (in. ³ /ft.)	k _b (in. ² /ft.)	S _y (in. ³ /ft.)
26	80	0.89	0.0840	0.0762	0.0817	0.0623

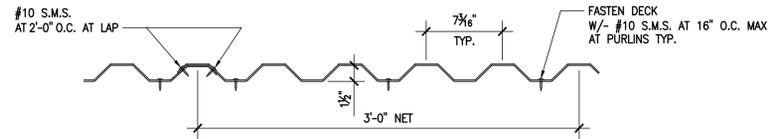

- NOTES:**
- MATERIAL AND SECTION PROPERTIES LISTED ABOVE ARE MINIMUM REQUIRED VALUES FOR METAL DECK BASED ON AEP HR-36 26 GA.
 - METAL ROOF DECK SHALL BE CLASS A PER CBC CHAPTERS 7A AND 15.

3 DECK DETAIL

N.T.S.

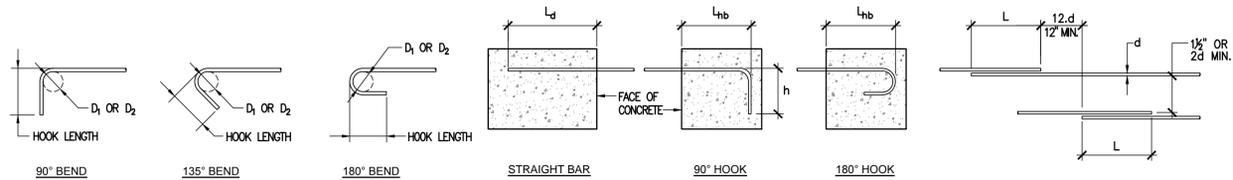

BAR SIZE	D ₁	D ₂
#3	1 1/2"	2 1/4"
#4	2"	3"
#5	2 1/2"	3 3/4"
#6, #7, #8	6 1/4"	6 1/4"

D₁ - FINISHED BEND DIA. FOR STIRRUP & TIE HOOKS.
D₂ - BEND DIA. FOR STD HOOKS.
'd' - BAR DIAMETER

BAR SIZE	MAIN REINF.		STIRRUP & TIE HOOKS	
	90°	180°	90°	180°
#3	6"	4"	3 1/2"	4 1/2"
#4	8"	4 1/2"	4 1/2"	4 1/2"
#5	10"	5"	5"	6"
#6	12"	6"	12"	7 1/2"
#7	14"	7"	14"	9"
#8	16"	8"	16"	10"

REINFORCEMENT DEVELOPMENT LENGTHS				
CONCRETE STRENGTH F _c = 3,000 PSI				
NOMINAL BAR SIZE	h	L _d		L _{hb}
		TOP BARS	OTHER BARS	
#3	6"	1'-10"	1'-5"	9"
#4	8"	2'-5"	1'-10"	11"
#5	10"	3'-0"	2'-4"	1'-2"
#6	12"	3'-7"	2'-9"	1'-5"
#7	14"	5'-3"	4'-0"	1'-7"
#8	16"	6'-0"	4'-7"	1'-10"

- NOTES:**
- TOP BARS ARE HORIZONTAL BARS WITH MORE THAN 12 INCHES OF CONCRETE CAST BELOW.

REINFORCEMENT LAP SPLICE LENGTH 'L'		
CONCRETE STRENGTH F _c = 3,000 PSI		
NOMINAL BAR SIZE	TOP BARS	OTHER BARS
#3	2'-4"	1'-10"
#4	3'-2"	2'-5"
#5	3'-11"	3'-0"
#6	4'-8"	3'-7"
#7	6'-9"	5'-3"
#8	7'-9"	6'-0"

- NOTES:**
- LAP SPLICE SHALL BE INCREASED 50% WHERE CLEAR SPACE BETWEEN BARS IS LESS THAN 2 BAR DIAMETERS AND/OR THE CLEAR COVER IS LESS THAN ONE BAR DIAMETER.

A STANDARD HOOKS

B DEVELOPMENT LENGTHS


C OFFSETS AND LAP SPLICES

4 TYPICAL REINFORCEMENT BAR BENDS AND LAPS

N.T.S.

SECTION NAME	D (in)	B (in)	L (in)	GA	WT (lb/ft)	A (in ²)	AXIS X-X			AXIS Y-Y		
							I _x (in ⁴)	S _x (in ³)	r _x (in)	I _y (in ⁴)	S _y (in ³)	r _y (in)
CS12 x 4 x 0.102 (12 GA)	12	4.0	1.0	12	7.35	2.16	46.87	6.76	4.66	4.38	1.53	1.42
CS12 x 4 x 0.124 (10 GA)	12	4.0	1.0	10	8.91	2.62	56.37	8.59	4.64	5.20	1.82	1.41
CS14 x 4 x 0.102 (12 GA)	14	4.0	1.0	12	8.04	2.36	67.42	8.22	5.34	4.57	1.55	1.39

- NOTES:**
- ALL PURLIN SECTIONS ARE ASTM A653, GR 55, F_y=55 ksi
 - ALL LIGHT GAGE STEEL DESIGNED USING 2012 AISI COLD-FORMED STEEL DESIGN MANUAL.
 - PROPERTIES PER AEP STANDARD SIZES.
 - ACTUAL MANUFACTURER'S PROPERTIES MUST MEET OR EXCEED AEP STANDARD PROPERTIES.

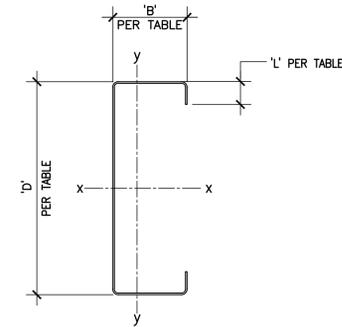


1 PURLIN & BEAM COLD FORMED C-SECTION

N.T.S.

SECTION NAME	D (in)	B (in)	t (in)	WT (lb/ft)	A (in ²)	AXIS X-X			AXIS Y-Y		
						I _x (in ⁴)	S _x (in ³)	r _x (in)	I _y (in ⁴)	S _y (in ³)	r _y (in)
HSS 12 x 6 x 1/4	12	6	1/4	29.23	8.59	161.00	26.80	4.33	55.20	18.40	2.53

- NOTES:**
- ALL COLUMNS SHALL BE ASTM A1085 GR. 50 (F_y=50 ksi)

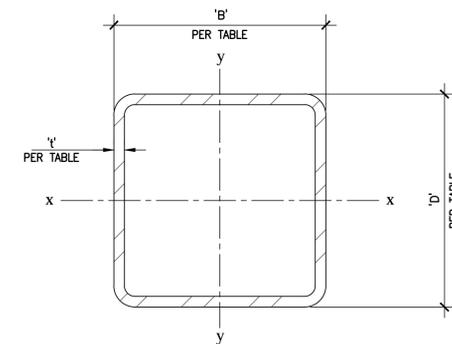

2 HSS COLUMN

N.T.S.

ENGINEER'S APPROVAL

IDENTIFICATION STAMP
DIVISION OF THE STATE ARCHITECT
APP: 01-118971 INC:
REVIEWED FOR
SS FLS ACS
DATE: 06/10/2020

DATE SIGNED
11/28/2018



SITE SPECIFIC DSA APPROVAL

FILE NUMBER: PC-119
IDENTIFICATION STAMP
DIVISION OF THE STATE ARCHITECT
APP. NO: 04-117111 INCR
AC. DF. RES. DS. SF. DP.
DATE: 12/05/2018

PRE-CHECK (PC) DOCUMENT
CODE: 2016 CBC
A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED

MBARC CONSTRUCTION INC.
PHONE: (760) 744-4131
SAN MARCOS, CA
FAX: (760) 744-4449
GREGJ@MBARCONLINE.COM (775) 787-8845

4STEL ENGINEERING
STRUCTURAL ENGINEERING
PHONE: (949) 305-1150
26030 ACHERO, SUITE 200
MISSION VIEJO, CA 92691
FAX: (949) 305-1420

VERSA CANOPY SECTION PROPERTIES & REBAR DETAILS

DRAWN GM
CHECKED KS
DATE 11/28/2018
4STEL JOB NO. MC03-01
SHEET S-5

ENGINEER'S APPROVAL

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP: 01-118971 INC:
 REVIEWED FOR
 SS FLS ACS
 DATE: 06/10/2020

DATE SIGNED
 11/28/2018



SITE SPECIFIC DSA APPROVAL

FILE NUMBER: PC-119
 IDENTIFICATION STAMP
 DIVISION OF THE STATE ARCHITECT
 APP. NO: 04-117111 INC:
 AC. DF. DES. DS. PS. DP.
 DATE: 12/05/2018

PRE-CHECK (PC) DOCUMENT
 CODE: 2016 CBC
 A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED

MBARC CONSTRUCTION INC.
 IIC # 869960
 B AND C51
 PHONE: (760) 744-4131
 FAX: (760) 744-4449
 GREGJ@MBARCONLINE.COM | (775) 787-8845
 674 RANCHEROS DR
 SAN MARCOS, CA 92069
 GREG JONES

4STEL ENGINEERING
 STRUCTURAL ENGINEERING
 26030 A CHERO, SUITE 200
 MISSION VIEJO, CA 92691
 PHONE: (949) 305-1150
 FAX: (949) 305-1420

VERSA CANOPY VC14, VC18 & VC20 FRAMING SCHEDULES

DRAWN GM
 CHECKED KS
 DATE 11/28/2018
 4STEL JOB NO. MC03-01
 SHEET S-7
 7 OF 13 SHEETS

VC14, VC18 & VC20 PURLIN SCHEDULE

I.D. #	MAX GROUND SNOW LOAD	MAX PURLIN SPACING (PS)	MAX COLUMN SPACING (S)	MAX CANTILEVER SPAN (CS)	PURLIN	
					SECTION	DETAIL
VC14	0 psf	63"	27'-0"	10'-0"	CS12 x 4 x 0.102 (12 GA)	1 S-5
VC18	0 psf	87"	27'-0"	10'-0"	CS12 x 4 x 0.124 (10 GA)	1 S-5
VC20	0 psf	99"	19'-0"	8'-0"	CS14 x 4 x 0.102 (12 GA)	1 S-5

- NOTES:
 1. REFER TO SHEET 'S-2' FOR CONSTRUCTION OPTIONS.
 2. REFER TO DETAIL '4/S-12' FOR ALLOWABLE PURLIN PENETRATIONS.
 3. MULTIPLE STRUCTURE ID'S MAY BE SELECTED WITHIN THE SAME SITE.
 4. WHEN UTILIZING A STRUCTURE ID READ FROM WITHIN THAT ID'S ROW ONLY.


1 VC14, VC18 & VC20
 - TYPICAL PURLIN SCHEDULE

VC14, VC18 & VC20 BEAM/COLUMN SCHEDULE


I.D. #	MAX GROUND SNOW LOAD	MAX WIDTH (W)	BEAM SHORT SPAN MIN (SS)	BEAM LONG SPAN MAX (LS)	MAX COLUMN SPACING (S)	ROOF SLOPE	BEAM		BEAM TO COLUMN DETAIL	COLUMN		MAX COLUMN HEIGHT
							SECTION	DETAIL		SECTION	DETAIL	
VC18	0 psf	18'-0"	7'-9"	10'-3"	27'-0"	3:12 MAX	CS12 x 4 x 0.102 (12 GA)	1 S-5	13 S-11	HSS 12 x 6 x 1/4	2 S-5	17'-9"
VC20	0 psf	20'-0"	5'-9"	14'-3"	19'-0"	3:12 MAX	CS14 x 4 x 0.124 (10 GA)	1 S-5	13 S-11	HSS 12 x 6 x 1/4	2 S-5	17'-0"

- NOTES:
 1. MULTIPLE STRUCTURE ID'S MAY BE SELECTED WITHIN THE SAME SITE.
 2. WHEN UTILIZING A STRUCTURE ID READ FROM WITHIN THAT ID ROW ONLY.
 3. THE SHORT SPAN AND LONG SPANS MAY BE ADJUSTED WITH THE FOLLOWING REQUIREMENT:
 THE OVERALL CANOPY WIDTH IS NOT EXCEEDED, NEITHER SPAN IS LESS THAN THE MIN SHORT SPAN & NEITHER SPAN EXCEEDS THE MAX LONG SPAN.


2 VC14, VC18 & VC20
 - TYPICAL BEAM/COLUMN SCHEDULE

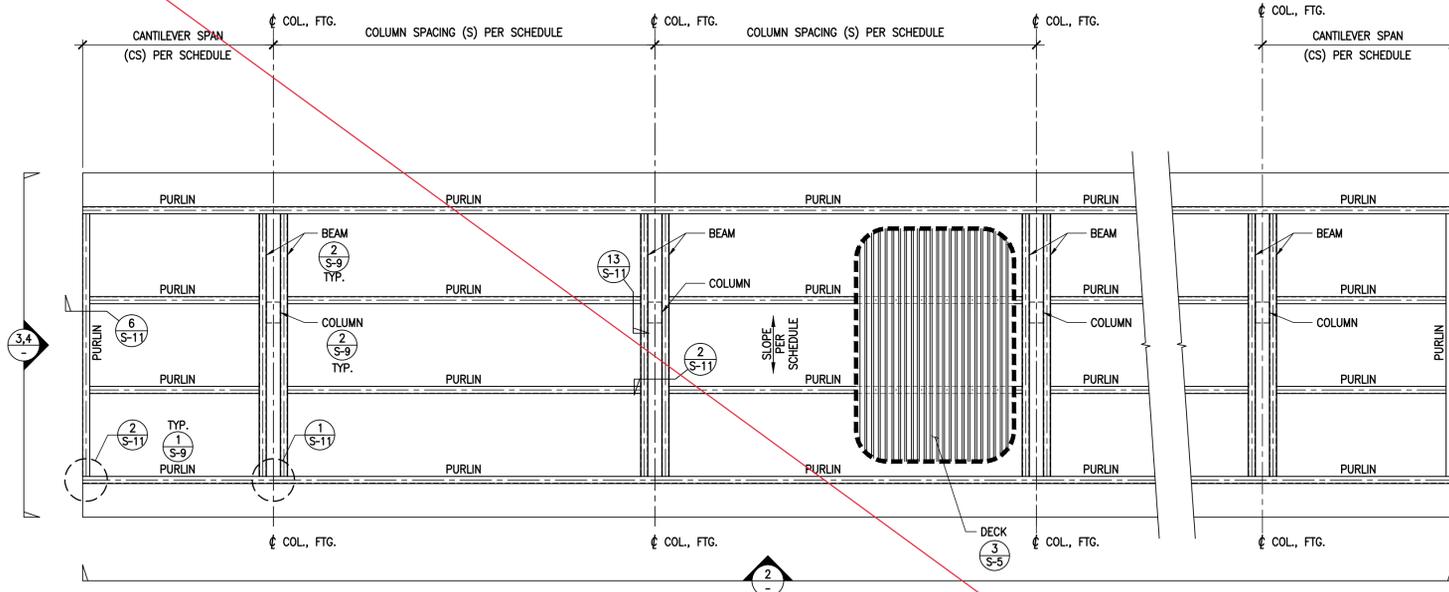


1 VC140, VC180 & VC200
 TYPICAL PLAN VIEW 1/4"=1'-0"

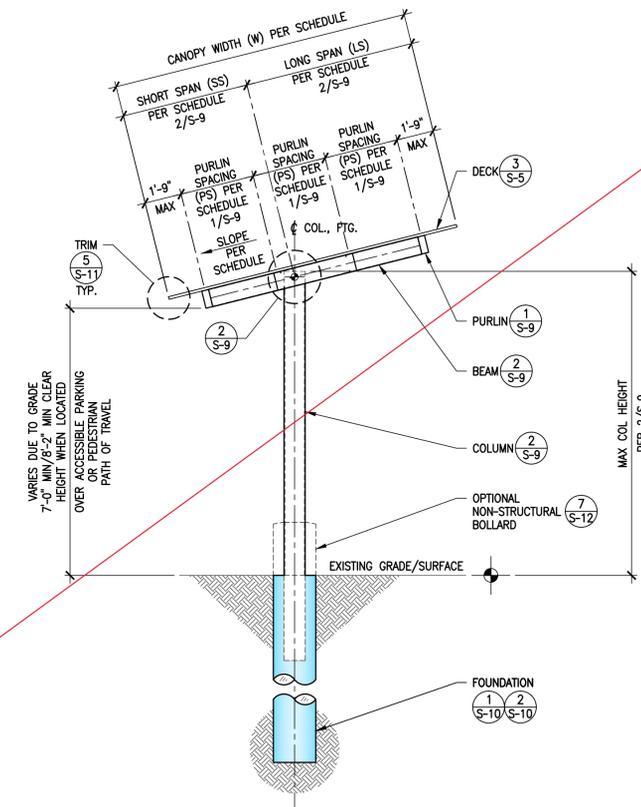

3 VC140, VC180 & VC200
 TYPICAL SIDE ELEVATION 1 1/4"=1'-0"

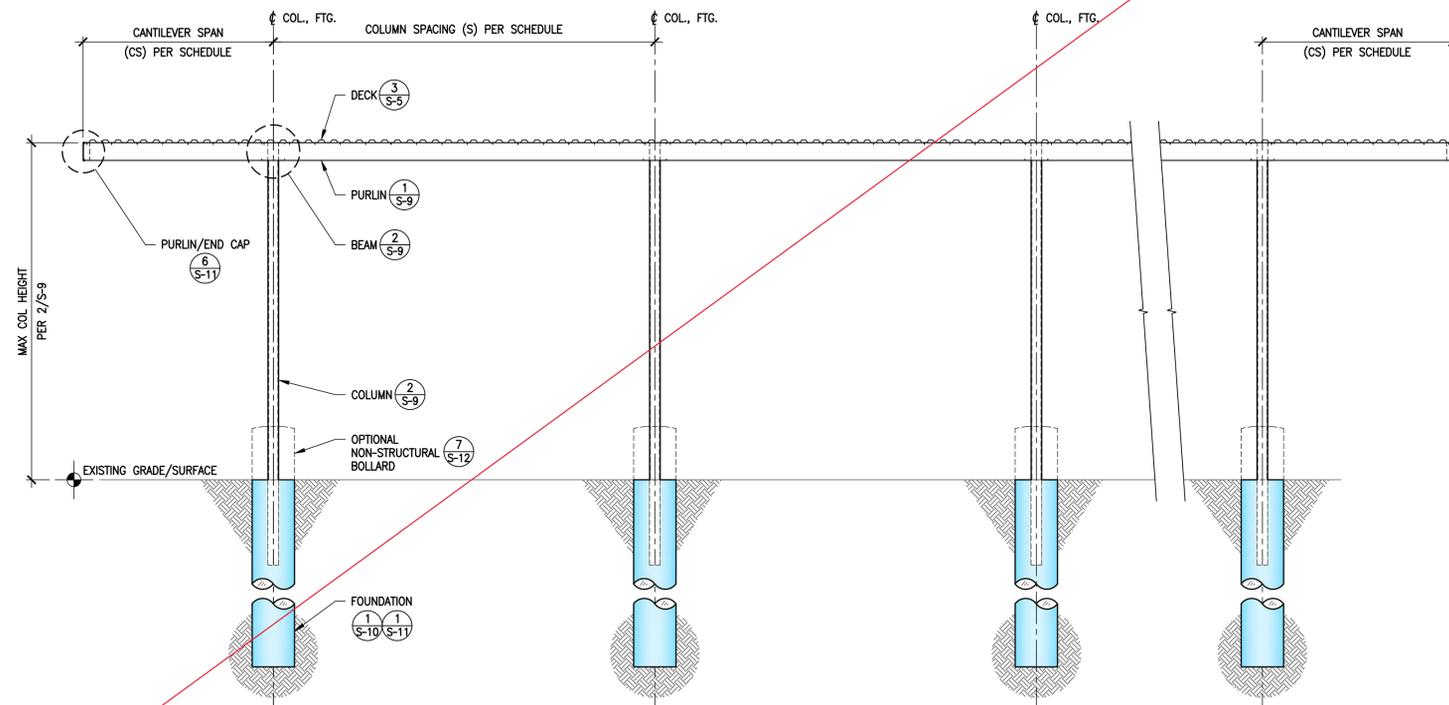

2 VC140, VC180 & VC200
 TYPICAL FRONT ELEVATION 1/4"=1'-0"

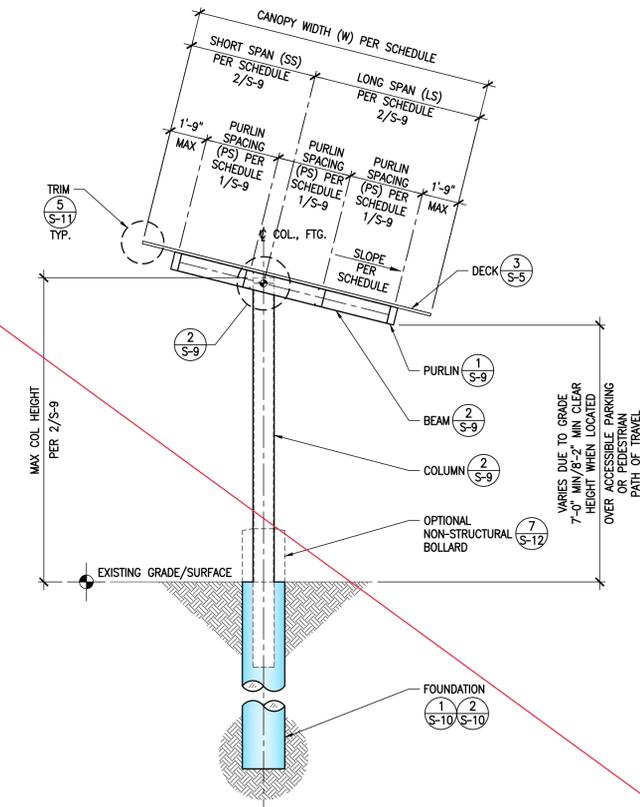

4 VC140, VC180 & VC200
 TYPICAL SIDE ELEVATION 2 1/4"=1'-0"

ENGINEER'S APPROVAL

DATE SIGNED
 11/28/2018



SITE SPECIFIC
 DSA APPROVAL

FILE NUMBER: PC-119
 IDENTIFICATION STAMP
 DIVISION OF THE STATE ARCHITECT
 APP. NO. G: 117117 INCR
 AC, DF, DS, SS, DP
 DATE: 12/05/2018

PRE-CHECK (PC) DOCUMENT
 CODE: 2016 CBC
 A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED

MBARC CONSTRUCTION INC.
 IIC # 869980
 B AND C 51
 PHONE: (760) 744-4131
 SAN MARCOS, CA
 FAX: (760) 744-4449
 GREGJ@MBARCONLINE.COM (775) 787-8845
 GREG JONES

4STEL ENGINEERING
 STRUCTURAL ENGINEERING
 26030 ACHERO, SUITE 200
 MISSION VIEJO, CA 92691
 PHONE: (949) 305-1150
 FAX: (949) 305-1420

VERSA CANOPY
 VC140, VC180 & VC200
 FRAMING PLAN & ELEVATIONS

DRAWN GM
 CHECKED KS
 DATE 11/28/2018
 4STEL JOB NO. MC03-01
 SHEET

S-8
 8 OF 13 SHEETS

VC140, VC180 & VC200 PURLIN SCHEDULE

I.D. #	MAX GROUND SNOW LOAD	MAX PURLIN SPACING (PS)	MAX COLUMN SPACING (S)	MAX CANTILEVER SPAN (CS)	PURLIN	
					SECTION	DETAIL
VC140	20 psf	42"	27'-0"	9'-0"	CS12 x 4 x 0.102 (12 GA)	① S-5
VC180	20 psf	58"	27'-0"	8'-6"	CS14 x 4 x 0.102 (12 GA)	① S-5
VC200	20 psf	66"	19'-0"	7'-9"	CS14 x 4 x 0.102 (12 GA)	① S-5

- NOTES:**
- REFER TO SHEET 'S-2' FOR CONSTRUCTION OPTIONS.
 - REFER TO DETAIL '4/S-12' FOR ALLOWABLE PURLIN PENETRATIONS.
 - MULTIPLE STRUCTURE ID'S MAY BE SELECTED WITHIN THE SAME SITE.
 - WHEN UTILIZING A STRUCTURE ID READ FROM WITHIN THAT ID'S ROW ONLY.
 - PURLIN SPACING MAY BE INCREASED BEYOND THE MAXIMUMS GIVEN IN THE CHART ABOVE AS LONG AS THE TRIBUTARY WIDTH TO THE PURLIN DOES NOT EXCEED 'PS'.

1 VC140, VC180 & VC200
- TYPICAL PURLIN SCHEDULE

VC140, VC180 & VC200 BEAM/COLUMN SCHEDULE

I.D. #	MAX GROUND SNOW LOAD	MAX WIDTH (W)	BEAM SHORT SPAN MIN (SS)	BEAM LONG SPAN MAX (LS)	MAX COLUMN SPACING (S)	ROOF SLOPE	BEAM		BEAM TO COLUMN DETAIL	COLUMN		MAX COLUMN HEIGHT
							SECTION	DETAIL		SECTION	DETAIL	
							VC140	20 psf		14'-0"	5'-3"	
VC180	20 psf	18'-0"	8'-0"	10'-0"	27'-0"	3:12 MAX	CS14 x 4 x 0.102 (12 GA)	① S-5	⑬ S-11	HSS 12 x 6 x 1/4	② S-5	16'-6"
VC200	20 psf	20'-0"	6'-9"	13'-3"	19'-0"	3:12 MAX	CS14 x 4 x 0.124 (10 GA)	① S-5	⑬ S-11	HSS 12 x 6 x 1/4	② S-5	16'-9"

- NOTES:**
- MULTIPLE STRUCTURE ID'S MAY BE SELECTED WITHIN THE SAME SITE.
 - WHEN UTILIZING A STRUCTURE ID READ FROM WITHIN THAT ID ROW ONLY.
 - THE SHORT SPAN AND LONG SPANS MAY BE ADJUSTED WITH THE FOLLOWING REQUIREMENT:
THE OVERALL CANOPY WIDTH IS NOT EXCEEDED, NEITHER SPAN IS LESS THAN THE MIN SHORT SPAN & NEITHER SPAN EXCEEDS THE MAX LONG SPAN.


2 VC140, VC180 & VC200
- TYPICAL BEAM/COLUMN SCHEDULE

ENGINEER'S APPROVAL

DATE SIGNED
11/28/2018



SITE SPECIFIC
DSA APPROVAL



PRE-CHECK (PC) DOCUMENT
CODE: 2016 CBC
A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED








MBARC CONSTRUCTION INC.
 674 RANCHEROS DR
 SAN MARCOS, CA 92069
 PHONE: (760) 744-4131
 FAX: (760) 744-4449
 GREGJ@MBARCONLINE.COM | (775) 787-8845
 IIC # 869960
 B AND C51

4STEL ENGINEERING
 STRUCTURAL ENGINEERING
 26030 A CHERO, SUITE 200
 MISSION VIEJO, CA 92691
 PHONE: (949) 305-1150
 FAX: (949) 305-1420

VERSA CANOPY
VC140, VC180 & VC200
FRAMING SCHEDULES

DRAWN GM
CHECKED KS
DATE 11/28/2018
4STEL JOB NO. MC03-01
SHEET

S-9
9 OF 13 SHEETS

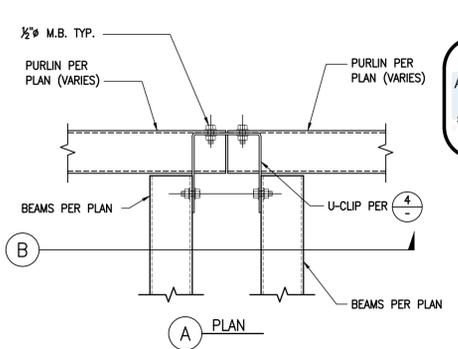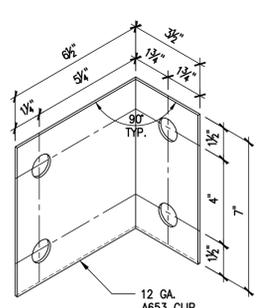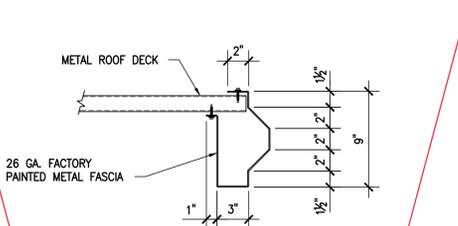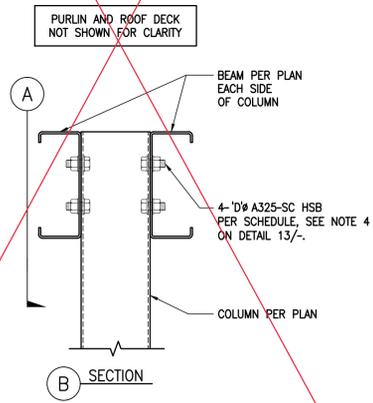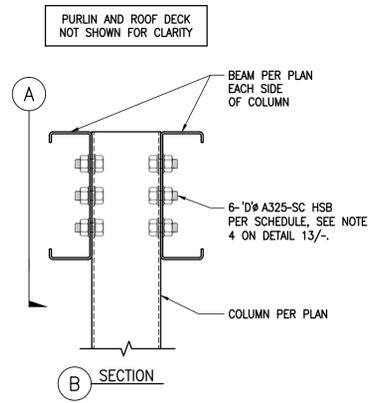
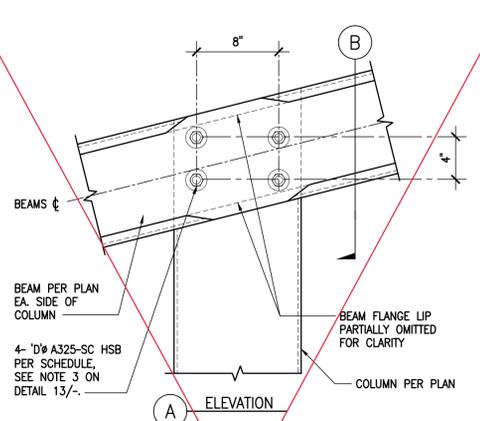
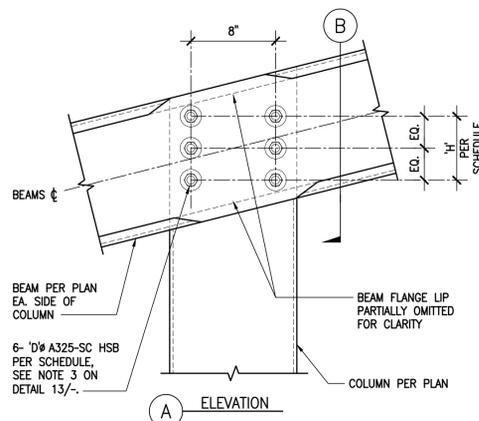


NOTES:

- ROOF DECK NOT SHOWN FOR CLARITY.
- PURLINS AT CANTILEVER SHALL BE CONTINUOUS.

7 ROOF DECK TRIM DETAIL (OPTIONAL) 3"=1'-0"



3 L-CLIP INTERIOR PURLIN TO BEAM 3"=1'-0"

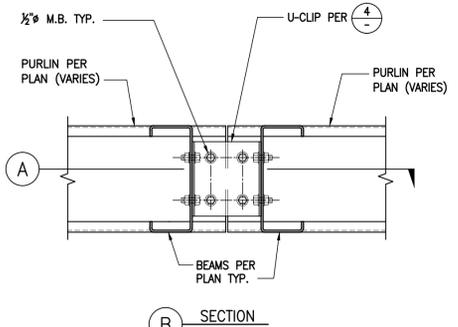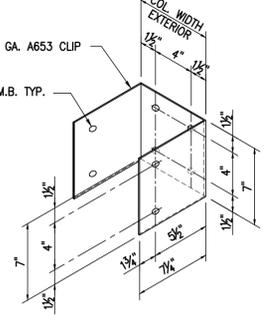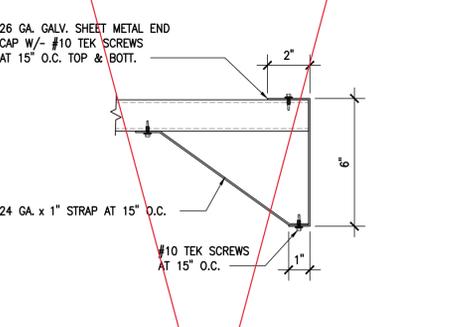


8 ROOF DECK TRIM DETAIL (OPTIONAL) 1-1/2"=1'-0"

4 U-CLIP EXTERIOR PURLIN TO BEAM 1-1/2"=1'-0"

1 EXTERIOR PURLIN TO BEAM 1-1/2"=1'-0"

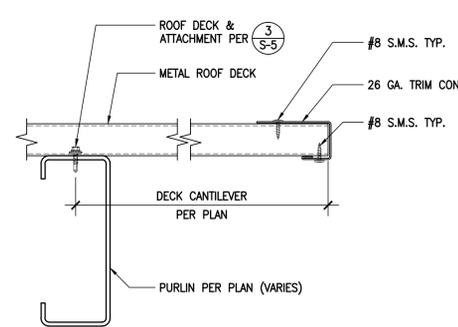
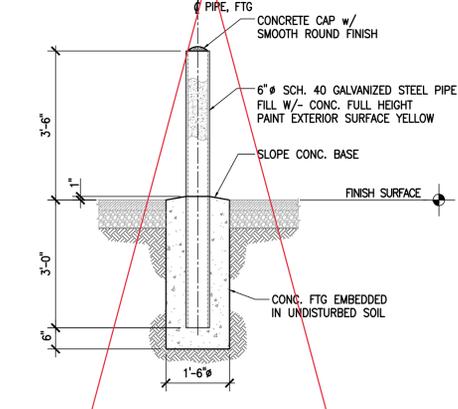


5 ROOF DECK TRIM DETAIL 3"=1'-0"

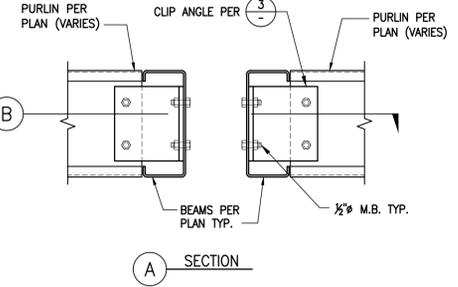


NOTES:

- ROOF DECK NOT SHOWN FOR CLARITY.

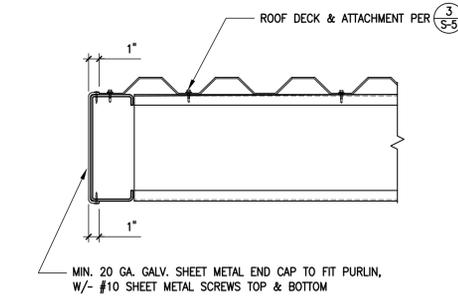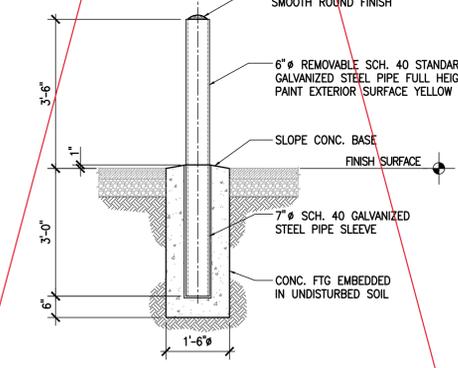

6 END ENCLOSURE DETAIL 1-1/2"=1'-0"

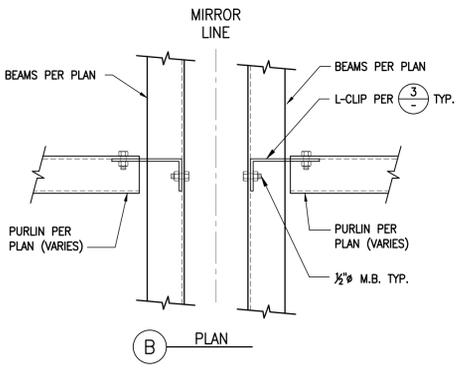

2 INTERIOR PURLIN TO BEAM 1-1/2"=1'-0"

BEAM TO COLUMN CONNECTION SCHEDULE					
I.D. #	MAX GROUND SNOW LOAD	# OF BOLTS (n)	BOLTED CONNECTION DETAIL	BOLT DIAMETER (D) ASTM A325-SC	BOLT PATTERN (B x H)
VC14	0 psf	4	11	1"	8" x 6"
VC18	0 psf	6	12	7/8"	8" x 6"
VC20	0 psf	6	12	7/8"	8" x 8"
VC140	20 psf	4	11	1"	8" x 6"
VC180	20 psf	6	12	7/8"	8" x 8"
VC200	20 psf	6	12	7/8"	8" x 8"

NOTES:

- MULTIPLE STRUCTURE ID'S MAY BE SELECTED WITHIN THE SAME SITE.
- WHEN UTILIZING A STRUCTURE ID READ FROM WITHIN THAT ID ROW ONLY.
- BOLTS SHALL BE PRETENSIONED A325-SC (SLIP-CRITICAL) TYPE N (THREADS NOT EXCLUDED FROM SHEAR PLANE) CLASS A FAYING SURFACE WITH STANDARD NUTS PER ASTM A563 AND WASHERS PER ASTM F436 TYPICAL U.N.O.
- BOLTS, NUTS AND WASHERS SHALL BE GALVANIZED.

10 TYPICAL BOLLARD 1/2"=1'-0"

6 END ENCLOSURE DETAIL 1-1/2"=1'-0"

2 INTERIOR PURLIN TO BEAM 1-1/2"=1'-0"

12 BEAM TO COLUMN - 6 BOLT

11 BEAM TO COLUMN - 4 BOLT 1-1/2"=1'-0"

13 BEAM TO COLUMN SCHEDULE N.T.S.

ENGINEER'S APPROVAL

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 01-118971 INC:
REVIEWED FOR
SS FLS ACS
DATE: 06/10/2020

DATE SIGNED
11/28/2018

SITE SPECIFIC DSA APPROVAL

PRE-CHECK (PC) DOCUMENT
CODE: 2016 CBC
A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED

MBARC CONSTRUCTION INC.
674 RANCHEROS DR
SAN MARCOS, CA 92069
PHONE: (760) 744-4131
FAX: (760) 744-4449
GREGJ@MBARCONLINE.COM (775) 787-8845


4STEL ENGINEERING STRUCTURAL ENGINEERING
26030 ACHERO, SUITE 200
MISSION VIEJO, CA 92691
PHONE: (949) 305-1150
FAX: (949) 305-1420

VERSA CANOPY STANDARD DETAILS 1

DRAWN GM CHECKED KS
DATE 11/28/2018
4STEL JOB NO. MC03-01
SHEET **S-11**
11 OF 13 SHEETS

NOTES:


1. CONCRETE BOLLARDS TO BE POURED IN A SECOND POUR AFTER THE FOUNDATION BELOW GRADE IS POURED. DSA INSPECTOR TO PERIODICALLY INSPECT THE INSTALLATION OF BONDING AGENT WHEN USED.
2. BOLLARD REBAR CAGE SHALL BE CONSTRUCTED INDEPENDENTLY FROM THE FOUNDATION USING 4-#4 VERTICAL BARS UNLESS WET SET IS PERFORMED PER NOTE 3 OR CONTINUOUS FOUNDATION BARS ARE USED PER NOTE 4.
3. VERTICAL BARS IN THE NONSTRUCTURAL BOLLARD ARE PERMITTED TO BE WET SET INTO THE STRUCTURAL FOUNDATION, PROVIDED THE FOUNDATION IS SUFFICIENTLY WORKABLE SO AS NOT TO REQUIRE HAMMERING IN OR ANY OTHER SUCH METHOD. WET SET SHALL BE PERFORMED USING #4 BARS WITH MINIMUM 20' EMBEDMENT.
4. BOLLARD REINFORCING IS PERMITTED TO USE MIN. (4) FOUNDATION VERT. BARS CONTINUOUS TO 3' BELOW TOP OF BOLLARD IN LIEU OF 4-#4 BARS.

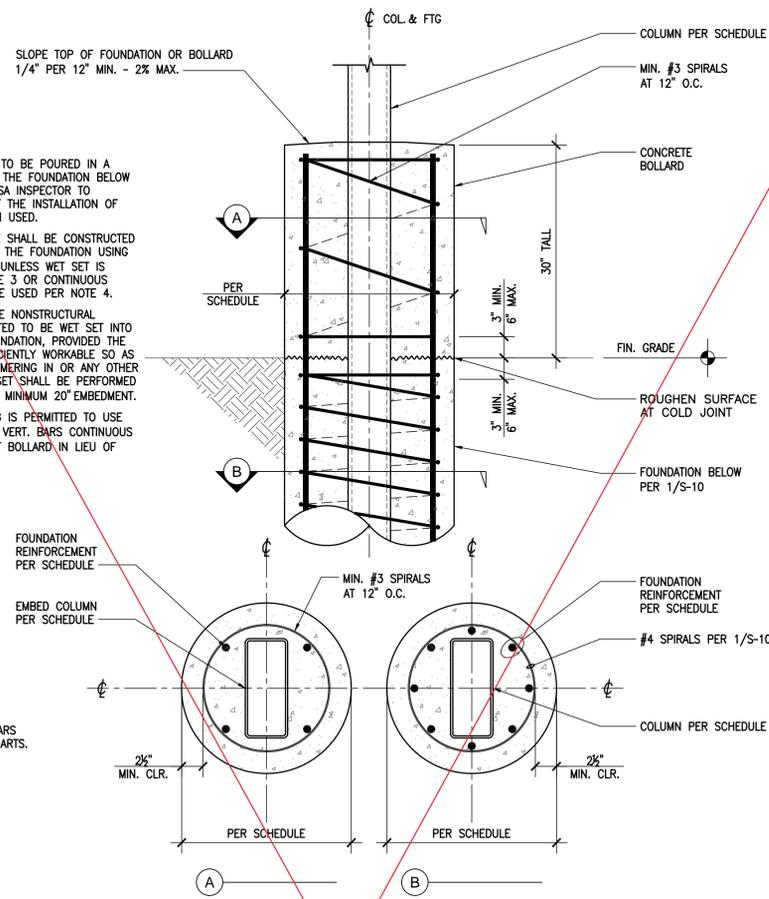

7 OPTIONAL CONCRETE BOLLARD
1"=1'-0"


NOTE:

NUMBER AND SIZES OF BARS VARY SEE FOUNDATION CHARTS.

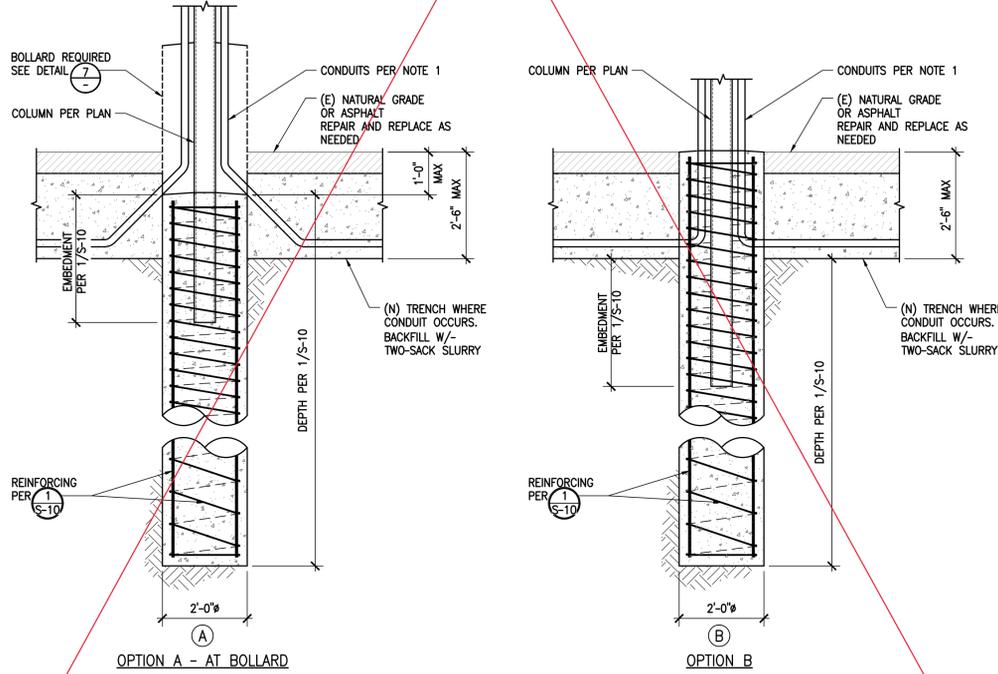


8 CONDUIT AT DRILLED PIER
1"=1'-0"

- NOTE:**
1. CONDUIT IN FOUNDATION SHALL NOT EXCEED (1) 2" MAX Ø CONDUIT OR (2) 1 1/2" MAX Ø CONDUIT. WHEN (2) CONDUIT ARE USED IN THE SAME FOUNDATION, THE CONDUIT MAY ENTER THE FOUNDATION FROM EITHER SIDE.
 2. CONDUIT TRENCH SHALL BE FILLED WITH MIN 2-SACK SLURRY.

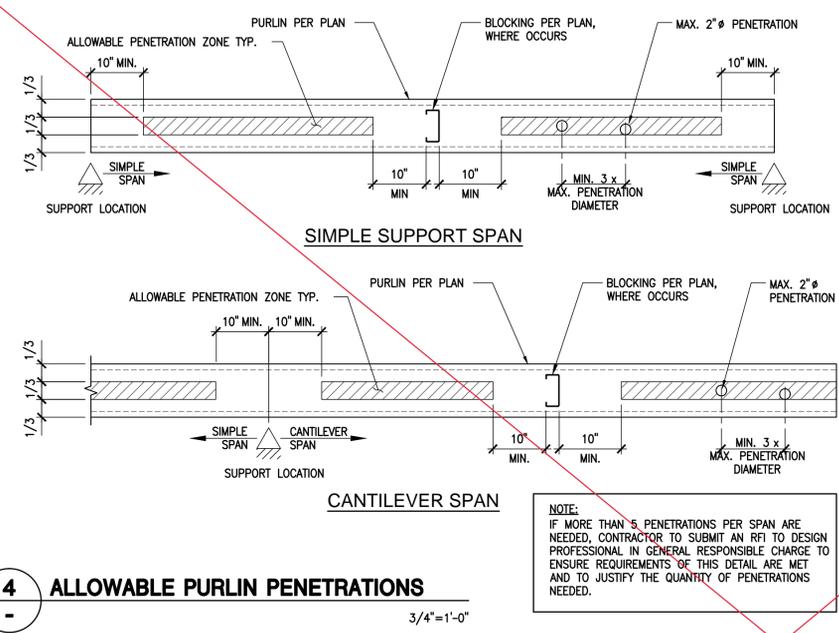


4 ALLOWABLE PURLIN PENETRATIONS
3/4"=1'-0"

NOTE:
IF MORE THAN 5 PENETRATIONS PER SPAN ARE NEEDED, CONTRACTOR TO SUBMIT AN RFI TO DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE TO ENSURE REQUIREMENTS OF THIS DETAIL ARE MET AND TO JUSTIFY THE QUANTITY OF PENETRATIONS NEEDED.

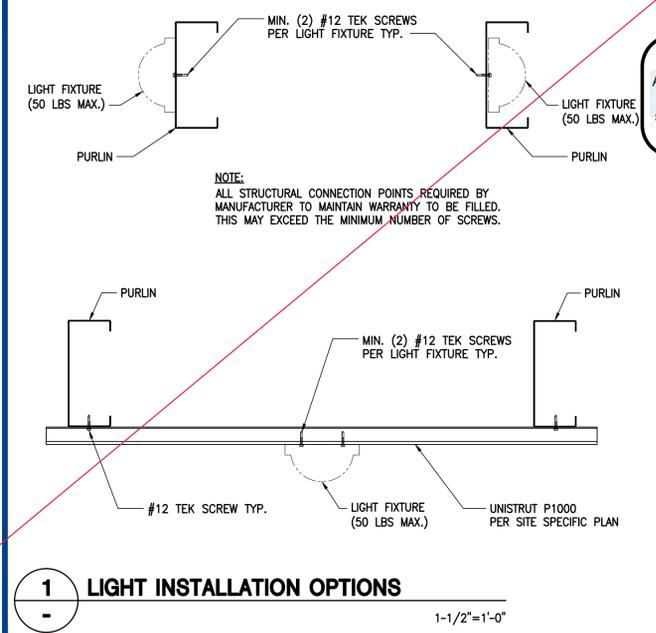


1 LIGHT INSTALLATION OPTIONS
1-1/2"=1'-0"

NOTE:
ALL STRUCTURAL CONNECTION POINTS REQUIRED BY MANUFACTURER TO MAINTAIN WARRANTY TO BE FILLED. THIS MAY EXCEED THE MINIMUM NUMBER OF SCREWS.

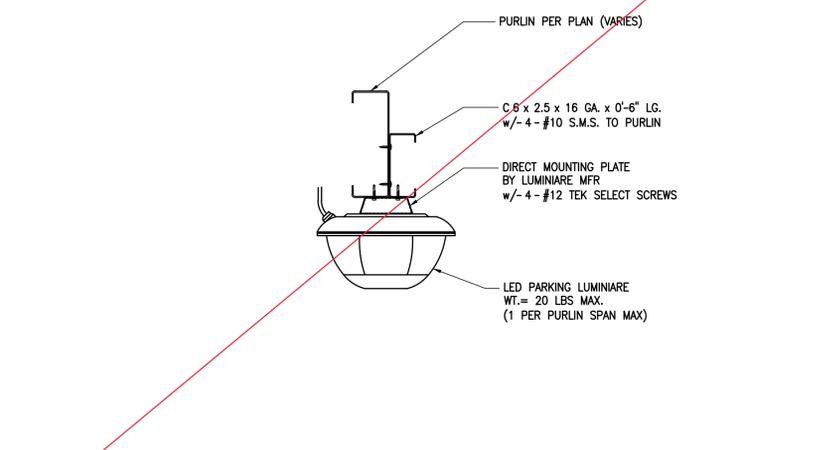


5 TYPICAL PARKING LUMINAIRE AT PURLIN
1 1/2"=1'-0"

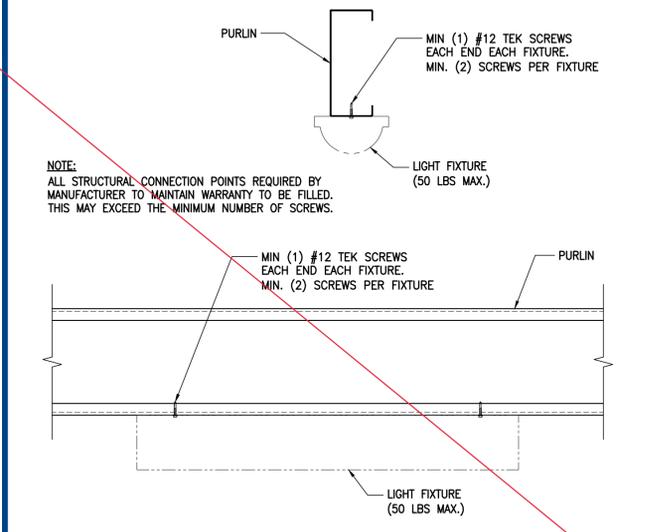


2 ALTERNATE LIGHT INSTALLATION OPTIONS
1-1/2"=1'-0"

NOTE:
ALL STRUCTURAL CONNECTION POINTS REQUIRED BY MANUFACTURER TO MAINTAIN WARRANTY TO BE FILLED. THIS MAY EXCEED THE MINIMUM NUMBER OF SCREWS.

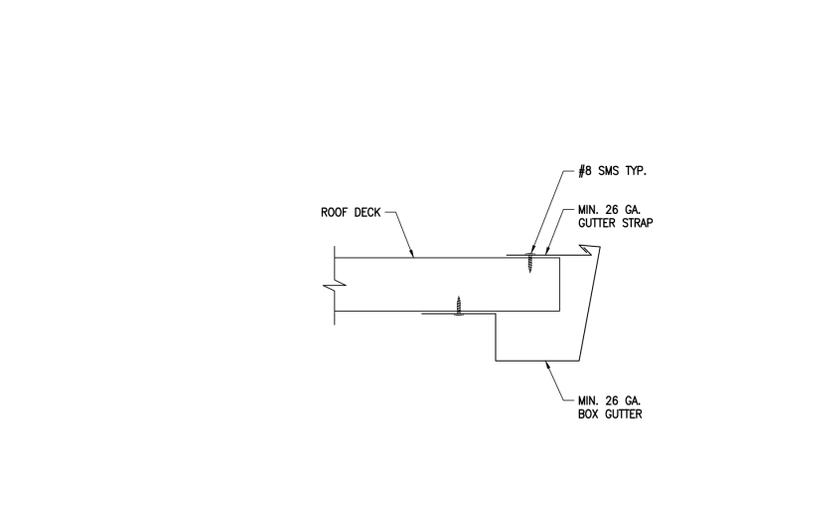

6 GUTTER DETAIL
3"=1'-0"

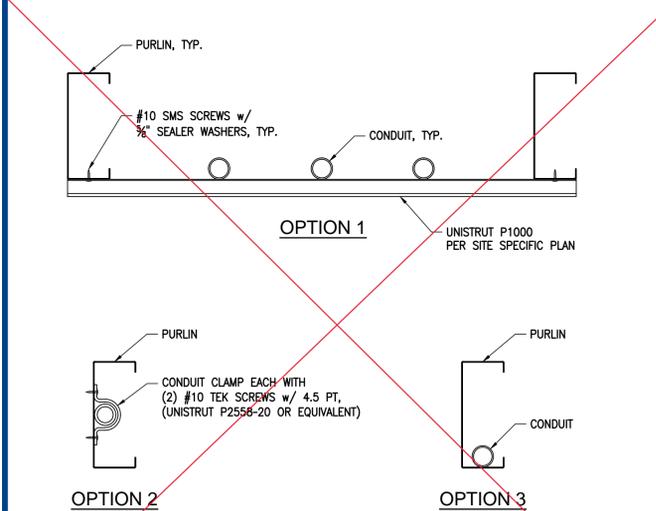

3 CONDUIT SUPPORT/ LOCATION OPTIONS
1-1/2"=1'-0"

ENGINEER'S APPROVAL

IDENTIFICATION STAMP
DIVISION OF THE STATE ARCHITECT
APP: 01-118971 INC:
REVIEWED FOR
SS FLS ACS
DATE: 06/10/2020

DATE SIGNED
11/28/2018



SITE SPECIFIC DSA APPROVAL

FILE NUMBER: PC-119
IDENTIFICATION STAMP
DIVISION OF THE STATE ARCHITECT
APP. NO: 04 117111 INCR
AC DF DES DS PS DP
DATE: 12/05/2018

PRE-CHECK (PC) DOCUMENT
CODE: 2016 CBC
A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED












MBARC CONSTRUCTION INC.
674 RANCHEROS DR SAN MARCOS, CA 92069
PHONE: (760) 744-4131 FAX: (760) 744-4449
IUC # 869980 B AND C 51 GREGJ@MBARCONLINE.COM (775) 787-8845

4STEL ENGINEERING STRUCTURAL ENGINEERING
26030 ACHERO, SUITE 200 MISSION VIEJO, CA 92691
PHONE: (949) 305-1150 FAX: (949) 305-1420

VERSA CANOPY STANDARD DETAILS 2

DRAWN GM CHECKED KS
DATE 11/28/2018
4STEL JOB NO. MC03-01
SHEET

S-12
12 OF 13 SHEETS

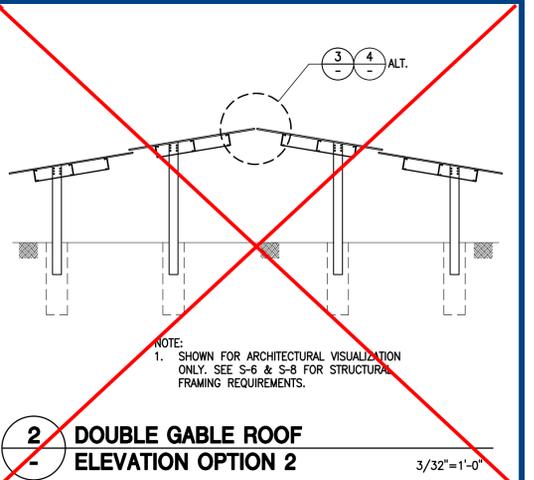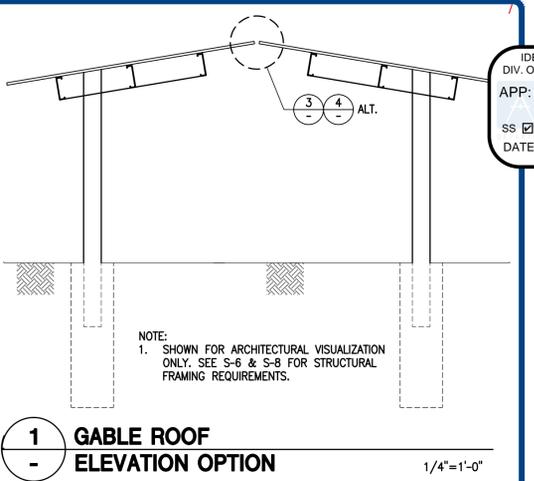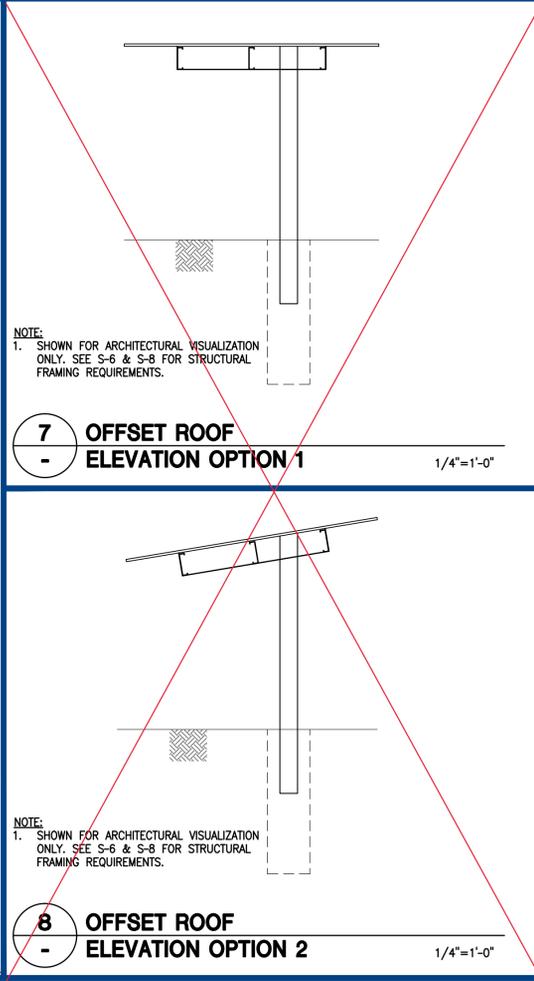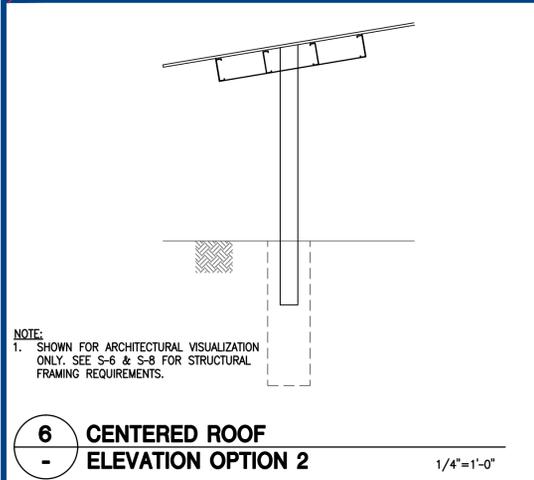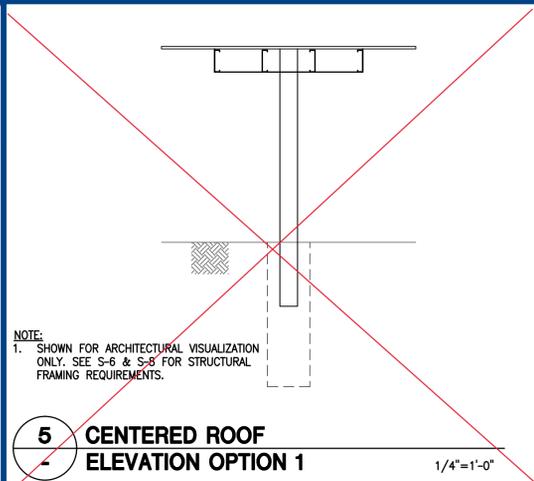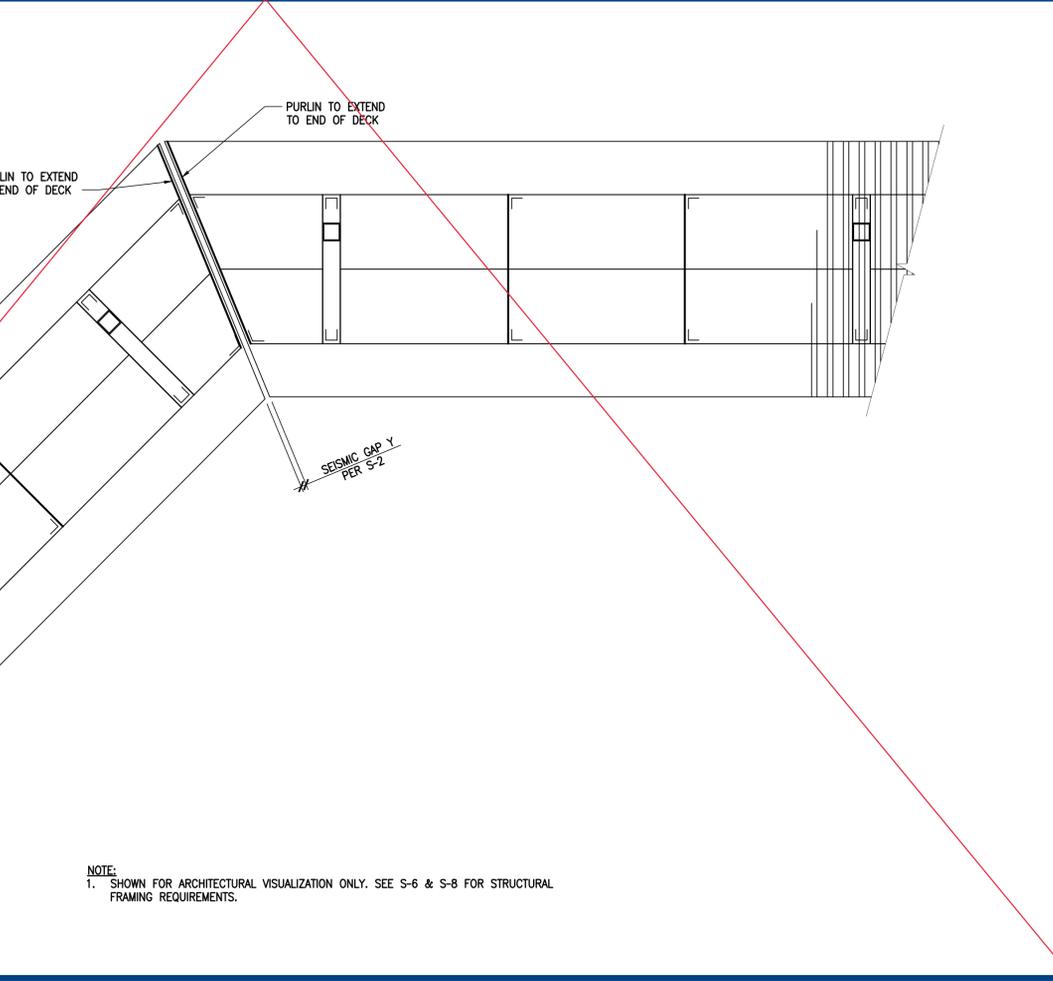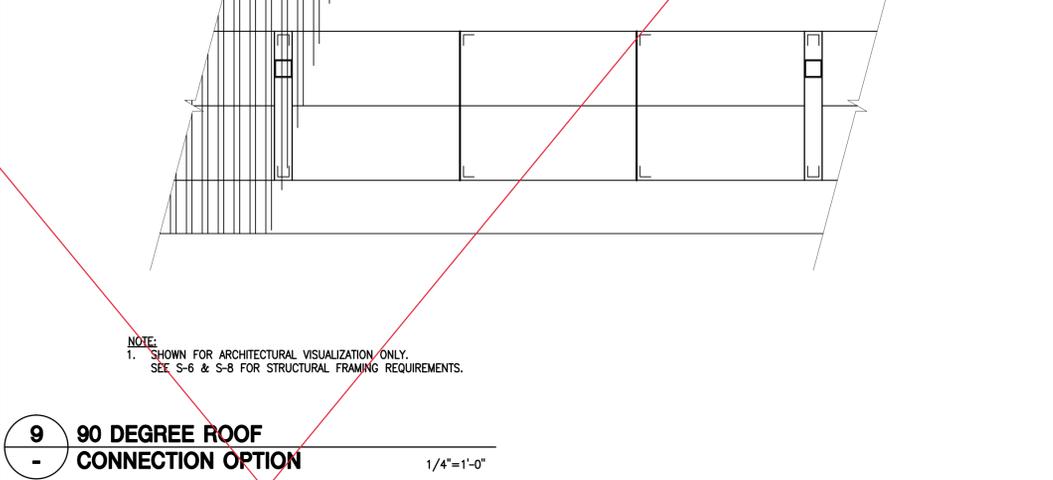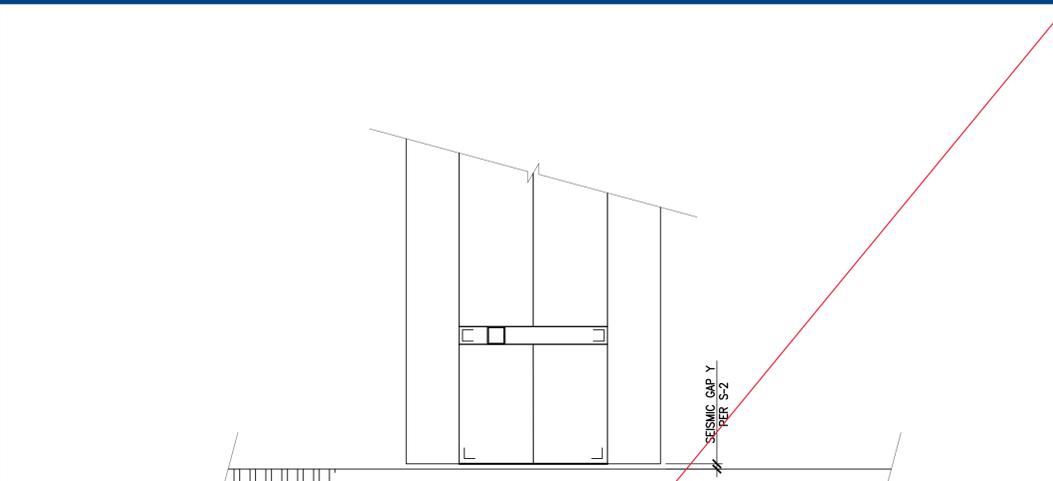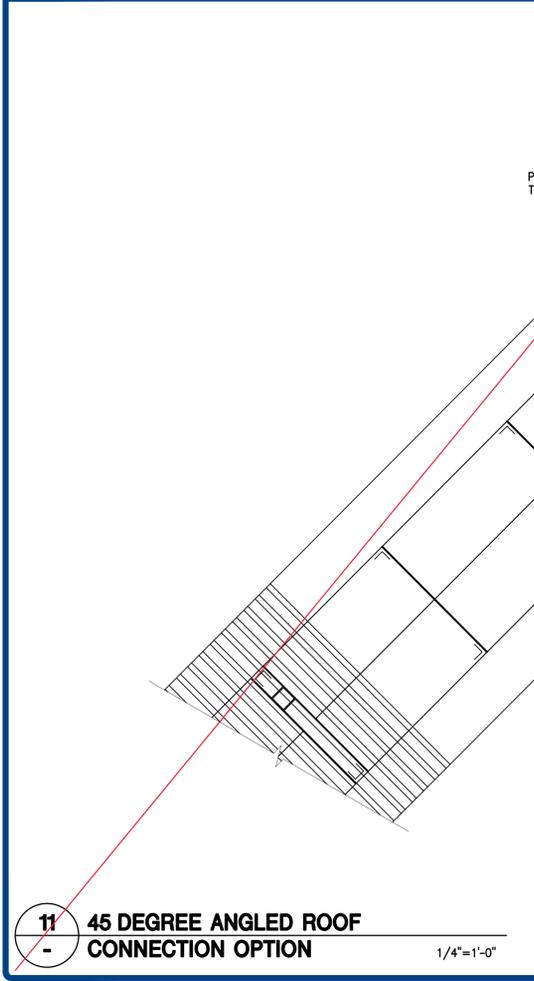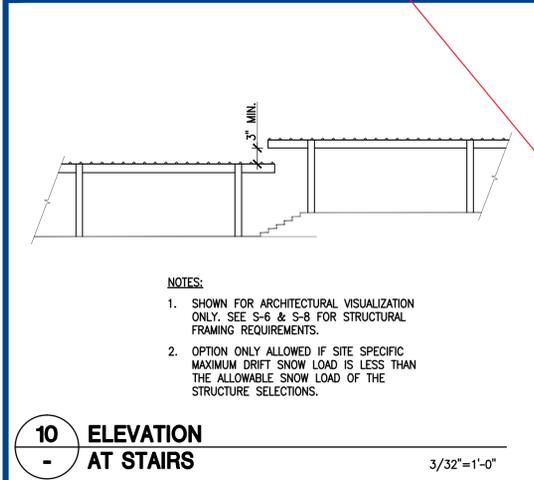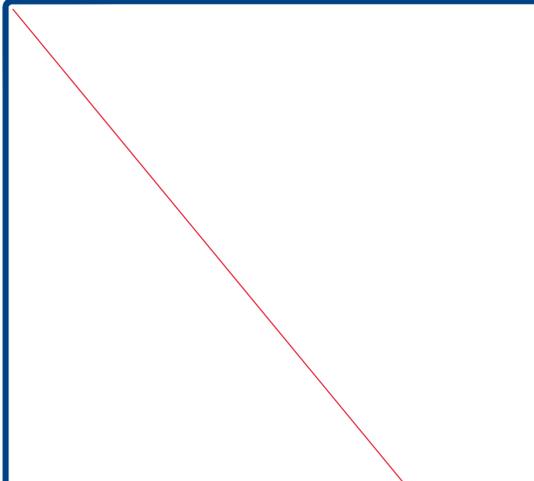

ENGINEER'S APPROVAL
 IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP: 01-118971 INC:
 REVIEWED FOR
 SS FLS ACS
 DATE: 06/10/2020

DATE SIGNED
 11/28/2018



SITE SPECIFIC DSA APPROVAL

FILE NUMBER: PC-119
 IDENTIFICATION STAMP
 DIVISION OF THE STATE ARCHITECT
 APP. NO: 04 117117 INCR
 AC DF DS DS ACS DP
 DATE: 12/05/2018
 PRE-CHECK (PC) DOCUMENT
 CODE: 2016 CBC
 A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED

MBARC CONSTRUCTION INC.
 IIC # 869960
 B AND C51
 GREGJ@MBARCONLINE.COM (775) 787-8845
 PHONE: (760) 744-4131
 FAX: (760) 744-4449
 674 RANCHEROS DR
 SAN MARCOS, CA
 GREG JONES

4STEL ENGINEERING
 STRUCTURAL ENGINEERING
 26030 A CHERO SUITE 200
 MISSION VIEJO, CA 92691
 PHONE: (949) 305-1150
 FAX: (949) 305-1420

VERSA CANOPY
 STANDARD DETAILS 3

DRAWN GM
CHECKED KS
DATE 11/28/2018
4STEL JOB NO. MC03-01
SHEET S-13
13 OF 13 SHEETS

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS

Application Number: 01-118971

School Name: Noble Elementary School

School District: Berryessa Union School District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/14/2020

IMPORTANT: This form is only a summary list of structural tests and some of the special inspections required for the project. Generally, the structural tests and special inspections noted on this form are those that will be performed by the Geotechnical Engineer of Record, Laboratory of Record, or Special Inspector. The actual complete test and inspection program must be performed as detailed on the DSA approved documents. The appendix at the bottom of this form identifies work NOT subject to DSA requirements for special inspection or structural testing. The project inspector is responsible for providing inspection of all facets of construction, including but not limited to, special inspections not listed on this form such as structural wood framing, high-load wood diaphragms, cold-formed steel framing, anchorage of non-structural components, etc., per Title 24, Part 2, Chapter 17A.

KEY TO COLUMNS

1. TYPE	2. PERFORMED BY
<p>Continuous – Indicates that a continuous special inspection is required</p> <p>Periodic – Indicates that a periodic special inspection is required</p> <p>Test – Indicates that a test is required</p>	<p>GE – Indicates that the special inspection shall be performed by a registered geotechnical engineer or his or her authorized representative.</p> <p>LOR – Indicates that the test or special inspection shall be performed by a testing laboratory accepted in the DSA Laboratory Evaluation and Acceptance (LEA) Program. See CAC Section 4-335.</p> <p>PI – Indicates that the special inspection may be performed by a project inspector when specifically approved by DSA.</p> <p>SI – Indicates that the special inspection shall be performed by an appropriately qualified/approved special inspector.</p>

****NOTE:** Undefined section and table references found in this document are from the CBC, or California Building Code.

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (SOILS)

Application Number: 01-118971

School Name: Noble Elementary School

School District: Berryessa Union School District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/14/2020

Geotechnical Reports: Project does NOT have and does NOT require a geotechnical report

1. GENERAL:		Table 1705A.6		
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/>	a. Verify that: <ul style="list-style-type: none"> • Site has been prepared properly prior to placement of controlled fill and/or excavations for foundations. • Foundation excavations are extended to proper depth and have reached proper material. • Materials below footings are adequate to achieve the design bearing capacity. 	See Notes	PI	Refer to specific items identified in the Appendix listing exemptions for limitations. Placement of controlled fill exceeding 12" depth under foundations is not permitted without a geotechnical report.

2. SOIL COMPACTION AND FILL:		Table 1705A.6		
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>	a. Verify use of proper materials, densities and inspect lift thicknesses, placement and compaction during placement of fill.	Continuous	LOR*	* Under the supervision of a geotechnical engineer or LOR's engineering manager. Refer to specific items identified in the Appendix listing exemptions for limitations.
<input type="checkbox"/>	b. Compaction testing.	Test	LOR*	* Under the supervision of a geotechnical engineer or LOR's engineering manager. Refer to specific items identified in the Appendix listing exemptions for limitations.

3. DRIVEN DEEP FOUNDATIONS (PILES):		Table 1705A.7		
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>	a. Verify pile materials, sizes and lengths comply with the requirements.	Continuous	GE*	* By geotechnical engineer or his or her qualified representative.

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (SOILS)

Application Number: 01-118971

School Name: Noble Elementary School

School District: Berryessa Union School District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/14/2020

<input type="checkbox"/>	b. Determine capacities of test piles and conduct additional load tests as required.	Test	LOR*	* Under the supervision of the geotechnical engineer.
<input type="checkbox"/>	c. Inspect driving operations and maintain complete and accurate records for each pile.	Continuous	GE*	* By geotechnical engineer or his or her qualified representative.
<input type="checkbox"/>	d. Verify locations of piles and their plumbness, confirm type and size of hammer, record number of blows per foot of penetration, determine required penetrations to achieve design capacity, record tip and butt elevations and record any pile damage.	Continuous	GE*	* By geotechnical engineer or his or her qualified representative.

3. DRIVEN DEEP FOUNDATIONS (PILES):		Table 1705A.7		
Test or Special Inspection		Type	Performed By	Code References and Notes
<input type="checkbox"/>	e. Steel piles.	Provide tests and inspections per STEEL section below.		
<input type="checkbox"/>	f. Concrete piles and concrete filled piles.	Provide tests and inspections per CONCRETE section below.		
<input type="checkbox"/>	g. For specialty piles, perform additional inspections as determined by the registered design professional in responsible charge.	*	*	* As defined on drawings or specifications.

4. CAST-IN-PLACE DEEP FOUNDATIONS (PIERS):		Table 1705A.8		
Test or Special Inspection		Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/>	a. Inspect drilling operations and maintain complete and accurate records for each pier.	Continuous	PI	Continuous inspection to be provided by project inspector. Refer to specific items identified in the Appendix listing exemptions for limitations.
<input checked="" type="checkbox"/>	b. Verify pier locations, diameters, plumbness and lengths. Record concrete or grout volumes.	Continuous	PI	Continuous inspection to be provided by project inspector. Refer to specific items identified in the Appendix listing exemptions for limitations.
<input checked="" type="checkbox"/>	c. Concrete piers.	Provide tests and inspections per CONCRETE section below.		

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (SOILS)

Application Number: 01-118971

School Name: Noble Elementary School

School District: Berryessa Union School District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/14/2020

5. RETAINING WALLS:				
<input type="checkbox"/>	a. Segmental retaining walls; inspect placement of units, dowels, connectors, etc.	Continuous	GE*	* By geotechnical engineer or his or her qualified representative. See DSA IR 16-3.
<input type="checkbox"/>	b. Placement of soil reinforcement, drainage devices and/or backfill.	Continuous	GE*	Placement, compaction and inspection of backfill per Section 1705A.6.1 for fills supporting foundations (Section 2 above). * By geotechnical engineer or his or her qualified representative.
<input type="checkbox"/>	c. Concrete retaining walls.	Provide tests and inspections per CONCRETE section below.		
<input type="checkbox"/>	d. Masonry retaining walls.	Provide tests and inspections per MASONRY section below.		

6. OTHER SOILS:				
<input type="checkbox"/>	a. Soil Improvements	Test	GE*	Submit a comprehensive report documenting final soil improvements constructed, construction observation and the results of the confirmation testing and analysis to CGS for final acceptance. * By geotechnical engineer or his or her qualified representative.
<input type="checkbox"/>	b. Inspection of Soil Improvements	Continuous	GE*	* By geotechnical engineer or his or her qualified representative.
<input type="checkbox"/>				

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (Concrete)

Table 1705A.3; ACI 318-14 Sections 26.12 & 26.13

Application Number: 01-118971 **School Name:** Noble Elementary School **School District:** Berryessa Union School District
DSA File Number: 43-7 **Increment Number:** N/A **Date Submitted:** 04/14/2020

7. CAST-IN-PLACE CONCRETE				
Material Verification and Testing:				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/>	a. Verify use of required design mix.	Periodic	SI	Table 1705A.3 Item 5, 1910A.1.
<input checked="" type="checkbox"/>	b. Identify, sample, and test reinforcing steel.	Test	LOR	1910A.2; ACI 318-14 Section 26.6.1.2; DSA IR 17-10. (See Appendix for exemptions.)
<input checked="" type="checkbox"/>	c. During concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.	Test	LOR	Table 1705A.3 Item 6; ACI 318-14 Sections 26.5 & 26.12.
<input checked="" type="checkbox"/>	d. Test concrete (f_c).	Test	LOR	1905A.1.15; ACI 318-14 Section 26.12.
Inspection:				
<input type="checkbox"/>	e. Batch plant inspection: Continuous	See Notes	SI	Default of ' Continuous ' per 1705A.3.3. If approved by DSA, batch plant inspection may be reduced to ' Periodic ' subject to requirements in Section 1705A.3.3.1, or eliminated per 1705A.3.3.2. (See Appendix for exemptions.)
<input type="checkbox"/>	f. Welding of reinforcing steel.	Provide special inspection per STEEL, Category 19.1(d) & (e) and/or 19.2(g) & (h) below.		

8. PRESTRESSED / POST-TENSIONED CONCRETE (in addition to Cast-in-Place Concrete tests and inspections):				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>	a. Sample and test prestressing tendons and anchorages.	Test	LOR	1705A.3.4, 1910A.3
<input type="checkbox"/>	b. Inspect placement of prestressing tendons.	Periodic	SI	1705A.3.4, Table 1705A.3 Items 1 & 9.

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (Concrete)

Table 1705A.3; ACI 318-14 Sections 26.12 & 26.13

Application Number: 01-118971	School Name: Noble Elementary School	School District: Berryessa Union School District
DSA File Number: 43-7	Increment Number: N/A	Date Submitted: 04/14/2020

<input type="checkbox"/>	c. Verify in-situ concrete strength prior to stressing of post-tensioning tendons.	Periodic	SI	Table 1705A.3 Item 11. Special inspector to verify specified concrete strength test prior to stressing.
<input type="checkbox"/>	d. Inspect application of post-tensioning or prestressing forces and grouting of bonded prestressing tendons.	Continuous	SI	1705A.3.4, Table 1705A.3 Item 9; ACI 318-14 Section 26.13

9. PRECAST CONCRETE (in addition to Cast-in-Place Concrete tests and inspections):

	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>	a. Inspect fabrication of precast concrete members.	Continuous	SI	ACI 318-14 Section 26.13.
<input type="checkbox"/>	b. Inspect erection of precast concrete members.	Periodic	SI*	Table 1705A.3 Item 10. * May be performed by PI when specifically approved by DSA.

10. SHOTCRETE (in addition to Cast-in-Place Concrete tests and inspections):

	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>	a. Inspect shotcrete placement for proper application techniques.	Continuous	SI	1705A.19, Table 1705A.3 Item 7, 1908A.6, 1908A.7, 1908A.8, 1908A.9, 1908A.11, 1908A.12. See ACI 506.2-13 Section 3.4, ACI 506R-16.
<input type="checkbox"/>	b. Sample and test shotcrete (f'_c).	Test	LOR	1908A.5, 1908A.10.

11. POST-INSTALLED ANCHORS:

	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>	a. Inspect installation of post-installed anchors	See Notes	SI*	1617A.1.19, Table 1705A.3 Item 4a (Continuous) & 4b (Periodic), 1705A.3.8 (See Appendix for exemptions). ACI 318-14

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (Concrete)

Table 1705A.3; ACI 318-14 Sections 26.12 & 26.13

Application Number: 01-118971	School Name: Noble Elementary School	School District: Berryessa Union School District
DSA File Number: 43-7	Increment Number: N/A	Date Submitted: 04/14/2020

<input type="checkbox"/>				Sections 17.8 & 26.13. * May be performed by the project inspector when specifically approved by DSA.
<input type="checkbox"/>	b. Test post-installed anchors.	Test	LOR	1910A.5. (See Appendix for exemptions.)

12. OTHER CONCRETE:				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>				

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (Steel and Aluminum)

1705A.2.1, Table 1705A.2.1; AISC 303-16, AISC 341-16, AISC 358-16, AISC 360-16; AISI S100-16

Application Number: 01-118971

School Name: Noble Elementary School

School District: Berryessa Union School

District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/14/2020

17. STRUCTURAL STEEL, COLD-FORMED STEEL AND ALUMINUM USED FOR STRUCTURAL PURPOSES				
Material Verification and Testing:				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/>	a. Verify identification of all materials and: <ul style="list-style-type: none"> • Mill certificates indicate material properties that comply with requirements. • Material sizes, types and grades comply with requirements. 	Periodic	*	Table 1705A.2.1 Item 3a–3c. 2202A.1; AISI S100-16 Section A3.1 & A3.2, AISI S240-15 Section A3 & A5, AISI S220-15 Sections A4 & A6. * By special inspector or qualified technician when performed off-site.
<input checked="" type="checkbox"/>	b. Test unidentified materials	Test	LOR	2202A.1.
<input checked="" type="checkbox"/>	c. Examine seam welds of HSS shapes	Periodic	SI	DSA IR 17-3.
Inspection:				
<input checked="" type="checkbox"/>	d. Verify and document steel fabrication per DSA-approved construction documents.	Periodic	SI	Not applicable to cold-formed steel light-frame construction, except for trusses (1705A.2.4).

18. HIGH-STRENGTH BOLTS: RCSC 2014				
Material Verification and Testing of High-Strength Bolts, Nuts and Washers:				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/>	a. Verify identification markings and manufacturer's certificates of compliance conform to ASTM standards specified in the DSA-approved documents.	Periodic	SI	Table 1705A.2.1 Items 1a & 1b, 2202A.1; AISC 360-16 Section A3.3, J3.1, and N3.2; RCSC 2014 Section 1.5 & 2.1; DSA IR 17-8 & DSA IR 17-9.
<input checked="" type="checkbox"/>	b. Test high-strength bolts, nuts and washers.	Test	LOR	Table 1705A.2.1 Item 1c, 2213A.1; RCSC 2014 Section 7.2; DSA IR 17-8.
Inspection of High-Strength Bolt Installation:				

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (Steel and Aluminum)

1705A.2.1, Table 1705A.2.1; AISC 303-16, AISC 341-16, AISC 358-16, AISC 360-16; AISI S100-16

Application Number: 01-118971

School Name: Noble Elementary School

School District: Berryessa Union School

District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/14/2020

<input type="checkbox"/>	c. Bearing-type ("snug tight") connections.	Periodic	SI	Table 1705A.2.1 Item 2a, 1705A.2.6, 2204A.2; AISC 360-16 J3.1, J3.2, M2.5 & N5.6; RCSC 2014 Section 9.1; DSA IR 17-9.
<input checked="" type="checkbox"/>	d. Pretensioned and slip-critical connections.	*	SI	Table 1705A.2.1 Items 2b & 2c, 1705A.2.6, 2204A.2; AISC 360-16 J3.1, J3.2, M2.5 & N5.6; RCSC 2014 Sections 9.2 & 9.3; DSA IR 17-9. * "Continuous" or "Periodic" depends on the tightening method used.

19. WELDING:	1705A.2.5, Table 1705A.2.1 Items 4 & 5; AWS D1.1 and AWS D1.8 for structural steel; AWS D1.2 for Aluminum; AWS D1.3 for cold-formed steel; AWS D1.4 for reinforcing steel; DSA IR 17-3 (See Appendix for exemptions.)
---------------------	--

Verification of Materials, Equipment, Welders, etc.:

	Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/>	a. Verify weld filler material identification markings per AWS designation listed on the DSA-approved documents and the WPS.	Periodic	SI	DSA IR 17-3.
<input checked="" type="checkbox"/>	b. Verify weld filler material manufacturer's certificate of compliance.	Periodic	SI	DSA IR 17-3.
<input checked="" type="checkbox"/>	c. Verify WPS, welder qualifications and equipment.	Periodic	SI	DSA IR 17-3.

19.1 SHOP WELDING:

	Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/>	a. Inspect groove welds, multi-pass fillet welds, single pass fillet welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Items 5a.1-4; AISC 360-16 (and AISC 341-16 as applicable); DSA IR 17-3.
<input checked="" type="checkbox"/>	b. Inspect single-pass fillet welds ≤ 5/16", floor and roof deck welds.	Periodic	SI	1705A.2.2, Table 1705A.2.1 Items 5a.5 & 5a.6; AISC 360-16 (and AISC 341-16 as applicable); DSA IR 17-3.
<input type="checkbox"/>	c. Inspect welding of stairs and railing systems.	Periodic	SI	1705A.2.1; AISC 360-16 (and AISC 341-16 as applicable); AWS D1.1 & D1.3; DSA IR 17-3.

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (Steel and Aluminum)

1705A.2.1, Table 1705A.2.1; AISC 303-16, AISC 341-16, AISC 358-16, AISC 360-16; AISI S100-16

Application Number: 01-118971

School Name: Noble Elementary School

School District: Berryessa Union School

District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/14/2020

<input type="checkbox"/>	d. Verification of reinforcing steel weldability other than ASTM A706.	Periodic	SI	1705A.3.1 ; AWS D1.4; DSA IR 17-3. Verify carbon equivalent reported on mill certificates.
<input type="checkbox"/>	e. Inspect welding of reinforcing steel.	Continuous	SI	Table 1705A.2.1 Item 5b, 1705A.3.1, Table 1705A.3 Item 2, 1903A.8 ; AWS D1.4; DSA IR 17-3.
19.2 FIELD WELDING:				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/>	a. Inspect groove welds, multi-pass fillet welds, single pass fillet welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Items 5a.1–4 ; AISC 360-16 (AISC 341-16 as applicable); DSA IR 17-3.
<input checked="" type="checkbox"/>	b. Inspect single-pass fillet welds ≤ 5/16".	Periodic	SI	Table 1705A.2.1 Item 5a.5 ; AISC 360-16 (AISC 341-16 as applicable); DSA IR 17-3.
<input type="checkbox"/>	c. Inspect end-welded studs (ASTM A-108) installation (including bend test).	Periodic	SI	2213A.2 ; AISC 360-16 (AISC 341-16 as applicable); AWS D1.1; DSA IR 17-3.
<input type="checkbox"/>	d. Inspect floor and roof deck welds.	Periodic	SI	1705A.2.2, Table 1705A.2.1 Item 5a.6 ; AISC 360-16 (AISC 341-16 as applicable); AWS D1.3; DSA IR 17-3.
<input type="checkbox"/>	e. Inspect welding of structural cold-formed steel.	Periodic	SI*	1705A.2.5; AWS D1.3; DSA IR 17-3. The quality control provisions of AISI S240-15 Chapter D shall also apply. * May be performed by the project inspector when specifically approved by DSA.
<input type="checkbox"/>	f. Inspect welding of stairs and railing systems.	Periodic	SI*	1705A.2.1 ; AISC 360-16 (AISC 341-16 as applicable); AWS D1.1 & D1.3; DSA IR 17-3. * May be performed by the project inspector when specifically approved by DSA.
<input type="checkbox"/>	g. Verification of reinforcing steel weldability.	Periodic	SI	1705A.3.1 ; AWS D1.4; DSA IR 17-3. Verify carbon equivalent reported on mill certificates.
<input type="checkbox"/>	h. Inspect welding of reinforcing steel.	Continuous	SI	Table 1705A.2.1 Item 5b, 1705A.3.1, Table 1705A.3 Item 2, 1903A.8 ; AWS D1.4; DSA IR 17-3.

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (Steel and Aluminum)

1705A.2.1, Table 1705A.2.1; AISC 303-16, AISC 341-16, AISC 358-16, AISC 360-16; AISI S100-16

Application Number: 01-118971

School Name: Noble Elementary School

School District: Berryessa Union School

District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/14/2020

20. NONDESTRUCTIVE TESTING: 1705A.2.1, Table 1705A.2.1; AISC 303-16, AISC 341-16, AISC 358-16, AISC 360-16; AISI S100-16				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>	a. Ultrasonic	Test	LOR	1705A.2.1, 1705A.2.5; AISC 341-16 J6.2, AISC 360-16 N5.5; ANSI/ASNT CP-189, SNT-TC-1A; AWS D1.1, AWS D1.8; DSA IR 17-2.
<input type="checkbox"/>	b. Magnetic Particle	Test	LOR	1705A.2.1, 1705A.2.5; AISC 341-16 J6.2, AISC 360-16 N5.5; ANSI/ASNT CP-189, SNT-TC-1A; AWS D1.1, AWS D1.8; DSA IR 17-2.
<input type="checkbox"/>				

21. STEEL JOISTS AND TRUSSES: 1705A.2.1, Table 1705A.2.1; AISC 303-16, AISC 341-16, AISC 358-16, AISC 360-16; AISI S100-16				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>	a. Verify size, type and grade for all chord and web members as well as connectors and weld filler material; verify joist profile, dimensions and camber (if applicable); verify all weld locations, lengths and profiles; mark or tag each joist.	Continuous	SI	1705A.2.3, Table 1705A.2.3; AWS D1.1; DSA IR 22-3 for steel joists only. 1705A.2.4; AWS D1.3 for cold-formed steel trusses.

22. SPRAY APPLIED FIRE-PROOFING: 1705A.2.1, Table 1705A.2.1; AISC 303-16, AISC 341-16, AISC 358-16, AISC 360-16; AISI S100-16				
	Test or Special Inspection	Type	Performed By	Code References and Notes

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (Steel and Aluminum)

1705A.2.1, Table 1705A.2.1; AISC 303-16, AISC 341-16, AISC 358-16, AISC 360-16; AISI S100-16

Application Number: 01-118971

School Name: Noble Elementary School

School District: Berryessa Union School

District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/14/2020

<input type="checkbox"/>	a. Examine structural steel surface conditions, inspect application, take samples, measure thickness and verify compliance of all aspects of application with DSA-approved documents.	Periodic	SI	1705A.14.
<input type="checkbox"/>	b. Test bond strength.	Test	LOR	1705A.14.6.
<input type="checkbox"/>	c. Test density.	Test	LOR	1705A.14.5.

23. ANCHOR BOLTS AND ANCHOR RODS:				
<input checked="" type="checkbox"/>	a. Anchor Bolts and Anchor Rods	Test	LOR	Sample and test anchor bolts and anchor rods not readily identifiable per procedures noted in DSA IR 17-11.
<input type="checkbox"/>	b. Threaded rod not used for foundation anchorage.	Test	LOR	Sample and test threaded rods not readily identifiable per procedures noted in DSA IR 17-11.

23.1 OTHER STEEL:				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>				

Appendix: Work Exempt from DSA Requirements for Structural Tests / Special Inspections

Application Number: 01-118971

School Name: Noble Elementary School

School District: Berryessa Union School
District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/14/2020

Exempt items given in DSA IR A-22 or the 2019 CBC (including DSA amendments) and those items identified below with an "X" by the design professional are NOT subject to DSA requirements for the structural tests / special inspections noted. **Items marked as exempt shall be identified on the approved construction documents.** The project inspector shall verify all construction complies with the approved construction documents.

	SOILS:
<input checked="" type="checkbox"/>	1. Deep foundations acting as a cantilever footing designed based on minimum allowable pressures per CBC Table 1806A.2 and having no geotechnical report for the following cases: A) free standing sign or scoreboard, B) cell or antenna towers and poles less than 35'-0" tall (e.g., lighting poles, flag poles, poles supporting open mesh fences, etc.), C) single-story structure with dead load less than 5 psf (e.g., open fabric shade structure), or D) covered walkway structure with an apex height less than 10'-0" above adjacent grade.
<input checked="" type="checkbox"/>	2. Shallow foundations, etc. are exempt from special inspections and testing by a Geotechnical Engineer for the following cases: A) buildings without a geotechnical report and meeting the exception Item #1 criteria in CBC Section 1803A.2 supported by native soil (any excavation depth) or fill soil (not exceeding 12" depth per CBC, Section 1804A.6), B) soil scarification/recompaction not exceeding 12" depth, C) native or fill soil supporting exterior non-structural flatwork (e.g., sidewalks, site concrete ramps, site stairs, parking lots, driveways, etc.), D) unpaved landscaping and playground areas, or E) utility trench backfill.

	CONCRETE/MASONRY:
<input type="checkbox"/>	1. Post-installed anchors for the following: A) exempt non-structural components (e.g., mechanical, electrical, plumbing equipment - see Item 7 for "Welding") given in CBC Section 1617A.1.18 (which replaces ASCE 7-16, Section 13.1.4) or B) interior nonstructural wall partitions meeting criteria listed in exempt Item 3 for "Welding."
<input checked="" type="checkbox"/>	2. Concrete batch plant inspection is not required for items given in CBC Section 1705A.3.3.2 subject to the requirements and limitations in that section.
<input type="checkbox"/>	3. Non-bearing non-shear masonry walls may be exempt from certain DSA masonry testing and special inspection items as allowed per DSA IR 21-1. Refer to construction documents for specific exemptions accordingly for each applicable wall condition.
<input type="checkbox"/>	4. Epoxy shear dowels in site flatwork and/or other non-structural concrete.
<input type="checkbox"/>	5. Testing of reinforcing bars is not required for items given in CBC Section 1910A.2 subject to the requirements and limitations in that section.

Appendix: Work Exempt from DSA Requirements for Structural Tests / Special Inspections

Application Number: 01-118971

School Name Noble Elementary School

School District: Berryessa Union School District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/14/2020

	Welding:
<input type="checkbox"/>	1. Solid-clad and open-mesh gates with maximum leaf span or rolling section for rolling gates of 10' and apex height less than 8'-0" above lowest adjacent grade. When located above circulation or occupied space below, these gates are not located within 1.5x gate/fence height (max 8'-0") to the edge of floor or roof.
<input type="checkbox"/>	2. Handrails, guardrails and modular or relocatable ramps associated with walking surfaces less than 30" above adjacent grade (excluding post base connections per the 'Exception' language in Section 1705A.2.1); fillet welds shall not be ground flush.
<input type="checkbox"/>	3. Non-structural interior cold-formed steel framing spanning less than 15'-0", such as in interior partitions, interior soffits, etc. supporting only self weight and light-weight finishes or adhered tile, masonry, stone, or terra cotta veneer no more than 5/8" thickness and apex less than 20'-0" in height and not over an exit way. Maximum tributary load to a member shall not exceed the equivalent of that occurring from a 10'x10' opening in a 15' tall wall for a header or king stud.
<input type="checkbox"/>	4. Manufactured support frames and curbs using hot rolled or cold-formed steel (i.e., light gauge) for mechanical, electrical, or plumbing equipment weighing less than 2000# (equipment only) (connections of such frames to superstructure elements using welding will require special inspection as noted in selected item(s) for Sections 19, 19.1 and/or 19.2 of listing above).
<input type="checkbox"/>	5. Manufactured components (e.g., Tolco, B-Line, Afcon, etc.) for mechanical, electrical, or plumbing hanger support and bracing (connections of such components to superstructure elements using welding will require special inspection as noted in selected item(s) for Sections 19, 19.1 and/or 19.2 of listing above).
<input type="checkbox"/>	6. TV Brackets, projector mounts with a valid listing (see DSA IR A-5) and recreational equipment (e.g., playground structures, basketball backstops, etc.) (connections of such elements to superstructure elements using welding will require special inspection as noted in selected item(s) for section 19, 19.1 and/or 19.2 located in the Steel/Aluminum category).
<input type="checkbox"/>	7. Any support for exempt non-structural components given in CBC Section 1617A.1.18 (which replaces ASCE 7-16, Section 13.1.4) meeting the following: A) when supported on a floor/roof, <400# and resulting composite center of mass (including component's center of mass) ≤4' above supporting floor/roof, B) when hung from a wall or roof/floor, <20# for discrete units or <5 plf for distributed systems.

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (SIGNATURE)

Application Number: 01-118971

School Name: Noble Elementary School

School District: Berryessa Union School District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/14/2020

Name of Architect or Engineer in general responsible charge: Mark C. Finney	
Name of Structural Engineer (When structural design has been delegated): 	
Signature of Architect or Structural Engineer:	Date: 03/03/2020



Note: Do not use secured electronic or digital signatures preventing DSA mark-ups.

DSA STAMP
IDENTIFICATION STAMP DIV. OF THE STATE ARCHITECT
APP: 01-118971 INC:
REVIEWED FOR
SS <input checked="" type="checkbox"/> FLS <input type="checkbox"/> ACS <input type="checkbox"/>
DATE: 06/10/2020

DSA 103: LIST OF REQUIRED VERIFIED REPORTS

Application Number: 01-118971

School Name: Noble Elementary School

School District: Berryessa Union School
District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/14/2020

-
1. Structural Testing and Inspection: Laboratory Verified Report Form DSA 291

 2. Concrete Batch Plant Inspection: Laboratory Verified Report Form DSA 291

 3. Shop Welding Inspection: Laboratory Verified Report Form DSA 291, or, for independently contracting SI, Special Inspection Verified Report Form DSA 292

 4. High-Strength Bolt Installation Inspection: Laboratory Verified Report Form DSA 291, or, for independently contracting SI, Special Inspection Verified Report Form DSA 292
-



RUSKIN ELEMENTARY SCHOOL SHADE STRUCTURE

1401 TURLOCK LN. SAN JOSE
BERRYESSA UNION SCHOOL DISTRICT

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 01-118968 INC:
REVIEWED FOR
SS FLS ACS
DATE: 06/12/2020



DSA FILE NUMBER 43-7
DSA APPLICATION NUMBER 01-118968
PROJECT TRACKING NUMBER 69377-112

GENERAL NOTES

PRE-BID SITE VISIT
CONTRACTOR SHALL VISIT THE PROJECT AREA IN ORDER TO BECOME FAMILIAR WITH EXISTING CONDITIONS AND THE REQUIREMENTS OF THE PROJECT. THE CONTRACTOR MAY CONTACT THE ARCHITECT DURING THE BIDDING PHASE REGARDING CLARIFICATIONS AND PROJECT REQUIREMENTS.

SAFETY
IN ACCORDANCE WITH GENERALLY ACCEPTED CONSTRUCTION PRACTICES, THE CONTRACTOR WILL BE SOLELY AND COMPLETELY RESPONSIBLE FOR CONDITIONS OF THE JOB SITE INCLUDING SAFETY OF ALL PERSONS AND PROPERTY DURING PERFORMANCE OF THE WORK. THIS REQUIREMENT WILL APPLY CONTINUOUSLY AND NOT BE LIMITED TO NORMAL WORKING HOURS.

DAMAGE TO STRUCTURE OR SYSTEMS TO REMAIN
CONTRACTOR SHALL REIMBURSE THE OWNER FOR REPAIR AND REPLACEMENT, INCLUDING ARCHITECT'S FEES, FOR ANY DAMAGE CAUSED TO STRUCTURES, LANDSCAPE, SITE WORK, OR EXISTING SYSTEMS TO REMAIN, AS THE RESULT OF CONSTRUCTION OPERATIONS.

EXISTING CONDITIONS
ALL EXISTING CONDITIONS ARE SHOWN BASED ON THE BEST INFORMATION AVAILABLE AT THE TIME, BUT WITHOUT GUARANTEE OF ACCURACY. THE CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS, DIMENSIONS, AND BUILDING DATA AT THE JOB SITE. ANY DISCREPANCIES REQUIRING MODIFICATION TO THE CONSTRUCTION DOCUMENTS SHALL BE REPORTED TO THE ARCHITECT IMMEDIATELY. NO MODIFICATIONS SHALL BE MADE BY THE CONTRACTOR WITHOUT PRIOR APPROVAL FROM THE ARCHITECT.

CONTRACTOR'S EQUIPMENT
COORDINATE WITH OWNER'S REPRESENTATIVE FOR APPROVED LOCATION OF JOB SITE ACCESS, PARKING, AND LOCATION OF CONTRACTOR'S EQUIPMENT AND MATERIAL STORAGE AREA. SEE SITE PLAN FOR ADDITIONAL NOTES.

UTILITY SHUT-DOWNS AND CONNECTIONS
ALL REQUIRED UTILITY SHUT DOWNS SHALL HAVE PRIOR APPROVAL FROM THE OWNER'S REPRESENTATIVE. REQUEST SHALL BE SUBMITTED WITH ADEQUATE ADVANCE NOTICE PER PROJECT REQUIREMENTS.

ASBESTOS AND ASBESTOS PRODUCTS
THE OWNER/OPERATOR AND CONTRACTOR SHALL BE AWARE THAT BUILDINGS CONSTRUCTED PRIOR TO 1978 (OR THEREABOUT) POSSIBILITY CONTAIN ASBESTOS IN SOME EXISTING CONSTRUCTION MATERIALS, AND WILL LIKELY BE ENCOUNTERED DURING ALTERATIONS OR REMODELING.

UNDER CALIFORNIA TITLE 8, THE OWNER AND CONTRACTOR BOTH HAVE RESPONSIBILITIES TO DETERMINE THE EXISTENCE OF ASBESTOS CONTAINING MATERIALS IN AREAS TO BE ALTERED OR REMOVED PRIOR TO COMMENCEMENT OF WORK AND TO TAKE APPROPRIATE MEASURES TO PROTECT PERSONNEL. CAL-OSHA HAS JURISDICTION OVER ASBESTOS RELATED WORK. ASBESTOS RELATED WORK SHALL BE DONE IN ACCORDANCE WITH CALIFORNIA GENERAL INDUSTRIAL SAFETY ORDINANCE, TITLE 8, SECTION 341.6 THROUGH 341.14. ASBESTOS IN THE WORK ENVIRONMENT IS REGULATED BY TITLE 8, SECTION 5208.

THE BAY AREA AIR QUALITY MANAGEMENT DISTRICT AND DISTRICT REGULATION 11-2-401.3 REQUIRES EVERY RENOVATION INVOLVING THE REMOVAL OF 100 SQ. FT. LN.FT. OR GREATER OF REGULATED ASBESTOS CONTAINING MATERIAL, AND FOR EVERY DEMOLITION (EVEN WHEN NO ASBESTOS IS PRESENT), A NOTIFICATION MUST BE SENT TO THE BAAQMD AT LEAST 10 WORKING DAYS PRIOR TO COMMENCEMENT OF DEMOLITION/RENOVATION.

ALL BUILDING MATERIALS MUST BE ASBESTOS FREE.
THESE DOCUMENTS DO NOT ADDRESS CONTAMINATION FOR EXISTING AREAS OF ASBESTOS WHICH MAY BE DISCOVERED DURING CONSTRUCTION. THE OWNER'S ABATEMENT SUBCONTRACTOR IS SOLELY RESPONSIBLE FOR THE DETECTION, REMOVAL, AND THE DISPOSAL OF ANY EXISTING ASBESTOS MATERIAL, ARCHITECTURAL AND ENGINEERING FEES FOR ADDITIONAL DESIGN EFFORT TO OBTAIN STATE APPROVALS, AS WELL AS THE COST OF ANY REPAIRS, FOR DAMAGE CAUSED OR REPLACEMENT OF EXISTING SYSTEMS TO REMAIN, DUE TO WORK PERFORMED BY THE ASBESTOS ABATEMENT SUBCONTRACTOR, SHALL BE THE RESPONSIBILITY OF SAID SUBCONTRACTOR.

CONSTRUCTION SCHEDULING
CONTRACTOR SHALL COORDINATE ALL CONSTRUCTION OPERATIONS WITH OWNER'S REPRESENTATIVE PRIOR TO SCHEDULING AND START OF THE WORK. CONTRACTOR SHALL PROVIDE PROTECTION TO ALL EXISTING SPACES AND SYSTEMS WHICH ARE IN USE, ADJOINING THE PROJECT, AND NOT PART OF THE PROJECT.

INTERIOR FINISHES
INTERIOR FINISHES AND ALL WALL COVERING MATERIAL SHALL CONFORM TO CCR TITLE 24, PART 2, CHAPTER 8.

TITLE 24 COMPLIANCE
THE INTENT OF THESE DRAWINGS AND SPECIFICATIONS IS THAT THE WORK OF THE ALTERATION, REHABILITATION OR RECONSTRUCTION IS TO BE IN ACCORDANCE WITH TITLE 24, CALIFORNIA CODE OF REGULATIONS (2019 CBC), SHOULD ANY EXISTING CONDITIONS BE DISCOVERED NOT COVERED BY THE CONTRACT DOCUMENTS WHERE IN THE FINISHED WORK DOES NOT COMPLY WITH 2019 CBC. A CONSTRUCTION CHANGE DOCUMENT OR A SEPARATE SET OF PLANS AND SPECIFICATIONS, DETAILING THE REQUIRED WORK, SHALL BE SUBMITTED TO AND APPROVED BY THE DSA BEFORE PROCEEDING WITH THE WORK.

ADMINISTRATIVE REQUIREMENTS FROM PART 1, TITLE 24, C.C.R.
- ADDENDA AND CHANGES AS PER SECTION 4-338
- INSPECTOR APPROVED BY DSA
- INSPECTOR AND CONTINUOUS INSPECTION OF WORK PER SECTION 4-333 (B) AND 4-342
- TESTS AND TESTING LABORATORY PER SECTION 4-335 (OWNER SHALL PAY THE TESTING LABORATORY)
- SPECIAL INSPECTION PER SECTION 4-333 (C)
- CONTRACTOR SHALL SUBMIT VERIFIED REPORT OR SECTION 4-336 & 4-343 (C)
- ADMINISTRATION OR CONSTRUCTION PER PART 1, TITLE 24, C.C.R.
- DUTIES OF ARCHITECT, STRUCTURAL ENGINEER, OR PROFESSIONAL ENGINEER PER SECTION 4-333 (A) AND 4-341
- DUTIES OF CONTRACTOR PER SECTION 4-343
- VERIFIED REPORTS PER SECTION 4-343 AND 4-336
- A COPY OF PARTS 1 TO 5 OF TITLE 24 SHALL BE KEPT AND AVAILABLE IN THE FIELD DURING CONSTRUCTION
- DSA SHALL BE NOTIFIED AT START OF CONSTRUCTION AND PRIOR TO PLACEMENT OF CONCRETE PER SECTION 4-331
- SUPERVISION BY DSA PER SECTION 4-334
- DSA IS NOT SUBJECT TO ARBITRATION

PIPES, DUCTS AND CONDUIT - SUPPORT AND BRACING
PIPES, DUCTS, AND CONDUITS SHALL BE SUPPORTED AND BRACED PER THE SMACNA "GUIDELINES FOR SEISMIC RESTRAINTS OF MECHANICAL SYSTEMS AND PLUMBING PIPING SYSTEMS", OPM 0052-13 SEISMIC BRACING AND SUPPORT SYSTEMS.

DRILLED-IN EXPANSION ANCHORS
WHEN INSTALLING DRILLED-IN ANCHORS AND/OR POWDER DRIVEN PINS IN EXISTING NON-PRESTRESSED REINFORCED CONCRETE, USE CARE AND CAUTION TO AVOID CUTTING OR DAMAGING THE EXISTING REINFORCING BARS. WHEN INSTALLING THEM INTO EXISTING PRESTRESSED CONCRETE (PRE- OR POST-TENSIONED), LOCATE THE PRESTRESSED TENDONS BY USING A NON-DESTRUCTIVE METHOD PRIOR TO INSTALLATION. EXERCISE EXTREME CARE AND CAUTION TO AVOID CUTTING OR DAMAGING THE TENDONS DURING INSTALLATION. MAINTAIN A MINIMUM CLEARANCE OF ONE INCH BETWEEN THE REINFORCEMENT AND THE DRILLED-IN ANCHOR AND/OR PIN.

GENERAL NOTES

ADMINISTRATIVE REQUIREMENTS
- ADDENDA MUST BE SIGNED BY ARCHITECT AND APPROVED BY DSA
- NO CHANGES OR REVISIONS SHALL BE MADE FOLLOWING WRITTEN APPROVAL WHICH AFFECTS ACCESS COMPLIANCE ITEM UNLESS SUCH CHANGES TO REVISIONS ARE SUBMITTED TO DSA FOR APPROVAL. SUBSTITUTIONS AFFECTING DSA REGULATED ITEMS SHALL BE SUBMITTED AS A CONSTRUCTION CHANGE DOCUMENT OR ADDENDA, AND SHALL BE APPROVED BY DSA PRIOR TO FABRICATION AND INSTALLATION
- CONSTRUCTION CHANGE DOCUMENTS MUST BE SIGNED BY THE FOLLOWING:
-- ARCHITECT OR ENGINEER OF RECORD
-- STRUCTURAL ENGINEER (WHEN APPLICABLE)
-- DELEGATED PROFESSIONAL ENGINEER
-- DSA
- MATERIALS AND THEIR INSTALLATIONS SHALL COMPLY WITH APPLICABLE CODES.
- PER CBC 11B-104.1 ALL DIMENSIONS ARE SUBJECT TO CONVENTIONAL INDUSTRY TOLERANCES EXCEPT WHERE THE REQUIREMENT IS STATED AS A RANGE WITH SPECIFIC MINIMUM AND MAXIMUM END POINTS.

SOILS AND GEOTECHNICAL: A GEOTECHNICAL INVESTIGATION MUST BE CONDUCTED IN ACCORDANCE WITH CBC SECTION 1803A AND REPORTED AS REQUIRED IN SECTION 1803A.7 (SEE EXCEPTION IN APPENDIX A ITEM C3). THE DESIGN ARCHITECT OR STRUCTURAL ENGINEER IN GENERAL RESPONSIBLE CHARGE MUST VERIFY THAT THE GEOTECHNICAL REPORT INDICATES THAT ALL SOILS RELATED PARAMETERS EXCEED THE MINIMUM DESIGN REQUIREMENTS IDENTIFIED ON THE PC DRAWINGS INCLUDING BUT NOT LIMITED TO ALLOWABLE SOIL PRESSURES, SURCHARGE, DOWN-DRAW, AND EFFECTS DUE TO HIGH-WATER TABLE, ETC., AS APPLICABLE.

GEOHAZARD REPORT (ENGINEERING GEOLOGIC REPORT): A GEOLOGIC HAZARDS INVESTIGATION MUST BE CONDUCTED IN ACCORDANCE WITH CBC SECTION 1803A.8 AND R 4-4. GEOHAZARD REPORT REQUIREMENTS. THE DESIGN ARCHITECT OR STRUCTURAL ENGINEER IN GENERAL RESPONSIBLE CHARGE MUST VERIFY THAT THE GEOLOGIC HAZARDS WHICH WOULD PRECLUDE THE USE OF THE PC DESIGN AT THE SITE, INCLUDING BUT NOT LIMITED TO LIQUEFACTION POTENTIAL, LANDSLIDE, FLOODING, EARTHQUAKE FAULTING, ETC.

ABBREVIATIONS

(REFER TO CONSULTANT DRAWINGS FOR ADDITIONAL ABBREVIATIONS)

A.F.F.	ABOVE FINISHED FLOOR	LAM.	LAMINATE
A.P.	ACCESS PANEL	LAV.	LAVATORY
ACT	ACOUSTIC TILE	M.B.	MACHINE BOLT
ADJ.	ADJUSTABLE	M.S.	MACHINE SCREW
ALUM.	ALUMINUM	M.H.	MANHOLE
A.B.	ANCHOR BOLT	MFG.	MANUFACTURER
APPROX.	APPROXIMATELY	M.B.	MARKER BOARD
ARCH.	ARCHITECT	MATL.	MATERIAL
AC	ASPHALTIC CONCRETE	MAX.	MAXIMUM
#	AT	MECH.	MECHANICAL
B.M.	BENCH MARK	MTL.	METAL
BLKG.	BLOCKING BOARD	MIN.	MINIMUM
BD.	BOTH WAYS	MISC.	MISCELLANEOUS
B.W.	BOTTOM	MOUNT.	MOUNTED
B.LDG.	BUILDING	(N)	NEW
B.U.R.	BUILT-UP ROOFING	NOM.	NOMINAL
C.B.	CATCH BASIN	N.C.	NOT IN CONTRACT
CEL.	CEILING	N.T.S.	NOT TO SCALE
CEM.	CEMENT	NO. or #	NUMBER
C.C. or O.C.	CENTER TO CENTER	OCC.	OCCUPANCY(%)
		OPN.	OPENING
CER. TILE	CERAMIC TILE	OPP.	OPPOSITE
C.O.T.G.	CLEANOUT TO GRADE	OUTSIDE HAND	OUTSIDE HAND
CLR.	CLEAR	O.F.O.S.	OUTSIDE FACE OF STUD
C.A.H.R.	CLEAR ALL HEART REDWOOD	O.H.W.S.	OVAL HEAD WOOD SCREW
		O.D.	OVERFLOW DRAIN and/or OUTSIDE DIAMETER
C.W.	COLD WATER	O.F.C.I.	OWNER FURNISHED and CONTRACTOR INSTALLED
COL.	COLUMN	PAR.	PARTITION
COM.	COMMON	PL.	PLATE
CONC.	CONCRETE	P.	PENNY (NAILS)
CONST.	CONSTRUCTION	PLAS.	PLASTER
C.H.	CONSTRUCTION HEART	PLYWD.	PLYWOOD
C.J.	CONSTRUCTION JOINT	P.V.C.	POLY VINYL CHLORIDE
CONT.	CONTINUOUS	P.T.	PRESSURE TREATED
CONTR.	CONTRACTOR	P.L.	PROPERTY LINE
COUNTER	COUNTER	R. or RAD.	RADIUS
COUNTER SUNK	COUNTER SUNK	R.W.L.	RAIN WATER LEADER
DET.	DETAIL	RWD./R.W.	REDWOOD
DIA. or Ø	DIAMETER	REINF.	REINFORCING
DIM.	DIMENSION	REQD.	REQUIRED
D.A.	DISABLED ACCESS	R.A.G.	RETURN AIR GRILLE
D.R.	DOOR	R.E.	RM ELEVATION
D.S.	DOWNSPOUT	R/O	ROUGH OPENING
DWG.	DRAWING	R.M.	ROOM
D.F.	DRINKING FOUNTAIN and/or DOUGLAS FIR	R.O.	ROUGH OPENING
EA.	EACH	ROUN.	ROUND
E.W.	EACH WAY	R.H.M.S.	ROUND HEAD METAL SCREW
ELEC.	ELECTRIC or ELECTRICAL	R.H.W.S.	ROUND HEAD WOOD SCREW
EL. or ELEV.	ELEVATION	SSD.	SEE STRUCTURAL DRAWINGS
ENCL.	ENCLOSE and/or ENCLOSURE	S.T.S.M.S.	SELF TAPPING SHEET METAL SCREW
EQ.	EQUAL	SHEATH.	SHEATHING
EQUIP.	EQUIPMENT	S.M.	SHEET METAL
EJ.	EXISTING	S.M.S.	SHEET METAL SCREW
EX.	EXPANSION	S.O.V.	SHUT OFF VALVE
E.J.	EXPANSION JOINT	SIM.	SIMILAR
EXP.	EXPOSED	S.C.	SOLID CORE
EXT.	EXTERIOR	SPEC.	SPECIFICATION
F.O.C.	FACE OF CONCRETE	SQ.	SQUARE
F.O.M.	FACE OF MASONRY	S.F.	SQUARE FEET
F.O.S.	FACE OF STUD	STAG.	STAGGERED
F.O.F.	FACE OF FINISH	STD.	STANDARD
FIN.	FINISH	S.S.	STAINLESS STEEL
F.F.	FINISHED FLOOR	STL.	STEEL
F.S.	FINISH SLAB	STOR.	STORAGE
F.E.	FIRE EXTINGUISHER	STRUC.	STRUCTURAL
F.E.C.	FIRE EXTINGUISHER CABINET	S.A.G.	SUPPLY AIR GRILLE
F.H.	FIRE HYDRANT	THRES.	THRESHOLD
F.H.M.S.	FLAT HEAD METAL SCREW	T&G	TONGUE & GROOVE
F.H.W.S.	FLAT HEAD WOOD SCREW	T.J.	TOOLED JOINT
FL. or FLR.	FLOOR	T.O.B.	TOP OF BEAM
F.D.	FLOOR DRAIN	T.O.C.	TOP OF CURB or CONCRETE
FTG.	FOOTING	T.O.S.	TOP OF STEEL or SHEATHING
GA.	GALVANIZED	T.O.W.	TOP OF WALK
G.I.	GALVANIZED IRON	TYP.	TYPICAL
GL.	GLASS	U.O.N.	UNLESS OTHERWISE NOTED
GLU-LAM	GLUE LAMINATED	U.O.S.	UNLESS OTHERWISE SHOWN
GRD.	GRADE	V.T.R.	VENT THROUGH ROOF
GYP. BD.	GYP. BOARD	VERT.	VERTICAL
H.W.	HARDWARE	V.G.	VERTICAL GRAIN
HT.	HEIGHT	V.I.F.	VERIFY IN FIELD
H.C.	HOLLOW CORE	V.C.T.	VINYL COMPOSITION TILE
H.M.	HOLLOW METAL	V.W.C.	VINYL WALL COVERING
HORIZ.	HORIZONTAL	V.O.I.P.	VOICE OVER INTERNET PROTOCOL
H.B.	HOLE BORE	W.C.	WATER CLOSET
I.D.	INSIDE DIAMETER	W.H.	WATER HEATER
INSUL.	INSULATION	W.P.R.	WATERPROOF
INT.	INTERIOR	W.R.	WATER RESISTANT
INV.	INVERT	W.W.M.	WELDED WIRE MESH
JT.	JOINT	W.D.	WINDOW DIMENSION
J.H.	JOIST HANGER	W.	WITH
K.D.	KILN DRIED	WO.	WOOD
WD.	WOOD		



BUILDING CODES AND STANDARDS:

2019	CALIFORNIA ADMINISTRATIVE CODE, PART 1, TITLE 24, C.C.R.	
2019	CALIFORNIA BUILDING CODE (CBC), PART 2, TITLE 24, C.C.R.	
2019	2018 INTERNATIONAL BUILDING CODE, VOLUMES 1 AND 2, WITH 2019 CALIFORNIA AMENDMENTS	
2019	CALIFORNIA ELECTRIC CODE (CEC), PART 3, TITLE 24, C.C.R.	
2019	2018 NATIONAL ELECTRIC CODE WITH 2019 CALIFORNIA AMENDMENTS	
2019	CALIFORNIA MECHANICAL CODE (CMC), PART 4, TITLE 24, C.C.R.	
2019	2018 INTERNATIONAL MECHANICAL CODE WITH 2019 CALIFORNIA AMENDMENTS	
2019	CALIFORNIA PLUMBING CODE (CPC), PART 5, TITLE 24, C.C.R.	
2019	2018 INTERNATIONAL PLUMBING CODE WITH 2019 CALIFORNIA AMENDMENTS	
2019	CALIFORNIA ENERGY CODE (CENC), PART 6, TITLE 24, C.C.R.	
2019	CALIFORNIA FIRE CODE (CFC), PART 9, TITLE 24, C.C.R.	
2019	2018 INTERNATIONAL FIRE CODE WITH 2019 CALIFORNIA AMENDMENTS	
2019	CALIFORNIA GREEN BUILDING STANDARDS CODE, PART 11, TITLE 24, C.C.R.	
2019	CALIFORNIA REFERENCED STANDARDS, PART 12, TITLE 24, C.C.R.	
2016	ADA STANDARDS FOR ACCESSIBLE DESIGN (2010 ADA AGC) SAFETY CODE FOR ELEVATORS AND ESCALATORS	
2010	ADA STANDARDS FOR ACCESSIBLE DESIGN (2010 ADA AGC) SAFETY CODE FOR ELEVATORS AND ESCALATORS	

SYMBOLS LEGEND

	SECTION / EXTERIOR ELEVATION
	SECTION IDENTIFICATION
	SHEET WHERE SECTION IS DRAWN
	DETAIL
	DETAIL IDENTIFICATION
	SHEET WHERE DETAIL IS DRAWN
	INTERIOR ELEVATION
	INDICATES ELEVATION SHOWN
	SHEET WHERE ELEVATION IS DRAWN
	ROOM IDENTIFICATION
	ROOM NUMBER
	SPECIFIC NOTE
	DOOR DESIGNATION
	WINDOW DESIGNATION
	ADDENDUM REVISION
	CLOUD AROUND REVISION
	CCD REVISION
	CLOUD AROUND REVISION
	FINISH NUMBER
	SEE SPECS AND I.E. DWGS.
	EQUIPMENT LETTER
	SEE EQUIPMENT SCHEDULE
	CEILING HEIGHT
	WALL TYPE
	MATCH LINE
	ELEV. HEIGHT
	F.O.S., U.O.N.
	FACE OF FINISH

PROJECT SUMMARY

INSTALLATION OF A NEW METAL SHADE STRUCTURE - PC #04-117117 AND ASSOCIATED SITE WORK.

THERE ARE NO DEFERRED SUBMITTALS FOR THIS PROJECT.


DESIGN TEAM

ARCHITECT
SUGIMURA FINNEY ARCHITECTS
2155 SOUTH BASCOM AVENUE SUITE 200
CAMPBELL, CALIFORNIA 95008
(408) 879-0600
(408) 377-6066 FAX
ATTN: MARK FINNEY MARK@SUGIMURA.COM

DRAWING INDEX

T1	TITLE SHEET
T2	SITE PLAN - FIRE LIFE SAFETY & ACCESS COMPLIANCE
ARCHITECTURAL	
A0.1	ENLARGED DEMOLITION SITE PLAN
A0.2	NEW ENLARGED SITE PLAN
A0.4	SITE DETAILS
A002	ENLARGED SITE PLAN AND DETAILS
A301	ENLARGED FLOOR PLAN - FIS & ADMIN & RESTROOM
A581	SIGNAGE & MISCELLANEOUS DETAILS
SHADE STRUCTURE MANUFACTURER'S DRAWINGS DSA #04-117117	
S-1	COVER SHEET
S-2	GENERAL DATA
S-3	GENERAL NOTES
S-4	SAMPLE DSA 103 FORMS
S-5	SECTIONS PROPERTIES & REBAR DETAILS
S-6	VC 14, VC 18, & VC 20 FRAMING PLAN & ELEVATIONS
S-7	VC 14, VC 18, & VC 20 FRAMING SCHEDULES
S-8	VC 140, VC 180, & VC 200 FRAMING PLAN & ELEVATIONS
S-9	VC 140, VC 180, & VC 200 FRAMING SCHEDULES
S-10	PIER FOUNDATION AND SPREAD FOOTINGS SCHEDULES
S-11	STANDARD DETAILS 1
S-12	STANDARD DETAILS 2
S-13	SAMPLE ARCHITECTURAL ELEVATIONS

VICINITY MAP

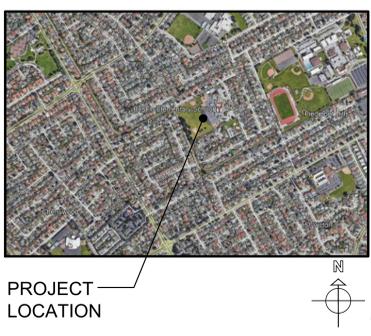

STATEMENT OF GENERAL CONFORMANCE

FOR ARCHITECTS / ENGINEERS WHO UTILIZE PLANS, INCLUDING BUT NOT LIMITED TO SHOP DRAWINGS, PREPARED BY OTHER LICENSED DESIGN PROFESSIONALS AND / OR OTHER CONSULTANTS

APPLICATION NO: 01-118968 FILE NO: 43-7

THE DRAWINGS OR SHEETS LISTED ON THE COVER OR INDEX SHEET MARKED WITH AN (*)
 THIS DRAWING, PAGE OF SPECIFICATIONS / CALCULATIONS

HAVE BEEN PREPARED BY OTHER DESIGN PROFESSIONALS OR CONSULTANTS WHO ARE LICENSED AND / OR AUTHORIZED TO PREPARE SUCH DRAWINGS IN THIS STATE. IT HAS BEEN EXAMINED BY ME FOR:

- DESIGN INTENT AND APPEARS TO MEET THE APPROPRIATE REQUIREMENTS OF TITLE 24, CALIFORNIA CODE OF REGULATIONS AND THE PROJECT SPECIFICATIONS PREPARED BY ME. AND
- COORDINATION WITH MY PLANS AND SPECIFICATIONS AND IS ACCEPTABLE FOR INCORPORATION INTO THE CONSTRUCTION OF THIS PROJECT.

THE STATEMENT OF GENERAL CONFORMANCE SHALL NOT BE CONSTRUED AS RELIEVING ME OF MY RIGHTS, DUTIES, AND RESPONSIBILITIES UNDER SECTIONS 17302 AND 81138 OF THE EDUCATION CODE AND SECTIONS 4-336, 4-341 AND 4-344* OF TITLE 24, PART 1, (TITLE 24, PART 1, SECTION 4-317(B))

I FIND THAT:
 ALL DRAWINGS OR SHEETS LISTED ON THE COVER OR INDEX SHEET
 THIS DRAWING OR PAGE

IS / ARE IN GENERAL CONFORMANCE WITH THE PROJECT DESIGN, AND
 HAS / HAVE BEEN COORDINATED WITH THE PROJECT PLANS AND SPECIFICATIONS.

MARK FINNEY	DATE
C-24673	04/09/2019
LICENSE NUMBER	9/30/2021
	EXPIRATION DATE

TITLE SHEET		
REVISIONS	NO.	ITEM DATE

DRAWN BY:	MJ
CHECKED BY:	NK
SFA JOB NO:	DATE
19066	08/17/2019
T1	

DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE STATEMENT:

THE PATH OF TRAVEL IDENTIFIED IN THESE CONSTRUCTION DOCUMENTS IS COMPLIANT WITH THE CURRENT APPLICABLE CALIFORNIA BUILDING CODE ACCESSIBILITY PROVISIONS FOR PATH OF TRAVEL REQUIREMENT FOR ALTERATIONS, ADDITIONS AND STRUCTURAL REPAIRS. AS PART OF THE DESIGN OF THIS PROJECT, THE P.O.T. WAS EXAMINED AND ANY ELEMENTS, COMPONENTS OR PORTIONS OF THE P.O.T. THAT WERE DETERMINED TO BE NONCOMPLIANT 1) HAVE BEEN IDENTIFIED AND 2) THE CORRECTIVE WORK NECESSARY TO BRING THEM INTO COMPLIANCE HAS BEEN INCLUDED WITHIN THE SCOPE OF THIS PROJECT'S WORK THROUGH DETAILS, DRAWINGS, AND SPECIFICATIONS INCORPORATED INTO THESE CONSTRUCTION DOCUMENTS. ANY NONCOMPLIANT ELEMENTS, COMPONENTS OR PORTIONS OF THE P.O.T. THAT WILL NOT BE CORRECTED BY THIS PROJECT BASED ON VALUATION THRESHOLD LIMITATIONS OR A FINDING OF UNREASONABLE HARDSHIP ARE SO INDICATED IN THESE CONSTRUCTION DOCUMENTS.

DURING CONSTRUCTION, IF P.O.T. ITEMS WITHIN THE SCOPE OF THIS PROJECT REPRESENTED AS CODE COMPLIANT ARE FOUND TO BE NONCONFORMING BEYOND REASONABLE CONSTRUCTION TOLERANCES, THEY SHALL BE BROUGHT INTO COMPLIANCE WITH THE CBC AS A PART OF THIS PROJECT BY MEANS OF A CONSTRUCTION CHANGE DOCUMENT.

SAFE DISPERSAL AREA

TOTAL 'E' OCCUPANCY BUILDINGS WITH OCCUPANTS = 18,912
18,912 SF @ 20 SF/OCC = 945 OCCUPANTS

TOTAL 'B' OCCUPANCY BUILDINGS WITH OCCUPANTS = 9,028
9,028 SF @ 100 SF/OCC = 90 OCCUPANTS

TOTAL 'F-1' OCCUPANCY BUILDINGS WITH OCCUPANTS = 5,154
5,154 SF @ 300 SF/OCC = 17 OCCUPANTS

TOTAL OCCUPANTS = 945 + 90 + 17 = 1,052

MINIMUM DISPERSAL AREA REQUIRED: OCCUPANTS x 5 SF/OCC
1,052 x 5 SF = 5,260 SF

AREA PROVIDED = 5,300 SF THEREFORE OK.

PARKING ANALYSIS


PARKING LOT 1:
EXISTING PARKING: 47 PARKING STALLS TOTAL
ACCESSIBLE - 2 PARKING STALLS INCLUDING 1 VAN PARKING STALL

PARKING LOT 2:
EXISTING PARKING: 20 PARKING STALLS TOTAL
ACCESSIBLE - 1 PARKING STALL INCLUDING 1 VAN PARKING STALL

BUILDING CODE ANALYSIS				
BUILDING	CONSTRUCTION TYPE/OCCUPANCY TYPE	AREA (SQ.FT.)	ALLOWABLE (SQ.FT.)	# OF STORIES
ADMINISTRATIVE UNIT A	V-B/B	1,793	8,000	1
CLASSROOMS UNIT C	V-B/E	3,577	9,500	1
UNIT D, D2 & FL. B	V-B/A2/E	SEE BELOW *	6000 / 9500*	2
CLASSROOM UNIT E	V-B/E	3175	9,500	1
CLASSROOM UNIT F	V-B/E	624	9,500	1
CLASSROOM UNIT G	V-B/E	3175	9,500	1
(N) SHADE STRUCTURE	V-B/A3	1600	6000	1

BUILDING*	D-A	D-B	D-C
TOTAL ALLOWABLE FLOOR AREA	9,500	21,064	9,500
TOTAL FLOOR AREA	3,134	20,243	6,338

NOTE:
FORM ABOVE IS DSA APPROVED FROM PROJECT DSA #01-100993. THERE ARE NO AREA INCREASES AS PART OF THIS PROJECT.

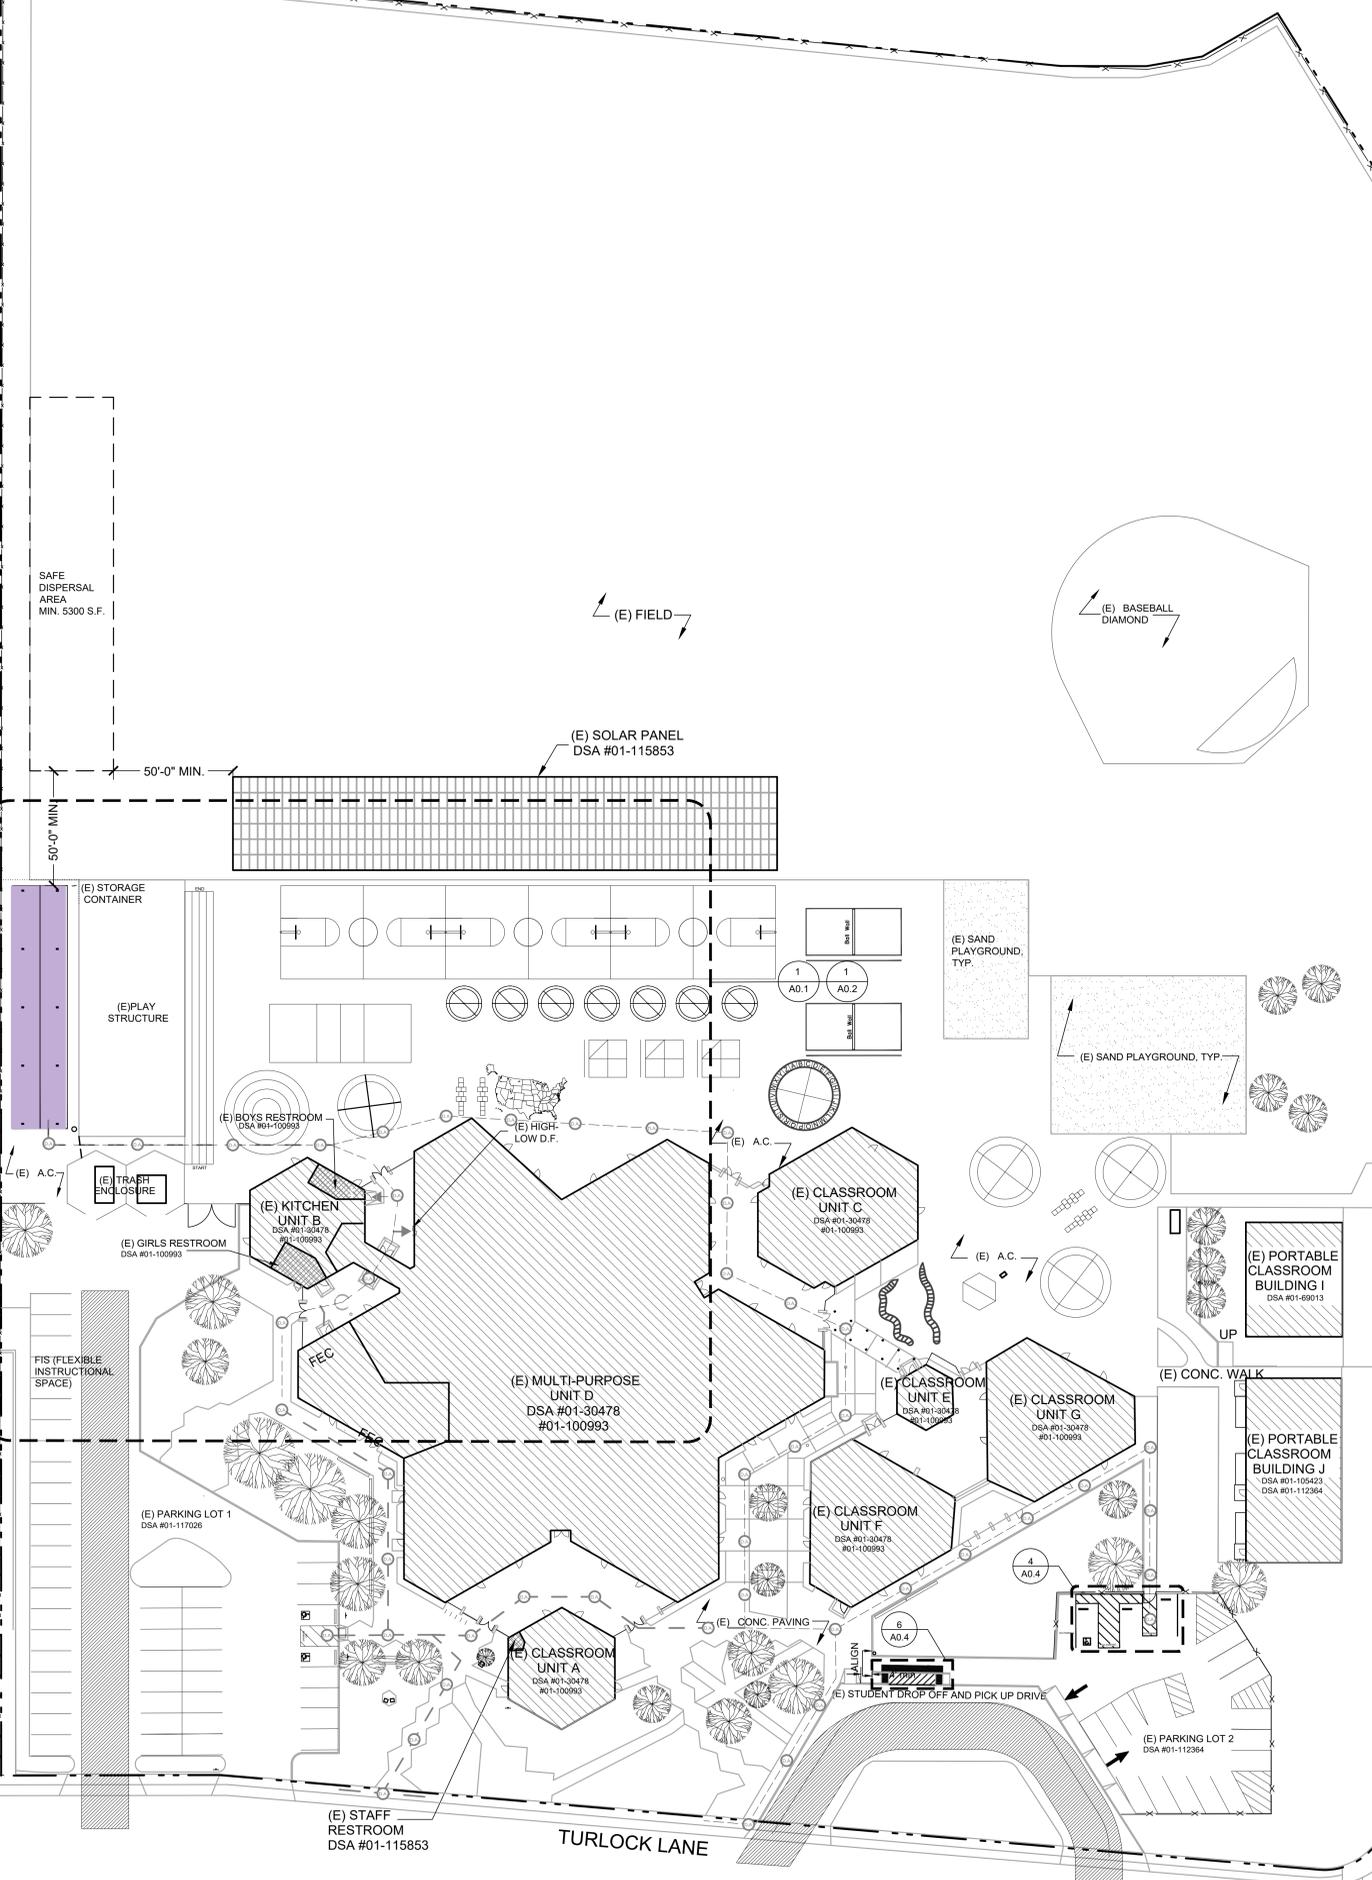

PROJECT SUMMARY

INSTALLATION OF (1) NEW METAL SHADE STRUCTURE PC #04-117117 AND ASSOCIATED SITE WORK.

GENERAL NOTES

- A. THIS SHEET IS FOR ACCESS COMPLIANCE CODE RELATED ITEMS. FOR SCOPE OF WORK SEE SHEETS A0.1 AND A0.2.
- B. REFER TO P.C. DRAWINGS FOR EXTENT OF P.C. WORK.
- C. ACCESSIBLE PATH OF TRAVEL (P.O.T.), AS INDICATED, IS A COMMON BARRIER FREE ACCESS ROUTE WITHOUT ANY ABRUPT VERTICAL CHANGES EXCEEDING A 1/2" BEVELED AT 1:2 MAXIMUM SLOPE, EXCEPT THAT LEVEL CHANGES DO NOT EXCEED 1/4" VERTICAL AND AT LEAST 48" WIDE. THE PATH SURFACE IS SLIP RESISTANT, STABLE, FIRM, AND SMOOTH. PASSING SPACES (11B-403.5.3) AT LEAST 60"x60" ARE LOCATED NOT MORE THAN 200' APART. PARTS OF P.O.T. WITH CONTINUOUS GRADIENTS HAVE 80' LEVEL AREAS (11B-403.7) NOT MORE THAN 400' APART. THE CROSS SLOPE DOES NOT EXCEED 2% AND SLOPE IN THE DIRECTION OF TRAVEL AND IS LESS THAN 5% UNLESS OTHERWISE INDICATED. P.O.T. SHALL BE MAINTAINED FREE OF OVERHANGING OBSTRUCTIONS TO 80" MINIMUM (11B-307.4) AND PROTRUDING OBJECTS GREATER THAN 4" PROJECTION FROM WALL AND ABOVE 27" AND LESS THAN 80" (11B-307.2).
- D. GATES IN THE PATH OF TRAVEL SHALL MEET DOOR REQUIREMENTS PER CBC SECTION 11B-404. ALL GATES TO HAVE ACCESSIBLE HARDWARE AND 10" MIN. SMOOTH BOTTOM OR KICK PLATES. PANIC HARDWARE AND EXIT SIGN MAY BE REQUIRED. COORDINATE WITH FIRE AND LIFE SAFETY.
- E. CONTRACTOR TO VERIFY ALL BARRIERS IN P.O.T. HAVE BEEN REMOVED.
- F. ALL EXTERIOR ENTRANCES AND EXITS IDENTIFIED WITH A TRIANGULAR SYMBOL ON THIS PLAN ARE ACCESSIBLE AND COMPLY WITH CBC 11B-401 AND INCLUDE A 32" CLEAR OPENING, THE REQUIRED STRIKE EDGE CLEARANCE AT PULL SIDE OF DOOR, LEVEL LANDINGS WITH A 2% MAX. SLOPE, AND AN ACCESSIBLE THRESHOLD, HARDWARE, CLOSER AND KICK PLATE.
- G. CONTRACTOR TO INSTALL MISSING GRAB BARS IN THE ACCESSIBLE RESTROOMS PER DSA # 01-117026 REFERENCE SHEET A301 & A381

SITE PLAN - FIRE LIFE SAFETY & ACCESS COMPLIANCE NOTES

- 1. EXISTING FIRE HYDRANT.
- 2. EXISTING PARKING ENTRY SIGN PER DSA #01-117026
- 3. (E) DA PARKING STALLS, PER DSA #01-117026, SEE REFERENCE DRAWINGS A002.
- 4. (E) DA PARKING SIGN, PER DSA #01-117026
- 5. (E) HI-LOW ACCESSIBLE DRINKING FOUNTAIN PER DSA #01-117026
- 6. (E) ACCESSIBLE BOYS RESTROOMS PER DSA #01-117026, SEE REFERENCE DRAWINGS A301
- 7. (E) ACCESSIBLE GIRLS RESTROOMS PER DSA #01-117026, SEE REFERENCE DRAWINGS A301
- 8. (N) METAL SHADE STRUCTURE PC #04-117117, SEE MANUFACTURER'S DRAWINGS.
- 9. (E) DROP OFF AREA ACCESSIBLE CURB RAMP PER DSA #01-117026, SEE REFERENCE DRAWING G003



810

FIRE & LIFE SAFETY SITE CONDITIONS SUBMITTAL

To facilitate the Division of the State Architect's (DSA) fire and life safety plan review of project site conditions, DSA requires the design professional to provide the following information at time of project submittal for projects consisting of construction of a new campus, construction of new buildings, additions to existing buildings, and for site alternate design means for fire department emergency vehicle access, and fire suppression water supply.

Information associated with compliance items 1-3 below is to be provided for all project types indicated above. Information associated with items 4-7 is to be completed when an alternate means is utilized. Acknowledgement by the school district and signature from the local fire authority (LFA) is only required when an alternate design means is being requested.

Page 1 of the completed form must be imaged onto the fire access site plan. When an alternate design/means is proposed, completed pages 1 and 2 are to be imaged on the fire access site plan.

For additional information refer to the instructions at the end of this form and [DSA Policy 09-01](#).

PROJECT INFORMATION			
School District/Owner: BERRYESSA UNION SCHOOL DISTRICT			
Project Name/School: RUSKIN ELEMENTARY SCHOOL SHADE STRUCTURES			
Project Address: 1401 TURLOCK LN., SAN JOSE, CA 95132			

FIRE & LIFE SAFETY INFORMATION			
1. Has a fire hydrant flow test been performed within the past 12 months? (If yes, provide a copy of the test data.)	Yes <input type="checkbox"/>	No <input checked="" type="checkbox"/>	
2. Was the fire hydrant water flow test performed as part of this LFA review?	Yes <input type="checkbox"/>	No <input checked="" type="checkbox"/>	
3. Is the project located within a designated fire hazard severity zone as established by Cal-Fire? (If yes, indicate fire hazard zone classification below)	Yes <input type="checkbox"/>	No <input checked="" type="checkbox"/>	
Refer to the following for fire hazard zone locations: www.fire.ca.gov/fire_prevention/fire_prevention_wildland_zones_maps			
	Moderate <input type="checkbox"/>	High <input type="checkbox"/>	Very High <input type="checkbox"/>
Wildland Interface Area (WIFA) (If any designations are checked, project design must meet the requirements of CBC Chapter 7A.)			WIFA <input type="checkbox"/>

CONDITION MEANS AND METHODS RESOLUTION		ALTERNATE ACCEPTED	
		Yes	No
4. Emergency vehicle access roadways do not meet CFC requirements.			<input checked="" type="checkbox"/>
4a. Acceptable Alternate: Emergency vehicle and personnel access as proposed by the project architect is acceptable for providing fire suppression and protection of life and property.			<input checked="" type="checkbox"/>
5. Fire Hydrants: Number and spacing does not meet CFC requirements.			<input checked="" type="checkbox"/>
5a. Acceptable Alternate: Number of fire hydrants and spacing as proposed by the project architect is acceptable for fire suppression and protection of life and property.			<input checked="" type="checkbox"/>
6. Fire Hydrants: Water flow and pressure are less than CFC minimum.			<input checked="" type="checkbox"/>
6a. Acceptable Alternate: The available flow and pressure is acceptable for providing fire suppression and protection of life and property.			<input checked="" type="checkbox"/>
7. Location of fire department connection(s) serving fire sprinkler systems or standpipe systems does not meet CFC requirements.			<input checked="" type="checkbox"/>
7a. Acceptable Alternate: The location of fire department connection serving the fire sprinkler system and/or standpipe system is acceptable for providing fire suppression and protection of life and property.			<input checked="" type="checkbox"/>

DSA 810 (rev 10-22-18) DIVISION OF THE STATE ARCHITECT DEPARTMENT OF GENERAL SERVICES STATE OF CALIFORNIA Page 1 of 4

GRAPHIC KEY

- - - - - EXISTING PROPERTY LINE
- - - - - ASSUMED PROPERTY LINE
- - - - - ACCESSIBLE PATH OF TRAVEL
- - - - - ROOF OVERHANG
- - - - - CHAIN LINK FENCE
- - - - - WOOD FENCE
- - - - - DECORATIVE FENCE
- [Hatched Box] FIRE DEPARTMENT ACCESS. FIRE DEPARTMENT ACCESS IS 36" WIDE AND RATED FOR 90,000 LB.
- (E) DRY STAND PIPE
- (E) FIRE HYDRANT
- (E) DRINKING FOUNTAIN
- (E) SIGN
- [Solid Box] NEW BUILDING
- [Hatched Box] EXISTING BUILDING

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 01-118968 INC.
REVIEWED FOR
SS FLS ACS
DATE: 06/12/2020

SUGIMURA FINNEY ARCHITECTS
SFA
ARCHITECTURE INTERIORS PLANNING
2155 SOUTH BASCOM AVE.
SUITE 200
CAMPBELL, CA 95005
PHONE: 408.379.9098
FAX: 408.377.4966


REGISTERED ARCHITECT
Mark C. Finney
No. C-24673
9-30-21
STATE OF CALIFORNIA

**SITE PLAN
FIRE LIFE SAFETY & ACCESS COMPLIANCE**
 SHADE STRUCTURE
 RUSKIN ELEMENTARY SCHOOL
 1401 TURLOCK LN., SAN JOSE, CA 95132
 BERRYESSA UNION SCHOOL DISTRICT


NO.	ITEM	DATE

DRAWN BY: MK
CHECKED BY: NJ
SFA JOB NO: 19066 DATE: 08/17/2019

T2



COPYRIGHT © 2019

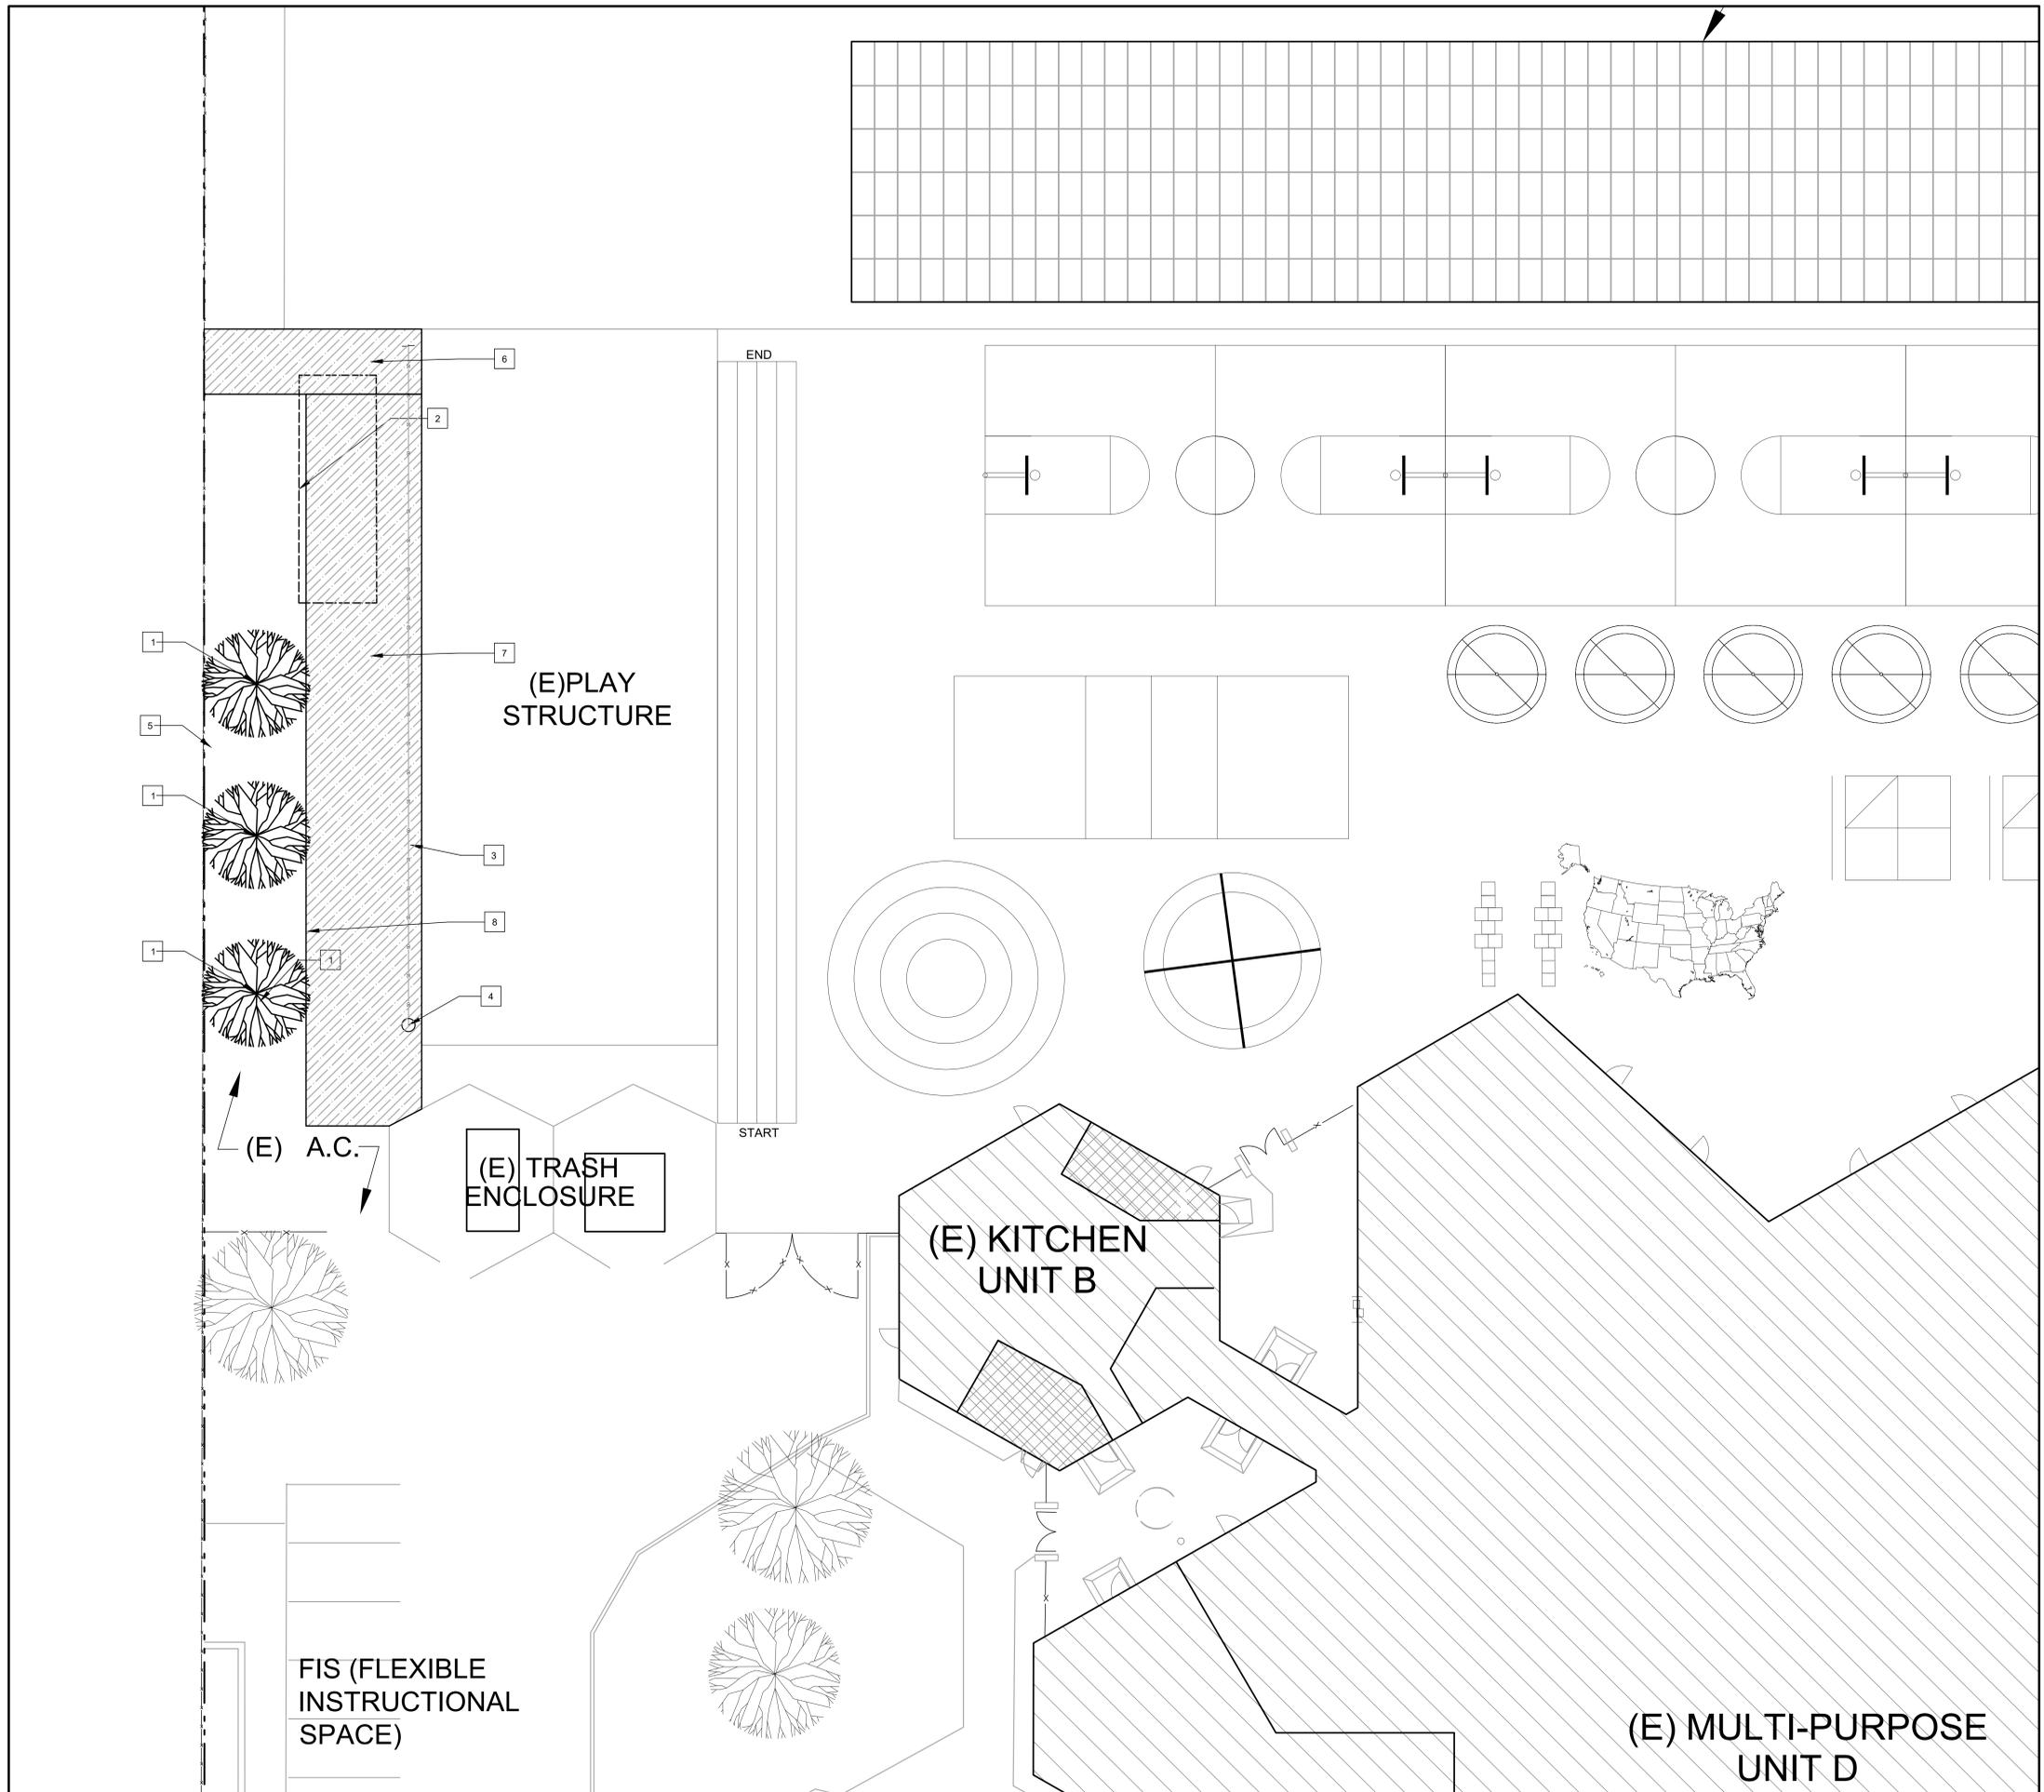

- GENERAL NOTES**
- CONTRACTOR TO VERIFY ALL BARRIERS IN P.O.T. HAVE BEEN REMOVED.
 - CONTRACTOR TO REMOVE ALL EXISTING ITEMS TO ALLOW THE NEW WORK, INCLUDING BUT NOT LIMITED TO TREES, SHRUBS, ASPHALT PAVING, FENCING, STRIPING.
 - GENERAL CONTRACTOR SHALL SURVEY THE AREA OF NEW CONSTRUCTION FOR UNDERGROUND UTILITIES PRIOR TO THE BEGINNING OF CONSTRUCTION, AND RELOCATE/REPAIR ALL EXISTING UTILITIES RUNNING BELOW THE AREA OF THE NEW SHADE STRUCTURES IF IT CONFLICTS WITH NEW SHADE STRUCTURE FOOTING.
 - THE CONTRACTOR SHALL VERIFY ALL UNDERGROUND UTILITIES WITH A LOCATING SERVICE PRIOR TO STARTING CONSTRUCTION.
 - ALL UTILITIES TO BE ABANDONED SHALL BE REMOVED IN THEIR ENTIRETY, AND WIRING PULLED BACK TO SOURCE.
 - REQUIRED UTILITY SHUTDOWNS SHALL BE REQUESTED 72 HOURS IN ADVANCE WITH ARCHITECT AND OWNER.
 - CONTRACTOR TO PROVIDE AND MAINTAIN IN PROPER CONDITION TEMPORARY FENCING PER DETAIL 1/A0.4 PRIOR TO START OF THE CONSTRUCTION AND DURING ALL THE CONSTRUCTION TIME. TEMPORARY FENCING TO BE INSTALLED ALONG THE PERIMETER OF WORK AREA.
 - DEMOLITION WORK SHALL CONFORM TO CALIFORNIA GREEN CODE SECTION 5.408.3 & 5.408.4, AND LOCAL CONSTRUCTION WASTE MANAGEMENT REQUIREMENTS.

- DEMOLITION SITE PLAN NOTES**
- REMOVE (E) TREES STOMP AND ROOTS TYPICAL. FILL THE TRENCH WITH 95% COMPACTED SOIL, FINISH GRADE WITH (N) AC PAVING TO CONFORM WITH EXISTING ADJACENT. SEE DETAIL 2/A0.4.
 - (E) STORAGE CONTAINER TO BE RELOCATED BY OWNER.
 - (E) STORM DRAIN LINE. CONTRACTOR TO VERIFY EXACT ROUTE PRIOR TO BEGINNING OF CONSTRUCTION.
 - APPROXIMATE LOCATION OF (E) STORM DRAIN INLET TO REMAIN. VERIFY EXACT LOCATION IN FIELD. ELEVATE TO (N) AC PAVING LEVEL. SEE A0.2.
 - (E) PROPERTY LINE FENCE TO REMAIN.
 - CLEAR AND GRUB, REMOVE ANY SHRUBS, GRASS, PAVING, PREPARE FOR NEW AC PAVING.
 - REMOVE (E) AC PAVING. GRADE TO ELEVATE (N) AC PAVING TO FLUSH WITH REMAINING (AC) PAVING TO PROVIDE MAX. 2% SLOPE IN ALL DIRECTIONS.
 - BORDER OF AC DEMOLITION AREA IS SHOWN DIAGMATICALLY. VERIFY IN FIELD EXACT BORDER LOCATION PER EXISTING CONDITIONS.

- GRAPHIC KEY**
- - - - - EXISTING PROPERTY LINE
 - - - - - ROOF OVERHANG
 - - - - - CHAINLINK FENCE
 - - - - - WOOD FENCE
 - - - - - DECORATIVE FENCE
 - [Hatched Box] AREA OF DEMOLITION
 - [Solid Box] EXISTING BUILDING
 - [Grid Box] EXISTING RESTROOMS
 - ⊕ (E) DRY STAND PIPE
 - ⊕ (E) DRINKING FOUNTAIN
 - ⊕ (E) FIRE HYDRANT
 - ⊕ (E) SIGN
 - M** (E) MENS TOILET ROOM
 - W** (E) WOMENS TOILET ROOM
 - G** (E) GIRLS TOILET ROOM
 - B** (E) BOYS TOILET ROOM
 - U** (E) UNISEX TOILET ROOM
 - K** (E) KINDERGARTEN TOILET ROOM

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP: 01-118968 INC.
 REVIEWED FOR: SS FLS ACS
 DATE: 06/12/2020

SUGIMURA FINNEY ARCHITECTS
SFA
 ALL-BUILDING, INTERIORS, PLANNING
 2155 SOUTH BASCOM AVE.
 SUITE 200
 CAMPBELL, CA 95008
 PHONE: 408.879.8009
 FAX: 408.577.4906



ENLARGED DEMOLITION SITE PLAN
 SHADE STRUCTURE
 RUSKIN ELEMENTARY SCHOOL
 1401 TURLOCK LN., SAN JOSE, CA 95132
 BERRYESSA UNION SCHOOL DISTRICT

NO.	ITEM	DATE


DRAWN BY: MK
 CHECKED BY: NJ
 SFA JOB NO: 19066 DATE: 08/17/2019


A0.1

COPYRIGHT © 2019

1

ENLARGED DEMOLITION SITE PLAN



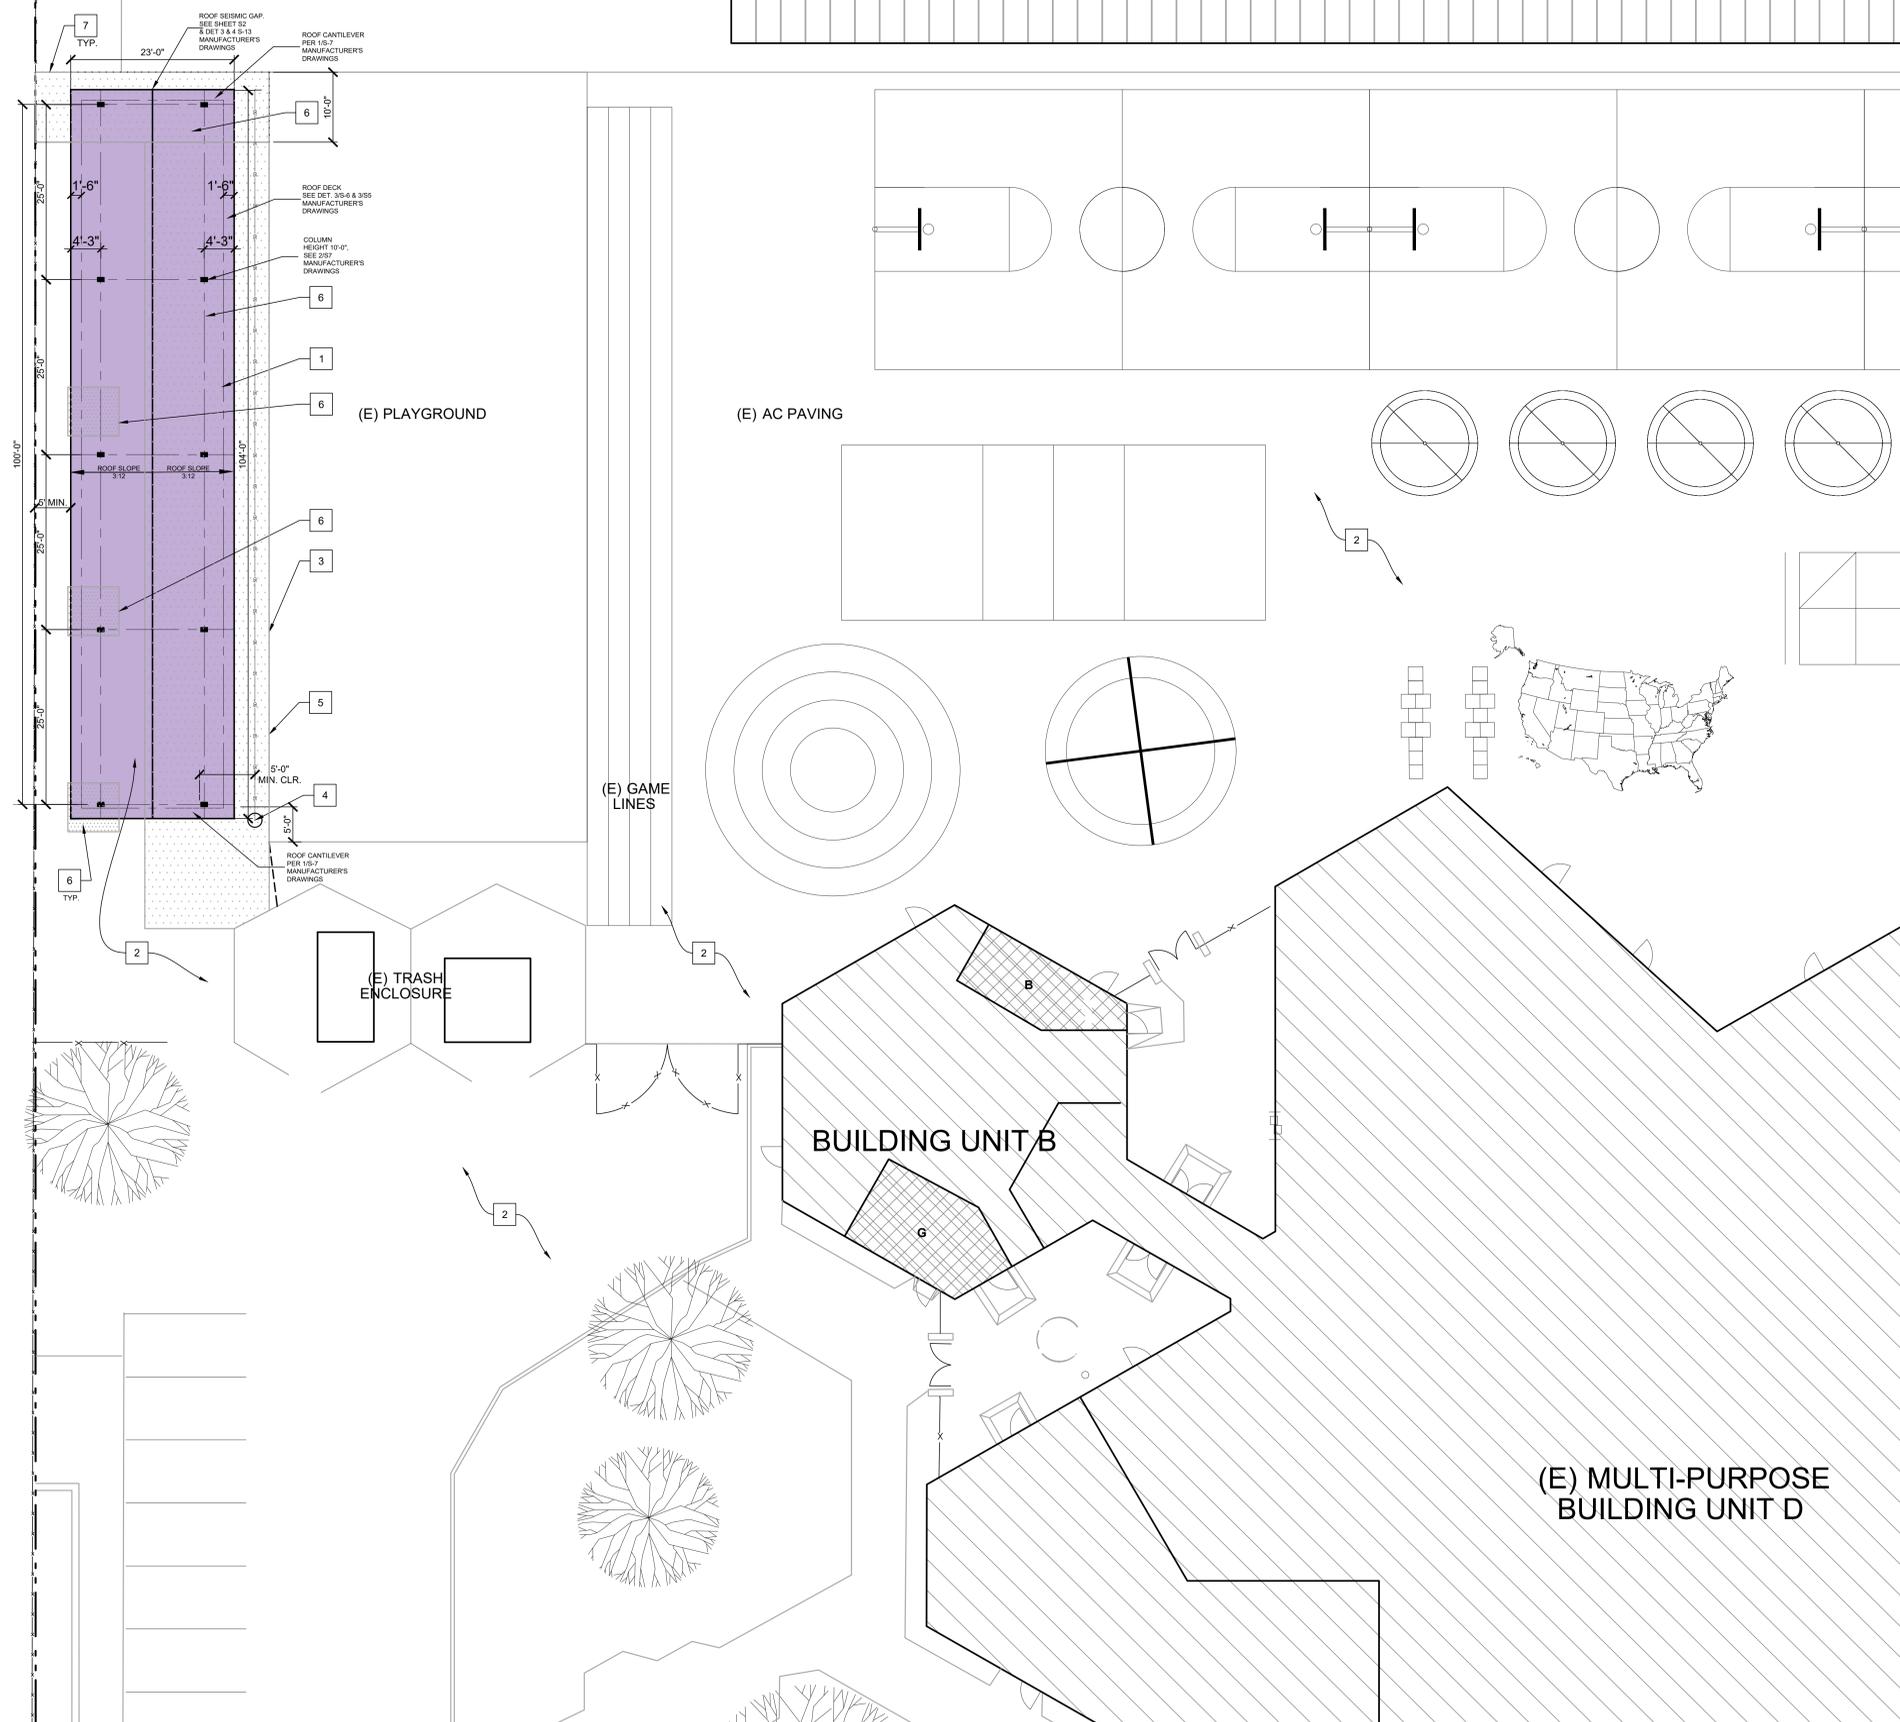

- GENERAL NOTES**
- CONTRACTOR TO VERIFY ALL BARRIERS IN P.O.T. HAVE BEEN REMOVED.
 - CONTRACTOR TO REMOVE ALL EXISTING ITEMS TO ALLOW THE NEW WORK, INCLUDING BUT NOT LIMITED TO TREES, SHRUBS, ASPHALT PAVING, FENCING.
 - GENERAL CONTRACTOR SHALL SURVEY THE AREA OF NEW CONSTRUCTION FOR UNDERGROUND UTILITIES PRIOR TO THE BEGINNING OF CONSTRUCTION, AND REROUTING ALL EXISTING UTILITIES RUNNING BELOW THE AREA OF THE NEW SHADE STRUCTURES IF IT CONFLICTS WITH NEW SHADE STRUCTURE FOOTING.
 - REFER TO SHADE STRUCTURES MANUFACTURER'S DRAWINGS FOR CONC. FOOTINGS DESIGN REQUIREMENTS.
 - NEW SHADE STRUCTURES IS O.F.C.I., GENERAL CONTRACTOR IS RESPONSIBLE FOR THE FOUNDATION AND INSTALLATION/COORDINATION OF THE PRE-MANUFACTURED SHADE STRUCTURE.
 - CONTRACTOR TO BACKFILL TRENCHES AND PATCH (E) PAVING AS REQUIRED TO MATCH EXISTING PAVING.
 - PROVIDE TEMPORARY FENCING DURING CONSTRUCTION. SEE DETAIL 1/A0.4
 - TIE IN (N) SHADE STRUCTURE DOWNSPOUTS TO THE NEAREST CLEAN OUT.

- NEW SITE PLAN NOTES**
- (N) SHADE STRUCTURE PC # 04-117117, SEE MANUFACTURER'S DRAWINGS.
 - (E) AC PAVING, PATCH AND REPAIR AS NEEDED AFTER INSTALLATION OF SHADE STRUCTURE. PROVIDE MAX 2% SLOPE IN ALL DIRECTIONS.
 - ASSUMED DIRECTION OF (E) STORM DRAIN LINE, CONTRACTOR TO VERIFY PRIOR TO BEGINNING OF CONSTRUCTION.
 - APPROXIMATE LOCATION OF (E) STORM INLET, VERIFY IN FIELD. ELEVATE AS NEEDED TO BE FLUSH WITH THE SURFACE OF (N) AC PAVING.
 - (E) PERIMETER BOARD OF PLAY AREA TO REMAIN.
 - NEW AC PAVING TO CONFORM WITH EXISTING. SEE DETAIL 2/A0.4. PROVIDE MAX 2% SLOPE IN ALL DIRECTIONS.
 - (N) HEADERBOARD, TYP. SEE DET. 3/A.04

- GRAPHIC KEY**
- EXISTING PROPERTY LINE
 - - - ROOF OVERHANG
 - - - CHAINLINK FENCE
 - - - WOOD FENCE
 - - - DECORATIVE FENCE
 - NEW SHADE STRUCTURE
 - ▨ EXISTING BUILDING
 - ▩ EXISTING RESTROOMS
 - ◇ (E) DRY STAND PIPE
 - ⊕ DRINKING FOUNTAIN
 - ⊕ (E) FIRE HYDRANT
 - ⊕ (E) SIGN
 - M (E) MENS TOILET ROOM
 - W (E) WOMENS TOILET ROOM
 - G (E) GIRLS TOILET ROOM
 - B (E) BOYS TOILET ROOM
 - U (E) UNISEX TOILET ROOM
 - K (E) KINDERGARTEN TOILET ROOM

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 01-118968 INC:
REVIEWED FOR:
SS FLS ACS
DATE: 06/12/2020

SUGIMURA
FINNEY
ARCHITECTS
SFA
ARCHITECTURE INTERIORS PLANNING
2155 SOUTH BASCOM AVE.
SUITE 200
CAMPBELL, CA 95005
PHONE: 408.879.8099
FAX: 408.377.4966



NEW ENLARGED SITE PLAN
SHADE STRUCTURE
RUSKIN ELEMENTARY SCHOOL
1401 TURLOCK LN., SAN JOSE, CA 95132
BERRYESSA UNION SCHOOL DISTRICT


REVISIONS		
NO.	ITEM	DATE


DRAWN BY: MK
CHECKED BY: NJ
SFA JOB NO: 19066 DATE: 08/17/2019

A0.2

COPYRIGHT © 2019

1 NEW ENLARGED SITE PLAN




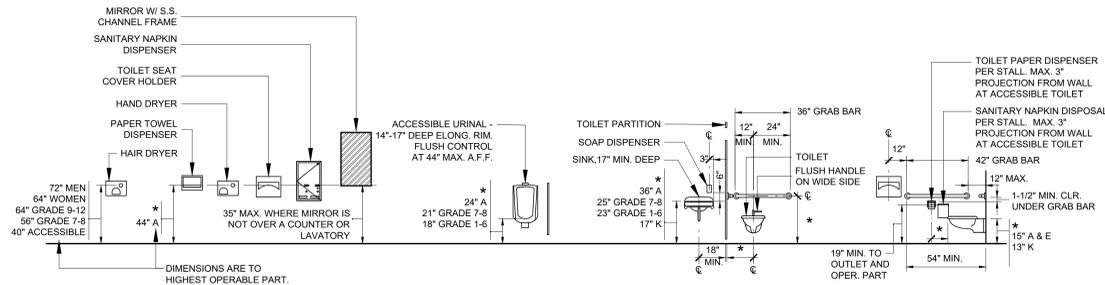


FIXTURE	ACCESSIBLE MOUNTING HEIGHTS		
	A (Inches)	E (Inches)	K (Inches)
Toilet conforming from wall	17-18	15-18	12-15
Toilet seat height	17-19	15-17	12-15
Grab bar height (side)	33-36	25-27	20-25
Toilet Paper in front of Toilet	7-9	6 max.	6 max.
Napkin disposal between toilet paper and rear wall behind toilet	12 max.	12 max.	N/A
Dispenser or mirror height	40 max.	36 max.	32 max.
Lavatory/sink top height	34 max.	29 max.	24 max.
Lavatory/sink knee clearance	27 min.	24 min.	19 min.
Urinal lip height	17 max.	15 max.	13 max.
Urinal flush handle height	44 max.	37 max.	32 max.
Drinking fountain bubbler height (standing persons)	38-43		
Drinking fountain bubbler height (accessible)	36 max.	32 max.	30 max.
Drinking fountain knee clearance	27 min.	24 min.	22 min.

NOTES:
* - SEE ACCESSIBLE MOUNTING HEIGHTS TABLE
* - SEE SPECIFIC MANUFACTURER'S DIMENSIONS
A - ADULT DIMENSIONS (AGE 12 AND OVER)
E - ELEMENTARY DIMENSIONS
K - KINDERGARTEN AND PRESCHOOL DIMENSIONS


8 TYPICAL FIXTURE MOUNTING HEIGHTS
SCALE: 1/4"=1'-0"

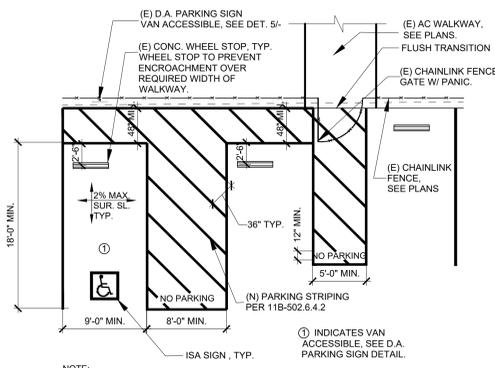


4 ACCESSIBLE PARKING STALL
SCALE: 1/8"=1'-0"

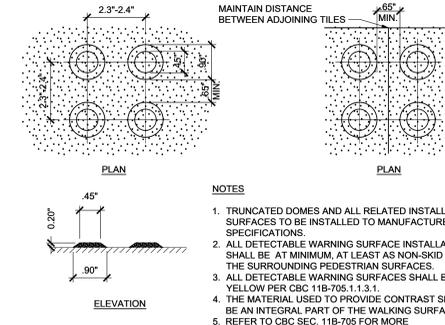


7 TRUNCATED DOMES
SCALE: 1/2"=1'-0"

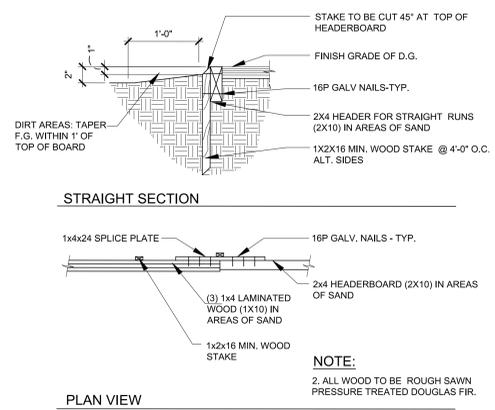


3 WOOD HEADERBOARD
SCALE: N.T.S.

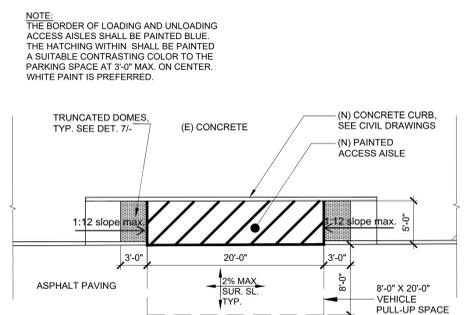


6 (N) PASSENGER DROP-OFF AND LOADING ZONE ACCESS AISLE
SCALE: 1/8"=1'-0"

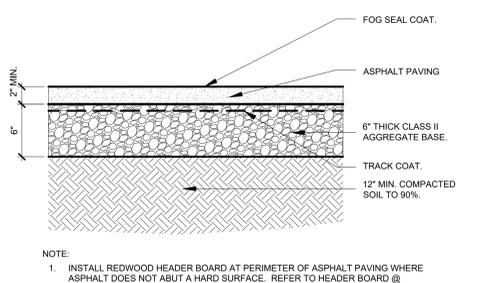

2 (N) ASPHALT PAVING
SCALE: 1-1/2"=1'-0"

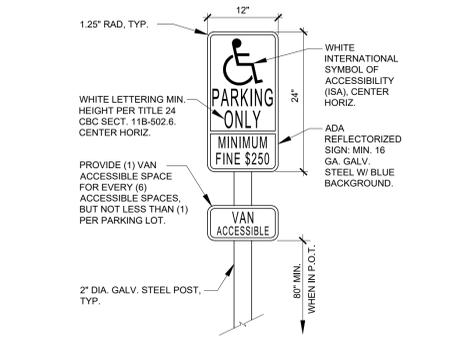


5 ACCESSIBLE PARKING SIGN ELEVATION
SCALE: 1"=1'-0"

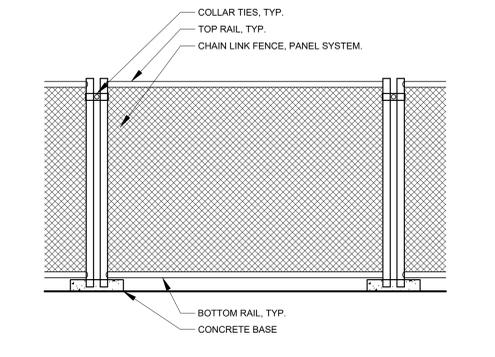

1 REQ'D TEMPORARY FENCING CONSTRUCTION FENCING
SCALE: 1/2"=1'-0"

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 01-118968 INC.
REVIEWED FOR
SS FLS ACS
DATE: 06/12/2020




SITE DETAILS
SHADE STRUCTURE
RUSKIN ELEMENTARY SCHOOL
1401 TURLOCK LN., SAN JOSE, CA 95132
BERRYESSA UNION SCHOOL DISTRICT

REVISIONS	NO.	ITEM	DATE

DRAWN BY: MK
CHECKED BY: NJ
SFA JOB NO: 19066
DATE: 08/17/2019







SHEET NOTE

1. ALL ITEMS ARE NEW UNLESS INDICATED AS EXISTING.
2. SEE (F10) (A581) FOR TYPICAL SIGNAGE MOUNTING LOCATIONS
3. SEE (A10) (A5) (A321) FOR CEILING AND FLOORING DIMENSIONS
4. SEE A011 FOR FINISHES AND FINISH ABBREVIATIONS
5. SEE SHEET A011 FOR WALL TYPES SCHEDULE.
6. SEE A321 FOR DIMENSIONS.



LEGEND

(E) 2HR RATED WALL ON THE INTERIOR SIDE OF ROOM E9. PROVIDE (2) LAYERS OF TYPE X GYPSUM BOARD FROM FLOOR TO ROOF DECK.

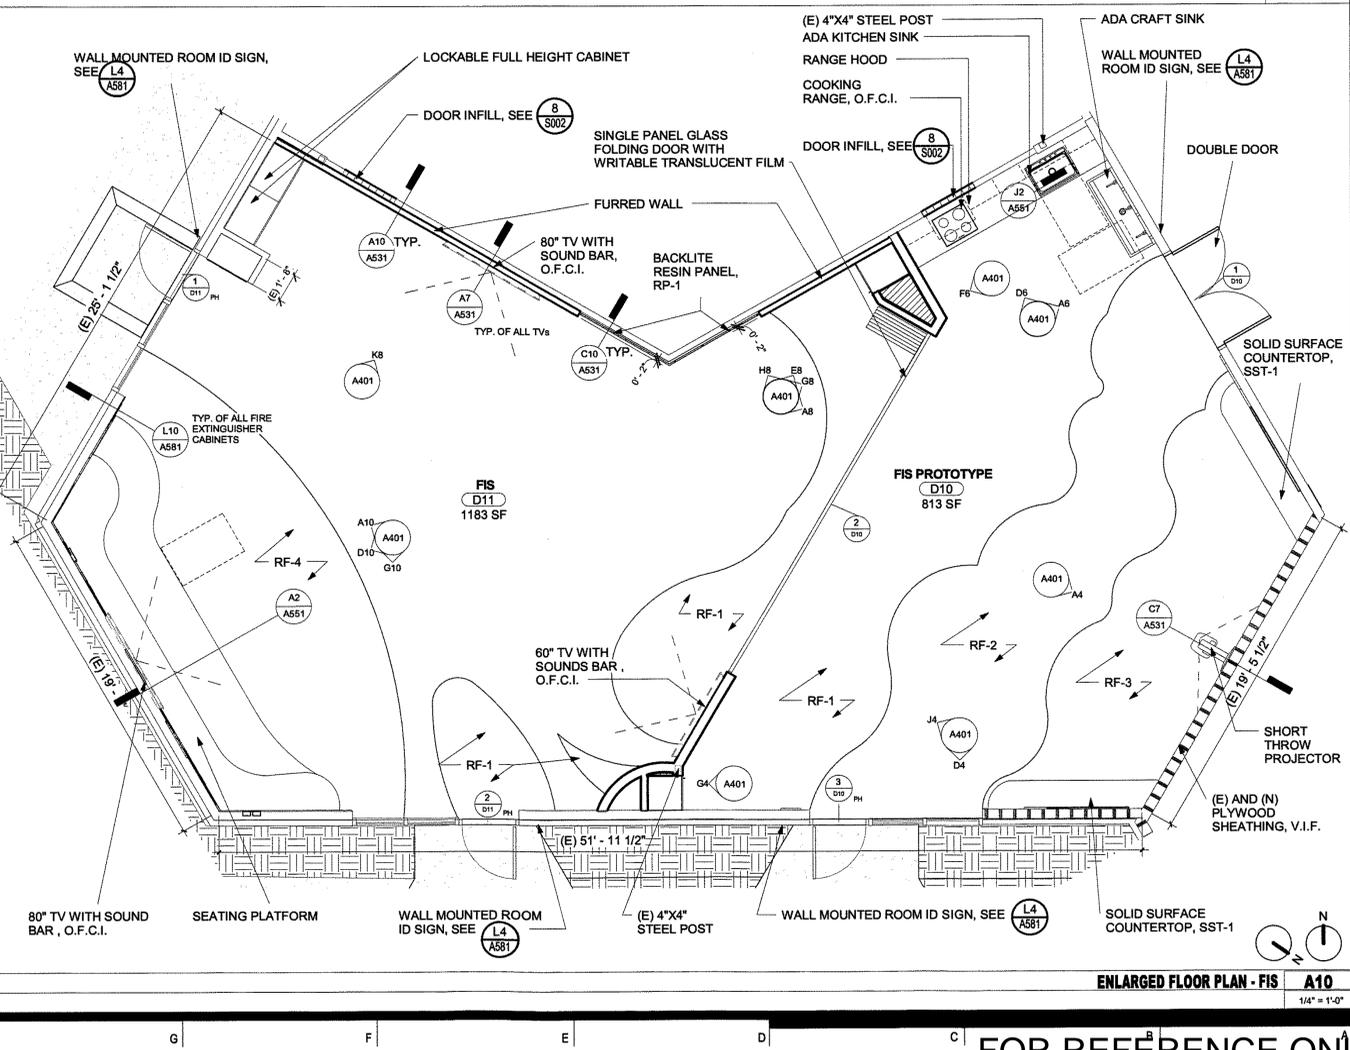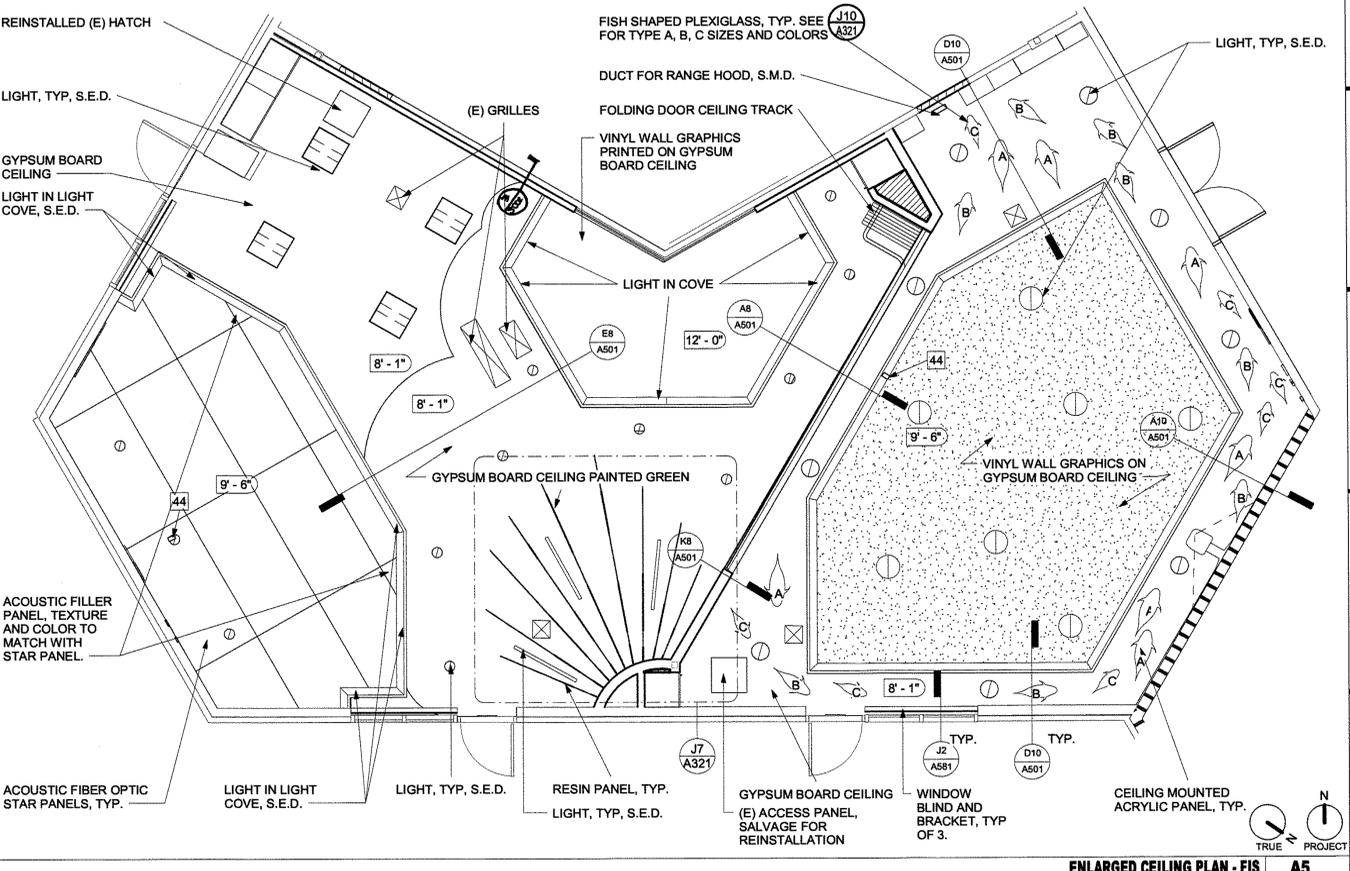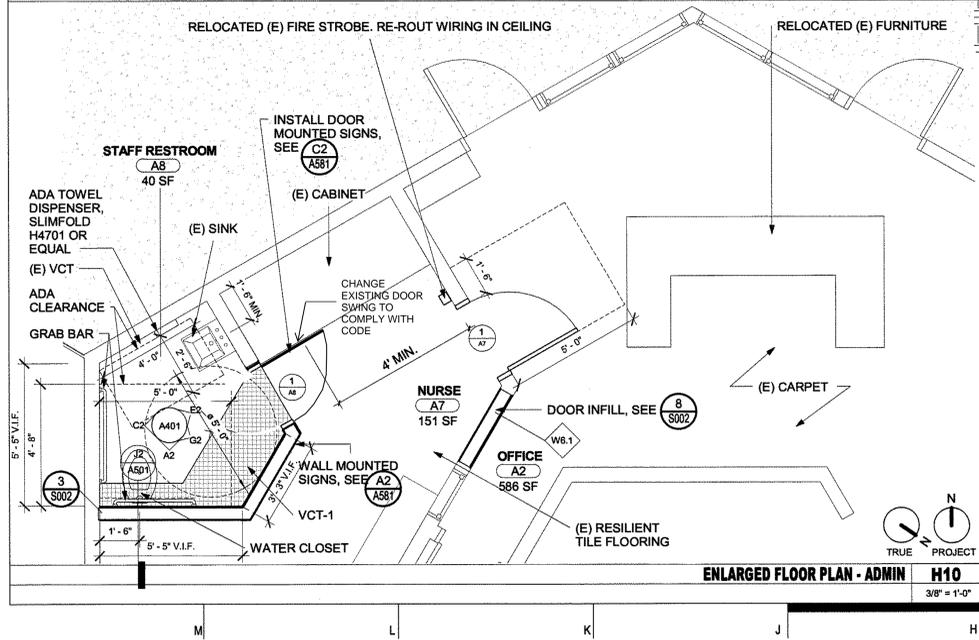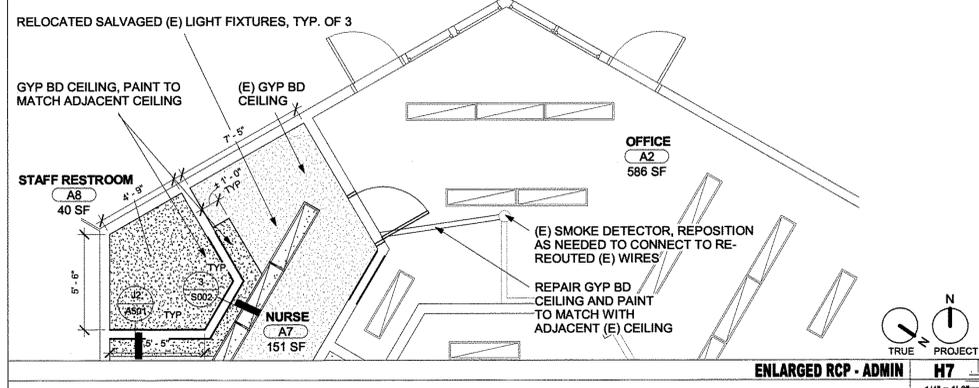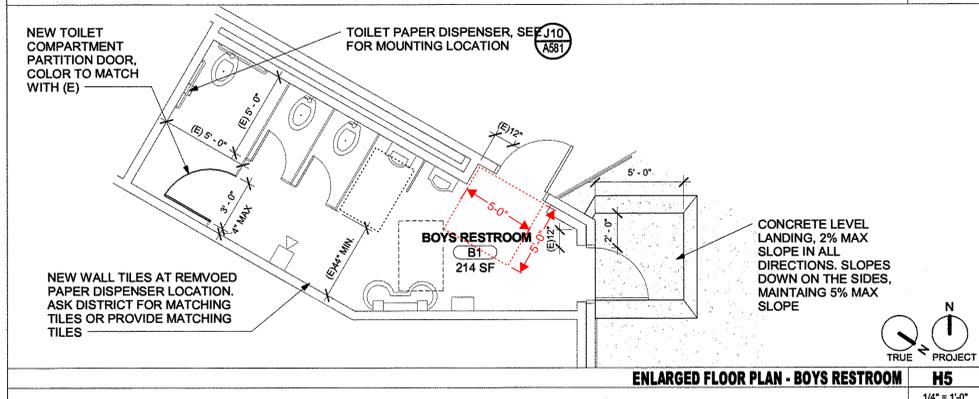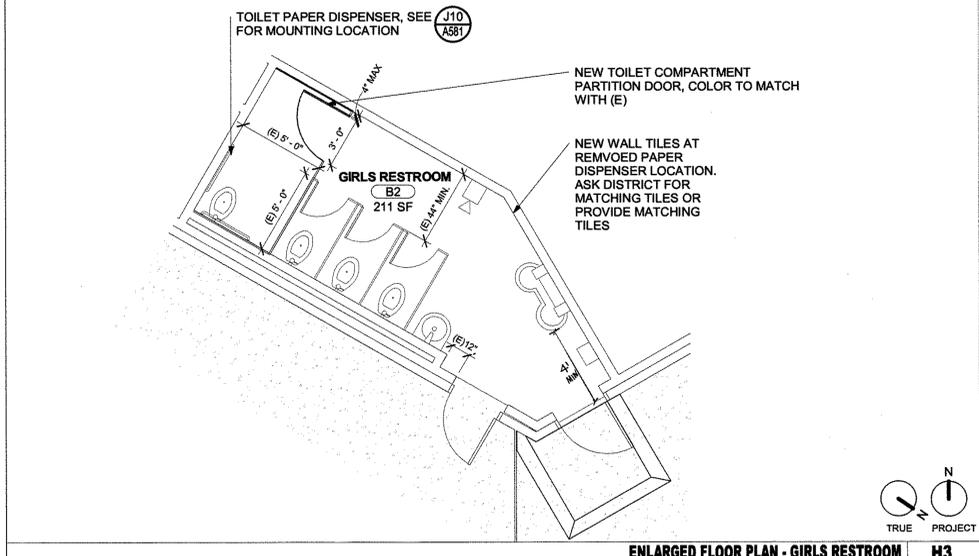

BERRYESSA UNION SCHOOL DISTRICT
1401 TURLOCK LN, SAN JOSE, CA 95132

JOB	21718
SCALE	AS NOTED
PM	SP
DATE	JAN 11, 2018

ENLARGED FLOOR PLAN - FIS & ADMIN & RESTROOM



COSTA MESA OAKLAND
www.dougherty.us

A301






FOR REFERENCE ONLY

BRAILLE:
 CONTRACTED CALIFORNIA GRADE 2 BRAILLE. BRAILLE SHALL BE IN A HORIZONTAL FORMAT WITH BRAILLE PLACED 3/8 INCH MINIMUM AND 1/2 INCH MAXIMUM DIRECTLY BELOW TACTILE CHARACTERS. FLUSH LEFT OR CENTERED.

BRAILLE DOTS WITHIN CELLS SHALL BE 1/10 INCH ON CENTER. CELLS MUST BE 2/10 INCH APART, MEASURED FROM THE SECOND COLUMN OF DOTS IN THE FIRST CELL TO THE FIRST COLUMN OF DOTS IN THE SECOND CELL. BRAILLE DOTS SHALL BE RAISED 1/40 INCH ABOVE THE BACKGROUND. BRAILLE DOTS SHALL BE DOMED OR ROUNDED.

INTER-CELL SPACING = .20"
 NO SQUARED DOT (NOT ACCESSIBLE)
 BRAILLE DOT

NOTE: SEE TABLE 11B-703.3.1 FOR REFERENCE

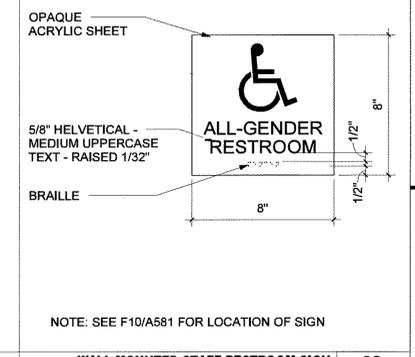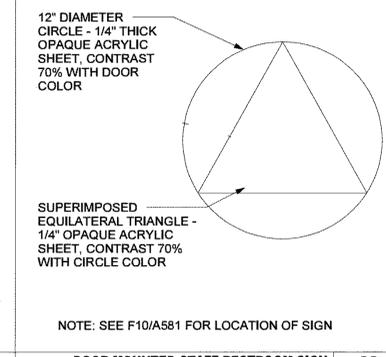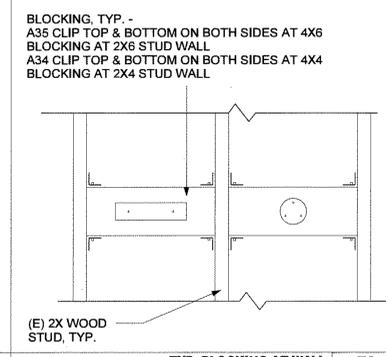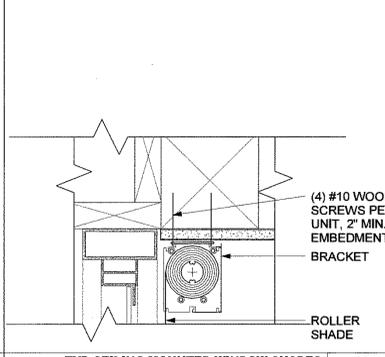

SHEET NOTE

1. ALL ITEMS ARE NEW UNLESS INDICATED AS EXISTING.
2. SEE DETAIL F10 FOR SIGNAGE MOUNTING LOCATIONS
3. SEE DETAIL L2 FOR BRAILLE DETAIL FOR ALL SIGNS

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP: 01-118968 INC.
 REVIEWED FOR:
 SS [] FLS [] ACS []
 DATE: 06/12/2020

BRAILLE SYMBOL L2
 12" x 1'-0"

DARK GRAY, SINGLE PLY MODIFIED ACRYLIC WITH NON-GLARE, MATTE FINISH

5/8" HELVETICA MEDIUM UPPERCASE WHITE TEXT OF CONTRASTING COLOR TO THE BACKGROUND - RAISED 1/32"

FLEXIBLE INSTRUCTIONAL SPACE

CONTRACTED GRADE II BRAILLE

NOTE: SEE F10/A581 FOR LOCATION OF SIGN

TYP CEILING MOUNTED WINDOW SHADES J2
 3" x 1'-0"

DARK GRAY, SINGLE PLY MODIFIED ACRYLIC WITH NON-GLARE, MATTE FINISH

5/8" HELVETICA MEDIUM UPPERCASE WHITE TEXT OF CONTRASTING COLOR TO THE BACKGROUND - RAISED 1/32"

EXIT

CONTRACTED GRADE II BRAILLE

NOTE: SEE F10/A581 FOR LOCATION OF SIGN

TYP. BLOCKING AT WALL E2
 1 1/2" x 1'-0"

OPAQUE ACRYLIC SHEET

PICTOGRAM & TEXT OF CONTRASTING COLOR

5/8" HELVETICAL - MEDIUM UPPERCASE TEXT - RAISED 1/32"

CONTRACTED GRADE II BRAILLE

BOYS

NOTE: SEE F10/A581 FOR LOCATION OF SIGN

DOOR MOUNTED STAFF RESTROOM SIGN C2
 3" x 1'-0"

OPAQUE ACRYLIC SHEET

PICTOGRAM & TEXT OF CONTRASTING COLOR

5/8" HELVETICAL - MEDIUM UPPERCASE TEXT - RAISED 1/32"

CONTRACTED GRADE II BRAILLE

GIRLS

NOTE: SEE F10/A581 FOR LOCATION OF SIGN

WALL MOUNTED STAFF RESTROOM SIGN A2
 3" x 1'-0"

EQUILATERAL TRIANGLE WITH 12" SIDES OPAQUE ACRYLIC SHEET, CONTRAST 70% WITH DOOR COLOR

NOTE: SEE F10/A581 FOR LOCATION OF SIGN

TYP. BLOCKING AT WALL E2
 1 1/2" x 1'-0"

OPAQUE ACRYLIC SHEET

PICTOGRAM & TEXT OF CONTRASTING COLOR

5/8" HELVETICAL - MEDIUM UPPERCASE TEXT - RAISED 1/32"

CONTRACTED GRADE II BRAILLE

GIRLS

NOTE: SEE F10/A581 FOR LOCATION OF SIGN

WALL MOUNTED STAFF RESTROOM SIGN A2
 3" x 1'-0"

12" DIAMETER CIRCLE ACRYLIC SHEET, CONTRAST 70% WITH DOOR COLOR

NOTE: SEE F10/A581 FOR LOCATION OF SIGN

ROOM ID SIGN - FIS L4
 3" x 1'-0"







EXIT SIGN J4
 3" x 1'-0"

TYP WALL MOUNTED RESTROOM SIGN - BOYS G4
 3" x 1'-0"

TYP WALL MOUNTED RESTROOM SIGN - GIRLS E4
 3" x 1'-0"

TYP DOOR MOUNTED RESTROOM SIGN - BOYS C4
 3" x 1'-0"







TYP DOOR MOUNTED RESTROOM SIGN - GIRLS A4
 3" x 1'-0"

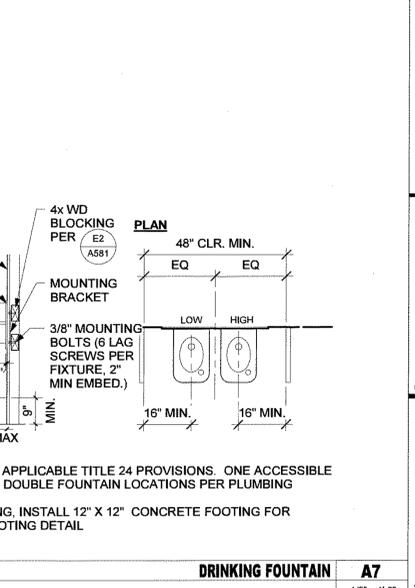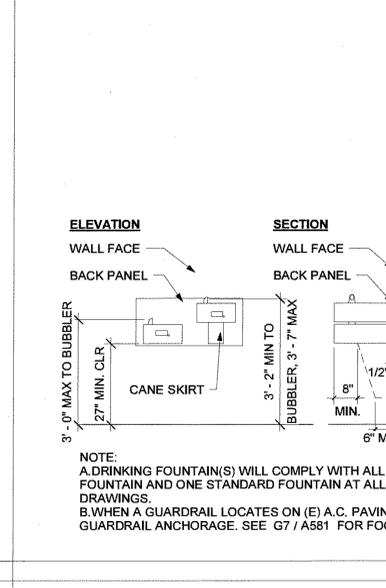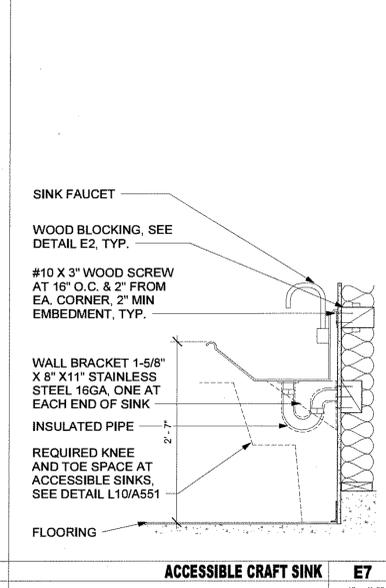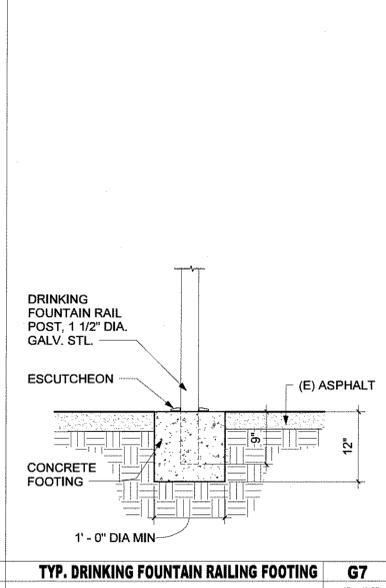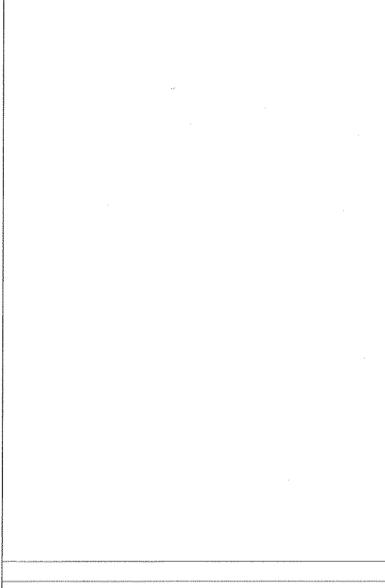

TYP. DRINKING FOUNTAIN RAILING FOOTING G7
 1" x 1'-0"

ACCESSIBLE CRAFT SINK E7
 1" x 1'-0"

DRINKING FOUNTAIN A7
 1/2" x 1'-0"

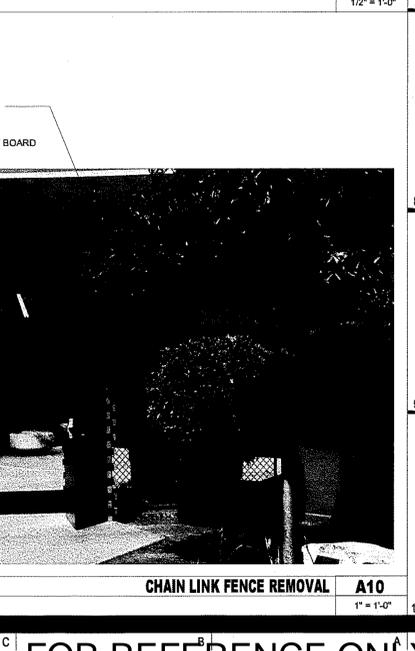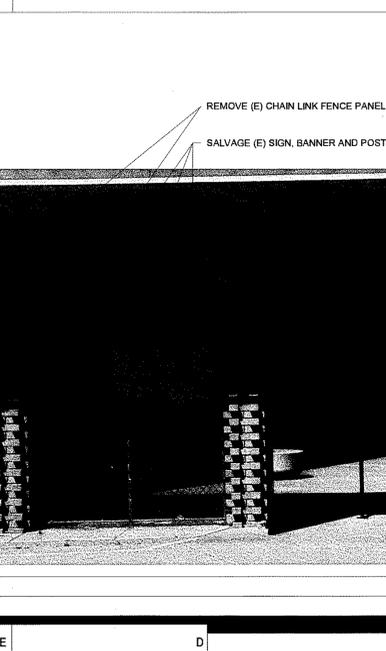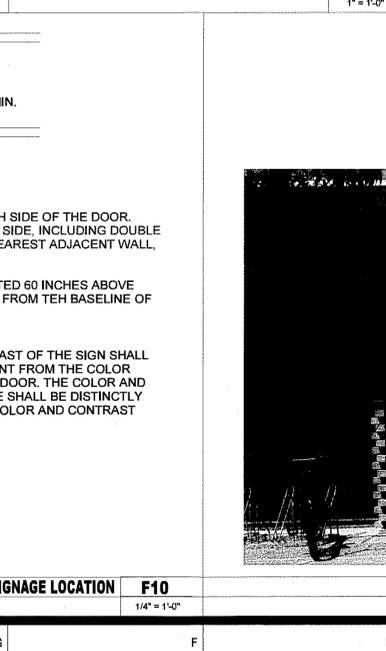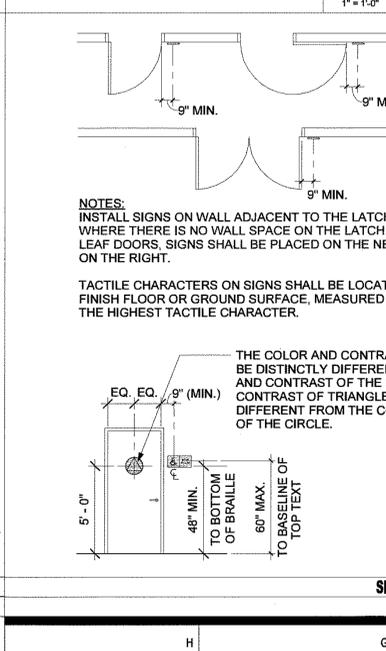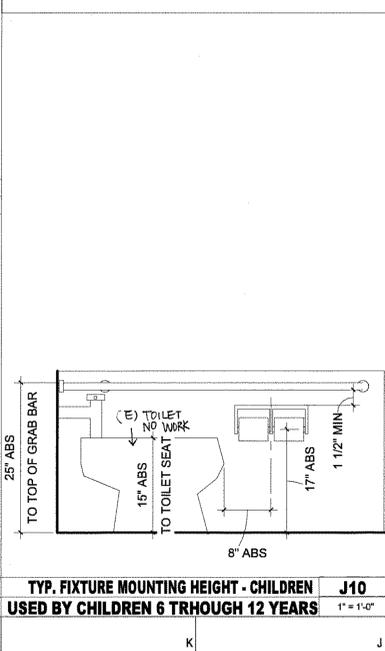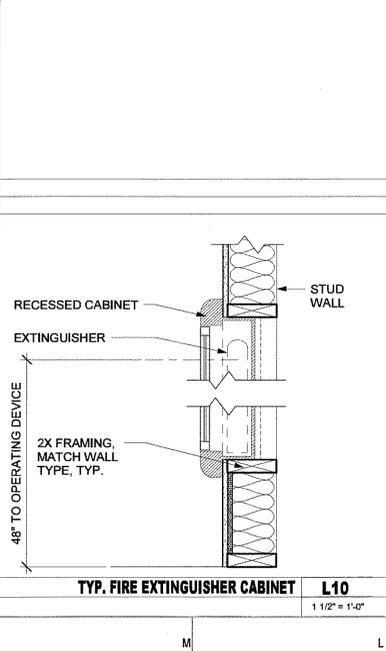

TYP. FIRE EXTINGUISHER CABINET L10
 1 1/2" x 1'-0"

TYP. FIXTURE MOUNTING HEIGHT - CHILDREN USED BY CHILDREN 6 THROUGH 12 YEARS J10
 1" x 1'-0"

SIGNAGE LOCATION F10
 1/4" x 1'-0"

CHAIN LINK FENCE REMOVAL A10
 1" x 1'-0"

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 FILE NO: 43-7
 AP: 01-117026
 AC [] FLS [] SS [] MTF []
 DATE: 1-11-18

FOR REFERENCE ONLY

BERRYESSA UNION SCHOOL DISTRICT
 1401 TURLOCK LN, SAN JOSE, CA 95132

JOB: 21718
 SCALE: AS NOTED
 PM: SP
 DATE: JAN 11, 2018

SIGNAGE & MISCELLANEOUS DETAILS

COSTA MESA OAKLAND
 www.dougherty.us

A581

Dougherty

M BAR C VERSA-CANOPY

PC OWNERSHIP - STRUCTURAL STEEL CONTRACTOR



**M BAR C
CONSTRUCTION
INC.**

674 RANCHEROS DR
SAN MARCOS, CA. 92069

PHONE: (760) 744-4131
FAX: (760) 744-4449

LIC # 869960
B AND C51

POINT OF CONTACT: GREG JONES
GREGJ@MBARCONLINE.COM
(775) 787-8845

LEGAL INFORMATION

- USE OF THE PC WITHOUT WRITTEN CONSENT FROM M BAR C CONSTRUCTION, INC. IS STRICTLY PROHIBITED.
- ALL INFORMATION HEREIN IS PROPRIETARY INFORMATION AND UNDER THE OWNERSHIP OF M BAR C CONSTRUCTION, INC.

STANDARD NOTES FOR PC USE

- 4 S.T.E.L. ENGINEERING, INC. IS AVAILABLE TO BID THE GENERATION OF THE FULL DSA SUBMITTAL PACKAGE ACTING AS THE DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE (DPGRC) OR TO SUPPORT THE DPGRC AS THE SITE SPECIFIC STRUCTURAL ENGINEER OF RECORD (SEOR). CONTACT DUSTIN ROSEPIK AT 4 S.T.E.L. ENGINEERING, INC FOR A PROPOSAL FOR SERVICES AT (949) 305-1150, DKRPINK@4STELENG.COM
- FOR CONSTRUCTION COST INFORMATION, CONTACT M BAR C CONSTRUCTION, INC.
- CUSTOM SIZES AND LOADINGS REQUIRE SUPPLEMENTARY SHOP DRAWINGS AND CALCULATIONS.

DSA OTC PLAN REVIEWER AND DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE NOTES

1. THE PC STRUCTURAL MEMBERS ARE DESIGNED TO THE FOLLOWING ASCE 7-10 SEISMIC CRITERIA: $S_s = 3.2$, $S_1 = 1.39$, $R = 1.25$.
2. THE DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE TO VERIFY SITE SPECIFIC DESIGN PARAMETERS COMPLY WITH DESIGN PARAMETERS FOR THE PC SHOWN ON SHEET S-2.
3. THE DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE IS RESPONSIBLE FOR VERIFYING SITE-SPECIFIC WIND PARAMETERS AT ANY AND ALL SITES WHERE THIS PC IS USED. THIS PC DESIGN IS BASED ON WIND SPEED 110 MPH FOR RISK CATEGORY II TYPE STRUCTURES UTILIZING EXPOSURE TYPE C PER ASCE 7-10. SEE DESIGN PARAMETER NOTE 1 ON SHEET S-2.
4. A SITE SPECIFIC GEOTECHNICAL REPORT SHALL BE SUBMITTED JUSTIFYING SOILS VALUES SELECTED IF GREATER THAN 100 PCF FOR LATERAL BEARING AND/OR 1,500 PSF FOR VERTICAL BEARING. SEE FOUNDATION NOTES ON SHEET S-3.
5. SITE SPECIFIC DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE TO SELECT SOILS CLASS FOR SITE SPECIFIC USE.
6. WET STAMPED & SIGNED COPIES OF PC PLANS ARE NOT REQUIRED FOR SITE SPECIFIC PC USE.
7. DUSTIN ROSEPIK IS NOT ACTING AS SITE SPECIFIC SEOR UNLESS HE IS THE DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE OR A SIGNED LETTER HAS BEEN SUBMITTED WITH DSA-1 FORM STATING HE ACCEPTS THE RESPONSIBILITY AS THE SEOR FOR THE SITE. REFER TO DSA IR A-18.
8. DUSTIN ROSEPIK WILL NOT SIGN ANY DSA FORMS (e.g. DSA-5, DSA-6, etc.), REVIEW OR APPROVE ANY SUBMITTALS (e.g. CONCRETE MIX DESIGNS, SHOP DRAWINGS, etc.) FOR THE SITE SPECIFIC PROJECT UNLESS HE IS ACTING AS THE DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE OR THE SITE SPECIFIC STRUCTURAL ENGINEER OF RECORD. REFER TO DSA IR A-18.
9. CUSTOM SIZES & LOADINGS REQUIRE SUPPLEMENTARY SHOP DRAWINGS & CALCULATIONS.

DESIGN PARAMETER CHECK LIST

1. VERIFY THE MAXIMUM WIND SPEED AT THE SITE DOES NOT EXCEED 110 MPH EXPOSURE C.
2. VERIFY THE MAXIMUM SEISMIC S_s AT THE SITE DOES NOT EXCEED $S_s = 3.2$.
3. VERIFY THE SITE SPECIFIC SNOW LOAD AND ENSURE ALL SITE SPECIFIC PC SELECTIONS MEET OR EXCEED THE SITE SPECIFIC SNOW LOAD. THIS PC HAS OPTIONS FOR NO SNOW AND 20 PSF SNOW LOAD. VERIFY THE SITE SPECIFIC DESIGN PROFESSIONAL HAS PROVIDED THE PROPER SITE SPECIFIC VALUES FOR P_g , P_f , P_s , C_e , I_c .
4. REVIEW THE SITE SPECIFIC GEOTECHNICAL REPORT AND ENSURE ALL SITE SPECIFIC PC SELECTIONS MEET WITH THE GEOTECHNICAL REPORT REQUIREMENTS. IF NO GEOTECHNICAL REPORT IS SUPPLIED VERIFY SOILS CLASS V IS SELECTED.
 - SITES NOT LOCATED IN STATE OR LOCAL GEOHAZARD ZONES UTILIZING THIS PC WITH STRUCTURES NOT EXCEEDING 4,000 SQ FT DO NOT REQUIRE CGS APPROVAL OF THE GEOTECHNICAL REPORT. STRUCTURES MAY BE BROKEN UP INTO MULTIPLE 4,000 SQ FT STRUCTURES WITH SEISMIC BREAKS PER SEISMIC GAPS ON S-2.
5. VERIFY THE SITE SPECIFIC FOUNDATION LOCATIONS MEET WITH SOILS NOTE 8 ON S-3 FOR SET BACK FROM TOP OF SLOPES OR THAT THE GEOTECHNICAL REPORT HAS ALLOWED A SMALLER DISTANCE.
6. VERIFY THE SITE SPECIFIC PLANS PROVIDE THE APPROPRIATE OCCUPANCY AND OCCUPANCY LOAD FACTOR FOR THE SITE. SEE BUILDING DATA ON S-2 FOR SAMPLE ACCEPTABLE OCCUPANCIES AND OCCUPANCY LOAD FACTORS.
7. VERIFY THE SITE SPECIFIC PLANS UTILIZE A RISK CATEGORY II STRUCTURE. RISK CATEGORY II STRUCTURES SHALL NOT PROVIDE SHELTER FOR EMERGENCY VEHICLES OR EQUIPMENT, OR PROVIDE REQUIRED ACCESS TO, REQUIRED EGRESS FROM, OR SHARE A LIFE SAFETY COMPONENT WITH A RISK CATEGORY III OR IV STRUCTURE.
8. VERIFY SELECTION OF USE AND OCCUPANCY CLASSIFICATION PER CBC CHAPTER 3; OCCUPANT LOAD FACTOR PER CBC TABLE 1004.1.2; RISK CATEGORY PER CBC TABLE 1604A.5; TO BE COMPLETED BY DESIGN PROFESSIONAL AT TIME OF DSA OTC OR PROJECT DSA SUBMITTAL.
9. VERIFY APPROPRIATE SEISMIC SEPARATION PER SEISMIC GAPS ON S-2.
10. VERIFY THE SITE SPECIFIC DESIGN PROFESSIONAL HAS APPROPRIATELY ADDRESSED FIRE SEPARATION AND PROPERTY LINE SETBACKS.
11. VERIFY THE SITE SPECIFIC SOLAR PANEL LAYOUT IS PROVIDED WITH DIMENSIONS THAT DO NOT EXCEED THE PC MAXIMUMS. THE MAXIMUM DIMENSIONS SHALL BE TO THE OUTSIDE EDGES OF THE SOLAR PANEL OR THE STRUCTURAL STEEL, WHICH EVER IS GREATER.
12. VERIFY STEEL SELECTIONS HAVE BEEN PROPERLY COORDINATED WITH BEAM/COLUMN SCHEDULES. REFER TO 2/S-8 & 2/S-9.
13. VERIFY SITE SPECIFIC PURLIN CANTILEVERS HAVE BEEN PROPERLY COORDINATED WITH PURLIN SCHEDULES. REFER TO 1/S-8 & 1/S-9.
14. WET STAMPED & SIGNED COPIES OF PC PLANS ARE NOT REQUIRED FOR SITE SPECIFIC PC USE.

SHEET INDEX

S-1.....	COVER SHEET
S-2.....	GENERAL DATA
S-3.....	GENERAL NOTES
S-4.....	SAMPLE DSA-103 FORMS
S-5.....	SECTION PROPERTIES & REBAR DETAILS
S-6.....	VC14, VC18 & VC20 FRAMING PLAN & ELEVATIONS
S-7.....	VC14, VC18 & VC20 FRAMING SCHEDULES
S-8.....	VC140, VC180 & VC200 FRAMING PLAN & ELEVATIONS
S-9.....	VC140, VC180 & VC200 FRAMING SCHEDULES
S-10.....	PIER FOUNDATION & SPREAD FOOTING SCHEDULES
S-11.....	STANDARD DETAILS 1
S-12.....	STANDARD DETAILS 2
S-13.....	SAMPLE ARCHITECTURAL ELEVATIONS

13 SHEETS

BID INFORMATION

THE STEEL STRUCTURES IN THIS PC ARE PROPRIETARY TO M BAR C CONSTRUCTION, INC. THE STEEL WORK SHALL NOT GO OUT TO BID.

PRE-CHECK (PC) DOCUMENT

CODE: 2016 CBC
A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED



ENGINEER'S APPROVAL



DATE SIGNED
11/28/2018

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 01-118968 INC:
REVIEWED FOR
SS FLS ACS
DATE: 05/12/2020

SITE SPECIFIC
DSA APPROVAL

FILE NUMBER: PC-119
IDENTIFICATION STAMP
DIVISION OF THE STATE ARCHITECT
APP. NO: 04 - 117117 INCR
AC DF FLS DS SS DP
DATE: 12/05/2018

PRE-CHECK (PC) DOCUMENT
CODE: 2016 CBC
A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED

**M BAR C
CONSTRUCTION
INC.**
674 RANCHEROS DR
SAN MARCOS, CA
92069
PHONE: (760) 744-4131
FAX: (760) 744-4449
GREGJ@MBARCONLINE.COM
(775) 787-8845

**4STEL ENGINEERING
STRUCTURAL ENGINEERING**
26030 A CHERO, SUITE 200
MISSION VIEJO, CA 92691
PHONE: (949) 305-1150
FAX: (949) 305-1420

VERSA
CANOPY
COVER SHEET

DRAWN
GM
CHECKED
KS
DATE
11/28/2018
4STEL JOB NO.
MC03-01
SHEET

S-1

1 OF 13 SHEETS

ABBREVIATIONS

&	AND
@	AT
⊕	CENTER LINE
A.B.	ANCHOR BOLT
ACI	AMERICAN CONCRETE INSTITUTE
AISC	AMERICAN INSTITUTE OF STEEL CONSTRUCTION
AISI	AMERICAN IRON AND STEEL INSTITUTE
ANSI	AMERICAN NATIONAL STANDARDS INSTITUTE
ASTM	AMERICAN SOCIETY FOR TESTING MATERIALS
AWS	AMERICAN WELDING SOCIETY
BLDG	BUILDING
BLK'G	BLOCKING
BM	BEAM
BOTT. OR (B)	BOTTOM
CBC	CALIFORNIA BUILDING CODE
CCD	CONSTRUCTION CHANGE DOCUMENT (DSA)
CCR	CALIFORNIA CODE OF REGULATIONS
CFS	COLD FORMED STEEL
C.J.	CONTROL JOINT
CJP	COMPLETE JOINT PENETRATION
CLR	CLEAR
CMU	CONCRETE MASONRY UNIT
COL.	COLUMN
CONC.	CONCRETE
CONT.	CONTINUOUS
CS	CFS C SECTION WITH FLANGE STIFFENING LIPS
DIA., Ø	DIAMETER
DPRGC	DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE
DSA	DIVISION OF THE STATE ARCHITECT
DWG	DRAWING
(E)	EXISTING
EA.	EACH
E.F.	EACH FACE
E.W.	EACH WAY
EXT.	EXTERIOR
FDN	FOUNDATION
FIN.	FINISH
FLR	FLOOR
FLS	FIRE LIFE SAFETY (DSA)
F.O.C.	FACE OF CONCRETE
F.S.	FAR SIDE
FTG.	FOOTING
GA.	GAUGE
GALV.	GALVANIZED
H.S.B.	HIGH STRENGTH BOLT (ASTM A325 U.N.O.)
HORIZ.	HORIZONTAL
HT.	HEIGHT
IAMPO	INTERNATIONAL ASSOCIATION OF MECHANICAL AND PLUMBING OFFICIALS
ICC	INTERNATIONAL CODE COUNCIL
INT.	INTERIOR
IOR	INSPECTOR OF RECORD
IR	INTERPRETATION OF REGULATIONS (DSA)
JT	JOINT
LG.	LONG
LLH	LONG LEG HORIZONTAL
LLV	LONG LEG VERTICAL
M.B.	MACHINE BOLT (ASTM A307 U.N.O.)
MAX.	MAXIMUM
MFR.	MANUFACTURER
MIN.	MINIMUM
MISC.	MISCELLANEOUS
(N)	NEW
NFPA	NATIONAL FIRE PROTECTION ASSOCIATION
NOM.	NOMINAL
N.S.	NEAR SIDE
NTS	NOT TO SCALE
O.C.	ON CENTER
OTC	OVER THE COUNTER (DSA)
O.H.	OPPOSITE HAND
⊕ OR PL	PLATE
PJP	PARTIAL JOINT PENETRATION
PC	PRE-CHECK (DSA)
PT	PRESSURE TREATED
PV	PHOTOVOLTAIC
REINF.	REINFORCEMENT
REQ'D	REQUIRED
SC	SLIP-CRITICAL JOINT PER ASTM SPECS
SCHED.	SCHEDULE
SEOR	STRUCTURAL ENGINEER OF RECORD
SHT'G	SHEATHING
SIM.	SIMILAR
S.M.S.	SHEET METAL SCREW
SQ.	SQUARE
SS	STAINLESS STEEL
ST	SNUG-TIGHTENED JOINT PER ASTM SPECS
STD	STANDARD
(T)	TOP
T&B	TOP AND BOTTOM
T.O.C.	TOP OF CONCRETE
T.O.S.	TOP OF STEEL
TYP.	TYPICAL
U.N.O.	UNLESS NOTED OTHERWISE
VERT.	VERTICAL
W/-	WITH
W/O	WITHOUT
WHS	WELDED HEADED STUD (ASTM A108 U.N.O.)
W.P.	WORK POINT
WT.	WEIGHT
WTS	WELDED THREADED STUD (ASTM A108 U.N.O.)

GENERAL NOTES

- ALL WORK SHALL CONFORM TO TITLE 24, CALIFORNIA CODE OF REGULATIONS (CCR)
- CHANGES TO THE APPROVED DRAWINGS AND SPECIFICATIONS SHALL BE MADE BY ADDENDA OR CONSTRUCTION CHANGE DOCUMENTS APPROVED BY THE DIVISION OF THE STATE ARCHITECT, AS REQUIRED BY SECTION 4-338, PART 1, TITLE 24, CCR.
- A 'DSA CERTIFIED' PROJECT INSPECTOR EMPLOYED BY THE DISTRICT (OWNER) AND APPROVED BY THE DIVISION OF THE STATE ARCHITECT SHALL PROVIDE CONTINUOUS INSPECTION OF THE WORK. THE DUTIES OF THE INSPECTOR ARE DEFINED IN SECTION 4-342, CALIFORNIA BUILDING STANDARDS ADMINISTRATIVE CODE (PART 1, TITLE 24, CCR).
- A 'DSA CERTIFIED' INSPECTOR WITH CLASS 2 CERTIFICATION IS REQUIRED FOR THIS PROJECT.
- A DSA ACCEPTED TESTING LABORATORY DIRECTLY EMPLOYED BY THE SCHOOL BOARD SHALL CONDUCT ALL THE REQUIRED TESTS AND INSPECTIONS FOR THE PROJECT.
- GRADING PLANS, DRAINAGE IMPROVEMENTS, ROAD AND ACCESS REQUIREMENTS AND ENVIRONMENTAL HEALTH CONSIDERATIONS SHALL COMPLY WITH ALL LOCAL ORDINANCES.
- IF THE PROJECT IS DIVIDED INTO INCREMENTS: THE SCOPE OF WORK FOR EACH INCREMENT MUST BE CLEARLY SPECIFIED ON THE TITLE SHEET OF ALL INCREMENTS SUBMITTED.


CONSTRUCTION OPTIONS

* ALL CONSTRUCTION OPTIONS INCLUDE OPTIONS FOR CONCRETE DRILLED PIERS AND/OR SPREAD FOOTINGS.

- 14'-0" MAX WIDTH, 3:12 MAX ROOF SLOPE, 17'-0" MAX COLUMN HEIGHT, 0 psf GROUND SNOW
- 18'-0" MAX WIDTH, 3:12 MAX ROOF SLOPE, 17'-9" MAX COLUMN HEIGHT, 0 psf GROUND SNOW
- 20'-0" MAX WIDTH, 3:12 MAX ROOF SLOPE, 17'-0" MAX COLUMN HEIGHT, 0 psf GROUND SNOW
- 14'-0" MAX WIDTH, 3:12 MAX ROOF SLOPE, 17'-5" MAX COLUMN HEIGHT, 20 psf GROUND SNOW
- 18'-0" MAX WIDTH, 3:12 MAX ROOF SLOPE, 16'-6" MAX COLUMN HEIGHT, 20 psf GROUND SNOW
- 20'-0" MAX WIDTH, 3:12 MAX ROOF SLOPE, 16'-9" MAX COLUMN HEIGHT, 20 psf GROUND SNOW

SEISMIC GAPS

OPTION	MAX COLUMN HEIGHT	GAP X	GAP Y
VC14	17'-0"	2 1/2"	7"
VC18	17'-9"	3 1/2"	9 1/2"
VC20	17'-0"	2 1/2"	7"
VC140	17'-5"	3 1/2"	9"
VC180	16'-6"	3"	8 1/2"
VC200	16'-9"	3"	8"

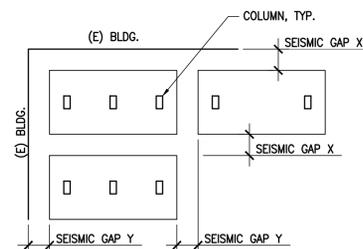

- NOTE
- SEISMIC GAPS LISTED ARE THE MINIMUM GAPS BETWEEN ANY TWO STRUCTURES (I.E. CANOPIES, BUILDINGS) AND DO NOT NEED TO BE COMBINED OR DOUBLED.
 - DIMENSIONS, QUANTITIES, AND LOCATIONS OF STRUCTURES AND COLUMNS SHOWN ABOVE ARE FOR ILLUSTRATIVE PURPOSES ONLY. SEE SITE-SPECIFIC SHEETS FOR LAYOUTS AND QUANTITIES.

STRUCTURAL DATA

LATERAL RESISTING SYSTEM..... STEEL ORDINARY CANTILEVER COLUMN
 FOUNDATION CONCRETE DRILLED PIERS AND SPREAD FOOTINGS
 TESTING AND INSPECTION LIST..... SEE SHEETS S-3 & S-4

DESIGN PARAMETERS

RISK CATEGORY II
 ROOF LIVE LOAD (L_p):
 DECK ONLY 20 psf
 POINT LOAD 300 lb

SNOW LOAD :
 MAX. DRIFT SNOW LOAD..... 0 psf, 20 psf (SEE CONSTRUCTION OPTIONS)

MAXIMUM DEAD LOAD:
 ROOF DECK..... 0.89 psf

WIND: ASCE 7-10 METHOD 2 - ANALYTICAL PROCEDURE
 BASIC WIND SPEED..... 110 mph⁽¹⁾
 WIND EXPOSURE C⁽¹⁾
 INTERNAL PRESSURE N/A (OPEN STRUCTURE)
 WIND DIRECTIONALITY FACTOR K_d = 0.85
 VELOCITY PRESSURE COEFFICIENT..... K_e = 0.90
 TOPOGRAPHIC FACTOR K_{zt} = 1.00

SEISMIC: ASCE 7-10
 SEISMIC IMPORTANCE FACTOR I = 1.0
 RESPONSE MODIFICATION FACTOR..... R = 1.25
 MAPPED SPECTRAL RESPONSE S_s = 3.22⁽²⁾
 ACCELERATION S₁ = 1.39
 SITE CLASS D
 DESIGN SPECTRAL RESPONSE S_{DS} = 2.133
 S₁₁ = 1.390
 SEISMIC DESIGN CATEGORY D (E WITH GROUND MOTION ANALYSIS)
 SEISMIC FORCE RESISTING SYSTEM STEEL ORDINARY CANTILEVER COLUMN
 SEISMIC RESPONSE COEFFICIENT C_s = 1.707
 ANALYSIS PROCEDURE EQUIVALENT LATERAL FORCE

NOTES:

- THE PC COMPONENTS & CLADDING AND MAIN WIND FORCE RESISTING SYSTEM DESIGN WIND PRESSURE q_s = 23.7 psf DETERMINED FROM THE CRITERIA LISTED ABOVE. (EXPOSURE C, K_e=0.960, K_{zt}=1.0, K_d = 0.85).

THE PC MAY BE USED FOR RISK CATEGORY II TYPE STRUCTURES IN ANY WIND ZONE WHERE q_s ≤ 23.7 psf.

EXAMPLE:
 SITE BASIC WIND SPEED, V = 120 mph
 RISK CATEGORY II
 WIND: EXPOSURE B
 K_d = 0.85
 K_e = 0.701
 K_{zt} = 1.00
 q_s = 22.0 psf < 23.7 psf

THE PC MAY BE USED AT THIS SITE, PENDING DSA SITE SPECIFIC APPROVAL.

- THE PC SEISMIC FORCE RESISTING SYSTEM IS GOVERNED BY C_s = 1.707 FROM THE CRITERIA LISTED ABOVE. (R = 1.25, S_s = 3.2, I = 1.00).

THE PC MAY BE USED FOR RISK CATEGORY II STRUCTURES AT ANY SITE WHERE THE SITE SPECIFIC SEISMIC PARAMETER S_s AND R = 1.25 RESULT IN A VALUE C_s ≤ 1.707.

EXAMPLE:
 RISK CATEGORY II
 SOIL: SITE CLASS A
 S_s = 3.4
 S₁ = 1.8
 R = 1.25
 I = 1.00
 S_{DS} = 1.813
 C_s = 1.451 < 1.707

THE PC MAY BE USED AT THIS SITE, PENDING DSA SITE SPECIFIC APPROVAL.

BUILDING DATA

TYPE OF CONSTRUCTION..... IIB
 OCCUPANCY..... VARIES - SEE EXAMPLES
 NUMBER OF STORIES..... 1
 BUILDING AREAS..... VARY DUE TO OCCUPANCY - SEE EXAMPLES
 MODULE SIZES..... VARY WITH OPTIONS

BUILDING LENGTH:
 ALL WIDTHS..... MAX. 500'-0" LENGTH

NOTE: NO SEISMIC AND/OR THERMAL EXPANSION JOINTS REQUIRED ALONG THE LENGTH OF THE STRUCTURES. (ALL JOINTS ARE INTERNAL)

OCCUPANCY AND BUILDING AREA EXAMPLES:
 ALL STRUCTURES SHALL BE BASED ON RISK CATEGORY II STRUCTURE.

A OCCUPANCY:

EXAMPLE 1:
 STRUCTURES LOCATED OVER LUNCH AREA WITHOUT FIXED SEATING
 OCCUPANCY: A-2
 OCCUPANCY LOAD: 15 sf/person - MAX 300 FOR RISK II
 MAX SQ FT: 4,500 sq ft

EXAMPLE 2:
 STRUCTURES LOCATED OVER LUNCH AREA WITH FIXED SEATING
 OCCUPANCY: A-2
 OCCUPANCY LOAD: 18"/person ALONG LINEAR BENCH - MAX 300 FOR RISK II
 MAX SQ FT: 5,400 LINEAR INCHES OF FIXED SEATING UNDER THE STRUCTURE

EXAMPLE 3:
 STRUCTURES LOCATED OVER AN AREA DESIGNATED FOR ASSEMBLY (TYPICALLY AMPHITHEATER, OR OTHER SPACE WITH FIXED SEATING OR DESIGNATED AS A STANDING ASSEMBLY AREA)
 OCCUPANCY: A
 OCCUPANCY LOAD: 7 sf/person - MAX 300 FOR RISK II
 MAX SQ FT: 2,100 sq ft

SHADE STRUCTURE

EXAMPLE 1:
 STRUCTURES LOCATED OVER A FIELD, BLACKTOP, PLAYGROUND EQUIPMENT,OR OTHER NON DESIGNATED USE SPACES
 OCCUPANCY: E
 OCCUPANCY LOAD: 20 sf/person - MAX 250 FOR RISK II
 MAX SQ FT: 5,000 sq ft

PARKING

EXAMPLE 1:
 STRUCTURES LOCATED OVER PARKING
 OCCUPANCY: S-2
 OCCUPANCY LOAD: 200 sf/person
 MAX SQ FT: UNLIMITED PER CBC 406.5.4 AND 406.5.5

CODES

TITLE 24, CCR CODES:

- 2016 CALIFORNIA ADMINISTRATIVE CODE (CAC) (PART 1, TITLE 24, CCR)
- 2016 CALIFORNIA BUILDING CODE (CBC), VOLUMES 1 AND 2 (PART 2, TITLE 24, CCR)
(2015 INTERNATIONAL BUILDING CODE WITH 2016 CALIFORNIA AMENDMENTS)
- 2016 CALIFORNIA ELECTRICAL CODE (PART 3, TITLE 24, CCR)
(2014 NATIONAL ELECTRICAL CODE WITH 2016 CALIFORNIA AMENDMENTS)
- 2016 CALIFORNIA MECHANICAL CODE (CMC) (PART 4, TITLE 24, CCR)
(2015 UNIFORM MECHANICAL CODE WITH 2016 CALIFORNIA AMENDMENTS)
- 2016 CALIFORNIA PLUMBING CODE (CPC) (PART 5, TITLE 24, CCR)
(2015 UNIFORM PLUMBING CODE WITH 2016 CALIFORNIA AMENDMENTS)
- 2016 CALIFORNIA ENERGY CODE (PART 6, TITLE 24, CCR)
(2016 EDITION CALIFORNIA ENERGY COMMISSION BUILDING ENERGY EFFICIENCY STANDARDS)
- 2016 CALIFORNIA FIRE CODE (CFC) (PART 9, TITLE 24, CCR)
(2015 INTERNATIONAL FIRE CODE WITH 2016 CALIFORNIA AMENDMENTS)
- 2016 CALIFORNIA GREEN BUILDING STANDARDS CODE (PART 11, TITLE 24, CCR)
- 2016 CALIFORNIA REFERENCED STANDARDS CODE (PART 12, TITLE 24, CCR)
NFPA 13 - 2016
NFPA 72 - 2016

REFERENCE CODE SECTIONS FOR APPLICABLE STANDARDS:

- 2016 CBC, CHAPTER 35
- 2016 CFC, CHAPTER 80

FIRE LIFE SAFETY

AUTOMATIC FIRE SPRINKLERS REQUIRED? (Y/N)..... N

ENGINEER'S APPROVAL



DATE SIGNED
11/28/2018

IDENTIFICATION STAMP

DIV. OF THE STATE ARCHITECT
 APP: 01-118968 INC:
 REVIEWED FOR:
 SS FLS ACS
 DATE: 06/12/2020

SITE SPECIFIC DSA APPROVAL

FILE NUMBER: PC-119

IDENTIFICATION STAMP
 DIVISION OF THE STATE ARCHITECT
 APP. NO: 04 - 117117 INCR
 AC DF FLS DS SS DP
 DATE 12/05/2018

PRE-CHECK (PC) DOCUMENT

CODE: 2016 CBC
 A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED

MBARC CONSTRUCTION INC.
 674 RANCHEROS DR SAN MARCOS, CA 92069
 PHONE: (760) 744-4131 FAX: (760) 744-4449
 IUC # 869980 B AND C51
 GREGJ@MBARCONLINE.COM (775) 787-8845


ASTEL ENGINEERING STRUCTURAL ENGINEERING
 26030 ACHERO, SUITE 200 MISSION VIEJO, CA 92691
 PHONE: (949) 305-1150 FAX: (949) 305-1420

VERSA CANOPY GENERAL DATA

DRAWN GM
 CHECKED KS
 DATE 11/28/2018
 4STEL JOB NO. MC03-01
 SHEET S-2
 2 OF 13 SHEETS

SOILS NOTES

- IF NO GEOTECHNICAL REPORT IS SUPPLIED AT THE TIME OF DSA REVIEW ADDRESSING SITE-SPECIFIC PARAMETERS, FOUNDATION SELECTIONS SHALL BE BASED ON CLASS W SOILS (SOIL CLASS 5 OF CBC TABLE 1806A.2 WITH DOUBLING OF LATERAL BEARING PRESSURE FOR STRUCTURES NOT ADVERSELY AFFECTED BY 1/2" MOTION AT GROUND SURFACE) IN THE SOIL CLASS TABLE BELOW.
- WHEN A GEOTECHNICAL REPORT IS SUPPLIED THE GEOTECHNICAL ENGINEER SHALL REVIEW THE SITE CONDITIONS, TESTING RESULTS, AND ALL ALLOWABLE INCREASES AND SUPPLY THE FINAL SOIL CLASS TO BE USED FROM THE BELOW TABLE. THE GEOTECHNICAL ENGINEER SHALL PROVIDE IN THE GEOTECHNICAL REPORT THE FOLLOWING BASE VALUES WITHOUT INCREASE FOR 24" DIAMETER PIERS: THE ALLOWABLE VERTICAL END BEARING, ALLOWABLE LATERAL BEARING, ALLOWABLE DOWNWARD SKIN FRICTION, ALLOWABLE SKIN FRICTION TO RESIST UPLIFT. THE GEOTECHNICAL ENGINEER SHALL ALSO PROVIDE ANY ALLOWABLE INCREASES TO THE BASE VALUES. ALLOWABLE INCREASES ARE TYPICALLY DUE TO BUT NOT EXCLUSIVE TO: DOUBLE VALUES DUE TO ISOLATED FOUNDATIONS, DOUBLE VALUES DUE TO THE STRUCTURE NOT BEING ADVERSELY AFFECTED BY 1/2" DEFLECTION AT THE SURFACE, A 4/3 INCREASE DUE TO SHORT TERM LOADING, AND ANY OTHER ALLOWABLE INCREASES. THE GEOTECHNICAL ENGINEER SHALL MAKE RECOMMENDATION OF THE SOIL CLASS TO BE USED AFTER ALL INCREASES HAVE BEEN APPLIED. ALL FOUNDATIONS HAVE BEEN DESIGN BASED ON THE VALUES PRESENTED IN THE BELOW TABLE. THE GEOTECHNICAL REPORT SHALL ADDRESS IF THE USE OF STEEL CASING THAT IS TWISTED INTO PLACE AND LEFT INSTALLED AFFECTS ANY ALLOWABLE VALUES.
- THE GEOTECHNICAL ENGINEER MAY SPECIFY DIFFERENT SOILS CLASSES TO BE USED FOR THE DIFFERENT STRUCTURE TYPES (VC14 OR VC20), DIFFERENT AREAS OF THE SITE (I.E. NORTH LOT OR WEST LOT), OR THE ENGINEER MAY SPECIFY ONE SOILS CLASS TO BE USED FOR THE ENTIRE SITE.
- THE GEOTECHNICAL ENGINEER SHALL ADDRESS IN THE REPORT ANY CONCRETE DURABILITY REQUIREMENTS IN ACCORDANCE WITH ACI 318-11 CHAPTER 4.
- THE GEOTECHNICAL REPORT SHALL BE SPECIFIC TO THE LOCATION OF THE STRUCTURES. BORING(S) SHALL BE DONE AT THE SPECIFIC LOCATION(S) WHERE THE STRUCTURES ARE TO OCCUR. THE GEOTECHNICAL REPORT SHALL CONFORM TO 2016 CBC SECTION 1803A.
- A COPY OF THE GEOTECHNICAL REPORT SHALL BE PROVIDED AT THE TIME OF PLAN REVIEW.
- AT THE TIME OF PLAN REVIEW, THE DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE SHALL SELECT A SOILS CLASS ON THE SITE-SPECIFIC PLANS BASED ON THE GEOTECHNICAL REPORT (OR NOTE 1 ABOVE). HOLES MAY BE LEFT OPEN FOR ANY AMOUNT OF TIME AS LONG AS THEY ARE PROPERLY COVERED FOR OSHA STANDARDS.
- FOUNDATIONS ADJACENT TO SLOPED GROUND SURFACES SHALL BE SET BACK PER THE FOLLOWING FIGURE UNLESS OTHERWISE RECOMMENDED BY A SITE SPECIFIC GEOTECHNICAL REPORT.

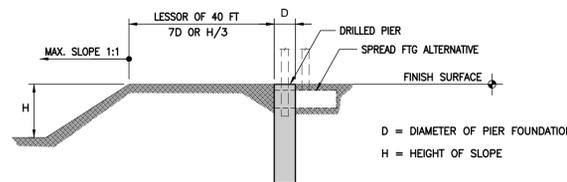

DESIGN SOIL VERTICAL AND LATERAL BEARING VALUES

SOIL CLASS	VERTICAL BEARING PRESSURE (psf)	LATERAL BEARING PRESSURE (psf/ft)	MAXIMUM LATERAL BEARING (psf)	MIN. DOWNWARD SKIN FRICTION (psf)	MIN. UPWARD SKIN FRICTION (psf)
CLASS V	1,500	133	2,000	175	50
CLASS W	1,500	267	4,000	225	50
CLASS X	2,000	400	6,000	250	75
CLASS Y	2,000	533	8,000	275	75
CLASS Z	3,000	800	12,000	325	100

SPECIAL INSPECTION

- SOILS:
 - VERIFY THE SITE HAS BEEN PREPARED PROPERLY PRIOR TO PLACEMENT OF CONTROLLED FILL AND/OR EXCAVATIONS FOR FOUNDATIONS.
 - VERIFY THAT THE FOUNDATION EXCAVATIONS ARE EXTENDED TO PROPER DEPTH AND HAVE REACHED PROPER MATERIAL.
 - VERIFY THAT MATERIALS BELOW FOOTINGS ARE ADEQUATE TO ACHIEVE THE DESIGN BEARING CAPACITY.
- PIER FOUNDATIONS:
 - INSPECT DRILLING OPERATIONS AND MAINTAIN COMPLETE AND ACCURATE RECORDS FOR EACH PIER.
 - VERIFY LOCATIONS OF PIERS.
- CONCRETE:
 - VERIFY USE OF REQUIRED DESIGN MIX, DETERMINE THE TEMPERATURE OF THE CONCRETE, AND (WHERE REQUIRED) PERFORM AIR CONTENT TEST.
 - TEST CONCRETE (COMPRESSION TEST).
 - INSPECT PLACEMENT OF FORMWORK, REINFORCING STEEL, EMBEDDED ITEMS, AND CONCRETE. INSPECT CURING AND FORM REMOVAL.
 - SLUMP TEST SHALL BE PERFORMED PER SITE SPECIFIC DSA-103.
- STEEL:
 - VERIFY THAT ALL MATERIALS ARE APPROPRIATELY MARKED AND THAT:
 - MILL CERTIFICATES INDICATE MATERIAL PROPERTIES THAT COMPLY WITH REQUIREMENTS.
 - MATERIAL SIZES, TYPES AND GRADES COMPLY WITH REQUIREMENTS.
 - TEST UNIDENTIFIED MATERIALS.
 - VERIFY MEMBER LOCATIONS, BRACING AND ALL DETAILS CONSTRUCTED IN THE FIELD.
 - VERIFY STIFFENER LOCATIONS, CONNECTION TAB LOCATIONS, AND ALL CONSTRUCTION DETAILS FABRICATED IN THE SHOP.
 - HIGH STRENGTH SLIP CRITICAL BOLTING.
- SHOP FABRICATION:
 - VERIFY FABRICATOR'S FABRICATION AND QUALITY CONTROL PROCEDURES.
 - VERIFY ALL ASPECTS OF SHOP FABRICATION INCLUDING MEMBER LOCATIONS, DIMENSIONAL LAYOUT OF ALL PARTS AND PIECES, BOLTING, ETC.
- SEE DSA APPROVED 103 FOR ADDITIONAL REQUIREMENTS.

GENERAL NOTES

- DESIGN PER 2016 C.B.C. AND ITS PRESCRIBED LOADING AND MATERIAL SPECIFICATIONS:
 - ASCE 7-10
 - 14TH EDITION AISC STEEL CONSTRUCTION MANUAL
 - 2012 AISI COLD FORMED STEEL STANDARD
 - ACI 318-14
- THESE STRUCTURES ARE NOT DESIGNED TO BE, NOR SHALL THEY BE, ENCLOSED.
- ALL DIMENSIONS, CONDITIONS, AND ELEVATIONS ARE TO BE FIELD VERIFIED BY THE CONTRACTOR PRIOR TO COMMENCING WORK OR FABRICATION. IF ANY DISCREPANCIES ARE FOUND OR IF ANY CONDITION EXISTS NOT AS SHOWN ON THE DRAWINGS THE DESIGN PROFESSIONAL IN RESPONSIBLE CHARGE SHALL BE NOTIFIED IMMEDIATELY.
- IF THE SNOW LOAD OPTION IS USED THEN THE SITE-SPECIFIC MAX GROUND SNOW LOADING INCLUDING DRIFT MUST BE LESS THAN OR EQUAL TO 20 PSF.
- ALL SCREWS TO BE ITW BUILDEX TEK SCREWS PER ICC ESR-1976 OR ELCO DRILL SCREW PER ICC ESR-3294.
- OWNER TO SIGN AUTHORIZATION TO PROCEED PRIOR TO DRILLING.
SEE SAMPLE BELOW:



Authorization to Proceed

Project Name: _____ Foreman: _____
Site Name: _____ Contractor: _____

As an authorized representative of Contractor listed above, I, _____ agree to the following statements below:

_____(initial) LAYOUT: The onsite layout for installation of structural steel for carports and canopies has been inspected and is approved as is.

_____(initial) ARRAY ORIENTATION/CONCRETE POUR: The tilt and direction of the canopies have been verified and are approved as is.

ARRAYS:

It is understood that additional costs will apply due to the following delays: re-layout not due to M Bar C, underground site conflicts (unmarked utility lines, including but not limited to water, sewer, fire, irrigation, electrical); encountered underground water; change in soils condition, including but not limited to hard drilling, caving soils, obstructions).

BY: _____ DATE: _____
(signature)

www.mbaronline.com

STEEL NOTES

- COLD FORMED STEEL SIZES ARE BASED ON BARE STEEL THICKNESS.
- STRUCTURAL PURLIN, BEAM & COLUMN MEMBERS SHALL HAVE MINIMUM STEEL YIELD STRENGTHS AS INDICATED.
- STRUCTURAL STEEL SHALL BE HOT-DIP GALVANIZED (MINIMUM ASTM A123 OR A153, CLASS D) OR PAINTED WITH ZINC-RICH PRIMER, UNDERCOAT, AND FINISH COAT; OR EQUIVALENT PAINT SYSTEM. COLD-FORMED STEEL MEMBERS SHALL BE 55% ALUMINUM-ZINC ALLOY COATED PER ASTM A792/A792M STANDARD IN ACCORDANCE TO AISI S200 TABLE A4-1, CP 90 COATING DESIGNATION.
- ALL EXPOSED STEEL FASTENERS, INCLUDING CAST IN PLACE ANCHOR BOLTS/RODS, SHALL BE STAINLESS STEEL (TYPE 304 MINIMUM), HOT-DIP GALVANIZED (ASTM A153, CLASS D MINIMUM OR ASTM F2329), OR PROTECTED WITH CORROSION-PREVENTIVE COATING THAT DEMONSTRATED NO MORE THAN 2% OF RED RUST IN MINIMUM 1,000 HOURS OF EXPOSURE IN SALT SPRAY TEST PER ASTM B117. ZINC-PLATED FASTENERS DO NOT COMPLY WITH THIS REQUIREMENT. (EXAMPLE PROPRIETARY COATINGS THAT COMPLY WITH THE 1000 HOUR REQUIREMENT INCLUDE BUT ARE NOT NECESSARILY LIMITED TO: QUIK GUARD BY SIMPSON, KWIK-COTE BY HILTI, STALGARD BY ELOCO, VISTA-CORR BY SFS INTEC, ETC.)
- STEEL FABRICATION SHALL COMPLY WITH LATEST AISC SPECIFICATIONS.
- HOLLOW STRUCTURAL STEEL (HSS) MEMBERS SHALL BE ASTM A1085 GR. 50 U.N.O. ASTM A1085 STEEL HAS THE SAME OR BETTER PROPERTIES AND WELDABILITY THAN ASTM A500 GR. B.
- COLD FORMED STEEL (CFS) MEMBERS SHALL BE ASTM A653 SS GR. 55 (F_y = 55 ksi, F_u = 70 ksi) OR ASTM A1011 SS GR. 55 (F_y = 55 ksi, F_u = 70 ksi).
- ZINC COATING OF STRUCTURAL STEEL SHALL CONFORM WITH G90 STANDARD OR BETTER. COLD FORMED STEEL (CFS) MEMBERS TO BE GALVANIZED IN ACCORDANCE WITH ASTM A653 G90 STANDARD. HOLLOW STRUCTURAL STEEL (HSS) MEMBERS SHALL BE GALVANIZED IN ACCORDANCE WITH ASTM A123, UNLESS NOTED OTHERWISE.
- ALL STEEL MEMBERS TO BE GALVANIZED OR PAINTED WITH ZINC-RICH PRIMER, UNDERCOAT AND FINISH COAT OR EQUIVALENT PAINT SYSTEM. CONTRACT DOCUMENTS SHALL SPECIFY THE TYPE OF SSPC CORROSION RESISTING SYSTEM TO BE UTILIZED AND THE SSPC GRADE FOR CLEANING, MINIMUM SSPC GRADE SP2.
- BOLTS SHALL CONFORM TO THE ASTM A307 SPECIFICATIONS UNLESS NOTED OTHERWISE. INSPECTION OF A307 BOLTING IS NOT REQUIRED.
- ASTM A307 BOLTS MAY BE SUBSTITUTED WITH THE SAME NUMBER AND SIZE OF SAE J429 GRADE 2 BOLTS.
- BOLTS SHALL BE TIGHTENED TO SNUG-TIGHT CONDITION UNLESS NOTED OTHERWISE EXCEPT FOR A325-SC HIGH STRENGTH BOLTS USED IN THE BEAM TO COLUMN CONNECTION.
- A325-SC BOLTS SHALL BE PRE-TENSIONED PER AISC SPECIFICATIONS USING APPROVED LOAD INDICATOR METHODS INCLUDING BUT NOT LIMITED TO TURN-OF-THE-NUT WITH MATCH MARKING, TWIST OFF TENSION CONTROL OR DIRECT TENSION INDICATOR BOLT, NUT AND WASHER ASSEMBLIES.
- ASTM A307 BOLTS SHALL HAVE STANDARD WASHERS UNDER THE NUT & BOLT HEAD (F436 WASHERS ARE NOT REQUIRED). STANDARD WASHERS DO NOT REQUIRE HARDNESS TEST.
- BOLT HOLES FOR 1/2" BOLTS SHALL BE AS FOLLOWS:
STANDARD HOLES: 3/8"

CONCRETE NOTES

- CONCRETE MIN. 4,500 PSI AT 28 DAYS UNLESS A SOILS REPORT IS PROVIDED THAT ALLOWS FOR A LOWER STRENGTH (3,000 PSI MIN.). BATCH PLANT INSPECTION NOT REQUIRED.
- CONCRETE SHALL MEET THE FOLLOWING MINIMUM REQUIREMENTS BASED ON EXPOSURE CLASS IN ACCORDANCE WITH ACI 318-14 TABLE 19.3.2.1 WHEN DETERMINED BY A SITE-SPECIFIC GEOTECHNICAL REPORT.

REQUIREMENTS FOR CONCRETE BASED ON EXPOSURE CLASS

EXPOSURE CLASS ACI TABLE 19.3.2.1	MINIMUM CONCRETE STRENGTH F _c	CEMENT TYPE ASTM C150	MAX. WATER/CEMENT RATIO W/M
NOT DETERMINED	4,500 PSI	TYPE IV	0.45
FO, SO, PO, CO, C1	3,000 PSI	TYPE II	N/A
S1, P1	4,000 PSI	TYPE II	0.50
ALL OTHER	4,500 PSI	TYPE V	0.45

- CONCRETE EXPOSED TO THAW AND FREEZE CYCLE SHALL BE AIR ENTRAINED PER ACI 318-14 TABLE 19.3.1.1.
- CONCRETE TO ATTAIN 1000 PSI PRIOR TO REMOVAL OF SHORING AND/OR INSTALLATION OF BEAMS AND PURLINS. (NOTE: A HIGHER COMPRESSIVE CONCRETE MAY BE USED TO ACHIEVE 1000 PSI SOONER. SUBMIT CONCRETE MIX DESIGN PREPARED BY A QUALIFIED LICENSED PROFESSIONAL ENGINEER FOR APPROVAL BY THE DESIGN PROFESSIONAL IN RESPONSIBLE CHARGE PRIOR TO BEING PLACED.)
- CONCRETE TO REACH 3000 PSI PRIOR TO INSTALLATION OF ROOF DECK. (NOTE: A HIGHER COMPRESSIVE CONCRETE MAY BE USED TO ACHIEVE 3000 PSI SOONER. SUBMIT CONCRETE MIX DESIGN PREPARED BY A QUALIFIED LICENSED PROFESSIONAL ENGINEER FOR APPROVAL BY THE DESIGN PROFESSIONAL IN RESPONSIBLE CHARGE PRIOR TO BEING PLACED.)
- REINFORCEMENT BARS SHALL BE ASTM A615, GR60 TYPICAL, U.N.O.
- MINIMUM CONCRETE COVER SHALL BE 2 1/2" TO EARTH (DRILLED PIER FOUNDATIONS ONLY), 3" TO EARTH ALL OTHER CONCRETE, 2" TO EXPOSED SURFACES PER CBC TABLE 1808A.8.2
- ALL REINFORCING STEEL AND OTHER EMBEDDED ITEMS SHALL BE SECURELY POSITIONED PRIOR TO THE POURING OF CONCRETE.
- ALL CONCRETE WORK SHALL COMPLY WITH ACI 301 & 318 STANDARDS.
- AGGREGATE GRADATION AND QUALITY SHALL BE IN ACCORDANCE WITH ACI 302-R.
- COLD JOINTS SHALL HAVE A ROUGHENED SURFACE. BONDING AGENT SHALL COMPLY WITH ASTM C1059. A SUBMITTAL FOR CONCRETE BONDING AGENT SHALL BE APPROVED BY DESIGN PROFESSIONAL IN RESPONSIBLE CHARGE PRIOR TO INSTALLATION. DSA INSPECTOR OF RECORD TO PERIODICALLY INSPECT INSTALLATION OF BONDING AGENT.
- BATCH PLANT INSPECTION NOT REQUIRED PER CBC 1705A3.3.2. SUBJECT TO:
 - A LICENSED WEIGHMASTER SHALL POSITIVELY IDENTIFY QUANTITY OF MATERIALS AND CERTIFY EACH LOAD BY A BATCH TICKET.
 - BATCH TICKETS, INCLUDING MATERIAL QUANTITIES AND WEIGHTS SHALL ACCOMPANY THE LOAD, SHALL BE TRANSMITTED TO THE INSPECTOR OF RECORD BY THE TRUCK DRIVER WITH LOAD IDENTIFIED THEREON. THE LOAD SHALL NOT BE PLACED WITHOUT A BATCH TICKET IDENTIFYING THE MIX. THE INSPECTOR OF RECORD SHALL KEEP A DAILY RECORD OF PLACEMENTS, IDENTIFYING EACH TRUCK, ITS LOAD, AND TIME OF RECEIPT AT THE JOBSITE, AND APPROXIMATE LOCATION OF DEPOSIT IN THE STRUCTURE AND SHALL MAINTAIN A COPY OF THE DAILY RECORD AS REQUIRED BY THE ENFORCEMENT AGENCY.
- CONCRETE MAY BE PUMPED, POURED, TAILGATED, OR OTHER SUCH METHODS INTO PLACE. CONCRETE SHALL BE ALLOWED TO FREE FALL THE ENTIRE DEPTH OF THE FOUNDATION. PLACEMENT OF ANY FREE-FALL CONCRETE SHALL BE SUCH THAT THE CONCRETE DOES NOT ALTER THE EMBEDMENT DEPTH OR THE CLEARANCE OF THE REINFORCING BAR CAGE OR OTHER EMBEDDED MATERIALS.

ENGINEER'S APPROVAL



DATE SIGNED
11/28/2018

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT

APP: 01-118968 INC:

REVIEWED FOR

SS FLS ACS

DATE: 05/12/2020

SITE SPECIFIC DSA APPROVAL

FILE NUMBER: PC-119

IDENTIFICATION STAMP
DIVISION OF THE STATE ARCHITECT

APP. NO: 04 - 117117 INCR

AC DF FLS DS SS DP

DATE: 12/05/2018

PRE-CHECK (PC) DOCUMENT

CODE: 2016 CBC

A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED

MBARC CONSTRUCTION INC.
674 RANCHEROS DR SAN MARCOS, CA 92069
PHONE: (760) 744-4131
FAX: (760) 744-4449
GREGJ@MBARCONLINE.COM (775) 787-8845

4STEL ENGINEERING
STRUCTURAL ENGINEERING
26030 ACHERO, SUITE 200 MISSION VIEJO, CA 92691
PHONE: (949) 305-1150
FAX: (949) 305-1420

VERSA CANOPY GENERAL NOTES

DRAWN GM
CHECKED KS
DATE 11/28/2018
4STEL JOB NO. MC03-01
SHEET
S-3

3 OF 13 SHEETS

DSA DSA-103 Issued 9/12/07
List of Required Structural Tests & Special Inspections - 2016 CBC

INCREMENT # _____ DSA File No.: PC-119
 Application No.: SA-117117
 Date Submitted: _____ Revisited: _____

Sheet Name: Spread Footings without Post Installed Anchors Sheets: _____


IMPORTANT: This form is only a summary list of structural tests and some of the special inspections required for the project. Generally, the structural tests and special inspections noted on this form are those that will be performed by the Geotechnical Engineer of Record, Laboratory of Record, or Special Inspector. The actual complete test and inspection program must be performed as detailed on the DSA approved documents. The appendices at the bottom of this form identify work NOT subject to DSA requirements for special inspection or structural testing. The project inspector is responsible for providing inspection of all tests of construction including but not limited to, special inspections not listed on this form such as structural wood framing, high-strength wood diaphragms, cold-formed steel framing, anchorage of non-structural components, etc., per Title 24, Part 2, Chapter 17A. NOTE: This form is also available for projects submitted for review under the 2007, 2010, and 2013 CBC.

INSTRUCTIONS: Click a plus sign (+) before any category or subcategory to reveal additional tests and special inspections. A shaded box indicates a test or special inspection that may be required, depending on the scope of the construction and other issues. A shaded box can be checked indicating your selection of that test. Note: A minus (-) on a category or subcategory heading indicates that it can be collapsed. However, any selection you may have made will be cleared. Click on the "COMPLETE" button to show only the tests and inspections fully selected. For more information on use of this form, see DSA-103.INSTR.

Note: References are to the 2016 edition of the California Building Code (CBC) unless otherwise noted.

TEST OR SPECIAL INSPECTION	TEST	PERIODIC	CONTINUOUS	CODE REFERENCE AND NOTES
SOILS				
1. GENERAL:				Table 1705A.6
X	Verify that:			
	• all soils have been properly prepared for placement of controlled fill and/or foundation			
	• foundation excavations are extended to proper depth and have reached proper materials, and	Periodic	GE	* By geotechnical engineer or his or her qualified representative. (See Appendix for exemptions.)
	• materials below footings are adequate to achieve the design bearing capacity.			
4. CAST-IN-PLACE DEEP FOUNDATIONS (PIERS):				Table 1705A.8
X	Inspect drilling operations and logs to complete and accurate records for each pier.	Continuous	GE	* By geotechnical engineer or his or her qualified representative. (See Appendix for exemptions.)
X	Verify pier location, dimensions, placement, and diameter (if applicable), length, and embedment into rock (if applicable). Record concrete or grout volumes.	Continuous	GE	* By geotechnical engineer or his or her qualified representative. (See Appendix for exemptions.)
X	Confirm adequate and strata bearing capacity.	Continuous	GE	* By geotechnical engineer or his or her qualified representative. (See Appendix for exemptions.)
X	Concrete piles.	Provide tests and inspections for CONCRETE section below.		
CONCRETE				Table 1705A.3, ACI 318-14 Sections 26.5.2 & 26.5.3
7. CAST IN PLACE CONCRETE				
X	Material Verification and Testing:	Periodic	SI	Table 1705A.3 Item 5, 1910A.1 (1909.2.3). * To be performed by qualified batch-plant inspector and concrete sampling technician.
X	Verify use of required design mix.	Periodic	SI	Table 1705A.3 Item 5, 1910A.1 (1909.2.3). * To be performed by qualified batch-plant inspector and concrete sampling technician.
X	Identify, sample, and test reinforcing steel.	Test	LOR	1910A.2 (1909.2.4); ACI 318-14 Section 26.6.1.2; DSA IR 17-10.16
X	During concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.	Test	LOR	Table 1705A.3 Item 6, ACI 318-14 Sections 26.5.9 & 26.12
X	Test concrete (f _c).	Test	LOR	1905A.1.6 (1909.3.7); ACI 318-14 Section 26.12.
X	Test concrete (f _t).	Test	LOR	1905A.1.6 (1909.3.7); ACI 318-14 Section 26.12.
MASONRY				TMS 402-13ACI 530-13ASCE 5-13 Table 2.1.3 & TMS 602-13ACI 530-13ASCE 6-13 Table 5
STEEL, ALUMINUM				Table 1705A.2.1, ABCS 300-10, ABCS 341-10, ABCS 358-10, AISI 1009-0702-10
17. STRUCTURAL STEEL, COLD-FORMED STEEL, AND ALUMINUM USED FOR STRUCTURAL PURPOSES				
X	Material Verification:			
X	Verify identification of all materials and:	Periodic	SI	2205A.1 (2003.1.7); Table 1705A.2.1 Item 3a-3c; AISI S100-0702-10 Section A2.1 & A2.2; AISI S200-12 Section 4.1; AISI S200-11 Section A4. * By special inspector or qualified technician when performed off-site.
X	Material labels, types and grades comply with requirements.	Periodic	SI	2205A.1 (2003.1.7)
X	Test unidentified materials.	Test	LOR	2205A.1 (2003.1.7)
X	Examine seam welds of HSS shapes.	Periodic	SI	DSA IR 17-3.
X	Verify and document steel fabrication per DSA approved construction documents.	Periodic	SI	Not applicable to cold-formed light-frame construction, except for trusses (1705A.2.6).
WELDING:				1705A.2.6, Table 1705A.2.1 Item 4 & 8, USA IR 17-3, AWS D1.1 and AWS D1.8 for structural steel, AWS D1.2 for Aluminum, AWS D1.3 for cold-formed steel, AWS D1.4 for reinforcing steel. (See Appendix for exemptions.)
19. WELDING:				
X	Verify materials, Equipment, Welders, etc.	Periodic	SI	DSA IR 17-3.
X	Verify welder material identification markings per AWS D1.1 and AWS D1.8.	Periodic	SI	DSA IR 17-3.
X	Verify welder material manufacturer's certificate of conformance.	Periodic	SI	DSA IR 17-3.
X	Verify WPS, welder qualifications and equipment.	Periodic	SI	DSA IR 17-3.
19.1. ROOF WELDING:				
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per AWS 300-10 (and AWS 341-10 as applicable), DSA IR 17-3.


ROOF DECK SPECIFICATIONS						
SECTION PROPERTIES			TOP IN COMPRESSION		BOTTOM IN COMPRESSION	
GA	F _y (ksi)	WEIGHT (psf)	k _t (in. ² /ft.)	S _x (in. ³ /ft.)	k _b (in. ² /ft.)	S _y (in. ³ /ft.)
26	80	0.89	0.0840	0.0762	0.0817	0.0623

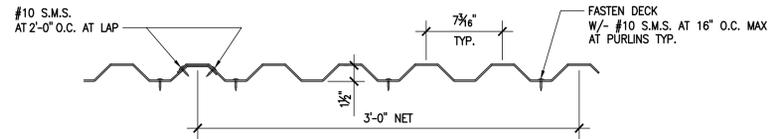

- NOTES:**
- MATERIAL AND SECTION PROPERTIES LISTED ABOVE ARE MINIMUM REQUIRED VALUES FOR METAL DECK BASED ON AEP HR-36 26 GA.
 - METAL ROOF DECK SHALL BE CLASS A PER CBC CHAPTERS 7A AND 15.

3 DECK DETAIL

N.T.S.

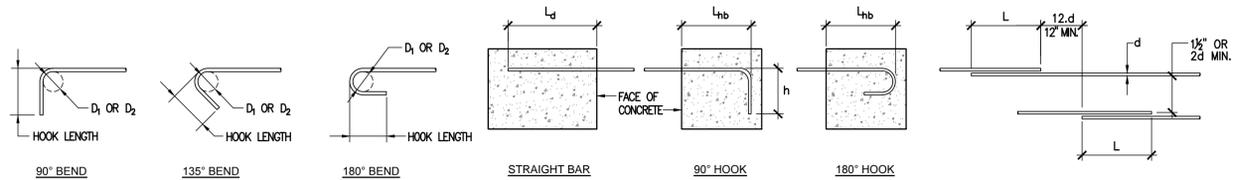

BAR SIZE	D ₁	D ₂
#3	1 1/2"	2 1/4"
#4	2"	3"
#5	2 1/2"	3 3/4"
#6, #7, #8	6 1/4"	6 1/4"

D₁ - FINISHED BEND DIA. FOR STIRRUP & TIE HOOKS.
D₂ - BEND DIA. FOR STD HOOKS.
d - BAR DIAMETER

BAR SIZE	MAIN REINFT.		STIRRUP & TIE HOOKS	
	90°	180°	90°	180°
#3	6"	4"	3 1/2"	4 1/2"
#4	8"	4 1/2"	4 1/2"	4 1/2"
#5	10"	5"	5"	6"
#6	12"	6"	12"	7 1/2"
#7	14"	7"	14"	9"
#8	16"	8"	16"	10"

REINFORCEMENT DEVELOPMENT LENGTHS				
CONCRETE STRENGTH F _c = 3,000 PSI				
NOMINAL BAR SIZE	h	L _d		L _{hb}
		TOP BARS	OTHER BARS	
#3	6"	1'-10"	1'-5"	9"
#4	8"	2'-5"	1'-10"	11"
#5	10"	3'-0"	2'-4"	1'-2"
#6	12"	3'-7"	2'-9"	1'-5"
#7	14"	5'-3"	4'-0"	1'-7"
#8	16"	6'-0"	4'-7"	1'-10"

- NOTES:**
- TOP BARS ARE HORIZONTAL BARS WITH MORE THAN 12 INCHES OF CONCRETE CAST BELOW.

REINFORCEMENT LAP SPlice LENGTH 'L'		
CONCRETE STRENGTH F _c =3,000 PSI		
NOMINAL BAR SIZE	TOP BARS	OTHER BARS
#3	2'-4"	1'-10"
#4	3'-2"	2'-5"
#5	3'-11"	3'-0"
#6	4'-8"	3'-7"
#7	6'-9"	5'-3"
#8	7'-9"	6'-0"

- NOTES:**
- LAP SPlice SHALL BE INCREASED 50% WHERE CLEAR SPACE BETWEEN BARS IS LESS THAN 2 BAR DIAMETERS AND/OR THE CLEAR COVER IS LESS THAN ONE BAR DIAMETER.

A STANDARD HOOKS

B DEVELOPMENT LENGTHS


C OFFSETS AND LAP SPICES

4 TYPICAL REINFORCEMENT BAR BENDS AND LAPS

N.T.S.

SECTION NAME	D (in)	B (in)	L (in)	GA	WT (lb/ft)	A (in ²)	AXIS X-X			AXIS Y-Y		
							I _x (in ⁴)	S _x (in ³)	r _x (in)	I _y (in ⁴)	S _y (in ³)	r _y (in)
CS12 x 4 x 0.102 (12 GA)	12	4.0	1.0	12	7.35	2.16	46.87	6.76	4.66	4.38	1.53	1.42
CS12 x 4 x 0.124 (10 GA)	12	4.0	1.0	10	8.91	2.62	56.37	8.59	4.64	5.20	1.82	1.41
CS14 x 4 x 0.102 (12 GA)	14	4.0	1.0	12	8.04	2.36	67.42	8.22	5.34	4.57	1.55	1.39

- NOTES:**
- ALL PURLIN SECTIONS ARE ASTM A653, GR 55, F_y=55 ksi
 - ALL LIGHT GAGE STEEL DESIGNED USING 2012 AISI COLD-FORMED STEEL DESIGN MANUAL.
 - PROPERTIES PER AEP STANDARD SIZES.
 - ACTUAL MANUFACTURER'S PROPERTIES MUST MEET OR EXCEED AEP STANDARD PROPERTIES.

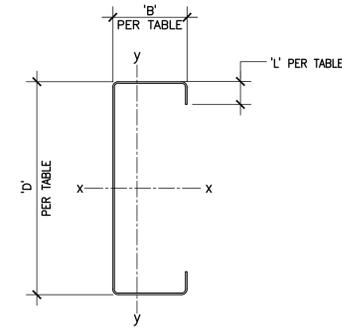


1 PURLIN & BEAM COLD FORMED C-SECTION

N.T.S.

SECTION NAME	D (in)	B (in)	t (in)	WT (lb/ft)	A (in ²)	AXIS X-X			AXIS Y-Y		
						I _x (in ⁴)	S _x (in ³)	r _x (in)	I _y (in ⁴)	S _y (in ³)	r _y (in)
HSS 12 x 6 x 1/4	12	6	1/4	29.23	8.59	161.00	26.80	4.33	55.20	18.40	2.53

- NOTES:**
- ALL COLUMNS SHALL BE ASTM A1085 GR. 50 (F_y=50 ksi)

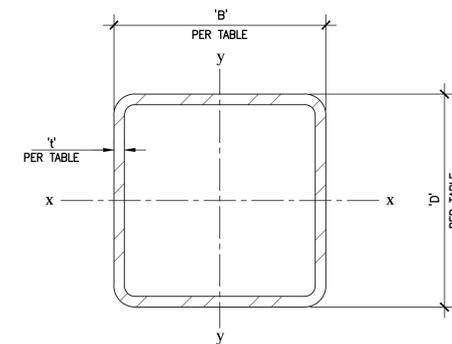

2 HSS COLUMN

N.T.S.

ENGINEER'S APPROVAL



DATE SIGNED
11/28/2018

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 01-118968 INC.
REVIEWED FOR
SS FLS ACS
DATE: 06/12/2020

SITE SPECIFIC DSA APPROVAL

FILE NUMBER: PC-119
IDENTIFICATION STAMP
DIVISION OF THE STATE ARCHITECT
APP. NO: 04 - 117117 INCR
AC DF FLS DS SS DP
DATE 12/05/2018


PRE-CHECK (PC) DOCUMENT
CODE: 2016 CBC
A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED

MBARC CONSTRUCTION INC.
PHONE: (760) 744-4131
SAN MARCOS, CA
FAX: (760) 744-4449
GREGJ@MBARCONLINE.COM (775) 787-8845


4STEL ENGINEERING
STRUCTURAL ENGINEERING
26030 ACHERO, SUITE 200
MISSION VIEJO, CA 92691
PHONE: (949) 305-1150
FAX: (949) 305-1420

VERSA CANOPY SECTION PROPERTIES & REBAR DETAILS


DRAWN GM
CHECKED KS
DATE 11/28/2018
4STEL JOB NO. MC03-01
SHEET S-5

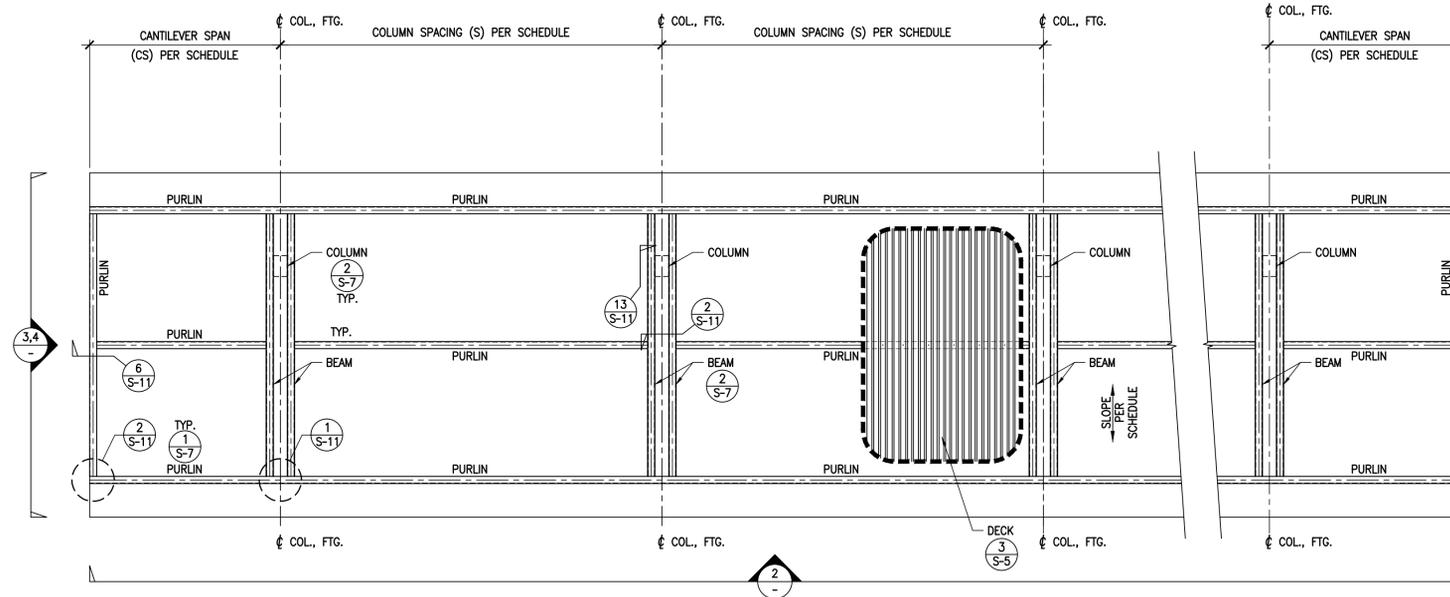


1 VC14, VC18 & VC20
 TYPICAL PLAN VIEW
 1/4"=1'-0"

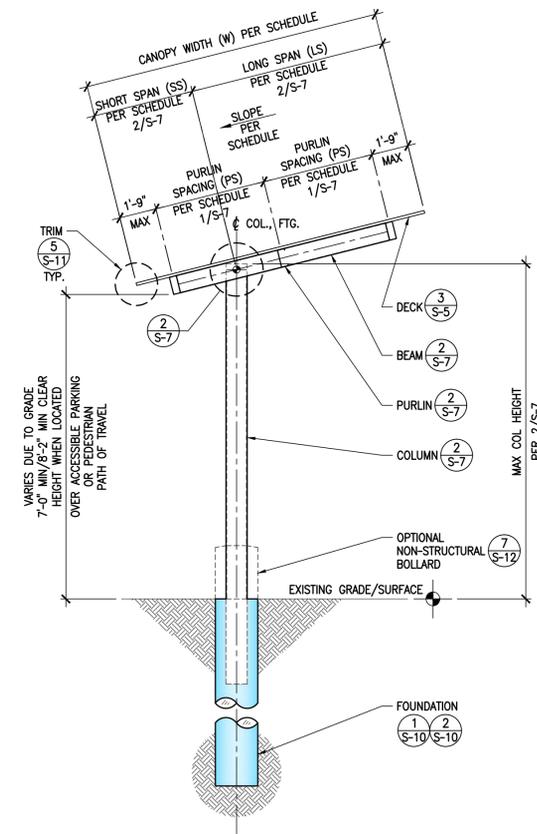

3 VC14, VC18 & VC20
 TYPICAL SIDE ELEVATION 1
 1/4"=1'-0"

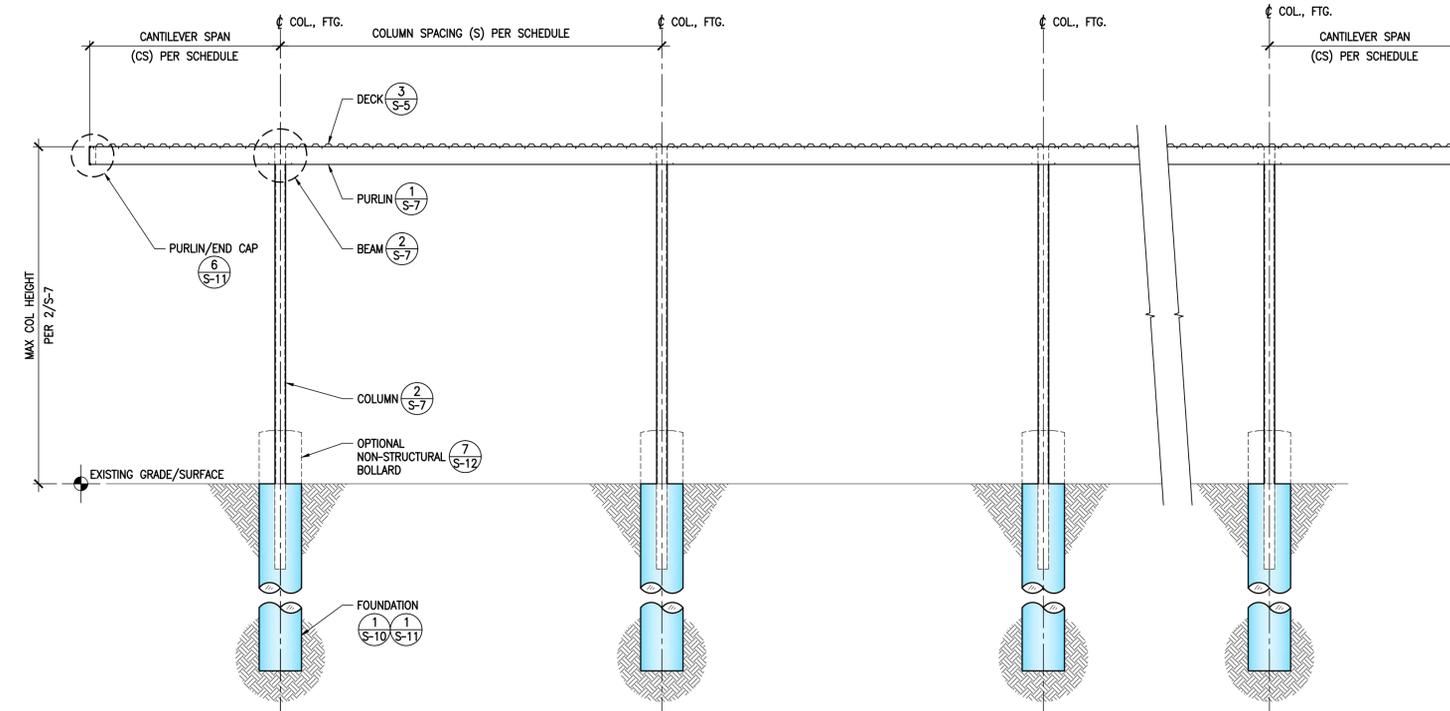

2 VC14, VC18 & VC20
 TYPICAL FRONT ELEVATION
 1/4"=1'-0"

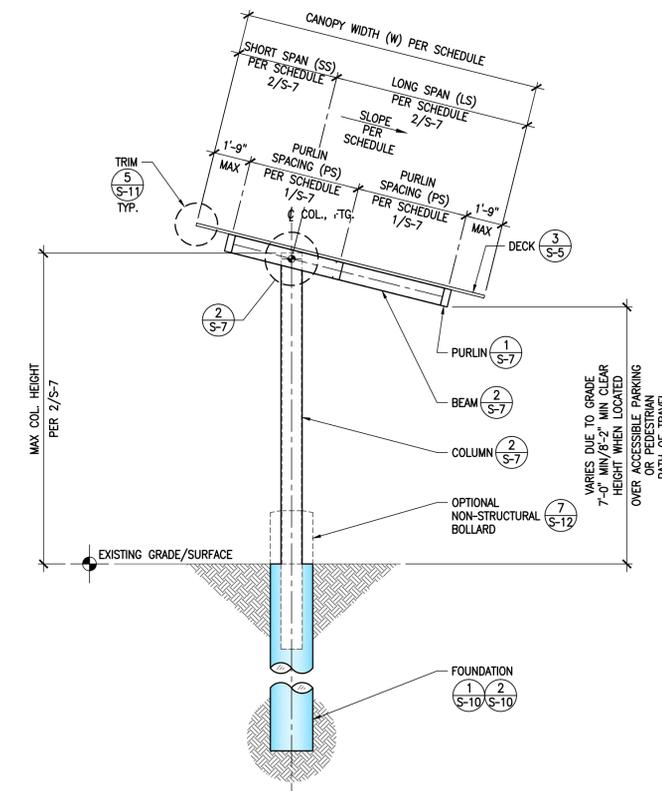

4 VC14, VC18 & VC20
 TYPICAL SIDE ELEVATION 2
 1/4"=1'-0"

ENGINEER'S APPROVAL



DATE SIGNED
 11/28/2018

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP: 01-118968 INC.
 REVIEWED FOR
 SS FLS ACS
 DATE: 06/12/2020

SITE SPECIFIC
 DSA APPROVAL

FILE NUMBER: PC-119
 IDENTIFICATION STAMP
 DIVISION OF THE STATE ARCHITECT
 APP. NO: 04 - 117117 INCR
 AC DF FLS DS SS DP
 DATE: 12/05/2018

PRE-CHECK (PC) DOCUMENT
 CODE: 2016 CBC
 A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED

MBARC CONSTRUCTION INC.
 674 RANCHEROS DR
 SAN MARCOS, CA 92069
 PHONE: (760) 744-4131
 FAX: (760) 744-4449
 GREGJ@MBARCONLINE.COM (775) 787-8845

4STEL ENGINEERING
 STRUCTURAL ENGINEERING
 26030 ACHERO, SUITE 200
 MISSION VIEJO, CA 92691
 PHONE: (949) 305-1150
 FAX: (949) 305-1420

VERSA CANOPY
 VC14, VC18 & VC20
 FRAMING PLAN & ELEVATIONS

DRAWN
 GM
 CHECKED
 KS
 DATE
 11/28/2018
 4STEL JOB NO.
 MC03-01
 SHEET

S-6

VC14, VC18 & VC20 PURLIN SCHEDULE

I.D. #	MAX GROUND SNOW LOAD	MAX PURLIN SPACING (PS)	MAX COLUMN SPACING (S)	MAX CANTILEVER SPAN (CS)	PURLIN	
					SECTION	DETAIL
VC14	0 psf	63"	27'-0"	10'-0"	CS12 x 4 x 0.102 (12 GA)	(1) S-5
VC18	0 psf	87"	27'-0"	10'-0"	CS12 x 4 x 0.124 (10 GA)	(1) S-5
VC20	0 psf	99"	19'-0"	8'-0"	CS14 x 4 x 0.102 (12 GA)	(1) S-5

- NOTES:**
- REFER TO SHEET 'S-2' FOR CONSTRUCTION OPTIONS.
 - REFER TO DETAIL '4/S-12' FOR ALLOWABLE PURLIN PENETRATIONS.
 - MULTIPLE STRUCTURE ID'S MAY BE SELECTED WITHIN THE SAME SITE.
 - WHEN UTILIZING A STRUCTURE ID READ FROM WITHIN THAT ID'S ROW ONLY.

1 VC14, VC18 & VC20
- TYPICAL PURLIN SCHEDULE

VC14, VC18 & VC20 BEAM/COLUMN SCHEDULE

I.D. #	MAX GROUND SNOW LOAD	MAX WIDTH (W)	BEAM SHORT SPAN MIN (SS)	BEAM LONG SPAN MAX (LS)	MAX COLUMN SPACING (S)	ROOF SLOPE	BEAM		BEAM TO COLUMN DETAIL	COLUMN		MAX COLUMN HEIGHT
							SECTION	DETAIL		SECTION	DETAIL	
VC14	0 psf	14'-0"	4'-3"	9'-9"	27'-0"	3:12 MAX	CS12 x 4 x 0.102 (12 GA)	(1) S-5	(13) S-11	HSS 12 x 6 x 1/4	(2) S-5	17'-0"
VC18	0 psf	18'-0"	7'-9"	10'-3"	27'-0"	3:12 MAX	CS12 x 4 x 0.102 (12 GA)	(1) S-5	(13) S-11	HSS 12 x 6 x 1/4	(2) S-5	17'-9"
VC20	0 psf	20'-0"	5'-9"	14'-3"	19'-0"	3:12 MAX	CS14 x 4 x 0.124 (10 GA)	(1) S-5	(13) S-11	HSS 12 x 6 x 1/4	(2) S-5	17'-0"

- NOTES:**
- MULTIPLE STRUCTURE ID'S MAY BE SELECTED WITHIN THE SAME SITE.
 - WHEN UTILIZING A STRUCTURE ID READ FROM WITHIN THAT ID ROW ONLY.
 - THE SHORT SPAN AND LONG SPANS MAY BE ADJUSTED WITH THE FOLLOWING REQUIREMENT:
THE OVERALL CANOPY WIDTH IS NOT EXCEEDED, NEITHER SPAN IS LESS THAN THE MIN SHORT SPAN & NEITHER SPAN EXCEEDS THE MAX LONG SPAN.

2 VC14, VC18 & VC20
- TYPICAL BEAM/COLUMN SCHEDULE

ENGINEER'S APPROVAL



DATE SIGNED
11/28/2018

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 01-118968 INC:
REVIEWED FOR
SS FLS ACS
DATE: 06/12/2020

SITE SPECIFIC
DSA APPROVAL

FILE NUMBER: PC-119
IDENTIFICATION STAMP
DIVISION OF THE STATE ARCHITECT
APP. NO: 04 - 117117 INC:
AC DF FLS DS SS DP
DATE 12/05/2018

PRE-CHECK (PC) DOCUMENT
CODE: 2016 CBC
A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED


MBARC CONSTRUCTION INC.
PHONE: (760) 744-4131
FAX: (760) 744-4449
GREGJ@MBARCONLINE.COM | (775) 787-8845
IIC # 869960
B AND C51
674 RANCHEROS DR
SAN MARCOS, CA 92069
GREG JONES

4STEL ENGINEERING
STRUCTURAL ENGINEERING
PHONE: (949) 305-1150
FAX: (949) 305-1420
26030 A CHERO SUITE 200
MISSION VIEJO, CA 92691


VERSA CANOPY
VC14, VC18 & VC20
FRAMING SCHEDULES

DRAWN GM
CHECKED KS
DATE 11/28/2018
4STEL JOB NO. MC03-01
SHEET S-7


7 OF 13 SHEETS

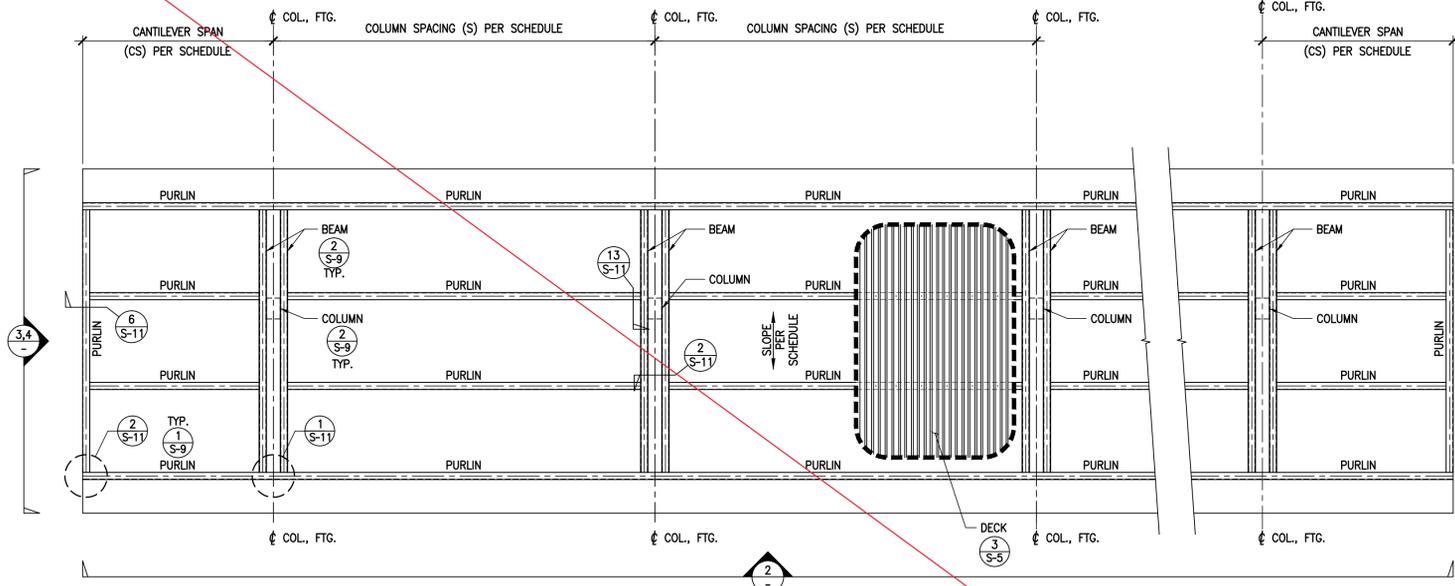


1 VC140, VC180 & VC200
 TYPICAL PLAN VIEW
 1/4"=1'-0"

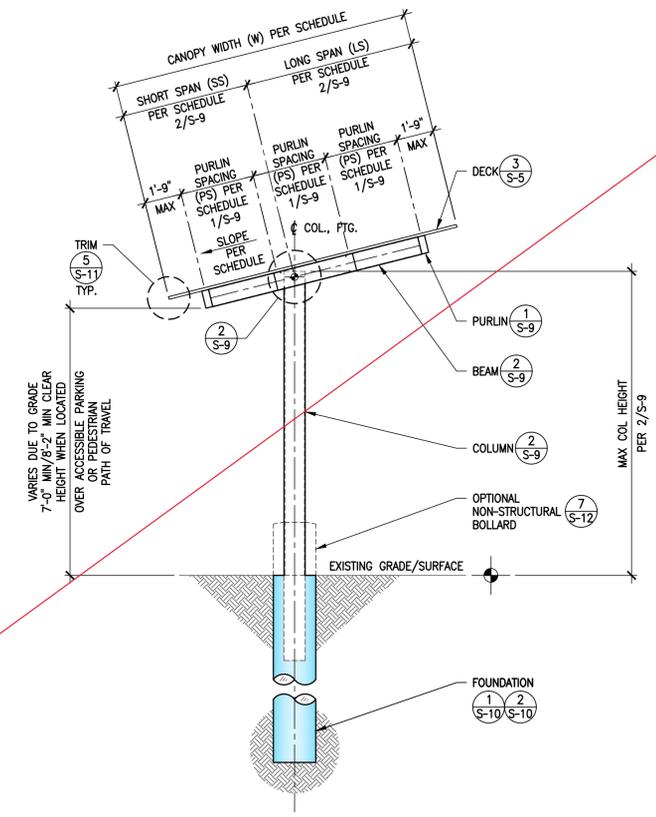

3 VC140, VC180 & VC200
 TYPICAL SIDE ELEVATION 1
 1/4"=1'-0"

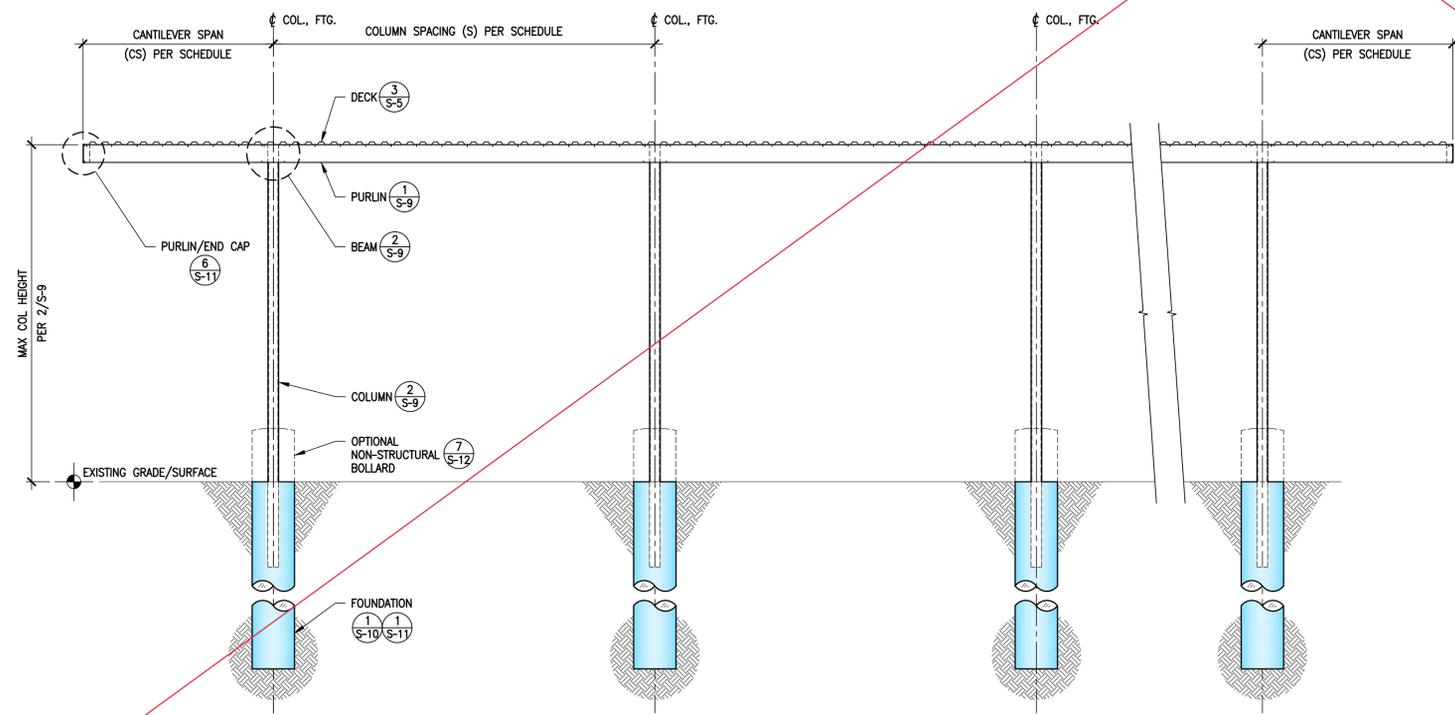

2 VC140, VC180 & VC200
 TYPICAL FRONT ELEVATION
 1/4"=1'-0"

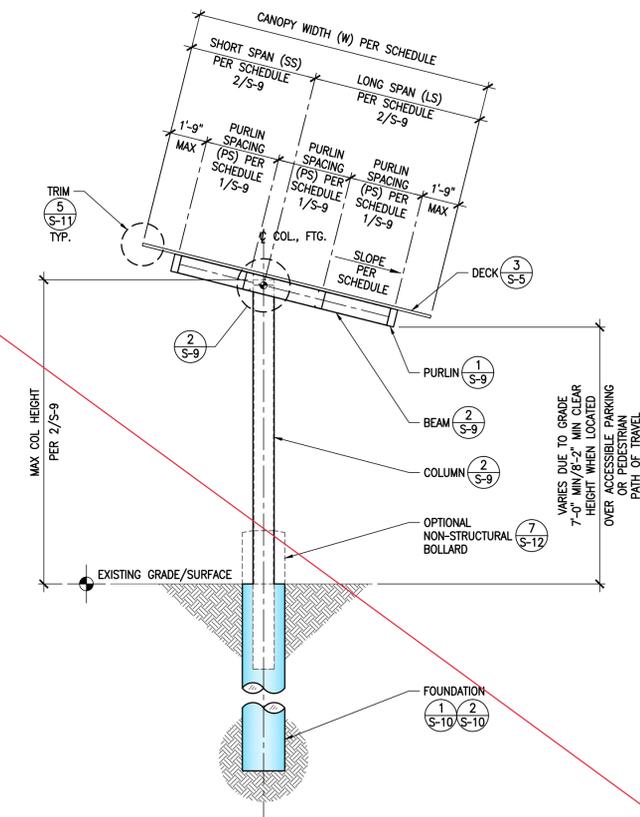

4 VC140, VC180 & VC200
 TYPICAL SIDE ELEVATION 2
 1/4"=1'-0"

ENGINEER'S APPROVAL



DATE SIGNED
 11/28/2018

SITE SPECIFIC
 DSA APPROVAL

FILE NUMBER: PC-119
 IDENTIFICATION STAMP
 DIVISION OF THE STATE ARCHITECT
 APP. NO. 04 - 117117 INCR
 AC DF FLS DS SS DP
 DATE 12/05/2018

PRE-CHECK (PC) DOCUMENT
 CODE: 2016 CBC
 A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED

MBARC CONSTRUCTION INC.
 IIC # 869980
 B AND C 51
 PHONE: (760) 744-4131
 (760) 744-4449
 FAX: (760) 744-4449
 GREGJ@MBARCONLINE.COM (775) 787-8845
 674 RANCHEROS DR
 SAN MARCOS, CA 92069
 GREG JONES

4STEL ENGINEERING
 STRUCTURAL ENGINEERING
 26030 ACHERO, SUITE 200
 MISSION VIEJO, CA 92691
 PHONE: (949) 305-1150
 (949) 305-1420
 FAX: (949) 305-1420

VERSA CANOPY
 VC140, VC180 & VC200
 FRAMING PLAN & ELEVATIONS

DRAWN GM
 CHECKED KS
 DATE 11/28/2018
 4STEL JOB NO. MC03-01
 SHEET

S-8
 8 OF 13 SHEETS

VC140, VC180 & VC200 PURLIN SCHEDULE

I.D. #	MAX GROUND SNOW LOAD	MAX PURLIN SPACING (PS)	MAX COLUMN SPACING (S)	MAX CANTILEVER SPAN (CS)	PURLIN	
					SECTION	DETAIL
VC140	20 psf	42"	27'-0"	9'-0"	CS12 x 4 x 0.102 (12 GA)	① S-5
VC180	20 psf	58"	27'-0"	8'-6"	CS14 x 4 x 0.102 (12 GA)	① S-5
VC200	20 psf	66"	19'-0"	7'-9"	CS14 x 4 x 0.102 (12 GA)	① S-5

- NOTES:**
- REFER TO SHEET 'S-2' FOR CONSTRUCTION OPTIONS.
 - REFER TO DETAIL '4/S-12' FOR ALLOWABLE PURLIN PENETRATIONS.
 - MULTIPLE STRUCTURE ID'S MAY BE SELECTED WITHIN THE SAME SITE.
 - WHEN UTILIZING A STRUCTURE ID READ FROM WITHIN THAT ID'S ROW ONLY.
 - PURLIN SPACING MAY BE INCREASED BEYOND THE MAXIMUMS GIVEN IN THE CHART ABOVE AS LONG AS THE TRIBUTARY WIDTH TO THE PURLIN DOES NOT EXCEED 'PS'.

1 VC140, VC180 & VC200
- TYPICAL PURLIN SCHEDULE

VC140, VC180 & VC200 BEAM/COLUMN SCHEDULE

I.D. #	MAX GROUND SNOW LOAD	MAX WIDTH (W)	BEAM SHORT SPAN MIN (SS)	BEAM LONG SPAN MAX (LS)	MAX COLUMN SPACING (S)	ROOF SLOPE	BEAM		BEAM TO COLUMN DETAIL	COLUMN		MAX COLUMN HEIGHT
							SECTION	DETAIL		SECTION	DETAIL	
VC140	20 psf	14'-0"	5'-3"	8'-9"	27'-0"	3:12 MAX	CS12 x 4 x 0.102 (12 GA)	① S-5	⑬ S-11	HSS 12 x 6 x 1/4	② S-5	17'-5"
VC180	20 psf	18'-0"	8'-0"	10'-0"	27'-0"	3:12 MAX	CS14 x 4 x 0.102 (12 GA)	① S-5	⑬ S-11	HSS 12 x 6 x 1/4	② S-5	16'-6"
VC200	20 psf	20'-0"	6'-9"	13'-3"	19'-0"	3:12 MAX	CS14 x 4 x 0.124 (10 GA)	① S-5	⑬ S-11	HSS 12 x 6 x 1/4	② S-5	16'-9"

- NOTES:**
- MULTIPLE STRUCTURE ID'S MAY BE SELECTED WITHIN THE SAME SITE.
 - WHEN UTILIZING A STRUCTURE ID READ FROM WITHIN THAT ID ROW ONLY.
 - THE SHORT SPAN AND LONG SPANS MAY BE ADJUSTED WITH THE FOLLOWING REQUIREMENT:
THE OVERALL CANOPY WIDTH IS NOT EXCEEDED, NEITHER SPAN IS LESS THAN THE MIN SHORT SPAN & NEITHER SPAN EXCEEDS THE MAX LONG SPAN.

2 VC140, VC180 & VC200
- TYPICAL BEAM/COLUMN SCHEDULE

ENGINEER'S APPROVAL



DATE SIGNED
11/28/2018

SITE SPECIFIC
DSA APPROVAL

FILE NUMBER: PC-119
IDENTIFICATION STAMP
DIVISION OF THE STATE ARCHITECT
APP. NO: 04 - 117117 INCR
AC DF FL DS SS DP
DATE 12/05/2018

PRE-CHECK (PC) DOCUMENT
CODE: 2016 CBC
A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED

MBARC CONSTRUCTION INC.
IIC # 869960
R AND C51
PHONE: (760) 744-4131
FAX: (760) 744-4449
GREGJ@MBARCONLINE.COM | (775) 787-8845
674 RANCHEROS DR
SAN MARCOS, CA 92069
GREG JONES

4STEL ENGINEERING
STRUCTURAL ENGINEERING
PHONE: (949) 305-1150
FAX: (949) 305-1420
26030 ACHERO, SUITE 200
MISSION VIEJO, CA 92691

VERSA CANOPY
VC140, VC180 & VC200
FRAMING SCHEDULES

DRAWN GM
CHECKED KS
DATE 11/28/2018
4STEL JOB NO. MC03-01
SHEET

S-9

9 OF 13 SHEETS

NON-CONSTRAINED PIER FOUNDATION SCHEDULE

I.D. #	MAX GROUND SNOW LOAD	FOUNDATION LONGITUDINAL REINFORCEMENT	FOUNDATION DIAMETER (D)	MIN COLUMN EMBEDMENT (CE)	MAX TIE SPACING AT TOP (TS)	FOUNDATION DETAIL	PIER FOUNDATION MINIMUM DEPTH (SEE SOIL NOTES ON S-3)				
							SOIL CLASS V	SOIL CLASS W	SOIL CLASS X	SOIL CLASS Y	SOIL CLASS Z
VC14	0 psf	4 - #8	2'-0"	3'-6"	6"	(3)	14'-0"	11'-0"	9'-6"	8'-9"	7'-6"
VC18	0 psf	4 - #8	2'-0"	3'-6"	6"	(3)	14'-9"	11'-6"	10'-0"	9'-0"	8'-0"
VC20	0 psf	4 - #8	2'-6"	3'-6"	6"	(3)	15'-0"	11'-9"	10'-3"	9'-3"	8'-0"
VC140	20 psf	4 - #8	2'-0"	3'-6"	6"	(3)	15'-0"	11'-6"	9'-9"	8'-9"	7'-6"
VC180	20 psf	4 - #8	2'-0"	3'-6"	6"	(3)	15'-3"	11'-9"	10'-0"	9'-0"	7'-9"
VC200	20 psf	4 - #8	2'-0"	3'-6"	6"	(3)	15'-3"	12'-0"	10'-3"	9'-3"	8'-3"

- NOTES:**
- MULTIPLE STRUCTURE ID'S MAY BE SELECTED WITHIN THE SAME SITE.
 - WHEN UTILIZING A STRUCTURE ID READ FROM WITHIN THAT ID ROW ONLY.
 - SEE SOILS NOTES ON SHEET S-3 FOR INFORMATION ON SOILS CLASS SELECTION.
 - FOR SITUATIONS WHERE WATER MITIGATION IS NECESSARY, OR FOR OTHER CONDITIONS REQUIRING MITIGATION, REFER TO DETAIL 2/- FOR SLEEVED FOUNDATION OPTION.


1 PIER FOUNDATION SCHEDULE

SPREAD FOOTING SCHEDULE


I.D. #	MAX GROUND SNOW LOAD	FOUNDATION DETAIL	SPREAD FOOTING MINIMUM DIMENSIONS FOR SOIL CLASS V (SOILS NOTES S-3)
VC14	0 psf	(4)	9'-6" (SQ.) x 2'-6" DEEP
VC18	0 psf	(4)	10'-3" (SQ.) x 2'-6" DEEP
VC20	0 psf	(4)	10'-0" (SQ.) x 2'-6" DEEP
VC140	20 psf	(4)	9'-3" (SQ.) x 2'-6" DEEP
VC180	20 psf	(4)	10'-0" (SQ.) x 2'-6" DEEP
VC200	20 psf	(4)	9'-9" (SQ.) x 2'-6" DEEP

- NOTES:**
- MULTIPLE STRUCTURE ID'S MAY BE SELECTED WITHIN THE SAME SITE.
 - WHEN UTILIZING A STRUCTURE ID READ FROM WITHIN THAT ID ROW ONLY.
 - SEE SOILS NOTES ON SHEET S-3 FOR INFORMATION ON SOILS CLASS SELECTION.

2 SPREAD FOOTING SCHEDULE

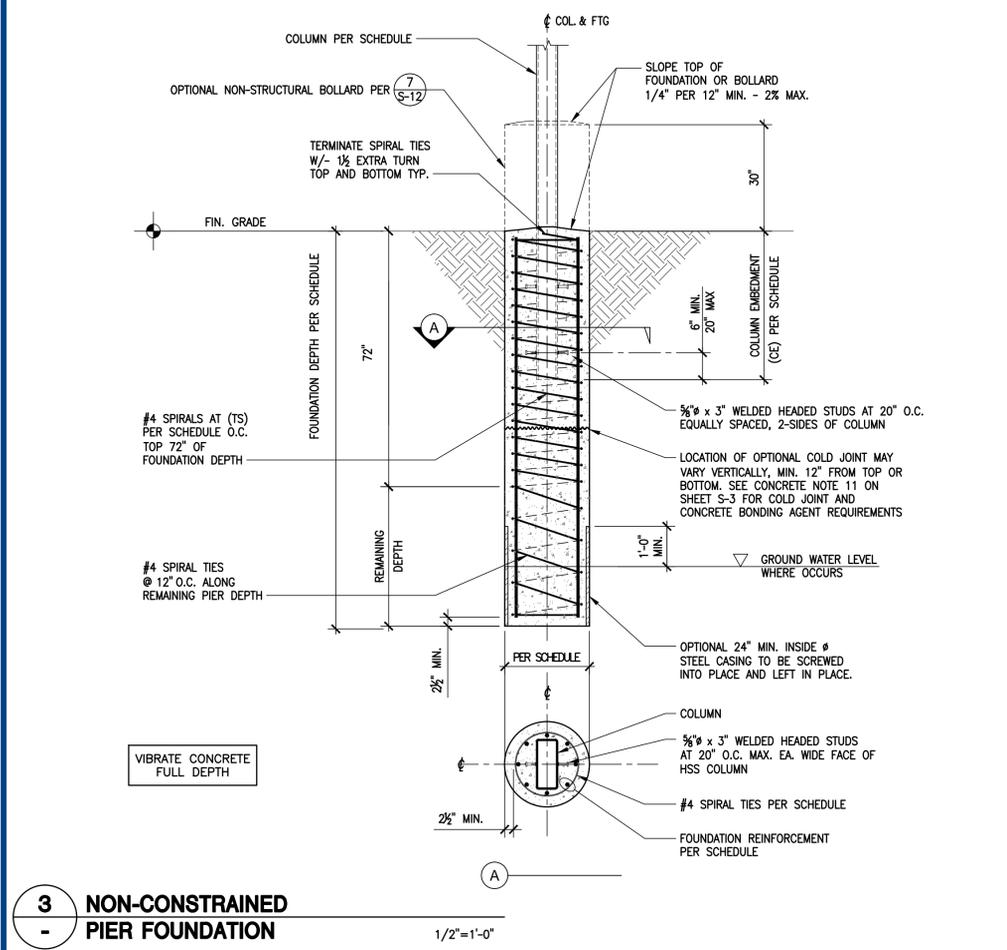

3 NON-CONSTRAINED PIER FOUNDATION

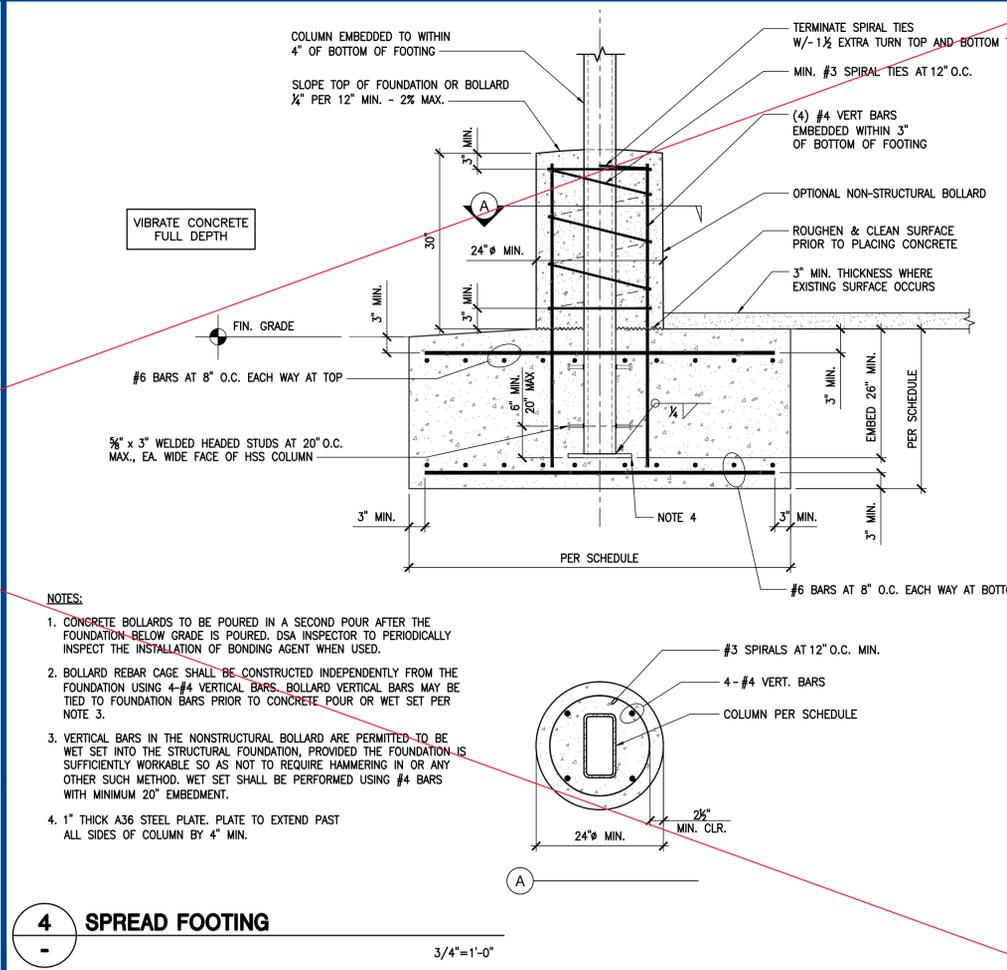

- NOTES:**
- CONCRETE BOLLARDS TO BE POURED IN A SECOND POUR AFTER THE FOUNDATION BELOW GRADE IS POURED. DSA INSPECTOR TO PERIODICALLY INSPECT THE INSTALLATION OF BONDING AGENT WHEN USED.
 - BOLLARD REBAR CAGE SHALL BE CONSTRUCTED INDEPENDENTLY FROM THE FOUNDATION USING 4-#4 VERTICAL BARS. BOLLARD VERTICAL BARS MAY BE TIED TO FOUNDATION BARS PRIOR TO CONCRETE POUR OR WET SET PER NOTE 3.
 - VERTICAL BARS IN THE NONSTRUCTURAL BOLLARD ARE PERMITTED TO BE WET SET INTO THE STRUCTURAL FOUNDATION, PROVIDED THE FOUNDATION IS SUFFICIENTLY WORKABLE SO AS NOT TO REQUIRE HAMMERING IN OR ANY OTHER SUCH METHOD. WET SET SHALL BE PERFORMED USING #4 BARS WITH MINIMUM 20" EMBEDMENT.
 - 1" THICK A36 STEEL PLATE. PLATE TO EXTEND PAST ALL SIDES OF COLUMN BY 4" MIN.

4 SPREAD FOOTING

ENGINEER'S APPROVAL

REGISTERED PROFESSIONAL ENGINEER
DAVID K. ROBERTSON
S 5885
STRUCTURAL
STATE OF CALIFORNIA

DATE SIGNED
11/28/2018

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 01-118968 INC.
REVIEWED FOR
SS FLS ACS
DATE: 06/12/2020

SITE SPECIFIC DSA APPROVAL

FILE NUMBER: PC-119
IDENTIFICATION STAMP
DIVISION OF THE STATE ARCHITECT
APP. NO. 04 - 117117 INCR
AC DF FL DS SS DP
DATE 12/05/2018


PRE-CHECK (PC) DOCUMENT
CODE: 2016 CBC
A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED

MBARC CONSTRUCTION INC.
7674 RANCHEROS DR
SAN MARCOS, CA 92069
PHONE: (760) 744-4131
FAX: (760) 744-4449
GREGJ@MBARCONLINE.COM (775) 787-8845


4STEL ENGINEERING STRUCTURAL ENGINEERING
26030 ACHERO, SUITE 200
MISSION VIEJO, CA 92691
PHONE: (949) 305-1150
FAX: (949) 305-1420

VERSA CANOPY FOUNDATION SCHEDULES



**DRAWN GM
CHECKED KS
DATE 11/28/2018
4STEL JOB NO. MC03-01
SHEET S-10
10 OF 13 SHEETS**

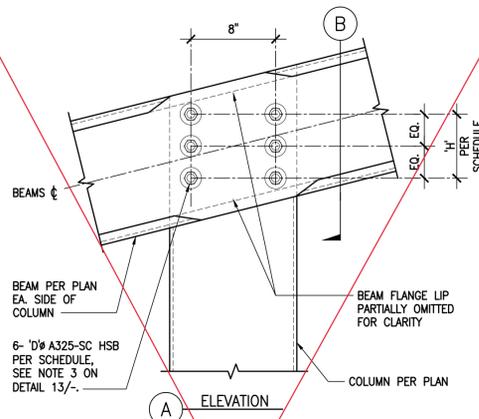

12 BEAM TO COLUMN - 6 BOLT
-
1-1/2"=1'-0"

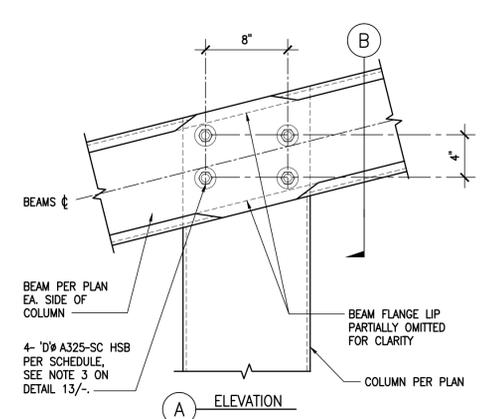


11 BEAM TO COLUMN - 4 BOLT
-
1-1/2"=1'-0"

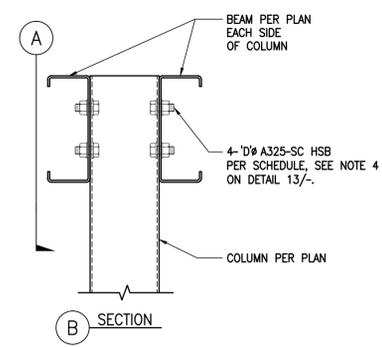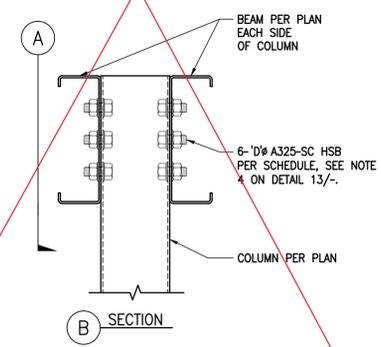


BEAM TO COLUMN CONNECTION SCHEDULE					
I.D. #	MAX GROUND SNOW LOAD	# OF BOLTS (n)	BOLTED CONNECTION DETAIL	BOLT DIAMETER (D) ASTM A325-SC	BOLT PATTERN (B x H)
VC14	0 psf	4	11	1"	8" x 6"
VC18	0 psf	6	12	7/8"	8" x 6"
VC20	0 psf	6	12	7/8"	8" x 8"
VC140	20 psf	4	11	1"	8" x 6"
VC180	20 psf	6	12	3/4"	8" x 8"
VC200	20 psf	6	12	7/8"	8" x 8"

NOTES:
 1. MULTIPLE STRUCTURE ID'S MAY BE SELECTED WITHIN THE SAME SITE.
 2. WHEN UTILIZING A STRUCTURE ID READ FROM WITHIN THAT ID ROW ONLY.
 3. BOLTS SHALL BE PRETENSIONED A325-SC (SLIP-CRITICAL) TYPE N (THREADS NOT EXCLUDED FROM SHEAR PLANE) CLASS A FAYING SURFACE WITH STANDARD NUTS PER ASTM A563 AND WASHERS PER ASTM F436 TYPICAL U.N.O.
 4. BOLTS, NUTS AND WASHERS SHALL BE GALVANIZED.


13 BEAM TO COLUMN SCHEDULE
-
N.T.S.

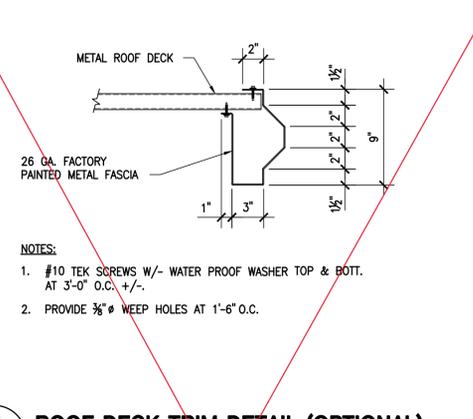



7 ROOF DECK TRIM DETAIL (OPTIONAL)
-
3"=1'-0"

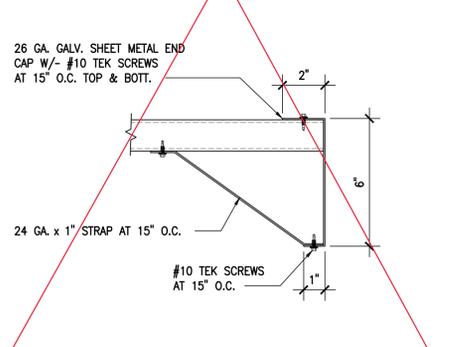


8 ROOF DECK TRIM DETAIL (OPTIONAL)
-
1-1/2"=1'-0"

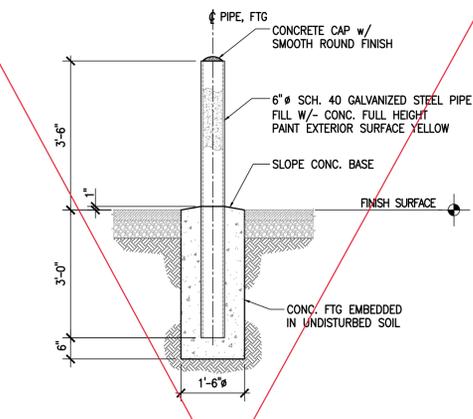


10 TYPICAL BOLLARD
-
1/2"=1'-0"

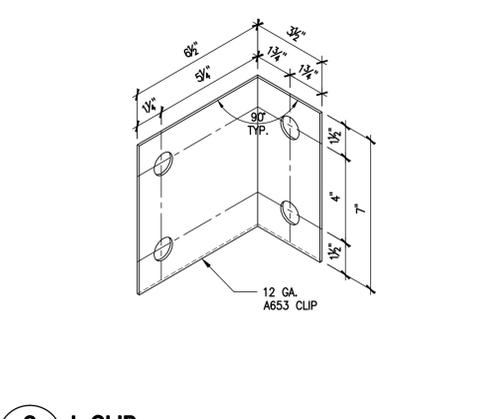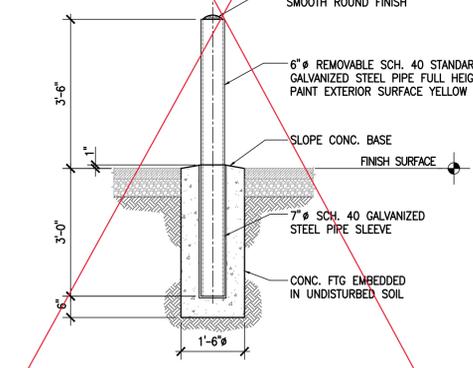


3 L-CLIP INTERIOR PURLIN TO BEAM
-
3"=1'-0"

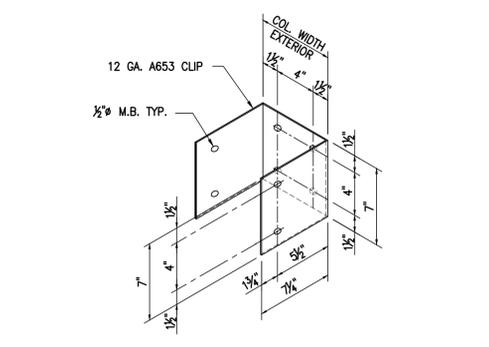


4 U-CLIP EXTERIOR PURLIN TO BEAM
-
1-1/2"=1'-0"

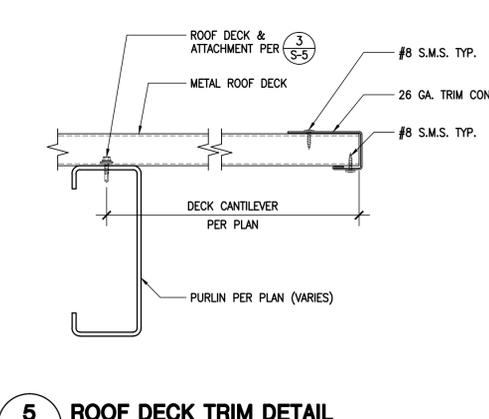


5 ROOF DECK TRIM DETAIL
-
3"=1'-0"

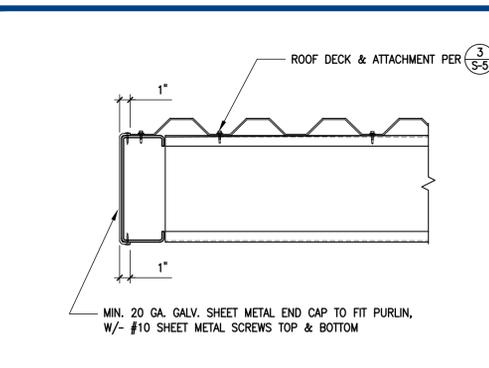


6 END ENCLOSURE DETAIL
-
1-1/2"=1'-0"

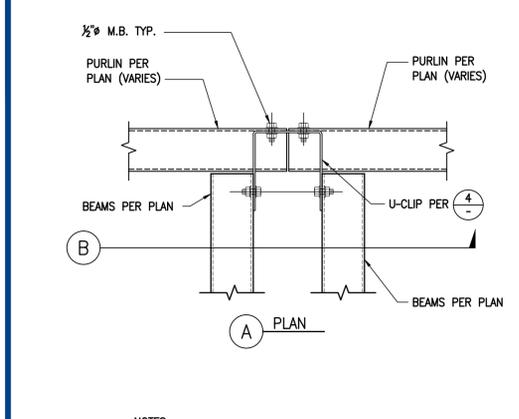


1 EXTERIOR PURLIN TO BEAM
-
1-1/2"=1'-0"

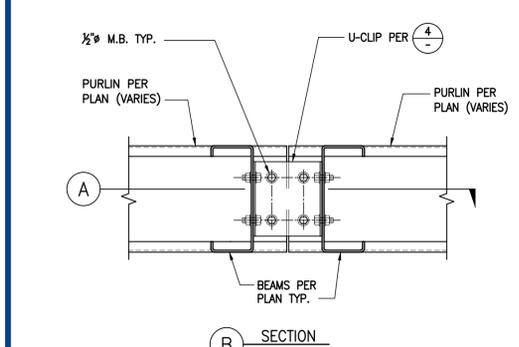

1 EXTERIOR PURLIN TO BEAM
-
1-1/2"=1'-0"

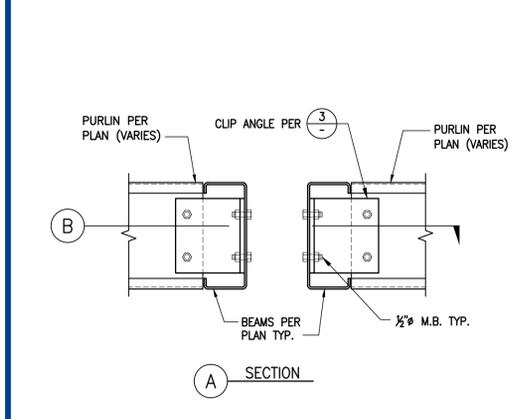

2 INTERIOR PURLIN TO BEAM
-
1-1/2"=1'-0"

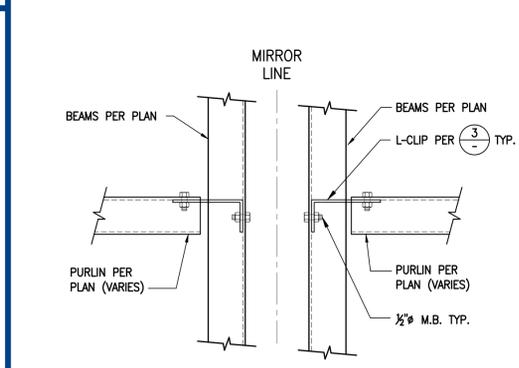

2 INTERIOR PURLIN TO BEAM
-
1-1/2"=1'-0"

ENGINEER'S APPROVAL
 REGISTERED PROFESSIONAL ENGINEER
 DUSTIN K. ROSENFELD
 S 5885
 STRUCTURAL
 STATE OF CALIFORNIA
 DATE SIGNED
 11/28/2018
 IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP: 01-118968 INC.
 REVIEWED FOR
 SS FLS ACS
 DATE: 06/12/2020

SITE SPECIFIC DSA APPROVAL

FILE NUMBER: PC-119
 IDENTIFICATION STAMP
 DIVISION OF THE STATE ARCHITECT
 APP. NO: 04 - 117117 INCR
 AC DF FLS DS SS DP
 DATE 12/05/2018
 PRE-CHECK (PC) DOCUMENT
 CODE: 2016 CBC
 A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED

MBARC CONSTRUCTION INC.
 674 RANCHEROS DR
 SAN MARCOS, CA 92069
 PHONE: (760) 744-4131
 FAX: (760) 744-4449
 GREGJ@MBARCONLINE.COM (775) 787-8845
 IIC # 869980
 B AND C 51


4STEL ENGINEERING
 STRUCTURAL ENGINEERING
 26030 ACHERO, SUITE 200
 MISSION VIEJO, CA 92691
 PHONE: (949) 305-1150
 FAX: (949) 305-1420

VERSA CANOPY STANDARD DETAILS 1

DRAWN GM
 CHECKED KS
 DATE 11/28/2018
 4STEL JOB NO. MC03-01
 SHEET S-11
 11 OF 13 SHEETS


NOTES:

1. CONCRETE BOLLARDS TO BE POURED IN A SECOND POUR AFTER THE FOUNDATION BELOW GRADE IS POURED. DSA INSPECTOR TO PERIODICALLY INSPECT THE INSTALLATION OF BONDING AGENT WHEN USED.
2. BOLLARD REBAR CAGE SHALL BE CONSTRUCTED INDEPENDENTLY FROM THE FOUNDATION USING 4-#4 VERTICAL BARS UNLESS WET SET IS PERFORMED PER NOTE 3 OR CONTINUOUS FOUNDATION BARS ARE USED PER NOTE 4.
3. VERTICAL BARS IN THE NONSTRUCTURAL BOLLARD ARE PERMITTED TO BE WET SET INTO THE STRUCTURAL FOUNDATION, PROVIDED THE FOUNDATION IS SUFFICIENTLY WORKABLE SO AS NOT TO REQUIRE HAMMERING IN OR ANY OTHER SUCH METHOD. WET SET SHALL BE PERFORMED USING #4 BARS WITH MINIMUM 20" EMBEDMENT.
4. BOLLARD REINFORCING IS PERMITTED TO USE MIN. (4) FOUNDATION VERT. BARS CONTINUOUS TO 3" BELOW TOP OF BOLLARD IN LIEU OF 4-#4 BARS.

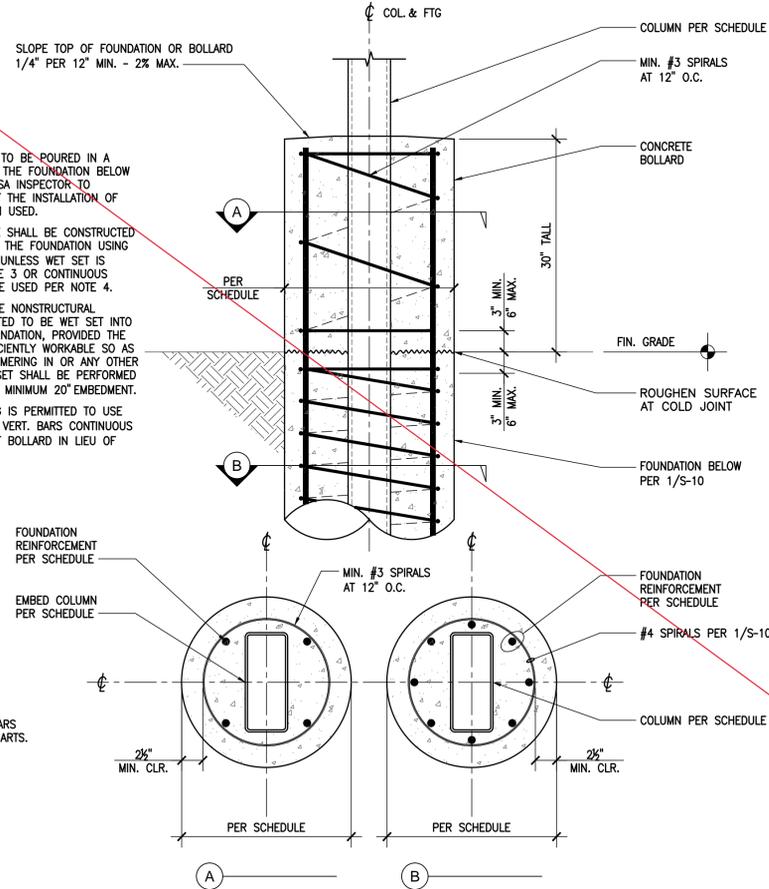

7 OPTIONAL CONCRETE BOLLARD


1"=1'-0"

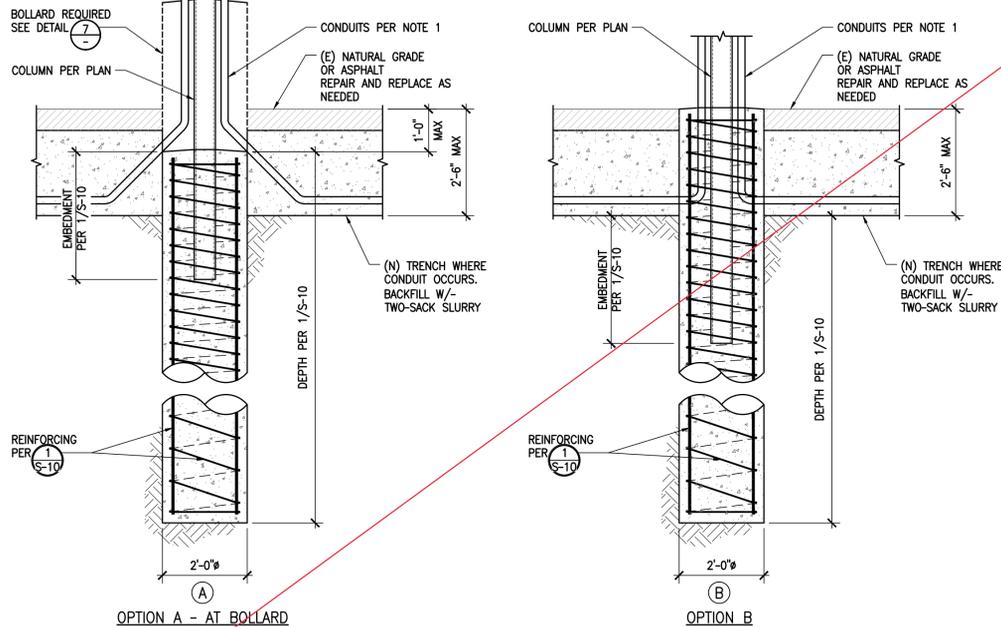

8 CONDUIT AT DRILLED PIER


1"=1'-0"

- NOTE:**
1. CONDUIT IN FOUNDATION SHALL NOT EXCEED (1) 2" MAX Ø CONDUIT OR (2) 1 1/2" MAX Ø CONDUIT. WHEN (2) CONDUIT ARE USED IN THE SAME FOUNDATION, THE CONDUIT MAY ENTER THE FOUNDATION FROM EITHER SIDE.
 2. CONDUIT TRENCH SHALL BE FILLED WITH MIN 2-SACK SLURRY.

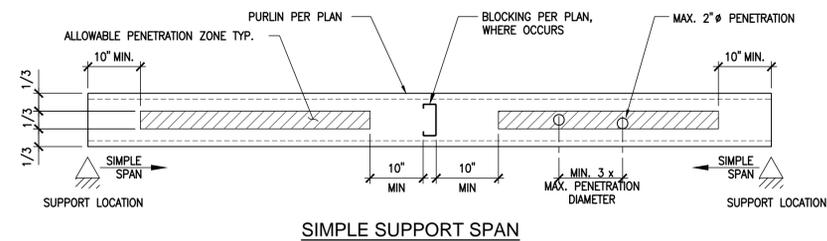


4 ALLOWABLE PURLIN PENETRATIONS

3/4"=1'-0"

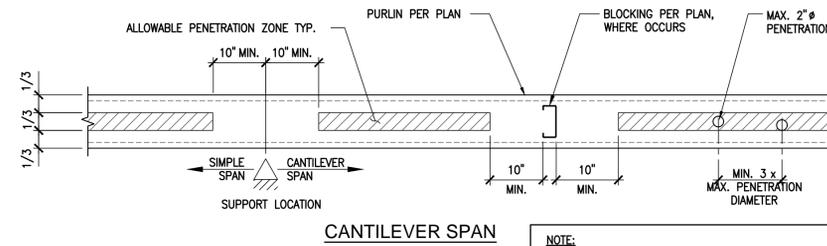


CANTILEVER SPAN

- NOTE:**
- IF MORE THAN 5 PENETRATIONS PER SPAN ARE NEEDED, CONTRACTOR TO SUBMIT AN RFI TO DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE TO ENSURE REQUIREMENTS OF THIS DETAIL ARE MET AND TO JUSTIFY THE QUANTITY OF PENETRATIONS NEEDED.

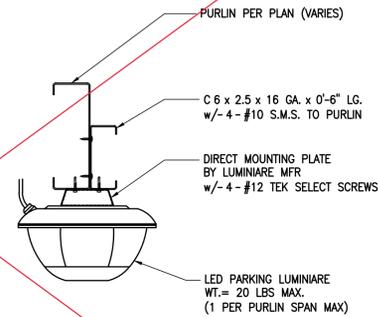


5 TYPICAL PARKING LUMINAIRE AT PURLIN

1 1/2"=1'-0"

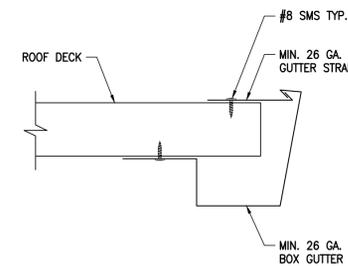


6 GUTTER DETAIL

3"=1'-0"

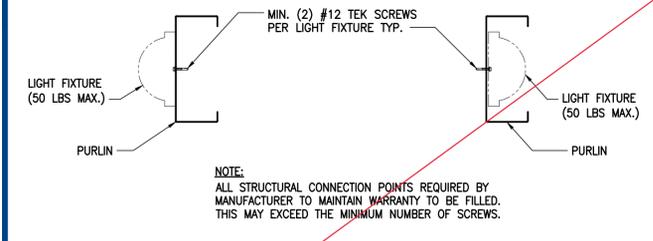


1 LIGHT INSTALLATION OPTIONS

1-1/2"=1'-0"

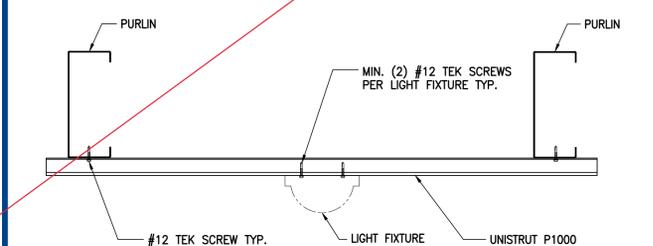

2 ALTERNATE LIGHT INSTALLATION OPTIONS


1-1/2"=1'-0"

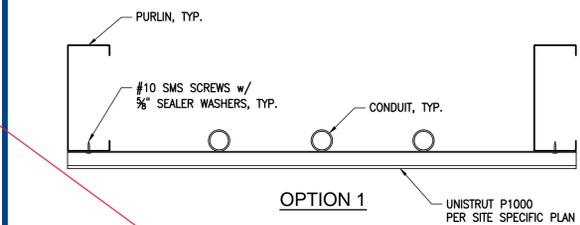

OPTION 2

3 CONDUIT SUPPORT/ LOCATION OPTIONS

OPTION 3

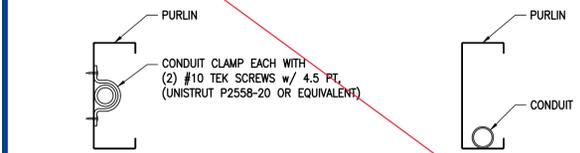

1-1/2"=1'-0"

ENGINEER'S APPROVAL



DATE SIGNED
11/28/2018

SITE SPECIFIC
DSA APPROVAL

FILE NUMBER: PC-119
IDENTIFICATION STAMP
DIVISION OF THE STATE ARCHITECT
APP. NO: 04 - 117117 INCR
AC DF FL DS SS DP
DATE 12/05/2018

PRE-CHECK (PC) DOCUMENT
CODE: 2016 CBC
A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED

MBARC CONSTRUCTION INC.
IIC # 869980
PHONE: (760) 744-4131
SAN MARCOS, CA 92069
FAX: (760) 744-4449
GREGJ@MBARCONLINE.COM (775) 787-8845
GREG JONES















4STEL ENGINEERING
STRUCTURAL ENGINEERING
PHONE: (949) 305-1150
26030 ACHERO, SUITE 200
MISSION VIEJO, CA 92691
FAX: (949) 305-1420

VERSA CANOPY
STANDARD DETAILS 2

DRAWN
GM
CHECKED
KS
DATE
11/28/2018
4STEL JOB NO.
MC03-01
SHEET

S-12

12 OF 13 SHEETS

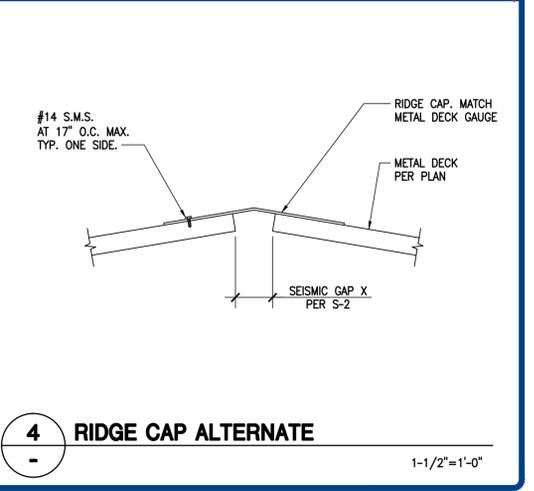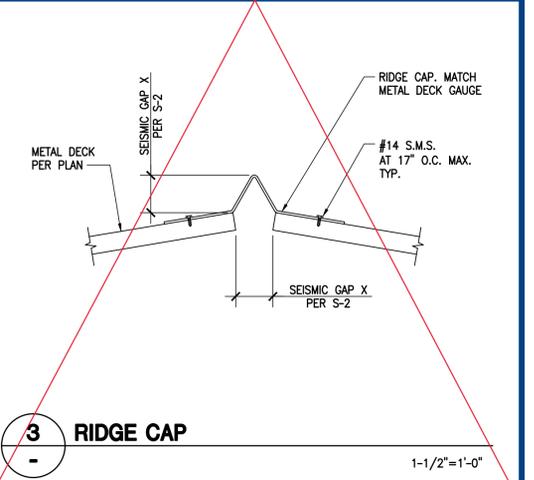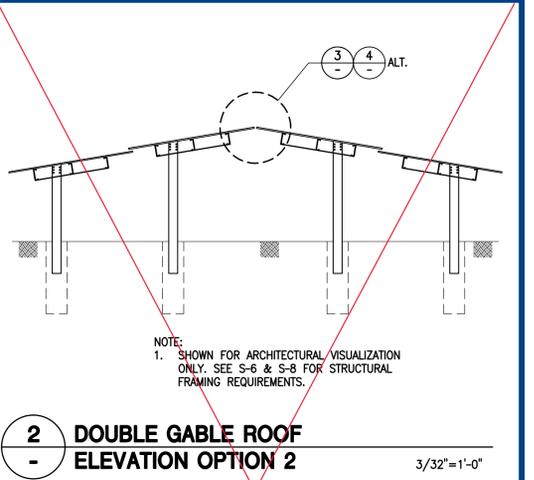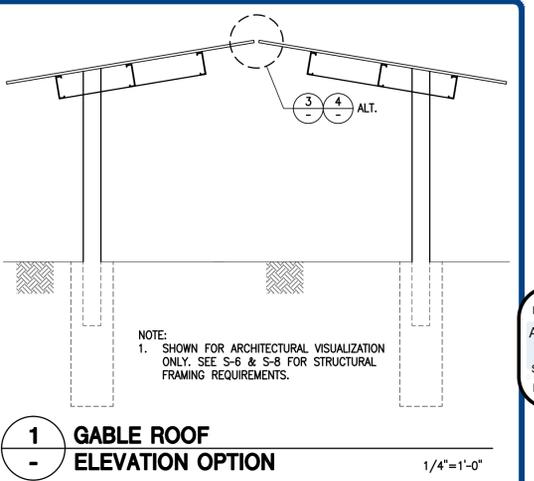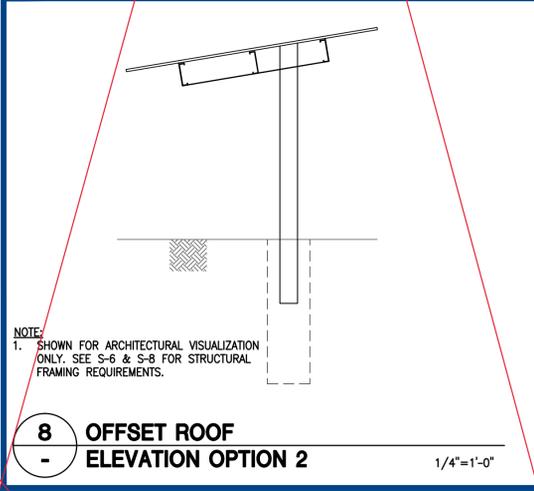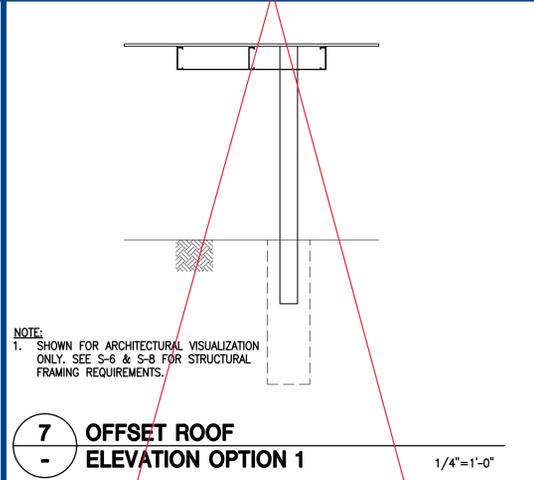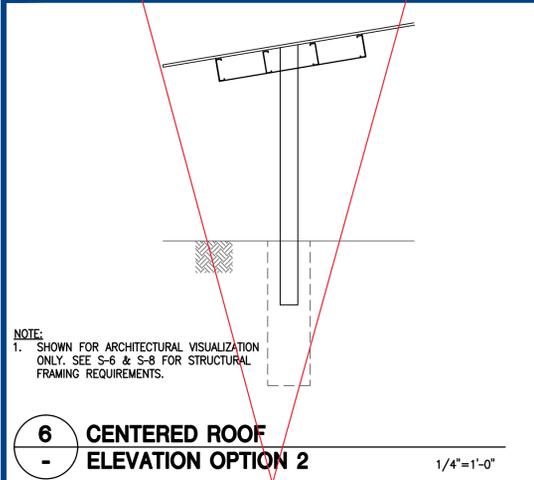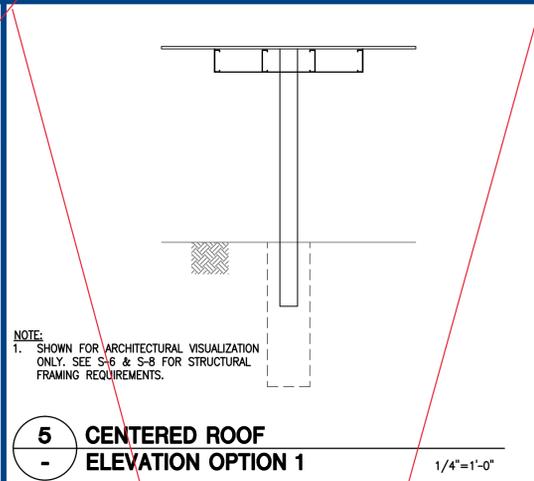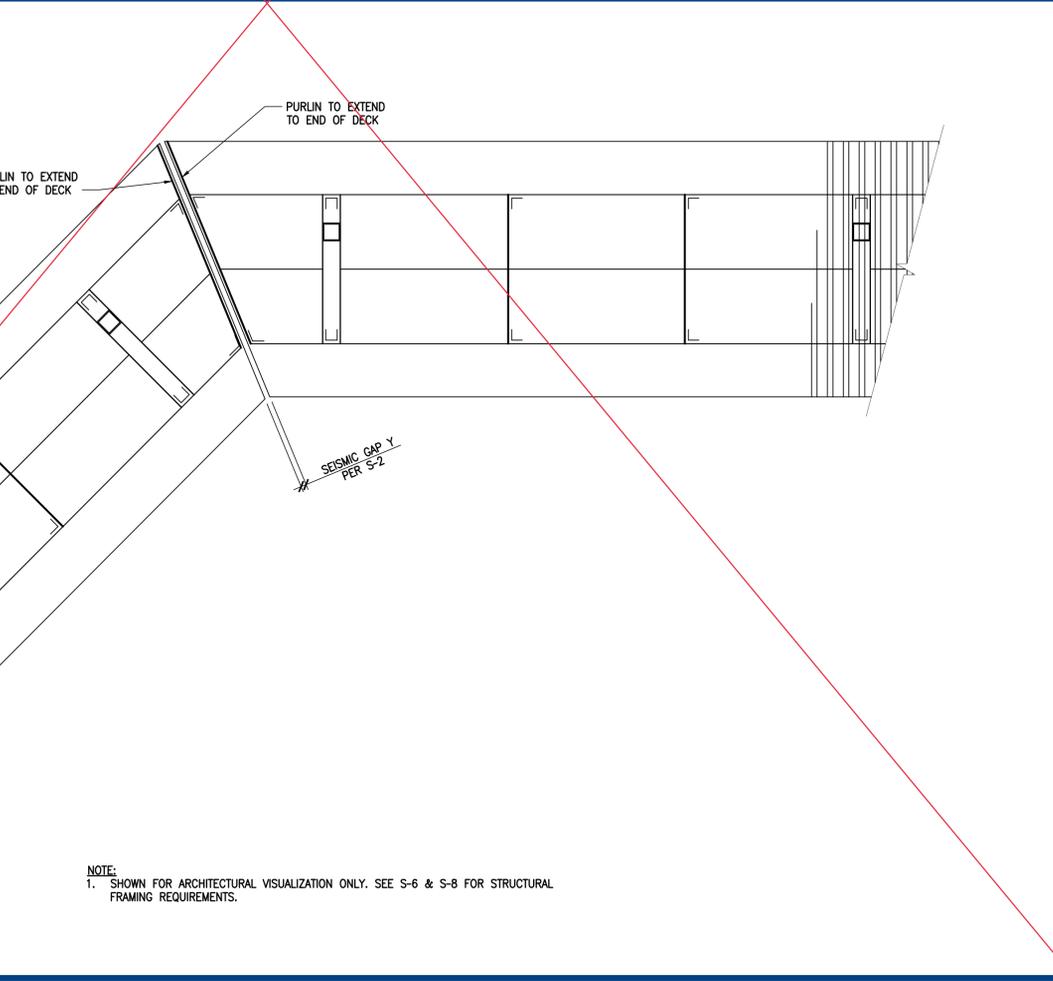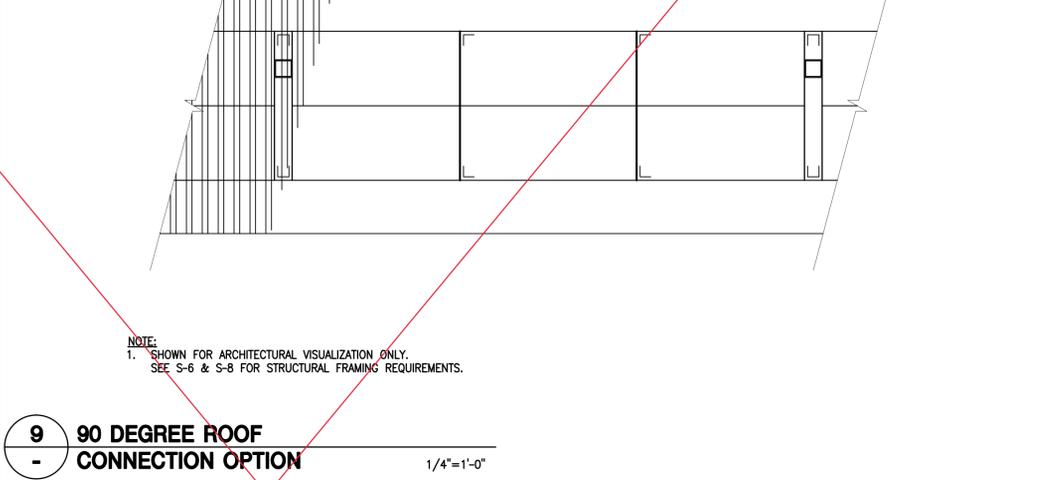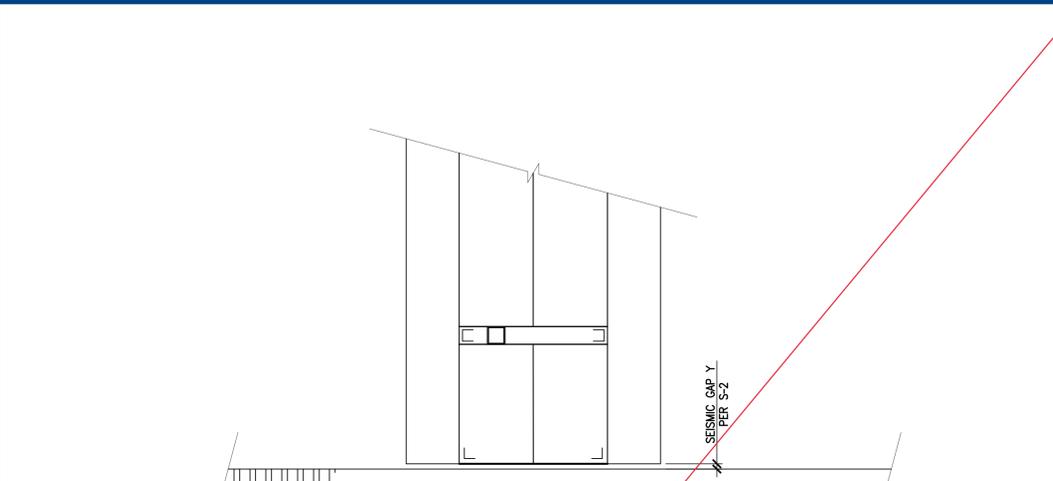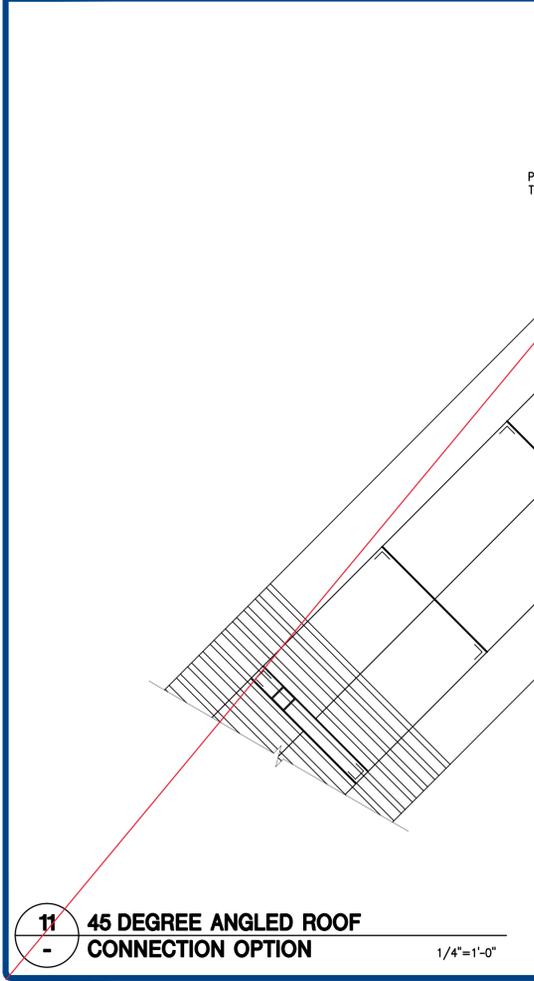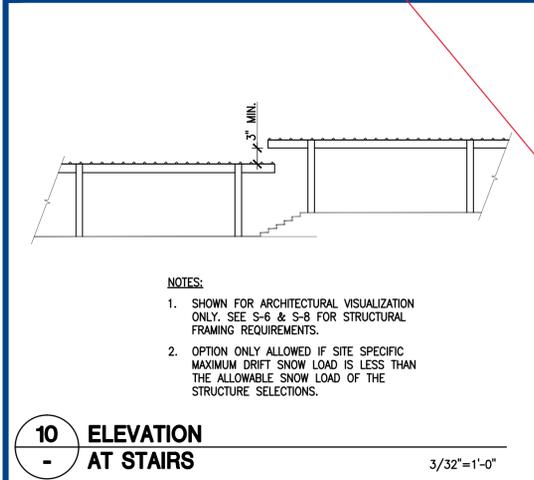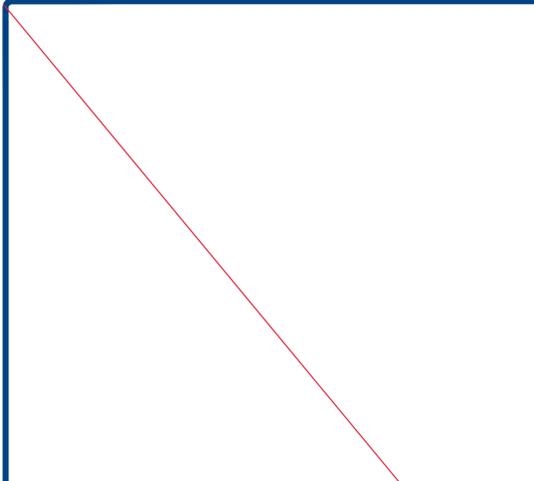

ENGINEER'S APPROVAL
 REGISTERED PROFESSIONAL ENGINEER
 DUSTIN K. ROSENTHAL
 S 5885
 STRUCTURAL ENGINEER
 STATE OF CALIFORNIA

DATE SIGNED
 11/28/2018

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP: 01-118968 INC.
 REVIEWED FOR
 SS FLS ACS
 DATE: 06/12/2020

SITE SPECIFIC
 DSA APPROVAL

FILE NUMBER: PC-119
 IDENTIFICATION STAMP
 DIVISION OF THE STATE ARCHITECT
 APP. NO: 04 - 117117 INCR
 AC DF FL DS SS DP
 DATE 12/05/2018
 PRE-CHECK (PC) DOCUMENT
 CODE: 2016 CBC
 A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED

MBARC CONSTRUCTION INC.
 IIC # 869960
 B AND C 51
 GREGJ@MBARCONLINE.COM (775) 787-8845
 PHONE: (760) 744-4131
 FAX: (760) 744-4449
 674 RANCHEROS DR
 SAN MARCOS, CA
 GREG JONES

4STEL ENGINEERING
 STRUCTURAL ENGINEERING
 PHONE: (949) 305-1150
 26030 ACHERO, SUITE 200
 MISSION VIEJO, CA 92691
 FAX: (949) 305-1420

VERSA CANOPY
 STANDARD DETAILS 3

DRAWN GM
 CHECKED KS
 DATE 11/28/2018
 4STEL JOB NO. MC03-01
 SHEET S-13
 13 OF 13 SHEETS

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS

Application Number: 01-118968

School Name: Ruskin Elementary School

School District: Berryessa Union School District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/14/2020

IMPORTANT: This form is only a summary list of structural tests and some of the special inspections required for the project. Generally, the structural tests and special inspections noted on this form are those that will be performed by the Geotechnical Engineer of Record, Laboratory of Record, or Special Inspector. The actual complete test and inspection program must be performed as detailed on the DSA approved documents. The appendix at the bottom of this form identifies work NOT subject to DSA requirements for special inspection or structural testing. The project inspector is responsible for providing inspection of all facets of construction, including but not limited to, special inspections not listed on this form such as structural wood framing, high-load wood diaphragms, cold-formed steel framing, anchorage of non-structural components, etc., per Title 24, Part 2, Chapter 17A.

KEY TO COLUMNS

1. TYPE	2. PERFORMED BY
<p>Continuous – Indicates that a continuous special inspection is required</p> <p>Periodic – Indicates that a periodic special inspection is required</p> <p>Test – Indicates that a test is required</p>	<p>GE – Indicates that the special inspection shall be performed by a registered geotechnical engineer or his or her authorized representative.</p> <p>LOR – Indicates that the test or special inspection shall be performed by a testing laboratory accepted in the DSA Laboratory Evaluation and Acceptance (LEA) Program. See CAC Section 4-335.</p> <p>PI – Indicates that the special inspection may be performed by a project inspector when specifically approved by DSA.</p> <p>SI – Indicates that the special inspection shall be performed by an appropriately qualified/approved special inspector.</p>

****NOTE:** Undefined section and table references found in this document are from the CBC, or California Building Code.

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (SOILS)

Application Number: 01-118968

School Name: Ruskin Elementary School

School District: Berryessa Union School District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/14/2020

Geotechnical Reports: Project does NOT have and does NOT require a geotechnical report

1. GENERAL:		Table 1705A.6		
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/>	a. Verify that: <ul style="list-style-type: none"> • Site has been prepared properly prior to placement of controlled fill and/or excavations for foundations. • Foundation excavations are extended to proper depth and have reached proper material. • Materials below footings are adequate to achieve the design bearing capacity. 	See Notes	PI	Refer to specific items identified in the Appendix listing exemptions for limitations. Placement of controlled fill exceeding 12" depth under foundations is not permitted without a geotechnical report.

2. SOIL COMPACTION AND FILL:		Table 1705A.6		
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>	a. Verify use of proper materials, densities and inspect lift thicknesses, placement and compaction during placement of fill.	Continuous	LOR*	* Under the supervision of a geotechnical engineer or LOR's engineering manager. Refer to specific items identified in the Appendix listing exemptions for limitations.
<input type="checkbox"/>	b. Compaction testing.	Test	LOR*	* Under the supervision of a geotechnical engineer or LOR's engineering manager. Refer to specific items identified in the Appendix listing exemptions for limitations.

3. DRIVEN DEEP FOUNDATIONS (PILES):		Table 1705A.7		
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>	a. Verify pile materials, sizes and lengths comply with the requirements.	Continuous	GE*	* By geotechnical engineer or his or her qualified representative.

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (SOILS)

Application Number: 01-118968

School Name: Ruskin Elementary School

School District: Berryessa Union School District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/14/2020

<input type="checkbox"/>	b. Determine capacities of test piles and conduct additional load tests as required.	Test	LOR*	* Under the supervision of the geotechnical engineer.
<input type="checkbox"/>	c. Inspect driving operations and maintain complete and accurate records for each pile.	Continuous	GE*	* By geotechnical engineer or his or her qualified representative.
<input type="checkbox"/>	d. Verify locations of piles and their plumbness, confirm type and size of hammer, record number of blows per foot of penetration, determine required penetrations to achieve design capacity, record tip and butt elevations and record any pile damage.	Continuous	GE*	* By geotechnical engineer or his or her qualified representative.

	3. DRIVEN DEEP FOUNDATIONS (PILES):	Table 1705A.7		
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>	e. Steel piles.			Provide tests and inspections per STEEL section below.
<input type="checkbox"/>	f. Concrete piles and concrete filled piles.			Provide tests and inspections per CONCRETE section below.
<input type="checkbox"/>	g. For specialty piles, perform additional inspections as determined by the registered design professional in responsible charge.	*	*	* As defined on drawings or specifications.

	4. CAST-IN-PLACE DEEP FOUNDATIONS (PIERS):	Table 1705A.8		
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/>	a. Inspect drilling operations and maintain complete and accurate records for each pier.	Continuous	PI	Continuous inspection to be provided by project inspector. Refer to specific items identified in the Appendix listing exemptions for limitations.
<input checked="" type="checkbox"/>	b. Verify pier locations, diameters, plumbness and lengths. Record concrete or grout volumes.	Continuous	PI	Continuous inspection to be provided by project inspector. Refer to specific items identified in the Appendix listing exemptions for limitations.
<input checked="" type="checkbox"/>	c. Concrete piers.			Provide tests and inspections per CONCRETE section below.

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (SOILS)

Application Number: 01-118968

School Name: Ruskin Elementary School

School District: Berryessa Union School District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/14/2020

5. RETAINING WALLS:				
<input type="checkbox"/>	a. Segmental retaining walls; inspect placement of units, dowels, connectors, etc.	Continuous	GE*	* By geotechnical engineer or his or her qualified representative. See DSA IR 16-3.
<input type="checkbox"/>	b. Placement of soil reinforcement, drainage devices and/or backfill.	Continuous	GE*	Placement, compaction and inspection of backfill per Section 1705A.6.1 for fills supporting foundations (Section 2 above). * By geotechnical engineer or his or her qualified representative.
<input type="checkbox"/>	c. Concrete retaining walls.	Provide tests and inspections per CONCRETE section below.		
<input type="checkbox"/>	d. Masonry retaining walls.	Provide tests and inspections per MASONRY section below.		

6. OTHER SOILS:				
<input type="checkbox"/>	a. Soil Improvements	Test	GE*	Submit a comprehensive report documenting final soil improvements constructed, construction observation and the results of the confirmation testing and analysis to CGS for final acceptance. * By geotechnical engineer or his or her qualified representative.
<input type="checkbox"/>	b. Inspection of Soil Improvements	Continuous	GE*	* By geotechnical engineer or his or her qualified representative.
<input type="checkbox"/>				

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (Concrete)

Table 1705A.3; ACI 318-14 Sections 26.12 & 26.13

Application Number: 01-118968 **School Name:** Ruskin Elementary School **School District:** Berryessa Union School District
DSA File Number: 43-7 **Increment Number:** N/A **Date Submitted:** 04/14/2020

7. CAST-IN-PLACE CONCRETE				
Material Verification and Testing:				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/>	a. Verify use of required design mix.	Periodic	SI	Table 1705A.3 Item 5, 1910A.1.
<input checked="" type="checkbox"/>	b. Identify, sample, and test reinforcing steel.	Test	LOR	1910A.2; ACI 318-14 Section 26.6.1.2; DSA IR 17-10. (See Appendix for exemptions.)
<input checked="" type="checkbox"/>	c. During concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.	Test	LOR	Table 1705A.3 Item 6; ACI 318-14 Sections 26.5 & 26.12.
<input checked="" type="checkbox"/>	d. Test concrete (f_c).	Test	LOR	1905A.1.15; ACI 318-14 Section 26.12.
Inspection:				
<input type="checkbox"/>	e. Batch plant inspection: Continuous	See Notes	SI	Default of ' Continuous ' per 1705A.3.3. If approved by DSA, batch plant inspection may be reduced to ' Periodic ' subject to requirements in Section 1705A.3.3.1, or eliminated per 1705A.3.3.2. (See Appendix for exemptions.)
<input checked="" type="checkbox"/>	f. Welding of reinforcing steel.	Provide special inspection per STEEL, Category 19.1(d) & (e) and/or 19.2(g) & (h) below.		

8. PRESTRESSED / POST-TENSIONED CONCRETE (in addition to Cast-in-Place Concrete tests and inspections):				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>	a. Sample and test prestressing tendons and anchorages.	Test	LOR	1705A.3.4, 1910A.3
<input type="checkbox"/>	b. Inspect placement of prestressing tendons.	Periodic	SI	1705A.3.4, Table 1705A.3 Items 1 & 9.

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (Concrete)

Table 1705A.3; ACI 318-14 Sections 26.12 & 26.13

Application Number: 01-118968	School Name: Ruskin Elementary School	School District: Berryessa Union School District
DSA File Number: 43-7	Increment Number: N/A	Date Submitted: 04/14/2020

<input type="checkbox"/>	c. Verify in-situ concrete strength prior to stressing of post-tensioning tendons.	Periodic	SI	Table 1705A.3 Item 11. Special inspector to verify specified concrete strength test prior to stressing.
<input type="checkbox"/>	d. Inspect application of post-tensioning or prestressing forces and grouting of bonded prestressing tendons.	Continuous	SI	1705A.3.4, Table 1705A.3 Item 9; ACI 318-14 Section 26.13

9. PRECAST CONCRETE (in addition to Cast-in-Place Concrete tests and inspections):

	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>	a. Inspect fabrication of precast concrete members.	Continuous	SI	ACI 318-14 Section 26.13.
<input type="checkbox"/>	b. Inspect erection of precast concrete members.	Periodic	SI*	Table 1705A.3 Item 10. * May be performed by PI when specifically approved by DSA.

10. SHOTCRETE (in addition to Cast-in-Place Concrete tests and inspections):

	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>	a. Inspect shotcrete placement for proper application techniques.	Continuous	SI	1705A.19, Table 1705A.3 Item 7, 1908A.6, 1908A.7, 1908A.8, 1908A.9, 1908A.11, 1908A.12. See ACI 506.2-13 Section 3.4, ACI 506R-16.
<input type="checkbox"/>	b. Sample and test shotcrete (f'_c).	Test	LOR	1908A.5, 1908A.10.

11. POST-INSTALLED ANCHORS:

	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>	a. Inspect installation of post-installed anchors	See Notes	SI*	1617A.1.19, Table 1705A.3 Item 4a (Continuous) & 4b (Periodic), 1705A.3.8 (See Appendix for exemptions). ACI 318-14

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (Concrete)

Table 1705A.3; ACI 318-14 Sections 26.12 & 26.13

Application Number: 01-118968	School Name: Ruskin Elementary School	School District: Berryessa Union School District
DSA File Number: 43-7	Increment Number: N/A	Date Submitted: 04/14/2020

				Sections 17.8 & 26.13. * May be performed by the project inspector when specifically approved by DSA.
<input type="checkbox"/>	b. Test post-installed anchors.	Test	LOR	1910A.5. (See Appendix for exemptions.)

12. OTHER CONCRETE:				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>				

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (Steel and Aluminum)

1705A.2.1, Table 1705A.2.1; AISC 303-16, AISC 341-16, AISC 358-16, AISC 360-16; AISI S100-16

Application Number: 01-118968

School Name: Ruskin Elementary School

School District: Berryessa Union School

District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/14/2020

17. STRUCTURAL STEEL, COLD-FORMED STEEL AND ALUMINUM USED FOR STRUCTURAL PURPOSES				
Material Verification and Testing:				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/>	a. Verify identification of all materials and: <ul style="list-style-type: none"> • Mill certificates indicate material properties that comply with requirements. • Material sizes, types and grades comply with requirements. 	Periodic	*	Table 1705A.2.1 Item 3a–3c. 2202A.1; AISI S100-16 Section A3.1 & A3.2, AISI S240-15 Section A3 & A5, AISI S220-15 Sections A4 & A6. * By special inspector or qualified technician when performed off-site.
<input checked="" type="checkbox"/>	b. Test unidentified materials	Test	LOR	2202A.1.
<input checked="" type="checkbox"/>	c. Examine seam welds of HSS shapes	Periodic	SI	DSA IR 17-3.
Inspection:				
<input checked="" type="checkbox"/>	d. Verify and document steel fabrication per DSA-approved construction documents.	Periodic	SI	Not applicable to cold-formed steel light-frame construction, except for trusses (1705A.2.4).

18. HIGH-STRENGTH BOLTS: RCSC 2014				
Material Verification and Testing of High-Strength Bolts, Nuts and Washers:				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/>	a. Verify identification markings and manufacturer's certificates of compliance conform to ASTM standards specified in the DSA-approved documents.	Periodic	SI	Table 1705A.2.1 Items 1a & 1b, 2202A.1; AISC 360-16 Section A3.3, J3.1, and N3.2; RCSC 2014 Section 1.5 & 2.1; DSA IR 17-8 & DSA IR 17-9.
<input checked="" type="checkbox"/>	b. Test high-strength bolts, nuts and washers.	Test	LOR	Table 1705A.2.1 Item 1c, 2213A.1; RCSC 2014 Section 7.2; DSA IR 17-8.
Inspection of High-Strength Bolt Installation:				

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (Steel and Aluminum)

1705A.2.1, Table 1705A.2.1; AISC 303-16, AISC 341-16, AISC 358-16, AISC 360-16; AISI S100-16

Application Number: 01-118968

School Name: Ruskin Elementary School

School District: Berryessa Union School

District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/14/2020

<input type="checkbox"/>	c. Bearing-type ("snug tight") connections.	Periodic	SI	Table 1705A.2.1 Item 2a, 1705A.2.6, 2204A.2; AISC 360-16 J3.1, J3.2, M2.5 & N5.6; RCSC 2014 Section 9.1; DSA IR 17-9.
<input checked="" type="checkbox"/>	d. Pretensioned and slip-critical connections.	*	SI	Table 1705A.2.1 Items 2b & 2c, 1705A.2.6, 2204A.2; AISC 360-16 J3.1, J3.2, M2.5 & N5.6; RCSC 2014 Sections 9.2 & 9.3; DSA IR 17-9. * "Continuous" or "Periodic" depends on the tightening method used.

19. WELDING:	1705A.2.5, Table 1705A.2.1 Items 4 & 5; AWS D1.1 and AWS D1.8 for structural steel; AWS D1.2 for Aluminum; AWS D1.3 for cold-formed steel; AWS D1.4 for reinforcing steel; DSA IR 17-3 (See Appendix for exemptions.)
---------------------	--

Verification of Materials, Equipment, Welders, etc.:

	Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/>	a. Verify weld filler material identification markings per AWS designation listed on the DSA-approved documents and the WPS.	Periodic	SI	DSA IR 17-3.
<input checked="" type="checkbox"/>	b. Verify weld filler material manufacturer's certificate of compliance.	Periodic	SI	DSA IR 17-3.
<input checked="" type="checkbox"/>	c. Verify WPS, welder qualifications and equipment.	Periodic	SI	DSA IR 17-3.

19.1 SHOP WELDING:

	Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/>	a. Inspect groove welds, multi-pass fillet welds, single pass fillet welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Items 5a.1-4; AISC 360-16 (and AISC 341-16 as applicable); DSA IR 17-3.
<input checked="" type="checkbox"/>	b. Inspect single-pass fillet welds ≤ 5/16", floor and roof deck welds.	Periodic	SI	1705A.2.2, Table 1705A.2.1 Items 5a.5 & 5a.6; AISC 360-16 (and AISC 341-16 as applicable); DSA IR 17-3.
<input type="checkbox"/>	c. Inspect welding of stairs and railing systems.	Periodic	SI	1705A.2.1; AISC 360-16 (and AISC 341-16 as applicable); AWS D1.1 & D1.3; DSA IR 17-3.

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (Steel and Aluminum)

1705A.2.1, Table 1705A.2.1; AISC 303-16, AISC 341-16, AISC 358-16, AISC 360-16; AISI S100-16

Application Number: 01-118968

School Name: Ruskin Elementary School

School District: Berryessa Union School

District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/14/2020

<input checked="" type="checkbox"/>	d. Verification of reinforcing steel weldability other than ASTM A706.	Periodic	SI	1705A.3.1; AWS D1.4; DSA IR 17-3. Verify carbon equivalent reported on mill certificates.
<input checked="" type="checkbox"/>	e. Inspect welding of reinforcing steel.	Continuous	SI	Table 1705A.2.1 Item 5b, 1705A.3.1, Table 1705A.3 Item 2, 1903A.8; AWS D1.4; DSA IR 17-3.
19.2 FIELD WELDING:				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/>	a. Inspect groove welds, multi-pass fillet welds, single pass fillet welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Items 5a.1–4; AISC 360-16 (AISC 341-16 as applicable); DSA IR 17-3.
<input checked="" type="checkbox"/>	b. Inspect single-pass fillet welds ≤ 5/16".	Periodic	SI	Table 1705A.2.1 Item 5a.5; AISC 360-16 (AISC 341-16 as applicable); DSA IR 17-3.
<input type="checkbox"/>	c. Inspect end-welded studs (ASTM A-108) installation (including bend test).	Periodic	SI	2213A.2; AISC 360-16 (AISC 341-16 as applicable); AWS D1.1; DSA IR 17-3.
<input type="checkbox"/>	d. Inspect floor and roof deck welds.	Periodic	SI	1705A.2.2, Table 1705A.2.1 Item 5a.6; AISC 360-16 (AISC 341-16 as applicable); AWS D1.3; DSA IR 17-3.
<input type="checkbox"/>	e. Inspect welding of structural cold-formed steel.	Periodic	SI*	1705A.2.5; AWS D1.3; DSA IR 17-3. The quality control provisions of AISI S240-15 Chapter D shall also apply. * May be performed by the project inspector when specifically approved by DSA.
<input type="checkbox"/>	f. Inspect welding of stairs and railing systems.	Periodic	SI*	1705A.2.1; AISC 360-16 (AISC 341-16 as applicable); AWS D1.1 & D1.3; DSA IR 17-3. * May be performed by the project inspector when specifically approved by DSA.
<input type="checkbox"/>	g. Verification of reinforcing steel weldability.	Periodic	SI	1705A.3.1; AWS D1.4; DSA IR 17-3. Verify carbon equivalent reported on mill certificates.
<input type="checkbox"/>	h. Inspect welding of reinforcing steel.	Continuous	SI	Table 1705A.2.1 Item 5b, 1705A.3.1, Table 1705A.3 Item 2, 1903A.8; AWS D1.4; DSA IR 17-3.

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (Steel and Aluminum)

1705A.2.1, Table 1705A.2.1; AISC 303-16, AISC 341-16, AISC 358-16, AISC 360-16; AISI S100-16

Application Number: 01-118968

School Name: Ruskin Elementary School

School District: Berryessa Union School

District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/14/2020

20. NONDESTRUCTIVE TESTING: 1705A.2.1, Table 1705A.2.1; AISC 303-16, AISC 341-16, AISC 358-16, AISC 360-16; AISI S100-16				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>	a. Ultrasonic	Test	LOR	1705A.2.1, 1705A.2.5; AISC 341-16 J6.2, AISC 360-16 N5.5; ANSI/ASNT CP-189, SNT-TC-1A; AWS D1.1, AWS D1.8; DSA IR 17-2.
<input type="checkbox"/>	b. Magnetic Particle	Test	LOR	1705A.2.1, 1705A.2.5; AISC 341-16 J6.2, AISC 360-16 N5.5; ANSI/ASNT CP-189, SNT-TC-1A; AWS D1.1, AWS D1.8; DSA IR 17-2.
<input type="checkbox"/>				

21. STEEL JOISTS AND TRUSSES: 1705A.2.1, Table 1705A.2.1; AISC 303-16, AISC 341-16, AISC 358-16, AISC 360-16; AISI S100-16				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>	a. Verify size, type and grade for all chord and web members as well as connectors and weld filler material; verify joist profile, dimensions and camber (if applicable); verify all weld locations, lengths and profiles; mark or tag each joist.	Continuous	SI	1705A.2.3, Table 1705A.2.3; AWS D1.1; DSA IR 22-3 for steel joists only. 1705A.2.4; AWS D1.3 for cold-formed steel trusses.

22. SPRAY APPLIED FIRE-PROOFING: 1705A.2.1, Table 1705A.2.1; AISC 303-16, AISC 341-16, AISC 358-16, AISC 360-16; AISI S100-16				
	Test or Special Inspection	Type	Performed By	Code References and Notes

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (Steel and Aluminum)

1705A.2.1, Table 1705A.2.1; AISC 303-16, AISC 341-16, AISC 358-16, AISC 360-16; AISI S100-16

Application Number: 01-118968

School Name: Ruskin Elementary School

School District: Berryessa Union School

District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/14/2020

<input type="checkbox"/>	a. Examine structural steel surface conditions, inspect application, take samples, measure thickness and verify compliance of all aspects of application with DSA-approved documents.	Periodic	SI	1705A.14.
<input type="checkbox"/>	b. Test bond strength.	Test	LOR	1705A.14.6.
<input type="checkbox"/>	c. Test density.	Test	LOR	1705A.14.5.

23. ANCHOR BOLTS AND ANCHOR RODS:				
<input checked="" type="checkbox"/>	a. Anchor Bolts and Anchor Rods	Test	LOR	Sample and test anchor bolts and anchor rods not readily identifiable per procedures noted in DSA IR 17-11.
<input type="checkbox"/>	b. Threaded rod not used for foundation anchorage.	Test	LOR	Sample and test threaded rods not readily identifiable per procedures noted in DSA IR 17-11.

23.1 OTHER STEEL:				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>				

Appendix: Work Exempt from DSA Requirements for Structural Tests / Special Inspections

Application Number: 01-118968

School Name: Ruskin Elementary School

School District: Berryessa Union School District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/14/2020

Exempt items given in DSA IR A-22 or the 2019 CBC (including DSA amendments) and those items identified below with an "X" by the design professional are NOT subject to DSA requirements for the structural tests / special inspections noted. **Items marked as exempt shall be identified on the approved construction documents.** The project inspector shall verify all construction complies with the approved construction documents.

	SOILS:
<input checked="" type="checkbox"/>	1. Deep foundations acting as a cantilever footing designed based on minimum allowable pressures per CBC Table 1806A.2 and having no geotechnical report for the following cases: A) free standing sign or scoreboard, B) cell or antenna towers and poles less than 35'-0" tall (e.g., lighting poles, flag poles, poles supporting open mesh fences, etc.), C) single-story structure with dead load less than 5 psf (e.g., open fabric shade structure), or D) covered walkway structure with an apex height less than 10'-0" above adjacent grade.
<input type="checkbox"/>	2. Shallow foundations, etc. are exempt from special inspections and testing by a Geotechnical Engineer for the following cases: A) buildings without a geotechnical report and meeting the exception Item #1 criteria in CBC Section 1803A.2 supported by native soil (any excavation depth) or fill soil (not exceeding 12" depth per CBC, Section 1804A.6), B) soil scarification/recompaction not exceeding 12" depth, C) native or fill soil supporting exterior non-structural flatwork (e.g., sidewalks, site concrete ramps, site stairs, parking lots, driveways, etc.), D) unpaved landscaping and playground areas, or E) utility trench backfill.

	CONCRETE/MASONRY:
<input type="checkbox"/>	1. Post-installed anchors for the following: A) exempt non-structural components (e.g., mechanical, electrical, plumbing equipment - see Item 7 for "Welding") given in CBC Section 1617A.1.18 (which replaces ASCE 7-16, Section 13.1.4) or B) interior nonstructural wall partitions meeting criteria listed in exempt Item 3 for "Welding."
<input type="checkbox"/>	2. Concrete batch plant inspection is not required for items given in CBC Section 1705A.3.3.2 subject to the requirements and limitations in that section.
<input type="checkbox"/>	3. Non-bearing non-shear masonry walls may be exempt from certain DSA masonry testing and special inspection items as allowed per DSA IR 21-1. Refer to construction documents for specific exemptions accordingly for each applicable wall condition.
<input type="checkbox"/>	4. Epoxy shear dowels in site flatwork and/or other non-structural concrete.
<input type="checkbox"/>	5. Testing of reinforcing bars is not required for items given in CBC Section 1910A.2 subject to the requirements and limitations in that section.

Appendix: Work Exempt from DSA Requirements for Structural Tests / Special Inspections

Application Number: 01-118968

School Name: Ruskin Elementary School

School District: Berryessa Union School

District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/14/2020

	Welding:
<input type="checkbox"/>	1. Solid-clad and open-mesh gates with maximum leaf span or rolling section for rolling gates of 10' and apex height less than 8'-0" above lowest adjacent grade. When located above circulation or occupied space below, these gates are not located within 1.5x gate/fence height (max 8'-0") to the edge of floor or roof.
<input type="checkbox"/>	2. Handrails, guardrails and modular or relocatable ramps associated with walking surfaces less than 30" above adjacent grade (excluding post base connections per the 'Exception' language in Section 1705A.2.1); fillet welds shall not be ground flush.
<input type="checkbox"/>	3. Non-structural interior cold-formed steel framing spanning less than 15'-0", such as in interior partitions, interior soffits, etc. supporting only self weight and light-weight finishes or adhered tile, masonry, stone, or terra cotta veneer no more than 5/8" thickness and apex less than 20'-0" in height and not over an exit way. Maximum tributary load to a member shall not exceed the equivalent of that occurring from a 10'x10' opening in a 15' tall wall for a header or king stud.
<input type="checkbox"/>	4. Manufactured support frames and curbs using hot rolled or cold-formed steel (i.e., light gauge) for mechanical, electrical, or plumbing equipment weighing less than 2000# (equipment only) (connections of such frames to superstructure elements using welding will require special inspection as noted in selected item(s) for Sections 19, 19.1 and/or 19.2 of listing above).
<input type="checkbox"/>	5. Manufactured components (e.g., Tolco, B-Line, Afcon, etc.) for mechanical, electrical, or plumbing hanger support and bracing (connections of such components to superstructure elements using welding will require special inspection as noted in selected item(s) for Sections 19, 19.1 and/or 19.2 of listing above).
<input type="checkbox"/>	6. TV Brackets, projector mounts with a valid listing (see DSA IR A-5) and recreational equipment (e.g., playground structures, basketball backstops, etc.) (connections of such elements to superstructure elements using welding will require special inspection as noted in selected item(s) for section 19, 19.1 and/or 19.2 located in the Steel/Aluminum category).
<input type="checkbox"/>	7. Any support for exempt non-structural components given in CBC Section 1617A.1.18 (which replaces ASCE 7-16, Section 13.1.4) meeting the following: A) when supported on a floor/roof, <400# and resulting composite center of mass (including component's center of mass) ≤4' above supporting floor/roof, B) when hung from a wall or roof/floor, <20# for discrete units or <5 plf for distributed systems.

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (SIGNATURE)

Application Number: 01-118968

School Name: Ruskin Elementary School

School District: Berryessa Union School District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/14/2020

Name of Architect or Engineer in general responsible charge: Mark C. Finney	
Name of Structural Engineer (When structural design has been delegated):	
Signature of Architect or Structural Engineer:	Date: 03/03/2020



Note: Do not use secured electronic or digital signatures preventing DSA mark-ups.

DSA STAMP
IDENTIFICATION STAMP DIV. OF THE STATE ARCHITECT
APP: 01-118968 INC:
REVIEWED FOR
SS <input checked="" type="checkbox"/> FLS <input type="checkbox"/> ACS <input type="checkbox"/>
DATE: 06/12/2020

DSA 103: LIST OF REQUIRED VERIFIED REPORTS

Application Number: 01-118968

School Name: Ruskin Elementary School

School District: Berryessa Union School
District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/14/2020

-
1. Structural Testing and Inspection: Laboratory Verified Report Form DSA 291

 2. Concrete Batch Plant Inspection: Laboratory Verified Report Form DSA 291

 3. Shop Welding Inspection: Laboratory Verified Report Form DSA 291, or, for independently contracting SI, Special Inspection Verified Report Form DSA 292

 4. High-Strength Bolt Installation Inspection: Laboratory Verified Report Form DSA 291, or, for independently contracting SI, Special Inspection Verified Report Form DSA 292

DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE STATEMENT:


THE PATH OF TRAVEL IDENTIFIED IN THESE CONSTRUCTION DOCUMENTS IS COMPLIANT WITH THE CURRENT APPLICABLE CALIFORNIA BUILDING CODE ACCESSIBILITY PROVISIONS FOR PATH OF TRAVEL REQUIREMENT FOR ALTERATIONS, ADDITIONS AND STRUCTURAL REPAIRS. AS PART OF THE DESIGN OF THIS PROJECT, THE P.O.T. WAS EXAMINED AND ANY ELEMENTS, COMPONENTS OR PORTIONS OF THE P.O.T. THAT WERE DETERMINED TO BE NONCOMPLIANT 1) HAVE BEEN IDENTIFIED AND 2) THE CORRECTIVE WORK NECESSARY TO BRING THEM INTO COMPLIANCE HAS BEEN INCLUDED WITHIN THE SCOPE OF THIS PROJECTS WORK THROUGH DETAILS, DRAWINGS, AND SPECIFICATIONS INCORPORATED INTO THESE CONSTRUCTION DOCUMENTS. ANY NONCOMPLIANT ELEMENTS, COMPONENTS OR PORTIONS OF THE P.O.T. THAT WILL NOT BE CORRECTED BY THIS PROJECT BASED ON VALUATION THRESHOLD LIMITATIONS OR A FINDING OF UNREASONABLE HARDSHIP ARE SO INDICATED IN THESE CONSTRUCTION DOCUMENTS.

DURING CONSTRUCTION, IF P.O.T. ITEMS WITHIN THE SCOPE OF THIS PROJECT REPRESENTED AS CODE COMPLIANT ARE FOUND TO BE NONCONFORMING BEYOND REASONABLE CONSTRUCTION TOLERANCES, THEY SHALL BE BROUGHT INTO COMPLIANCE WITH THE CBC AS A PART OF THIS PROJECT BY MEANS OF A CONSTRUCTION CHANGE DOCUMENT.

SAFE DISPERSAL AREA

TOTAL 'E' OCCUPANCY BUILDINGS WITH OCCUPANTS = 18,912
18,912 SF @ 20 SF/OCC = 945 OCCUPANTS
TOTAL 'B' OCCUPANCY BUILDINGS WITH OCCUPANTS = 9,028
9,028 SF @ 100 SF/OCC = 90 OCCUPANTS
TOTAL 'F-1' OCCUPANCY BUILDINGS WITH OCCUPANTS = 5,154
5,154 SF @ 300 SF/OCC = 17 OCCUPANTS
TOTAL OCCUPANTS = 945 + 90 + 17 = 1,052
MINIMUM DISPERSAL AREA REQUIRED: OCCUPANTS x 5 SF/OCC
1,052 X 5 SF = 5,260 SF
AREA PROVIDED = 5,600 SF THEREFORE OK.

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 01-118970 INC.
REVIEWED FOR:
SS FLS ACS
DATE: 08/11/2020
(DSA STAMP AREA)
SUGIMURA FINNEY ARCHITECTS
SFA
ARCHITECTURE INTERIORS PLANNING
2155 SOUTH BASCOM AVE.
SUITE 200
CAMPBELL, CA 95005
PHONE: 408.379.8009
FAX: 408.379.4966

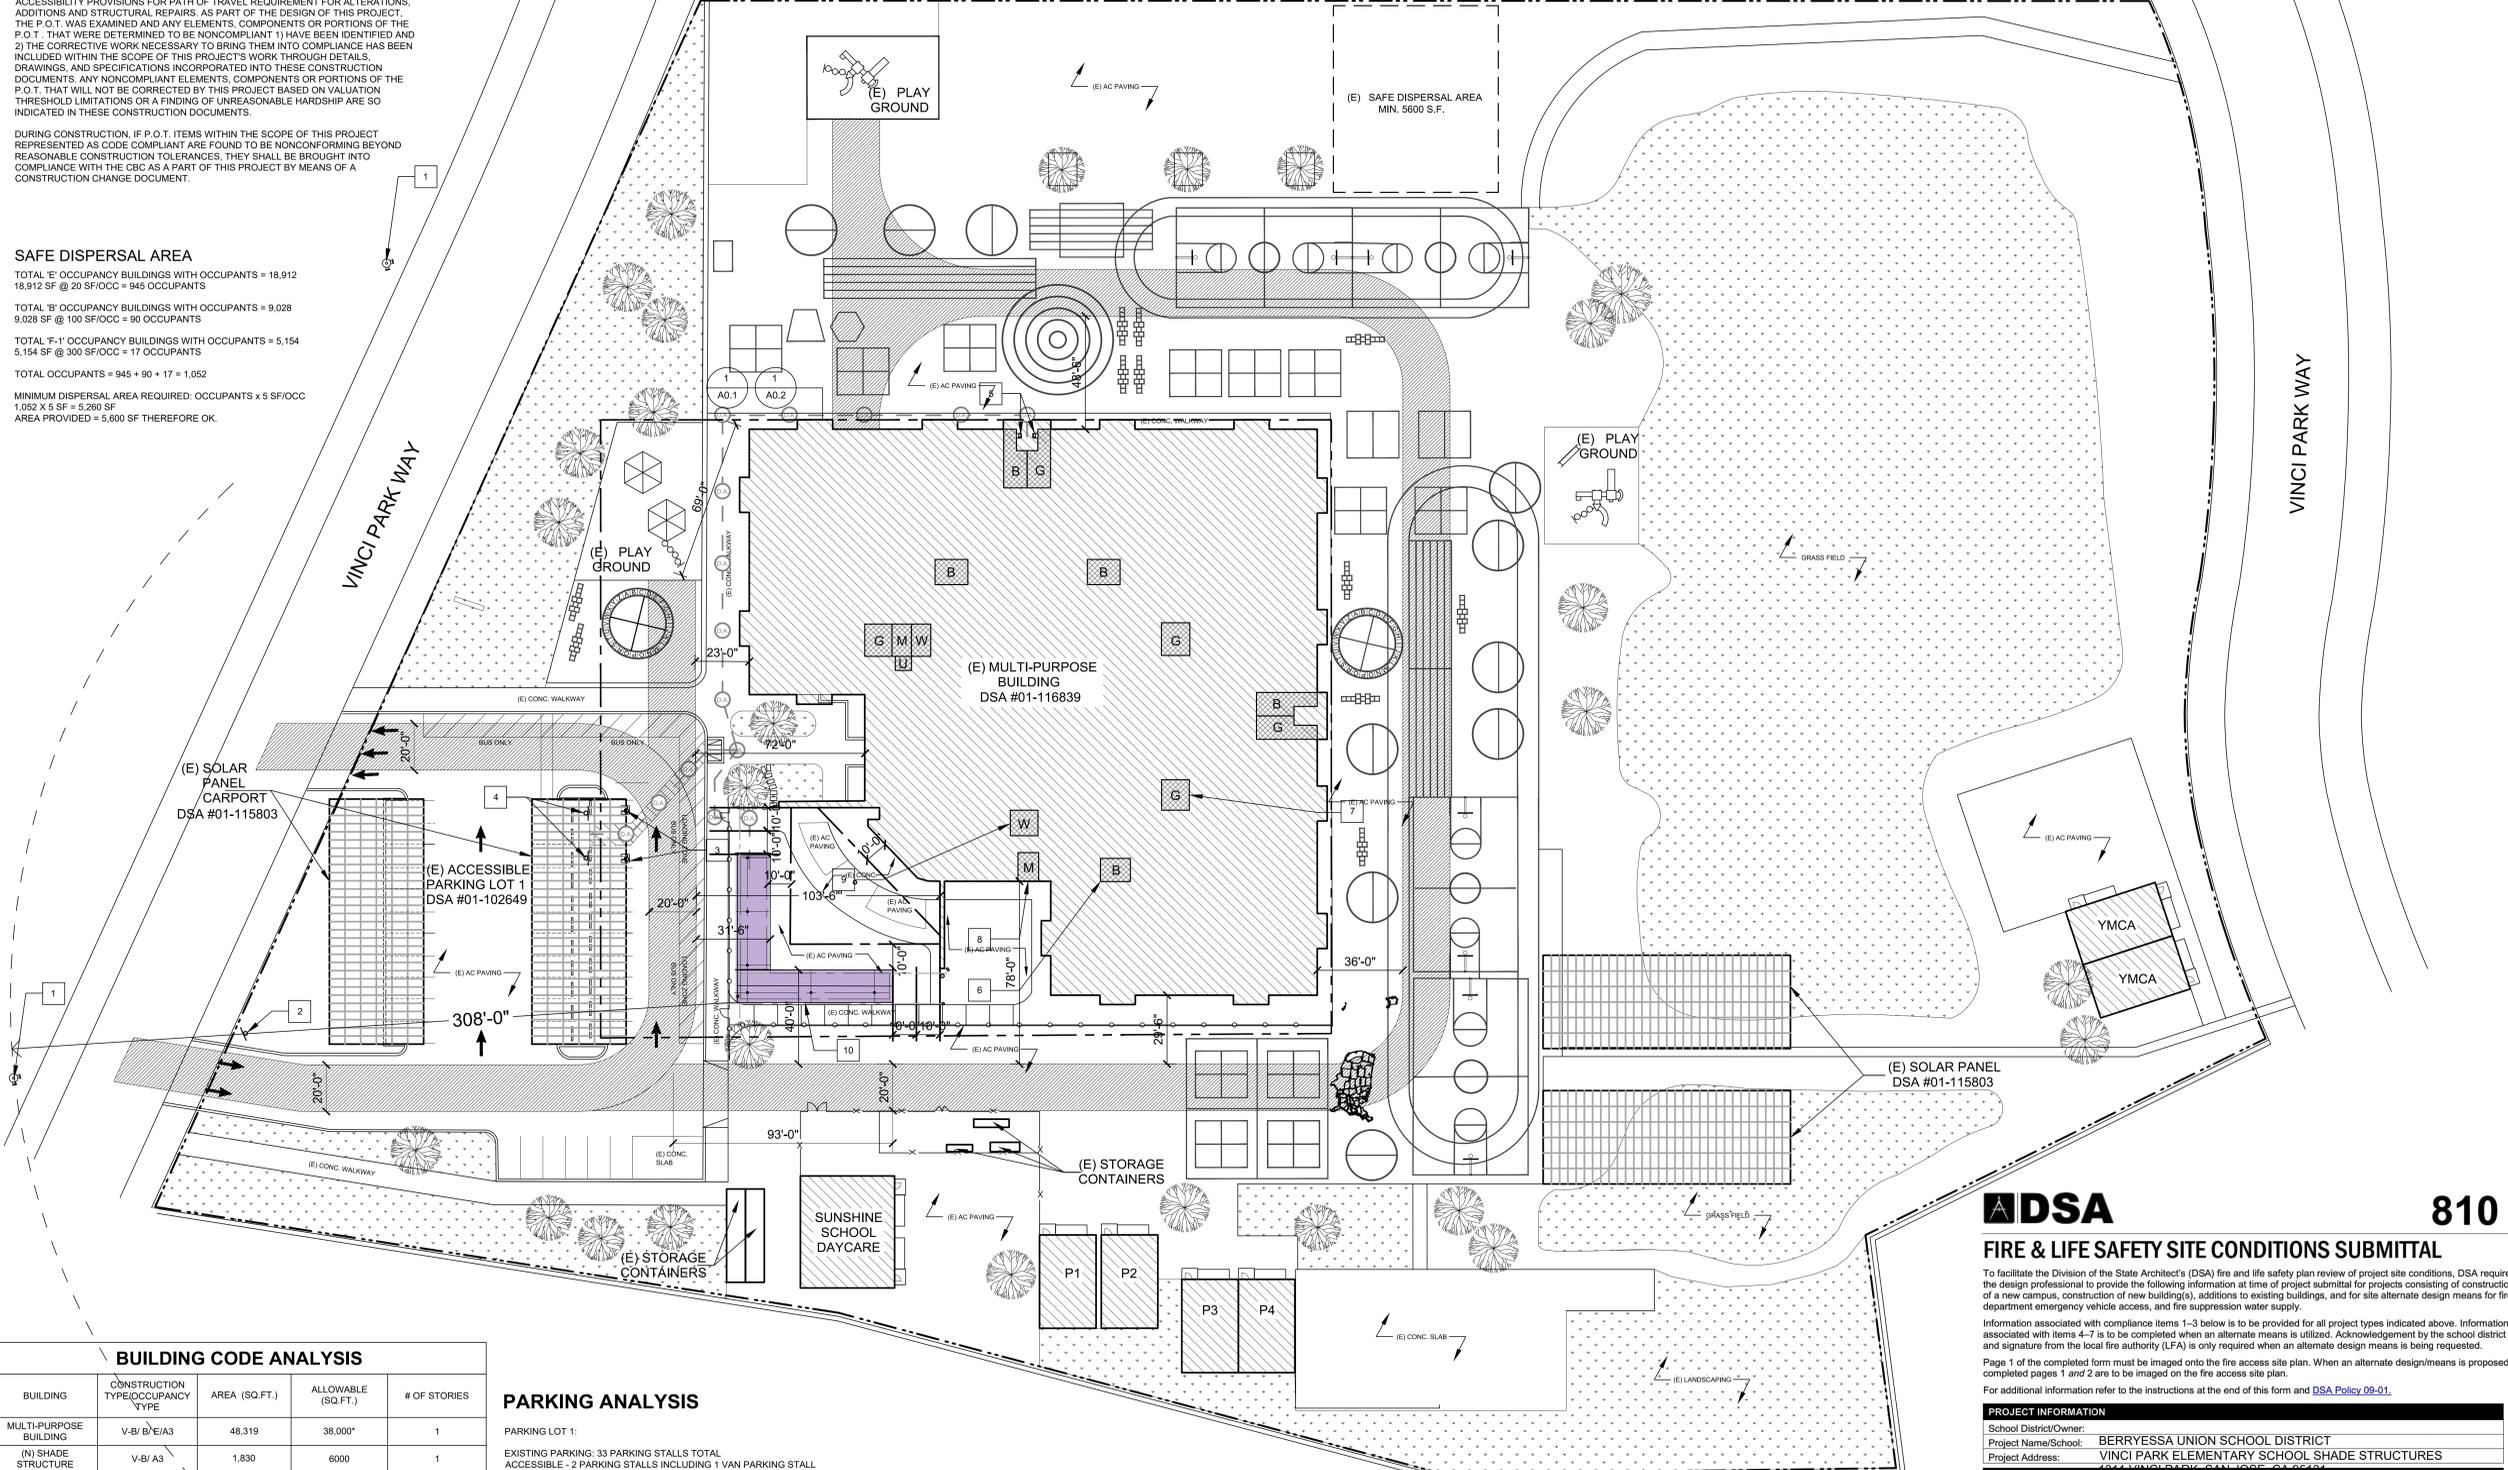

BUILDING CODE ANALYSIS

BUILDING	CONSTRUCTION TYPE/OCCUPANCY TYPE	AREA (SQ.FT.)	ALLOWABLE (SQ.FT.)	# OF STORIES
MULTI-PURPOSE BUILDING	V-B/E/A3	48,319	38,000*	1
(N) SHADE STRUCTURE	V-B/ A3	1,830	6000	1

PARKING ANALYSIS

PARKING LOT 1:
EXISTING PARKING: 33 PARKING STALLS TOTAL
ACCESSIBLE - 2 PARKING STALLS INCLUDING 1 VAN PARKING STALL

* MULTIPURPOSE BUILDING MIXED OCCUPANCY CALCULATIONS PER 506.2.4 CBC 2019:
EXISTING "E" OCCUPANCY = 37,237 S.F.
ALLOWED "E" OCCUPANCY = 38,000 + (9600 X 1.75) = 54,625 S.F.
37,237 / 54,625 = 0.68
EXISTING "A-3" OCCUPANCY = 3,277 S.F.
ALLOWED "A-3" OCCUPANCY = 24,000 + (6000 X 1.75) = 34,500 S.F.
3,277 / 34,500 = 0.09
EXISTING "B" OCCUPANCY = 2,744 S.F.
ALLOWED "B" OCCUPANCY = 36,000 + (9000 X 1.75) = 51,750 S.F.
2,744 / 51,750 = 0.05
EXISTING "S-1" OCCUPANCY = 1,735 S.F.
ALLOWED "S-1" OCCUPANCY = 36,000 + (9000 X 1.75) = 51,750 S.F.
1,735 / 51,750 = 0.03
TOTAL: 0.68 + 0.09 + 0.05 + 0.03 = 0.85 < 1


1 SITE PLAN FIRE LIFE SAFETY & ACCESS COMPLIANCE

PROJECT SUMMARY
INSTALLATION OF (1) NEW METAL SHADE STRUCTURE PC #04-117117, AND ASSOCIATED SITE WORK.

GENERAL NOTES

A. THIS SHEET IS FOR ACCESS & FIRE LIFE SAFETY COMPLIANCE CODE RELATED ITEMS. FOR SCOPE OF WORK SEE SHEETS A0.1 AND A0.2.
B. REFER TO P.C. DRAWINGS FOR EXTENT OF P.C. WORK.
C. ACCESSIBLE PATH OF TRAVEL (P.O.T.), AS INDICATED, IS A COMMON BARRIER FREE ACCESS ROUTE WITHOUT ANY ABRUPT VERTICAL CHANGES EXCEEDING A 1/2" BEVELED AT 1:2 MAXIMUM SLOPE, EXCEPT THAT LEVEL CHANGES DO NOT EXCEED 1/4" VERTICAL AND AT LEAST 48" WIDE. THE PATH SURFACE IS SLIP RESISTANT, STABLE, FIRM, AND SMOOTH. PASSING SPACES (11B-403.5.3) AT LEAST 60"x60" ARE LOCATED NOT MORE THAN 200' APART. PARTS OF P.O.T. WITH CONTINUOUS GRADIENTS HAVE 60" LEVEL AREAS (11B-403.7) NOT MORE THAN 400' APART. THE CROSS SLOPE DOES NOT EXCEED 2% AND SLOPE IN THE DIRECTION OF TRAVEL AND IS LESS THAN 5% UNLESS OTHERWISE INDICATED. P.O.T. SHALL BE MAINTAINED FREE OF OVERHANGING OBSTRUCTIONS TO 80" MINIMUM (11B-307.4) AND PROTRUDING OBJECTS GREATER THAN 4" PROJECTION FROM WALL AND ABOVE 27" AND LESS THAN 80" (11B-307.2).
D. GATES IN THE PATH OF TRAVEL SHALL MEET DOOR REQUIREMENTS PER CBC SECTION 11B-404. ALL GATES TO HAVE ACCESSIBLE HARDWARE AND 10" MIN. SMOOTH BOTTOM OR KICK PLATES. PANIC HARDWARE AND EXIT SIGN MAY BE REQUIRED. COORDINATE WITH FIRE AND LIFE SAFETY CONTRACTOR TO VERIFY ALL BARRIERS IN P.O.T. HAVE BEEN REMOVED.
E. ALL EXTERIOR ENTRANCES AND EXITS IDENTIFIED WITH A TRIANGULAR SYMBOL ON THIS PLAN ARE ACCESSIBLE AND COMPLY WITH CBC 11B-401 AND INCLUDE A 32" CLEAR OPENING, THE REQUIRED STRIKE EDGE CLEARANCE AT PULL SIDE OF DOOR, LEVEL LANDINGS WITH A 2% MAX. SLOPE, AND AN ACCESSIBLE THRESHOLD, HARDWARE, CLOSER AND KICK PLATE.

- SITE PLAN - FIRE LIFE SAFETY & ACCESS COMPLIANCE NOTES**
- EXISTING FIRE HYDRANT.
 - EXISTING TOW AWAY SIGN PER DSA #102649 & DSA #01-116839
 - (E) DA PARKING STALLS PER DSA #01-102649 & DSA #01-116839
 - (E) DA PARKING SIGNS PER DSA #01-102649 & DSA #01-116839
 - (E) ACCESSIBLE DRINKING FOUNTAIN PER DSA #01-116839
 - (E) ACCESSIBLE BOYS RESTROOMS PER DSA #01-116839
 - (E) ACCESSIBLE GIRLS RESTROOMS PER DSA #01-116839
 - (E) ACCESSIBLE MEN'S RESTROOMS PER DSA #01-116839
 - (E) ACCESSIBLE WOMEN'S RESTROOMS PER DSA #01-116839
 - (N) METAL SHADE STRUCTURE PC #04-117117, SEE MANUFACTURER'S DRAWINGS.



810 DSA FIRE & LIFE SAFETY SITE CONDITIONS SUBMITTAL

To facilitate the Division of the State Architect's (DSA) fire and life safety plan review of project site conditions, DSA requires the design professional to provide the following information at time of project submittal for projects consisting of construction of a new campus, construction of new building(s), additions to existing buildings, and for site alternate design means for fire department emergency vehicle access, and fire suppression water supply.
Information associated with compliance items 1-3 below is to be provided for all project types indicated above. Information associated with items 4-7 is to be completed when an alternate means is utilized. Acknowledgement by the school district and signature from the local fire authority (LFA) is only required when an alternate design means is being requested.
Page 1 of the completed form must be imaged onto the fire access site plan. When an alternate design/means is proposed, completed pages 1 and 2 are to be imaged on the fire access site plan.
For additional information refer to the instructions at the end of this form and [DSA Policy 09-01](#).

PROJECT INFORMATION

School District/Owner: BERRYESSA UNION SCHOOL DISTRICT
Project Name/School: VINCI PARK ELEMENTARY SCHOOL SHADE STRUCTURES
Project Address: 1311 VINCI PARK WAY, SAN JOSE, CA 95131

FIRE & LIFE SAFETY INFORMATION

1. Has a fire hydrant flow test been performed within the past 12 months? (If yes, provide a copy of the test data.)	Yes <input type="checkbox"/>	No <input checked="" type="checkbox"/>	
2. Was the fire hydrant water flow test performed as part of this LFA review?	Yes <input type="checkbox"/>	No <input checked="" type="checkbox"/>	
3. Is the project located within a designated fire hazard severity zone as established by Cal-Fire? (If yes, indicate fire hazard zone classification below)	Moderate <input type="checkbox"/>	High <input type="checkbox"/>	Very High <input type="checkbox"/>
Refer to the following for fire hazard zone locations: www.fire.ca.gov/fire_prevention/fire_prevention_wildland_zones_maps			
Wildland Interface Area (WIFA) (If any designations are checked, project design must meet the requirements of CBC Chapter 7A.)		WIFA <input type="checkbox"/>	

GRAPHIC KEY


—	EXISTING PROPERTY LINE	▨	FIRE DEPARTMENT ACCESS. FIRE DEPARTMENT ACCESS IS 20' WIDE AND RATED FOR 90,000 GPM.
- - -	ASSUMED PROPERTY LINE	⊕	(E) DRY STAND PIPE
⊕	ACCESSIBLE PATH OF TRAVEL	⊕	(E) FIRE HYDRANT
—	ROOF OVERHANG	⊕	DRINKING FOUNTAIN
—	CHAIN LINK FENCE	⊕	(E) SIGN
—	WOOD FENCE	▨	NEW SHADE STRUCTURE
—	DECORATIVE FENCE	▨	EXISTING BUILDING

SITE PLAN FIRE LIFE SAFETY & ACCESS COMPLIANCE
SHADE STRUCTURES
VINCI PARK ELEMENTARY SCHOOL
1311 VINCI PARK WAY, SAN JOSE, CA 95131
BERRYESSA UNION SCHOOL DISTRICT

REVISIONS

NO.	ITEM	DATE

DRAWN BY: MK
CHECKED BY: NJ
SFA JOB NO: DATE:
19067 09/03/2019

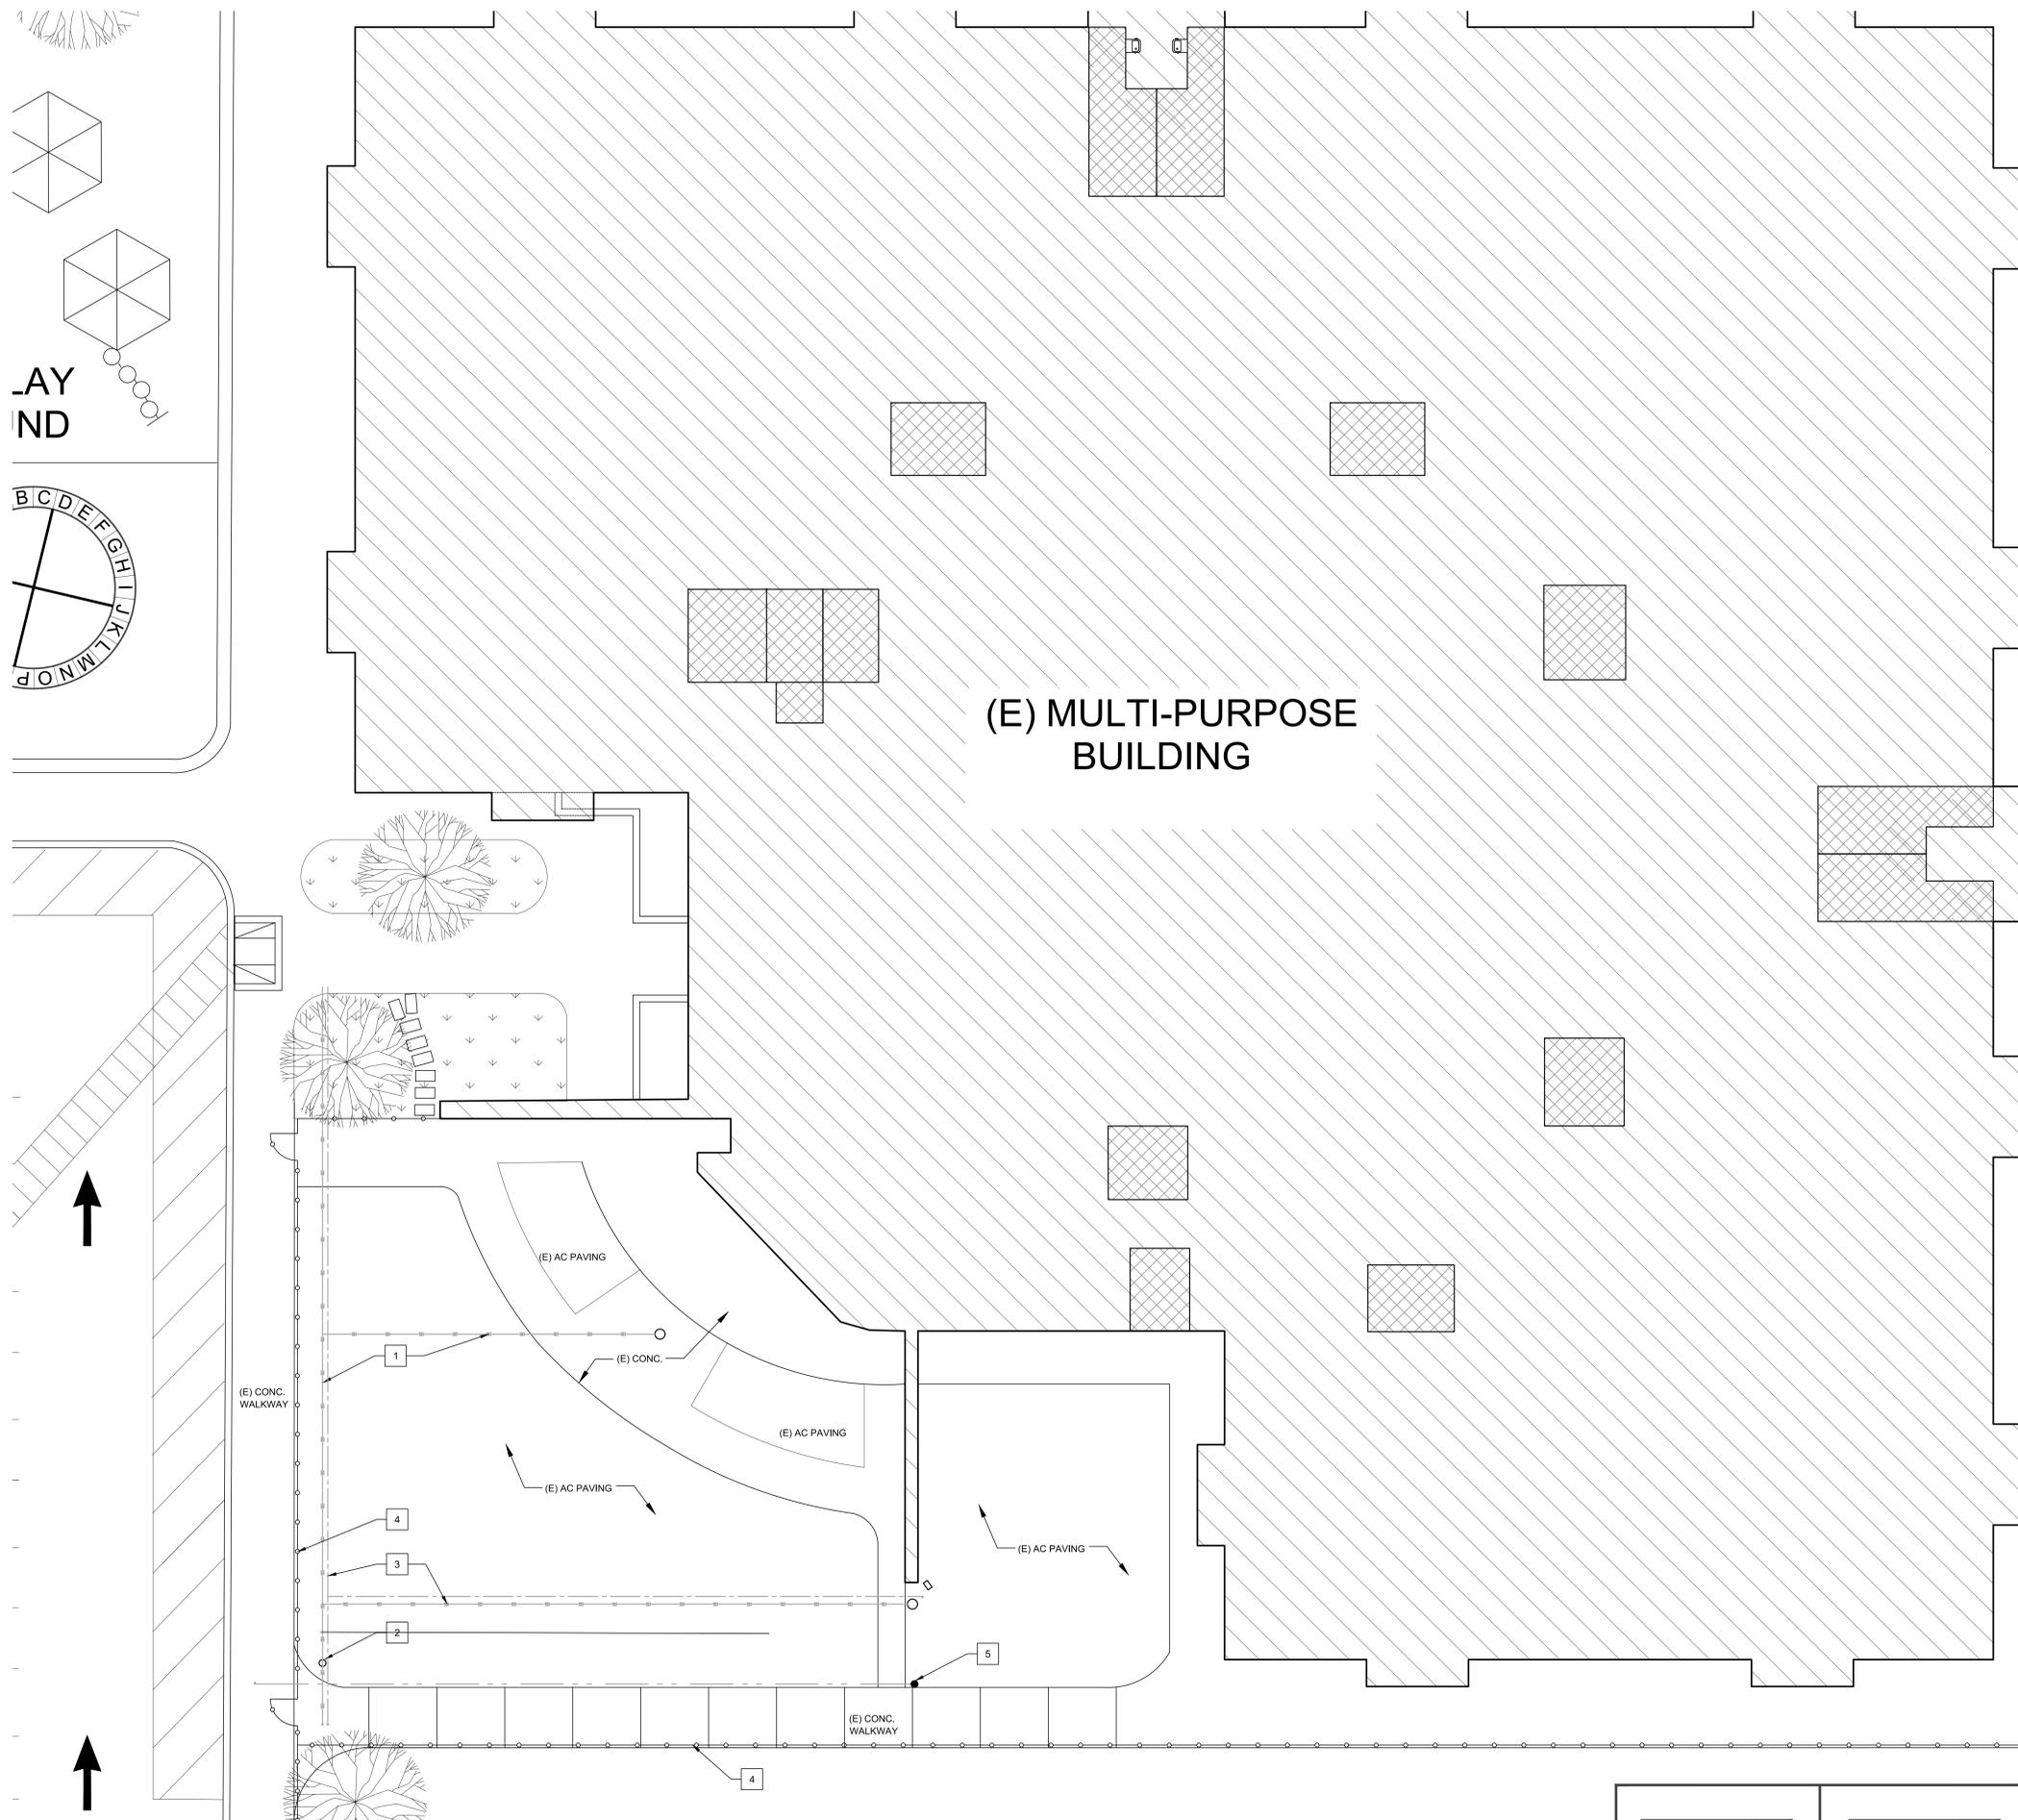

- GENERAL NOTES**
- CONTRACTOR TO VERIFY ALL BARRIERS IN P.O.T. HAVE BEEN REMOVED.
 - GENERAL CONTRACTOR SHALL SURVEY THE AREA OF NEW CONSTRUCTION FOR UNDERGROUND UTILITIES PRIOR TO THE BEGINNING OF CONSTRUCTION AND PERROUTE/CAP ALL EXISTING UTILITIES RUNNING BELOW THE AREA OF THE NEW SHADE STRUCTURES IF IT CONFLICTS WITH NEW SHADE STRUCTURE FOOTING.
 - THE CONTRACTOR SHALL VERIFY ALL UNDERGROUND UTILITIES WITH A LOCATING SERVICE PRIOR TO STARTING CONSTRUCTION.
 - ALL UTILITIES TO BE ABANDONED SHALL BE REMOVED IN THEIR ENTIRETY, AND WIRING PULLED BACK TO SOURCE.
 - REQUIRED UTILITY SHUTDOWNS SHALL BE REQUESTED 72 HOURS IN ADVANCE WITH ARCHITECT AND OWNER.
 - CONTRACTOR TO PROVIDE AND MAINTAIN IN PROPER CONDITION TEMPORARY FENCING PER DETAIL 1A0.4 PRIOR TO START OF THE CONSTRUCTION AND DURING ALL THE CONSTRUCTION TIME. TEMPORARY FENCING TO BE INSTALLED ALONG THE PERIMETER OF WORK AREA.
 - DEMOLITION WORK SHALL CONFORM TO CALIFORNIA GREEN CODE MANAGEMENT REQUIREMENTS.

- DEMOLITION SITE PLAN NOTES**
- ASSUMED DIRECTION OF STORM DRAIN LINE. CONTRACTOR TO VERIFY PRIOR TO BEGINNING OF CONSTRUCTION.
 - APPROXIMATE LOCATION OF (E) STORM DRAIN INLET. VERIFY IN FIELD.
 - (E) UNDERGROUND UTILITIES, LOCATION TO BE VERIFIED IN FIELD.
 - (E) FENCING TO REMAIN. TYP.
 - (E) LIGHT POLE TO REMAIN.

- GRAPHIC KEY**
- - - - - EXISTING PROPERTY LINE
 - - - - - ROOF OVERHANG
 - - - - - CHAINLINK FENCE
 - - - - - WOOD FENCE
 - - - - - DECORATIVE FENCE
 - [Hatched Box] EXISTING BUILDING
 - [Cross-hatched Box] EXISTING RESTROOMS
 - (E) DRY STAND PIPE
 - (E) DRINKING FOUNTAIN
 - ⊕ (E) FIRE HYDRANT
 - ⊙ (E) SIGN
 - M (E) MENS TOILET ROOM
 - W (E) WOMENS TOILET ROOM
 - G (E) GIRLS TOILET ROOM
 - B (E) BOYS TOILET ROOM
 - U (E) UNISEX TOILET ROOM
 - K (E) KINDERGARTEN TOILET ROOM

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP: 01-118970 INC.
 REVIEWED FOR
 SS FLS ACS
 DATE: 08/11/2020
 (SEA STAMP AREA)

SUGIMURA
 FINNEY
 ARCHITECTS
SFA
 ARCHITECTURE INTERIORS PLANNING
 2155 SOUTH BASCOM AVE.
 SUITE 200
 CAMPBELL, CA 95005
 PHONE: 408.879.8099
 FAX: 408.577.4996



ENLARGED DEMOLITION SITE PLAN
 SHADE STRUCTURES
 VINCI PARK ELEMENTARY SCHOOL
 1311 VINCI PARK WAY, SAN JOSE, CA 95131
 BERRYESSA UNION SCHOOL DISTRICT


REVISIONS NO.	ITEM	DATE

DRAWN BY: MK
 CHECKED BY: NJ
 SFA JOB NO: 19067 DATE: 09/03/2019

A0.1

COPYRIGHT © 2019

1 ENLARGED DEMOLITION SITE PLAN




IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP: 01-118970 INC.
 REVIEWED FOR
 SS FLS ACS
 DATE: 08/11/2020

(DSA STAMP AREA)


SUGIMURA
 FINNEY
 ARCHITECTS
SFA
 ARCHITECTURE INTERIORS PLANNING

2155 SOUTH BASCOM AVE.
 SUITE 209
 CAMPBELL, CA 95003
 PHONE: 402-878-6009
 FAX: 402-377-6569

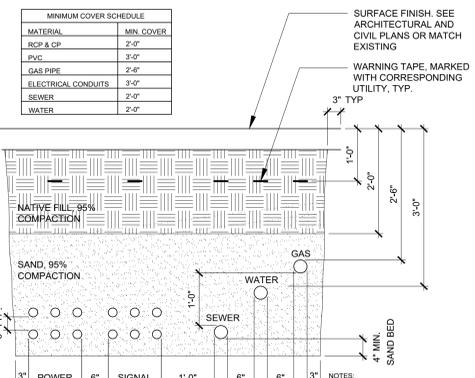


3 TYP. JOINT TRENCH 3/4"=1'-0"

NOTES:
 1. PROVIDE DETAIL OF TRENCH LAYOUT FOR JOINT TRENCHES BY DIFFERENT TRADES FOR ARCHITECT'S APPROVAL.
 2. WATER JETTING TO ACHIEVE COMPACTION IS NOT PERMITTED.
 3. REF. MPA 04 FOR MIN. FIRE LANE COVERAGE.
 4. REF. CBC SECT 1805AA.7

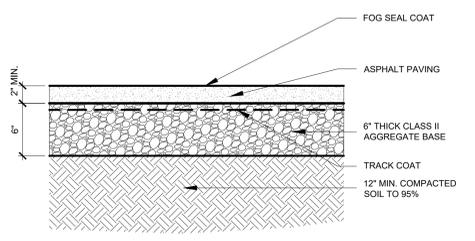

2 (N) ASPHALT PAVING 1-1/2"=1'-0"

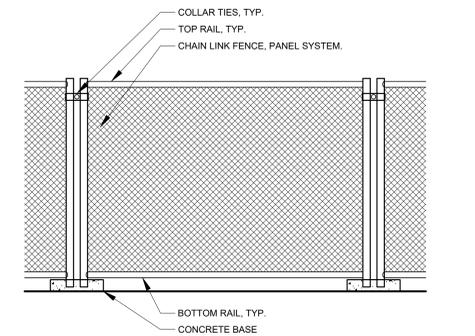

1 REQ'D TEMPORARY FENCING CONSTRUCTION FENCING 1/2"=1'-0"

SITE DETAILS

SHADE STRUCTURES
 VINCI PARK ELEMENTARY SCHOOL
 1311 VINCI PARK WAY, SAN JOSE, CA 95131
 BERRYESSA UNION SCHOOL DISTRICT

REVISIONS NO.	ITEM	DATE

DRAWN BY: MK
 CHECKED BY: NJ
 SFA JOB NO: 19067 DATE: 09/03/2019

A0.4

M BAR C VERSA-CANOPY

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 01-118970 INC:
REVIEWED FOR
SS FLS ACS
DATE: 08/11/2020

ENGINEER'S
APPROVAL



DATE SIGNED
11/28/2018

SITE SPECIFIC
DSA APPROVAL

FILE NUMBER: PC-119
IDENTIFICATION STAMP
DIVISION OF THE STATE ARCHITECT
APP. NO: 04 - 117117 INCR
AC DF FLS DS SS DP
DATE: 12/05/2018

PRE-CHECK (PC) DOCUMENT
CODE: 2016 CBC
A SEPARATE PROJECT APPLICATION FOR
CONSTRUCTION IS REQUIRED

M BAR C
CONSTRUCTION
INC.
674 RANCHEROS DR
SAN MARCOS, CA
92069
PHONE: (760) 744-4131
FAX: (760) 744-4449
LIC # 869960
B AND C51
GREGJ@MBARCONLINE.COM (775) 787-8845

4STEL
ENGINEERING
STRUCTURAL ENGINEERING
26030 A CHERO, SUITE 200
MISSION VIEJO, CA 92691
PHONE: (949) 305-1150
FAX: (949) 305-1420

VERSA
CANOPY
COVER SHEET

DRAWN
GM
CHECKED
KS
DATE
11/28/2018
4STEL JOB NO.
MC03-01
SHEET
S-1
1 OF 13 SHEETS

PC OWNERSHIP - STRUCTURAL STEEL CONTRACTOR



M BAR C
CONSTRUCTION
INC.

674 RANCHEROS DR
SAN MARCOS, CA. 92069

PHONE: (760) 744-4131
FAX: (760) 744-4449

LIC # 869960
B AND C51

POINT OF CONTACT: GREG JONES
GREGJ@MBARCONLINE.COM
(775) 787-8845

LEGAL INFORMATION

- USE OF THE PC WITHOUT WRITTEN CONSENT FROM M BAR C CONSTRUCTION, INC. IS STRICTLY PROHIBITED.
- ALL INFORMATION HEREIN IS PROPRIETARY INFORMATION AND UNDER THE OWNERSHIP OF M BAR C CONSTRUCTION, INC.

STANDARD NOTES FOR PC USE

- 4 S.T.E.L. ENGINEERING, INC. IS AVAILABLE TO BID THE GENERATION OF THE FULL DSA SUBMITTAL PACKAGE ACTING AS THE DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE (DPGRC) OR TO SUPPORT THE DPGRC AS THE SITE SPECIFIC STRUCTURAL ENGINEER OF RECORD (SEOR). CONTACT DUSTIN ROSEPINK AT 4 S.T.E.L. ENGINEERING, INC FOR A PROPOSAL FOR SERVICES AT (949) 305-1150, DKRPINK@4STELENG.COM
- FOR CONSTRUCTION COST INFORMATION, CONTACT M BAR C CONSTRUCTION, INC.
- CUSTOM SIZES AND LOADINGS REQUIRE SUPPLEMENTARY SHOP DRAWINGS AND CALCULATIONS.

DSA OTC PLAN REVIEWER AND DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE NOTES

1. THE PC STRUCTURAL MEMBERS ARE DESIGNED TO THE FOLLOWING ASCE 7-10 SEISMIC CRITERIA: $S_s = 3.2$, $S_1 = 1.39$, $R = 1.25$.
2. THE DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE TO VERIFY SITE SPECIFIC DESIGN PARAMETERS COMPLY WITH DESIGN PARAMETERS FOR THE PC SHOWN ON SHEET S-2.
3. THE DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE IS RESPONSIBLE FOR VERIFYING SITE-SPECIFIC WIND PARAMETERS AT ANY AND ALL SITES WHERE THIS PC IS USED. THIS PC DESIGN IS BASED ON WIND SPEED 110 MPH FOR RISK CATEGORY II TYPE STRUCTURES UTILIZING EXPOSURE TYPE C PER ASCE 7-10. SEE DESIGN PARAMETER NOTE 1 ON SHEET S-2.
4. A SITE SPECIFIC GEOTECHNICAL REPORT SHALL BE SUBMITTED JUSTIFYING SOILS VALUES SELECTED IF GREATER THAN 100 PCF FOR LATERAL BEARING AND/OR 1,500 PSF FOR VERTICAL BEARING. SEE FOUNDATION NOTES ON SHEET S-3.
5. SITE SPECIFIC DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE TO SELECT SOILS CLASS FOR SITE SPECIFIC USE.
6. WET STAMPED & SIGNED COPIES OF PC PLANS ARE NOT REQUIRED FOR SITE SPECIFIC PC USE.
7. DUSTIN ROSEPINK IS NOT ACTING AS SITE SPECIFIC SEOR UNLESS HE IS THE DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE OR A SIGNED LETTER HAS BEEN SUBMITTED WITH DSA-1 FORM STATING HE ACCEPTS THE RESPONSIBILITY AS THE SEOR FOR THE SITE. REFER TO DSA IR A-18.
8. DUSTIN ROSEPINK WILL NOT SIGN ANY DSA FORMS (e.g. DSA-5, DSA-6, etc.), REVIEW OR APPROVE ANY SUBMITTALS (e.g. CONCRETE MIX DESIGNS, SHOP DRAWINGS, etc.) FOR THE SITE SPECIFIC PROJECT UNLESS HE IS ACTING AS THE DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE OR THE SITE SPECIFIC STRUCTURAL ENGINEER OF RECORD. REFER TO DSA IR A-18.
9. CUSTOM SIZES & LOADINGS REQUIRE SUPPLEMENTARY SHOP DRAWINGS & CALCULATIONS.

DESIGN PARAMETER CHECK LIST

1. VERIFY THE MAXIMUM WIND SPEED AT THE SITE DOES NOT EXCEED 110 MPH EXPOSURE C.
2. VERIFY THE MAXIMUM SEISMIC S_s AT THE SITE DOES NOT EXCEED $S_s = 3.2$.
3. VERIFY THE SITE SPECIFIC SNOW LOAD AND ENSURE ALL SITE SPECIFIC PC SELECTIONS MEET OR EXCEED THE SITE SPECIFIC SNOW LOAD. THIS PC HAS OPTIONS FOR NO SNOW AND 20 PSF SNOW LOAD. VERIFY THE SITE SPECIFIC DESIGN PROFESSIONAL HAS PROVIDED THE PROPER SITE SPECIFIC VALUES FOR P_g , P_f , P_s , C_e , I_c .
4. REVIEW THE SITE SPECIFIC GEOTECHNICAL REPORT AND ENSURE ALL SITE SPECIFIC PC SELECTIONS MEET WITH THE GEOTECHNICAL REPORT REQUIREMENTS. IF NO GEOTECHNICAL REPORT IS SUPPLIED VERIFY SOILS CLASS V IS SELECTED.
 - SITES NOT LOCATED IN STATE OR LOCAL GEOHAZARD ZONES UTILIZING THIS PC WITH STRUCTURES NOT EXCEEDING 4,000 SQ FT DO NOT REQUIRE CGS APPROVAL OF THE GEOTECHNICAL REPORT. STRUCTURES MAY BE BROKEN UP INTO MULTIPLE 4,000 SQ FT STRUCTURES WITH SEISMIC BREAKS PER SEISMIC GAPS ON S-2.
5. VERIFY THE SITE SPECIFIC FOUNDATION LOCATIONS MEET WITH SOILS NOTE 8 ON S-3 FOR SET BACK FROM TOP OF SLOPES OR THAT THE GEOTECHNICAL REPORT HAS ALLOWED A SMALLER DISTANCE.
6. VERIFY THE SITE SPECIFIC PLANS PROVIDE THE APPROPRIATE OCCUPANCY AND OCCUPANCY LOAD FACTOR FOR THE SITE. SEE BUILDING DATA ON S-2 FOR SAMPLE ACCEPTABLE OCCUPANCIES AND OCCUPANCY LOAD FACTORS.
7. VERIFY THE SITE SPECIFIC PLANS UTILIZE A RISK CATEGORY II STRUCTURE. RISK CATEGORY II STRUCTURES SHALL NOT PROVIDE SHELTER FOR EMERGENCY VEHICLES OR EQUIPMENT, OR PROVIDE REQUIRED ACCESS TO, REQUIRED EGRESS FROM, OR SHARE A LIFE SAFETY COMPONENT WITH A RISK CATEGORY III OR IV STRUCTURE.
8. VERIFY SELECTION OF USE AND OCCUPANCY CLASSIFICATION PER CBC CHAPTER 3; OCCUPANT LOAD FACTOR PER CBC TABLE 1004.1.2; RISK CATEGORY PER CBC TABLE 1604A.5; TO BE COMPLETED BY DESIGN PROFESSIONAL AT TIME OF DSA OTC OR PROJECT DSA SUBMITTAL.
9. VERIFY APPROPRIATE SEISMIC SEPARATION PER SEISMIC GAPS ON S-2.
10. VERIFY THE SITE SPECIFIC DESIGN PROFESSIONAL HAS APPROPRIATELY ADDRESSED FIRE SEPARATION AND PROPERTY LINE SETBACKS.
11. VERIFY THE SITE SPECIFIC SOLAR PANEL LAYOUT IS PROVIDED WITH DIMENSIONS THAT DO NOT EXCEED THE PC MAXIMUMS. THE MAXIMUM DIMENSIONS SHALL BE TO THE OUTSIDE EDGES OF THE SOLAR PANEL OR THE STRUCTURAL STEEL, WHICH EVER IS GREATER.
12. VERIFY STEEL SELECTIONS HAVE BEEN PROPERLY COORDINATED WITH BEAM/COLUMN SCHEDULES. REFER TO 2/S-8 & 2/S-9.
13. VERIFY SITE SPECIFIC PURLIN CANTILEVERS HAVE BEEN PROPERLY COORDINATED WITH PURLIN SCHEDULES. REFER TO 1/S-8 & 1/S-9.
14. WET STAMPED & SIGNED COPIES OF PC PLANS ARE NOT REQUIRED FOR SITE SPECIFIC PC USE.

SHEET INDEX

S-1.....	COVER SHEET
S-2.....	GENERAL DATA
S-3.....	GENERAL NOTES
S-4.....	SAMPLE DSA-103 FORMS
S-5.....	SECTION PROPERTIES & REBAR DETAILS
S-6.....	VC14, VC18 & VC20 FRAMING PLAN & ELEVATIONS
S-7.....	VC14, VC18 & VC20 FRAMING SCHEDULES
S-8.....	VC140, VC180 & VC200 FRAMING PLAN & ELEVATIONS
S-9.....	VC140, VC180 & VC200 FRAMING SCHEDULES
S-10.....	PIER FOUNDATION & SPREAD FOOTING SCHEDULES
S-11.....	STANDARD DETAILS 1
S-12.....	STANDARD DETAILS 2
S-13.....	SAMPLE ARCHITECTURAL ELEVATIONS
13 SHEETS	

BID INFORMATION

THE STEEL STRUCTURES IN THIS PC ARE
PROPRIETARY TO M BAR C CONSTRUCTION, INC.
THE STEEL WORK SHALL NOT GO OUT TO BID.

PRE-CHECK (PC) DOCUMENT

CODE: 2016 CBC
A SEPARATE PROJECT APPLICATION
FOR CONSTRUCTION IS REQUIRED



ABBREVIATIONS

&	AND
@	AT
⊕	CENTER LINE
A.B.	ANCHOR BOLT
ACI	AMERICAN CONCRETE INSTITUTE
AISC	AMERICAN INSTITUTE OF STEEL CONSTRUCTION
AISI	AMERICAN IRON AND STEEL INSTITUTE
ANSI	AMERICAN NATIONAL STANDARDS INSTITUTE
ASTM	AMERICAN SOCIETY FOR TESTING MATERIALS
AWS	AMERICAN WELDING SOCIETY
BLDG	BUILDING
BL'G	BLOCKING
BM	BEAM
BOTT. OR (B)	BOTTOM
CBC	CALIFORNIA BUILDING CODE
CCD	CONSTRUCTION CHANGE DOCUMENT (DSA)
CCR	CALIFORNIA CODE OF REGULATIONS
CFS	COLD FORMED STEEL
C.J.	CONTROL JOINT
CJP	COMPLETE JOINT PENETRATION
CLR	CLEAR
CMU	CONCRETE MASONRY UNIT
COL.	COLUMN
CONC.	CONCRETE
CONT.	CONTINUOUS
CS	CFS C SECTION WITH FLANGE STIFFENING LIPS
DIA., Ø	DIAMETER
DPRGC	DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE
DSA	DIVISION OF THE STATE ARCHITECT
DWG	DRAWING
(E)	EXISTING
EA.	EACH
E.F.	EACH FACE
E.W.	EACH WAY
EXT.	EXTERIOR
FDN	FOUNDATION
FIN.	FINISH
FLR	FLOOR
FLS	FIRE LIFE SAFETY (DSA)
F.O.C.	FACE OF CONCRETE
F.S.	FAR SIDE
FTG.	FOOTING
GA.	GAUGE
GALV.	GALVANIZED
H.S.B.	HIGH STRENGTH BOLT (ASTM A325 U.N.O.)
HORIZ.	HORIZONTAL
HT.	HEIGHT
IAMPO	INTERNATIONAL ASSOCIATION OF MECHANICAL AND PLUMBING OFFICIALS
ICC	INTERNATIONAL CODE COUNCIL
INT.	INTERIOR
IOR	INSPECTOR OF RECORD
IR	INTERPRETATION OF REGULATIONS (DSA)
JT	JOINT
LG.	LONG
LLH	LONG LEG HORIZONTAL
LLV	LONG LEG VERTICAL
M.B.	MACHINE BOLT (ASTM A307 U.N.O.)
MAX.	MAXIMUM
MFR.	MANUFACTURER
MIN.	MINIMUM
MISC.	MISCELLANEOUS
(N)	NEW
NFPA	NATIONAL FIRE PROTECTION ASSOCIATION
NOM.	NOMINAL
N.S.	NEAR SIDE
NTS	NOT TO SCALE
O.C.	ON CENTER
OTC	OVER THE COUNTER (DSA)
O.H.	OPPOSITE HAND
⊕ OR PL	PLATE
PJP	PARTIAL JOINT PENETRATION
PC	PRE-CHECK (DSA)
PT	PRESSURE TREATED
PV	PHOTOVOLTAIC
REINF.	REINFORCEMENT
REQ'D	REQUIRED
SC	SLIP-CRITICAL JOINT PER ASTM SPECS
SCHED.	SCHEDULE
SEOR	STRUCTURAL ENGINEER OF RECORD
SHT'G	SHEATHING
SIM.	SIMILAR
S.M.S.	SHEET METAL SCREW
SQ.	SQUARE
SS	STAINLESS STEEL
ST	SNUG-TIGHTENED JOINT PER ASTM SPECS
STD	STANDARD
(T)	TOP
T&B	TOP AND BOTTOM
T.O.C.	TOP OF CONCRETE
T.O.S.	TOP OF STEEL
TYP.	TYPICAL
U.N.O.	UNLESS NOTED OTHERWISE
VERT.	VERTICAL
W/-	WITH
W/O	WITHOUT
WHS	WELDED HEADED STUD (ASTM A108 U.N.O.)
W.P.	WORK POINT
WT.	WEIGHT
WTS	WELDED THREADED STUD (ASTM A108 U.N.O.)

GENERAL NOTES

- ALL WORK SHALL CONFORM TO TITLE 24, CALIFORNIA CODE OF REGULATIONS (CCR)
- CHANGES TO THE APPROVED DRAWINGS AND SPECIFICATIONS SHALL BE MADE BY ADDENDA OR CONSTRUCTION CHANGE DOCUMENTS APPROVED BY THE DIVISION OF THE STATE ARCHITECT, AS REQUIRED BY SECTION 4-338, PART 1, TITLE 24, CCR.
- A 'DSA CERTIFIED' PROJECT INSPECTOR EMPLOYED BY THE DISTRICT (OWNER) AND APPROVED BY THE DIVISION OF THE STATE ARCHITECT SHALL PROVIDE CONTINUOUS INSPECTION OF THE WORK. THE DUTIES OF THE INSPECTOR ARE DEFINED IN SECTION 4-342, CALIFORNIA BUILDING STANDARDS ADMINISTRATIVE CODE (PART 1, TITLE 24, CCR).
- A 'DSA CERTIFIED' INSPECTOR WITH CLASS 2 CERTIFICATION IS REQUIRED FOR THIS PROJECT.
- A DSA ACCEPTED TESTING LABORATORY DIRECTLY EMPLOYED BY THE SCHOOL BOARD SHALL CONDUCT ALL THE REQUIRED TESTS AND INSPECTIONS FOR THE PROJECT.
- GRADING PLANS, DRAINAGE IMPROVEMENTS, ROAD AND ACCESS REQUIREMENTS AND ENVIRONMENTAL HEALTH CONSIDERATIONS SHALL COMPLY WITH ALL LOCAL ORDINANCES.
- IF THE PROJECT IS DIVIDED INTO INCREMENTS: THE SCOPE OF WORK FOR EACH INCREMENT MUST BE CLEARLY SPECIFIED ON THE TITLE SHEET OF ALL INCREMENTS SUBMITTED.


CONSTRUCTION OPTIONS

* ALL CONSTRUCTION OPTIONS INCLUDE OPTIONS FOR CONCRETE DRILLED PIERS AND/OR SPREAD FOOTINGS.

- 14'-0" MAX WIDTH, 3:12 MAX ROOF SLOPE, 17'-0" MAX COLUMN HEIGHT, 0 psf GROUND SNOW
- 18'-0" MAX WIDTH, 3:12 MAX ROOF SLOPE, 17'-9" MAX COLUMN HEIGHT, 0 psf GROUND SNOW
- 20'-0" MAX WIDTH, 3:12 MAX ROOF SLOPE, 17'-0" MAX COLUMN HEIGHT, 0 psf GROUND SNOW
- 14'-0" MAX WIDTH, 3:12 MAX ROOF SLOPE, 17'-5" MAX COLUMN HEIGHT, 20 psf GROUND SNOW
- 18'-0" MAX WIDTH, 3:12 MAX ROOF SLOPE, 16'-6" MAX COLUMN HEIGHT, 20 psf GROUND SNOW
- 20'-0" MAX WIDTH, 3:12 MAX ROOF SLOPE, 16'-9" MAX COLUMN HEIGHT, 20 psf GROUND SNOW

SEISMIC GAPS

OPTION	MAX COLUMN HEIGHT	GAP X	GAP Y
VC14	17'-0"	2½"	7"
VC18	17'-9"	3½"	9½"
VC20	17'-0"	2½"	7"
VC140	17'-5"	3½"	9"
VC180	16'-6"	3"	8½"
VC200	16'-9"	3"	8"

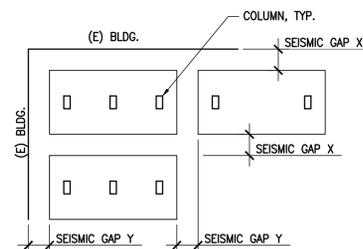

- NOTE
- SEISMIC GAPS LISTED ARE THE MINIMUM GAPS BETWEEN ANY TWO STRUCTURES (I.E. CANOPIES, BUILDINGS) AND DO NOT NEED TO BE COMBINED OR DOUBLED.
 - DIMENSIONS, QUANTITIES, AND LOCATIONS OF STRUCTURES AND COLUMNS SHOWN ABOVE ARE FOR ILLUSTRATIVE PURPOSES ONLY. SEE SITE-SPECIFIC SHEETS FOR LAYOUTS AND QUANTITIES.

STRUCTURAL DATA

LATERAL RESISTING SYSTEM..... STEEL ORDINARY CANTILEVER COLUMN
 FOUNDATION CONCRETE DRILLED PIERS AND SPREAD FOOTINGS
 TESTING AND INSPECTION LIST..... SEE SHEETS S-3 & S-4

DESIGN PARAMETERS

RISK CATEGORY II
 ROOF LIVE LOAD (L_p):
 DECK ONLY 20 psf
 POINT LOAD 300 lb

SNOW LOAD:
 MAX. DRIFT SNOW LOAD..... 0 psf, 20 psf (SEE CONSTRUCTION OPTIONS)

MAXIMUM DEAD LOAD:
 ROOF DECK..... 0.89 psf

WIND: ASCE 7-10 METHOD 2 - ANALYTICAL PROCEDURE
 BASIC WIND SPEED..... 110 mph⁽¹⁾
 WIND EXPOSURE C⁽¹⁾
 INTERNAL PRESSURE N/A (OPEN STRUCTURE)
 WIND DIRECTIONALITY FACTOR K_d = 0.85
 VELOCITY PRESSURE COEFFICIENT..... K_e = 0.90
 TOPOGRAPHIC FACTOR K_{zt} = 1.00

SEISMIC: ASCE 7-10
 SEISMIC IMPORTANCE FACTOR I = 1.0
 RESPONSE MODIFICATION FACTOR..... R = 1.25
 MAPPED SPECTRAL RESPONSE S_s = 3.22⁽²⁾
 ACCELERATION S₁ = 1.39
 SITE CLASS D
 DESIGN SPECTRAL RESPONSE S_{DS} = 2.133
 S₁₁ = 1.390
 SEISMIC DESIGN CATEGORY D (E WITH GROUND MOTION ANALYSIS)
 SEISMIC FORCE RESISTING SYSTEM STEEL ORDINARY CANTILEVER COLUMN
 SEISMIC RESPONSE COEFFICIENT C_s = 1.707
 ANALYSIS PROCEDURE EQUIVALENT LATERAL FORCE

- NOTES:
- THE PC COMPONENTS & CLADDING AND MAIN WIND FORCE RESISTING SYSTEM DESIGN WIND PRESSURE q_s = 23.7 psf DETERMINED FROM THE CRITERIA LISTED ABOVE. (EXPOSURE C, K_e=0.960, K_{zt}=1.0, K_d = 0.85).

THE PC MAY BE USED FOR RISK CATEGORY II TYPE STRUCTURES IN ANY WIND ZONE WHERE q_s ≤ 23.7 psf.

EXAMPLE:
 SITE BASIC WIND SPEED, V = 120 mph
 RISK CATEGORY II
 WIND: EXPOSURE B
 K_d = 0.85
 K_e = 0.701
 K_{zt} = 1.00
 q_s = 22.0 psf < 23.7 psf

THE PC MAY BE USED AT THIS SITE, PENDING DSA SITE SPECIFIC APPROVAL.

- THE PC SEISMIC FORCE RESISTING SYSTEM IS GOVERNED BY C_s = 1.707 FROM THE CRITERIA LISTED ABOVE. (R = 1.25, S_s = 3.2, I_e = 1.00).

THE PC MAY BE USED FOR RISK CATEGORY II STRUCTURES AT ANY SITE WHERE THE SITE SPECIFIC SEISMIC PARAMETER S_s AND R = 1.25 RESULT IN A VALUE C_s ≤ 1.707.

EXAMPLE:
 RISK CATEGORY II
 SOIL: SITE CLASS A
 S_s = 3.4
 S₁ = 1.8
 R = 1.25
 I = 1.00
 S_{DS} = 1.813
 C_s = 1.451 < 1.707

THE PC MAY BE USED AT THIS SITE, PENDING DSA SITE SPECIFIC APPROVAL.

BUILDING DATA

TYPE OF CONSTRUCTION..... IIB
 OCCUPANCY..... VARIES - SEE EXAMPLES
 NUMBER OF STORIES..... 1
 BUILDING AREAS..... VARY DUE TO OCCUPANCY - SEE EXAMPLES
 MODULE SIZES..... VARY WITH OPTIONS
 BUILDING LENGTH:
 ALL WIDTHS..... MAX. 500'-0" LENGTH

NOTE: NO SEISMIC AND/OR THERMAL EXPANSION JOINTS REQUIRED ALONG THE LENGTH OF THE STRUCTURES. (ALL JOINTS ARE INTERNAL)

OCCUPANCY AND BUILDING AREA EXAMPLES:
 ALL STRUCTURES SHALL BE BASED ON RISK CATEGORY II STRUCTURE.

A OCCUPANCY:

EXAMPLE 1:
 STRUCTURES LOCATED OVER LUNCH AREA WITHOUT FIXED SEATING
 OCCUPANCY: A-2
 OCCUPANCY LOAD: 15 sf/person - MAX 300 FOR RISK II
 MAX SQ FT: 4,500 sq ft

EXAMPLE 2:
 STRUCTURES LOCATED OVER LUNCH AREA WITH FIXED SEATING
 OCCUPANCY: A-2
 OCCUPANCY LOAD: 18"/person ALONG LINEAR BENCH - MAX 300 FOR RISK II
 MAX SQ FT: 5,400 LINEAR INCHES OF FIXED SEATING UNDER THE STRUCTURE

EXAMPLE 3:
 STRUCTURES LOCATED OVER AN AREA DESIGNATED FOR ASSEMBLY (TYPICALLY AMPHITHEATER, OR OTHER SPACE WITH FIXED SEATING OR DESIGNATED AS A STANDING ASSEMBLY AREA)
 OCCUPANCY: A
 OCCUPANCY LOAD: 7 sf/person - MAX 300 FOR RISK II
 MAX SQ FT: 2,100 sq ft

SHADE STRUCTURE

EXAMPLE 1:
 STRUCTURES LOCATED OVER A FIELD, BLACKTOP, PLAYGROUND EQUIPMENT,OR OTHER NON DESIGNATED USE SPACES
 OCCUPANCY: E
 OCCUPANCY LOAD: 20 sf/person - MAX 250 FOR RISK II
 MAX SQ FT: 5,000 sq ft

PARKING

EXAMPLE 1:
 STRUCTURES LOCATED OVER PARKING
 OCCUPANCY: S-2
 OCCUPANCY LOAD: 200 sf/person
 MAX SQ FT: UNLIMITED PER CBC 406.5.4 AND 406.5.5

CODES

TITLE 24, CCR CODES:

- 2016 CALIFORNIA ADMINISTRATIVE CODE (CAC) (PART 1, TITLE 24, CCR)
- 2016 CALIFORNIA BUILDING CODE (CBC), VOLUMES 1 AND 2 (PART 2, TITLE 24, CCR) (2015 INTERNATIONAL BUILDING CODE WITH 2016 CALIFORNIA AMENDMENTS)
- 2016 CALIFORNIA ELECTRICAL CODE (PART 3, TITLE 24, CCR) (2014 NATIONAL ELECTRICAL CODE WITH 2016 CALIFORNIA AMENDMENTS)
- 2016 CALIFORNIA MECHANICAL CODE (CMC) (PART 4, TITLE 24, CCR) (2015 UNIFORM MECHANICAL CODE WITH 2016 CALIFORNIA AMENDMENTS)
- 2016 CALIFORNIA PLUMBING CODE (CPC) (PART 5, TITLE 24, CCR) (2015 UNIFORM PLUMBING CODE WITH 2016 CALIFORNIA AMENDMENTS)
- 2016 CALIFORNIA ENERGY CODE (PART 6, TITLE 24, CCR) (2016 EDITION CALIFORNIA ENERGY COMMISSION BUILDING ENERGY EFFICIENCY STANDARDS)
- 2016 CALIFORNIA FIRE CODE (CFC) (PART 9, TITLE 24, CCR) (2015 INTERNATIONAL FIRE CODE WITH 2016 CALIFORNIA AMENDMENTS)
- 2016 CALIFORNIA GREEN BUILDING STANDARDS CODE (PART 11, TITLE 24, CCR)
- 2016 CALIFORNIA REFERENCED STANDARDS CODE (PART 12, TITLE 24, CCR) NFPA 13 - 2016 NFPA 72 - 2016

REFERENCE CODE SECTIONS FOR APPLICABLE STANDARDS:

- 2016 CBC, CHAPTER 35
- 2016 CFC, CHAPTER 80

FIRE LIFE SAFETY

AUTOMATIC FIRE SPRINKLERS REQUIRED? (Y/N)..... N

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP: 01-118970 INC:
 REVIEWED FOR
 SS FLS ACS
 DATE: 08/11/2020
 5885

ENGINEER'S APPROVAL
 DATE SIGNED
 11/28/2018

SITE SPECIFIC DSA APPROVAL

PRE-CHECK (PC) DOCUMENT
 CODE: 2016 CBC
 A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED

MBARC CONSTRUCTION INC.
 674 RANCHEROS DR
 SAN MARCOS, CA 92069
 PHONE: (760) 744-4131
 FAX: (760) 744-4449
 GREGJ@MBARCONLINE.COM (775) 787-8845
 IIC # 869980
 B AND C51


ASTEL ENGINEERING
 STRUCTURAL ENGINEERING
 26030 ACHERO, SUITE 200
 MISSION VIEJO, CA 92691
 PHONE: (949) 305-1150
 FAX: (949) 305-1420

VERSA CANOPY GENERAL DATA

DRAWN GM
 CHECKED KS
 DATE 11/28/2018
 4STEL JOB NO. MC03-01
 SHEET S-2
 2 OF 13 SHEETS

SOILS NOTES

- IF NO GEOTECHNICAL REPORT IS SUPPLIED AT THE TIME OF DSA REVIEW ADDRESSING SITE-SPECIFIC PARAMETERS, FOUNDATION SELECTIONS SHALL BE BASED ON CLASS W SOILS (SOIL CLASS 5 OF CBC TABLE 1806A.2 WITH DOUBLING OF LATERAL BEARING PRESSURE FOR STRUCTURES NOT ADVERSELY AFFECTED BY 1/2" MOTION AT GROUND SURFACE) IN THE SOIL CLASS TABLE BELOW.
- WHEN A GEOTECHNICAL REPORT IS SUPPLIED THE GEOTECHNICAL ENGINEER SHALL REVIEW THE SITE CONDITIONS, TESTING RESULTS, AND ALL ALLOWABLE INCREASES AND SUPPLY THE FINAL SOIL CLASS TO BE USED FROM THE BELOW TABLE. THE GEOTECHNICAL ENGINEER SHALL PROVIDE IN THE GEOTECHNICAL REPORT THE FOLLOWING BASE VALUES WITHOUT INCREASE FOR 24" DIAMETER PIERS: THE ALLOWABLE VERTICAL END BEARING, ALLOWABLE LATERAL BEARING, ALLOWABLE DOWNWARD SKIN FRICTION, ALLOWABLE SKIN FRICTION TO RESIST UPLIFT. THE GEOTECHNICAL ENGINEER SHALL ALSO PROVIDE ANY ALLOWABLE INCREASES TO THE BASE VALUES. ALLOWABLE INCREASES ARE TYPICALLY DUE TO BUT NOT EXCLUSIVE TO: DOUBLE VALUES DUE TO ISOLATED FOUNDATIONS, DOUBLE VALUES DUE TO THE STRUCTURE NOT BEING ADVERSELY AFFECTED BY 1/2" DEFLECTION AT THE SURFACE, A 4/3 INCREASE DUE TO SHORT TERM LOADING, AND ANY OTHER ALLOWABLE INCREASES. THE GEOTECHNICAL ENGINEER SHALL MAKE RECOMMENDATION OF THE SOIL CLASS TO BE USED AFTER ALL INCREASES HAVE BEEN APPLIED. ALL FOUNDATIONS HAVE BEEN DESIGN BASED ON THE VALUES PRESENTED IN THE BELOW TABLE. THE GEOTECHNICAL REPORT SHALL ADDRESS IF THE USE OF STEEL CASING THAT IS TWISTED INTO PLACE AND LEFT INSTALLED AFFECTS ANY ALLOWABLE VALUES.
- THE GEOTECHNICAL ENGINEER MAY SPECIFY DIFFERENT SOILS CLASSES TO BE USED FOR THE DIFFERENT STRUCTURE TYPES (VC14 OR VC20), DIFFERENT AREAS OF THE SITE (I.E. NORTH LOT OR WEST LOT), OR THE ENGINEER MAY SPECIFY ONE SOILS CLASS TO BE USED FOR THE ENTIRE SITE.
- THE GEOTECHNICAL ENGINEER SHALL ADDRESS IN THE REPORT ANY CONCRETE DURABILITY REQUIREMENTS IN ACCORDANCE WITH ACI 318-11 CHAPTER 4.
- THE GEOTECHNICAL REPORT SHALL BE SPECIFIC TO THE LOCATION OF THE STRUCTURES. BORING(S) SHALL BE DONE AT THE SPECIFIC LOCATION(S) WHERE THE STRUCTURES ARE TO OCCUR. THE GEOTECHNICAL REPORT SHALL CONFORM TO 2016 CBC SECTION 1803A.
- A COPY OF THE GEOTECHNICAL REPORT SHALL BE PROVIDED AT THE TIME OF PLAN REVIEW.
- AT THE TIME OF PLAN REVIEW, THE DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE SHALL SELECT A SOILS CLASS ON THE SITE-SPECIFIC PLANS BASED ON THE GEOTECHNICAL REPORT (OR NOTE 1 ABOVE). HOLES MAY BE LEFT OPEN FOR ANY AMOUNT OF TIME AS LONG AS THEY ARE PROPERLY COVERED FOR OSHA STANDARDS.
- FOUNDATIONS ADJACENT TO SLOPED GROUND SURFACES SHALL BE SET BACK PER THE FOLLOWING FIGURE UNLESS OTHERWISE RECOMMENDED BY A SITE SPECIFIC GEOTECHNICAL REPORT.

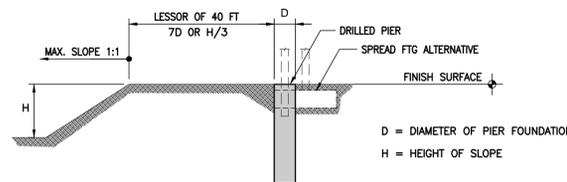

DESIGN SOIL VERTICAL AND LATERAL BEARING VALUES

SOIL CLASS	VERTICAL BEARING PRESSURE (psf)	LATERAL BEARING PRESSURE (psf/ft)	MAXIMUM LATERAL BEARING (psf)	MIN. DOWNWARD SKIN FRICTION (psf)	MIN. UPWARD SKIN FRICTION (psf)
CLASS W	1,500	267	4,000	225	50
CLASS X	2,000	400	6,000	250	75
CLASS Y	2,000	533	8,000	275	75
CLASS Z	3,000	800	12,000	325	100

SPECIAL INSPECTION

- SOILS:**
 - VERIFY THE SITE HAS BEEN PREPARED PROPERLY PRIOR TO PLACEMENT OF CONTROLLED FILL AND/OR EXCAVATIONS FOR FOUNDATIONS.
 - VERIFY THAT THE FOUNDATION EXCAVATIONS ARE EXTENDED TO PROPER DEPTH AND HAVE REACHED PROPER MATERIAL.
 - VERIFY THAT MATERIALS BELOW FOOTINGS ARE ADEQUATE TO ACHIEVE THE DESIGN BEARING CAPACITY.
- PIER FOUNDATIONS:**
 - INSPECT DRILLING OPERATIONS AND MAINTAIN COMPLETE AND ACCURATE RECORDS FOR EACH PIER.
 - VERIFY LOCATIONS OF PIERS.
- CONCRETE:**
 - VERIFY USE OF REQUIRED DESIGN MIX, DETERMINE THE TEMPERATURE OF THE CONCRETE, AND (WHERE REQUIRED) PERFORM AIR CONTENT TEST.
 - TEST CONCRETE (COMPRESSION TEST).
 - INSPECT PLACEMENT OF FORMWORK, REINFORCING STEEL, EMBEDDED ITEMS, AND CONCRETE. INSPECT CURING AND FORM REMOVAL.
 - SLUMP TEST SHALL BE PERFORMED PER SITE SPECIFIC DSA-103.
- STEEL:**
 - VERIFY THAT ALL MATERIALS ARE APPROPRIATELY MARKED AND THAT:
 - MILL CERTIFICATES INDICATE MATERIAL PROPERTIES THAT COMPLY WITH REQUIREMENTS.
 - MATERIAL SIZES, TYPES AND GRADES COMPLY WITH REQUIREMENTS.
 - TEST UNIDENTIFIED MATERIALS.
 - VERIFY MEMBER LOCATIONS, BRACING AND ALL DETAILS CONSTRUCTED IN THE FIELD.
 - VERIFY STIFFENER LOCATIONS, CONNECTION TAB LOCATIONS, AND ALL CONSTRUCTION DETAILS FABRICATED IN THE SHOP.
 - HIGH STRENGTH SLIP CRITICAL BOLTING.
- SHOP FABRICATION:**
 - VERIFY FABRICATOR'S FABRICATION AND QUALITY CONTROL PROCEDURES.
 - VERIFY ALL ASPECTS OF SHOP FABRICATION INCLUDING MEMBER LOCATIONS, DIMENSIONAL LAYOUT OF ALL PARTS AND PIECES, BOLTING, ETC.
- SEE DSA APPROVED 103 FOR ADDITIONAL REQUIREMENTS.

GENERAL NOTES

- DESIGN PER 2016 C.B.C. AND ITS PRESCRIBED LOADING AND MATERIAL SPECIFICATIONS:
 - ASCE 7-10
 - 14TH EDITION AISC STEEL CONSTRUCTION MANUAL
 - 2012 AISI COLD FORMED STEEL STANDARD
 - ACI 318-14
- THESE STRUCTURES ARE NOT DESIGNED TO BE, NOR SHALL THEY BE, ENCLOSED.
- ALL DIMENSIONS, CONDITIONS, AND ELEVATIONS ARE TO BE FIELD VERIFIED BY THE CONTRACTOR PRIOR TO COMMENCING WORK OR FABRICATION. IF ANY DISCREPANCIES ARE FOUND OR IF ANY CONDITION EXISTS NOT AS SHOWN ON THE DRAWINGS THE DESIGN PROFESSIONAL IN RESPONSIBLE CHARGE SHALL BE NOTIFIED IMMEDIATELY.
- IF THE SNOW LOAD OPTION IS USED THEN THE SITE-SPECIFIC MAX GROUND SNOW LOADING INCLUDING DRIFT MUST BE LESS THAN OR EQUAL TO 20 PSF.
- ALL SCREWS TO BE ITW BUILDEX TEK SCREWS PER ICC ESR-1976 OR ELCO DRILL SCREW PER ICC ESR-3294.
- OWNER TO SIGN AUTHORIZATION TO PROCEED PRIOR TO DRILLING.



Authorization to Proceed

Project Name: _____ Foreman: _____
 Site Name: _____ Contractor: _____

As an authorized representative of Contractor listed above, I, _____ agree to the following statements below:

_____(initial) **LAYOUT:** The onsite layout for installation of structural steel for carports and canopies has been inspected and is approved as is.

_____(initial) **ARRAY ORIENTATION/CONCRETE POUR:** The tilt and direction of the canopies have been verified and are approved as is.

ARRAYS:

It is understood that additional costs will apply due to the following delays: re-layout not due to M Bar C, underground site conflicts (unmarked utility lines, including but not limited to water, sewer, fire, irrigation, electrical); encountered underground water; change in soils condition, including but not limited to hard drilling, caving soils, obstructions).

BY: _____ DATE: _____
 (signature)

www.mbaronline.com

STEEL NOTES

- COLD FORMED STEEL SIZES ARE BASED ON BARE STEEL THICKNESS.
- STRUCTURAL PURLIN, BEAM & COLUMN MEMBERS SHALL HAVE MINIMUM STEEL YIELD STRENGTHS
- STRUCTURAL STEEL SHALL BE HOT-DIP GALVANIZED (MINIMUM ASTM A123 OR A153, CLASS D) OR PAINTED WITH ZINC-RICH PRIMER, UNDERCOAT, AND FINISH COAT; OR EQUIVALENT PAINT SYSTEM. COLD-FORMED STEEL MEMBERS SHALL BE 55% ALUMINUM-ZINC ALLOY COATED PER ASTM A792/A792M STANDARD IN ACCORDANCE TO AISI S200 TABLE A4-1, CP 90 COATING DESIGNATION.
- ALL EXPOSED STEEL FASTENERS, INCLUDING CAST IN PLACE ANCHOR BOLTS/RODS, SHALL BE STAINLESS STEEL (TYPE 304 MINIMUM), HOT-DIP GALVANIZED (ASTM A153, CLASS D MINIMUM OR ASTM F2329), OR PROTECTED WITH CORROSION-PREVENTIVE COATING THAT DEMONSTRATED NO MORE THAN 2% OF RED RUST IN MINIMUM 1,000 HOURS OF EXPOSURE IN SALT SPRAY TEST PER ASTM B117. ZINC-PLATED FASTENERS DO NOT COMPLY WITH THIS REQUIREMENT. (EXAMPLE PROPRIETARY COATINGS THAT COMPLY WITH THE 1000 HOUR REQUIREMENT INCLUDE BUT ARE NOT NECESSARILY LIMITED TO: QUIK GUARD BY SIMPSON, KWIK-COTE BY HILTI, STALGARD BY ELOCO, VISTA-CORR BY SFS INTEC, ETC.)
- STEEL FABRICATION SHALL COMPLY WITH LATEST AISC SPECIFICATIONS.
- HOLLOW STRUCTURAL STEEL (HSS) MEMBERS SHALL BE ASTM A1085 GR. 50 U.N.O. ASTM A1085 STEEL HAS THE SAME OR BETTER PROPERTIES AND WELDABILITY THAN ASTM A500 GR. B.
- COLD FORMED STEEL (CFS) MEMBERS SHALL BE ASTM A653 SS GR. 55 (F_y = 55 ksi, F_u = 70 ksi) OR ASTM A1011 SS GR. 55 (F_y = 55 ksi, F_u = 70 ksi).
- ZINC COATING OF STRUCTURAL STEEL SHALL CONFORM WITH G90 STANDARD OR BETTER. COLD FORMED STEEL (CFS) MEMBERS TO BE GALVANIZED IN ACCORDANCE WITH ASTM A653 G90 STANDARD. HOLLOW STRUCTURAL STEEL (HSS) MEMBERS SHALL BE GALVANIZED IN ACCORDANCE WITH ASTM A123, UNLESS NOTED OTHERWISE.
- ALL STEEL MEMBERS TO BE GALVANIZED OR PAINTED WITH ZINC-RICH PRIMER, UNDERCOAT AND FINISH COAT OR EQUIVALENT PAINT SYSTEM. CONTRACT DOCUMENTS SHALL SPECIFY THE TYPE OF SSPC CORROSION RESISTING SYSTEM TO BE UTILIZED AND THE SSPC GRADE FOR CLEANING, MINIMUM SSPC GRADE SP2.
- BOLTS SHALL CONFORM TO THE ASTM A307 SPECIFICATIONS UNLESS NOTED OTHERWISE. INSPECTION OF A307 BOLTING IS NOT REQUIRED.
- ASTM A307 BOLTS MAY BE SUBSTITUTED WITH THE SAME NUMBER AND SIZE OF SAE J429 GRADE 2 BOLTS.
- BOLTS SHALL BE TIGHTENED TO SNUG-TIGHT CONDITION UNLESS NOTED OTHERWISE EXCEPT FOR A325-SC HIGH STRENGTH BOLTS USED IN THE BEAM TO COLUMN CONNECTION.
- A325-SC BOLTS SHALL BE PRE-TENSIONED PER AISC SPECIFICATIONS USING APPROVED LOAD INDICATOR METHODS INCLUDING BUT NOT LIMITED TO TURN-OF-THE-NUT WITH MATCH MARKING, TWIST OFF TENSION CONTROL OR DIRECT TENSION INDICATOR BOLT, NUT AND WASHER ASSEMBLIES.
- ASTM A307 BOLTS SHALL HAVE STANDARD WASHERS UNDER THE NUT & BOLT HEAD (F436 WASHERS ARE NOT REQUIRED). STANDARD WASHERS DO NOT REQUIRE HARDNESS TEST.
- BOLT HOLES FOR 1/2" BOLTS SHALL BE AS FOLLOWS:
 STANDARD HOLES: 3/8"

CONCRETE NOTES

- CONCRETE MIN. 4,500 PSI AT 28 DAYS UNLESS A SOILS REPORT IS PROVIDED THAT ALLOWS FOR A LOWER STRENGTH (3,000 PSI MIN.). BATCH PLANT INSPECTION NOT REQUIRED.
- CONCRETE SHALL MEET THE FOLLOWING MINIMUM REQUIREMENTS BASED ON EXPOSURE CLASS IN ACCORDANCE WITH ACI 318-14 TABLE 19.3.2.1 WHEN DETERMINED BY A SITE-SPECIFIC GEOTECHNICAL REPORT.

REQUIREMENTS FOR CONCRETE BASED ON EXPOSURE CLASS

EXPOSURE CLASS ACI TABLE 19.3.2.1	MINIMUM CONCRETE STRENGTH F _c	CEMENT TYPE ASTM C150	MAX. WATER/CEMENT RATIO W/M
NOT DETERMINED	4,500 PSI	TYPE IV	0.45
FO, SO, PO, CO, C1	3,000 PSI	TYPE II	N/A
S1, P1	4,000 PSI	TYPE II	0.50
ALL OTHER	4,500 PSI	TYPE V	0.45

- CONCRETE EXPOSED TO THAW AND FREEZE CYCLE SHALL BE AIR ENTRAINED PER ACI 318-14 TABLE 19.3.1.1.
- CONCRETE TO ATTAIN 1000 PSI PRIOR TO REMOVAL OF SHORING AND/OR INSTALLATION OF BEAMS AND PURLINS. (NOTE: A HIGHER COMPRESSIVE CONCRETE MAY BE USED TO ACHIEVE 1000 PSI SOONER. SUBMIT CONCRETE MIX DESIGN PREPARED BY A QUALIFIED LICENSED PROFESSIONAL ENGINEER FOR APPROVAL BY THE DESIGN PROFESSIONAL IN RESPONSIBLE CHARGE PRIOR TO BEING PLACED.)
- CONCRETE TO REACH 3000 PSI PRIOR TO INSTALLATION OF ROOF DECK. (NOTE: A HIGHER COMPRESSIVE CONCRETE MAY BE USED TO ACHIEVE 3000 PSI SOONER. SUBMIT CONCRETE MIX DESIGN PREPARED BY A QUALIFIED LICENSED PROFESSIONAL ENGINEER FOR APPROVAL BY THE DESIGN PROFESSIONAL IN RESPONSIBLE CHARGE PRIOR TO BEING PLACED.)
- REINFORCEMENT BARS SHALL BE ASTM A615, GR60 TYPICAL, U.N.O.
- MINIMUM CONCRETE COVER SHALL BE 2" TO EARTH (DRILLED PIER FOUNDATIONS ONLY), 3" TO EARTH ALL OTHER CONCRETE, 2" TO EXPOSED SURFACES PER CBC TABLE 1808A.8.2
- ALL REINFORCING STEEL AND OTHER EMBEDDED ITEMS SHALL BE SECURELY POSITIONED PRIOR TO THE POURING OF CONCRETE.
- ALL CONCRETE WORK SHALL COMPLY WITH ACI 301 & 318 STANDARDS.
- AGGREGATE GRADATION AND QUALITY SHALL BE IN ACCORDANCE WITH ACI 302-R.
- COLD JOINTS SHALL HAVE A ROUGHENED SURFACE. BONDING AGENT SHALL COMPLY WITH ASTM C1059. A SUBMITTAL FOR CONCRETE BONDING AGENT SHALL BE APPROVED BY DESIGN PROFESSIONAL IN RESPONSIBLE CHARGE PRIOR TO INSTALLATION. DSA INSPECTOR OF RECORD TO PERIODICALLY INSPECT INSTALLATION OF BONDING AGENT.
- BATCH PLANT INSPECTION NOT REQUIRED PER CBC 1705A3.3.2. SUBJECT TO:
 - A LICENSED WEIGHMASTER SHALL POSITIVELY IDENTIFY QUANTITY OF MATERIALS AND CERTIFY EACH LOAD BY A BATCH TICKET.
 - BATCH TICKETS, INCLUDING MATERIAL QUANTITIES AND WEIGHTS SHALL ACCOMPANY THE LOAD, SHALL BE TRANSMITTED TO THE INSPECTOR OF RECORD BY THE TRUCK DRIVER WITH LOAD IDENTIFIED THEREON. THE LOAD SHALL NOT BE PLACED WITHOUT A BATCH TICKET IDENTIFYING THE MIX. THE INSPECTOR OF RECORD SHALL KEEP A DAILY RECORD OF PLACEMENTS, IDENTIFYING EACH TRUCK, ITS LOAD, AND TIME OF RECEIPT AT THE JOBSITE, AND APPROXIMATE LOCATION OF DEPOSIT IN THE STRUCTURE AND SHALL MAINTAIN A COPY OF THE DAILY RECORD AS REQUIRED BY THE ENFORCEMENT AGENCY.
- CONCRETE MAY BE PUMPED, POURED, TAILGATED, OR OTHER SUCH METHODS INTO PLACE. CONCRETE SHALL BE ALLOWED TO FREE FALL THE ENTIRE DEPTH OF THE FOUNDATION. PLACEMENT OF ANY FREE-FALL CONCRETE SHALL BE SUCH THAT THE CONCRETE DOES NOT ALTER THE EMBEDMENT DEPTH OR THE CLEARANCE OF THE REINFORCING BAR CAGE OR OTHER EMBEDDED MATERIALS.

ENGINEER'S APPROVAL

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT

APP: 01-118970 INC.
 REVIEWED FOR
 SS FLS ACS
 DATE: 08/11/2020

DATE SIGNED
 11/28/2018

SITE SPECIFIC DSA APPROVAL

PRE-CHECK (PC) DOCUMENT

FILE NUMBER: PC-119
 IDENTIFICATION STAMP
 DIVISION OF THE STATE ARCHITECT
 APP. NO. 04 - 117117 INCR
 AC DF _____ FLS DS _____ SS DP _____
 DATE 12/05/2018

MBARC CONSTRUCTION INC.

674 RANCHEROS DR
 SAN MARCOS, CA 92069
 GREGJ@MBARCONLINE.COM

PHONE: (760) 744-4131
 FAX: (760) 744-4449

IC # 869960
 B AND C 51
 (775) 787-8845

ASTEL ENGINEERING
 STRUCTURAL ENGINEERING

26030 ACHERO, SUITE 200
 MISSION VIEJO, CA 92691

PHONE: (949) 305-1150
 FAX: (949) 305-1420

VERSACANOPY GENERAL NOTES

DRAWN GM
 CHECKED KS
 DATE 11/28/2018
 4STEL JOB NO. MC03-01
 SHEET S-3
 3 OF 13 SHEETS

DSA DSA-103 Issued 01/2017
List of Required Structural Tests & Special Inspections - 2016 CBC

INCREMENT # [] DSA File No.: PC-119 Application No.: SA-117117
 Date Submitted: [] Revised: []

Sheet Name: Spread Footings without post installed anchors Sheets: []

IMPORTANT: This form is only a summary list of structural tests and some of the special inspections required for the project. Generally, the structural tests and special inspections noted on this form are those that will be performed by the Geotechnical Engineer of Record, Laboratory of Record, or Special Inspector. The actual complete test and inspection program must be performed as detailed on the DSA approved documents. The appendices at the bottom of this form identify work NOT subject to DSA requirements for special inspection or structural testing. The project inspector is responsible for providing inspection of all facets of construction, including but not limited to, special inspections not listed on this form such as structural wood framing, high-strength wood diaphragms, cold-formed steel framing, anchorage of non-structural components, etc., per Title 24, Part 2, Chapter 17A. NOTE: This form is also available for projects submitted for review under the 2007, 2010, and 2013 CBC.

INSTRUCTIONS: Click a plus sign (+) before any category or subcategory to reveal additional tests and special inspections. A shaded box indicates a test or special inspection that may be required, depending on the scope of the construction and other issues. A shaded box can be checked indicating your selection of that test. Note: A minus (-) on a category or subcategory heading indicates that it can be collapsed. However, any selection you may have made will be observed. Click on the "COMPLETE" button to show only the tests and inspections fully selected. For more information on use of this form, see DSA-103.INSTR.

Note: References are to the 2016 edition of the California Building Code (CBC) unless otherwise noted.

TEST OR SPECIAL INSPECTION	TEST	PERIODIC	CONTINUOUS	CODE REFERENCE AND NOTES
SOILS				
1. GENERAL:				Table 1705A.6
X	Verify that:			
	• all test specimens are properly placed to placement of controlled fill and/or soil for foundation.			
	• foundation excavations are extended to proper depth and have reached proper materials, and	Periodic	GE	* By geotechnical engineer or his or her qualified representative. (See Appendix for exemptions.)
	• materials below footings are adequate to achieve the design bearing capacity.			
4. CAST-IN-PLACE DEEP FOUNDATIONS (PIERS):				Table 1705A.8
X	Inspect drilling operations and test specimens and recover records for each pier.	Continuous	GE	* By geotechnical engineer or his or her qualified representative. (See Appendix for exemptions.)
X	Verify pier location, dimensions, placement, bell dimensions (if applicable), length, and embedment into rock (if applicable). Record concrete or grout volumes.	Continuous	GE	* By geotechnical engineer or his or her qualified representative. (See Appendix for exemptions.)
X	Confirm adequate and strata bearing capacity.	Continuous	GE	* By geotechnical engineer or his or her qualified representative. (See Appendix for exemptions.)
X	Concrete piles.	Provide tests and inspections per CONCRETE section below.		
CONCRETE				Table 1705A.3, ACI 318-14 Sections 26.12 & 26.13
7. CAST IN PLACE CONCRETE				
X	Material Verification and Testing:			
X	Verify use of required design mix.	Periodic	SI	Table 1705A.3 Item 5, 1916A.1 (1909.3.7), * To be performed by qualified batch-plant inspector and concrete sampling technician.
X	Identify, sample, and test reinforcing steel.	Test	LOR	1916A.2 (1909.4.7), ACI 318-14 Section 26.6.1.2, DSA IR 17-10.16
X	During concrete placement, fabricate specimens for strength tests, perform pump and air content tests, and determine the temperature of the concrete.	Test	LOR	Table 1705A.3 Item 6, ACI 318-14 Sections 26.5.9 & 26.12
X	Test concrete (f _c).	Test	LOR	1905A.1.6 (1909.3.7), ACI 318-14 Section 26.12.
MASONRY				TMS 402-13ACI 530-13ASCE 5-13 Table 2.1.3 & TMS 602-13ACI 530-13ASCE 6-13 Table 5
STEEL, ALUMINUM				Table 1705A.2.1, ASCE 310-10, ASCE 310-10, ASCE 310-10, ASCE 310-10
17. STRUCTURAL STEEL, COLD-FORMED STEEL, AND ALUMINUM USED FOR STRUCTURAL PURPOSES				
X	Verify identification of all materials and:	Periodic	SI	2293A.1 (2003.1.7), Table 1705A.2.1 Item 3a-3c; AISI S100-07/08-10 Section A2.1 & A2.2, AISI S200-12 Sections 4.3, AISI S200-11 Section A4. * By special inspector or qualified technician when performed off-site.
X	Material labels, types and grades comply with requirements.	Periodic	SI	2293A.1 (2003.1.7)
X	Test underlaid materials.	Test	LOR	2293A.1 (2003.1.7)
X	Examine seam welds of HSS shapes.	Periodic	SI	DSA IR 17-3.
19. WELDING:				Table 1705A.2.1, ASCE 310-10, ASCE 310-10, ASCE 310-10
X	Verify and document steel fabrication per DSA approved construction documents.	Periodic	SI	Not applicable to cold-formed light-frame construction, except for trusses (1705A.2.4).
X	Verify identification markings per AWS D1.1 for structural steel, AWS D1.2 for Aluminum, AWS D1.4 for reinforcing steel. (See Appendix for exemptions.)	Periodic	SI	DSA IR 17-3.
X	Verify weld filler material manufacturer's certificate of conformance.	Periodic	SI	DSA IR 17-3.
X	Verify WPS, welder qualifications and equipment.	Periodic	SI	DSA IR 17-3.
19.1 SHOP WELDING:				Table 1705A.2.1 Item 5a1-4. Per ASCE 310-10 (and ASCE 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per ASCE 310-10 (and ASCE 341-10 as applicable), DSA IR 17-3.
X	Inspect single-pass flat welds > 5/16", floor and roof deck welds.	Periodic	SI	Table 1705A.2.1 Item 5a1-4. Per ASCE 310-10 (and ASCE 341-10 as applicable), DSA IR 17-3.
19.2 FIELD WELDING:				Table 1705A.2.1 Item 5a1-4. Per ASCE 310-10 (and ASCE 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per ASCE 310-10 (and ASCE 341-10 as applicable), DSA IR 17-3.
X	Inspect single-pass flat welds > 5/16".	Periodic	SI	Table 1705A.2.1 Item 5a1-4. Per ASCE 310-10 (and ASCE 341-10 as applicable), DSA IR 17-3.
23. ANCHOR BOLTS, ANCHOR RODS, & OTHER STEEL:				Table 1705A.2.1 Item 5a1-4. Per ASCE 310-10 (and ASCE 341-10 as applicable), DSA IR 17-3.
X	Anchor Bolts and Anchor Rods	Test	LOR	IR 17-11 Samples and test anchor bolts and anchor rods not readily identifiable.
WOOD				
OTHER				

3 - SAMPLE DSA 103 - STRUCTURES WITH ONLY SPREAD FOOTINGS

DSA DSA-103 Issued 01/2017
List of Required Structural Tests & Special Inspections - 2016 CBC

INCREMENT # [] DSA File No.: PC-119 Application No.: SA-117117
 Date Submitted: [] Revised: []

Sheet Name: Pier and Pad Footings without Post Installed Anchors Sheets: []

IMPORTANT: This form is only a summary list of structural tests and some of the special inspections required for the project. Generally, the structural tests and special inspections noted on this form are those that will be performed by the Geotechnical Engineer of Record, Laboratory of Record, or Special Inspector. The actual complete test and inspection program must be performed as detailed on the DSA approved documents. The appendices at the bottom of this form identify work NOT subject to DSA requirements for special inspection or structural testing. The project inspector is responsible for providing inspection of all facets of construction, including but not limited to, special inspections not listed on this form such as structural wood framing, high-strength wood diaphragms, cold-formed steel framing, anchorage of non-structural components, etc., per Title 24, Part 2, Chapter 17A. NOTE: This form is also available for projects submitted for review under the 2007, 2010, and 2013 CBC.

INSTRUCTIONS: Click a plus sign (+) before any category or subcategory to reveal additional tests and special inspections. A shaded box indicates a test or special inspection that may be required, depending on the scope of the construction and other issues. A shaded box can be checked indicating your selection of that test. Note: A minus (-) on a category or subcategory heading indicates that it can be collapsed. However, any selection you may have made will be observed. Click on the "COMPLETE" button to show only the tests and inspections fully selected. For more information on use of this form, see DSA-103.INSTR.

Note: References are to the 2016 edition of the California Building Code (CBC) unless otherwise noted.

TEST OR SPECIAL INSPECTION	TEST	PERIODIC	CONTINUOUS	CODE REFERENCE AND NOTES
SOILS				
1. GENERAL:				Table 1705A.6
X	Verify that:			
	• all test specimens are properly placed to placement of controlled fill and/or soil for foundation.			
	• foundation excavations are extended to proper depth and have reached proper materials, and	Periodic	GE	* By geotechnical engineer or his or her qualified representative. (See Appendix for exemptions.)
	• materials below footings are adequate to achieve the design bearing capacity.			
4. CAST-IN-PLACE DEEP FOUNDATIONS (PIERS):				Table 1705A.8
X	Inspect drilling operations and test specimens and recover records for each pier.	Continuous	GE	* By geotechnical engineer or his or her qualified representative. (See Appendix for exemptions.)
X	Verify pier location, dimensions, placement, bell dimensions (if applicable), length, and embedment into rock (if applicable). Record concrete or grout volumes.	Continuous	GE	* By geotechnical engineer or his or her qualified representative. (See Appendix for exemptions.)
X	Confirm adequate and strata bearing capacity.	Continuous	GE	* By geotechnical engineer or his or her qualified representative. (See Appendix for exemptions.)
X	Concrete piles.	Provide tests and inspections per CONCRETE section below.		
CONCRETE				Table 1705A.3, ACI 318-14 Sections 26.12 & 26.13
7. CAST IN PLACE CONCRETE				
X	Material Verification and Testing:			
X	Verify use of required design mix.	Periodic	SI	Table 1705A.3 Item 5, 1916A.1 (1909.3.7), * To be performed by qualified batch-plant inspector and concrete sampling technician.
X	Identify, sample, and test reinforcing steel.	Test	LOR	1916A.2 (1909.4.7), ACI 318-14 Section 26.6.1.2, DSA IR 17-10.16
X	During concrete placement, fabricate specimens for strength tests, perform pump and air content tests, and determine the temperature of the concrete.	Test	LOR	Table 1705A.3 Item 6, ACI 318-14 Sections 26.5.9 & 26.12
X	Test concrete (f _c).	Test	LOR	1905A.1.6 (1909.3.7), ACI 318-14 Section 26.12.
MASONRY				TMS 402-13ACI 530-13ASCE 5-13 Table 2.1.3 & TMS 602-13ACI 530-13ASCE 6-13 Table 5
STEEL, ALUMINUM				Table 1705A.2.1, ASCE 310-10, ASCE 310-10, ASCE 310-10, ASCE 310-10
17. STRUCTURAL STEEL, COLD-FORMED STEEL, AND ALUMINUM USED FOR STRUCTURAL PURPOSES				
X	Verify identification of all materials and:	Periodic	SI	2293A.1 (2003.1.7), Table 1705A.2.1 Item 3a-3c; AISI S100-07/08-10 Section A2.1 & A2.2, AISI S200-12 Sections 4.3, AISI S200-11 Section A4. * By special inspector or qualified technician when performed off-site.
X	Material labels, types and grades comply with requirements.	Periodic	SI	2293A.1 (2003.1.7)
X	Test underlaid materials.	Test	LOR	2293A.1 (2003.1.7)
X	Examine seam welds of HSS shapes.	Periodic	SI	DSA IR 17-3.
19. WELDING:				Table 1705A.2.1, ASCE 310-10, ASCE 310-10, ASCE 310-10
X	Verify and document steel fabrication per DSA approved construction documents.	Periodic	SI	Not applicable to cold-formed light-frame construction, except for trusses (1705A.2.4).
X	Verify identification markings per AWS D1.1 for structural steel, AWS D1.2 for Aluminum, AWS D1.4 for reinforcing steel. (See Appendix for exemptions.)	Periodic	SI	DSA IR 17-3.
X	Verify weld filler material manufacturer's certificate of conformance.	Periodic	SI	DSA IR 17-3.
X	Verify WPS, welder qualifications and equipment.	Periodic	SI	DSA IR 17-3.
19.1 SHOP WELDING:				Table 1705A.2.1 Item 5a1-4. Per ASCE 310-10 (and ASCE 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per ASCE 310-10 (and ASCE 341-10 as applicable), DSA IR 17-3.
X	Inspect single-pass flat welds > 5/16", floor and roof deck welds.	Periodic	SI	Table 1705A.2.1 Item 5a1-4. Per ASCE 310-10 (and ASCE 341-10 as applicable), DSA IR 17-3.
19.2 FIELD WELDING:				Table 1705A.2.1 Item 5a1-4. Per ASCE 310-10 (and ASCE 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per ASCE 310-10 (and ASCE 341-10 as applicable), DSA IR 17-3.
X	Inspect single-pass flat welds > 5/16".	Periodic	SI	Table 1705A.2.1 Item 5a1-4. Per ASCE 310-10 (and ASCE 341-10 as applicable), DSA IR 17-3.
23. ANCHOR BOLTS, ANCHOR RODS, & OTHER STEEL:				Table 1705A.2.1 Item 5a1-4. Per ASCE 310-10 (and ASCE 341-10 as applicable), DSA IR 17-3.
X	Anchor Bolts and Anchor Rods	Test	LOR	IR 17-11 Samples and test anchor bolts and anchor rods not readily identifiable.
WOOD				
OTHER				

1 - SAMPLE DSA 103 - STRUCTURES WITH PIER & SPREAD FOOTINGS

THE EXAMPLE FORM DSA-103'S SHOWN ON THIS SHEET ARE FOR ILLUSTRATION PURPOSES ONLY TO ASSIST IN THE COMPLETION OF FUTURE PROJECT-SPECIFIC FORM DSA-103'S. A FORM DSA-103 IS TO BE COMPLETED FOR EACH APPLICATION THAT THIS PC IS BEING INCORPORATED INTO AND ALL EXAMPLE FORM DSA-103'S ARE TO BE CROSSED OUT ON THIS DRAWING

DSA DSA-103 Issued 01/2017
List of Required Structural Tests & Special Inspections - 2016 CBC

INCREMENT # [] DSA File No.: PC-119 Application No.: SA-117117
 Date Submitted: [] Revised: []

Sheet Name: Pier Footings without Post Installed Anchors Sheets: []

IMPORTANT: This form is only a summary list of structural tests and some of the special inspections required for the project. Generally, the structural tests and special inspections noted on this form are those that will be performed by the Geotechnical Engineer of Record, Laboratory of Record, or Special Inspector. The actual complete test and inspection program must be performed as detailed on the DSA approved documents. The appendices at the bottom of this form identify work NOT subject to DSA requirements for special inspection or structural testing. The project inspector is responsible for providing inspection of all facets of construction, including but not limited to, special inspections not listed on this form such as structural wood framing, high-strength wood diaphragms, cold-formed steel framing, anchorage of non-structural components, etc., per Title 24, Part 2, Chapter 17A. NOTE: This form is also available for projects submitted for review under the 2007, 2010, and 2013 CBC.

INSTRUCTIONS: Click a plus sign (+) before any category or subcategory to reveal additional tests and special inspections. A shaded box indicates a test or special inspection that may be required, depending on the scope of the construction and other issues. A shaded box can be checked indicating your selection of that test. Note: A minus (-) on a category or subcategory heading indicates that it can be collapsed. However, any selection you may have made will be observed. Click on the "COMPLETE" button to show only the tests and inspections fully selected. For more information on use of this form, see DSA-103.INSTR.

Note: References are to the 2016 edition of the California Building Code (CBC) unless otherwise noted.

TEST OR SPECIAL INSPECTION	TEST	PERIODIC	CONTINUOUS	CODE REFERENCE AND NOTES
SOILS				
1. GENERAL:				Table 1705A.6
X	Verify that:			
	• all test specimens are properly placed to placement of controlled fill and/or soil for foundation.			
	• foundation excavations are extended to proper depth and have reached proper materials, and	Periodic	GE	* By geotechnical engineer or his or her qualified representative. (See Appendix for exemptions.)
	• materials below footings are adequate to achieve the design bearing capacity.			
4. CAST-IN-PLACE DEEP FOUNDATIONS (PIERS):				Table 1705A.8
X	Inspect drilling operations and test specimens and recover records for each pier.	Continuous	GE	* By geotechnical engineer or his or her qualified representative. (See Appendix for exemptions.)
X	Verify pier location, dimensions, placement, bell dimensions (if applicable), length, and embedment into rock (if applicable). Record concrete or grout volumes.	Continuous	GE	* By geotechnical engineer or his or her qualified representative. (See Appendix for exemptions.)
X	Confirm adequate and strata bearing capacity.	Continuous	GE	* By geotechnical engineer or his or her qualified representative. (See Appendix for exemptions.)
X	Concrete piles.	Provide tests and inspections per CONCRETE section below.		
CONCRETE				Table 1705A.3, ACI 318-14 Sections 26.12 & 26.13
7. CAST IN PLACE CONCRETE				
X	Material Verification and Testing:			
X	Verify use of required design mix.	Periodic	SI	Table 1705A.3 Item 5, 1916A.1 (1909.3.7), * To be performed by qualified batch-plant inspector and concrete sampling technician.
X	Identify, sample, and test reinforcing steel.	Test	LOR	1916A.2 (1909.4.7), ACI 318-14 Section 26.6.1.2, DSA IR 17-10.16
X	During concrete placement, fabricate specimens for strength tests, perform pump and air content tests, and determine the temperature of the concrete.	Test	LOR	Table 1705A.3 Item 6, ACI 318-14 Sections 26.5.9 & 26.12
X	Test concrete (f _c).	Test	LOR	1905A.1.6 (1909.3.7), ACI 318-14 Section 26.12.
MASONRY				TMS 402-13ACI 530-13ASCE 5-13 Table 2.1.3 & TMS 602-13ACI 530-13ASCE 6-13 Table 5
STEEL, ALUMINUM				Table 1705A.2.1, ASCE 310-10, ASCE 310-10, ASCE 310-10, ASCE 310-10
17. STRUCTURAL STEEL, COLD-FORMED STEEL, AND ALUMINUM USED FOR STRUCTURAL PURPOSES				
X	Verify identification of all materials and:	Periodic	SI	2293A.1 (2003.1.7), Table 1705A.2.1 Item 3a-3c; AISI S100-07/08-10 Section A2.1 & A2.2, AISI S200-12 Sections 4.3, AISI S200-11 Section A4. * By special inspector or qualified technician when performed off-site.
X	Material labels, types and grades comply with requirements.	Periodic	SI	2293A.1 (2003.1.7)
X	Test underlaid materials.	Test	LOR	2293A.1 (2003.1.7)
X	Examine seam welds of HSS shapes.	Periodic	SI	DSA IR 17-3.
19. WELDING:				Table 1705A.2.1, ASCE 310-10, ASCE 310-10, ASCE 310-10
X	Verify and document steel fabrication per DSA approved construction documents.	Periodic	SI	Not applicable to cold-formed light-frame construction, except for trusses (1705A.2.4).
X	Verify identification markings per AWS D1.1 for structural steel, AWS D1.2 for Aluminum, AWS D1.4 for reinforcing steel. (See Appendix for exemptions.)	Periodic	SI	DSA IR 17-3.
X	Verify weld filler material manufacturer's certificate of conformance.	Periodic	SI	DSA IR 17-3.
X	Verify WPS, welder qualifications and equipment.	Periodic	SI	DSA IR 17-3.
19.1 SHOP WELDING:				Table 1705A.2.1 Item 5a1-4. Per ASCE 310-10 (and ASCE 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per ASCE 310-10 (and ASCE 341-10 as applicable), DSA IR 17-3.
X	Inspect single-pass flat welds > 5/16", floor and roof deck welds.	Periodic	SI	Table 1705A.2.1 Item 5a1-4. Per ASCE 310-10 (and ASCE 341-10 as applicable), DSA IR 17-3.
19.2 FIELD WELDING:				Table 1705A.2.1 Item 5a1-4. Per ASCE 310-10 (and ASCE 341-10 as applicable), DSA IR 17-3.
X	Inspect groove welds, multi-pass flat welds, single pass flat welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a1-4. Per ASCE 310-10 (and ASCE 341-10 as applicable), DSA IR 17-3.
X	Inspect single-pass flat welds > 5/16".	Periodic	SI	Table 1705A.2.1 Item 5a1-4. Per ASCE 310-10 (and ASCE 341-10 as applicable), DSA IR 17-3.
23. ANCHOR BOLTS, ANCHOR RODS, & OTHER STEEL:				Table 1705A.2.1 Item 5a1-4. Per ASCE 310-10 (and ASCE 341-10 as applicable), DSA IR 17-3.
X	Anchor Bolts and Anchor Rods	Test	LOR	IR 17-11 Samples and test anchor bolts and anchor rods not readily identifiable.
WOOD				
OTHER				

2 - SAMPLE DSA 103 - STRUCTURES WITH ONLY PIER FOOTINGS

ENGINEER'S APPROVAL

REGISTERED PROFESSIONAL ENGINEER
 S 5885
 STRUCTURAL
 STATE OF CALIFORNIA

DATE SIGNED
 11/28/2018

SITE SPECIFIC DSA APPROVAL

FILE NUMBER: PC-119
 IDENTIFICATION STAMP
 DIVISION OF THE STATE ARCHITECT
 APP. NO. 04 - 117117 INCR
 AC DF FL DS SS DP
 DATE 12/05/2018

PRE-CHECK (PC) DOCUMENT

CODE: 2016 CBC
 A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED

MBARC CONSTRUCTION INC.

674 RANCHEROS DR
 SAN MARCOS, CA 92069
 PHONE: (760) 744-4131
 FAX: (760) 744-4449
 GREGJ@MBARCONLINE.COM (775) 787-8845

4STEL ENGINEERING
 STRUCTURAL ENGINEERING

26030 A CHERO, SUITE 200
 MISSION VIEJO, CA 92691
 PHONE: (949) 305-1150
 FAX: (949) 305-1420


VERSA CANOPY

SAMPLE DSA-103 FORMS

DRAWN GM CHECKED KS

DATE
 11/28/2018
4STEL JOB NO.
 MC03-01
SHEET
 S-4
 4 OF 13 SHEETS

ROOF DECK SPECIFICATIONS						
SECTION PROPERTIES			TOP IN COMPRESSION		BOTTOM IN COMPRESSION	
GA	F _y (ksi)	WEIGHT (psf)	I _x (in. ⁴ /ft.)	S _x (in. ³ /ft.)	I _y (in. ⁴ /ft.)	S _y (in. ³ /ft.)
26	80	0.89	0.0840	0.0762	0.0817	0.0623

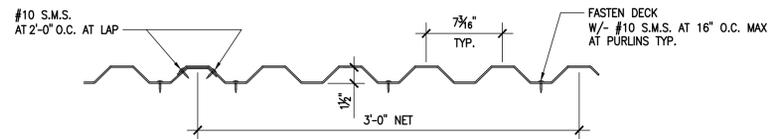


NOTES:

- MATERIAL AND SECTION PROPERTIES LISTED ABOVE ARE MINIMUM REQUIRED VALUES FOR METAL DECK BASED ON AEP HR-36 26 GA.
- METAL ROOF DECK SHALL BE CLASS A PER CBC CHAPTERS 7A AND 15.

3 DECK DETAIL

N.T.S.

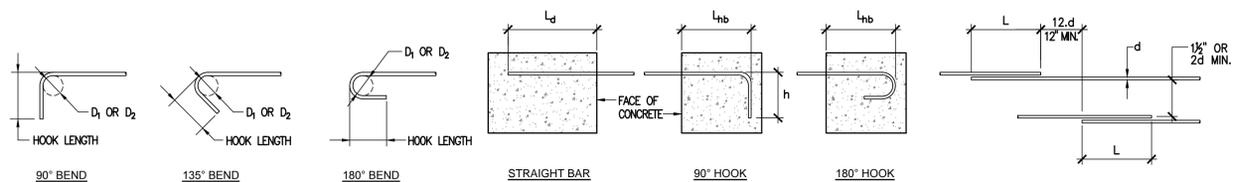

BAR SIZE	D ₁	D ₂
#3	1 1/2"	2 1/4"
#4	2"	3"
#5	2 1/2"	3 3/4"
#6, #7, #8	6 1/4"	6 1/4"

D₁ - FINISHED BEND DIA. FOR STIRRUP & TIE HOOKS.
D₂ - BEND DIA. FOR STD HOOKS.
d - BAR DIAMETER

BAR SIZE	MAIN REINFT.		STIRRUP & TIE HOOKS	
	90°	180°	90°	180°
#3	6"	4"	3 1/2"	4 1/2"
#4	8"	4 1/2"	4 1/2"	4 1/2"
#5	10"	5"	5"	6"
#6	12"	6"	12"	7 1/2"
#7	14"	7"	14"	9"
#8	16"	8"	16"	10"

REINFORCEMENT DEVELOPMENT LENGTHS				
CONCRETE STRENGTH F _c = 3,000 PSI				
NOMINAL BAR SIZE	h	L _d		L _{hb}
		TOP BARS	OTHER BARS	
#3	6"	1'-10"	1'-5"	9"
#4	8"	2'-5"	1'-10"	11"
#5	10"	3'-0"	2'-4"	1'-2"
#6	12"	3'-7"	2'-9"	1'-5"
#7	14"	5'-3"	4'-0"	1'-7"
#8	16"	6'-0"	4'-7"	1'-10"

- NOTES:**
- TOP BARS ARE HORIZONTAL BARS WITH MORE THAN 12 INCHES OF CONCRETE CAST BELOW.

REINFORCEMENT LAP SPLICE LENGTH 'L'		
CONCRETE STRENGTH F _c = 3,000 PSI		
NOMINAL BAR SIZE	TOP BARS	OTHER BARS
#3	2'-4"	1'-10"
#4	3'-2"	2'-5"
#5	3'-11"	3'-0"
#6	4'-8"	3'-7"
#7	6'-9"	5'-3"
#8	7'-9"	6'-0"

- NOTES:**
- LAP SPLICE SHALL BE INCREASED 50% WHERE CLEAR SPACE BETWEEN BARS IS LESS THAN 2 BAR DIAMETERS AND/OR THE CLEAR COVER IS LESS THAN ONE BAR DIAMETER.

A STANDARD HOOKS

B DEVELOPMENT LENGTHS

C OFFSETS AND LAP SPLICES


4 TYPICAL REINFORCEMENT BAR BENDS AND LAPS

N.T.S.

SECTION NAME	D (in)	B (in)	L (in)	GA	WT (lb/ft)	A (in ²)	AXIS X-X			AXIS Y-Y		
							I _x (in ⁴)	S _x (in ³)	r _x (in)	I _y (in ⁴)	S _y (in ³)	r _y (in)
CS12 x 4 x 0.102 (12 GA)	12	4.0	1.0	12	7.35	2.16	46.87	6.76	4.66	4.38	1.53	1.42
CS12 x 4 x 0.124 (10 GA)	12	4.0	1.0	10	8.91	2.62	56.37	8.59	4.64	5.20	1.82	1.41
CS14 x 4 x 0.102 (12 GA)	14	4.0	1.0	12	8.04	2.36	67.42	8.22	5.34	4.57	1.55	1.39

NOTES:

- ALL PURLIN SECTIONS ARE ASTM A653, GR 55, F_y=55 ksi
- ALL LIGHT GAGE STEEL DESIGNED USING 2012 AISI COLD-FORMED STEEL DESIGN MANUAL.
- PROPERTIES PER AEP STANDARD SIZES.
- ACTUAL MANUFACTURER'S PROPERTIES MUST MEET OR EXCEED AEP STANDARD PROPERTIES.

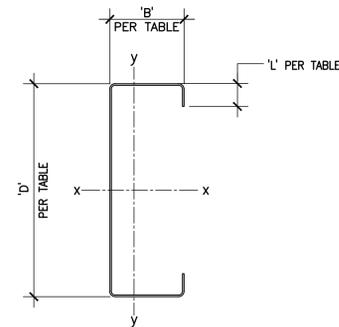


1 PURLIN & BEAM COLD FORMED C-SECTION

N.T.S.

SECTION NAME	D (in)	B (in)	t (in)	WT (lb/ft)	A (in ²)	AXIS X-X			AXIS Y-Y		
						I _x (in ⁴)	S _x (in ³)	r _x (in)	I _y (in ⁴)	S _y (in ³)	r _y (in)
HSS 12 x 6 x 1/4	12	6	1/4	29.23	8.59	161.00	26.80	4.33	55.20	18.40	2.53

NOTES:

- ALL COLUMNS SHALL BE ASTM A1085 GR. 50 (F_y=50 ksi)

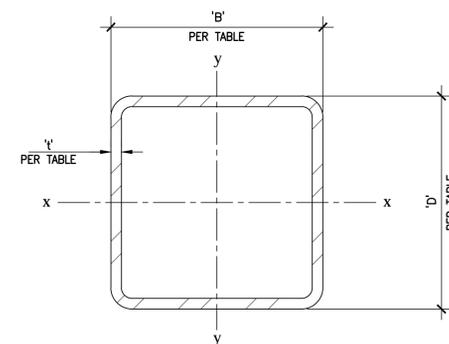

2 HSS COLUMN

N.T.S.

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 01-118970 INC.
REVIEWED FOR
SS FLS ACS
DATE: 08/11/2020

ENGINEER'S APPROVAL

PROFESSIONAL ENGINEER
DUSTIN K. ROBERTSON
S 5885
STRUCTURAL
STATE OF CALIFORNIA

DATE SIGNED
11/28/2018

SITE SPECIFIC
DSA APPROVAL

FILE NUMBER: PC-119
IDENTIFICATION STAMP
DIVISION OF THE STATE ARCHITECT
APP. NO: 04 - 117117 INCR
AC DF FLS DS SS DP
DATE 12/05/2018

PRE-CHECK (PC) DOCUMENT
CODE: 2016 CBC
A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED

MBARC CONSTRUCTION INC.
PHONE: (760) 744-4131
SAN MARCOS, CA
FAX: (760) 744-4449
GREGJ@MBARCONLINE.COM (775) 787-8845
IIC # 869980
B AND C 51
GREG JONES

4STEL ENGINEERING
STRUCTURAL ENGINEERING
PHONE: (949) 305-1150
SAN MARCOS, CA
FAX: (949) 305-1420
26030 ACHERO, SUITE 200
MISSION VIEJO, CA 92691

VERSA CANOPY SECTION PROPERTIES & REBAR DETAILS

DRAWN GM
CHECKED KS
DATE 11/28/2018
4STEL JOB NO. MC03-01
SHEET

S-5

5 OF 13 SHEETS

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP: 01-118970 INC:
 REVIEWED FOR
 SS FLS ACS
 DATE: 08/11/2020

ENGINEER'S
 APPROVAL



DATE SIGNED
 11/28/2018

SITE SPECIFIC
 DSA APPROVAL

FILE NUMBER: PC-119
 IDENTIFICATION STAMP
 DIVISION OF THE STATE ARCHITECT
 APP. NO: 04 - 117117 INC:
 AC DF FLS DS SS DP
 DATE 12/05/2018

PRE-CHECK (PC) DOCUMENT
 CODE: 2016 CBC
 A SEPARATE PROJECT APPLICATION FOR
 CONSTRUCTION IS REQUIRED

MBARC CONSTRUCTION INC.
 IIC # 869960
 B AND C51
 PHONE: (760) 744-4131
 FAX: (760) 744-4449
 GREGJ@MBARCONLINE.COM | (775) 787-8845
 674 RANCHEROS DR
 SAN MARCOS, CA 92069
 GREG JONES

4STEL ENGINEERING
 STRUCTURAL ENGINEERING
 PHONE: (949) 305-1150
 FAX: (949) 305-1420
 26030 A CHERO, SUITE 200
 MISSION VIEJO, CA 92691

VERSA
 CANOPY
 VC14, VC18
 & VC20
 FRAMING
 SCHEDULES

DRAWN
 GM
 CHECKED
 KS
 DATE
 11/28/2018
 4STEL JOB NO.
 MC03-01
 SHEET

S-7

7 OF 13 SHEETS

VC14, VC18 & VC20 PURLIN SCHEDULE

I.D. #	MAX GROUND SNOW LOAD	MAX PURLIN SPACING (PS)	MAX COLUMN SPACING (S)	MAX CANTILEVER SPAN (CS)	PURLIN	
					SECTION	DETAIL
VC14	0 psf	63"	27'-0"	10'-0"	CS12 x 4 x 0.102 (12 GA)	(1) S-5
VC18	0 psf	87"	27'-0"	10'-0"	CS12 x 4 x 0.124 (10 GA)	(1) S-5
VC20	0 psf	99"	19'-0"	8'-0"	CS14 x 4 x 0.102 (12 GA)	(1) S-5

- NOTES:
- REFER TO SHEET 'S-2' FOR CONSTRUCTION OPTIONS.
 - REFER TO DETAIL '4/S-12' FOR ALLOWABLE PURLIN PENETRATIONS.
 - MULTIPLE STRUCTURE ID'S MAY BE SELECTED WITHIN THE SAME SITE.
 - WHEN UTILIZING A STRUCTURE ID READ FROM WITHIN THAT ID'S ROW ONLY.


1 VC14, VC18 & VC20
 - TYPICAL PURLIN SCHEDULE

VC14, VC18 & VC20 BEAM/COLUMN SCHEDULE


I.D. #	MAX GROUND SNOW LOAD	MAX WIDTH (W)	BEAM SHORT SPAN MIN (SS)	BEAM LONG SPAN MAX (LS)	MAX COLUMN SPACING (S)	ROOF SLOPE	BEAM		BEAM TO COLUMN DETAIL	COLUMN		MAX COLUMN HEIGHT
							SECTION	DETAIL		SECTION	DETAIL	
VC14	0 psf	14'-0"	4'-3"	9'-9"	27'-0"	3:12 MAX	CS12 x 4 x 0.102 (12 GA)	(1) S-5	(13) S-11	HSS 12 x 6 x 1/4	(2) S-5	17'-0"
VC18	0 psf	18'-0"	7'-9"	10'-3"	27'-0"	3:12 MAX	CS12 x 4 x 0.102 (12 GA)	(1) S-5	(13) S-11	HSS 12 x 6 x 1/4	(2) S-5	17'-9"
VC20	0 psf	20'-0"	5'-9"	14'-3"	19'-0"	3:12 MAX	CS14 x 4 x 0.124 (10 GA)	(1) S-5	(13) S-11	HSS 12 x 6 x 1/4	(2) S-5	17'-0"

- NOTES:
- MULTIPLE STRUCTURE ID'S MAY BE SELECTED WITHIN THE SAME SITE.
 - WHEN UTILIZING A STRUCTURE ID READ FROM WITHIN THAT ID ROW ONLY.
 - THE SHORT SPAN AND LONG SPANS MAY BE ADJUSTED WITH THE FOLLOWING REQUIREMENT:
 THE OVERALL CANOPY WIDTH IS NOT EXCEEDED, NEITHER SPAN IS LESS THAN THE MIN SHORT SPAN & NEITHER SPAN EXCEEDS THE MAX LONG SPAN.


2 VC14, VC18 & VC20
 - TYPICAL BEAM/COLUMN SCHEDULE

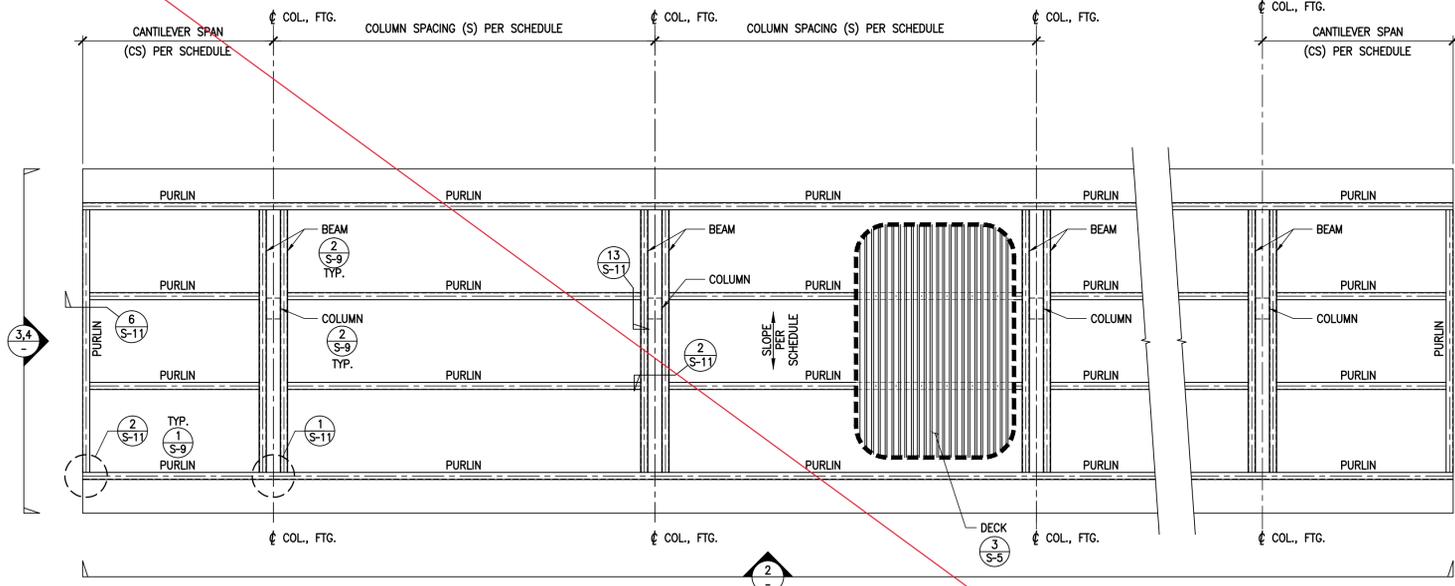


1 VC140, VC180 & VC200
 TYPICAL PLAN VIEW
 1/4"=1'-0"

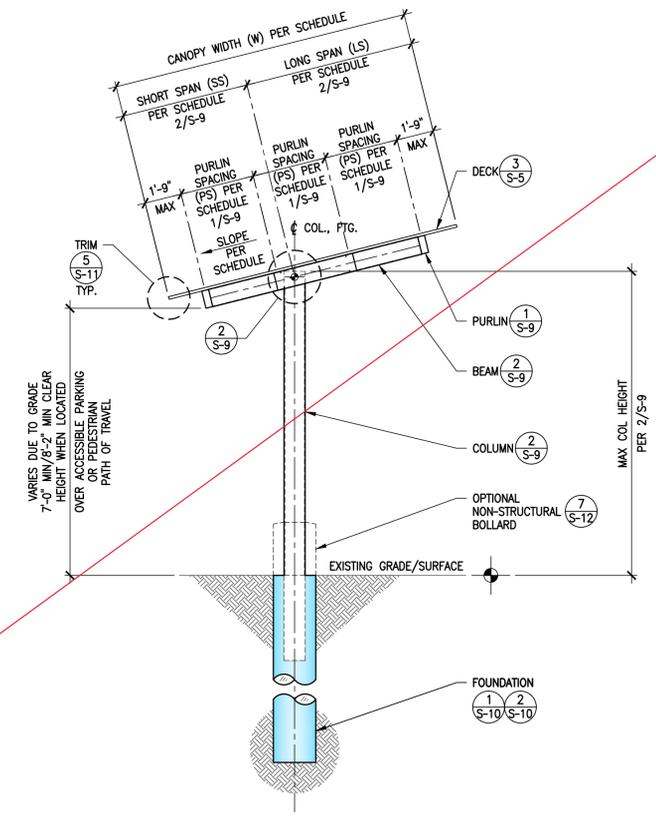

3 VC140, VC180 & VC200
 TYPICAL SIDE ELEVATION 1
 1/4"=1'-0"

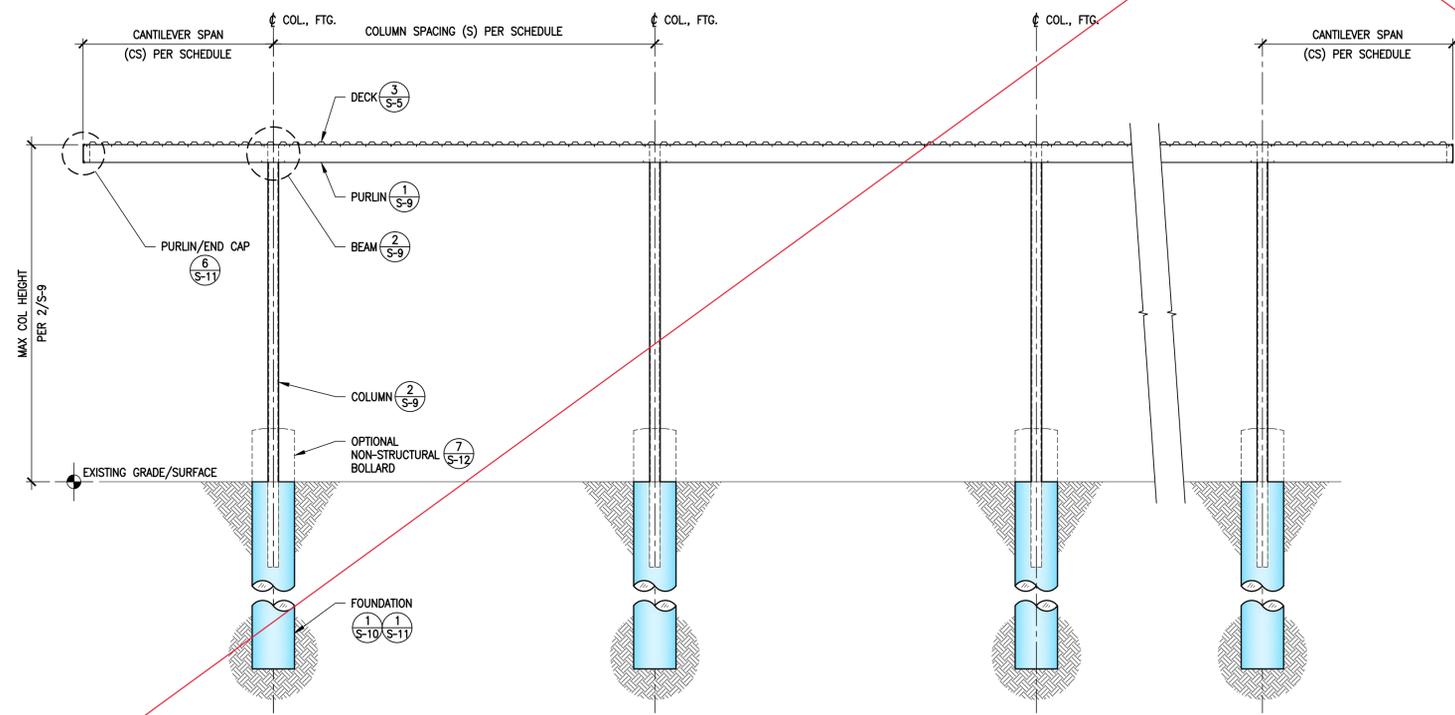

2 VC140, VC180 & VC200
 TYPICAL FRONT ELEVATION
 1/4"=1'-0"

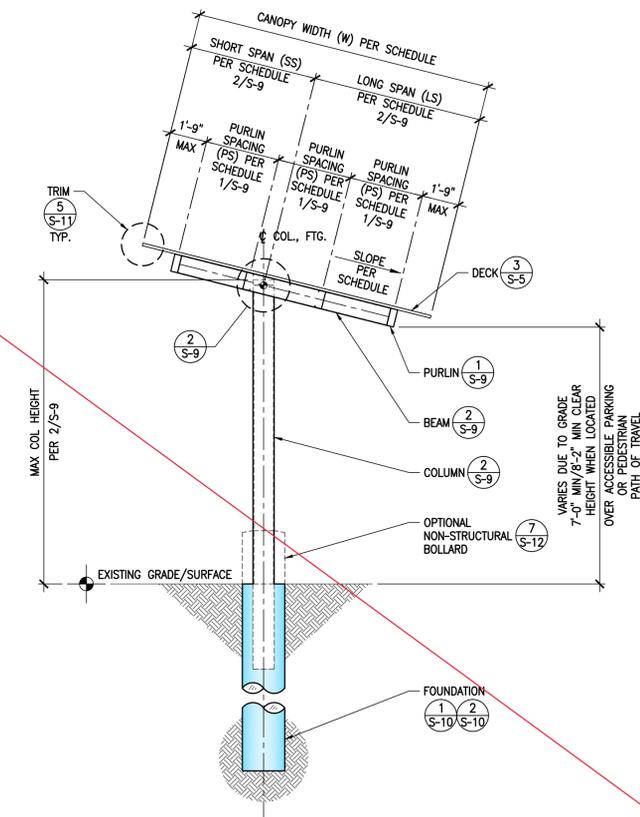

4 VC140, VC180 & VC200
 TYPICAL SIDE ELEVATION 2
 1/4"=1'-0"

ENGINEER'S APPROVAL
 REGISTERED PROFESSIONAL ENGINEER
 DUSTIN K. ROSENFELD
 S 5885
 STRUCTURAL
 STATE OF CALIFORNIA
 DATE SIGNED
 11/28/2018

SITE SPECIFIC
 DSA APPROVAL

FILE NUMBER: PC-119
 IDENTIFICATION STAMP
 DIVISION OF THE STATE ARCHITECT
 APP. NO. 04 - 117117 INCR
 AC DF FLS DS SS DP
 DATE 12/05/2018
 PRE-CHECK (PC) DOCUMENT
 CODE: 2016 CBC
 A SEPARATE PROJECT APPLICATION FOR
 CONSTRUCTION IS REQUIRED

MBARC CONSTRUCTION INC.
 IIC # 869960
 B AND C 51
 PHONE: (760) 744-4131
 (760) 744-4449
 FAX: (775) 787-8845
 GREGJ@MBARCONLINE.COM
 674 RANCHEROS DR
 SAN MARCOS, CA
 92069
 GREG JONES

4STEL ENGINEERING
 STRUCTURAL ENGINEERING
 26030 ACHERO, SUITE 200
 MISSION VIEJO, CA 92691
 PHONE: (949) 305-1150
 (949) 305-1420
 FAX: (949) 305-1420

VERSA
 CANOPY
 VC140, VC180
 & VC200
 FRAMING PLAN
 & ELEVATIONS

DRAWN
 GM
 CHECKED
 KS
 DATE
 11/28/2018
 4STEL JOB NO.
 MC03-01
 SHEET
S-8
 8 OF 13 SHEETS

VC140, VC180 & VC200 PURLIN SCHEDULE

I.D. #	MAX GROUND SNOW LOAD	MAX PURLIN SPACING (PS)	MAX COLUMN SPACING (S)	MAX CANTILEVER SPAN (CS)	PURLIN	
					SECTION	DETAIL
VC140	20 psf	42"	27'-0"	9'-0"	CS12 x 4 x 0.102 (12 GA)	1 S-5
VC180	20 psf	58"	27'-0"	8'-6"	CS14 x 4 x 0.102 (12 GA)	1 S-5
VC200	20 psf	66"	19'-0"	7'-9"	CS14 x 4 x 0.102 (12 GA)	1 S-5

NOTES:

- REFER TO SHEET 'S-2' FOR CONSTRUCTION OPTIONS.
- REFER TO DETAIL '4/S-12' FOR ALLOWABLE PURLIN PENETRATIONS.
- MULTIPLE STRUCTURE ID'S MAY BE SELECTED WITHIN THE SAME SITE.
- WHEN UTILIZING A STRUCTURE ID READ FROM WITHIN THAT ID'S ROW ONLY.
- PURLIN SPACING MAY BE INCREASED BEYOND THE MAXIMUMS GIVEN IN THE CHART ABOVE AS LONG AS THE TRIBUTARY WIDTH TO THE PURLIN DOES NOT EXCEED 'PS'.

1 VC140, VC180 & VC200
- TYPICAL PURLIN SCHEDULE

VC140, VC180 & VC200 BEAM/COLUMN SCHEDULE

I.D. #	MAX GROUND SNOW LOAD	MAX WIDTH (W)	BEAM SHORT SPAN MIN (SS)	BEAM LONG SPAN MAX (LS)	MAX COLUMN SPACING (S)	ROOF SLOPE	BEAM		BEAM TO COLUMN DETAIL	COLUMN		MAX COLUMN HEIGHT
							SECTION	DETAIL		SECTION	DETAIL	
VC180	20 psf	18'-0"	8'-0"	10'-0"	27'-0"	3:12 MAX	CS14 x 4 x 0.102 (12 GA)	1 S-5	13 S-11	HSS 12 x 6 x 1/4	2 S-5	16'-6"
VC200	20 psf	20'-0"	6'-9"	13'-3"	19'-0"	3:12 MAX	CS14 x 4 x 0.124 (10 GA)	1 S-5	13 S-11	HSS 12 x 6 x 1/4	2 S-5	16'-9"

NOTES:

- MULTIPLE STRUCTURE ID'S MAY BE SELECTED WITHIN THE SAME SITE.
- WHEN UTILIZING A STRUCTURE ID READ FROM WITHIN THAT ID ROW ONLY.
- THE SHORT SPAN AND LONG SPANS MAY BE ADJUSTED WITH THE FOLLOWING REQUIREMENT:
THE OVERALL CANOPY WIDTH IS NOT EXCEEDED, NEITHER SPAN IS LESS THAN THE MIN SHORT SPAN & NEITHER SPAN EXCEEDS THE MAX LONG SPAN.

2 VC140, VC180 & VC200
- TYPICAL BEAM/COLUMN SCHEDULE

ENGINEER'S APPROVAL



DATE SIGNED
11/28/2018

SITE SPECIFIC
DSA APPROVAL

FILE NUMBER: PC-119
IDENTIFICATION STAMP
DIVISION OF THE STATE ARCHITECT
APP. NO: 04 - 117117 INCR
AC DF FL DS SS DP
DATE 12/05/2018

PRE-CHECK (PC) DOCUMENT
CODE: 2016 CBC
A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED

MBARC CONSTRUCTION INC.
IIC # 869960
R AND C 51
PHONE: (760) 744-4131
FAX: (760) 744-4449
GREGJ@MBARCONLINE.COM | (775) 787-8845
674 RANCHEROS DR
SAN MARCOS, CA 92069
GREG JONES

4STEL ENGINEERING
STRUCTURAL ENGINEERING
PHONE: (949) 305-1150
FAX: (949) 305-1420
26030 ACHERO, SUITE 200
MISSION VIEJO, CA 92691

VERSA CANOPY
VC140, VC180 & VC200
FRAMING SCHEDULES

DRAWN GM
CHECKED KS
DATE 11/28/2018
4STEL JOB NO. MC03-01
SHEET

S-9

9 OF 13 SHEETS

NON-CONSTRAINED PIER FOUNDATION SCHEDULE

I.D. #	MAX GROUND SNOW LOAD	FOUNDATION LONGITUDINAL REINFORCEMENT	FOUNDATION DIAMETER (D)	MIN COLUMN EMBEDMENT (CE)	MAX TIE SPACING AT TOP (TS)	FOUNDATION DETAIL	PIER FOUNDATION MINIMUM DEPTH (SEE SOIL NOTES ON S-3)				
							SOIL CLASS V	SOIL CLASS W	SOIL CLASS X	SOIL CLASS Y	SOIL CLASS Z
VC14	0 psf	4 - #8	2'-0"	3'-6"	6"	(3) -	14'-0"	11'-0"	9'-6"	8'-9"	7'-6"
VC18	0 psf	4 - #8	2'-0"	3'-6"	6"	(3) -	14'-9"	11'-6"	10'-0"	9'-0"	8'-0"
VC20	0 psf	4 - #8	2'-6"	3'-6"	6"	(3) -	15'-0"	11'-9"	10'-3"	9'-3"	8'-0"
VC140	20 psf	4 - #8	2'-0"	3'-6"	6"	(3) -	15'-0"	11'-6"	9'-9"	8'-9"	7'-6"
VC180	20 psf	4 - #8	2'-0"	3'-6"	6"	(3) -	15'-3"	11'-9"	10'-0"	9'-0"	7'-9"
VC200	20 psf	4 - #8	2'-0"	3'-6"	6"	(3) -	15'-3"	12'-0"	10'-3"	9'-3"	8'-3"

- NOTES:**
- MULTIPLE STRUCTURE ID'S MAY BE SELECTED WITHIN THE SAME SITE.
 - WHEN UTILIZING A STRUCTURE ID READ FROM WITHIN THAT ID ROW ONLY.
 - SEE SOILS NOTES ON SHEET S-3 FOR INFORMATION ON SOILS CLASS SELECTION.
 - FOR SITUATIONS WHERE WATER MITIGATION IS NECESSARY, OR FOR OTHER CONDITIONS REQUIRING MITIGATION, REFER TO DETAIL 2/- FOR SLEEVED FOUNDATION OPTION.


1 PIER FOUNDATION SCHEDULE

SPREAD FOOTING SCHEDULE


I.D. #	MAX GROUND SNOW LOAD	FOUNDATION DETAIL	SPREAD FOOTING MINIMUM DIMENSIONS FOR SOIL CLASS V (SOILS NOTES S-3)
VC14	0 psf	(4) -	9'-6" (SQ.) x 2'-6" DEEP
VC18	0 psf	(4) -	10'-3" (SQ.) x 2'-6" DEEP
VC20	0 psf	(4) -	10'-0" (SQ.) x 2'-6" DEEP
VC140	20 psf	(4) -	9'-3" (SQ.) x 2'-6" DEEP
VC180	20 psf	(4) -	10'-0" (SQ.) x 2'-6" DEEP
VC200	20 psf	(4) -	9'-9" (SQ.) x 2'-6" DEEP

- NOTES:**
- MULTIPLE STRUCTURE ID'S MAY BE SELECTED WITHIN THE SAME SITE.
 - WHEN UTILIZING A STRUCTURE ID READ FROM WITHIN THAT ID ROW ONLY.
 - SEE SOILS NOTES ON SHEET S-3 FOR INFORMATION ON SOILS CLASS SELECTION.

2 SPREAD FOOTING SCHEDULE

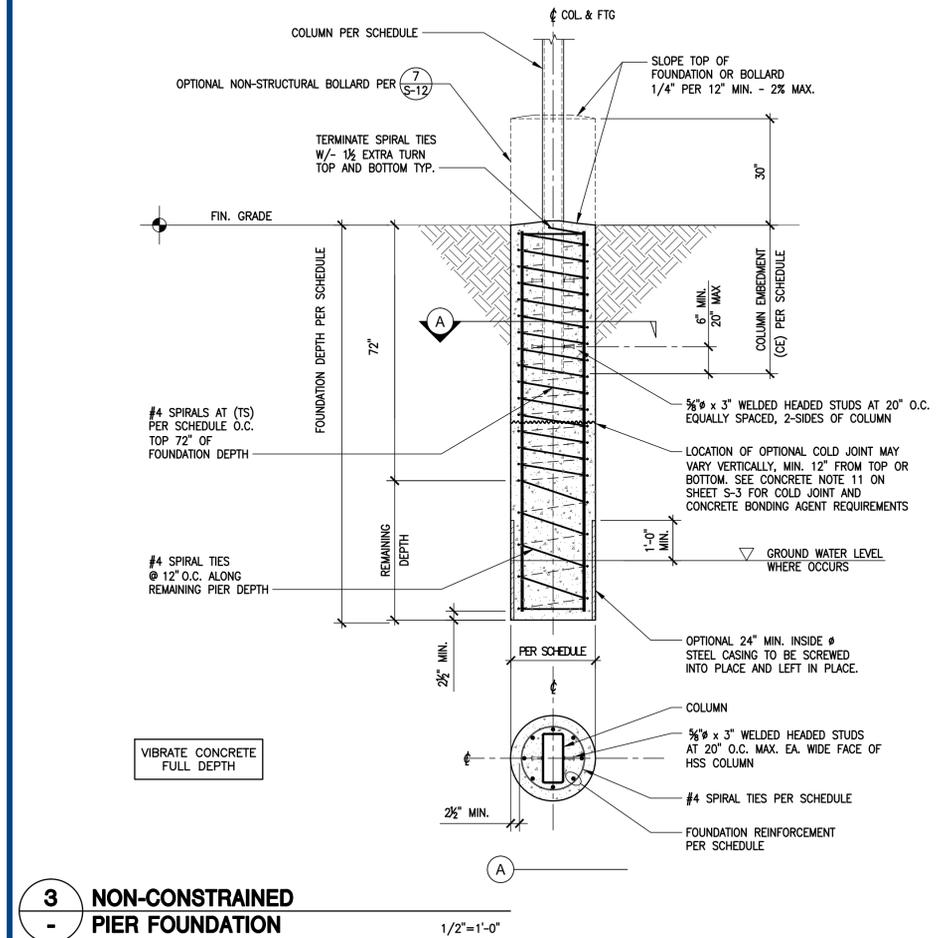

3 NON-CONSTRAINED PIER FOUNDATION

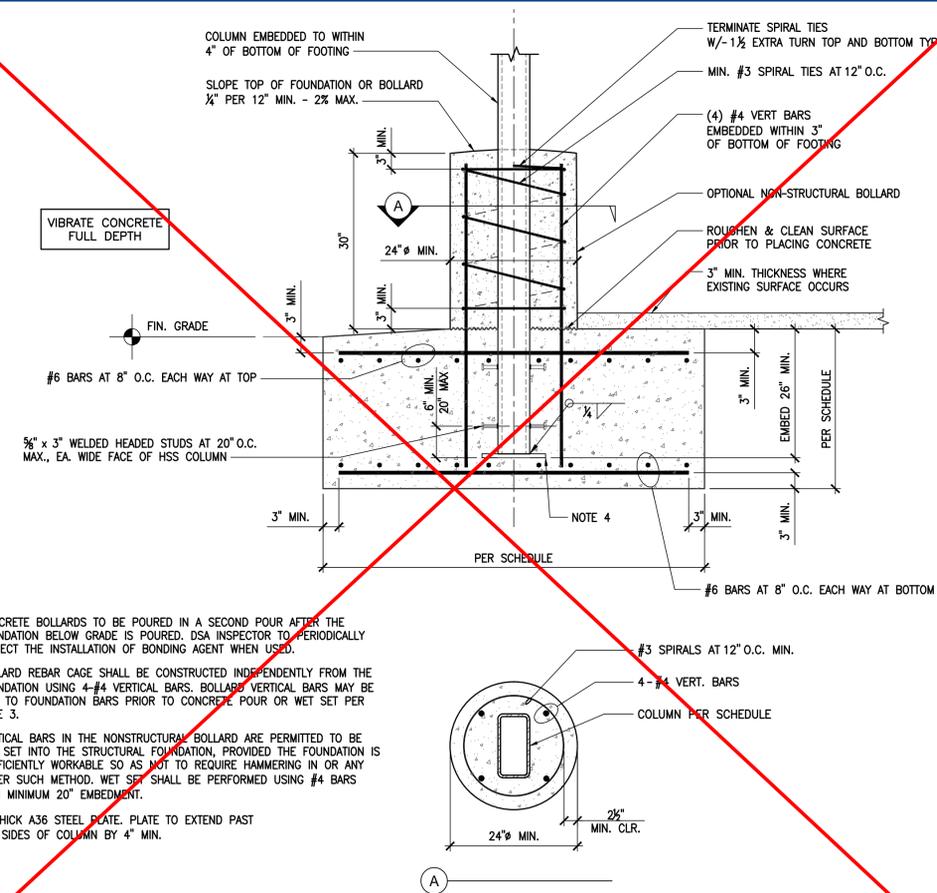

- NOTES:**
- CONCRETE BOLLARDS TO BE POURED IN A SECOND POUR AFTER THE FOUNDATION BELOW GRADE IS POURED. DSA INSPECTOR TO PERIODICALLY INSPECT THE INSTALLATION OF BONDING AGENT WHEN USED.
 - BOLLARD REBAR CAGE SHALL BE CONSTRUCTED INDEPENDENTLY FROM THE FOUNDATION USING 4-#4 VERTICAL BARS. BOLLARD VERTICAL BARS MAY BE TIED TO FOUNDATION BARS PRIOR TO CONCRETE POUR OR WET SET PER NOTE 3.
 - VERTICAL BARS IN THE NONSTRUCTURAL BOLLARD ARE PERMITTED TO BE WET SET INTO THE STRUCTURAL FOUNDATION, PROVIDED THE FOUNDATION IS SUFFICIENTLY WORKABLE SO AS NOT TO REQUIRE HAMMERING IN OR ANY OTHER SUCH METHOD. WET SET SHALL BE PERFORMED USING #4 BARS WITH MINIMUM 20" EMBEDMENT.
 - 1" THICK A36 STEEL PLATE TO EXTEND PAST ALL SIDES OF COLUMN BY 4" MIN.

4 SPREAD FOOTING

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 01-118970 INC:
REVIEWED FOR
SS FLS ACS
DATE: 08/11/2020

ENGINEER'S APPROVAL

DATE SIGNED
11/28/2018

SITE SPECIFIC DSA APPROVAL

FILE NUMBER: PC-119
IDENTIFICATION STAMP
DIVISION OF THE STATE ARCHITECT
APP. NO: 04 - 117117 INCR
AC DF FLS DS SS DP
DATE 12/05/2018

PRE-CHECK (PC) DOCUMENT
CODE: 2016 CBC
A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED

MBARC CONSTRUCTION INC.
PHONE: (760) 744-4131
FAX: (760) 744-4449
GREGJ@MBARCONLINE.COM (775) 787-8845
674 RANCHEROS DR
SAN MARCOS, CA 92069
GREG JONES

4STEL ENGINEERING
STRUCTURAL ENGINEERING
PHONE: (949) 305-1150
FAX: (949) 305-1420
26030 ACHERO, SUITE 200
MISSION VIEJO, CA 92691

VERSA CANOPY FOUNDATION SCHEDULES


DRAWN GM
CHECKED KS
DATE 11/28/2018
4STEL JOB NO. MC03-01
SHEET

S-10


10 OF 13 SHEETS

NOTES:

1. CONCRETE BOLLARDS TO BE POURED IN A SECOND POUR AFTER THE FOUNDATION BELOW GRADE IS POURED. DSA INSPECTOR TO PERIODICALLY INSPECT THE INSTALLATION OF BONDING AGENT WHEN USED.
2. BOLLARD REBAR CAGE SHALL BE CONSTRUCTED INDEPENDENTLY FROM THE FOUNDATION USING 4-#4 VERTICAL BARS UNLESS WET SET IS PERFORMED PER NOTE 3 OR CONTINUOUS FOUNDATION BARS ARE USED PER NOTE 4.
3. VERTICAL BARS IN THE NONSTRUCTURAL BOLLARD ARE PERMITTED TO BE WET SET INTO THE STRUCTURAL FOUNDATION, PROVIDED THE FOUNDATION IS SUFFICIENTLY WORKABLE SO AS NOT TO REQUIRE HAMMERING IN OR ANY OTHER SUCH METHOD. WET SET SHALL BE PERFORMED USING #4 BARS WITH MINIMUM 20' EMBEDMENT.
4. BOLLARD REINFORCING IS PERMITTED TO USE MIN. (4) FOUNDATION VERT. BARS CONTINUOUS TO 3' BELOW TOP OF BOLLARD IN LIEU OF 4-#4 BARS.

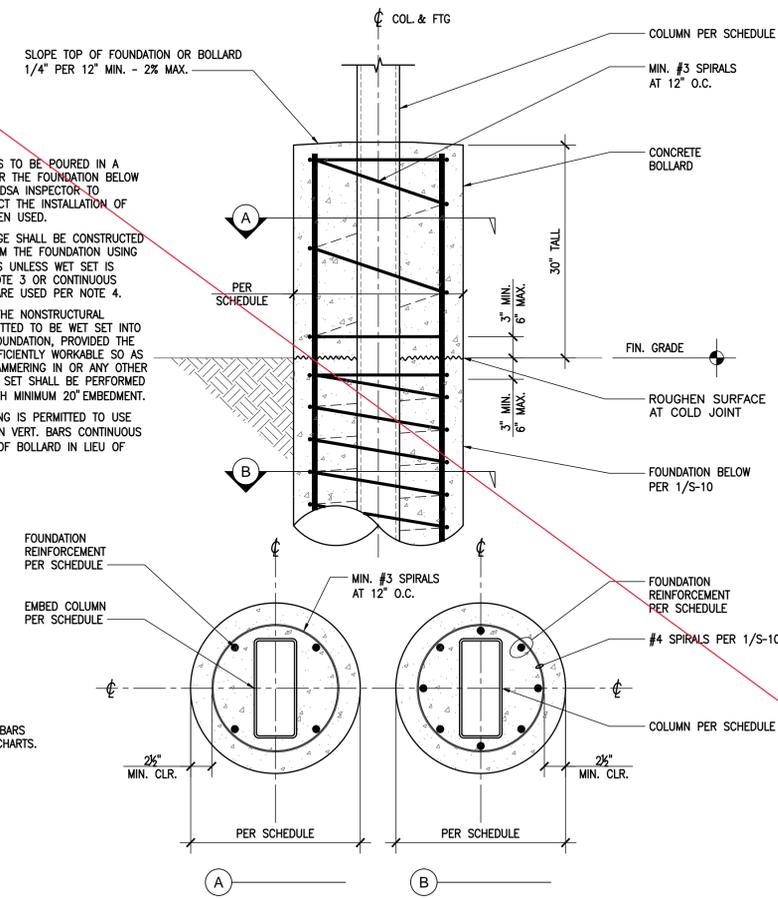


7 OPTIONAL CONCRETE BOLLARD
1"=1'-0"

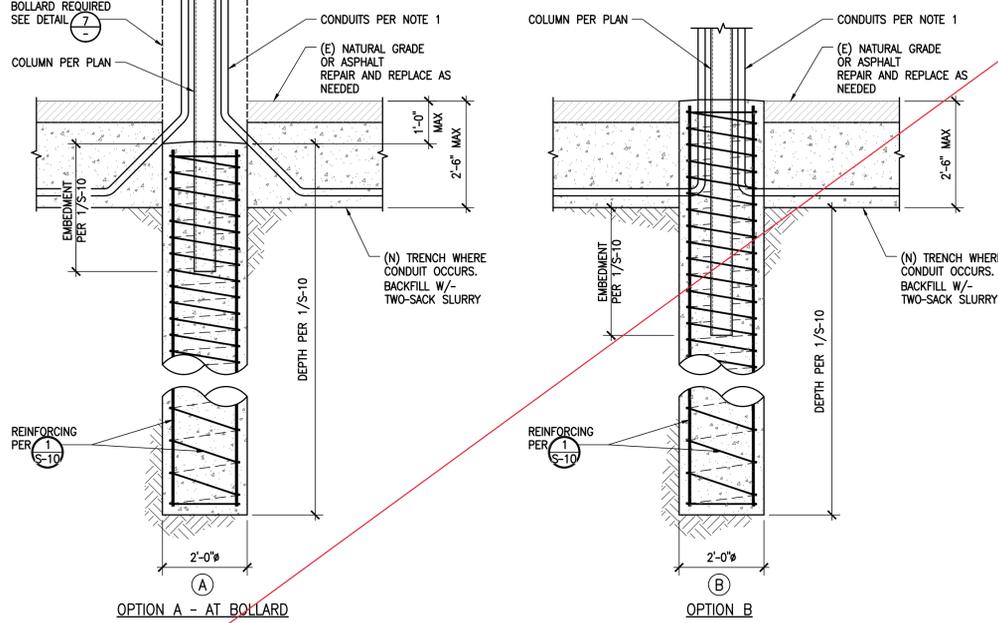


8 CONDUIT AT DRILLED PIER
1"=1'-0"

- NOTE:**
1. CONDUIT IN FOUNDATION SHALL NOT EXCEED (1) 2" MAX Ø CONDUIT OR (2) 1 1/2" MAX Ø CONDUIT. WHEN (2) CONDUIT ARE USED IN THE SAME FOUNDATION, THE CONDUIT MAY ENTER THE FOUNDATION FROM EITHER SIDE.
 2. CONDUIT TRENCH SHALL BE FILLED WITH MIN 2-SACK SLURRY.

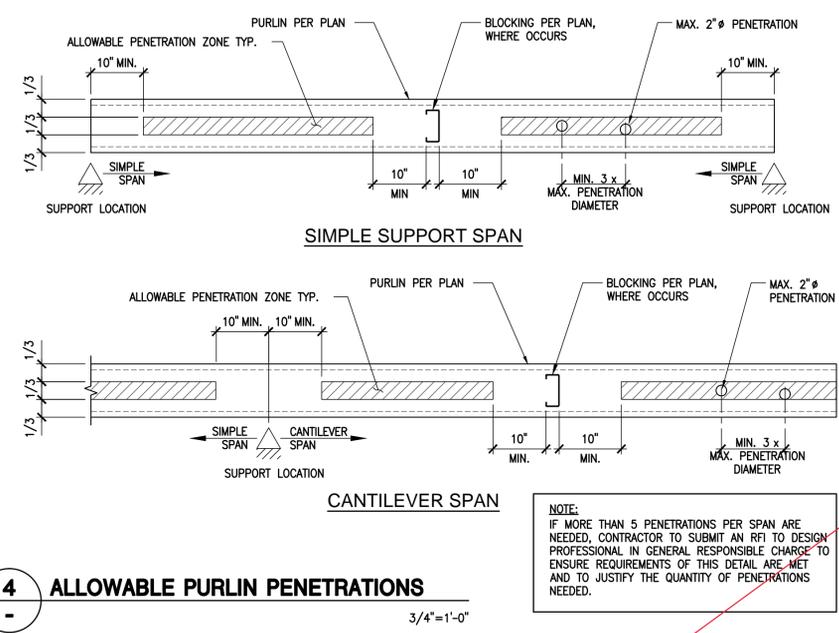


4 ALLOWABLE PURLIN PENETRATIONS
3/4"=1'-0"

- NOTE:**
- IF MORE THAN 5 PENETRATIONS PER SPAN ARE NEEDED, CONTRACTOR TO SUBMIT AN RFI TO DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE TO ENSURE REQUIREMENTS OF THIS DETAIL ARE MET AND TO JUSTIFY THE QUANTITY OF PENETRATIONS NEEDED.

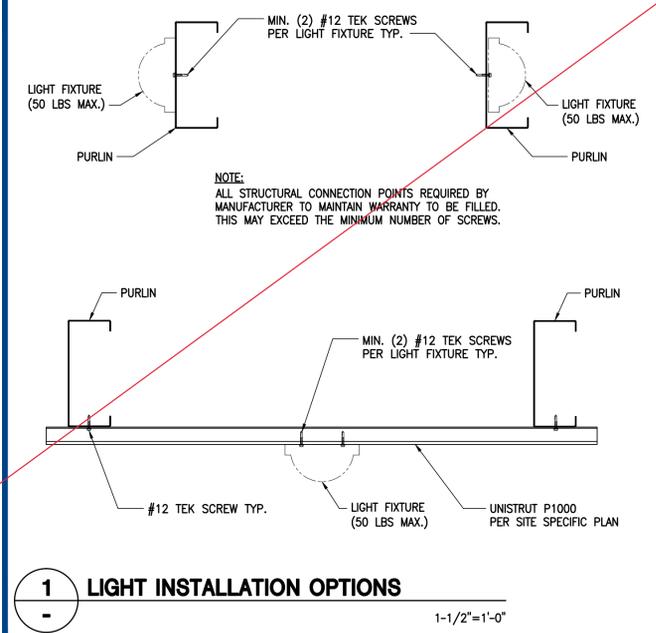


1 LIGHT INSTALLATION OPTIONS
1-1/2"=1'-0"

- NOTE:**
- ALL STRUCTURAL CONNECTION POINTS REQUIRED BY MANUFACTURER TO MAINTAIN WARRANTY TO BE FILLED. THIS MAY EXCEED THE MINIMUM NUMBER OF SCREWS.

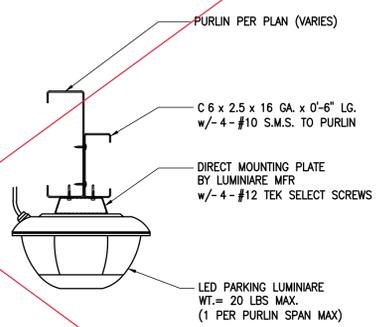


5 TYPICAL PARKING LUMINAIRE AT PURLIN
1 1/2"=1'-0"

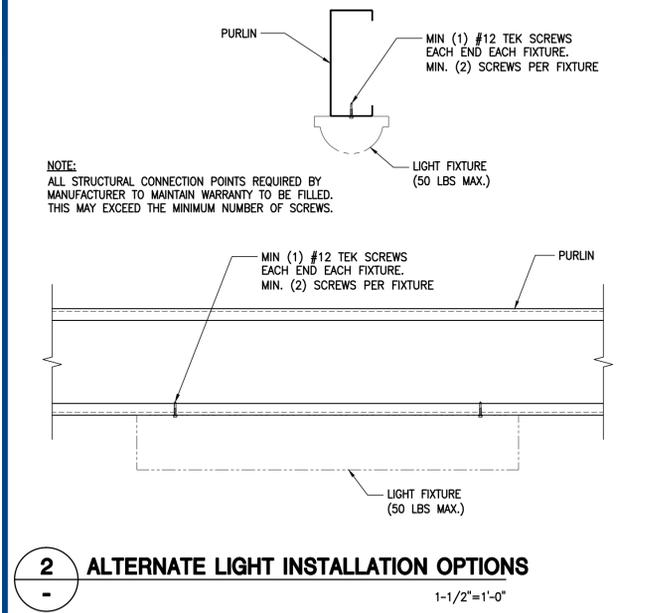


2 ALTERNATE LIGHT INSTALLATION OPTIONS
1-1/2"=1'-0"

- NOTE:**
- ALL STRUCTURAL CONNECTION POINTS REQUIRED BY MANUFACTURER TO MAINTAIN WARRANTY TO BE FILLED. THIS MAY EXCEED THE MINIMUM NUMBER OF SCREWS.

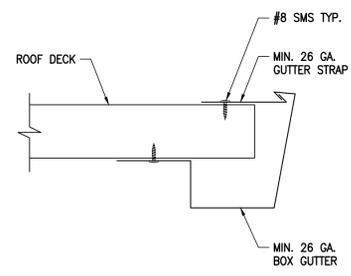

6 GUTTER DETAIL
3"=1'-0"

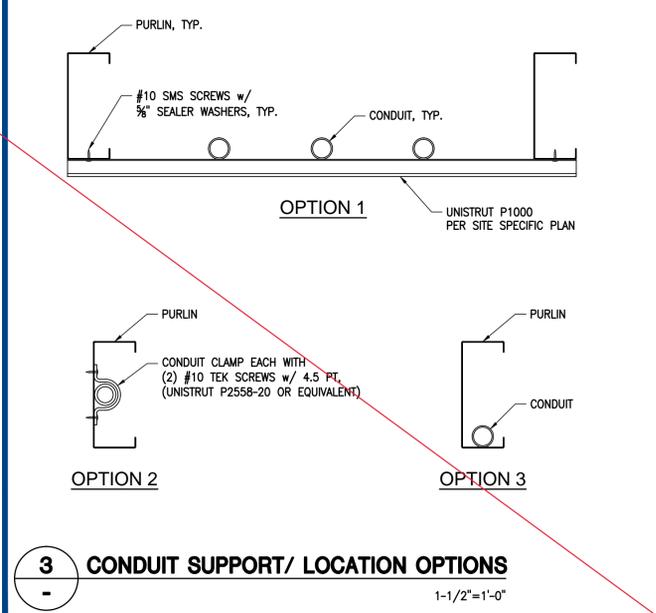

3 CONDUIT SUPPORT/ LOCATION OPTIONS
1-1/2"=1'-0"

ENGINEER'S APPROVAL

DATE SIGNED
11/28/2018

SITE SPECIFIC DSA APPROVAL

FILE NUMBER: PC-119
IDENTIFICATION STAMP
DIVISION OF THE STATE ARCHITECT
APP. NO: 04 - 117117 INCR
AC DF FL DS SS DP
DATE 12/05/2018

PRE-CHECK (PC) DOCUMENT
CODE: 2016 CBC
A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED

MBARC CONSTRUCTION INC.
IIC # 869980
PHONE: (760) 744-4131
SAN MARCOS, CA 92069
FAX: (760) 744-4449
GREGJ@MBARCONLINE.COM (775) 787-8845
GREG JONES

4STEL ENGINEERING
STRUCTURAL ENGINEERING
26030 ACHERO, SUITE 200
MISSION VIEJO, CA 92691
PHONE: (949) 305-1150
FAX: (949) 305-1420


VERSA CANOPY STANDARD DETAILS 2

DRAWN GM
CHECKED KS
DATE
11/28/2018
4STEL JOB NO.
MC03-01
SHEET
S-12
12 OF 13 SHEETS




10 ELEVATION AT STAIRS
 3/32"=1'-0"

NOTES:
 1. SHOWN FOR ARCHITECTURAL VISUALIZATION ONLY. SEE S-6 & S-8 FOR STRUCTURAL FRAMING REQUIREMENTS.
 2. OPTION ONLY ALLOWED IF SITE SPECIFIC MAXIMUM DRIFT SNOW LOAD IS LESS THAN THE ALLOWABLE SNOW LOAD OF THE STRUCTURE SELECTIONS.

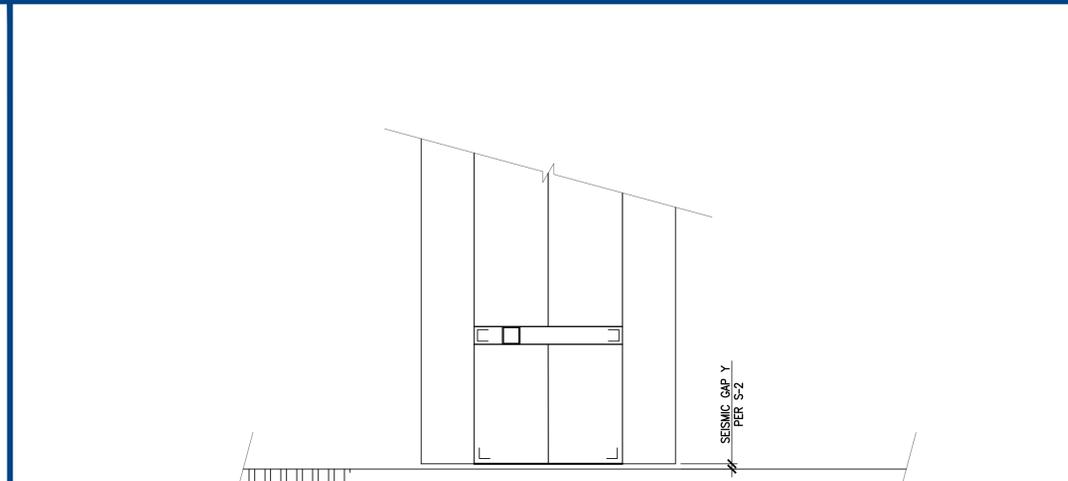


9 90 DEGREE ROOF CONNECTION OPTION
 1/4"=1'-0"

NOTE:
 1. SHOWN FOR ARCHITECTURAL VISUALIZATION ONLY. SEE S-6 & S-8 FOR STRUCTURAL FRAMING REQUIREMENTS.

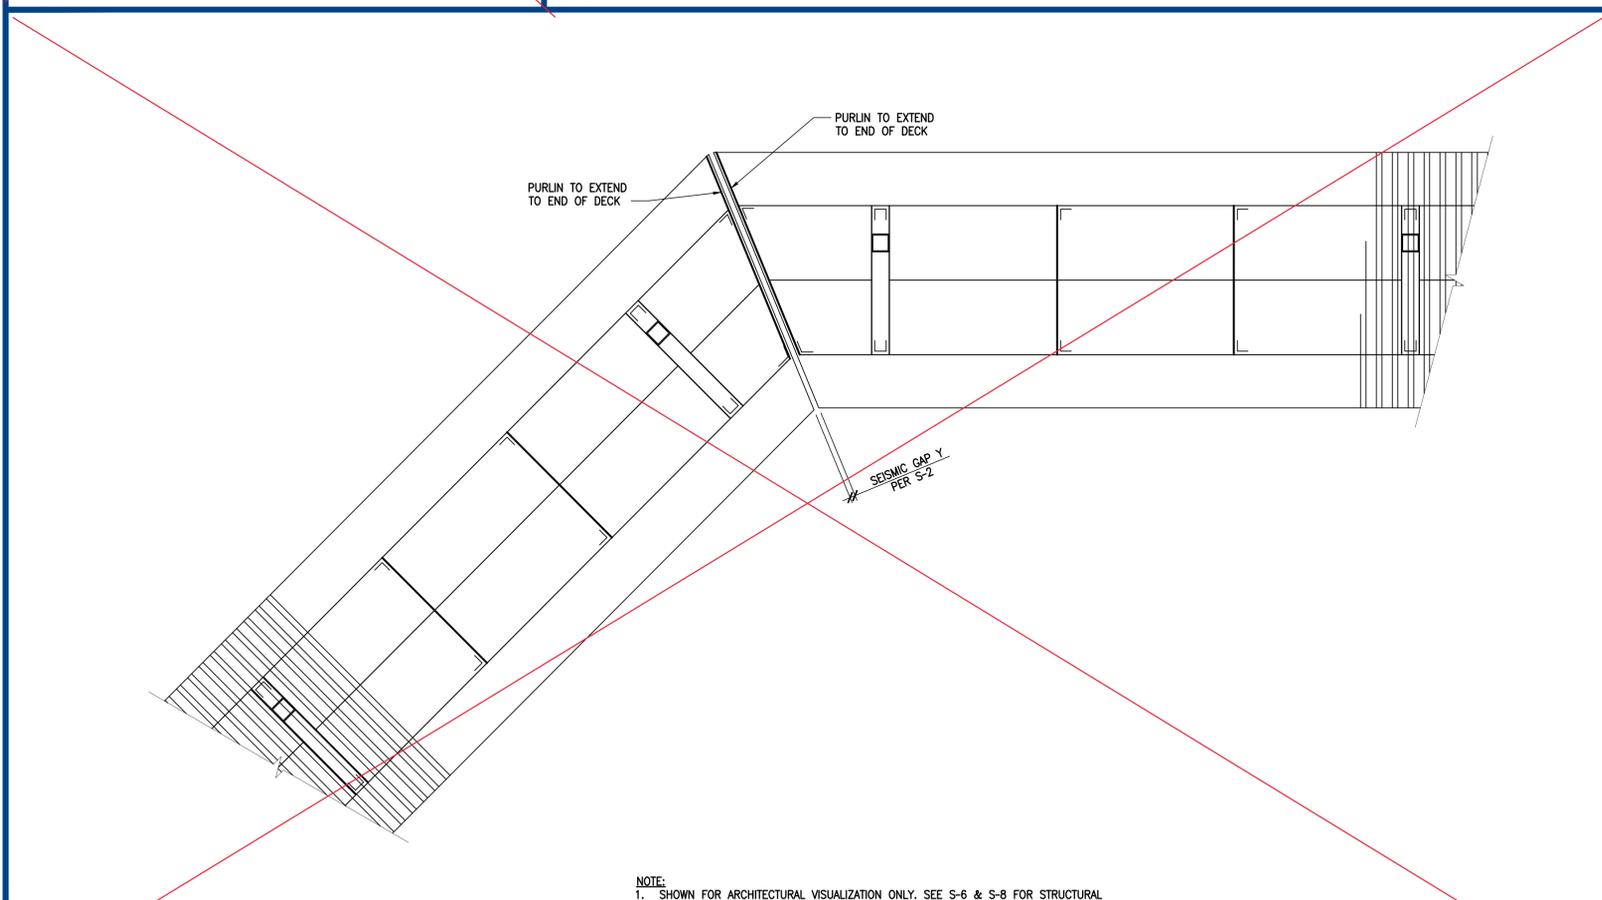


11 45 DEGREE ANGLED ROOF CONNECTION OPTION
 1/4"=1'-0"

NOTE:
 1. SHOWN FOR ARCHITECTURAL VISUALIZATION ONLY. SEE S-6 & S-8 FOR STRUCTURAL FRAMING REQUIREMENTS.

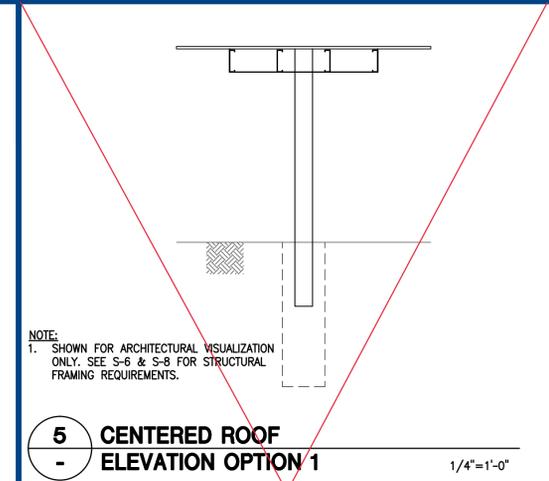


5 CENTERED ROOF ELEVATION OPTION 1
 1/4"=1'-0"

NOTE:
 1. SHOWN FOR ARCHITECTURAL VISUALIZATION ONLY. SEE S-6 & S-8 FOR STRUCTURAL FRAMING REQUIREMENTS.

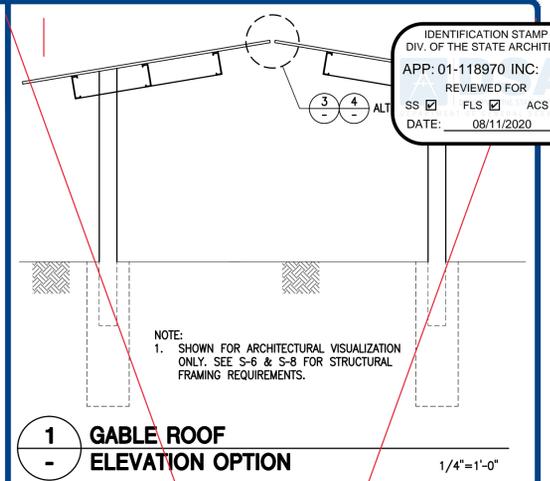


1 GABLE ROOF ELEVATION OPTION
 1/4"=1'-0"

NOTE:
 1. SHOWN FOR ARCHITECTURAL VISUALIZATION ONLY. SEE S-6 & S-8 FOR STRUCTURAL FRAMING REQUIREMENTS.

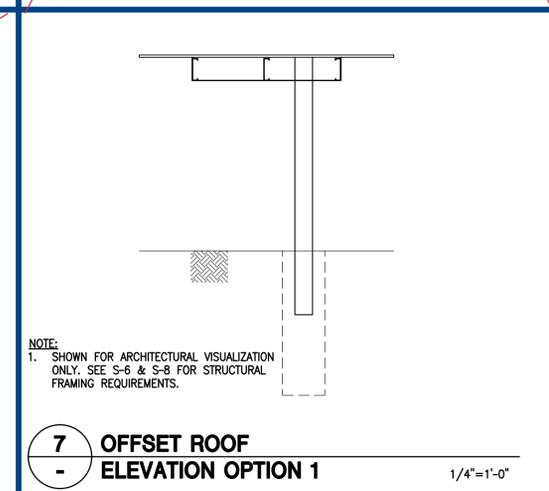


6 CENTERED ROOF ELEVATION OPTION 2
 1/4"=1'-0"

NOTE:
 1. SHOWN FOR ARCHITECTURAL VISUALIZATION ONLY. SEE S-6 & S-8 FOR STRUCTURAL FRAMING REQUIREMENTS.

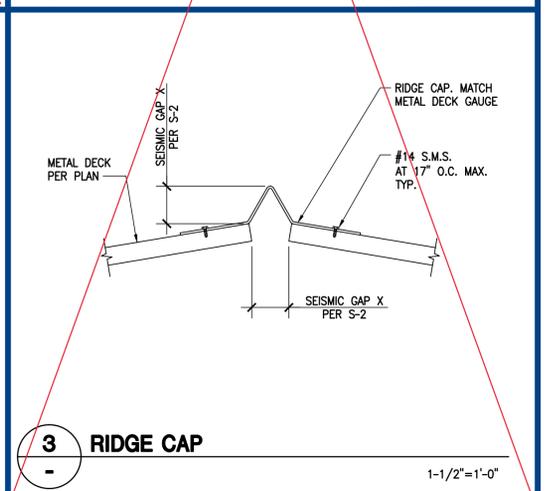


2 DOUBLE GABLE ROOF ELEVATION OPTION 2
 3/32"=1'-0"

NOTE:
 1. SHOWN FOR ARCHITECTURAL VISUALIZATION ONLY. SEE S-6 & S-8 FOR STRUCTURAL FRAMING REQUIREMENTS.

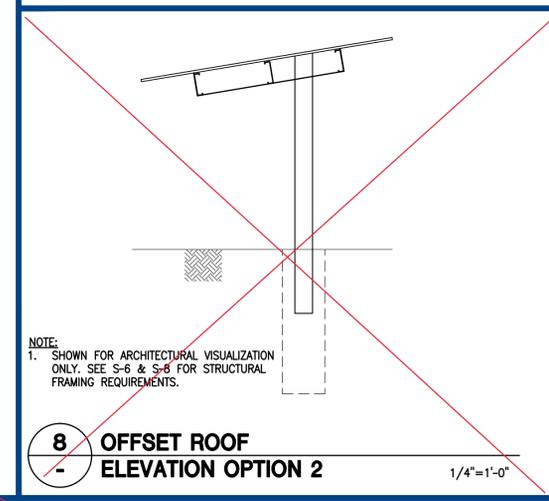

7 OFFSET ROOF ELEVATION OPTION 1
 1/4"=1'-0"

NOTE:
 1. SHOWN FOR ARCHITECTURAL VISUALIZATION ONLY. SEE S-6 & S-8 FOR STRUCTURAL FRAMING REQUIREMENTS.

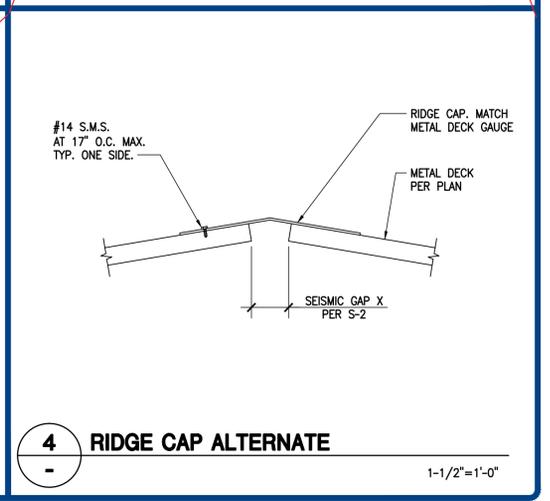

3 RIDGE CAP
 1-1/2"=1'-0"



8 OFFSET ROOF ELEVATION OPTION 2
 1/4"=1'-0"

NOTE:
 1. SHOWN FOR ARCHITECTURAL VISUALIZATION ONLY. SEE S-6 & S-8 FOR STRUCTURAL FRAMING REQUIREMENTS.



4 RIDGE CAP ALTERNATE
 1-1/2"=1'-0"

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP: 01-118970 INC:
 REVIEWED FOR
 SS FLS ACS
 DATE: 08/11/2020

ENGINEER'S APPROVAL

DATE SIGNED
 11/28/2018

SITE SPECIFIC DSA APPROVAL

FILE NUMBER: PC-119
 IDENTIFICATION STAMP
 DIVISION OF THE STATE ARCHITECT
 APP. NO: 04 - 117117 INCR
 AC DF FL S DS SS DP
 DATE 12/05/2018
 PRE-CHECK (PC) DOCUMENT
 CODE: 2016 CBC
 A SEPARATE PROJECT APPLICATION FOR CONSTRUCTION IS REQUIRED

MBARC CONSTRUCTION INC.
 674 RANCHEROS DR
 SAN MARCOS, CA 92069
 PHONE: (760) 744-4131
 FAX: (760) 744-4449
 GREGJ@MBARCONLINE.COM (775) 787-8845
 LIC # 869960
 B AND C 51

4STEL ENGINEERING
 STRUCTURAL ENGINEERING
 26030 A CHERO, SUITE 200
 MISSION VIEJO, CA 92691
 PHONE: (949) 305-1150
 FAX: (949) 305-1420

VERSA CANOPY
 STANDARD DETAILS 3

DRAWN GM
 CHECKED KS
 DATE 11/28/2018
 4STEL JOB NO. MC03-01
 SHEET

S-13
 13 OF 13 SHEETS

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS

Application Number: 01-118970

School Name:Vinci Park Elementary School **School District:** Berryessa Union School District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/15/2020

IMPORTANT: This form is only a summary list of structural tests and some of the special inspections required for the project. Generally, the structural tests and special inspections noted on this form are those that will be performed by the Geotechnical Engineer of Record, Laboratory of Record, or Special Inspector. The actual complete test and inspection program must be performed as detailed on the DSA approved documents. The appendix at the bottom of this form identifies work NOT subject to DSA requirements for special inspection or structural testing. The project inspector is responsible for providing inspection of all facets of construction, including but not limited to, special inspections not listed on this form such as structural wood framing, high-load wood diaphragms, cold-formed steel framing, anchorage of non-structural components, etc., per Title 24, Part 2, Chapter 17A.

KEY TO COLUMNS

1. TYPE	2. PERFORMED BY
<p>Continuous – Indicates that a continuous special inspection is required</p> <p>Periodic – Indicates that a periodic special inspection is required</p> <p>Test – Indicates that a test is required</p>	<p>GE – Indicates that the special inspection shall be performed by a registered geotechnical engineer or his or her authorized representative.</p> <p>LOR – Indicates that the test or special inspection shall be performed by a testing laboratory accepted in the DSA Laboratory Evaluation and Acceptance (LEA) Program. See CAC Section 4-335.</p> <p>PI – Indicates that the special inspection may be performed by a project inspector when specifically approved by DSA.</p> <p>SI – Indicates that the special inspection shall be performed by an appropriately qualified/approved special inspector.</p>

****NOTE:** Undefined section and table references found in this document are from the CBC, or California Building Code.

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (SOILS)

Application Number: 01-118970

School Name: Vinci Park Elementary School School District: Berryessa Union School

District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/15/2020

Geotechnical Reports: Project does NOT have and does NOT require a geotechnical report

1. GENERAL:		Table 1705A.6		
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/>	a. Verify that: <ul style="list-style-type: none"> • Site has been prepared properly prior to placement of controlled fill and/or excavations for foundations. • Foundation excavations are extended to proper depth and have reached proper material. • Materials below footings are adequate to achieve the design bearing capacity. 	See Notes	PI	Refer to specific items identified in the Appendix listing exemptions for limitations. Placement of controlled fill exceeding 12" depth under foundations is not permitted without a geotechnical report.

2. SOIL COMPACTION AND FILL:		Table 1705A.6		
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>	a. Verify use of proper materials, densities and inspect lift thicknesses, placement and compaction during placement of fill.	Continuous	LOR*	* Under the supervision of a geotechnical engineer or LOR's engineering manager. Refer to specific items identified in the Appendix listing exemptions for limitations.
<input type="checkbox"/>	b. Compaction testing.	Test	LOR*	* Under the supervision of a geotechnical engineer or LOR's engineering manager. Refer to specific items identified in the Appendix listing exemptions for limitations.

3. DRIVEN DEEP FOUNDATIONS (PILES):		Table 1705A.7		
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>	a. Verify pile materials, sizes and lengths comply with the requirements.	Continuous	GE*	* By geotechnical engineer or his or her qualified representative.

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (SOILS)

Application Number: 01-118970

School Name: Vinci Park Elementary School School District: Berryessa Union School

District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/15/2020

<input type="checkbox"/>	b. Determine capacities of test piles and conduct additional load tests as required.	Test	LOR*	* Under the supervision of the geotechnical engineer.
<input type="checkbox"/>	c. Inspect driving operations and maintain complete and accurate records for each pile.	Continuous	GE*	* By geotechnical engineer or his or her qualified representative.
<input type="checkbox"/>	d. Verify locations of piles and their plumbness, confirm type and size of hammer, record number of blows per foot of penetration, determine required penetrations to achieve design capacity, record tip and butt elevations and record any pile damage.	Continuous	GE*	* By geotechnical engineer or his or her qualified representative.

3. DRIVEN DEEP FOUNDATIONS (PILES):		Table 1705A.7		
Test or Special Inspection		Type	Performed By	Code References and Notes
<input type="checkbox"/>	e. Steel piles.	Provide tests and inspections per STEEL section below.		
<input type="checkbox"/>	f. Concrete piles and concrete filled piles.	Provide tests and inspections per CONCRETE section below.		
<input type="checkbox"/>	g. For specialty piles, perform additional inspections as determined by the registered design professional in responsible charge.	*	*	* As defined on drawings or specifications.

4. CAST-IN-PLACE DEEP FOUNDATIONS (PIERS):		Table 1705A.8		
Test or Special Inspection		Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/>	a. Inspect drilling operations and maintain complete and accurate records for each pier.	Continuous	PI	Continuous inspection to be provided by project inspector. Refer to specific items identified in the Appendix listing exemptions for limitations.
<input checked="" type="checkbox"/>	b. Verify pier locations, diameters, plumbness and lengths. Record concrete or grout volumes.	Continuous	PI	Continuous inspection to be provided by project inspector. Refer to specific items identified in the Appendix listing exemptions for limitations.
<input checked="" type="checkbox"/>	c. Concrete piers.	Provide tests and inspections per CONCRETE section below.		

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (SOILS)

Application Number: 01-118970

School Name: Vinci Park Elementary School School District: Berryessa Union School District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/15/2020

5. RETAINING WALLS:				
<input type="checkbox"/>	a. Segmental retaining walls; inspect placement of units, dowels, connectors, etc.	Continuous	GE*	* By geotechnical engineer or his or her qualified representative. See DSA IR 16-3.
<input type="checkbox"/>	b. Placement of soil reinforcement, drainage devices and/or backfill.	Continuous	GE*	Placement, compaction and inspection of backfill per Section 1705A.6.1 for fills supporting foundations (Section 2 above). * By geotechnical engineer or his or her qualified representative.
<input type="checkbox"/>	c. Concrete retaining walls.	Provide tests and inspections per CONCRETE section below.		
<input type="checkbox"/>	d. Masonry retaining walls.	Provide tests and inspections per MASONRY section below.		

6. OTHER SOILS:				
<input type="checkbox"/>	a. Soil Improvements	Test	GE*	Submit a comprehensive report documenting final soil improvements constructed, construction observation and the results of the confirmation testing and analysis to CGS for final acceptance. * By geotechnical engineer or his or her qualified representative.
<input type="checkbox"/>	b. Inspection of Soil Improvements	Continuous	GE*	* By geotechnical engineer or his or her qualified representative.
<input type="checkbox"/>				

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (Concrete)

Table 1705A.3; ACI 318-14 Sections 26.12 & 26.13

Application Number: 01-118970

School Name: Vinci Park Elementary School School District: Berryessa Union School District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/15/2020

7. CAST-IN-PLACE CONCRETE				
Material Verification and Testing:				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/>	a. Verify use of required design mix.	Periodic	SI	Table 1705A.3 Item 5, 1910A.1.
<input checked="" type="checkbox"/>	b. Identify, sample, and test reinforcing steel.	Test	LOR	1910A.2; ACI 318-14 Section 26.6.1.2; DSA IR 17-10. (See Appendix for exemptions.)
<input checked="" type="checkbox"/>	c. During concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.	Test	LOR	Table 1705A.3 Item 6; ACI 318-14 Sections 26.5 & 26.12.
<input checked="" type="checkbox"/>	d. Test concrete (f_c).	Test	LOR	1905A.1.15; ACI 318-14 Section 26.12.
Inspection:				
<input type="checkbox"/>	e. Batch plant inspection: Continuous	See Notes	SI	Default of ' Continuous ' per 1705A.3.3. If approved by DSA, batch plant inspection may be reduced to ' Periodic ' subject to requirements in Section 1705A.3.3.1, or eliminated per 1705A.3.3.2. (See Appendix for exemptions.)
<input checked="" type="checkbox"/>	f. Welding of reinforcing steel.	Provide special inspection per STEEL, Category 19.1(d) & (e) and/or 19.2(g) & (h) below.		

8. PRESTRESSED / POST-TENSIONED CONCRETE (in addition to Cast-in-Place Concrete tests and inspections):				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>	a. Sample and test prestressing tendons and anchorages.	Test	LOR	1705A.3.4, 1910A.3
<input type="checkbox"/>	b. Inspect placement of prestressing tendons.	Periodic	SI	1705A.3.4, Table 1705A.3 Items 1 & 9.

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (Concrete)

Table 1705A.3; ACI 318-14 Sections 26.12 & 26.13

Application Number: 01-118970

School Name: Vinci Park Elementary School **School District:** Berryessa Union School District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/15/2020

<input type="checkbox"/>	c. Verify in-situ concrete strength prior to stressing of post-tensioning tendons.	Periodic	SI	Table 1705A.3 Item 11. Special inspector to verify specified concrete strength test prior to stressing.
<input type="checkbox"/>	d. Inspect application of post-tensioning or prestressing forces and grouting of bonded prestressing tendons.	Continuous	SI	1705A.3.4, Table 1705A.3 Item 9; ACI 318-14 Section 26.13

9. PRECAST CONCRETE (in addition to Cast-in-Place Concrete tests and inspections):

	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>	a. Inspect fabrication of precast concrete members.	Continuous	SI	ACI 318-14 Section 26.13.
<input type="checkbox"/>	b. Inspect erection of precast concrete members.	Periodic	SI*	Table 1705A.3 Item 10. * May be performed by PI when specifically approved by DSA.

10. SHOTCRETE (in addition to Cast-in-Place Concrete tests and inspections):

	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>	a. Inspect shotcrete placement for proper application techniques.	Continuous	SI	1705A.19, Table 1705A.3 Item 7, 1908A.6, 1908A.7, 1908A.8, 1908A.9, 1908A.11, 1908A.12. See ACI 506.2-13 Section 3.4, ACI 506R-16.
<input type="checkbox"/>	b. Sample and test shotcrete (f'_c).	Test	LOR	1908A.5, 1908A.10.

11. POST-INSTALLED ANCHORS:

	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>	a. Inspect installation of post-installed anchors	See Notes	SI*	1617A.1.19, Table 1705A.3 Item 4a (Continuous) & 4b (Periodic), 1705A.3.8 (See Appendix for exemptions). ACI 318-14

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (Concrete)

Table 1705A.3; ACI 318-14 Sections 26.12 & 26.13

Application Number: 01-118970

School Name:Vinci Park Elementary School **School District:** Berryessa Union School District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/15/2020

				Sections 17.8 & 26.13. * May be performed by the project inspector when specifically approved by DSA.
<input type="checkbox"/>	b. Test post-installed anchors.	Test	LOR	1910A.5. (See Appendix for exemptions.)

12. OTHER CONCRETE:				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>				

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (Steel and Aluminum)

1705A.2.1, Table 1705A.2.1; AISC 303-16, AISC 341-16, AISC 358-16, AISC 360-16; AISI S100-16

Application Number: 01-118970

School Name: Vinci Park Elementary School School District: Berryessa Union School

District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/15/2020

17. STRUCTURAL STEEL, COLD-FORMED STEEL AND ALUMINUM USED FOR STRUCTURAL PURPOSES				
Material Verification and Testing:				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/>	a. Verify identification of all materials and: <ul style="list-style-type: none"> • Mill certificates indicate material properties that comply with requirements. • Material sizes, types and grades comply with requirements. 	Periodic	*	Table 1705A.2.1 Item 3a–3c. 2202A.1; AISI S100-16 Section A3.1 & A3.2, AISI S240-15 Section A3 & A5, AISI S220-15 Sections A4 & A6. * By special inspector or qualified technician when performed off-site.
<input checked="" type="checkbox"/>	b. Test unidentified materials	Test	LOR	2202A.1.
<input checked="" type="checkbox"/>	c. Examine seam welds of HSS shapes	Periodic	SI	DSA IR 17-3.
Inspection:				
<input checked="" type="checkbox"/>	d. Verify and document steel fabrication per DSA-approved construction documents.	Periodic	SI	Not applicable to cold-formed steel light-frame construction, except for trusses (1705A.2.4).

18. HIGH-STRENGTH BOLTS: RCSC 2014				
Material Verification and Testing of High-Strength Bolts, Nuts and Washers:				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/>	a. Verify identification markings and manufacturer's certificates of compliance conform to ASTM standards specified in the DSA-approved documents.	Periodic	SI	Table 1705A.2.1 Items 1a & 1b, 2202A.1; AISC 360-16 Section A3.3, J3.1, and N3.2; RCSC 2014 Section 1.5 & 2.1; DSA IR 17-8 & DSA IR 17-9.
<input checked="" type="checkbox"/>	b. Test high-strength bolts, nuts and washers.	Test	LOR	Table 1705A.2.1 Item 1c, 2213A.1; RCSC 2014 Section 7.2; DSA IR 17-8.
Inspection of High-Strength Bolt Installation:				

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (Steel and Aluminum)

1705A.2.1, Table 1705A.2.1; AISC 303-16, AISC 341-16, AISC 358-16, AISC 360-16; AISI S100-16

Application Number: 01-118970

School Name Vinci Park Elementary School School District: Berryessa Union School

District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/15/2020

<input type="checkbox"/>	c. Bearing-type ("snug tight") connections.	Periodic	SI	Table 1705A.2.1 Item 2a, 1705A.2.6, 2204A.2; AISC 360-16 J3.1, J3.2, M2.5 & N5.6; RCSC 2014 Section 9.1; DSA IR 17-9.
<input checked="" type="checkbox"/>	d. Pretensioned and slip-critical connections.	*	SI	Table 1705A.2.1 Items 2b & 2c, 1705A.2.6, 2204A.2; AISC 360-16 J3.1, J3.2, M2.5 & N5.6; RCSC 2014 Sections 9.2 & 9.3; DSA IR 17-9. * "Continuous" or "Periodic" depends on the tightening method used.

19. WELDING:	1705A.2.5, Table 1705A.2.1 Items 4 & 5; AWS D1.1 and AWS D1.8 for structural steel; AWS D1.2 for Aluminum; AWS D1.3 for cold-formed steel; AWS D1.4 for reinforcing steel; DSA IR 17-3 (See Appendix for exemptions.)
---------------------	--

Verification of Materials, Equipment, Welders, etc.:

	Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/>	a. Verify weld filler material identification markings per AWS designation listed on the DSA-approved documents and the WPS.	Periodic	SI	DSA IR 17-3.
<input checked="" type="checkbox"/>	b. Verify weld filler material manufacturer's certificate of compliance.	Periodic	SI	DSA IR 17-3.
<input checked="" type="checkbox"/>	c. Verify WPS, welder qualifications and equipment.	Periodic	SI	DSA IR 17-3.

19.1 SHOP WELDING:

	Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/>	a. Inspect groove welds, multi-pass fillet welds, single pass fillet welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Items 5a.1-4; AISC 360-16 (and AISC 341-16 as applicable); DSA IR 17-3.
<input type="checkbox"/>	b. Inspect single-pass fillet welds ≤ 5/16", floor and roof deck welds.	Periodic	SI	1705A.2.2, Table 1705A.2.1 Items 5a.5 & 5a.6; AISC 360-16 (and AISC 341-16 as applicable); DSA IR 17-3.
<input type="checkbox"/>	c. Inspect welding of stairs and railing systems.	Periodic	SI	1705A.2.1; AISC 360-16 (and AISC 341-16 as applicable); AWS D1.1 & D1.3; DSA IR 17-3.

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (Steel and Aluminum)

1705A.2.1, Table 1705A.2.1; AISC 303-16, AISC 341-16, AISC 358-16, AISC 360-16; AISI S100-16

Application Number: 01-118970

School Name: Vinci Park Elementary School School District: Berryessa Union School

District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/15/2020

<input type="checkbox"/>	d. Verification of reinforcing steel weldability other than ASTM A706.	Periodic	SI	1705A.3.1; AWS D1.4; DSA IR 17-3. Verify carbon equivalent reported on mill certificates.
<input type="checkbox"/>	e. Inspect welding of reinforcing steel.	Continuous	SI	Table 1705A.2.1 Item 5b, 1705A.3.1, Table 1705A.3 Item 2, 1903A.8; AWS D1.4; DSA IR 17-3.
19.2 FIELD WELDING:				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>	a. Inspect groove welds, multi-pass fillet welds, single pass fillet welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Items 5a.1–4; AISC 360-16 (AISC 341-16 as applicable); DSA IR 17-3.
<input type="checkbox"/>	b. Inspect single-pass fillet welds ≤ 5/16".	Periodic	SI	Table 1705A.2.1 Item 5a.5; AISC 360-16 (AISC 341-16 as applicable); DSA IR 17-3.
<input type="checkbox"/>	c. Inspect end-welded studs (ASTM A-108) installation (including bend test).	Periodic	SI	2213A.2; AISC 360-16 (AISC 341-16 as applicable); AWS D1.1; DSA IR 17-3.
<input type="checkbox"/>	d. Inspect floor and roof deck welds.	Periodic	SI	1705A.2.2, Table 1705A.2.1 Item 5a.6; AISC 360-16 (AISC 341-16 as applicable); AWS D1.3; DSA IR 17-3.
<input type="checkbox"/>	e. Inspect welding of structural cold-formed steel.	Periodic	SI*	1705A.2.5; AWS D1.3; DSA IR 17-3. The quality control provisions of AISI S240-15 Chapter D shall also apply. * May be performed by the project inspector when specifically approved by DSA.
<input type="checkbox"/>	f. Inspect welding of stairs and railing systems.	Periodic	SI*	1705A.2.1; AISC 360-16 (AISC 341-16 as applicable); AWS D1.1 & D1.3; DSA IR 17-3. * May be performed by the project inspector when specifically approved by DSA.
<input type="checkbox"/>	g. Verification of reinforcing steel weldability.	Periodic	SI	1705A.3.1; AWS D1.4; DSA IR 17-3. Verify carbon equivalent reported on mill certificates.
<input type="checkbox"/>	h. Inspect welding of reinforcing steel.	Continuous	SI	Table 1705A.2.1 Item 5b, 1705A.3.1, Table 1705A.3 Item 2, 1903A.8; AWS D1.4; DSA IR 17-3.

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (Steel and Aluminum)

1705A.2.1, Table 1705A.2.1; AISC 303-16, AISC 341-16, AISC 358-16, AISC 360-16; AISI S100-16

Application Number: 01-118970

School Name Vinci Park Elementary School School District: Berryessa Union School

District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/15/2020

20. NONDESTRUCTIVE TESTING: 1705A.2.1, Table 1705A.2.1; AISC 303-16, AISC 341-16, AISC 358-16, AISC 360-16; AISI S100-16				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>	a. Ultrasonic	Test	LOR	1705A.2.1, 1705A.2.5; AISC 341-16 J6.2, AISC 360-16 N5.5; ANSI/ASNT CP-189, SNT-TC-1A; AWS D1.1, AWS D1.8; DSA IR 17-2.
<input type="checkbox"/>	b. Magnetic Particle	Test	LOR	1705A.2.1, 1705A.2.5; AISC 341-16 J6.2, AISC 360-16 N5.5; ANSI/ASNT CP-189, SNT-TC-1A; AWS D1.1, AWS D1.8; DSA IR 17-2.
<input type="checkbox"/>				

21. STEEL JOISTS AND TRUSSES: 1705A.2.1, Table 1705A.2.1; AISC 303-16, AISC 341-16, AISC 358-16, AISC 360-16; AISI S100-16				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>	a. Verify size, type and grade for all chord and web members as well as connectors and weld filler material; verify joist profile, dimensions and camber (if applicable); verify all weld locations, lengths and profiles; mark or tag each joist.	Continuous	SI	1705A.2.3, Table 1705A.2.3; AWS D1.1; DSA IR 22-3 for steel joists only. 1705A.2.4; AWS D1.3 for cold-formed steel trusses.

22. SPRAY APPLIED FIRE-PROOFING: 1705A.2.1, Table 1705A.2.1; AISC 303-16, AISC 341-16, AISC 358-16, AISC 360-16; AISI S100-16				
	Test or Special Inspection	Type	Performed By	Code References and Notes

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (Steel and Aluminum)

1705A.2.1, Table 1705A.2.1; AISC 303-16, AISC 341-16, AISC 358-16, AISC 360-16; AISI S100-16

Application Number: 01-118970

School Name: Vinci Park Elementary School **School District:** Berryessa Union School

District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/15/2020

<input type="checkbox"/>	a. Examine structural steel surface conditions, inspect application, take samples, measure thickness and verify compliance of all aspects of application with DSA-approved documents.	Periodic	SI	1705A.14.
<input type="checkbox"/>	b. Test bond strength.	Test	LOR	1705A.14.6.
<input type="checkbox"/>	c. Test density.	Test	LOR	1705A.14.5.

23. ANCHOR BOLTS AND ANCHOR RODS:				
<input type="checkbox"/>	a. Anchor Bolts and Anchor Rods	Test	LOR	Sample and test anchor bolts and anchor rods not readily identifiable per procedures noted in DSA IR 17-11.
<input type="checkbox"/>	b. Threaded rod not used for foundation anchorage.	Test	LOR	Sample and test threaded rods not readily identifiable per procedures noted in DSA IR 17-11.

23.1 OTHER STEEL:				
	Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/>				

Appendix: Work Exempt from DSA Requirements for Structural Tests / Special Inspections

Application Number: 01-118970

School Name: Vinci Park Elementary School School District: Berryessa Union School

District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/15/2020

Exempt items given in DSA IR A-22 or the 2019 CBC (including DSA amendments) and those items identified below with an "X" by the design professional are NOT subject to DSA requirements for the structural tests / special inspections noted. **Items marked as exempt shall be identified on the approved construction documents.** The project inspector shall verify all construction complies with the approved construction documents.

	SOILS:
<input type="checkbox"/>	1. Deep foundations acting as a cantilever footing designed based on minimum allowable pressures per CBC Table 1806A.2 and having no geotechnical report for the following cases: A) free standing sign or scoreboard, B) cell or antenna towers and poles less than 35'-0" tall (e.g., lighting poles, flag poles, poles supporting open mesh fences, etc.), C) single-story structure with dead load less than 5 psf (e.g., open fabric shade structure), or D) covered walkway structure with an apex height less than 10'-0" above adjacent grade.
<input type="checkbox"/>	2. Shallow foundations, etc. are exempt from special inspections and testing by a Geotechnical Engineer for the following cases: A) buildings without a geotechnical report and meeting the exception Item #1 criteria in CBC Section 1803A.2 supported by native soil (any excavation depth) or fill soil (not exceeding 12" depth per CBC, Section 1804A.6), B) soil scarification/recompaction not exceeding 12" depth, C) native or fill soil supporting exterior non-structural flatwork (e.g., sidewalks, site concrete ramps, site stairs, parking lots, driveways, etc.), D) unpaved landscaping and playground areas, or E) utility trench backfill.

	CONCRETE/MASONRY:
<input type="checkbox"/>	1. Post-installed anchors for the following: A) exempt non-structural components (e.g., mechanical, electrical, plumbing equipment - see Item 7 for "Welding") given in CBC Section 1617A.1.18 (which replaces ASCE 7-16, Section 13.1.4) or B) interior nonstructural wall partitions meeting criteria listed in exempt Item 3 for "Welding."
<input type="checkbox"/>	2. Concrete batch plant inspection is not required for items given in CBC Section 1705A.3.3.2 subject to the requirements and limitations in that section.
<input type="checkbox"/>	3. Non-bearing non-shear masonry walls may be exempt from certain DSA masonry testing and special inspection items as allowed per DSA IR 21-1. Refer to construction documents for specific exemptions accordingly for each applicable wall condition.
<input type="checkbox"/>	4. Epoxy shear dowels in site flatwork and/or other non-structural concrete.
<input type="checkbox"/>	5. Testing of reinforcing bars is not required for items given in CBC Section 1910A.2 subject to the requirements and limitations in that section.

Appendix: Work Exempt from DSA Requirements for Structural Tests / Special Inspections

Application Number: 01-118970

School Name Vinci Park Elementary School **School District:** Berryessa Union School

District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted: 04/15/2020

	Welding:
<input type="checkbox"/>	1. Solid-clad and open-mesh gates with maximum leaf span or rolling section for rolling gates of 10' and apex height less than 8'-0" above lowest adjacent grade. When located above circulation or occupied space below, these gates are not located within 1.5x gate/fence height (max 8'-0") to the edge of floor or roof.
<input type="checkbox"/>	2. Handrails, guardrails and modular or relocatable ramps associated with walking surfaces less than 30" above adjacent grade (excluding post base connections per the 'Exception' language in Section 1705A.2.1); fillet welds shall not be ground flush.
<input type="checkbox"/>	3. Non-structural interior cold-formed steel framing spanning less than 15'-0", such as in interior partitions, interior soffits, etc. supporting only self weight and light-weight finishes or adhered tile, masonry, stone, or terra cotta veneer no more than 5/8" thickness and apex less than 20'-0" in height and not over an exit way. Maximum tributary load to a member shall not exceed the equivalent of that occurring from a 10'x10' opening in a 15' tall wall for a header or king stud.
<input type="checkbox"/>	4. Manufactured support frames and curbs using hot rolled or cold-formed steel (i.e., light gauge) for mechanical, electrical, or plumbing equipment weighing less than 2000# (equipment only) (connections of such frames to superstructure elements using welding will require special inspection as noted in selected item(s) for Sections 19, 19.1 and/or 19.2 of listing above).
<input type="checkbox"/>	5. Manufactured components (e.g., Tolco, B-Line, Afcon, etc.) for mechanical, electrical, or plumbing hanger support and bracing (connections of such components to superstructure elements using welding will require special inspection as noted in selected item(s) for Sections 19, 19.1 and/or 19.2 of listing above).
<input type="checkbox"/>	6. TV Brackets, projector mounts with a valid listing (see DSA IR A-5) and recreational equipment (e.g., playground structures, basketball backstops, etc.) (connections of such elements to superstructure elements using welding will require special inspection as noted in selected item(s) for section 19, 19.1 and/or 19.2 located in the Steel/Aluminum category).
<input type="checkbox"/>	7. Any support for exempt non-structural components given in CBC Section 1617A.1.18 (which replaces ASCE 7-16, Section 13.1.4) meeting the following: A) when supported on a floor/roof, <400# and resulting composite center of mass (including component's center of mass) ≤4' above supporting floor/roof, B) when hung from a wall or roof/floor, <20# for discrete units or <5 plf for distributed systems.

DSA 103: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (SIGNATURE)

Application Number: 01-118970

School Name: Vinci Park Elementary School **School District:** Berryessa Union School

District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted 04/15/2020

Name of Architect or Engineer in general responsible charge: Mark C. Finney	
Name of Structural Engineer (When structural design has been delegated):	
Signature of Architect or Structural Engineer:	Date: 03/03/2020



Note: Do not use secured electronic or digital signatures preventing DSA mark-ups.

DSA STAMP
IDENTIFICATION STAMP DIV. OF THE STATE ARCHITECT
APP: 01-118970 INC:
REVIEWED FOR
SS <input checked="" type="checkbox"/> FLS <input type="checkbox"/> ACS <input type="checkbox"/>
DATE: 08/11/2020

DSA 103: LIST OF REQUIRED VERIFIED REPORTS

Application Number: 01-118970

School Name: Vinci Park Elementary School **School District:** Berryessa Union School District

DSA File Number: 43-7

Increment Number: N/A

Date Submitted 04/15/2020

1. Structural Testing and Inspection: Laboratory Verified Report Form DSA 291

2. Concrete Batch Plant Inspection: Laboratory Verified Report Form DSA 291

3. Shop Welding Inspection: Laboratory Verified Report Form DSA 291, or, for independently contracting SI, Special Inspection Verified Report Form DSA 292

4. High-Strength Bolt Installation Inspection: Laboratory Verified Report Form DSA 291, or, for independently contracting SI, Special Inspection Verified Report Form DSA 292



**GEOTECHNICAL SITE CHARACTERIZATION
SOLAR ARRAY PROJECTS – TEN SCHOOL SITES
BERRYESSA UNION SCHOOL DISTRICT
SAN JOSE, CALIFORNIA**

BSK PROJECT NO. G15-239-11L

PREPARED FOR:

OPTERRA ENERGY SERVICES
505 12TH STREET, SUITE 300
OAKLAND, CALIFORNIA 94607

APRIL 18, 2016



324 Earhart Way
Livermore CA 94551
P 925.315.3151
F 925.315.3152
www.bskassociates.com

April 18, 2016

OpTerra Energy Services
505 12TH Street, Suite 300
Oakland, California 94607

ATTENTION: Mr. Patrick Yost

**SUBJECT: Geotechnical Site Characterization
Ten Campus Solar Sites for Berryessa Union School District
San Jose, California**

Dear Mr. Yost:

We are pleased to submit our geotechnical site characterization report for the proposed photovoltaic panel projects at ten campuses within the Berryessa Union School district in San Jose, California. The enclosed report provides a description of the investigation performed and presents geotechnical site characterization in accordance with the site classifications and design recommendations established for the DSA Pre-Check Design by Beacon Technologies on their plans entitled *DSA Pre-Check Approval, Photovoltaic System, California School Districts, Sheet SO.1, Structural Notes*, dated June 25, 2015. . A Geologic and Seismic Hazards report was not prepared for these sites and is not required according to Section 3.2.3 of DSA Interpretation of Regulations (IR A-4.13) which cites this exemption for structures which are seismically separated into areas less than 4,000 ft² and the sites do not lie with a Seismic Hazard Zone.

The accompanying report is specifically intended to provide foundation design parameters for the proposed solar panels and should not be used to design other structures. The main geotechnical concern for these projects is the presence of moderately to highly expansive surface soils and the potential for strong ground shaking, which is typical of the entire Bay Area. Given the presence of sands and gravels at some of these sites, the contractor installing the drilled piers should be prepared to handle unstable borehole conditions, as discussed in Section 5.6, Construction Considerations.

Conclusions and recommendations presented in the enclosed report are based on limited subsurface investigation and laboratory testing programs. Consequently, variations between anticipated and actual subsurface soil conditions may be found in localized areas during construction. If significant variation in the subsurface conditions is encountered during construction, BSK should review the recommendations presented herein and provide supplemental recommendations, if necessary.

Additionally, design plans should be reviewed by our office prior to their issuance for conformance with the general intent of our recommendations presented in the enclosed report.

We appreciate the opportunity of providing our services to you on this project and trust this report meets your needs at this time. If you have any questions concerning the information presented, please contact us at (925) 315-3151.

Sincerely,

BSK Associates, Inc.



Carrie Foulk, PE, GE #3016
Senior Geotechnical Engineer



Bradley E. Steen, PE, GE #2839
Principal Geotechnical Engineer



Table of Contents

1.	INTRODUCTION	1
1.1	Project Description.....	1
1.2	Approach and Scope of Services	2
2.	GEOLOGIC AND SEISMIC SETTING	3
2.1	Topography and Geology	3
2.2	Faulting and Seismicity.....	3
3.	SITE INVESTIGATION	5
3.1	Field Exploration	5
3.2	Laboratory Testing	6
4.	GENERAL SUBSURFACE CONDITIONS	8
5.	DISCUSSION AND CONCLUSIONS.....	9
5.1	General.....	9
5.2	Site Classification for Drilled Pier Foundations	9
5.3	Driven H-Piles	10
5.3.1	<i>Vertical Support</i>	<i>10</i>
5.3.2	<i>Lateral Resistance.....</i>	<i>10</i>
5.4	Mat Slab Foundations	11
5.4.1	<i>Mat Slab Lateral Resistance.....</i>	<i>12</i>
5.4	2013 Seismic Design Criteria	12
5.5	Geologic Hazards.....	12
5.5.1	<i>Expansive Soils</i>	<i>13</i>
5.5.2	<i>Liquefaction Potential.....</i>	<i>13</i>
5.5.3	<i>Dynamic Compaction/Seismic Settlement</i>	<i>14</i>
5.6	Variations in Subsurface Conditions	14
5.7	Construction Considerations.....	14
5.8	Utility Trench Backfill	15
5.9	Corrosion Potential	16
6.	ADDITIONAL SERVICES AND LIMITATIONS.....	17

Plates and Appendices

PLATES

Plate 1 – Vicinity Map

Plate 2 – Seismic Hazard Zonation Map

EXHIBITS

Exhibit 1 – Unified Soil Classification System (ASTM D2487)

Exhibit 2 – Soil Description Key

Exhibit 3 – Log Key

APPENDICES

Appendix A – Cherrywood Elementary School (Site Plan, Site and Subsurface Conditions, 2013 Seismic Design Criteria, Boring Logs, Laboratory Data, Corrosion Potential)

Appendix B – Laneview Elementary School (Site Plan, Site and Subsurface Conditions, 2013 Seismic Design Criteria, Boring Logs, Laboratory Data, Corrosion Potential)

Appendix C – Majestic Way Elementary School (Site Plan, Site and Subsurface Conditions, 2013 Seismic Design Criteria, Boring Logs, Laboratory Data, Corrosion Potential)

Appendix D – Morrill Middle School (Site Plan, Site and Subsurface Conditions, Boring Logs, 2013 Seismic Design Criteria, Laboratory Data, Corrosion Potential)

Appendix E – Noble Elementary School (Site Plan, Site and Subsurface Conditions, 2013 Seismic Design Criteria, Boring Logs, Laboratory Data, Corrosion Potential)

Appendix F – Piedmont Middle School (Site Plan, Site and Subsurface Conditions, 2013 Seismic Design Criteria, Boring Logs, Laboratory Data, Corrosion Potential)

Appendix G – Ruskin Elementary School (Site Plan, Site and Subsurface Conditions, 2013 Seismic Design Criteria, Boring Logs, Laboratory Data, Corrosion Potential)

Appendix H – Sierramont Middle School (Site Plan, Site and Subsurface Conditions, 2013 Seismic Design Criteria, Boring Logs, Laboratory Data, Corrosion Potential)

Appendix I – Summerdale Elementary School (Site Plan, Site and Subsurface Conditions, 2013 Seismic Design Criteria, Boring Logs, Laboratory Data, Corrosion Potential)

Appendix J – Toyon Elementary School (Site Plan, Site and Subsurface Conditions, Boring Logs, 2013 Seismic Design Criteria, Laboratory Data, Corrosion Potential)

Appendix K - Summary of Compaction Requirements

1. INTRODUCTION

This report presents the results of our geotechnical site characterization for the installation of photovoltaic (PV) panels at ten school sites within the Berryessa Union School District in San Jose, California. This report provides a description of the geotechnical investigation performed and presents geotechnical site characterization in accordance with the site classifications and design recommendations established for the DSA Pre-Check Design by Beacon Technologies (Beacon) on their plans entitled *DSA Pre-Check Approval, Photovoltaic System, California School Districts, Sheet SO.1, Structural Notes*, dated June 25, 2015. This report is specifically intended to provide foundation design parameters for the proposed PV panels and should not be used to design other structures.

A Vicinity Map showing the locations of the sites is presented on Plate 1. Throughout this study, we have corresponded regularly with Mr. Patrick Yost of OpTerra Energy Services (OES).

1.1 Project Description

The proposed project consists of constructing PV panels at each site within existing parking lots, landscaped areas or other unimproved areas. The panels will be installed on elevated canopies supported on drilled piers at all sites except Sierramont Middle School which will have ground mount arrays supported on driven H-piles. The PV panel frames will vary in dimensions at each site. No significant site grading is planned. Other site work will include underground electrical line installation and construction of transformer pads.

The elevated canopy PV panels are relatively light, but wind and seismic loads will create lateral forces that will likely control the foundation dimensions. The dead plus live vertical load for each elevated canopy column is less than 25 kips. Moments at the base of the columns caused by wind or seismic are expected to be on the order of less than 60 kip-feet. Cast-in-drilled-hole (CIDH) piers will be used to support the columns of the elevated canopies. These piers are typically less than 15 feet deep as dictated by the soil conditions and seismic setting. Anticipated pier diameters are 30 inches. The ground mount loadings are less than 3 kips vertical and less than 2½ kip-feet in moment and will be supported on W6X9 H-piles which are typically less than 10 feet deep. The approximate configuration of the proposed solar panels at each site is included on the Site Plans for each location, within Appendices A through J.

If the actual project differs significantly from that described above, we should be contacted to review and/or revise our conclusions and recommendations presented in this report.

1.2 Approach and Scope of Services

The purpose of our study was to review available geotechnical information for the sites and conduct subsurface investigations at each site in order to characterize them in accordance with the criteria established in the above referenced Beacon Pre-Check Design. Our scope of services included the following:

- A site reconnaissance to mark exploration locations, observe the existing site conditions, and meet with onsite staff (if applicable);
- Coordination with Underground Service Alert and OpTerra Energy Services;
- A subsurface investigation including drilling, logging, sampling and backfilling of 25 exploratory borings;
- Laboratory testing to substantiate field classifications and to provide engineering parameters for geotechnical design;
- Geotechnical analyses utilizing the field and laboratory testing data in order to select geotechnical design parameters; and
- Preparation of this report.

This investigation specifically excludes the assessment of site environmental characteristics, particularly those involving hazardous substances.

2. GEOLOGIC AND SEISMIC SETTING

2.1 Topography and Geology

All ten sites lie within the Santa Clara Valley within the City of San Jose. The locations have the following approximate surface elevations, above Mean Sea Level (MSL), according to the Google Earth Pro (2015):

SITE	APPROXIMATE ELEVATION
Cherrywood Elementary School	134 ft.
Laneview Elementary School	116 ft.
Majestic Way Elementary School	159 ft.
Morrill Middle School	120 ft.
Noble Elementary School	224 ft.
Piedmont Middle School	204 ft.
Ruskin Elementary School	152 ft.
Sierramont Middle School	154 ft.
Summerdale Elementary School	180 ft.
Toyon Elementary School	222 ft.

All ten sites are located within the USGS Calaveras Reservoir 7½ Minute Quadrangle. Based on geologic mapping performed in the area by Dibblee and Minch (2005)¹, the sites are underlain by “alluvial gravel, sand and clay, includes alluvial fan deposits”.

The potential for geologic hazards associated with the sites was evaluated and is discussed in Section 5.4.

2.2 Faulting and Seismicity

The San Francisco Bay Area is seismically dominated by the active San Andreas Fault system. This fault system movement is distributed across a complex system of generally strike-slip, right-lateral parallel and sub-parallel faults including, among others, the San Andreas, San Gregorio, Hayward and Calaveras faults.

¹ Dibblee, T.W. and Minch, J.A., 2005, Geologic map of the Calaveras Reservoir quadrangle, Alameda & Santa Clara Counties, California: Dibblee Geological Foundation, Dibblee Foundation Map DF-154, scale 1:24,000.

State Geologic hazard maps covering the sites include those by the California Geological Survey (CGS, 2001² and CGS, 1982³). These maps indicate that none of the schools fall within a CGS designated Seismic Hazard Zone for potential liquefaction nor an Earthquake Fault Zone.

Santa Clara County maps for Geologic Hazard Zone for potential liquefaction and Earthquake Fault Rupture Hazards show that none of these sites lie with these zones.

No mapped active fault traces are known to transverse the sites. Principal active faults in the general site vicinities include the Hayward, Monte Vista, and San Andreas faults. The closest major active fault to these sites is the Hayward fault, with distance to the fault shown as follows:

SITE	CLOSEST ACTIVE FAULT
Cherrywood Elementary School	Hayward Fault – approx. 2.3 km, northeast
Laneview Elementary School	Hayward Fault – approx. 1.3 km, northeast
Majestic Way Elementary School	Hayward Fault – approx. 0.7 km, northeast
Morrill Middle School	Hayward Fault – approx. 1.6 km, northeast
Noble Elementary School	Hayward Fault – approx. 0.8 km, northeast
Piedmont Middle School	Hayward Fault – approx. 1.3 km, northeast
Ruskin Elementary School	Hayward Fault – approx. 1.5 km, northeast
Sierramont Middle School	Hayward Fault – approx. 1.9 km, northeast
Summerdale Elementary School	Hayward Fault – approx. 1.8 km, northeast
Toyon Elementary School	Hayward Fault – approx. 1.3 km, northeast

These and other geologic hazards are discussed in Section 5.4.

For these PV panels, seismic design parameters used for the Pre-Check Design were based on a worst case scenario for sites located in Northern California. This design approach has previously been approved by the Division of the State Architect and the California Geological Survey for similar projects. Site specific seismic design parameters are presented in the respective appendix for each site.

² California Division of Mines and Geology staff, 2001, Seismic Hazard Zone Report, Calaveras Reservoir 7.5-minute quadrangle, Santa Clara County, California: California Division of Mines and Geology, Seismic Hazard Zone Report 048

³ California Division of Mines and Geology, 1982, Revised official map of Alquist-Priolo Earthquake Fault Hazard Zones, Calaveras Reservoir Quadrangle: California Division of Mines and Geology,

3. SITE INVESTIGATION

Prior to our subsurface investigation, a site reconnaissance was performed to observe the existing site conditions in the area of the planned PV panels and mark the locations of the exploratory borings. A general description of site conditions is provided for each site in Appendices A through J.

3.1 Field Exploration

Our subsurface investigation consisted of drilling the following number of soil borings to characterize the shallow subsurface conditions (upper 20 feet).

APPENDIX	SITE	EXPLORATION	DATE
A	Cherrywood Elementary School	2 borings	Feb 18 th
B	Laneview Elementary School	2 borings	Feb 19 th
C	Majestic Way Elementary School	3 borings	Feb 19 th
D	Morrill Middle School	2 borings	Feb 17 th
E	Nobel Elementary School	2 borings	Feb 20 th
F	Piedmont Middle School	3 borings	Feb 20 th
G	Ruskin Elementary School	2 borings	Feb 19 th and 20 th
H	Sierramont Middle School	3 borings	Feb 16 th
I	Summerdale Elementary School	3 borings	Feb 16 th
J	Toyon Elementary School	3 borings	Feb 17 th

The borings were performed at the approximate locations shown on the Site Plans, Plates A through J, in each site's respective appendix. A BSK field engineer selected the locations, depths, sampling intervals, and observed the drilling operations. The selected locations were based on plans of proposed photovoltaic panel locations provided by OES.

The locations of the borings were estimated by our field engineer based on rough measurements from existing features at the site. The elevation shown on the boring logs was estimated using the elevation information available on Google Earth Pro. As such the elevation and location of the borings should be considered approximate to the degree implied by the methods used.

Exploration GeoServices of San Jose, California drilled the borings using a truck-mounted drill-rig equipped with hollow-stem augers. Soil classifications made in the field from auger cuttings and samples were re-evaluated in the laboratory after further examination and testing. The

soils were classified in the field in general accordance with the Unified Soil Classification System (Visual/Manual Procedure - ASTM D2488). Where laboratory tests were performed, the designations reflect the laboratory test results in general accordance with ASTM D2487 as presented on Exhibit 1. The Soil Description Key and Log Key are presented in Exhibits 2 and 3. Sample classifications, blow counts recorded during sampling, and other related information were recorded on the soil boring logs. A discussion of the subsurface conditions encountered at the sites is presented in the “Subsurface Conditions” of each site’s respective appendix.

Relatively undisturbed samples of the subsurface materials were obtained using a split spoon sampler with a 2.5-inch inside diameter (I.D.) and a 3-inch outside diameter (O.D.) fitted with stainless steel liners. The samplers were driven 18 inches using a 140-pound, semi-automatic trip hammer falling 30 inches, and blow counts for successive 6-inch penetration intervals were recorded and reported on the final boring log. After the sampler was withdrawn from the borehole, the samples were removed, sealed to reduce moisture loss, labeled, and returned to our laboratory. Prior to sealing the samples, strength characteristics of the cohesive soil samples recovered were evaluated using a hand-held pocket penetrometer. The results of these tests are shown adjacent to the samples on the boring log.

Prior to subsurface exploration, Underground Service Alert (USA) was contacted to provide utility clearance. In addition, our proposed boring locations were cleared by a subcontractor to OES prior to the start of our field operations. Upon completion of the field investigation, the borings were backfilled with grout and capped with asphalt patch, where appropriate. Excess cuttings generated during drilling were disposed and spread at the sites in landscaping areas or unimproved areas.

3.2 Laboratory Testing

The laboratory testing program was formulated with the emphasis on evaluating the density, moisture content, strength, and plasticity properties of the soils encountered. Classification tests included dry unit weight, natural water content, and Atterberg Limits. These tests aid in classifying the soils from selected samples and are used to correlate the results of other field and laboratory tests conducted on samples from different borings or different depths. Where possible, testing of engineering properties included triaxial compression tests to evaluate strength parameters.

Most of the laboratory test results are presented on the boring logs. The results of the Atterberg Limits and triaxial compression tests for each site are presented graphically in their respective appendices.

Chemical analyses were performed on one sample of the near-surface soils at each site to assist in evaluating the corrosive potential of the soil. The corrosivity testing and evaluation was performed by CERCO Analytical, a State-certified laboratory in Concord, California for redox potential, pH, resistivity, chloride content, and sulfate content in accordance with ASTM test methods. The results of the corrosion testing are discussed in Section 5.8 and presented for each of the ten sites in their respective appendices.

4. GENERAL SUBSURFACE CONDITIONS

Specific subsurface conditions for each site, including a general description of the subsurface conditions encountered in our borings and groundwater depths are located within Appendices A through J. A more detailed description of the soil and groundwater conditions encountered is presented on the Boring Logs in each appendix.

5. DISCUSSION AND CONCLUSIONS

5.1 General

Based on the results of our field investigation, it is our opinion that the proposed elevated canopy arrays may be supported on drilled piers per the Beacon Pre-Check Design, and ground mount arrays at Sierramont Middle School may be supported on driven H-piles, as currently planned. The main geotechnical concern for the projects is the presence of expansive surface soils and the presence of granular deposits below the design groundwater level which could experience minor potential liquefaction settlement during a significant seismic event. Additionally, excavations within the more granular soils at the sites may not stand near-vertical (e.g. drilled piers and utility trenches).

5.2 Site Classification for Drilled Pier Foundations

As part of the Beacon Pre-Check Design, a list of assumed soil/rock physical parameters for eight design cases is shown on a table⁴ below. These eight cases were chosen to represent various subsurface types in California.

CASE	MATERIAL DESCRIPTION	CONCRETE ALLOWABLE SKIN FRICTION (PSF)	CONCRETE ALLOWABLE SKIN FRICTION (PSF)	ALLOWABLE BEARING CAPACITY (PSF)	ALLOWABLE LATERAL PASSIVE PRESSURE (PSF/FT)	EMBEDMENT DEPTH	MIN. COHESION (PSF)	PHI (DEG)
		DOWN	UPLIFT					
1	SOFT CLAY	225	113	700	135	11'-0"	530	0
2	FIRM / MEDIUM CLAY	340	170	1500	335	8'-3"	750	0
3	STIFF CLAY	475	238	2700	470	7'-3"	1000	0
4	VERY STIFF CLAY	575	288	4000	700	6'-4"	2000	0
5	HARD CLAY/ CLAYSTONE	800	400	5000	700	6'-4"	4000	0
6	MEDIUM DENSE SILTY SAND	100	50	2000	330	10'-0"	0	32
7	MEDIUM DENSE CLEAN SAND	115	58	5000	570	9'-0"	0	36
8	SANDSTONE SILTSTONE BEDROCK	1000	500	6000	1100	8'-0"	2000	31

We evaluated the site-specific properties of each site based on our soil borings and laboratory test results. Vertical capacities were evaluated using the computer program SHAFT 2012 and the lateral capacities were evaluated using LPile 2015, both by Ensoft, Inc. Based on the results

⁴ DSA Pre-Check Design by Beacon Technologies on their plans entitled *DSA Pre-Check Approval, Photovoltaic System, California School Districts, Sheet SO.1, Soil Notes*, dated May 27, 2014. See plans for complete details of Site Design Cases.

of our analyses and the Beacon Pre-Check Design Criteria, we recommend embedment depths for the drilled piers as shown in the table below. Where embedment depth is governed by lateral load resistance, the limiting magnitudes for deflection are 0.5 inch at top of pier and 0.1 inch at toe of pier, as prescribed by the Structural Engineer.

SITE NAME	LOAD CASE	DESIGN CASE	RECOMMENDED MINIMUM EMBEDMENT DEPTH (Paved Area)	RECOMMENDED MINIMUM EMBEDMENT DEPTH (Unpaved Area)*
Cherrywood ES	Full-T	2	8.25 ft	10.25 ft
Laneview ES	Full-T	2	8.25 ft	11.25 ft
Majestic ES	Full-T	2	9.0 ft	11.0 ft
Morrill MS	Full-T	3	7.25 ft	10.25 ft
Noble ES	Full-T	3	7.25 ft	10.25 ft
Piedmont MS	Full-T	2	8.25 ft	10.25 ft
	Half-T	2	9.0 ft	11.0 ft
Ruskin ES	Full-T	6	10.0 ft	12.0 ft
Summerdale ES	Full-T	2	8.25 ft	10.25 ft**
Toyon ES	Full-T	2	8.25 ft	10.25 ft

*These depths reflect the recommended neglect for unpaved surfaces for expansive and non-expansive soils as shown on Sheet S0.1, Soil Notes, Beacon Pre-Check Design.

** The face of the supporting drilled piers at the top of slope at the rear of the campus should not be used for calculated lateral load resistance until at least 7 feet of horizontal cover exists between the face of the pier and the slope face.

5.3 Driven H-Piles

5.3.1 Vertical Support

Ground mount arrays are planned for the solar array at Sierramont Middle School. Driven H-piles are recommended for the ground mounted arrays in order to transfer the loads to the native soils, as currently planned. The piles should derive their capacities to resist downward dead and operating loads through skin friction on the side of the piles using an allowable skin friction of 500 pounds per square foot (psf). This frictional value may be applied along a circumscribed rectangle around the outside perimeter of the H-pile and includes a Safety Factor of 2. Uplift loads may be resisted by an allowable skin friction equal to 70 percent of the downward allowable skin friction capacity. The upper two feet of soil should also be ignored for calculation of skin friction against uplift.

5.3.2 Lateral Resistance

Resistance to lateral loads for driven H-piles can be provided by passive resistance acting against the piles using an allowable equivalent fluid pressure of 300 psf per foot, up to a

maximum of 2,000 psf acting against the piles. The passive resistance may be applied to a width of twice the diameter of the piles. H-piles should be spaced at least 6 diameters apart (center to center) or lateral resistance capacity reductions may be necessary. The upper foot of soil cover should be ignored for calculation of lateral resistance unless the ground surface is to be confined by exterior concrete flatwork or a pavement. The face of the supporting driven H-piles should not be used for calculated lateral load resistance until at least 7 feet of horizontal cover exists between the face of the pile and the slope face at the southwestern corner of the Sierramont project area.

5.4 Mat Slab Foundations

Ancillary equipment may be supported by a reinforced concrete mat slab foundation system placed on 12 inches of compacted Class 2 aggregate baserock. The purpose of the baserock is to help mitigate minor seasonal movement of the moderately expansive site soils at some sites and to enhance slab support. It is anticipated that the slab foundation will impose a modest bearing pressure (less than 300 psf). If isolated areas of imposed stress concentrations occur, the slab may be designed for an allowable bearing pressure of 2,000 pounds per square foot (psf) within these isolated areas. This value includes a factor of safety of at least two. Allowable soil bearing pressures may be increased by one-third for transient loads, such as wind and seismic loads.

A modulus of subgrade reaction, K_{V1} , of 125 pounds per square inch per inch of deflection (based on a one square foot bearing plate) is considered applicable to the sites provided the mat slabs are supported as discussed above. This modulus is typically reduced for mat slab sizes larger than 1 square foot. For various slab sizes, the subgrade modulus may be calculated using the following formulas:

Square:
$$K_S = (K_{V1}) \times \left(\frac{1 \text{ foot}}{B} \right)$$

Rectangular:
$$K_R = (K_{V1}) \times \left(\frac{1 \text{ foot}}{B} \right) \times \left(\frac{m+0.5}{1.5 \times m} \right)$$

Where:

- K_{V1} is the modulus of subgrade reaction for a 1 square foot plate (in units of pci);
- B is the width of the foundation/slab (in units of feet);
- m is the ratio of the foundation/slab length divided by its width; and
- K_S and K_R are the adjusted modulus of subgrade reaction based on the actual dimensions of the foundation/slab (in units of pci).

If a computer program is used to design the project foundations and it requires the input of a modulus of subgrade reaction for the site, the designer should check whether the program requires input of the unadjusted or adjusted modulus of subgrade reaction.

5.3.1 Mat Slab Lateral Resistance

Lateral loads for equipment pads may be resisted by a combination of friction between the foundation bottoms and the supporting subgrade, and by passive resistance acting against the vertical faces of the foundations. An allowable friction coefficient of 0.30 between the foundation and supporting subgrade may be used. For passive resistance, an allowable equivalent fluid pressure of 300 pounds per cubic foot acting against the footing may be used. The friction coefficient and passive resistance may be used concurrently, and the passive resistance can be increased by one-third for wind and/or seismic loading. We recommend that the first foot of soil cover be neglected in the passive resistance calculations if the ground surface above is not confined by a slab, pavement or in some similar manner. These values include a factor of safety of about 1.5.

5.4 2013 Seismic Design Criteria

The seismicity of the region surrounding the site is discussed in the “Faulting and Seismicity” section of this report. From that discussion, it is important to note that the site is in a region of high seismic activity and will likely be subjected to major shaking during the life of the project. As a result, structures to be constructed on these sites should be designed in accordance with applicable seismic provisions of the building codes. Site specific seismic design criteria are presented in the Appendix for each campus.

5.5 Geologic Hazards

As required by the State of California in Title 24 of the California Building Code, a geologic and seismic hazard evaluation is needed for school developments. However, according to Section 3.2.3 of DSA Interpretation of Regulations (IR A-4), these types of canopy carports are exempt from a full geologic and seismic hazard evaluations if they are seismically separated into areas less than 4,000 ft² and do not lie within a Seismic Hazard Zone. We conclude that the planned structures are free of most geologic and seismic hazards except for: 1) low to highly expansive surface soils and 2) strong ground shaking (see Section 2.2). These hazards are discussed below.

5.5.1 Expansive Soils

Where expansive soils with higher plasticity ($PI > 15$) are encountered and if the surface is unpaved, underlying soil will be exposed to moisture fluctuation and therefore soils can shrink and swell seasonally. This could result in some vertical movement of the drilled piers and lateral and vertical pier support could be reduced due to shrinkage. The generic design already includes a recommendation to exclude vertical and lateral support in the upper one foot of unpaved areas. The soils we tested were low to highly expansive. Exclusion zones for expansive soils for the drilled piers have been incorporated into the design case selection. The plasticity index values of the on-site soils for each site are summarized in the table below.

SOIL PLASTICITY	
Site Name	Plasticity Index
Cherrywood Elementary School	14
Laneview Elementary School	24
Majestic Elementary School	17
Morrill Middle School	23
Noble Elementary School	30
Piedmont Middle School	17
Ruskin Elementary School	Non-plastic
Sierramont Middle School	36
tSummerdale Elementary School	14
Toyon Elementary School	18

5.5.2 Liquefaction Potential

The solar panel sites lie within the Milpitas and Calaveras Reservoir quadrangles, which have been mapped by the California Geological Survey for the potential for seismically-induced landslide and liquefaction related hazards. None of the ten campuses lie within an area identified by CGS as potentially susceptible to liquefaction as shown on Plate 2. Therefore, liquefaction was only evaluated to the depth of our exploration.

Liquefaction is a condition where saturated, granular soils undergo a substantial loss of strength and deformation due to pore pressure increase, resulting from cyclic stress application induced by earthquakes. In the process, the soil acquires mobility sufficient to permit both horizontal and vertical movements if the soil is not confined. Soils most susceptible to liquefaction are loose, clean, uniformly graded, silt and fine sand, as well as some lean clay deposits.

In order for liquefaction triggering to occur due to ground shaking, it is generally accepted that four conditions will exist:

- The subsurface soils are in a relatively loose state
- The soils are saturated
- The soils have low plasticity
- Ground shaking is of sufficient intensity to act as a triggering mechanism

In addition, after the soil liquefies, dissipation of the excess pore pressures can produce volume changes within the liquefied soil layer, which can result in ground surface settlement. Based on the measured groundwater depths and the historical depth to groundwater, and the relative density of the layers of more granular soils that underlie the areas of planned improvements, we anticipate that the cyclic stress associated with the design peak horizontal ground accelerations (PGA_M) are insufficient to result in significant liquefaction-induced settlement at these sites.

5.5.3 *Dynamic Compaction/Seismic Settlement*

Another type of seismically-induced ground failure, which can occur as a result of seismic shaking, is dynamic compaction, or seismic settlement. Such phenomena typically occur in unsaturated, loose granular material or uncompacted fill soils. We evaluated dynamic compaction where loose sands existed above the groundwater table at all sites and found the potential for seismic settlement to be negligible.

5.6 Variations in Subsurface Conditions

Our interpretations of soil and groundwater conditions, as described above, are based on data from the borings and laboratory test data that we collected for this study. The conclusions and recommendations provided in this report are based on these interpretations. Therefore, it is likely that undisclosed variations in subsurface conditions exist at these sites.

We recommend that we be retained during construction to confirm our interpretations. Should variations from our interpretations be observed, we will need to evaluate whether any revisions should be made to our recommendations.

5.7 Construction Considerations

We recommend that drilled pier steel reinforcement and concrete be placed within about 4 to 6 hours upon completion of each drilled hole. As a minimum, the holes should be poured the same day they are drilled. The steel reinforcement should be centered in the drilled hole. Concrete used for pier construction should be discharged vertically into the holes to reduce

aggregate segregation. Under no circumstances should concrete be allowed to free-fall against either the steel reinforcement or the sides of the excavation during construction.

No free groundwater was encountered in our borings at any of the sites, to a depth of 20 feet. However, groundwater levels can fluctuate depending on factors such as seasonal rainfall, groundwater withdrawal, and construction activities on this or adjacent properties. Therefore, the foundation contractor should be prepared for groundwater. If water more than 6 inches deep is present during concrete placement, either the water needs to be pumped out or the concrete needs to be placed into the hole using tremie methods. If tremie methods are used, the end of the tremie pipe must remain below the surface of the in-place concrete at all times. Given the presence of sands and gravels at some sites and the variability of silt and clay content (which tend to bind the soils), the contractor installing the drilled piers needs to be prepared to handle unstable borehole conditions. Unit prices for dewatering and/or tremie placement methods and for casing should be obtained during the bidding process.

The bottom of the drilled holes should be clean such that no more than 2 inches of loose soil remains in the hole prior to placement of concrete. A representative from BSK should be present to observe drilled holes to confirm bottom conditions prior to placing steel reinforcement.

Concrete used for pier construction should be discharged vertically into the drilled holes to reduce aggregate segregation. Under no circumstances during pile construction should concrete be allowed to free-fall against either the steel reinforcement or the sides of the excavation.

In order to develop the design skin friction, concrete used for drilled pier construction should have a slump ranging from 6 to 8 inches. The concrete mix should be designed with appropriate admixtures and/or water/cement ratios to achieve these recommended slumps. Adding water to a conventional mix to achieve the recommended slump should not be allowed. For concrete mixes with slumps over 6 inches, vibration of the concrete during placement is generally not recommended as aggregate settlement may result in the lack of aggregate within the upper portion of the pier. Careful vibration of the concrete around anchor bolt assemblies is recommended.

5.8 Utility Trench Backfill

We recommend that utility trench backfill be compacted to a minimum of 90 percent compaction at near optimum moisture content for granular soils and at a minimum of 2 percent over optimum moisture content for clayey soils. Proper granular bedding and shading should be

used beneath and around new utilities. Within pavement areas, the top 12 inches should be compacted to a minimum of 95 percent compaction at over optimum moisture content. Care should be taken to adequately compact utility trench backfill in all structure areas including pavements. Poor compaction will likely cause subsequent settlement of the trench, resulting in possible distress cracking to the overlying flexible pavement. Pavement sections covering utility trenches should match the existing sections. Baserock should be compacted to a minimum of 95 percent relative compaction near optimum moisture content. Utility trench backfill in landscape areas should be compacted to a minimum of 85 percent relative compaction.

5.9 Corrosion Potential

Results of corrosion testing by CERCO Analytical for each site are presented in their respective appendix. Also included is an evaluation of the results of the corrosion tests. Based upon the resistivity measurements, the samples collected at all the sites, at shallow depths below the ground surface, are classified as “moderately corrosive” to “corrosive”. All buried iron, steel, cast iron, ductile iron, galvanized steel, and dielectric coated steel or iron should be properly protected against corrosion depending upon the critical nature of the structure. All buried metallic pressure piping such as ductile iron firewater pipelines should be protected against corrosion. Given the low levels of measured sulfate ion concentration within our limited sampling, we believe that Type I/ Type II concrete should provide adequate resistance to the deleterious effects of sulfate at most sites. Since we are not corrosion specialists, a corrosion testing firm should be contacted for specific design details.

A more detailed investigation may include more or fewer concerns and should be directed by a corrosion expert. Consideration should also be given to soils in contact with concrete that may be imported to the site during construction, such as topsoil and landscaping materials. Also, on-site cutting and filling may result in soils contacting concrete that were not anticipated at the time of the investigation.

As an alternative or in addition to meeting CBC mix requirements, your Structural Engineer, architect or corrosion expert may choose to isolate the concrete from the corrosive soils or from ground or surface water that may leach corrosive materials from the soils and contact the concrete.

6. ADDITIONAL SERVICES AND LIMITATIONS

This work was performed in a manner consistent with that level of care and skill ordinarily exercised by other members of BSK's profession practicing in the same locality, under similar conditions and at the date the services are provided. Our conclusions, opinions and recommendations are based on a limited number of observations and data. It is possible that conditions could vary between or beyond the data evaluated. BSK makes no other representation, guarantee or warranty, express or implied, regarding the services, communication (oral or written), report, opinion, or instrument of service provided. This report may be used only by OES (Client) and the registered design professional in responsible charge and only for the purposes stated for this specific engagement within a reasonable time from its issuance, but in no event later than two (2) years from the date of the report. The work performed was based on project information provided by the Client. If the Client does not retain BSK to review any plans and specifications, including any revisions or modifications to the plans and specifications, BSK assumes no responsibility for the suitability of our recommendations. In addition, if there are any changes in the field to the plans and specifications, the Client must obtain written approval from BSK's engineer that such changes do not affect our recommendations. Failure to do so will vitiate BSK's recommendations.

The scope of services was limited to twenty five borings at the ten sites. It should be recognized that definition and evaluation of subsurface conditions are difficult. Judgments leading to conclusions and recommendations are generally made with incomplete knowledge of the subsurface conditions present due to the limitations of data from field studies. The conclusions of this assessment are based on subsurface exploration including borings drilled to a maximum depth of 20 feet, laboratory testing and engineering analyses.

BSK offers various levels of investigative and engineering services to suit the varying needs of different clients. Although risk can never be eliminated, more detailed and extensive studies yield more information, which may help understand and manage the level of risk. Since detailed study and analysis involves greater expense, our clients participate in determining levels of service, which provide information for their purposes at acceptable levels of risk. The Client and key members of the design team should discuss the issues covered in this report with BSK, so that the issues are understood and applied in a manner consistent with the owner's budget, tolerance of risk and expectations for future performance and maintenance.

Recommendations contained in this report are based on our field observations and subsurface explorations, limited laboratory tests, and our present knowledge of the proposed construction. It is possible that soil or groundwater conditions could vary between or beyond

the points explored. If soil or groundwater conditions are encountered during construction that differ from those described herein, the client is responsible for ensuring that BSK is notified immediately so that we may reevaluate the recommendations of this report. If the scope of the proposed construction, including the estimated structure loads, and the design depths or locations of the foundations, changes from that described in this report, the conclusions and recommendations contained in this report are not considered valid unless the changes are reviewed, and the conclusions of this report are modified or approved in writing, by BSK.

As the geotechnical engineering firm that performed the geotechnical evaluation for this project, BSK should be retained to confirm that the recommendations of this report are properly incorporated in the design of this project, and properly implemented during construction. This may avoid misinterpretation of the information by other parties and will allow us to review and modify our recommendations if variations in the soil conditions are encountered. As a minimum BSK should be retained to provide the following continuing services for the project:


- Review the project plans and specifications, including any revisions or modifications;
- Observe and evaluate the site earthwork operations to confirm subgrade soils are suitable for construction of foundations, slabs-on-grade, and placement of engineered fill;
- Confirm engineered fill for the structure and other improvements is placed and compacted per the project specifications; and
- Observe drilled pier excavations to confirm conditions are as anticipated.

The scope of services for this subsurface exploration and geotechnical report did not include environmental assessments or evaluations regarding the presence or absence of wetlands or hazardous substances in the soil, surface water, or groundwater at this site.

This report, and any future addenda or reports regarding this site, may be made available to bidders to supply them with only the data contained in the report regarding subsurface conditions and laboratory test results at the point and time noted. Bidders may not rely on interpretations, opinion, recommendations, or conclusions contained in the report. Because of the limited nature of any subsurface study, the contractor may encounter conditions during construction which differ from those presented in this report. In such event, the contractor should promptly notify the owner so that BSK's geotechnical engineer can be contacted to confirm those conditions. We recommend the contractor describe the nature and extent of the differing conditions in writing and that the construction contract include provisions for dealing with differing conditions. Contingency funds should be reserved for potential problems during earthwork and foundation construction. Furthermore, the contractor should be prepared to

handle contamination conditions encountered at this site, which may affect the excavation, removal, or disposal of soil; dewatering of excavations; and health and safety of workers.

PLATES

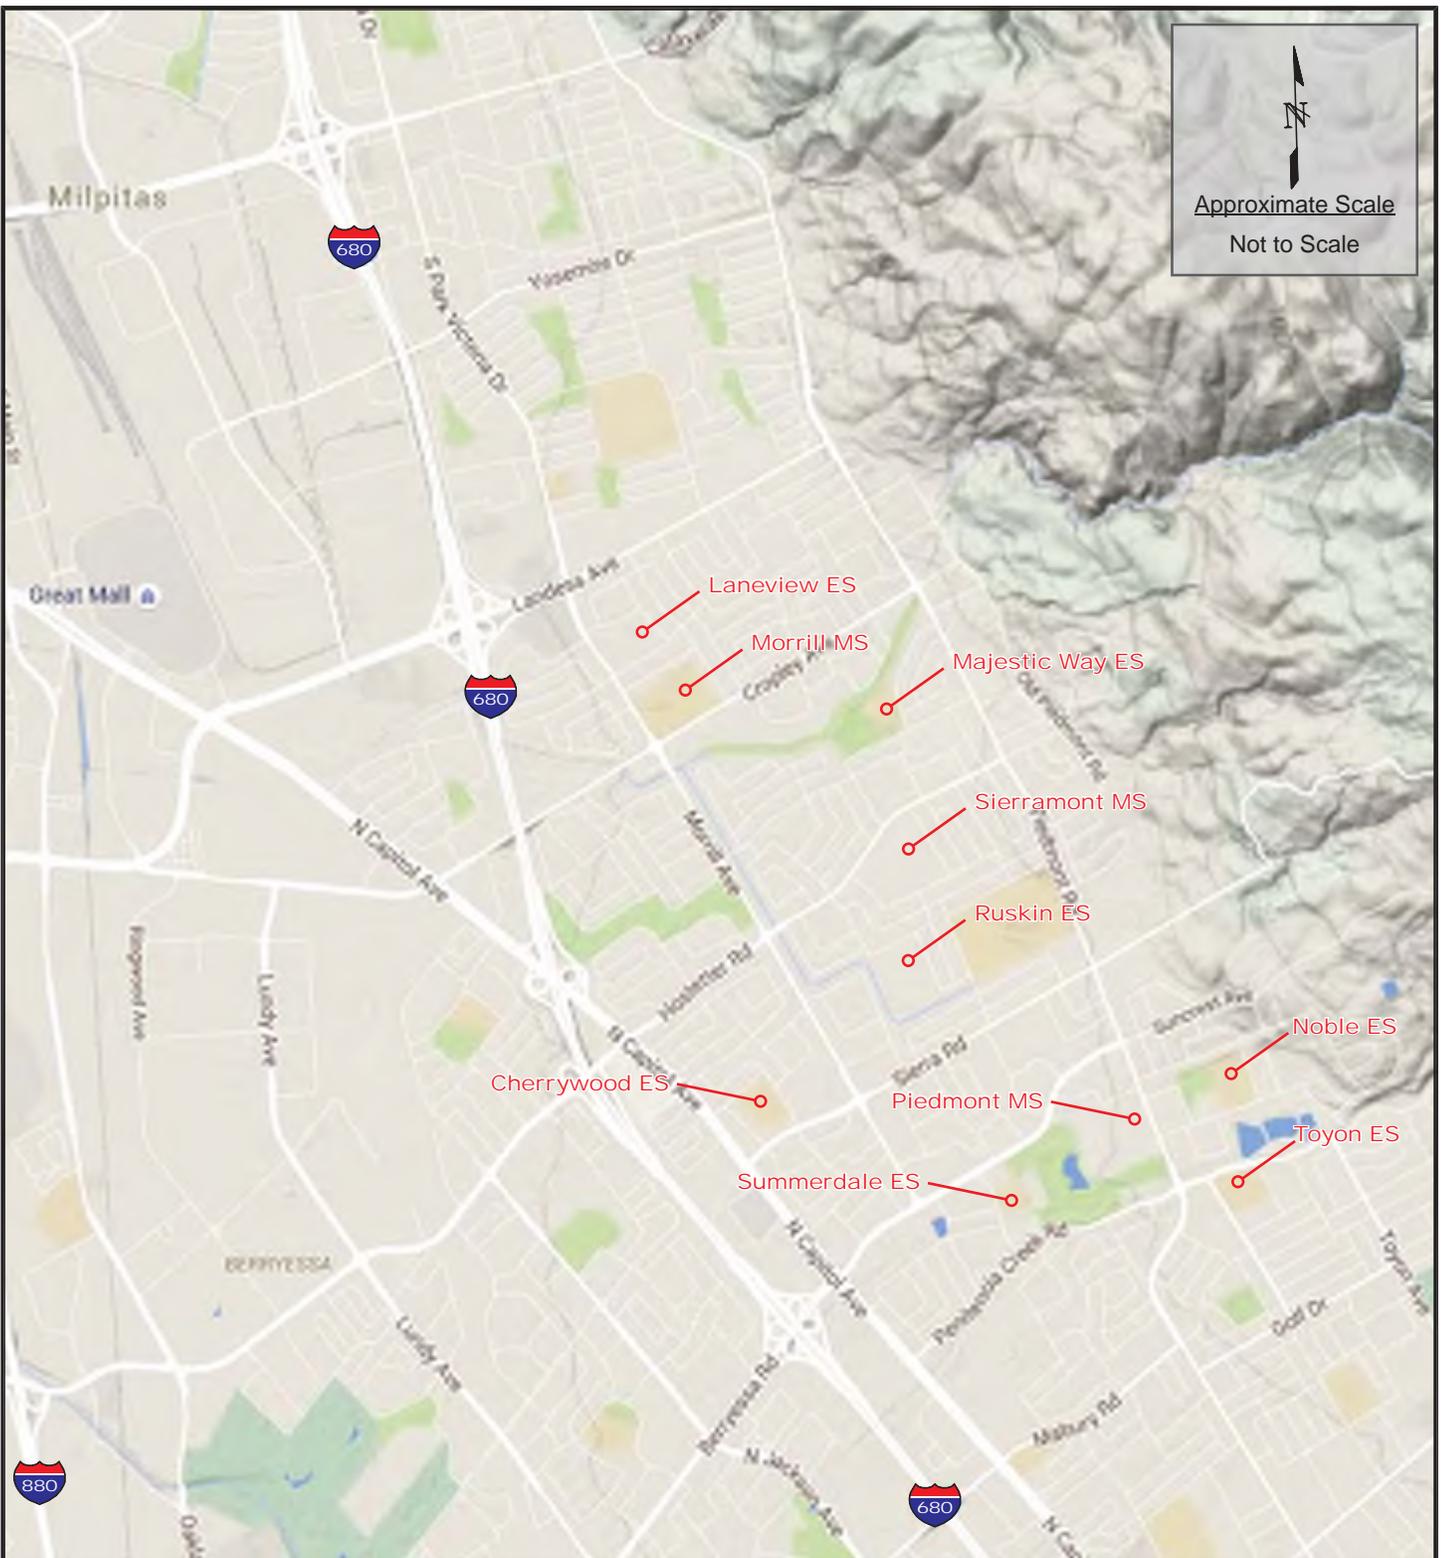


 Approximate Scale
 Not to Scale

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.





PROJECT NO. G15-239-11L
DRAWN: 03/01/16
DRAWN BY: B. Steen
CHECKED BY: C. Foulk
FILE NAME:
 VicMap.indd

VICINITY MAP

**Planned Solar Array Project
 Ten Campuses within
 Berryessa Union School District
 San Jose, California**

PLATE

 1

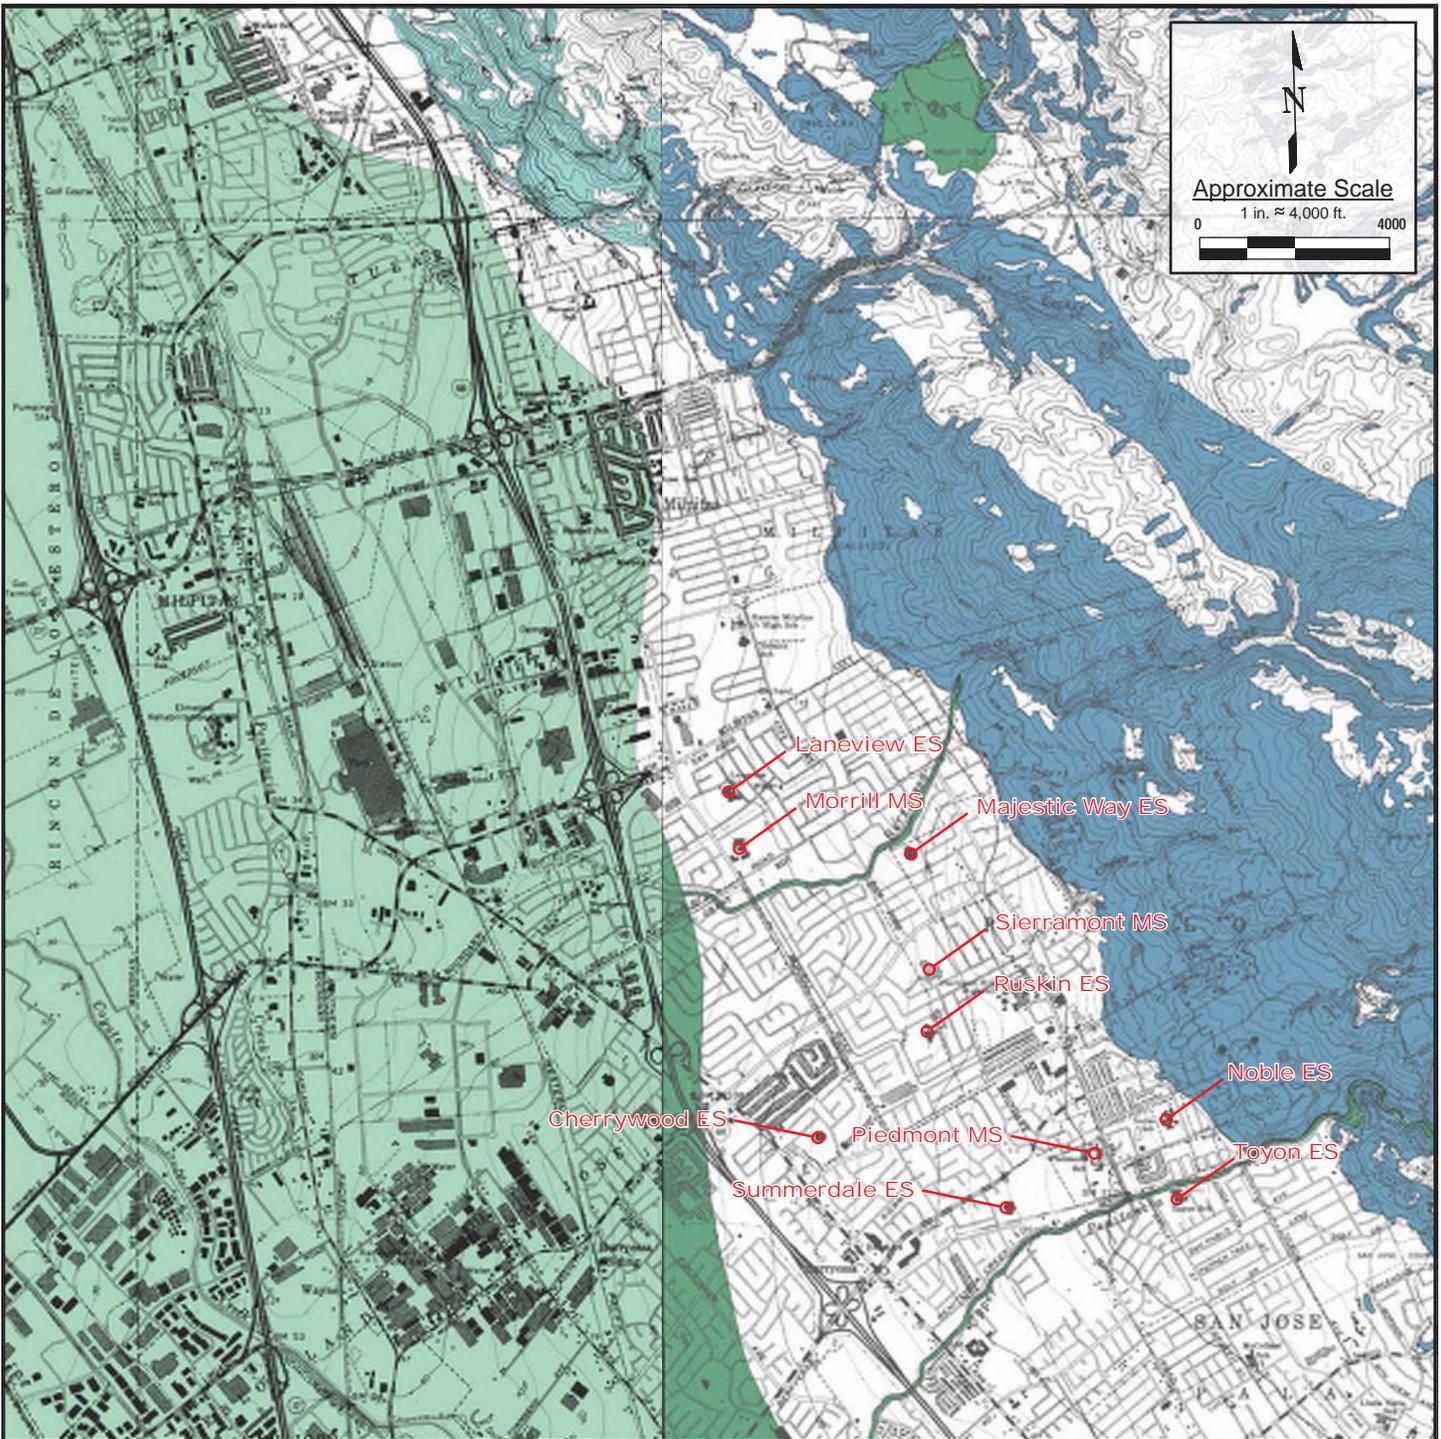

Laneview ES
 Morrill MS
 Majestic Way ES
 Sierramont MS
 Ruskin ES
 Noble ES
 Toyon ES
 Piedmont MS
 Summerdale ES
 Cherrywood ES

EXPLANATION

-  Liquefaction Zone – Areas where liquefaction has occurred or has the potential to occur
-  Earthquake-Induced Landslide Zone – Areas where landslides have occurred or have the potential to occur

Map Source: California Geological Survey, Seismic Hazard Zones, Milpitas Quadrangle (dated 10/19/04) and Calaveras Reservoir Quadrangle (dated 10/17/01).

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.



PROJECT NO. G15-239-11L
 DRAWN: 03/01/16
 DRAWN BY: B. Steen
 CHECKED BY: C. Foulk
 FILE NAME:

SEISMIC HAZARD ZONATION MAP
 Planned Solar Array Project
 Ten Campuses within
 Berryessa Union School District
 San Jose, California

PLATE
 2

EXHIBITS

UNIFIED SOIL CLASSIFICATION SYSTEM (ASTM D 2487/2488)

MAJOR DIVISIONS

GRAPHIC LOG

TYPICAL DESCRIPTIONS

MAJOR DIVISIONS	GRAPHIC LOG	TYPICAL DESCRIPTIONS	
GRAVELS (More than half of coarse fraction is larger than the #4 sieve)	CLEAN GRAVELS WITH <5% FINES Cu >4 and 1 < Cc < 3	 GW WELL-GRADED GRAVELS, GRAVEL-SAND MIXTURES WITH LITTLE OR NO FINES	
		 GP POORLY-GRADED GRAVELS, GRAVEL-SAND MIXTURES WITH LITTLE OR NO FINES	
	GRAVELS WITH 5 to 12% FINES Cu >4 and 1 < Cc < 3	 GW-GM WELL-GRADED GRAVELS, GRAVEL-SAND MIXTURES WITH LITTLE FINES	
		 GW-GC WELL-GRADED GRAVELS, GRAVEL-SAND MIXTURES WITH LITTLE CLAY FINES	
		 GP-GM POORLY-GRADED GRAVELS, GRAVEL-SAND MIXTURES WITH LITTLE FINES	
		 GP-GC POORLY-GRADED GRAVELS, GRAVEL-SAND MIXTURES WITH LITTLE CLAY FINES	
	GRAVELS WITH >12% FINES	 GM SILTY GRAVELS, GRAVEL-SILT-SAND MIXTURES	
		 GC CLAYEY GRAVELS, GRAVEL-SAND-CLAY MIXTURES	
		 GC-GM CLAYEY GRAVELS, GRAVEL-SAND-CLAY-SILT MIXTURES	
	COARSE GRAINED SOILS (More than half of material is larger than the #200 sieve)	CLEAN SANDS WITH <5% FINES Cu >6 and 1 < Cc < 3	 SW WELL-GRADED SANDS, SAND-GRAVEL MIXTURES WITH LITTLE OR NO FINES
			 SP POORLY-GRADED SANDS, SAND-GRAVEL MIXTURES WITH LITTLE OR NO FINES
		SANDS WITH 5 to 12% FINES Cu >6 and 1 < Cc < 3	 SW-SM WELL-GRADED SANDS, SAND-GRAVEL MIXTURES WITH LITTLE FINES
			 SW-SC WELL-GRADED SANDS, SAND-GRAVEL MIXTURES WITH LITTLE CLAY FINES
			 SP-SM POORLY-GRADED SANDS, SAND-GRAVEL MIXTURES WITH LITTLE FINES
 SP-SC POORLY-GRADED SANDS, SAND-GRAVEL MIXTURES WITH LITTLE CLAY FINES			
SANDS WITH >12% FINES		 SM SILTY SANDS, SAND-GRAVEL-SILT MIXTURES	
		 SC CLAYEY SANDS, SAND-GRAVEL-CLAY MIXTURES	
		 SC-SM CLAYEY SANDS, SAND-SILT-CLAY MIXTURES	
FINE GRAINED SOILS (More than half of material is smaller than the #200 sieve)		SILTS AND CLAYS (Liquid limit less than 50)	 ML INORGANIC SILTS AND VERY FINE SANDS, SILTY OR CLAYEY FINE SANDS, SILTS WITH SLIGHT PLASTICITY,
	 CL INORGANIC CLAYS OF LOW TO MEDIUM PLASTICITY, GRAVELLY CLAYS, SANDY CLAYS, SILTY CLAYS, LEAN CLAYS		
	 CL-ML INORGANIC CLAYS-SILTS OF LOW PLASTICITY, GRAVELLY CLAYS, SANDY CLAYS, SILTY CLAYS, LEAN CLAYS		
	SILTS AND CLAYS (Liquid limit greater than 50)	 OL ORGANIC SILTS & ORGANIC SILTY CLAYS OF LOW PLASTICITY	
		 MH INORGANIC SILTS, MICACEOUS OR DIATOMACEOUS FINE SAND OR SILT	
		 CH INORGANIC CLAYS OF HIGH PLASTICITY, FAT CLAYS	
 OH ORGANIC CLAYS & ORGANIC SILTS OF MEDIUM-TO-HIGH PLASTICITY			



PROJECT NO. G15-239-11L
 DRAWN: 03/07/16
 DRAWN BY: D. Tower
 CHECKED BY: B. Steen
 FILE NAME: Legend.indd

UNIFIED SOIL CLASSIFICATION SYSTEM (ASTM D 2487/2488)
 Planned Solar Array Project
 Berryessa Union School District
 San Jose, California

EXHIBIT
 1

SOIL DESCRIPTION KEY

MOISTURE CONTENT

DESCRIPTION	ABBR	FIELD TEST
Dry	D	Absence of moisture, dusty, dry to the touch
Moist	M	Damp but no visible water
Wet	W	Visible free water, usually soil is below water table

CEMENTATION

DESCRIPTION	FIELD TEST
Weakly	Crumbles or breaks with handling or slight finger pressure
Moderately	Crumbles or breaks with considerable finger pressure
Strongly	Will not crumble or break with finger pressure

PLASTICITY


DESCRIPTION	ABBR	FIELD TEST
Non-plastic	NP	A 1/8-in. (3 mm) thread cannot be rolled at any water content.
Low (L)	LP	The thread can barely be rolled and the lump or thread cannot be formed when drier than the plastic limit.
Medium (M)	MP	The thread is easy to roll and not much time is required to reach the plastic limit. The thread cannot be rerolled after reaching the plastic limit. The lump or thread crumbles when drier than the plastic limit
High (H)	HP	It takes considerable time rolling and kneading to reach the plastic limit. The thread can be rerolled several times after reaching the plastic limit. The lump or thread can be formed without crumbling when drier than the plastic limit

GRAIN SIZE

DESCRIPTION	SIEVE SIZE	GRAIN SIZE	APPROXIMATE SIZE
Boulders	>12"	>12"	Larger than basketball-sized
Cobbles	3 - 12"	3 - 12"	Fist-sized to basketball-sized
Gravel	coarse	3/4 - 3"	Thumb-sized to fist-sized
	fine	#4 - 3/4"	Pea-sized to thumb-sized
Sand	coarse	#10 - #4	Rock salt-sized to pea-sized
	medium	#40 - #10	Sugar-sized to rock salt-sized
	fine	#200 - #10	Flour-sized to sugar-sized
Fines	Passing #200	<0.0029	Flour-sized and smaller


REACTION WITH HCl

DESCRIPTION	FIELD TEST
None	No visible reaction
Weak	Some reaction, with bubbles forming slowly
Strong	Violent reaction, with bubbles forming immediately



ANGULARITY

DESCRIPTION	ABBR	CRITERIA
Angular	A	Particles have sharp edges and relatively plane sides with unpolished surfaces
Subangular	SA	Particles are similar to angular description but have rounded edges
Subrounded	SR	Particles have nearly plane sides but have well-rounded corners and edges
Rounded	R	Particles have smoothly curved sides and no edges

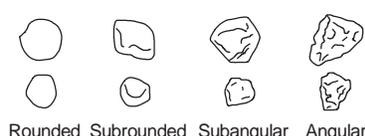

APPARENT / RELATIVE DENSITY - COARSE-GRAINED SOIL

APPARENT DENSITY	ABBR	SPT (# blows/ft)	MODIFIED CA SAMPLER (# blows/ft)	CALIFORNIA SAMPLER (# blows/ft)	RELATIVE DENSITY (%)	FIELD TEST
Very Loose	VL	<4	<4	<5	0 - 15	Easily penetrated with 1/2-inch reinforcing rod by hand
Loose	L	4 - 10	5 - 12	5 - 15	15 - 35	Difficult to penetrate with 1/2-inch reinforcing rod pushed by hand
Medium Dense	MD	10 - 30	12 - 35	15 - 40	35 - 65	Easily penetrated a foot with 1/2-inch reinforcing rod driven with 5-lb. hammer
Dense	D	30 - 50	35 - 60	40 - 70	65 - 85	Difficult to penetrate a foot with 1/2-inch reinforcing rod driven with 5-lb. hammer
Very Dense	VD	>50	>60	>70	85 - 100	Penetrated only a few inches with 1/2-inch reinforcing rod driven with 5-lb. hammer



PROJECT NO. G15-239-11L
 DRAWN: 03/07/16
 DRAWN BY: D, Tower
 CHECKED BY: B. Steen
 FILE NAME: Legend.indd

SOIL DESCRIPTION KEY

Planned Solar Array Project
 Berryessa Union School District
 San Jose, California

EXHIBIT

2

LOG SYMBOLS

	BULK / BAG SAMPLE	-4	PERCENT FINER THAN THE NO. 4 SIEVE (ASTM Test Method C 136)
	SPLIT BARREL SAMPLER (2-1/2 inch outside diameter)	-200	PERCENT FINER THAN THE NO. 200 SIEVE (ASTM Test Method C 117)
	SPLIT BARREL SAMPLER (3 inch outside diameter)	LL	LIQUID LIMIT (ASTM Test Method D 4318)
	STANDARD PENETRATION SPLIT SPOON SAMPLER (2 inch outside diameter)	PI	PLASTICITY INDEX (ASTM Test Method D 4318)
	CONTINUOUS CORE	TXUU	UNCONSOLIDATED UNDRAINED TRIAXIAL COMPRESSION (EM 1110-1-1906)/ASTM Test Method D 2850
	SHELBY TUBE	EI	EXPANSION INDEX (UBC STANDARD 18-2)
	ROCK CORE	COL	COLLAPSE POTENTIAL
	GROUNDWATER LEVEL (encountered at time of drilling)	UC	UNCONFINED COMPRESSION (ASTM Test Method D 2166)
	GROUNDWATER LEVEL (measured after drilling)		
	SEEPAGE	MC	MOISTURE CONTENT (ASTM Test Method D 2216)

GENERAL NOTES

Boring log data represents a data snapshot.

This data represents subsurface characteristics only to the extent encountered at the location of the boring.

The data inherently cannot accurately predict the entire subsurface conditions to be encountered at the project site relative to construction or other subsurface activities.

Lines between soil layers and/or rock units are approximate and may be gradual transitions.

The information provided should be used only for the purposes intended as described in the accompanying documents.

In general, Unified Soil Classification System designations presented on the logs were evaluated by visual methods.

Where laboratory tests were performed, the designations reflect the laboratory test results.



PROJECT NO. G15-239-11L

DRAWN: 03/07/16

DRAWN BY: D, Tower

CHECKED BY: B. Steen

FILE NAME:
Legend.indd

LOG KEY

Planned Solar Array Project
Berryessa Union School District
San Jose, California

EXHIBIT

3

APPENDIX A

CHERRYWOOD ELEMENTARY SCHOOL



N

Approximate Scale

0 1 in. ≈ 75 ft. 75

References: 1. <http://earth.google.com>, 2015

Legend


 Approximate Boring Location (BSK, 2016)

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.

	PROJECT NO. G15-239-11L	<u>SITE PLAN</u>	PLATE A
	DRAWN: 02/23/16		
	DRAWN BY: B. Steen	Planned Solar Array Project Cherrywood Elementary School 2550 Greengate Drive San Jose, California	
	CHECKED BY: C. Foulk		
FILE NAME: SitePlan.indd			

SITE DESCRIPTION

Cherrywood Elementary school is located at 2550 Greengate Drive in San Jose, California. The site is located in a residential area bounded by Greengate Drive to the north, Cabrillo Avenue to the east and housing to the west and south. The main school building and multiple portable structures are located adjacent to asphalt paved parking and driveway at the north half of the parcel. Asphalt paved playgrounds and grassy playfields southern half of the campus. The proposed location of the elevated arrays will be located in the front parking lot, as shown on Plate A.

Topography of the site, as well as the proposed array locations, is generally flat with elevation at approximately 134 feet above mean sea level. The planned arrays will not be located near any slopes.

SUBSURFACE CONDITIONS

We drilled two subsurface borings (B-3 and B-4) to depths of about 20 feet deep at the approximate locations shown on Plate A. Our borings encountered interbedded firm to hard clays and silts, and medium dense poorly graded sands and silty sands with varying clay and gravel content.

Groundwater was not encountered in our borings to a depth 20 feet below the ground surface. Historical groundwater in the area has been measured as high as about 40 feet below grade. It should be noted that the groundwater level can fluctuate depending on factors such as seasonal rainfall, groundwater withdrawal, and construction activities on this or adjacent properties.

The above is a general description of soil and groundwater conditions encountered at the site in the borings for this investigation. For a more detailed description of the soils encountered, refer to the attached boring logs.

It should be noted that soil and subsurface conditions can deviate from those conditions encountered at the boring locations. If significant variation in the subsurface conditions is encountered during construction, it may be necessary for BSK to review the recommendations presented herein and recommend adjustments as necessary.

2013 SEISMIC DESIGN CRITERIA

Based on the site subsurface conditions, the site may be classified as Site Class D (stiff soil profile) per the ASCE 7-10. Use of the 2013 CBC mapped seismic design criteria is considered appropriate for this site and the following parameters should be considered applicable for the design of structural improvements:

SPECTRAL ACCELERATION PARAMETERS			
RISK TARGETED MAXIMUM CONSIDERED EARTHQUAKE			
Seismic Design Parameter	Value		Reference
Site Class	D		Table 20.3-1, ASCE 7-10
MCE _R Mapped Spectral Acceleration (g)	$S_S = 1.570$	$S_1 = 0.618$	USGS Mapped Values based on Figures 1613.3.1(1) and 1613.3.1(2), 2013 CBC
Site Coefficients	$F_a = 1.000$	$F_v = 1.500$	Tables 1613.3.3(1) and 1613.3.3(2), 2013 CBC
MCE _R Mapped Spectral Acceleration Adjusted for Site Class Effects (g)	$S_{MS} = 1.570$	$S_{M1} = 0.927$	Section 1613.3.3, 2013 CBC
Design Spectral Acceleration (g)	$S_{DS} = 1.046$	$S_{D1} = 0.618$	Section 1613.3.4, 2013 CBC
MCE _G peak ground acceleration adjusted for Site Class effects (g)	$PGA_M = 0.608$		Section 11.8.3, ASCE 7-10
Definitions:			
MCE _R = Risk-Targeted Maximum Considered Earthquake			
MCE _G = Maximum Considered Earthquake Geometric Mean			



BSK Associates
 324 Earhart Way
 Livermore, CA 94551
 Telephone: 925-315-3151
 Fax: 925-315-3152

LOG OF BORING NO. B-3

Project Name: **Berryessa School District Solar Array Project**
 Project Number: **G15-239-11L**
 Project Location: **Berryessa School District**
 Logged by: **G. Minerales**
 Checked by: **D. Tower**

Depth, feet	Graphic Log	Surface El.: 134 ft Location: Cherrywood Elementary School	Samples	Sample Number	Penetration Blows / Foot	Pocket Penetrometer, TSF	% Passing No. 200 Sieve	In-Situ Dry Weight (pcf)	In-Situ Moisture Content (%)	Liquid Limit	Plastic Limit	Plasticity Index
MATERIAL DESCRIPTION												
	0	ASPHALT 3 inches										
	1	AGGREGATE BASE 4 inches										
	2	SANDY LEAN CLAY (CL) : olive brown, moist, hard, low to medium plasticity, fine grained sand, iron oxide staining		1A	7	>4						
	3		1B	10								
	4		1C	12							31	17
	5	SANDY SILT WITH GRAVEL (ML) : olive brown, moist, firm, low to medium plasticity, fine subrounded gravel TXUU (see Plate A-2) c=830 psf		2A	3	1.75		107	15			
	6		2B	4								
	7		2C	4								
	10	SILTY SAND WITH GRAVEL (SM) : olive brown, moist, loose, fine grained sand, fine subrounded gravel		3A	3			96	11			
	11		3B	5								
	12		3C	7								
	15	slightly cemented, medium dense		4A	18							
	16	yellowish brown		4B	18							
	17		4C	20								
	18		5A	8								
	19	gravel content increasing up to 1.5 inch subrounded gravel, cemented-like structure		5B	15							
	20		5C	15								
	21		6A	6								
	22			6B	11							
	23			6C	23							
	25	Boring terminated at approximately 20 feet. No free groundwater observed. Boring backfilled with cement grout.										

GEO_TARGET BERRYESSA LOGS.GPJ GEOTECHNICAL 08.GDT 4/19/16

Completion Depth: 20.0 Date Started: 2/18/16 Date Completed: 2/18/16 California Sampler: 2.5-inch inner diameter SPT Sampler: 1.4-inch inner diameter	Drilling Equipment: Exploration GeoServices Mobile B-40 Drilling Method: Hollow Stem Drive Weight: 140 lbs Hole Diameter: 8-in Drop: 30-in Remarks:
--	--



BSK Associates
 324 Earhart Way
 Livermore, CA 94551
 Telephone: 925-315-3151
 Fax: 925-315-3152

LOG OF BORING NO. B-4

Project Name: **Berryessa School District Solar Array Project**
 Project Number: **G15-239-11L**
 Project Location: **Berryessa School District**
 Logged by: **G. Minerales**
 Checked by: **D. Tower**

Depth, feet	Graphic Log	MATERIAL DESCRIPTION	Samples	Sample Number	Penetration Blows / Foot	Pocket Penetrometer, TSF	% Passing No. 200 Sieve	In-Situ Dry Weight (pcf)	In-Situ Moisture Content (%)	Liquid Limit	Plastic Limit	Plasticity Index
		Surface El.: 134 ft Location: Cherrywood Elementary School										
	ASPHALT 3 inches											
	AGGREGATE BASE 4 inches											
	SANDY LEAN CLAY WITH GRAVEL (CL): olive brown, moist, hard, low to medium plasticity, fine grained sands and gravel		1A 1B 1C	5 6 7	2.5							
	SANDY SILT WITH GRAVEL (ML): olive brown, moist, firm, fine subrounded gravel, rootlets, slightly porous		2A 2B 2C	5 7 8	2.5			90	11			
	SILTY SAND WITH GRAVEL (SM): olive brown, moist, medium dense, fine grained sand, fine subangular gravel, slightly cemented		3A 3B 3C	5 9 17				98	14			
	POORLY GRADED SAND WITH GRAVEL (SP): yellowish brown, slightly moist, medium dense, up to 2.5-inch subangular gravel		4A 4B 4C	10 13 15								
	CLAYEY SAND WITH GRAVEL (SC): yellowish brown, moist, medium dense		5A 5B 5C	5 8 10								
		Boring terminated at approximately 20 feet. No free groundwater observed. Boring backfilled with cement grout.										


GEO_TARGET BERRYESSA LOGS.GPJ GEOTECHNICAL 08.GDT 4/19/16

Completion Depth: 20.0
Date Started: 2/18/16
Date Completed: 2/18/16
California Sampler: 2.5-inch inner diameter
SPT Sampler: 1.4-inch inner diameter

Drilling Equipment: Exploration GeoServices Mobile B-40
Drilling Method: Hollow Stem
Drive Weight: 140 lbs
Hole Diameter: 8-in
Drop: 30-in
Remarks:

GROUP SYMBOL	UNIFIED SOIL CLASSIFICATION FINE GRAINED SOIL GROUPS
OL	Organic silts and organic silty clays of low plasticity
ML	Inorganic clayey silts to very fine sands of slight plasticity
CL	Inorganic clays of low to moderate plasticity
OH	Organic clays of moderate to high plasticity, organic silts
MH	Inorganic silts and clayey silts
CH	Inorganic clays of high plasticity

EXPLANATION

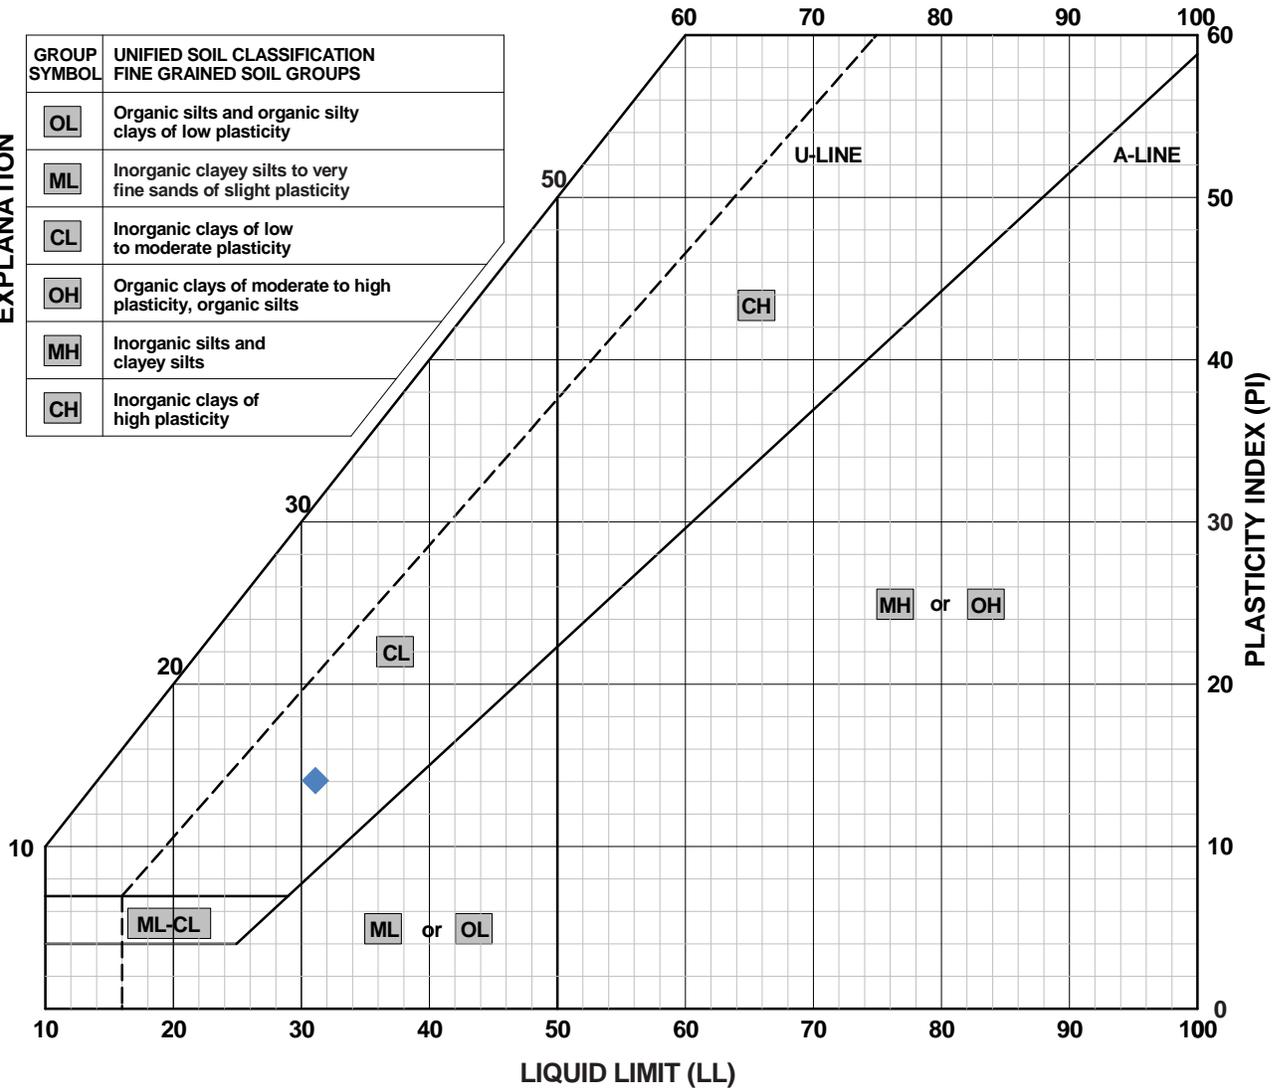

LEGEND:	SOURCE	DEPTH (ft)	LL	PL	PI	DESCRIPTION
◆	B-3	2.0	31	17	14	Olive Brown Sandy Lean CLAY (CL)

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.



PROJECT NO. G15-239-11L
 DRAWN: 3/4/16
 DRAWN BY: D. Tower
 CHECKED BY: B. Steen
 FILE NAME: Lab.indd

ATTERBERG LIMITS



Planned Solar Array Project
 Cherrywood Elementary School
 2550 Greengate Drive
 San Jose, California

PLATE

A-1



Unconsolidated-Undrained Triaxial Test
ASTM D2850

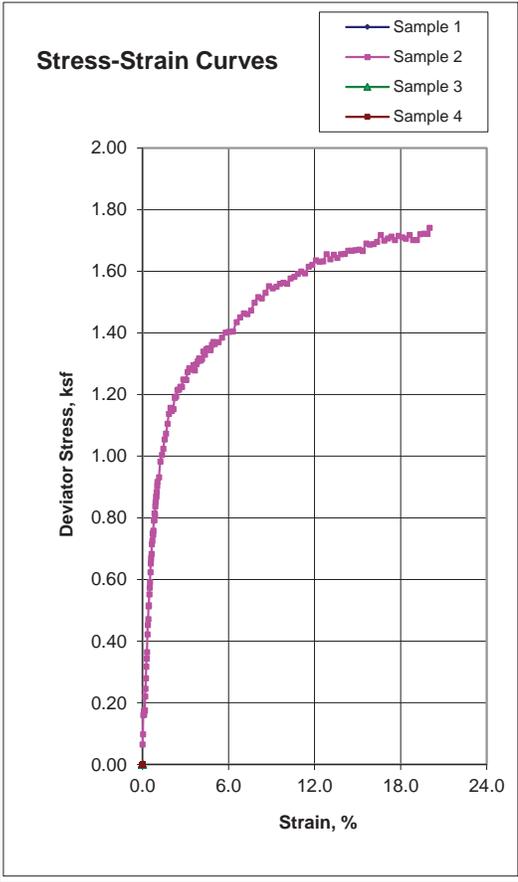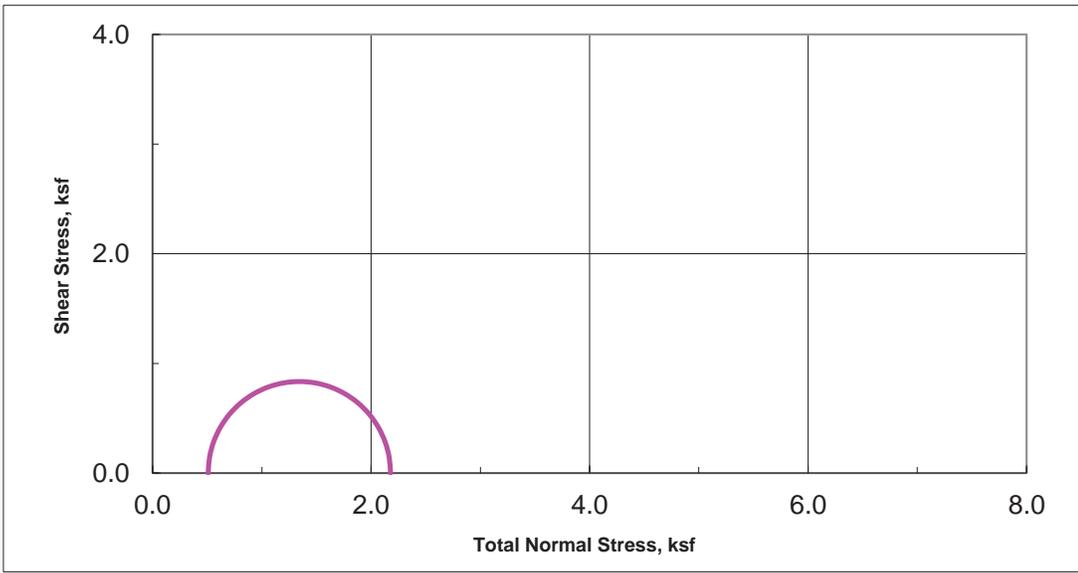

Sample Data				
	1	2	3	4
Moisture %		15.3		
Dry Den,pcf		106.6		
Void Ratio		0.581		
Saturation %		71.3		
Height in		4.99		
Diameter in		2.39		
Cell psi		3.5		
Strain %		15.00		
Deviator, ksf		1.669		
Rate %/min		1.00		
in/min		0.050		
Job No.:	664-063a			
Client:	BSK Associates			
Project:	G15-239-11L			
Boring:		B-3		
Sample:		2C		
Depth ft:		4.5		

Visual Soil Description				
Sample #				
1				
2	Olive Brown Sandy SILT w/ Gravel			
3				
4				
Remarks:				

Note: Strengths are picked at the peak deviator stress or 15% strain which ever occurs first per ASTM D2850.

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.



PROJECT NO. G15-239-11L
 DRAWN: 3/4/16
 DRAWN BY: D. Tower
 CHECKED BY: B. Steen
 FILE NAME: Lab.indd

UNCONSOLIDATED-UNDRAINED TRIAXIAL COMPRESSION

Planned Solar Array Project
 Cherrywood Elementary School
 2550 Greengate Drive
 San Jose, California

PLATE
A-2

APPENDIX B

LANEVIEW ELEMENTARY SCHOOL



References: 1. <http://earth.google.com>, 2015

Legend
 Approximate Boring Location (BSK, 2016)

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.



PROJECT NO. G15-239-11L

DRAWN: 02/23/16

DRAWN BY: B. Steen

CHECKED BY: C. Foulk

FILE NAME:
SitePlan.indd

SITE PLAN

Planned Solar Array Project
 Laneview Elementary School
 2095 Warmwood Lane
 San Jose, California

PLATE

B

SITE DESCRIPTION

Laneview Elementary School is located at 2095 Warmwood Lane in San Jose, California (see Plate B). The site is located in a primarily residential area with a commercial retail area towards the west. The approximately 10-acre rectangular parcel is generally aligned east-west, and is bordered by Laneview Drive to the north, Warmwood Lane to the east and residential homes along the south and west boundaries. The main school building and several portables occupy the eastern portion of the parcel with parking and driveway access from both streets. Grassy playfields and asphalt paved playcourts occupy the western portion of the campus. The proposed location of the elevated array will be located in the rear playcourt and playfield, as shown on Plate B.

Topography of the site, as well as the proposed array locations, is generally flat with elevations at approximately 116 feet above mean sea level. The planned arrays will not be located near any slopes.

SUBSURFACE CONDITIONS

We drilled two subsurface boring (B-5 and B-6) to a depth of about 20 feet deep at the approximate locations shown on Plate B. Our borings encountered firm to hard sandy clays and silts with varying gravel content to a depth of approximately 20 feet. Somewhat cleaner, poorly graded, medium dense sand was encountered at about 18 feet in boring B-6.

Groundwater was not encountered in our borings to a depth 20 feet below the ground surface. Historical groundwater in the area has been measured at about 40 feet below grade. It should be noted that the groundwater level can fluctuate depending on factors such as seasonal rainfall, groundwater withdrawal, and construction activities on this or adjacent properties.

The above is a general description of soil and groundwater conditions encountered at the site in the borings for this investigation. For a more detailed description of the soils encountered, refer to the attached boring logs.

It should be noted that soil and subsurface conditions can deviate from those conditions encountered at the boring locations. If significant variation in the subsurface conditions is encountered during construction, it may be necessary for BSK to review the recommendations presented herein and recommend adjustments as necessary.

2013 SEISMIC DESIGN CRITERIA

Based on the site subsurface conditions, the site may be classified as Site Class D (stiff soil profile) per the ASCE 7-10. Use of the 2013 CBC mapped seismic design criteria is considered appropriate for this site and the following parameters should be considered applicable for the design of structural improvements:

SPECTRAL ACCELERATION PARAMETERS		
RISK TARGETED MAXIMUM CONSIDERED EARTHQUAKE		
Seismic Design Parameter	Value	Reference
Site Class	D	Table 20.3-1, ASCE 7-10
MCE _R Mapped Spectral Acceleration (g)	S _S = 1.802 S ₁ = 0.720	USGS Mapped Values based on Figures 1613.3.1(1) and 1613.3.1(2), 2013 CBC
Site Coefficients	F _a = 1.000 F _v = 1.500	Tables 1613.3.3(1) and 1613.3.3(2), 2013 CBC
MCE _R Mapped Spectral Acceleration Adjusted for Site Class Effects (g)	S _{MS} = 1.802 S _{M1} = 1.080	Section 1613.3.3, 2013 CBC
Design Spectral Acceleration (g)	S _{DS} = 1.202 S _{D1} = 0.720	Section 1613.3.4, 2013 CBC
MCE _G peak ground acceleration adjusted for Site Class effects (g)	PGA _M = 0.695	Section 11.8.3, ASCE 7-10
Definitions:		
MCE _R = Risk-Targeted Maximum Considered Earthquake		
MCE _G = Maximum Considered Earthquake Geometric Mean		



BSK Associates
 324 Earhart Way
 Livermore, CA 94551
 Telephone: 925-315-3151
 Fax: 925-315-3152

LOG OF BORING NO. B-5

Project Name: **Berryessa School District Solar Array Project**
 Project Number: **G15-239-11L**
 Project Location: **Berryessa School District**
 Logged by: **G. Minerales**
 Checked by: **D. Tower**

Depth, feet	Graphic Log	Surface El.: 116 ft Location: Laneview Elementary School	Samples	Sample Number	Penetration Blows / Foot	Pocket Penetrometer, TSF	% Passing No. 200 Sieve	In-Situ Dry Weight (pcf)	In-Situ Moisture Content (%)	Liquid Limit	Plastic Limit	Plasticity Index
MATERIAL DESCRIPTION												
		ASPHALT 3 inches										
		AGGREGATE BASE 4 inches										
		SANDY LEAN CLAY WITH GRAVEL (CL): olive brown, moist, firm to hard, medium to high plasticity, fine grained sand, fine subrounded gravel		1A 1B 1C	5 6 7	1.25 3.25		105	15			
5		hard, iron oxide staining		2A 2B 2C	4 5 8	3.5 >4		103	15			
10		sand content decreasing		3A 3B 3C	5 10 16	>4		111	17			
15		SANDY SILT WITH GRAVEL (ML): olive brown, moist, hard, low plasticity, fine subrounded gravel		4A 4B 4C	5 10 15	>4						
20				5A 5B 5C	7 9 11	>4						
25		Boring terminated at approximately 20 feet. No free groundwater observed. Boring backfilled with cement grout.										

GEO_TARGET BERRYESSA LOGS.GPJ GEOTECHNICAL 08.GDT 4/19/16

Completion Depth: 20.0
Date Started: 2/19/16
Date Completed: 2/19/16
California Sampler: 2.5-inch inner diameter
SPT Sampler: 1.4-inch inner diameter

Drilling Equipment: Exploration GeoServices Mobile B-40
Drilling Method: Hollow Stem
Drive Weight: 140 lbs
Hole Diameter: 8-in
Drop: 30-in
Remarks:



BSK Associates
 324 Earhart Way
 Livermore, CA 94551
 Telephone: 925-315-3151
 Fax: 925-315-3152

LOG OF BORING NO. B-6

Project Name: **Berryessa School District Solar Array Project**
 Project Number: **G15-239-11L**
 Project Location: **Berryessa School District**
 Logged by: **G. Minerales**
 Checked by: **D. Tower**

Depth, feet	Graphic Log	Surface El.: 117 ft Location: Laneview Elementary School	Samples	Sample Number	Penetration Blows / Foot	Pocket Penetrometer, TSF	% Passing No. 200 Sieve	In-Situ Dry Weight (pcf)	In-Situ Moisture Content (%)	Liquid Limit	Plastic Limit	Plasticity Index
MATERIAL DESCRIPTION												
		SANDY LEAN CLAY (CL): olive brown, moist, firm to hard, medium to high plasticity		1A 1B 1C	5 7 9	2.5 2.5				42	18	24
5		fine subrounded gravel TXUU (see Plate B-2) c=1,300 psf		2A 2B 2C	5 5 6	2.5 3.0		107	17			
10		hard, fine subrounded gravel, slightly porous		3A 3B 3C	7 12 16	>4		117	15			
15		SANDY SILT WITH GRAVEL (ML): olive brown, moist, hard, low to medium plasticity, fine grained sand, fine subangular and subrounded gravels		4A 4B 4C	7 12 15	>4						
20		POORLY GRADED SAND WITH SILT AND GRAVEL (SP-SM): yellowish brown, medium dense, up to 3/4 inch subangular gravel		5A 5B 5C	7 8 11							
25		Boring terminated at approximately 20 feet. No free groundwater observed. Boring backfilled with cement grout.										


GEO_TARGET BERRYESSA LOGS.GPJ GEOTECHNICAL 08.GDT 4/19/16

Completion Depth: 20.0
Date Started: 2/19/16
Date Completed: 2/19/16
California Sampler: 2.5-inch inner diameter
SPT Sampler: 1.4-inch inner diameter

Drilling Equipment: Exploration GeoServices Mobile B-40
Drilling Method: Hollow Stem
Drive Weight: 140 lbs
Hole Diameter: 8-in
Drop: 30-in
Remarks:

EXPLANATION

GROUP SYMBOL	UNIFIED SOIL CLASSIFICATION FINE GRAINED SOIL GROUPS
OL	Organic silts and organic silty clays of low plasticity
ML	Inorganic clayey silts to very fine sands of slight plasticity
CL	Inorganic clays of low to moderate plasticity
OH	Organic clays of moderate to high plasticity, organic silts
MH	Inorganic silts and clayey silts
CH	Inorganic clays of high plasticity

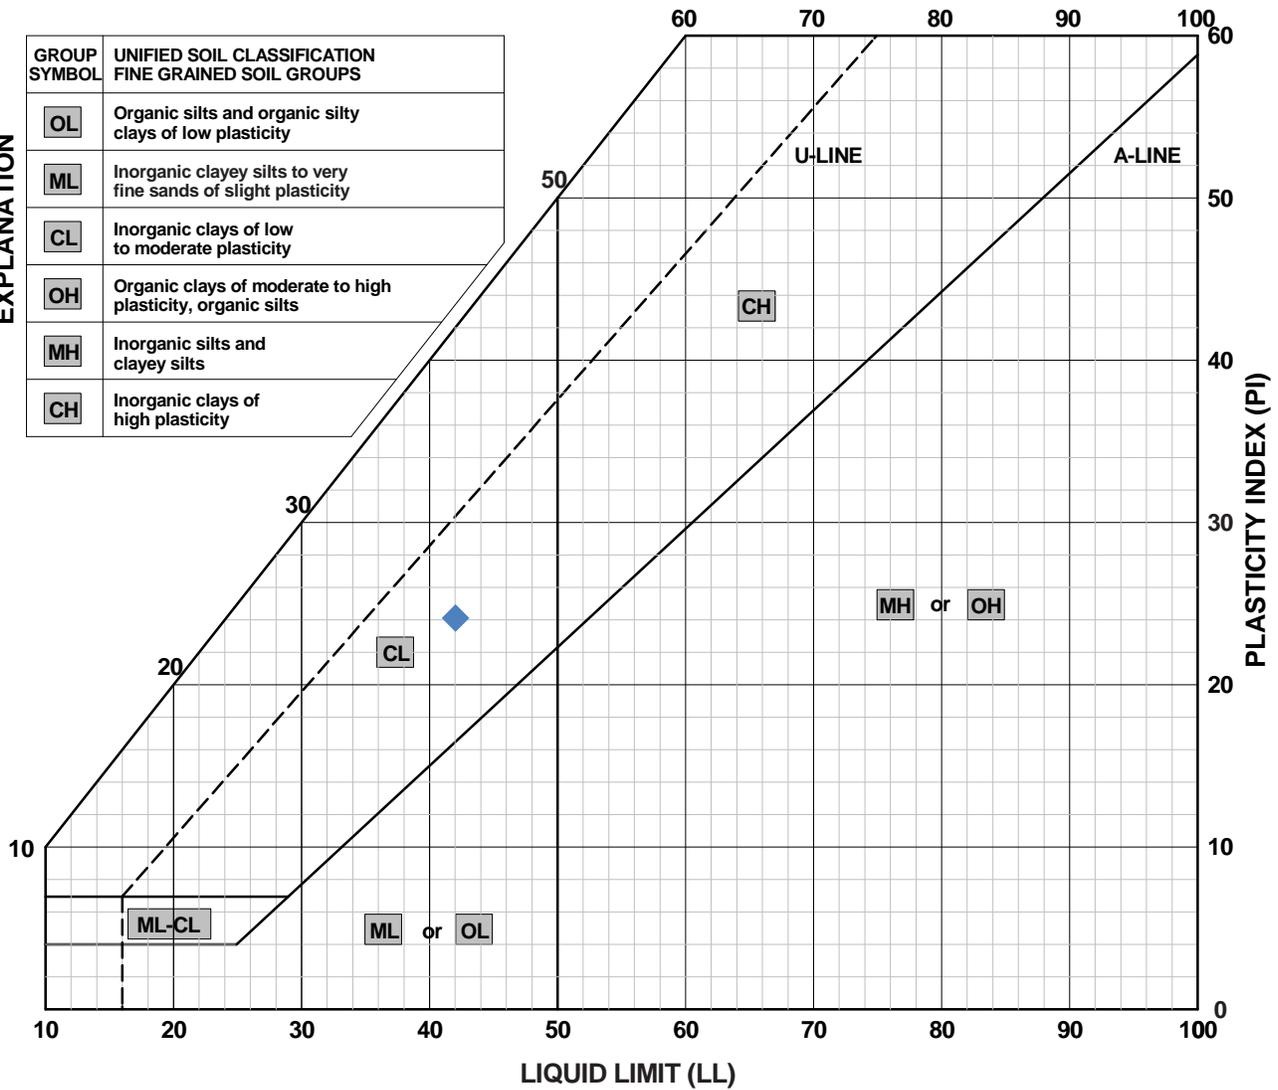

LEGEND:	SOURCE	DEPTH (ft)	LL	PL	PI	DESCRIPTION
◆	B-6	2.0	42	18	24	Olive Brown Sandy Lean CLAY (CL)

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.



PROJECT NO. G15-239-11L
 DRAWN: 3/4/16
 DRAWN BY: D. Tower
 CHECKED BY: B. Steen
 FILE NAME: Lab.indd

ATTERBERG LIMITS



Planned Solar Array Project
 Laneview Elementary School
 2095 Warmwood Lane
 San Jose, California

PLATE

B-1



Unconsolidated-Undrained Triaxial Test
ASTM D2850

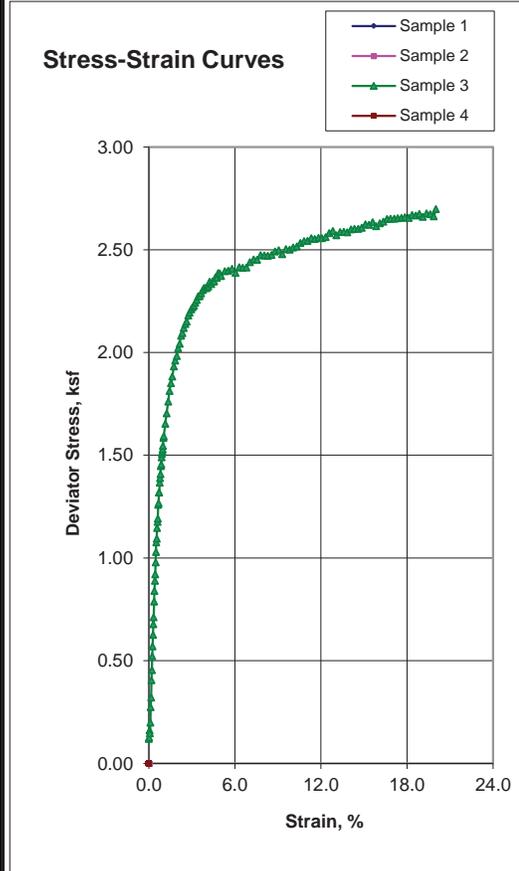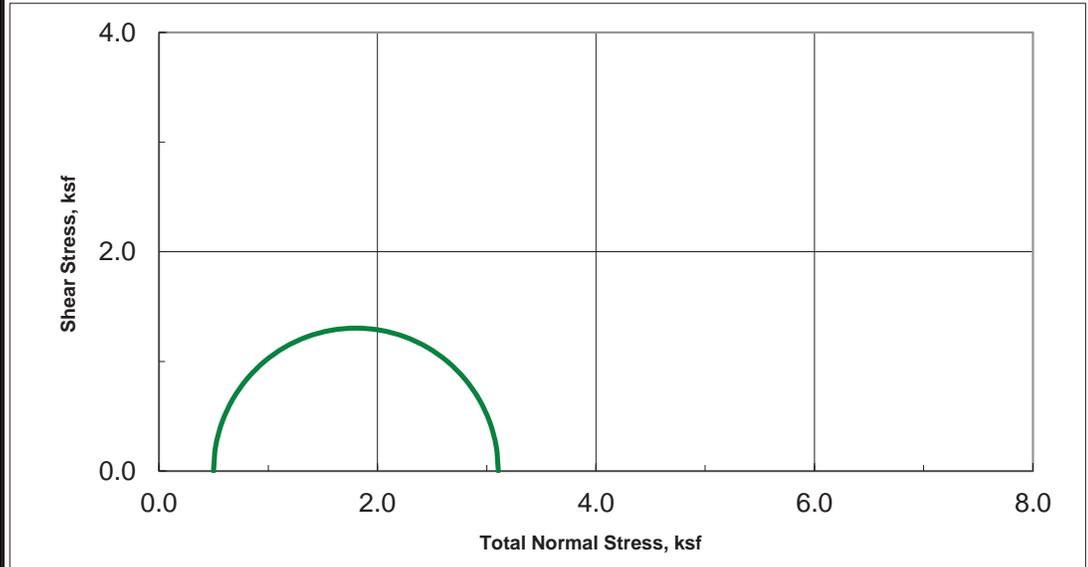

Sample Data				
	1	2	3	4
Moisture %			17.2	
Dry Den,pcf			106.7	
Void Ratio			0.580	
Saturation %			79.9	
Height in			5.00	
Diameter in			2.40	
Cell psi			3.5	
Strain %			15.00	
Deviator, ksf			2.608	
Rate %/min			1.00	
in/min			0.050	
Job No.:	664-063a			
Client:	BSK Associates			
Project:	G15-239-11L			
Boring:			B-6	
Sample:			2C	
Depth ft:			4.5	

Visual Soil Description				
Sample #				
1				
2				
3	Olive Brown Sandy Lean CLAY			
4				
Remarks:				

Note: Strengths are picked at the peak deviator stress or 15% strain which ever occurs first per ASTM D2850.

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.



PROJECT NO. G15-239-11L
 DRAWN: 3/7/16
 DRAWN BY: D. Tower
 CHECKED BY: B. Steen
 FILE NAME: Lab.indd

UNCONSOLIDATED-UNDRAINED TRIAXIAL COMPRESSION

Planned Solar Array Project
 Laneview Elementary School
 2095 Warmwood Lane
 San Jose, California

PLATE

B-2

2 March, 2016

Job No. 1602189
Cust. No. 12667

Mr. Brad Steen
BSK Associates Engineers & Laboratories
324 Earhart Way
Livermore, CA 94551

Subject: Project No.: G15-239-11L
Project Name: Berryessa School District
Corrosivity Analysis – ASTM Test Methods

Dear Mr. Steen:

Pursuant to your request, CERCO Analytical has analyzed the soil samples submitted on February 23, 2016. Based on the analytical results, this brief corrosivity evaluation is enclosed for your consideration.

Based upon the resistivity measurements, samples 001, 004, 005, 007, 010 & 013 are classified as "corrosive" and samples 002, 003, 006, 008, 009, 011 & 012 are classified as "moderately corrosive". All buried iron, steel, cast iron, ductile iron, galvanized steel and dielectric coated steel or iron should be properly protected against corrosion depending upon the critical nature of the structure. All buried metallic pressure piping such as ductile iron firewater pipelines should be protected against corrosion.

The chloride ion concentrations range from none detected to 77 mg/kg. Because the chloride ion concentrations are less than 300 mg/kg, they are determined to be insufficient to attack steel embedded in a concrete mortar coating.

The sulfate ion concentrations range from none detected to 80 mg/kg and are determined to be insufficient to damage reinforced concrete structures and cement mortar-coated steel at these locations.

The pH of the soils range from 7.28 to 8.44 which does not present corrosion problems for buried iron, steel, mortar-coated steel and reinforced concrete structures.

The redox potentials range from 390 to 480-mV. Sample No. 001, 002, 003, 004, 005, 006, 007, 008, 009, 010, 012 and 013 are indicative of aerobic soil conditions, and sample 011 is indicative of potentially "slightly corrosive" soils resulting from anaerobic soil conditions.

This corrosivity evaluation is based on general corrosion engineering standards and is non-specific in nature. For specific long-term corrosion control design recommendations or consultation, please call *JDH Corrosion Consultants, Inc. at (925) 927-6630.*

We appreciate the opportunity of working with you on this project. If you have any questions, or if you require further information, please do not hesitate to contact us.

Very truly yours,
CERCO ANALYTICAL, INC.



J. Darby Howard, Jr., P.E.
President

JDH/jdl
Enclosure


Client: BSK Associates Engineers & Laboratories
 Client's Project No.: G-15-239-11L
 Client's Project Name: Berryessa School District
 Date Sampled: 23-Feb-16
 Date Received: 23-Feb-16
 Matrix: Soil
 Authorization: Signed Chain of Custody

1100 Willow Pass Court, Suite A
 Concord, CA 94520-1006
 925 462 2771 Fax. 925 462 2775
 www.cercoanalytical.com

Date of Report: 2-Mar-2016

Job/Sample No.	Sample I.D.	Redox (mV)	pH	Conductivity (umhos/cm)*	Resistivity (100% Saturation) (ohms-cm)	Sulfide (mg/kg)*	Chloride (mg/kg)*	Sulfate (mg/kg)*
1602189-001	B-2 @ 1'-3'	460	7.93	-	1,000	-	77	80
1602189-002	B-3 @ 1'-3'	420	8.21	-	2,600	-	N.D.	N.D.
1602189-003	B-6 @ 1'-3'	410	7.28	-	2,500	-	N.D.	N.D.
1602189-004	B-8 @ 1'-3'	400	8.44	-	1,700	-	N.D.	73
1602189-005	B-10 @ 1'-3'	440	8.24	-	1,400	-	35	44
1602189-006	B-12 @ 1'-2'	430	8.01	-	2,300	-	N.D.	N.D.
1602189-007	B-14 @ 1'-3'	420	8.14	-	1,700	-	N.D.	28
1602189-008	B-16 @ 1'-2'	410	7.37	-	2,900	-	N.D.	N.D.
1602189-009	B-19 @ 1'-2'	420	7.85	-	4,300	-	N.D.	N.D.
1602189-010	B-20 @ 1'-3'	410	7.72	-	700	-	37	76
1602189-011	B-23 @ 1'-3'	390	7.74	-	2,900	-	N.D.	23
1602189-012	B-26 @ 1'-3'	480	8.18	-	2,400	-	25	35
1602189-013	B-30 @ 1'-3'	460	8.12	-	1,600	-	44	45

Method:	ASTM D1498	ASTM D4972	ASTM D1125M	ASTM G57	ASTM D4658M	ASTM D4327	ASTM D4327
Reporting Limit:	-	-	10	-	50	15	15
	1-Mar-2016	1-Mar-2016	-	1-Mar-2016	-	1-Mar-2016	1-Mar-2016

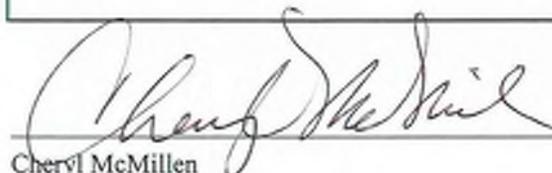


Cheryl McMillen
 Laboratory Director

* Results Reported on "As Received" Basis
 N.D. - None Detected

APPENDIX C

MAJESTIC WAY ELEMENTARY SCHOOL



References: 1. <http://earth.google.com>, 2015

Legend
 Approximate Boring Location (BSK, 2016)

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.

	PROJECT NO. G15-239-11L	SITE PLAN	PLATE C
	DRAWN: 02/23/16		
	DRAWN BY: B. Steen	Planned Solar Array Project Majestic Way Elementary School 1855 Majestic Way San Jose, California	
	CHECKED BY: C. Foulk		
FILE NAME: SitePlan.indd			

SITE DESCRIPTION

Majestic Way Elementary school is located at 1855 Majestic Way in San Jose, California. The campus is located in a predominately residential neighborhood. Berryessa Creek Park and Majestic Park abut the campus to the north and west, respectively. Majestic Way lies to the east and Isadora Drive lies to the south. The facility's structures are single story and occupy the central portion of the parcel. Asphalt paved parking and blacktop play courts surround the school with grassy play fields on the south side. The proposed location of the arrays will be located in the parking areas directly north of the entrance of the school and in the small landscape areas just west of the main school building, as shown on Plate C.

Topography of the site, as well as the proposed array locations, is generally flat with elevation at about 159 feet above mean sea level. The planned arrays will not be located near any slopes.

SUBSURFACE CONDITIONS

We drilled three subsurface borings (B-7 through B-9) to a depth of about 20 feet deep. Our borings encountered interbedded layers of firm to hard clay and silts with gravel and sands mixed throughout in the upper 20 feet.

Groundwater was not encountered in our borings to a depth 20 feet below the ground surface. Historical groundwater in the area has been measured deeper than 50 feet below grade. It should be noted that the groundwater level can fluctuate depending on factors such as seasonal rainfall, groundwater withdrawal, and construction activities on this or adjacent properties.

The above is a general description of soil and groundwater conditions encountered at the site in the borings for this investigation. For a more detailed description of the soils encountered, refer to the attached boring logs.

It should be noted that soil and subsurface conditions can deviate from those conditions encountered at the boring locations. If significant variation in the subsurface conditions is encountered during construction, it may be necessary for BSK to review the recommendations presented herein and recommend adjustments as necessary.

2013 SEISMIC DESIGN CRITERIA

Based on the site subsurface conditions, the site may be classified as Site Class D (stiff soil profile) per the ASCE 7-10. Use of the 2013 CBC mapped seismic design criteria is considered appropriate for this site and the following parameters should be considered applicable for the design of structural improvements:

SPECTRAL ACCELERATION PARAMETERS		
RISK TARGETED MAXIMUM CONSIDERED EARTHQUAKE		
Seismic Design Parameter	Value	Reference
Site Class	D	Table 20.3-1, ASCE 7-10
MCE _R Mapped Spectral Acceleration (g)	S _S = 1.796 S ₁ = 0.716	USGS Mapped Values based on Figures 1613.3.1(1) and 1613.3.1(2), 2013 CBC
Site Coefficients	F _a = 1.000 F _v = 1.500	Tables 1613.3.3(1) and 1613.3.3(2), 2013 CBC
MCE _R Mapped Spectral Acceleration Adjusted for Site Class Effects (g)	S _{MS} = 1.796 S _{M1} = 1.075	Section 1613.3.3, 2013 CBC
Design Spectral Acceleration (g)	S _{DS} = 1.197 S _{D1} = 0.716	Section 1613.3.4, 2013 CBC
MCE _G peak ground acceleration adjusted for Site Class effects (g)	PGA _M = 0.693	Section 11.8.3, ASCE 7-10
Definitions:		
MCE _R = Risk-Targeted Maximum Considered Earthquake		
MCE _G = Maximum Considered Earthquake Geometric Mean		



BSK Associates
 324 Earhart Way
 Livermore, CA 94551
 Telephone: 925-315-3151
 Fax: 925-315-3152

LOG OF BORING NO. B-7

Project Name: **Berryessa School District Solar Array Project**
 Project Number: **G15-239-11L**
 Project Location: **Berryessa School District**
 Logged by: **G. Minerales**
 Checked by: **D. Tower**

Depth, feet	Graphic Log	Surface El.: 159 ft Location: Majestic Way Elementary School	Samples	Sample Number	Penetration Blows / Foot	Pocket Penetrometer, TSF	% Passing No. 200 Sieve	In-Situ Dry Weight (pcf)	In-Situ Moisture Content (%)	Liquid Limit	Plastic Limit	Plasticity Index
MATERIAL DESCRIPTION												
		ASPHALT 3.5 inches AGGREGATE BASE 5.5 inches										
		SANDY SILT WITH GRAVEL (ML): olive brown, moist, firm to hard, fine subangular gravel		1A 1B 1C	5 6 9	2.5		106	17			
5		POORLY GRADED GRAVEL WITH SAND (GP): light yellowish brown, slightly moist to moist, medium dense, fine subangular and subrounded gravel, fine to coarse grained sand		2A 2B 2C	11 11 12			118	7			
10		SILTY SAND (SM): yellowish brown, slightly moist, medium dense to dense, fine grained sand		3A 3B 3C	6 13 16			105	20			
15				4A 4B 4C	6 22 33							
20				5A 5B 5C	12 16 30							
		Boring terminated at approximately 20 feet. No free groundwater observed. Boring backfilled with cement grout.										

GEO_TARGET BERRYESSA LOGS.GPJ GEOTECHNICAL 08.GDT 4/19/16

Completion Depth: 20.0
Date Started: 2/19/16
Date Completed: 2/19/16
California Sampler: 2.5-inch inner diameter
SPT Sampler: 1.4-inch inner diameter

Drilling Equipment: Exploration GeoServices Mobile B-40
Drilling Method: Hollow Stem
Drive Weight: 140 lbs
Hole Diameter: 8-in
Drop: 30-in
Remarks:



BSK Associates
 324 Earhart Way
 Livermore, CA 94551
 Telephone: 925-315-3151
 Fax: 925-315-3152

LOG OF BORING NO. B-8

Project Name: **Berryessa School District Solar Array Project**
 Project Number: **G15-239-11L**
 Project Location: **Berryessa School District**
 Logged by: **G. Minerales**
 Checked by: **D. Tower**

Depth, feet	Graphic Log	Surface El.: 157 ft Location: Majestic Way Elementary School	Samples	Sample Number	Penetration Blows / Foot	Pocket Penetrometer, TSF	% Passing No. 200 Sieve	In-Situ Dry Weight (pcf)	In-Situ Moisture Content (%)	Liquid Limit	Plastic Limit	Plasticity Index
		ASPHALT 3.5 inches										
		AGGREGATE BASE 5.5 inches										
		SANDY CLAY WITH GRAVEL (CL): olive brown, moist, firm, low to medium plasticity, fine subrounded gravel		1A 1B 1C	5 7 6	1.75				34	17	17
5		very moist, soft to firm, fine grained sands, increasing sand content TXUU (see Plate C-2) c=770 psf		2A 2B 2C	2 3 5	0.25		92	30			
10		hard		3A 3B 3C	4 11 14	>4		109	19			
15		increasing sand content		4A 4B 4C	11 15 20	>4						
20		POORLY GRADED GRAVEL WITH SILT AND SAND (GP-GM): olive brown, moist, medium dense, fine subrounded gravel up to 3/4 inch		5A 5B 5C	10 13 16							
		Boring terminated at approximately 20 feet. No free groundwater observed. Boring backfilled with cement grout.										

GEO_TARGET BERRYESSA LOGS.GPJ GEOTECHNICAL 08.GDT 4/19/16

Completion Depth: 20.0
Date Started: 2/19/16
Date Completed: 2/19/16
California Sampler: 2.5-inch inner diameter
SPT Sampler: 1.4-inch inner diameter

Drilling Equipment: Exploration GeoServices Mobile B-40
Drilling Method: Hollow Stem
Drive Weight: 140 lbs
Hole Diameter: 8-in
Drop: 30-in
Remarks:



BSK Associates
 324 Earhart Way
 Livermore, CA 94551
 Telephone: 925-315-3151
 Fax: 925-315-3152

LOG OF BORING NO. B-9

Project Name: **Berryessa School District Solar Array Project**
 Project Number: **G15-239-11L**
 Project Location: **Berryessa School District**
 Logged by: **G. Minerales**
 Checked by: **D. Tower**

Depth, feet	Graphic Log	Surface El.: 160 ft Location: Majestic Way Elementary School	Samples	Sample Number	Penetration Blows / Foot	Pocket Penetrometer, TSF	% Passing No. 200 Sieve	In-Situ Dry Weight (pcf)	In-Situ Moisture Content (%)	Liquid Limit	Plastic Limit	Plasticity Index
MATERIAL DESCRIPTION												
		SILTY CLAY WITH GRAVEL (CL): light olive brown, moist, hard, medium to high plasticity, fine subangular gravel, iron oxide staining, roots found		1A 1B 1C	6 8 9	>4						
5		CLAYEY SILT WITH SAND AND GRAVEL (ML): olive brown, very moist to moist, firm to hard, low to medium plasticity, fine grained sands, fine subrounded gravel		2A 2B 2C	4 6 8	1.0 3.25		98	24			
10		SANDY LEAN CLAY (CL): olive brown, very moist, soft to firm, medium to high plasticity, fine grained sands, roots found TXUU (see C-2) c=450 psf		3A 3B 3C	2 3 4	0.5 1.0		89	29			
15		moist, firm to hard sand content increasing		4A 4B 4C	3 4 6	>4						
20		SANDY SILT WITH GRAVEL (ML): yellowish brown, moist, firm, low to medium plasticity, fine subangular gravel		5A 5B 5C	11 16 16	1.5						
		Boring terminated at approximately 20 feet. No free groundwater observed. Boring backfilled with cement grout.										


GEO_TARGET BERRYESSA LOGS.GPJ GEOTECHNICAL 08.GDT 4/19/16

Completion Depth: 20.0
Date Started: 2/19/16
Date Completed: 2/19/16
California Sampler: 2.5-inch inner diameter
SPT Sampler: 1.4-inch inner diameter

Drilling Equipment: Exploration GeoServices Mobile B-40
Drilling Method: Hollow Stem
Drive Weight: 140 lbs
Hole Diameter: 8-in
Drop: 30-in
Remarks:

EXPLANATION

GROUP SYMBOL	UNIFIED SOIL CLASSIFICATION FINE GRAINED SOIL GROUPS
OL	Organic silts and organic silty clays of low plasticity
ML	Inorganic clayey silts to very fine sands of slight plasticity
CL	Inorganic clays of low to moderate plasticity
OH	Organic clays of moderate to high plasticity, organic silts
MH	Inorganic silts and clayey silts
CH	Inorganic clays of high plasticity

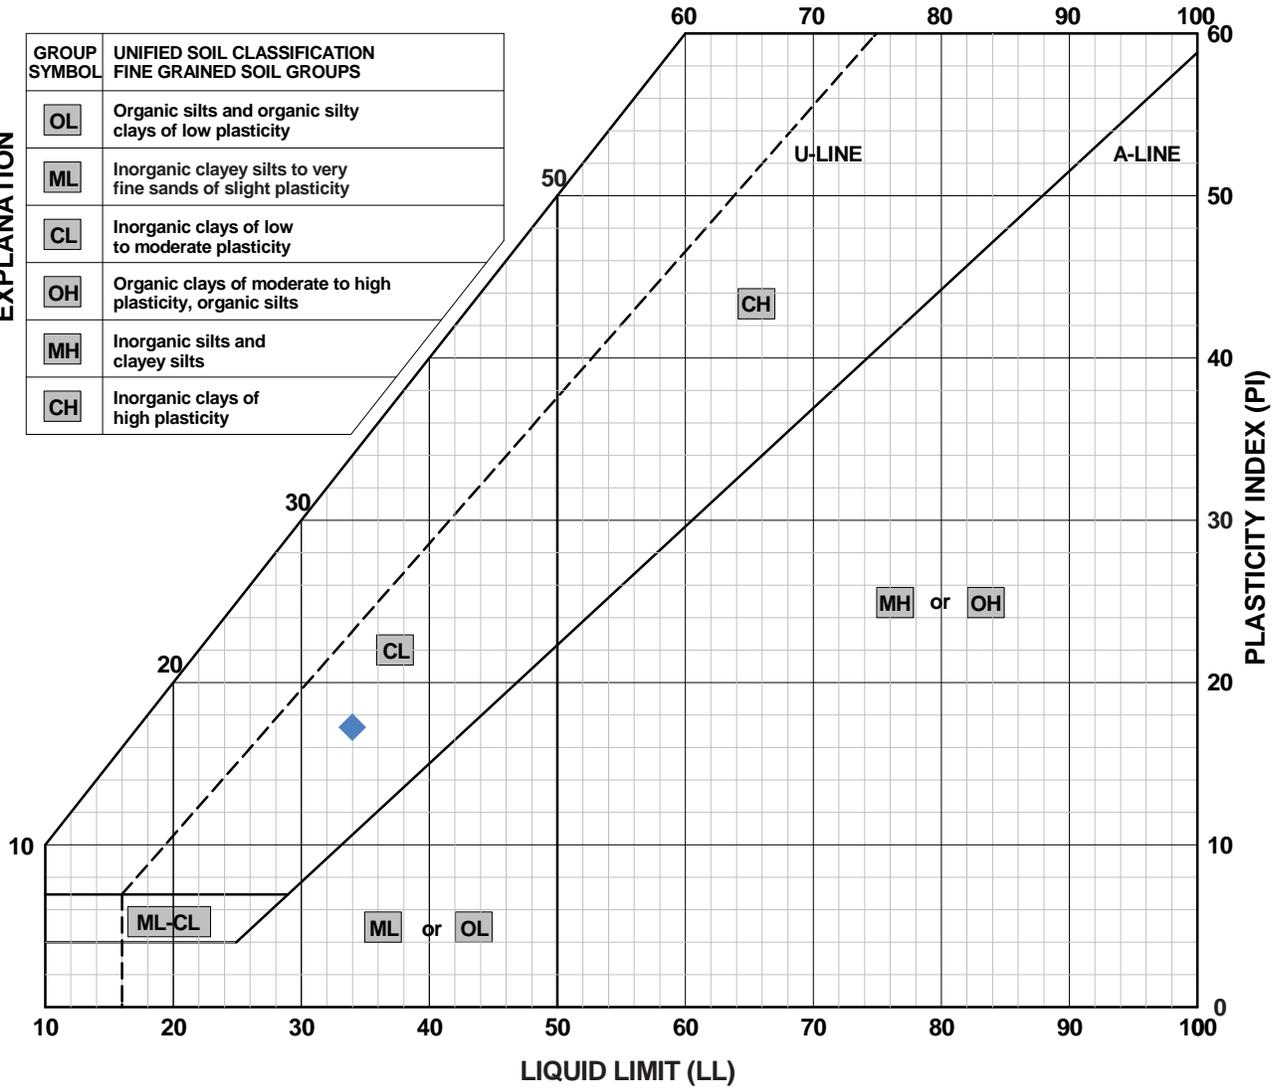

LEGEND:	SOURCE	DEPTH (ft)	LL	PL	PI	DESCRIPTION
◆	B-8	2.0	34	17	17	Olive Brown Sandy CLAY w/ Gravel (CL)

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.





PROJECT NO. G15-239-11L
 DRAWN: 3/4/16
 DRAWN BY: D. Tower
 CHECKED BY: B. Steen
 FILE NAME: Lab.indd

ATTERBERG LIMITS
 Planned Solar Array Project
 Majestic Way Elementary School
 1855 Majestic Way
 San Jose, California

PLATE
 C-1



Unconsolidated-Undrained Triaxial Test
ASTM D2850

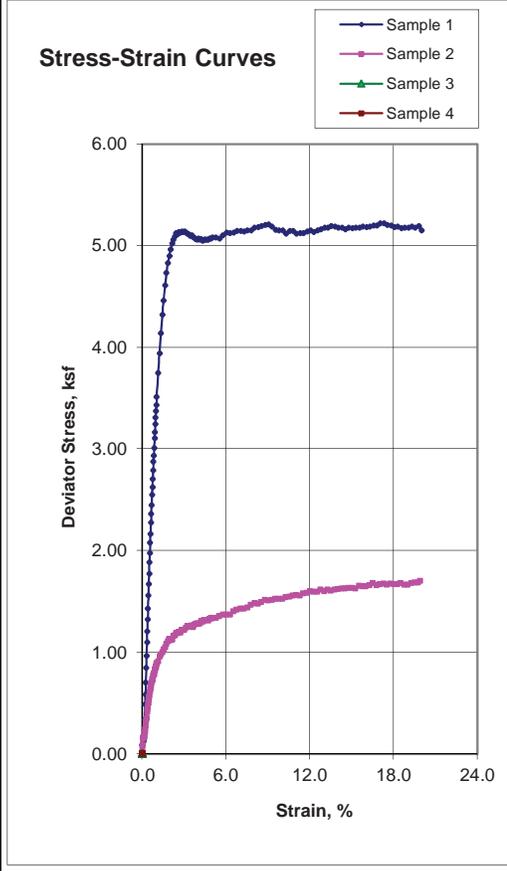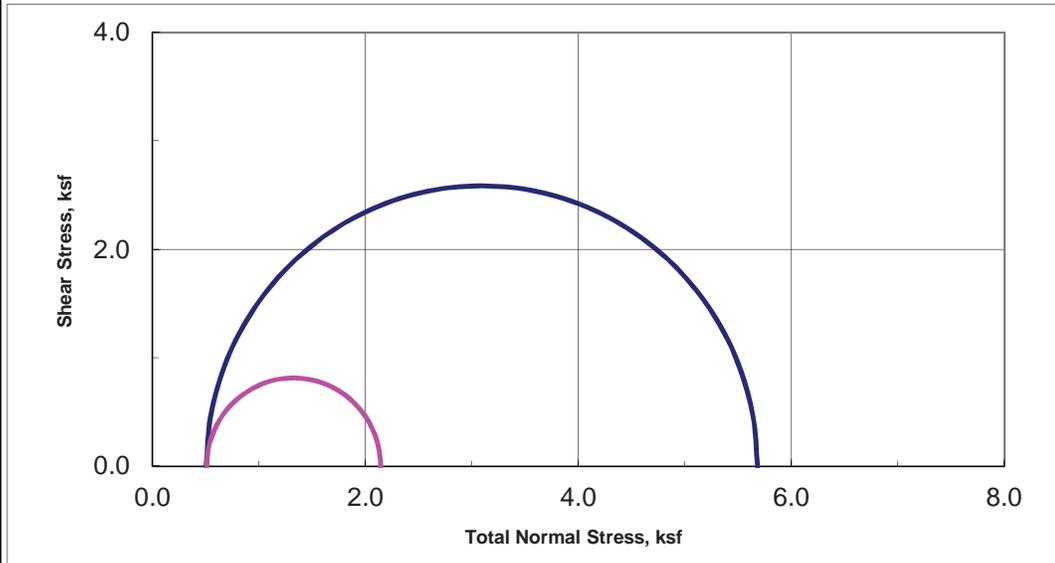

Sample Data				
	1	2	3	4
Moisture %	29.7	29.1		
Dry Den,pcf	91.7	89.2		
Void Ratio	0.839	0.890		
Saturation %	95.7	88.1		
Height in	5.00	5.02		
Diameter in	2.41	2.42		
Cell psi	3.5	3.5		
Strain %	15.00	15.00		
Deviator, ksf	5.175	1.634		
Rate %/min	1.00	1.00		
in/min	0.050	0.050		
Job No.:	664-063a			
Client:	BSK Associates			
Project:	G15-239-11L			
Boring:	B-8	B-9		
Sample:	2C	3B		
Depth ft:	4.5	9		
Visual Soil Description				
Sample #				
1	Dark Brown Sandy CLAY w/ Gravel			
2	Olive Brown Sandy Lean CLAY			
3				
4				
Remarks:				

Note: Strengths are picked at the peak deviator stress or 15% strain which ever occurs first per ASTM D2850.

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.



PROJECT NO. G15-239-11L
 DRAWN: 3/7/16
 DRAWN BY: D. Tower
 CHECKED BY: B. Steen
 FILE NAME: Lab.indd

UNCONSOLIDATED-UNDRAINED TRIAXIAL COMPRESSION

Planned Solar Array Project
 Majestic Way Elementary School
 1855 Majestic Way
 San Jose, California

PLATE

C-2

2 March, 2016

Job No. 1602189
Cust. No. 12667

Mr. Brad Steen
BSK Associates Engineers & Laboratories
324 Earhart Way
Livermore, CA 94551

Subject: Project No.: G15-239-11L
Project Name: Berryessa School District
Corrosivity Analysis – ASTM Test Methods

Dear Mr. Steen:

Pursuant to your request, CERCO Analytical has analyzed the soil samples submitted on February 23, 2016. Based on the analytical results, this brief corrosivity evaluation is enclosed for your consideration.

Based upon the resistivity measurements, samples 001, 004, 005, 007, 010 & 013 are classified as "corrosive" and samples 002, 003, 006, 008, 009, 011 & 012 are classified as "moderately corrosive". All buried iron, steel, cast iron, ductile iron, galvanized steel and dielectric coated steel or iron should be properly protected against corrosion depending upon the critical nature of the structure. All buried metallic pressure piping such as ductile iron firewater pipelines should be protected against corrosion.

The chloride ion concentrations range from none detected to 77 mg/kg. Because the chloride ion concentrations are less than 300 mg/kg, they are determined to be insufficient to attack steel embedded in a concrete mortar coating.

The sulfate ion concentrations range from none detected to 80 mg/kg and are determined to be insufficient to damage reinforced concrete structures and cement mortar-coated steel at these locations.

The pH of the soils range from 7.28 to 8.44 which does not present corrosion problems for buried iron, steel, mortar-coated steel and reinforced concrete structures.

The redox potentials range from 390 to 480-mV. Sample No. 001, 002, 003, 004, 005, 006, 007, 008, 009, 010, 012 and 013 are indicative of aerobic soil conditions, and sample 011 is indicative of potentially "slightly corrosive" soils resulting from anaerobic soil conditions.

This corrosivity evaluation is based on general corrosion engineering standards and is non-specific in nature. For specific long-term corrosion control design recommendations or consultation, please call *JDH Corrosion Consultants, Inc.* at (925) 927-6630.

We appreciate the opportunity of working with you on this project. If you have any questions, or if you require further information, please do not hesitate to contact us.

Very truly yours,
CERCO ANALYTICAL, INC.


J. Darby Howard, Jr., P.E.
President

JDH/jdl
Enclosure

Client: BSK Associates Engineers & Laboratories
 Client's Project No.: G-15-239-11L
 Client's Project Name: Berryessa School District
 Date Sampled: 23-Feb-16
 Date Received: 23-Feb-16
 Matrix: Soil
 Authorization: Signed Chain of Custody

Date of Report: 2-Mar-2016

Job/Sample No.	Sample I.D.	Redox (mV)	pH	Conductivity (umhos/cm)*	Resistivity (100% Saturation) (ohms-cm)	Sulfide (mg/kg)*	Chloride (mg/kg)*	Sulfate (mg/kg)*
1602189-001	B-2 @ 1'-3'	460	7.93	-	1,000	-	77	80
1602189-002	B-3 @ 1'-3'	420	8.21	-	2,600	-	N.D.	N.D.
1602189-003	B-6 @ 1'-3'	410	7.28	-	2,500	-	N.D.	N.D.
1602189-004	B-8 @ 1'-3'	400	8.44	-	1,700	-	N.D.	73
1602189-005	B-10 @ 1'-3'	440	8.24	-	1,400	-	35	44
1602189-006	B-12 @ 1'-2'	430	8.01	-	2,300	-	N.D.	N.D.
1602189-007	B-14 @ 1'-3'	420	8.14	-	1,700	-	N.D.	28
1602189-008	B-16 @ 1'-2'	410	7.37	-	2,900	-	N.D.	N.D.
1602189-009	B-19 @ 1'-2'	420	7.85	-	4,300	-	N.D.	N.D.
1602189-010	B-20 @ 1'-3'	410	7.72	-	700	-	37	76
1602189-011	B-23 @ 1'-3'	390	7.74	-	2,900	-	N.D.	23
1602189-012	B-26 @ 1'-3'	480	8.18	-	2,400	-	25	35
1602189-013	B-30 @ 1'-3'	460	8.12	-	1,600	-	44	45

Method:	ASTM D1498	ASTM D4972	ASTM D1125M	ASTM G57	ASTM D4658M	ASTM D4327	ASTM D4327
Reporting Limit:	-	-	10	-	50	15	15
	1-Mar-2016	1-Mar-2016	-	1-Mar-2016	-	1-Mar-2016	1-Mar-2016


 Cheryl McMillen
 Laboratory Director

* Results Reported on "As Received" Basis

N.D. - None Detected

APPENDIX D

MORRILL MIDDLE SCHOOL



References: 1. <http://earth.google.com>, 2015

Legend

 Approximate Boring Location (BSK, 2016)

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.



PROJECT NO. G15-239-11L

DRAWN: 02/23/16

DRAWN BY: B. Steen

CHECKED BY: C. Foulk

FILE NAME:
SitePlan.indd

SITE PLAN

Planned Solar Array Project
Morrill Middle School
1970 Morrill Avenue
San Jose, California

PLATE

D

SITE DESCRIPTION

Morrill Middle School is located at 1970 Morrill Avenue in San Jose, California. The approximately 20-acre parcel is located in a predominately residential neighborhood at the northeast corner of the intersection of Morrill Avenue and Cropley Avenue. The four main buildings are located in the western end of the parcel. Two asphalt paved parking areas border the west end of the campus with a blacktop play court to the east side of the school. The proposed location of the arrays will be located in the grassy playfields directly northeast of the school, as shown on Plate D.

Topography of the site slopes gently downward to the west with elevations ranging from approximately 100 to 130 feet above mean sea level. The proposed array location is generally flat and will not be located near any slopes.

SUBSURFACE CONDITIONS

We drilled two subsurface borings (B-10 and B-11) to a depth of about 20 feet deep. Both borings primarily encountered interbedded firm to hard sandy clays in the upper 18 feet. Below 18 feet, clayey and sandy gravel was encountered.

Groundwater was not encountered in our borings to a depth 20 feet below the ground surface. Historical high groundwater in the area has been measured at about 40 feet below grade. It should be noted that the groundwater level can fluctuate depending on factors such as seasonal rainfall, groundwater withdrawal, and construction activities on this or adjacent properties.

The above is a general description of soil and groundwater conditions encountered at the site in the borings for this investigation. For a more detailed description of the soils encountered, refer to the attached boring logs.

It should be noted that soil and subsurface conditions can deviate from those conditions encountered at the boring locations. If significant variation in the subsurface conditions is encountered during construction, it may be necessary for BSK to review the recommendations presented herein and recommend adjustments as necessary.

2013 SEISMIC DESIGN CRITERIA

Based on the site subsurface conditions, the site may be classified as Site Class D (stiff soil profile) per the ASCE 7-10. Use of the 2013 CBC mapped seismic design criteria is considered

appropriate for this site and the following parameters should be considered applicable for the design of structural improvements:

SPECTRAL ACCELERATION PARAMETERS RISK TARGETED MAXIMUM CONSIDERED EARTHQUAKE			
Seismic Design Parameter	Value		Reference
Site Class	D		Table 20.3-1, ASCE 7-10
MCE _R Mapped Spectral Acceleration (g)	$S_S = 1.757$	$S_1 = 0.698$	USGS Mapped Values based on Figures 1613.3.1(1) and 1613.3.1(2), 2013 CBC
Site Coefficients	$F_a = 1.000$	$F_v = 1.500$	Tables 1613.3.3(1) and 1613.3.3(2), 2013 CBC
MCE _R Mapped Spectral Acceleration Adjusted for Site Class Effects (g)	$S_{MS} = 1.757$	$S_{M1} = 1.047$	Section 1613.3.3, 2013 CBC
Design Spectral Acceleration (g)	$S_{DS} = 1.172$	$S_{D1} = 0.698$	Section 1613.3.4, 2013 CBC
MCE _G peak ground acceleration adjusted for Site Class effects (g)	$PGA_M = 0.678$		Section 11.8.3, ASCE 7-10
Definitions:			
MCE _R = Risk-Targeted Maximum Considered Earthquake			
MCE _G = Maximum Considered Earthquake Geometric Mean			



BSK Associates
 324 Earhart Way
 Livermore, CA 94551
 Telephone: 925-315-3151
 Fax: 925-315-3152

LOG OF BORING NO. B-10

Project Name: **Berryessa School District Solar Array Project**
 Project Number: **G15-239-11L**
 Project Location: **Berryessa School District**
 Logged by: **G. Minerales**
 Checked by: **D. Tower**

Depth, feet	Graphic Log	Surface El.: 118 ft Location: Morrill Middle School	Samples	Sample Number	Penetration Blows / Foot	Pocket Penetrometer, TSF	% Passing No. 200 Sieve	In-Situ Dry Weight (pcf)	In-Situ Moisture Content (%)	Liquid Limit	Plastic Limit	Plasticity Index
MATERIAL DESCRIPTION												
		LEAN CLAY WITH SAND AND GRAVEL (CL): dark brownish mottled with greenish black, moist, hard, medium to high plasticity, fine subangular gravel	█	1A 1B 1C	6 8 10	>4				41	18	23
5		olive brown, increasing sand content	█	2A 2B 2C	5 7 8	2.5		107	18			
10			█	3A 3B 3C	5 7 12	>4		109	20			
15		CLAYEY SAND WITH GRAVEL (SC): yellowish brown, moist, medium dense, fine subrounded gravel	█	4A 4B 4C	6 8 11							
20		CLAYEY GRAVEL WITH SAND (GC): olive brown, moist, medium dense	█	5A 5B 5C	7 10 16							
		Boring terminated at approximately 20 feet. No free groundwater observed. Boring backfilled with cement grout.										

GEO_TARGET BERRYESSA LOGS.GPJ GEOTECHNICAL 08.GDT 4/19/16

Completion Depth: 20.0
Date Started: 2/17/16
Date Completed: 2/17/16
California Sampler: 2.5-inch inner diameter
SPT Sampler: 1.4-inch inner diameter

Drilling Equipment: Exploration GeoServices Mobile B-40
Drilling Method: Hollow Stem
Drive Weight: 140 lbs
Hole Diameter: 8-in
Drop: 30-in
Remarks:



BSK Associates
 324 Earhart Way
 Livermore, CA 94551
 Telephone: 925-315-3151
 Fax: 925-315-3152

LOG OF BORING NO. B-11


Project Name: **Berryessa School District Solar Array Project**
 Project Number: **G15-239-11L**
 Project Location: **Berryessa School District**
 Logged by: **G. Minerales**
 Checked by: **D. Tower**

Depth, feet	Graphic Log	MATERIAL DESCRIPTION	Samples	Sample Number	Penetration Blows / Foot	Pocket Penetrometer, TSF	% Passing No. 200 Sieve	In-Situ Dry Weight (pcf)	In-Situ Moisture Content (%)	Liquid Limit	Plastic Limit	Plasticity Index
		Surface El.: 122 ft Location: Morrill Middle School										
	[Hatched Pattern]	LEAN CLAY WITH SAND AND GRAVEL (CL): dark brown, moist, hard, medium to high plasticity, fine subangular gravel, rootlets	█	1A 1B 1C	8 12 18	>4		111	17			
5		SANDY LEAN CLAY (CL): olive brown, moist, hard, medium to high plasticity, fine grained sand TXUU (see Plate D-2) c=4,300 psf	█	2A 2B 2C	6 5 5	2.5		112	17			
10			█	3A 3B 3C	4 8 15	>4		114	17			
15		GRAVELLY CLAY WITH SAND (CL): yellowish brown, moist, hard, fine subangular gravel, fine and coarse sand	█	4A 4B 4C	6 8 9	>4						
20	[Dotted Pattern]	SANDY GRAVEL WITH SILT (GM): light yellowish brown, moist, dense, iron oxide staining, fine subangular gravel	█	5A 5B 5C	11 29 26							
		Boring terminated at approximately 20 feet. No free groundwater observed. Boring backfilled with cement grout.										

GEO_TARGET BERRYESSA LOGS.GPJ GEOTECHNICAL 08.GDT 4/19/16

Completion Depth: 20.0
Date Started: 2/17/16
Date Completed: 2/17/16
California Sampler: 2.5-inch inner diameter
SPT Sampler: 1.4-inch inner diameter

Drilling Equipment: Exploration GeoServices Mobile B-40
Drilling Method: Hollow Stem
Drive Weight: 140 lbs
Hole Diameter: 8-in
Drop: 30-in
Remarks:

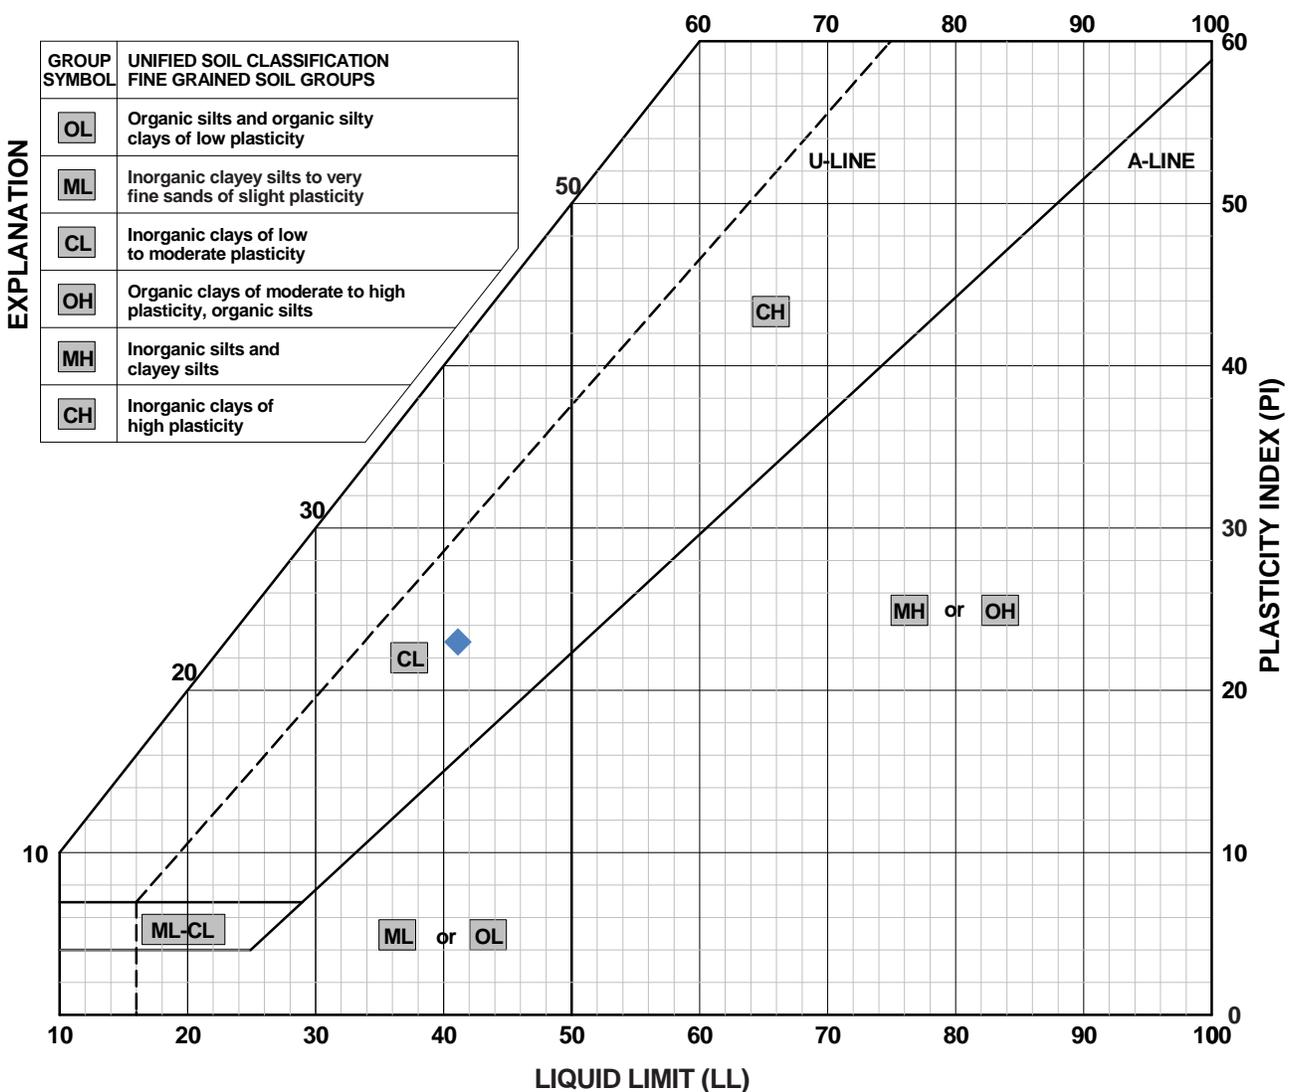

EXPLANATION

GROUP SYMBOL	UNIFIED SOIL CLASSIFICATION FINE GRAINED SOIL GROUPS
OL	Organic silts and organic silty clays of low plasticity
ML	Inorganic clayey silts to very fine sands of slight plasticity
CL	Inorganic clays of low to moderate plasticity
OH	Organic clays of moderate to high plasticity, organic silts
MH	Inorganic silts and clayey silts
CH	Inorganic clays of high plasticity

LEGEND:	SOURCE	DEPTH (ft)	LL	PL	PI	DESCRIPTION
◆	B-10	2.0	41	18	23	Brown Lean CLAY w/ Sand & Gravel (CL)

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.





PROJECT NO. G15-239-11L
DRAWN: 3/4/16
DRAWN BY: D. Tower
CHECKED BY: B. Steen
FILE NAME: Lab.indd

ATTERBERG LIMITS
Planned Solar Array Project Morrill Middle School 1970 Morrill Avenue San Jose, California

PLATE
D-1



Unconsolidated-Undrained Triaxial Test
ASTM D2850

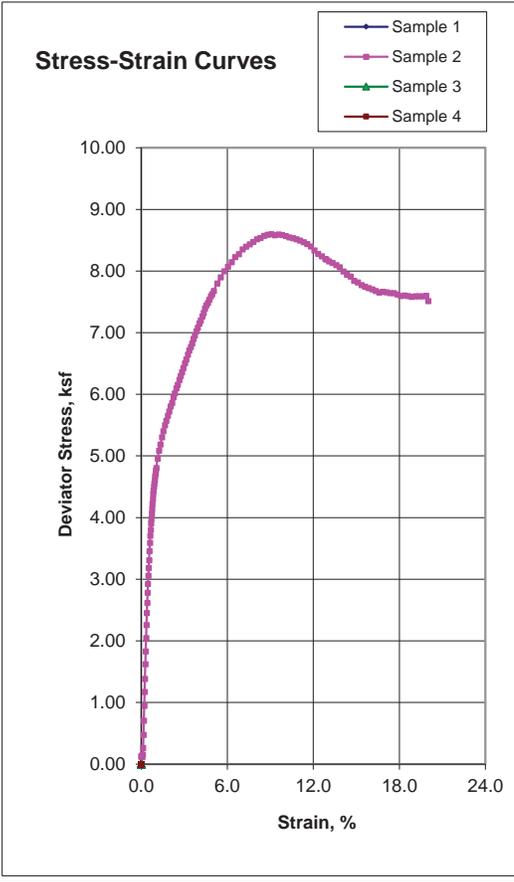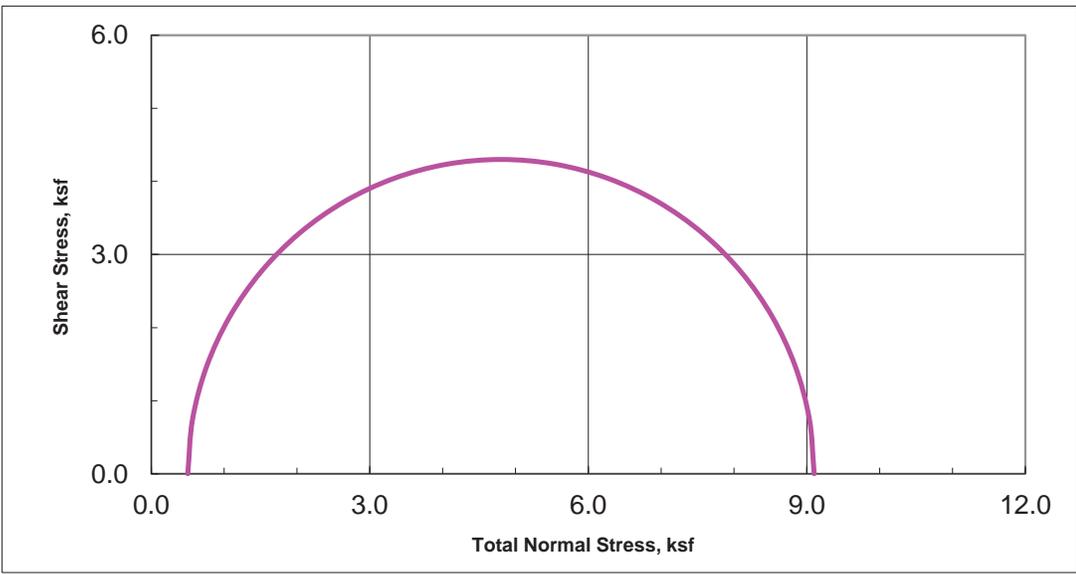

Sample Data				
	1	2	3	4
Moisture %		17.2		
Dry Den,pcf		111.6		
Void Ratio		0.511		
Saturation %		90.8		
Height in		4.99		
Diameter in		2.41		
Cell psi		3.5		
Strain %		9.07		
Deviator, ksf		8.600		
Rate %/min		1.00		
in/min		0.050		
Job No.:	664-063b			
Client:	BSK Associates			
Project:	G15-239-11L			
Boring:		B-11		
Sample:		2C		
Depth ft:		4.5		

Visual Soil Description				
Sample #				
1				
2	Dark Brown Sandy Lean CLAY			
3				
4				
Remarks:				

Note: Strengths are picked at the peak deviator stress or 15% strain which ever occurs first per ASTM D2850.

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.



PROJECT NO. G15-239-11L
 DRAWN: 3/7/16
 DRAWN BY: D. Tower
 CHECKED BY: B. Steen
 FILE NAME: Lab.indd

UNCONSOLIDATED-UNDRAINED TRIAXIAL COMPRESSION

Planned Solar Array Project
 Morrill Middle School
 1970 Morrill Avenue
 San Jose, California

PLATE

D-2

2 March, 2016

Job No. 1602189
Cust. No. 12667

Mr. Brad Steen
BSK Associates Engineers & Laboratories
324 Earhart Way
Livermore, CA 94551

Subject: Project No.: G15-239-11L
Project Name: Berryessa School District
Corrosivity Analysis – ASTM Test Methods

Dear Mr. Steen:

Pursuant to your request, CERCO Analytical has analyzed the soil samples submitted on February 23, 2016. Based on the analytical results, this brief corrosivity evaluation is enclosed for your consideration.

Based upon the resistivity measurements, samples 001, 004, 005, 007, 010 & 013 are classified as "corrosive" and samples 002, 003, 006, 008, 009, 011 & 012 are classified as "moderately corrosive". All buried iron, steel, cast iron, ductile iron, galvanized steel and dielectric coated steel or iron should be properly protected against corrosion depending upon the critical nature of the structure. All buried metallic pressure piping such as ductile iron firewater pipelines should be protected against corrosion.

The chloride ion concentrations range from none detected to 77 mg/kg. Because the chloride ion concentrations are less than 300 mg/kg, they are determined to be insufficient to attack steel embedded in a concrete mortar coating.

The sulfate ion concentrations range from none detected to 80 mg/kg and are determined to be insufficient to damage reinforced concrete structures and cement mortar-coated steel at these locations.

The pH of the soils range from 7.28 to 8.44 which does not present corrosion problems for buried iron, steel, mortar-coated steel and reinforced concrete structures.

The redox potentials range from 390 to 480-mV. Sample No. 001, 002, 003, 004, 005, 006, 007, 008, 009, 010, 012 and 013 are indicative of aerobic soil conditions, and sample 011 is indicative of potentially "slightly corrosive" soils resulting from anaerobic soil conditions.

This corrosivity evaluation is based on general corrosion engineering standards and is non-specific in nature. For specific long-term corrosion control design recommendations or consultation, please call *JDH Corrosion Consultants, Inc.* at (925) 927-6630.

We appreciate the opportunity of working with you on this project. If you have any questions, or if you require further information, please do not hesitate to contact us.

Very truly yours,
CERCO ANALYTICAL, INC.



J. Darby Howard, Jr., P.E.
President


JDH/jdl
Enclosure

Client: BSK Associates Engineers & Laboratories
 Client's Project No.: G-15-239-11L
 Client's Project Name: Berryessa School District
 Date Sampled: 23-Feb-16
 Date Received: 23-Feb-16
 Matrix: Soil
 Authorization: Signed Chain of Custody

Date of Report: 2-Mar-2016

Job/Sample No.	Sample I.D.	Redox (mV)	pH	Conductivity (umhos/cm)*	Resistivity (100% Saturation) (ohms-cm)	Sulfide (mg/kg)*	Chloride (mg/kg)*	Sulfate (mg/kg)*
1602189-001	B-2 @ 1'-3'	460	7.93	-	1,000	-	77	80
1602189-002	B-3 @ 1'-3'	420	8.21	-	2,600	-	N.D.	N.D.
1602189-003	B-6 @ 1'-3'	410	7.28	-	2,500	-	N.D.	N.D.
1602189-004	B-8 @ 1'-3'	400	8.44	-	1,700	-	N.D.	73
1602189-005	B-10 @ 1'-3'	440	8.24	-	1,400	-	35	44
1602189-006	B-12 @ 1'-2'	430	8.01	-	2,300	-	N.D.	N.D.
1602189-007	B-14 @ 1'-3'	420	8.14	-	1,700	-	N.D.	28
1602189-008	B-16 @ 1'-2'	410	7.37	-	2,900	-	N.D.	N.D.
1602189-009	B-19 @ 1'-2'	420	7.85	-	4,300	-	N.D.	N.D.
1602189-010	B-20 @ 1'-3'	410	7.72	-	700	-	37	76
1602189-011	B-23 @ 1'-3'	390	7.74	-	2,900	-	N.D.	23
1602189-012	B-26 @ 1'-3'	480	8.18	-	2,400	-	25	35
1602189-013	B-30 @ 1'-3'	460	8.12	-	1,600	-	44	45

Method:	ASTM D1498	ASTM D4972	ASTM D1125M	ASTM G57	ASTM D4658M	ASTM D4327	ASTM D4327
Reporting Limit:	-	-	10	-	50	15	15
	1-Mar-2016	1-Mar-2016	-	1-Mar-2016	-	1-Mar-2016	1-Mar-2016

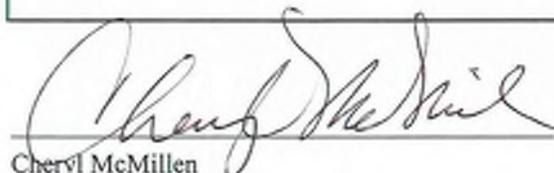


Cheryl McMillen
 Laboratory Director

* Results Reported on "As Received" Basis

N.D. - None Detected

APPENDIX E

NOBLE ELEMENTARY SCHOOL



References: 1. <http://earth.google.com>, 2015

Legend
 Approximate Boring Location (BSK, 2016)

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.

	PROJECT NO. G15-239-11L	SITE PLAN	PLATE E
	DRAWN: 02/23/16		
	DRAWN BY: B. Steen	Planned Solar Array Project Noble Elementary School 3466 Grossmont Drive San Jose, California	
	CHECKED BY: C. Foulk		
FILE NAME: SitePlan.indd			

SITE DESCRIPTION

Noble Elementary School is located at 3466 Grossmont Drive in San Jose, California. The school is located in a residential neighborhood on the eastern fringe of San Jose. The approximately 10 acre site is rectangular in shape and is bounded by Noble Park to the west, residential housing to the north, and Grossmont Drive and Noble Avenue to the east and south, respectively. The school buildings and asphalt paved play courts lie in the northern half of the parcel. A grassy playfield occupies the southern portion of the campus. The proposed location of the arrays will border the play courts, as shown on Plate E.

Topography of the site, as well as the proposed array locations, is generally flat with elevation of approximately 224 feet above mean sea level. The planned arrays will not be located near any slopes.

SUBSURFACE CONDITIONS

We drilled two subsurface borings (B-12 and B-13) to a depth of about 20 feet deep (see Plate E for approximate locations). Our borings encountered lean to fat, sandy clays with varying gravel content to 20 feet. The clays are firm to hard.

Groundwater was not encountered in our borings to a depth 20 feet below the ground surface. Historical high groundwater in the area has been measured at a depth greater than 50 feet below grade. It should be noted that the groundwater level can fluctuate depending on factors such as seasonal rainfall, groundwater withdrawal, and construction activities on this or adjacent properties.

The above is a general description of soil and groundwater conditions encountered at the site in the borings for this investigation. For a more detailed description of the soils encountered, refer to the attached boring logs.

It should be noted that soil and subsurface conditions can deviate from those conditions encountered at the boring locations. If significant variation in the subsurface conditions is encountered during construction, it may be necessary for BSK to review the recommendations presented herein and recommend adjustments as necessary.

2013 SEISMIC DESIGN CRITERIA

Based on the site subsurface conditions, the site may be classified as Site Class D (stiff soil profile) per the ASCE 7-10. Use of the 2013 CBC mapped seismic design criteria is considered appropriate for this site and the following parameters should be considered applicable for the design of structural improvements:

SPECTRAL ACCELERATION PARAMETERS		
RISK TARGETED MAXIMUM CONSIDERED EARTHQUAKE		
Seismic Design Parameter	Value	Reference
Site Class	D	Table 20.3-1, ASCE 7-10
MCE _R Mapped Spectral Acceleration (g)	S _S = 1.625 S ₁ = 0.626	USGS Mapped Values based on Figures 1613.3.1(1) and 1613.3.1(2), 2013 CBC
Site Coefficients	F _a = 1.000 F _v = 1.500	Tables 1613.3.3(1) and 1613.3.3(2), 2013 CBC
MCE _R Mapped Spectral Acceleration Adjusted for Site Class Effects (g)	S _{MS} = 1.625 S _{M1} = 0.939	Section 1613.3.3, 2013 CBC
Design Spectral Acceleration (g)	S _{DS} = 1.083 S _{D1} = 0.626	Section 1613.3.4, 2013 CBC
MCE _G peak ground acceleration adjusted for Site Class effects (g)	PGA _M = 0.624	Section 11.8.3, ASCE 7-10
Definitions:		
MCE _R = Risk-Targeted Maximum Considered Earthquake		
MCE _G = Maximum Considered Earthquake Geometric Mean		



BSK Associates
 324 Earhart Way
 Livermore, CA 94551
 Telephone: 925-315-3151
 Fax: 925-315-3152

LOG OF BORING NO. B-12

Project Name: **Berryessa School District Solar Array Project**
 Project Number: **G15-239-11L**
 Project Location: **Berryessa School District**
 Logged by: **D. Tower**
 Checked by:

Depth, feet	Graphic Log	Surface El.: 222 ft Location: Noble Elementary School	Samples	Sample Number	Penetration Blows / Foot	Pocket Penetrometer, TSF	% Passing No. 200 Sieve	In-Situ Dry Weight (pcf)	In-Situ Moisture Content (%)	Liquid Limit	Plastic Limit	Plasticity Index	
MATERIAL DESCRIPTION													
		<p>SANDY LEAN CLAY WITH GRAVEL (CL): dark brown, moist, high plasticity, fine grained sands, fine subrounded and rounded gravel, rootlets</p> <p>grading into more clay content, decreasing gravel content and gravel size TXUU (see Plate E-2) c=1,750 psf</p>	1A	4	2.75	100	19						
			1B	7									
			1C	8									
5					2A	4	2.5	98	23				
			2B	9									
			2C	13									
				<p>FAT CLAY WITH SAND (CH): dark brown, moist, high plasticity, firm to hard</p>	3A	4	3.25	107	20				
			3B		10								
			3C		11								
				<p>SANDY LEAN CLAY WITH SILT (CL): yellowish brown mottled with olive yellow, moist, hard, medium plasticity, fine grained sands, tan sandy streaks</p> <p>slightly cemented, iron oxide present</p>	4A	10	4.0						
	4B	12											
	4C	25											
			5A		7	>4.5							
	5B	13											
	5C	24											
20		Boring terminated at approximately 20 feet. No free groundwater observed. Boring backfilled with cement grout.											

GEO_TARGET BERRYESSA LOGS.GPJ GEOTECHNICAL 08.GDT 4/19/16

Completion Depth: 20.0
Date Started: 2/20/16
Date Completed: 2/20/16
California Sampler: 2.5-inch inner diameter
SPT Sampler: 1.4-inch inner diameter

Drilling Equipment: Exploration GeoServices Mobile B-40
Drilling Method: Hollow Stem
Drive Weight: 140 lbs
Hole Diameter: 8-in
Drop: 30-in
Remarks:



BSK Associates
 324 Earhart Way
 Livermore, CA 94551
 Telephone: 925-315-3151
 Fax: 925-315-3152

LOG OF BORING NO. B-13

Project Name: **Berryessa School District Solar Array Project**
 Project Number: **G15-239-11L**
 Project Location: **Berryessa School District**
 Logged by: **D. Tower**
 Checked by:


Depth, feet	Graphic Log	Surface El.: 226 ft Location: Noble Elementary School	Samples	Sample Number	Penetration Blows / Foot	Pocket Penetrometer, TSF	% Passing No. 200 Sieve	In-Situ Dry Weight (pcf)	In-Situ Moisture Content (%)	Liquid Limit	Plastic Limit	Plasticity Index
MATERIAL DESCRIPTION												
	[Hatched Box]	SANDY LEAN CLAY WITH GRAVEL (CL): olive brown, moist, firm to hard, high plasticity, fine grained sand, fine subangular gravel	[Black Box]	1A 1B 1C	5 5 6	2.5-3.5				47	17	30
5		fine subrounded and rounded gravel, grading to very little gravel content	[Black Box]	2A 2B 2C	4 7 13	2.5-4.0		99	21			
10		yellowish brown, firm, medium plasticity, fine grained sand, no gravel present	[Black Box]	3A 3B 3C	4 8 13	3.0		104	23			
15		fine coarse subrounded gravel, hard	[Black Box]	4A 4B 4C	6 13 25	>4.5						
20		Boring terminated at approximately 20 feet. No free groundwater observed. Boring backfilled with cement grout.	[Black Box]	5A 5B 5C	4 11 20	>4.5						

GEO_TARGET BERRYESSA LOGS.GPJ GEOTECHNICAL 08.GDT 4/19/16

Completion Depth: 20.0 Date Started: 2/20/16 Date Completed: 2/20/16 California Sampler: 2.5-inch inner diameter SPT Sampler: 1.4-inch inner diameter	Drilling Equipment: Exploration GeoServices Mobile B-40 Drilling Method: Hollow Stem Drive Weight: 140 lbs Hole Diameter: 8-in Drop: 30-in Remarks:
--	--

EXPLANATION

GROUP SYMBOL	UNIFIED SOIL CLASSIFICATION FINE GRAINED SOIL GROUPS
OL	Organic silts and organic silty clays of low plasticity
ML	Inorganic clayey silts to very fine sands of slight plasticity
CL	Inorganic clays of low to moderate plasticity
OH	Organic clays of moderate to high plasticity, organic silts
MH	Inorganic silts and clayey silts
CH	Inorganic clays of high plasticity

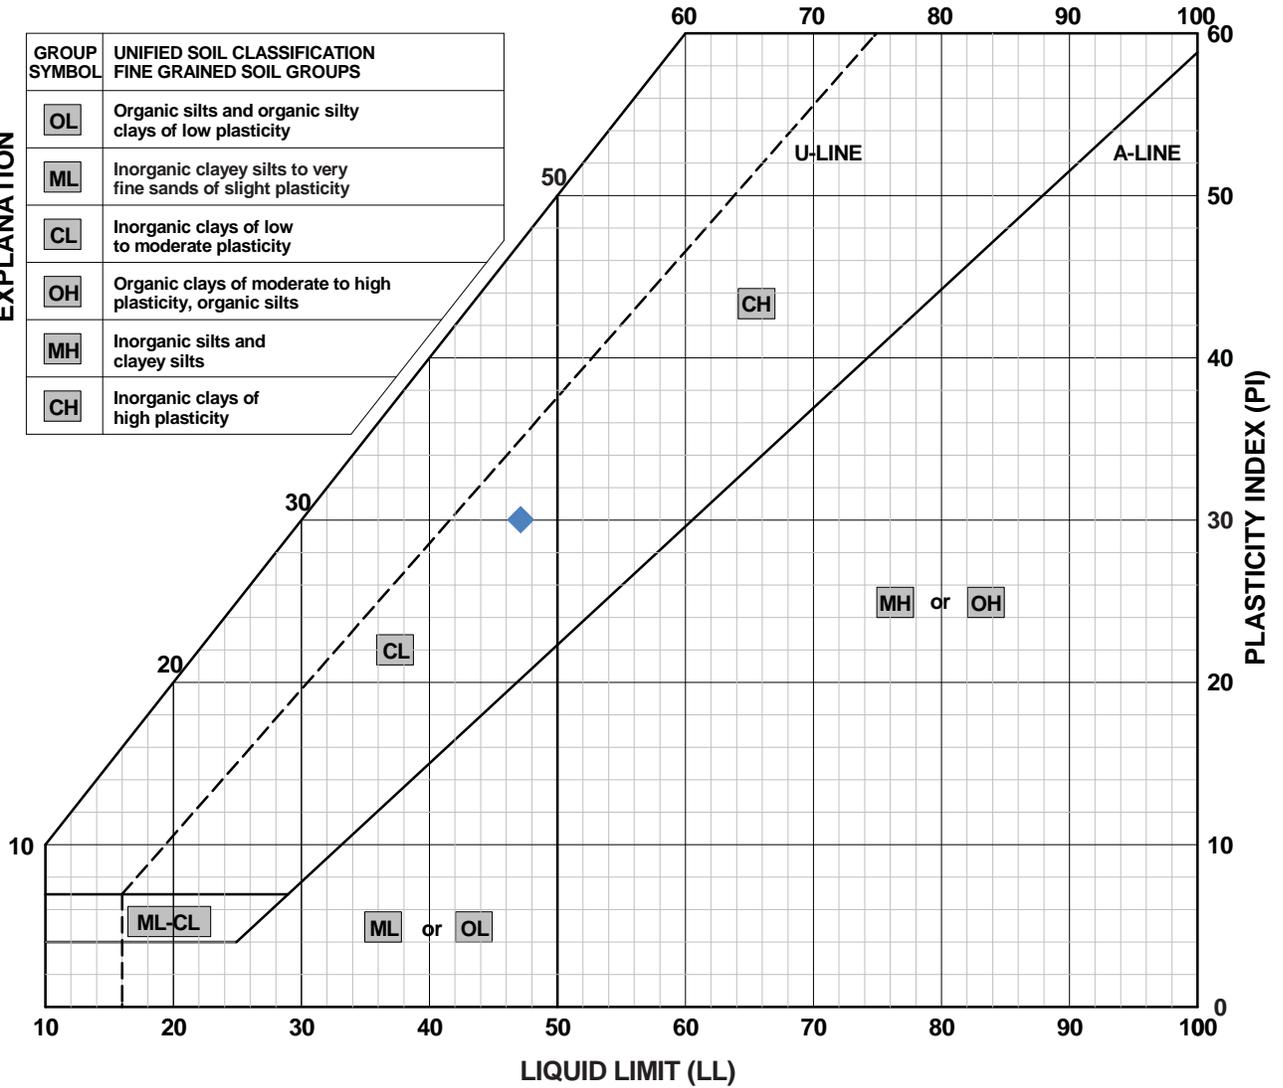

LEGEND:	SOURCE	DEPTH (ft)	LL	PL	PI	DESCRIPTION
◆	B-13	2.0	47	17	30	Brown Sandy Lean CLAY w/ Gravel (CL)

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.



PROJECT NO. G15-239-11L
 DRAWN: 3/4/16
 DRAWN BY: D. Tower
 CHECKED BY: B. Steen
 FILE NAME: Lab.indd

ATTERBERG LIMITS



Planned Solar Array Project
 Noble Elementary School
 3466 Grossmont Drive
 San Jose, California

PLATE

F-1



Unconsolidated-Undrained Triaxial Test
ASTM D2850

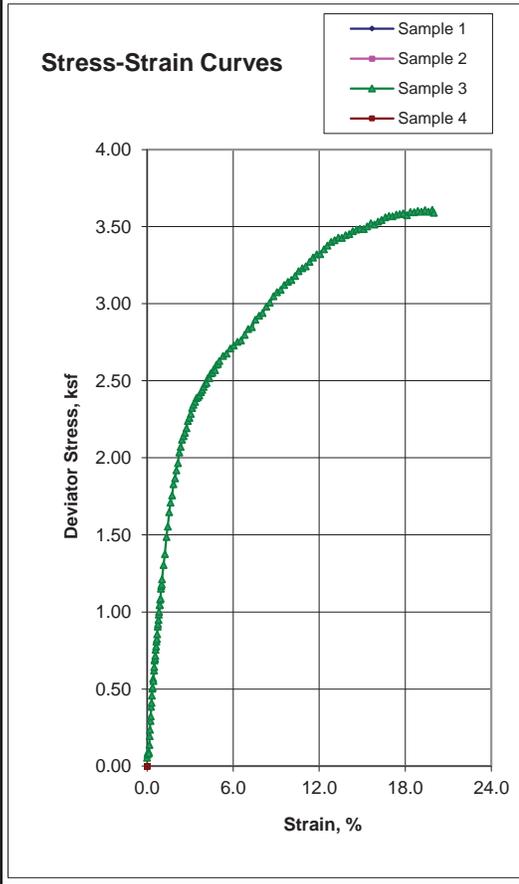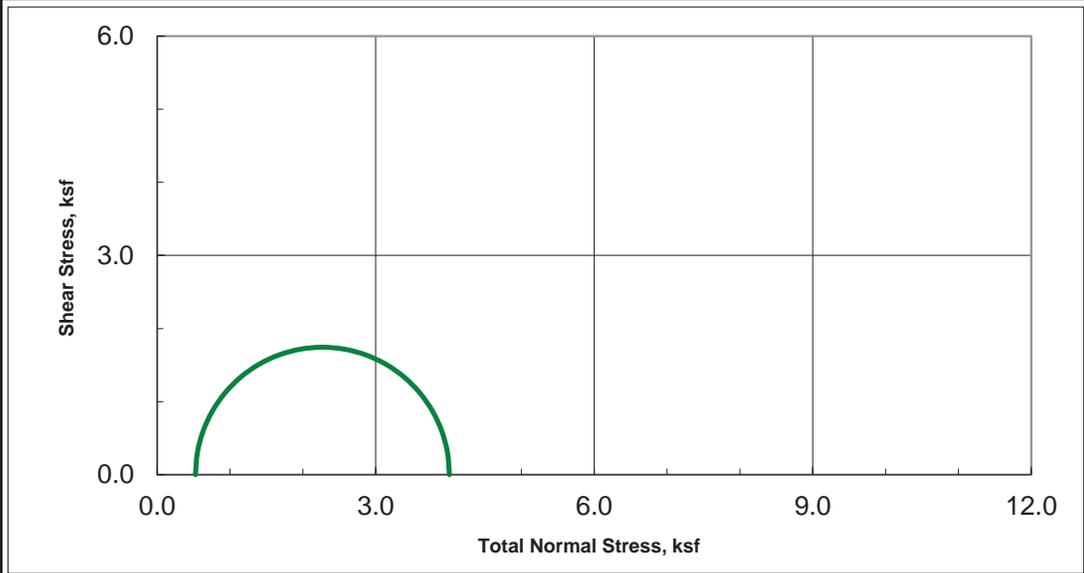

Sample Data				
	1	2	3	4
Moisture %			23.3	
Dry Den,pcf			97.7	
Void Ratio			0.726	
Saturation %			86.8	
Height in			5.01	
Diameter in			2.40	
Cell psi			3.6	
Strain %			15.00	
Deviator, ksf			3.487	
Rate %/min			1.00	
in/min			0.050	
Job No.:	664-063b			
Client:	BSK Associates			
Project:	G15-239-11L			
Boring:			B-12	
Sample:			2C	
Depth ft:			4.5	

Visual Soil Description				
Sample #				
1				
2				
3	Dark Brown Sandy Lean CLAY w/ Gravel			
4				
Remarks:				

Note: Strengths are picked at the peak deviator stress or 15% strain which ever occurs first per ASTM D2850.

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.



PROJECT NO. G15-239-11L
 DRAWN: 3/7/16
 DRAWN BY: D. Tower
 CHECKED BY: B. Steen
 FILE NAME: Lab.indd

UNCONSOLIDATED-UNDRAINED TRIAXIAL COMPRESSION

Planned Solar Array Project
 Noble Elementary School
 3466 Grossmont Drive
 San Jose, California

PLATE
F-2

2 March, 2016

Job No. 1602189
Cust. No. 12667

Mr. Brad Steen
BSK Associates Engineers & Laboratories
324 Earhart Way
Livermore, CA 94551

Subject: Project No.: G15-239-11L
Project Name: Berryessa School District
Corrosivity Analysis – ASTM Test Methods

Dear Mr. Steen:

Pursuant to your request, CERCO Analytical has analyzed the soil samples submitted on February 23, 2016. Based on the analytical results, this brief corrosivity evaluation is enclosed for your consideration.

Based upon the resistivity measurements, samples 001, 004, 005, 007, 010 & 013 are classified as "corrosive" and samples 002, 003, 006, 008, 009, 011 & 012 are classified as "moderately corrosive". All buried iron, steel, cast iron, ductile iron, galvanized steel and dielectric coated steel or iron should be properly protected against corrosion depending upon the critical nature of the structure. All buried metallic pressure piping such as ductile iron firewater pipelines should be protected against corrosion.

The chloride ion concentrations range from none detected to 77 mg/kg. Because the chloride ion concentrations are less than 300 mg/kg, they are determined to be insufficient to attack steel embedded in a concrete mortar coating.

The sulfate ion concentrations range from none detected to 80 mg/kg and are determined to be insufficient to damage reinforced concrete structures and cement mortar-coated steel at these locations.

The pH of the soils range from 7.28 to 8.44 which does not present corrosion problems for buried iron, steel, mortar-coated steel and reinforced concrete structures.

The redox potentials range from 390 to 480-mV. Sample No. 001, 002, 003, 004, 005, 006, 007, 008, 009, 010, 012 and 013 are indicative of aerobic soil conditions, and sample 011 is indicative of potentially "slightly corrosive" soils resulting from anaerobic soil conditions.

This corrosivity evaluation is based on general corrosion engineering standards and is non-specific in nature. For specific long-term corrosion control design recommendations or consultation, please call *JDH Corrosion Consultants, Inc. at (925) 927-6630.*

We appreciate the opportunity of working with you on this project. If you have any questions, or if you require further information, please do not hesitate to contact us.

Very truly yours,
CERCO ANALYTICAL, INC.


J. Darby Howard, Jr., P.E.
President

JDH/jdl
Enclosure


Client: BSK Associates Engineers & Laboratories
 Client's Project No.: G-15-239-11L
 Client's Project Name: Berryessa School District
 Date Sampled: 23-Feb-16
 Date Received: 23-Feb-16
 Matrix: Soil
 Authorization: Signed Chain of Custody

1100 Willow Pass Court, Suite A
 Concord, CA 94520-1006
 925 462 2771 Fax. 925 462 2775
 www.cercoanalytical.com

Date of Report: 2-Mar-2016

Job/Sample No.	Sample I.D.	Redox (mV)	pH	Conductivity (umhos/cm)*	Resistivity (100% Saturation) (ohms-cm)	Sulfide (mg/kg)*	Chloride (mg/kg)*	Sulfate (mg/kg)*
1602189-001	B-2 @ 1'-3'	460	7.93	-	1,000	-	77	80
1602189-002	B-3 @ 1'-3'	420	8.21	-	2,600	-	N.D.	N.D.
1602189-003	B-6 @ 1'-3'	410	7.28	-	2,500	-	N.D.	N.D.
1602189-004	B-8 @ 1'-3'	400	8.44	-	1,700	-	N.D.	73
1602189-005	B-10 @ 1'-3'	440	8.24	-	1,400	-	35	44
1602189-006	B-12 @ 1'-2'	430	8.01	-	2,300	-	N.D.	N.D.
1602189-007	B-14 @ 1'-3'	420	8.14	-	1,700	-	N.D.	28
1602189-008	B-16 @ 1'-2'	410	7.37	-	2,900	-	N.D.	N.D.
1602189-009	B-19 @ 1'-2'	420	7.85	-	4,300	-	N.D.	N.D.
1602189-010	B-20 @ 1'-3'	410	7.72	-	700	-	37	76
1602189-011	B-23 @ 1'-3'	390	7.74	-	2,900	-	N.D.	23
1602189-012	B-26 @ 1'-3'	480	8.18	-	2,400	-	25	35
1602189-013	B-30 @ 1'-3'	460	8.12	-	1,600	-	44	45

Method:	ASTM D1498	ASTM D4972	ASTM D1125M	ASTM G57	ASTM D4658M	ASTM D4327	ASTM D4327
Reporting Limit:	-	-	10	-	50	15	15
	1-Mar-2016	1-Mar-2016	-	1-Mar-2016	-	1-Mar-2016	1-Mar-2016

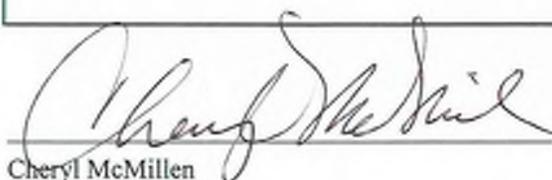

Cheryl McMillen

Laboratory Director

* Results Reported on "As Received" Basis
 N.D. - None Detected

APPENDIX F


PIEDMONT MIDDLE SCHOOL



References: 1. <http://earth.google.com>, 2015

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.

Legend



Approximate Boring Location (BSK, 2016)

Approximate Boring Location (Earth Systems, 2015)

	PROJECT NO. G15-239-11L	SITE PLAN	PLATE F
	DRAWN: 02/23/16		
	DRAWN BY: B. Steen	Planned Solar Array Project Piedmont Middle School 955 Piedmont Road San Jose, California	
	CHECKED BY: C. Foulk		
FILE NAME: SitePlan.indd			

SITE DESCRIPTION

Piedmont Middle School is located at 955 Piedmont Road in San Jose, California. The site is located in a residential and mixed commercial neighborhood. The approximately 22 acre parcel is rectangular in shape and bordered to the south and west by Penitencia Park, and Flanders Drive and Piedmont Road to the north and east, respectively. The eastern half of the parcel is occupied by the campus buildings, asphalt paved parking areas and play courts, and the District's Maintenance and Operations Yard. The western half of the campus is an athletic track and grassy play fields. One of the proposed arrays is located in the southern play courts and a second array will be located in District Maintenance and Operations parking lot. Plate F shows the approximate locations of the arrays.

Topography of the site, as well as the proposed array locations, is generally flat with elevation of approximately 204 feet above mean sea level. The planned arrays will not be located near any slopes.

SUBSURFACE CONDITIONS

We drilled three subsurface borings (B-15 through B-17) to a depth of about 20 feet deep. Our borings encountered firm to hard, lean to fat clays with varying sand and gravel content to a depth of about 9 feet. Below the clays, we encountered clayey sands and gravels, and poorly graded sands to a depth of 20 feet. Minor interbeds of clay were encountered throughout the borings.

In addition, we reviewed borings performed by others⁵ proximate to the planned arrays. These borings were considered in our investigation and are appended to BSK's boring logs.

Groundwater was not encountered in our borings to a depth 20 feet below the ground surface. Historical high groundwater in the area has been measured at greater than 50 feet below grade. It should be noted that the groundwater level can fluctuate depending on factors such as seasonal rainfall, groundwater withdrawal, and construction activities on this or adjacent properties.

⁵ "Geologic Hazards Evaluation and Geotechnical Engineering Study, Berryessa Union School District, New Central Kitchen Facility, 945 Piedmont Road, San Jose", by Earth Systems Pacific, dated June 24, 2015.

The above is a general description of soil and groundwater conditions encountered at the site in the borings for this investigation. For a more detailed description of the soils encountered, refer to the attached boring logs.

It should be noted that soil and subsurface conditions can deviate from those conditions encountered at the boring locations. If significant variation in the subsurface conditions is encountered during construction, it may be necessary for BSK to review the recommendations presented herein and recommend adjustments as necessary. .

2013 SEISMIC DESIGN CRITERIA

Based on the site subsurface conditions, the site may be classified as Site Class D (stiff soil profile) per the ASCE 7-10. Use of the 2013 CBC mapped seismic design criteria is considered appropriate for this site and the following parameters should be considered applicable for the design of structural improvements:

SPECTRAL ACCELERATION PARAMETERS RISK TARGETED MAXIMUM CONSIDERED EARTHQUAKE			
Seismic Design Parameter	Value		Reference
Site Class	D		Table 20.3-1, ASCE 7-10
MCE _R Mapped Spectral Acceleration (g)	S _S = 1.584	S ₁ = 0.614	USGS Mapped Values based on Figures 1613.3.1(1) and 1613.3.1(2), 2013 CBC
Site Coefficients	F _a = 1.000	F _v = 1.500	Tables 1613.3.3(1) and 1613.3.3(2), 2013 CBC
MCE _R Mapped Spectral Acceleration Adjusted for Site Class Effects (g)	S _{MS} = 1.584	S _{M1} = 0.921	Section 1613.3.3, 2013 CBC
Design Spectral Acceleration (g)	S _{DS} = 1.056	S _{D1} = 0.614	Section 1613.3.4, 2013 CBC
MCE _G peak ground acceleration adjusted for Site Class effects (g)	PGA _M = 0.611		Section 11.8.3, ASCE 7-10
Definitions:			
MCE _R = Risk-Targeted Maximum Considered Earthquake			
MCE _G = Maximum Considered Earthquake Geometric Mean			



BSK Associates
 324 Earhart Way
 Livermore, CA 94551
 Telephone: 925-315-3151
 Fax: 925-315-3152

LOG OF BORING NO. B-15

Project Name: **Berryessa School District Solar Array Project**
 Project Number: **G15-239-11L**
 Project Location: **Berryessa School District**
 Logged by: **D. Tower**
 Checked by:

Depth, feet	Graphic Log	Surface El.: 206 ft Location: Piedmont Middle School	Samples	Sample Number	Penetration Blows / Foot	Pocket Penetrometer, TSF	% Passing No. 200 Sieve	In-Situ Dry Weight (pcf)	In-Situ Moisture Content (%)	Liquid Limit	Plastic Limit	Plasticity Index		
MATERIAL DESCRIPTION														
		SANDY LEAN CLAY WITH GRAVEL (CL): dark olive brown, moist, firm, low to medium plasticity, fine and coarse grained sand, fine gravel		1A	4	3.75								
				1B	4									
				1C	5									
5						2A	4	3.75		110	18			
					2B	9								
					2C	13								
				CLAYEY SAND WITH GRAVEL (SC): yellowish brown, moist, medium dense, fine to coarse sands, fine subrounded gravel		3A	4	4.0		118	11			
						3B	13							
						3C	21							
						4A	7							
				4B	9									
				4C	12									
				5A	12									
				5B	14									
				5C	15									
20		Boring terminated at approximately 20 feet. No free groundwater observed. Boring backfilled with cement grout.												

GEO_TARGET BERRYESSA LOGS.GPJ GEOTECHNICAL 08.GDT 4/19/16

Completion Depth: 20.0
Date Started: 2/20/16
Date Completed: 2/20/16
California Sampler: 2.5-inch inner diameter
SPT Sampler: 1.4-inch inner diameter

Drilling Equipment: Exploration GeoServices Mobile B-40
Drilling Method: Hollow Stem
Drive Weight: 140 lbs
Hole Diameter: 8-in
Drop: 30-in
Remarks:



BSK Associates
 324 Earhart Way
 Livermore, CA 94551
 Telephone: 925-315-3151
 Fax: 925-315-3152

LOG OF BORING NO. B-16

Project Name: **Berryessa School District Solar Array Project**
 Project Number: **G15-239-11L**
 Project Location: **Berryessa School District**
 Logged by: **D. Tower**
 Checked by:

Depth, feet	Graphic Log	Surface El.: 203 ft Location: Piedmont Middle School	Samples	Sample Number	Penetration Blows / Foot	Pocket Penetrometer, TSF	% Passing No. 200 Sieve	In-Situ Dry Weight (pcf)	In-Situ Moisture Content (%)	Liquid Limit	Plastic Limit	Plasticity Index
MATERIAL DESCRIPTION												
		SANDY LEAN CLAY (CL): brown, moist, firm, low to moderate plasticity, fine grained sands		1A 1B 1C	7 7 12	1.75				34	17	17
5		TXUU (see Plate F-2) c=1,300 psf		2A 2B 2C	6 8 10	2.0		107	20			
10		POORLY GRADED SAND WITH GRAVEL (SP): brown (multicolored), moist, dense, non-plastic, fine and coarse grained sand, fine subangular and subrounded gravel		3A 3B 3C	12 14 16							
15		very dense, cemented structure		4A 4B 4C	19 50 / 6"							
20		POORLY GRADED SAND WITH CLAY AND GRAVEL (SP-SC): multicolored, moist, dense, highly weathered sandstone material		5A 5B 5C	16 19 27							
		Boring terminated at approximately 20 feet. No free groundwater observed. Boring backfilled with cement grout.										

GEO_TARGET BERRYESSA LOGS.GPJ GEOTECHNICAL 08.GDT 4/19/16

Completion Depth: 20.0
Date Started: 2/20/16
Date Completed: 2/20/16
California Sampler: 2.5-inch inner diameter
SPT Sampler: 1.4-inch inner diameter

Drilling Equipment: Exploration GeoServices Mobile B-40
Drilling Method: Hollow Stem
Drive Weight: 140 lbs
Hole Diameter: 8-in
Drop: 30-in
Remarks:



BSK Associates
 324 Earhart Way
 Livermore, CA 94551
 Telephone: 925-315-3151
 Fax: 925-315-3152

LOG OF BORING NO. B-17

Project Name: **Berryessa School District Solar Array Project**
 Project Number: **G15-239-11L**
 Project Location: **Berryessa School District**
 Logged by: **D. Tower**
 Checked by:

Depth, feet	Graphic Log	Surface El.: 203 ft Location: Piedmont Middle School	Samples	Sample Number	Penetration Blows / Foot	Pocket Penetrometer, TSF	% Passing No. 200 Sieve	In-Situ Dry Weight (pcf)	In-Situ Moisture Content (%)	Liquid Limit	Plastic Limit	Plasticity Index
MATERIAL DESCRIPTION												
		SANDY LEAN CLAY WITH GRAVEL (CL): olive brown, moist, hard, medium plasticity, fine subrounded and subangular gravel	█	1A 1B 1C	6 11 15	3.25-4.5		118	11			
5		firm, fine gravel TXUU (see Plate F-2) c=1,800 psf	█	2A 2B 2C	5 10 14	2.5-3.5		109	20			
		cemented-like structure	█	3A 3B 3C	12 18 34	>4.5		129	10			
		yellowish brown	█	4A 4B 4C	6 12 18							
15		POORLY GRADED SAND WITH CLAY AND GRAVEL (SP-SC): multicolored, moist, dense, highly weathered sandstone material	█	5A 5B 5C	16 28 35							
20		Boring terminated at approximately 20 feet. No free groundwater observed. Boring backfilled with cement grout.										

GEO_TARGET BERRYESSA LOGS.GPJ GEOTECHNICAL 08.GDT 4/19/16

Completion Depth: 20.0
Date Started: 2/20/16
Date Completed: 2/20/16
California Sampler: 2.5-inch inner diameter
SPT Sampler: 1.4-inch inner diameter

Drilling Equipment: Exploration GeoServices Mobile B-40
Drilling Method: Hollow Stem
Drive Weight: 140 lbs
Hole Diameter: 8-in
Drop: 30-in
Remarks:



Earth Systems Pacific

LOGGED BY: Xyrus Mejia
 DRILL RIG: Mobile B-40
 AUGER TYPE: Hollow Stem

Boring No. 1
 PAGE 1 OF 1
 JOB NO.: SH-12771-SA
 DATE: 5/8/15

DEPTH (feet)	USCS CLASS	SYMBOL	SOIL DESCRIPTION	SAMPLE DATA						
				INTERVAL (feet)	SAMPLE NUMBER	SAMPLE TYPE	DRY DENSITY (pcf)	MOISTURE (%)	BLOWS PER 6 IN.	POCKET PEN (t.s.f)
0			Surface: Tanbark (landscaping area)							
1	CL		Lean CLAY with sand, brown to dark brown, stiff, moist							
2			[LL=34, PI=18]]	1.0-2.5	1-1		101.2	14.7	5 6 7	3.5
3										
4									9 17	
5			-same, very stiff	3.5-5.0	1-2		109.4	18.2	23	3.5
6										
7										
8										
9	SC/ CL		Clayey SAND with gravel to sandy lean CLAY with gravel, brown to reddish brown, dense/hard, moist; gravels are subangular, gravel fraction fine to coarse						50 34	
10	CL		Sandy lean CLAY with gravel, brown to reddish brown, very stiff, moist; trace subrounded sandstone gravels	8.5-10.0	1-3		112.4	14.9	27	
11										
12										
13										
14									14 20	
15			-increasing amount of subrounded fine sandstone gravels and fine gravels, hard	13.5-15.0	1-4		121.1	13.6	30	
16										
17										
18										
19	GC		Clayey GRAVEL with sand, brown, dense to very dense, moist; trace decomposed wood (charcoal), thin sandy clay lenses throughout, cobble in shoe						34 47	
20				18.5-20.0	1-5		106.4	12.4	50/2	
21										
22										
23										
24	GC/ SC		Sandstone gravels/cobbles in a matrix of sandy lean clay to clayey sand; yellow brown sandstone, brown to gray brown sandy lean clay, very dense, moist						21 35	
25				23.5-25.0	1-6		-	11.5	37	
26										

LEGEND: 2.5" Mod Cal Sample Bulk Sample 2.0" Mod Cal Sample SPT

NOTE: This log of subsurface conditions is a simplification of actual conditions encountered. It applies at the location and time of drilling. Subsurface conditions may differ at other locations and times.



Earth Systems Pacific

LOGGED BY: Xyrus M.
 DRILL RIG: Mobile B-53
 AUGER TYPE: Hollow Stem

Boring No. 1
 PAGE 2 OF 2
 JOB NO.: SH-12771-SA
 DATE: 5/8/15

DEPTH (feet)	USCS CLASS	SYMBOL	Berryessa Union School District New Central Kitchen Facility 945 Piedmont Road San Jose, California	SAMPLE DATA						
				INTERVAL (feet)	SAMPLE NUMBER	SAMPLE TYPE	DRY DENSITY (pcf)	MOISTURE (%)	BLOWS PER 6 IN.	POCKET PEN (t.s.f)
SOIL DESCRIPTION										
27	GC/SC		(see previous description)							
28										
29	SC		Clayey SAND with gravel, brown, dense, moist						27	
30				28.5-30.0	1-7		-	-	41	
31			End of boring at 30 feet Groundwater not encountered						23	
32										
33										
34										
35										
36										
37										
38										
39										
40										
41										
42										
43										
44										
45										
46										
47										
48										
49										
50										
51										
52										
53										

LEGEND: 2.5" Mod Cal Sample Shelby Tube Sample SPT

NOTE: This log of subsurface conditions is a simplification of actual conditions encountered. It applies at the location and time of drilling. Subsurface conditions may differ at other locations and times.



LOGGED BY: Xyrus Mejia
 DRILL RIG: Mobile B-40
 AUGER TYPE: Hollow Stem

PAGE 1 OF 1
 JOB NO.: SH-12771-SA
 DATE: 5/8/15


DEPTH (feet)	USCS CLASS	SYMBOL	Berryessa Union School District New Central Kitchen Facility 945 Piedmont Road San Jose, California SOIL DESCRIPTION	SAMPLE DATA						
				INTERVAL (feet)	SAMPLE NUMBER	SAMPLE TYPE	DRY DENSITY (pcf)	MOISTURE (%)	BLOWS PER 6 IN.	POCKET PEN (t.s.f)
0			Surface: 2.5 inches AC/4 inches AB Clayey SAND to Silty SAND, yellow brown, loose, moist [FILL]							
1										
2	CL		Lean CLAY, brown, stiff, moist	1.0-2.5	2-1	█	107.9	18.4	3 4 8	2.0
3										
4										
5			-very stiff	3.5-5.0	2-2	█	107.9	18.1	8 12 17	3.5
6										
7										
8										
9	SC		Clayey SAND with gravel, light brown to brown, hard/dense, moist; subrounded fine to medium sand, trace fine angular and subangular sandstone gravels [Passing No. 200 = 16%]	8.5-10.0	2-3	█	124.6	10.8	20 25 37	
10										
11										
12										
13										
14	CL		Lean CLAY with sand and gravel, orange brown, moist, very stiff; trace fine and coarse gravels	13.5-15.0	2-4	█	116.1	12.7	17 15 25	
15										
16			End of boring at 30 feet Groundwater not encountered							
17										
18										
19										
20										
21										
22										
23										
24										
25										
26										

LEGEND: █ 2.5" Mod Cal Sample ○ Bulk Sample □ 2.0" Mod Cal Sample ● SPT

NOTE: This log of subsurface conditions is a simplification of actual conditions encountered. It applies at the location and time of drilling. Subsurface conditions may differ at other locations and times.

EXPLANATION

GROUP SYMBOL	UNIFIED SOIL CLASSIFICATION FINE GRAINED SOIL GROUPS
OL	Organic silts and organic silty clays of low plasticity
ML	Inorganic clayey silts to very fine sands of slight plasticity
CL	Inorganic clays of low to moderate plasticity
OH	Organic clays of moderate to high plasticity, organic silts
MH	Inorganic silts and clayey silts
CH	Inorganic clays of high plasticity

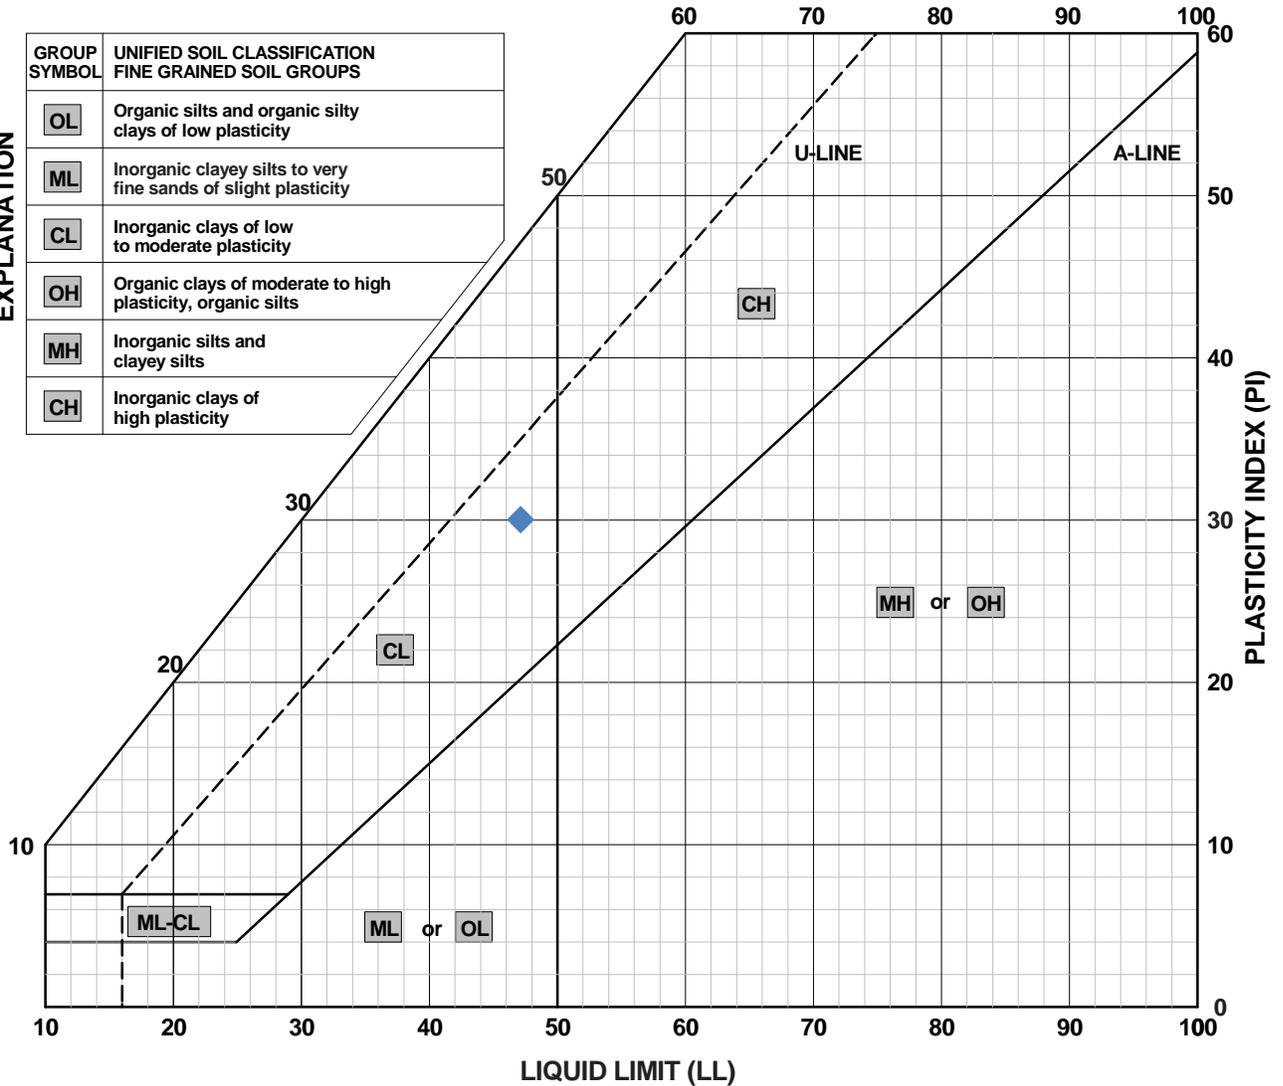

LEGEND:	SOURCE	DEPTH (ft)	LL	PL	PI	DESCRIPTION
◆	B-13	2.0	47	17	30	Brown Sandy Lean CLAY w/ Gravel (CL)

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.



PROJECT NO. G15-239-11L
 DRAWN: 3/4/16
 DRAWN BY: D. Tower
 CHECKED BY: B. Steen
 FILE NAME: Lab.indd

ATTERBERG LIMITS



Planned Solar Array Project
 Noble Elementary School
 3466 Grossmont Drive
 San Jose, California

PLATE

F-1



Unconsolidated-Undrained Triaxial Test
ASTM D2850

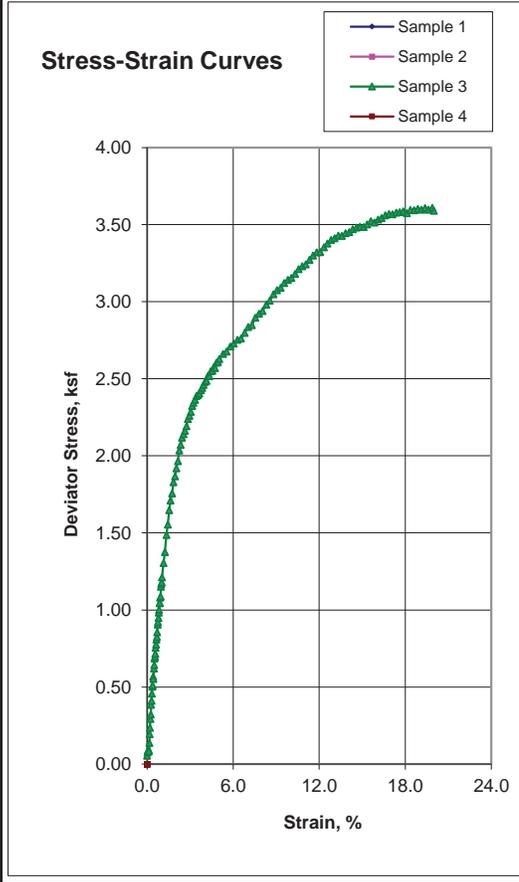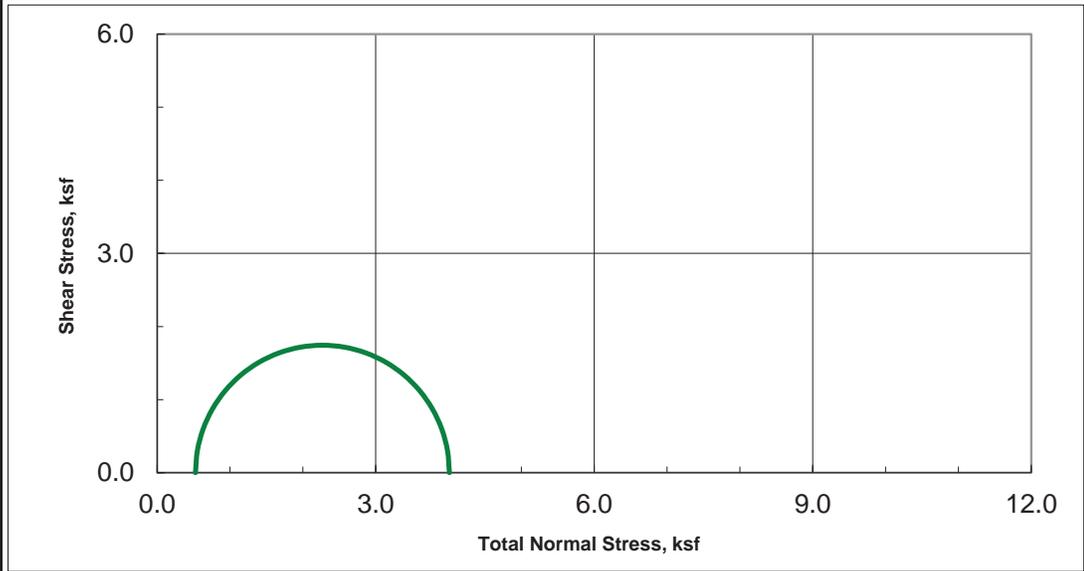

Sample Data				
	1	2	3	4
Moisture %			23.3	
Dry Den,pcf			97.7	
Void Ratio			0.726	
Saturation %			86.8	
Height in			5.01	
Diameter in			2.40	
Cell psi			3.6	
Strain %			15.00	
Deviator, ksf			3.487	
Rate %/min			1.00	
in/min			0.050	
Job No.:	664-063b			
Client:	BSK Associates			
Project:	G15-239-11L			
Boring:			B-12	
Sample:			2C	
Depth ft:			4.5	

Visual Soil Description				
Sample #				
1				
2				
3	Dark Brown Sandy Lean CLAY w/ Gravel			
4				
Remarks:				

Note: Strengths are picked at the peak deviator stress or 15% strain which ever occurs first per ASTM D2850.

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.



PROJECT NO. G15-239-11L
 DRAWN: 3/7/16
 DRAWN BY: D. Tower
 CHECKED BY: B. Steen
 FILE NAME: Lab.indd

UNCONSOLIDATED-UNDRAINED TRIAXIAL COMPRESSION

Planned Solar Array Project
 Noble Elementary School
 3466 Grossmont Drive
 San Jose, California

PLATE

F-2

2 March, 2016

Job No. 1602189
Cust. No. 12667Mr. Brad Steen
BSK Associates Engineers & Laboratories
324 Earhart Way
Livermore, CA 94551Subject: Project No.: G15-239-11L
Project Name: Berryessa School District
Corrosivity Analysis – ASTM Test Methods

Dear Mr. Steen:

Pursuant to your request, CERCO Analytical has analyzed the soil samples submitted on February 23, 2016. Based on the analytical results, this brief corrosivity evaluation is enclosed for your consideration.

Based upon the resistivity measurements, samples 001, 004, 005, 007, 010 & 013 are classified as "corrosive" and samples 002, 003, 006, 008, 009, 011 & 012 are classified as "moderately corrosive". All buried iron, steel, cast iron, ductile iron, galvanized steel and dielectric coated steel or iron should be properly protected against corrosion depending upon the critical nature of the structure. All buried metallic pressure piping such as ductile iron firewater pipelines should be protected against corrosion.

The chloride ion concentrations range from none detected to 77 mg/kg. Because the chloride ion concentrations are less than 300 mg/kg, they are determined to be insufficient to attack steel embedded in a concrete mortar coating.

The sulfate ion concentrations range from none detected to 80 mg/kg and are determined to be insufficient to damage reinforced concrete structures and cement mortar-coated steel at these locations.

The pH of the soils range from 7.28 to 8.44 which does not present corrosion problems for buried iron, steel, mortar-coated steel and reinforced concrete structures.

The redox potentials range from 390 to 480-mV. Sample No. 001, 002, 003, 004, 005, 006, 007, 008, 009, 010, 012 and 013 are indicative of aerobic soil conditions, and sample 011 is indicative of potentially "slightly corrosive" soils resulting from anaerobic soil conditions.

This corrosivity evaluation is based on general corrosion engineering standards and is non-specific in nature. For specific long-term corrosion control design recommendations or consultation, please call *JDH Corrosion Consultants, Inc.* at (925) 927-6630.

We appreciate the opportunity of working with you on this project. If you have any questions, or if you require further information, please do not hesitate to contact us.


Very truly yours,
CERCO ANALYTICAL, INC.
J. Darby Howard, Jr., P.E.
PresidentJDH/jdl
Enclosure

Client: BSK Associates Engineers & Laboratories
 Client's Project No.: G-15-239-11L
 Client's Project Name: Berryessa School District
 Date Sampled: 23-Feb-16
 Date Received: 23-Feb-16
 Matrix: Soil
 Authorization: Signed Chain of Custody

Date of Report: 2-Mar-2016

Job/Sample No.	Sample I.D.	Redox (mV)	pH	Conductivity (umhos/cm)*	Resistivity (100% Saturation) (ohms-cm)	Sulfide (mg/kg)*	Chloride (mg/kg)*	Sulfate (mg/kg)*
1602189-001	B-2 @ 1'-3'	460	7.93	-	1,000	-	77	80
1602189-002	B-3 @ 1'-3'	420	8.21	-	2,600	-	N.D.	N.D.
1602189-003	B-6 @ 1'-3'	410	7.28	-	2,500	-	N.D.	N.D.
1602189-004	B-8 @ 1'-3'	400	8.44	-	1,700	-	N.D.	73
1602189-005	B-10 @ 1'-3'	440	8.24	-	1,400	-	35	44
1602189-006	B-12 @ 1'-2'	430	8.01	-	2,300	-	N.D.	N.D.
1602189-007	B-14 @ 1'-3'	420	8.14	-	1,700	-	N.D.	28
1602189-008	B-16 @ 1'-2'	410	7.37	-	2,900	-	N.D.	N.D.
1602189-009	B-19 @ 1'-2'	420	7.85	-	4,300	-	N.D.	N.D.
1602189-010	B-20 @ 1'-3'	410	7.72	-	700	-	37	76
1602189-011	B-23 @ 1'-3'	390	7.74	-	2,900	-	N.D.	23
1602189-012	B-26 @ 1'-3'	480	8.18	-	2,400	-	25	35
1602189-013	B-30 @ 1'-3'	460	8.12	-	1,600	-	44	45

Method:	ASTM D1498	ASTM D4972	ASTM D1125M	ASTM G57	ASTM D4658M	ASTM D4327	ASTM D4327
Reporting Limit:	-	-	10	-	50	15	15
	1-Mar-2016	1-Mar-2016	-	1-Mar-2016	-	1-Mar-2016	1-Mar-2016


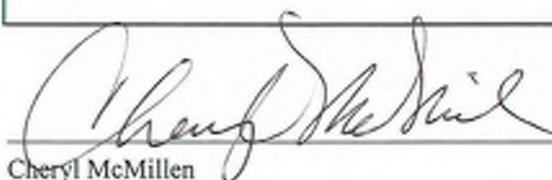


Cheryl McMillen
 Laboratory Director

* Results Reported on "As Received" Basis
 N.D. - None Detected

APPENDIX G

RUSKIN ELEMENTARY SCHOOL

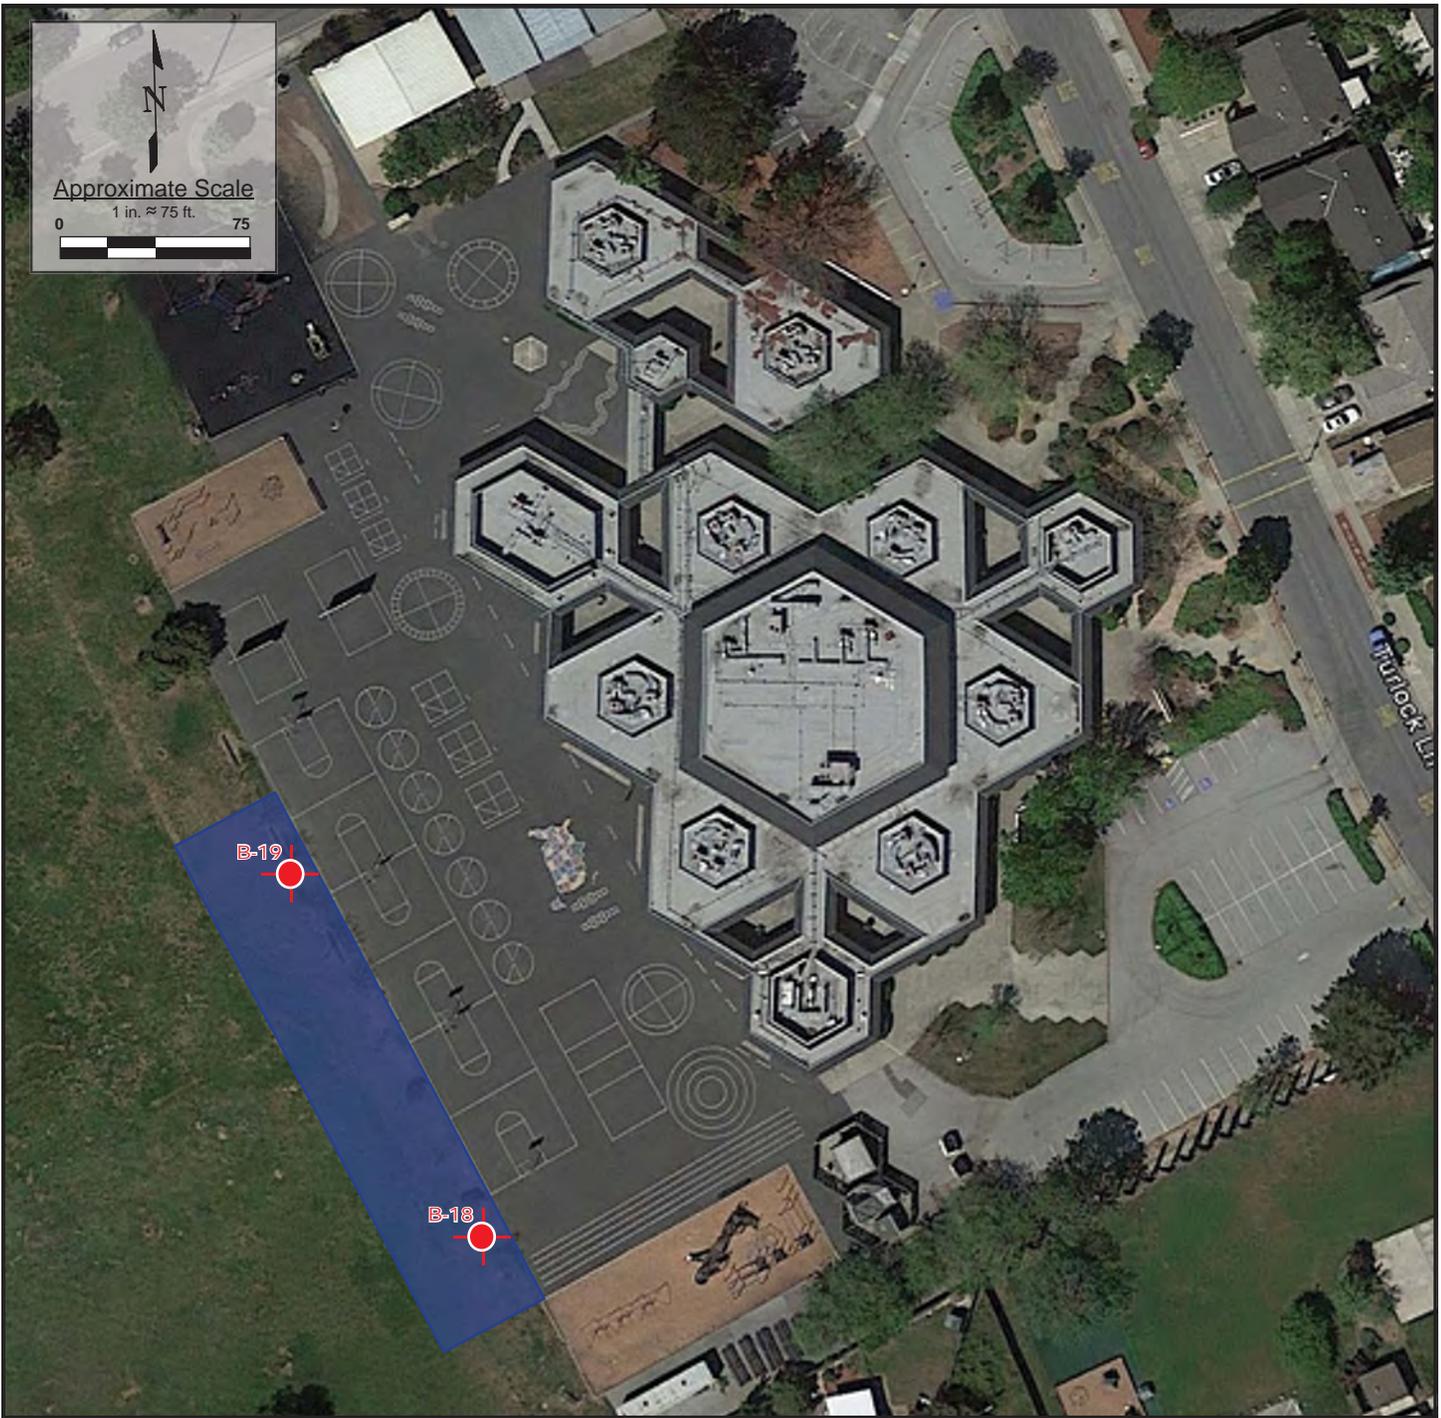

References: 1. <http://earth.google.com>, 2015

Legend

 B-18 Approximate Boring Location (BSK, 2016)

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.

	PROJECT NO. G15-239-11L	SITE PLAN	PLATE G
	DRAWN: 02/23/16		
	DRAWN BY: B. Steen	Planned Solar Array Project Ruskin Elementary School 1401 Turlock Lane San Jose, California	
	CHECKED BY: C. Foulk		
FILE NAME: SitePlan.indd			

SITE DESCRIPTION

Ruskin Elementary School is located at 1401 Turlock Lane in San Jose, California. The approximately 12 acre site is located in a residential neighborhood bounded by Tulare Drive and Turlock Lane to the north and east, respectively, and to the west and south by residential housing and the Sunshine School. There is one main school building and several portable structures, surrounded by asphalt paved parking and blacktop play courts. A grassy area occupies the western half of the parcel. The proposed location of the arrays will be in the playfield adjacent to blacktop play courts, as shown on Plate G.

Topography of the site, as well as the proposed array locations, is generally flat with elevation at approximately 152 feet above mean sea level. The planned arrays will not be located near any slopes.

SUBSURFACE CONDITIONS

We drilled two subsurface borings (B-18 and B-19) to a depth of about 20 feet deep. Our borings encountered interbedded medium dense to dense, poorly graded sands and gravels with interbeds of firm sandy clays and silts.

Groundwater was not encountered in our borings to a depth 20 feet below the ground surface. Historical high groundwater in the area has been measured at greater than 50 feet below grade. It should be noted that the groundwater level can fluctuate depending on factors such as seasonal rainfall, groundwater withdrawal, and construction activities on this or adjacent properties.

The above is a general description of soil and groundwater conditions encountered at the site in the borings for this investigation. For a more detailed description of the soils encountered, refer to the attached boring logs.

It should be noted that soil and subsurface conditions can deviate from those conditions encountered at the boring locations. If significant variation in the subsurface conditions is encountered during construction, it may be necessary for BSK to review the recommendations presented herein and recommend adjustments as necessary.

2013 SEISMIC DESIGN CRITERIA

Based on the site subsurface conditions, the site may be classified as Site Class D (stiff soil profile) per the ASCE 7-10. Use of the 2013 CBC mapped seismic design criteria is considered appropriate for this site and the following parameters should be considered applicable for the design of structural improvements:

SPECTRAL ACCELERATION PARAMETERS RISK TARGETED MAXIMUM CONSIDERED EARTHQUAKE			
Seismic Design Parameter	Value		Reference
Site Class	D		Table 20.3-1, ASCE 7-10
MCE _R Mapped Spectral Acceleration (g)	S _S = 1.652	S ₁ = 0.650	USGS Mapped Values based on Figures 1613.3.1(1) and 1613.3.1(2), 2013 CBC
Site Coefficients	F _a = 1.000	F _v = 1.500	Tables 1613.3.3(1) and 1613.3.3(2), 2013 CBC
MCE _R Mapped Spectral Acceleration Adjusted for Site Class Effects (g)	S _{MS} = 1.652	S _{M1} = 0.975	Section 1613.3.3, 2013 CBC
Design Spectral Acceleration (g)	S _{DS} = 1.101	S _{D1} = 0.650	Section 1613.3.4, 2013 CBC
MCE _G peak ground acceleration adjusted for Site Class effects (g)	PGA _M = 0.639		Section 11.8.3, ASCE 7-10
Definitions:			
MCE _R = Risk-Targeted Maximum Considered Earthquake			
MCE _G = Maximum Considered Earthquake Geometric Mean			



BSK Associates
 324 Earhart Way
 Livermore, CA 94551
 Telephone: 925-315-3151
 Fax: 925-315-3152

LOG OF BORING NO. B-18

Project Name: **Berryessa School District Solar Array Project**
 Project Number: **G15-239-11L**
 Project Location: **Berryessa School District**
 Logged by: **G. Minerales**
 Checked by: **D. Tower**

Depth, feet	Graphic Log	Surface El.: 152 ft Location: Ruskin Elementary School	Samples	Sample Number	Penetration Blows / Foot	Pocket Penetrometer, TSF	% Passing No. 200 Sieve	In-Situ Dry Weight (pcf)	In-Situ Moisture Content (%)	Liquid Limit	Plastic Limit	Plasticity Index
MATERIAL DESCRIPTION												
5		POORLY GRADED GRAVEL WITH SAND (GP): brown, moist, medium dense, fine subrounded gravel up to 1-inch	█	1A 1B 1C	10 9 10			96	6			
10		POORLY GRADED SAND WITH SILT AND GRAVEL (SP-SM): brown and multicolored, moist, loose, non plastic, fine to coarse grained sand, fine subrounded gravel up to 1-inch	█	3A 3B 3C	11 3 3							
15		medium dense	█	4A 4B 4C	7 9 13							
20		SANDY SILT WITH GRAVEL (ML): yellowish brown, moist, hard, fine grained sand, fine subrounded gravel	█	5A 5B 5C	7 11 13	3.75 >4						
25		Boring terminated at approximately 20 feet. No free groundwater observed. Boring backfilled with cement grout.										

GEO_TARGET BERRYESSA LOGS.GPJ GEOTECHNICAL 08.GDT 4/19/16

Completion Depth: 20.0
Date Started: 2/19/16
Date Completed: 2/19/16
California Sampler: 2.5-inch inner diameter
SPT Sampler: 1.4-inch inner diameter

Drilling Equipment: Exploration GeoServices Mobile B-40
Drilling Method: Hollow Stem
Drive Weight: 140 lbs
Hole Diameter: 8-in
Drop: 30-in
Remarks:



BSK Associates
 324 Earhart Way
 Livermore, CA 94551
 Telephone: 925-315-3151
 Fax: 925-315-3152

LOG OF BORING NO. B-19

Project Name: **Berryessa School District Solar Array Project**
 Project Number: **G15-239-11L**
 Project Location: **Berryessa School District**
 Logged by: **D. Tower**
 Checked by: **D. Tower**

Depth, feet	Graphic Log	Surface El.: 152 ft Location: Ruskin Elementary School	Samples	Sample Number	Penetration Blows / Foot	Pocket Penetrometer, TSF	% Passing No. 200 Sieve	In-Situ Dry Weight (pcf)	In-Situ Moisture Content (%)	Liquid Limit	Plastic Limit	Plasticity Index
MATERIAL DESCRIPTION												
		SANDY CLAY WITH GRAVEL (CL) brown, moist, low plasticity, fine sand, fine subrounded gravel, roots found		1A 1B 1C	4 4 5	2.5		104	12			
5		POORLY GRADED GRAVEL WITH SAND (GP): multicolored brown, moist, medium dense, fine and coarse grained sand, fine subangular gravel		2A 2B 2C	7 8 8			110	5			
10		dense		3A 3B 3C	10 22 17							
15		SANDY LEAN CLAY WITH GRAVEL (CL): brown, moist, medium to high plasticity, fine grained sand, fine subangular gravel		4A 4B 4C	7 8 8							
20		yellowish brown, iron oxide staining present, very fine grained sands, no gravel content found		5A 5B 5C	5 6 7							
		Boring terminated at approximately 20 feet. No free groundwater observed. Boring backfilled with cement grout.										

GEO_TARGET BERRYESSA LOGS.GPJ GEOTECHNICAL 08.GDT 4/19/16

Completion Depth: 20.0
Date Started: 2/19/16
Date Completed: 2/20/16
California Sampler: 2.5-inch inner diameter
SPT Sampler: 1.4-inch inner diameter

Drilling Equipment: Exploration GeoServices Mobile B-40
Drilling Method: Hollow Stem
Drive Weight: 140 lbs
Hole Diameter: 8-in
Drop: 30-in
Remarks:

2 March, 2016

Job No. 1602189
Cust. No. 12667

Mr. Brad Steen
BSK Associates Engineers & Laboratories
324 Earhart Way
Livermore, CA 94551

Subject: Project No.: G15-239-11L
Project Name: Berryessa School District
Corrosivity Analysis – ASTM Test Methods

Dear Mr. Steen:

Pursuant to your request, CERCO Analytical has analyzed the soil samples submitted on February 23, 2016. Based on the analytical results, this brief corrosivity evaluation is enclosed for your consideration.

Based upon the resistivity measurements, samples 001, 004, 005, 007, 010 & 013 are classified as "corrosive" and samples 002, 003, 006, 008, 009, 011 & 012 are classified as "moderately corrosive". All buried iron, steel, cast iron, ductile iron, galvanized steel and dielectric coated steel or iron should be properly protected against corrosion depending upon the critical nature of the structure. All buried metallic pressure piping such as ductile iron firewater pipelines should be protected against corrosion.

The chloride ion concentrations range from none detected to 77 mg/kg. Because the chloride ion concentrations are less than 300 mg/kg, they are determined to be insufficient to attack steel embedded in a concrete mortar coating.

The sulfate ion concentrations range from none detected to 80 mg/kg and are determined to be insufficient to damage reinforced concrete structures and cement mortar-coated steel at these locations.

The pH of the soils range from 7.28 to 8.44 which does not present corrosion problems for buried iron, steel, mortar-coated steel and reinforced concrete structures.

The redox potentials range from 390 to 480-mV. Sample No. 001, 002, 003, 004, 005, 006, 007, 008, 009, 010, 012 and 013 are indicative of aerobic soil conditions, and sample 011 is indicative of potentially "slightly corrosive" soils resulting from anaerobic soil conditions.

This corrosivity evaluation is based on general corrosion engineering standards and is non-specific in nature. For specific long-term corrosion control design recommendations or consultation, please call *JDH Corrosion Consultants, Inc.* at (925) 927-6630.

We appreciate the opportunity of working with you on this project. If you have any questions, or if you require further information, please do not hesitate to contact us.

Very truly yours,
CERCO ANALYTICAL, INC.


J. Darby Howard, Jr., P.E.
President


JDH/jdl
Enclosure

Client: BSK Associates Engineers & Laboratories
 Client's Project No.: G-15-239-11L
 Client's Project Name: Berryessa School District
 Date Sampled: 23-Feb-16
 Date Received: 23-Feb-16
 Matrix: Soil
 Authorization: Signed Chain of Custody

Date of Report: 2-Mar-2016

Job/Sample No.	Sample I.D.	Redox (mV)	pH	Conductivity (umhos/cm)*	Resistivity (100% Saturation) (ohms-cm)	Sulfide (mg/kg)*	Chloride (mg/kg)*	Sulfate (mg/kg)*
1602189-001	B-2 @ 1'-3'	460	7.93	-	1,000	-	77	80
1602189-002	B-3 @ 1'-3'	420	8.21	-	2,600	-	N.D.	N.D.
1602189-003	B-6 @ 1'-3'	410	7.28	-	2,500	-	N.D.	N.D.
1602189-004	B-8 @ 1'-3'	400	8.44	-	1,700	-	N.D.	73
1602189-005	B-10 @ 1'-3'	440	8.24	-	1,400	-	35	44
1602189-006	B-12 @ 1'-2'	430	8.01	-	2,300	-	N.D.	N.D.
1602189-007	B-14 @ 1'-3'	420	8.14	-	1,700	-	N.D.	28
1602189-008	B-16 @ 1'-2'	410	7.37	-	2,900	-	N.D.	N.D.
1602189-009	B-19 @ 1'-2'	420	7.85	-	4,300	-	N.D.	N.D.
1602189-010	B-20 @ 1'-3'	410	7.72	-	700	-	37	76
1602189-011	B-23 @ 1'-3'	390	7.74	-	2,900	-	N.D.	23
1602189-012	B-26 @ 1'-3'	480	8.18	-	2,400	-	25	35
1602189-013	B-30 @ 1'-3'	460	8.12	-	1,600	-	44	45

Method:	ASTM D1498	ASTM D4972	ASTM D1125M	ASTM G57	ASTM D4658M	ASTM D4327	ASTM D4327
Reporting Limit:	-	-	10	-	50	15	15
	1-Mar-2016	1-Mar-2016	-	1-Mar-2016	-	1-Mar-2016	1-Mar-2016

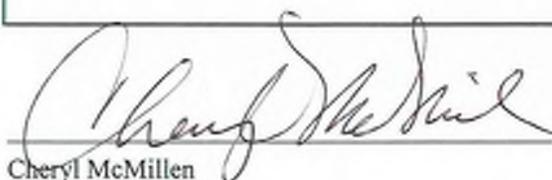

Cheryl McMillen
 Laboratory Director

* Results Reported on "As Received" Basis
 N.D. - None Detected

APPENDIX H

SIERRAMONT MIDDLE SCHOOL



References: 1. <http://earth.google.com>, 2015

Legend

 B-20 Approximate Boring Location (BSK, 2016)

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.



PROJECT NO. G15-239-11L

DRAWN: 02/23/16

DRAWN BY: B. Steen

CHECKED BY: C. Foulk

FILE NAME:
SitePlan.indd

SITE PLAN

Planned Solar Array Project
Sierramont Middle School
3155 Kimlee Drive
San Jose, California

PLATE

H

SITE DESCRIPTION

Sierramont Middle School is located at 3155 Kimlee Drive in San Jose, California. The approximately 20 acre site is located in a residential neighborhood. The parcel is bounded by Walkingshaw Way and Kimlee Drive to the west and south, respectively, and to the north and east by residential housing. The main campus structures and paved parking are located in the southeastern portion of the parcel. Grassy playfields and blacktop play courts surround the remainder of the school. The proposed location of the arrays will be located in an undeveloped grassy field in the northern section of the parcel, as shown on Plate H.

Topography of the site is generally flat with elevation at approximately 145 feet above mean sea level. The northern corner of the parcel, in the location of the planned ground mount arrays, rises gently up to elevation 155 feet. An undeveloped area has been excavated into this raised corner of the campus, creating a minor slope adjacent to the planned arrays. We understand that the planned arrays will be set back from the top of this slope.

SUBSURFACE CONDITIONS

We drilled three subsurface borings (B-20 through B-22) to a depth of about 20 feet deep (see Plate H for approximate locations). Our borings encountered interbedded firm to hard clays with a varying sands and gravel content. The surface clays exhibit a medium to high plasticity.

Groundwater was not encountered in our borings to a depth 20 feet below the ground surface. Historical high groundwater in the area has been mapped at greater than 50 feet below grade. It should be noted that the groundwater level can fluctuate depending on factors such as seasonal rainfall, groundwater withdrawal, and construction activities on this or adjacent properties.

The above is a general description of soil and groundwater conditions encountered at the site in the borings for this investigation. For a more detailed description of the soils encountered, refer to the attached boring logs.

It should be noted that soil and subsurface conditions can deviate from those conditions encountered at the boring locations. If significant variation in the subsurface conditions is encountered during construction, it may be necessary for BSK to review the recommendations presented herein and recommend adjustments as necessary.

2013 SEISMIC DESIGN CRITERIA

Based on the site subsurface conditions, the site may be classified as Site Class D (stiff soil profile) per the ASCE 7-10. Use of the 2013 CBC mapped seismic design criteria is considered appropriate for this site and the following parameters should be considered applicable for the design of structural improvements:

SPECTRAL ACCELERATION PARAMETERS			
RISK TARGETED MAXIMUM CONSIDERED EARTHQUAKE			
Seismic Design Parameter	Value		Reference
Site Class	D		Table 20.3-1, ASCE 7-10
MCE _R Mapped Spectral Acceleration (g)	$S_S = 1.704$	$S_1 = 0.674$	USGS Mapped Values based on Figures 1613.3.1(1) and 1613.3.1(2), 2013 CBC
Site Coefficients	$F_a = 1.000$	$F_v = 1.500$	Tables 1613.3.3(1) and 1613.3.3(2), 2013 CBC
MCE _R Mapped Spectral Acceleration Adjusted for Site Class Effects (g)	$S_{MS} = 1.704$	$S_{M1} = 1.011$	Section 1613.3.3, 2013 CBC
Design Spectral Acceleration (g)	$S_{DS} = 1.136$	$S_{D1} = 0.674$	Section 1613.3.4, 2013 CBC
MCE _G peak ground acceleration adjusted for Site Class effects (g)	$PGA_M = 0.658$		Section 11.8.3, ASCE 7-10
Definitions:			
MCE _R = Risk-Targeted Maximum Considered Earthquake			
MCE _G = Maximum Considered Earthquake Geometric Mean			



BSK Associates
 324 Earhart Way
 Livermore, CA 94551
 Telephone: 925-315-3151
 Fax: 925-315-3152

LOG OF BORING NO. B-20

Project Name: **Berryessa School District Solar Array Project**
 Project Number: **G15-239-11L**
 Project Location: **Berryessa School District**
 Logged by: **G. Minerale**
 Checked by: **D. Tower**

Depth, feet	Graphic Log	Surface El.: 147 ft Location: Sierramont Middle School	Samples	Sample Number	Penetration Blows / Foot	Pocket Penetrometer, TSF	% Passing No. 200 Sieve	In-Situ Dry Weight (pcf)	In-Situ Moisture Content (%)	Liquid Limit	Plastic Limit	Plasticity Index
MATERIAL DESCRIPTION												
5	[Hatched pattern]	LEAN CLAY WITH GRAVEL (CL): dark brown, moist, hard, medium to high plasticity, fine subrounded gravel olive brown, slightly moist to moist	1A 1B 1C	7 8 10	3.0							
10	[Hatched pattern]	SILTY CLAY WITH SAND AND GRAVEL (CL): light yellowish brown, slightly moist, hard, low to medium plasticity, fine grained sand, fine subrounded gravel TXUU (see Plate H-2) c=6,700 psf	3A 3B 3C	21 30 35	>4			111	13			
15	[Hatched pattern]		4A 4B 4C	14 21 40	>4							
20	[Hatched pattern]	decreasing gravel content	5A 5B 5C	18 26 35	>4							
25	[Hatched pattern]	Boring terminated at approximately 20 feet. No free groundwater observed. Boring backfilled with cement grout.										

GEO_TARGET BERRYESSA LOGS.GPJ GEOTECHNICAL 08.GDT 4/19/16

Completion Depth: 20.0
Date Started: 2/16/16
Date Completed: 2/16/16
California Sampler: 2.5-inch inner diameter
SPT Sampler: 1.4-inch inner diameter

Drilling Equipment: Exploration GeoServices Mobile B-40
Drilling Method: Hollow Stem
Drive Weight: 140 lbs
Hole Diameter: 8-in
Drop: 30-in
Remarks:



BSK Associates
 324 Earhart Way
 Livermore, CA 94551
 Telephone: 925-315-3151
 Fax: 925-315-3152

LOG OF BORING NO. B-21

Project Name: **Berryessa School District Solar Array Project**
 Project Number: **G15-239-11L**
 Project Location: **Berryessa School District**
 Logged by: **G. Minerales**
 Checked by: **D. Tower**

Depth, feet	Graphic Log	Surface El.: 150 ft Location: Sierramont Middle School	Samples	Sample Number	Penetration Blows / Foot	Pocket Penetrometer, TSF	% Passing No. 200 Sieve	In-Situ Dry Weight (pcf)	In-Situ Moisture Content (%)	Liquid Limit	Plastic Limit	Plasticity Index
MATERIAL DESCRIPTION												
	FAT CLAY (CH): olive brown, moist, hard, medium to high plasticity			1A 1B 1C	6 9 12	3.25				56	20	36
5	TXUU (see Plate H-2) c=2,300 psf			2A 2B 2C	6 9 15	>4		102	23			
	SILTY CLAY WITH SAND AND GRAVEL (CL): light yellowish brown, slightly moist, hard, low to medium plasticity, fine grained sand, fine subrounded gravel			3A 3B 3C	17 27 34	>4		113	13			
15	decreasing gravel content			4A 4B 4C	17 20 32	>4						
20	decreasing gravel content			5A 5B 5C	17 26 41	>4						
25	Boring terminated at approximately 20 feet. No free groundwater observed. Boring backfilled with cement grout.											

GEO_TARGET BERRYESSA LOGS.GPJ GEOTECHNICAL 08.GDT 4/19/16

Completion Depth: 20.0
Date Started: 2/16/16
Date Completed: 2/16/16
California Sampler: 2.5-inch inner diameter
SPT Sampler: 1.4-inch inner diameter

Drilling Equipment: Exploration GeoServices Mobile B-40
Drilling Method: Hollow Stem
Drive Weight: 140 lbs
Hole Diameter: 8-in
Drop: 30-in
Remarks:



BSK Associates
 324 Earhart Way
 Livermore, CA 94551
 Telephone: 925-315-3151
 Fax: 925-315-3152

LOG OF BORING NO. B-22

Project Name: **Berryessa School District Solar Array Project**
 Project Number: **G15-239-11L**
 Project Location: **Berryessa School District**
 Logged by: **G. Minerales**
 Checked by: **D. Tower**

Depth, feet	Graphic Log	Surface El.: 153 ft Location: Sierramont Middle School	Samples	Sample Number	Penetration Blows / Foot	Pocket Penetrometer, TSF	% Passing No. 200 Sieve	In-Situ Dry Weight (pcf)	In-Situ Moisture Content (%)	Liquid Limit	Plastic Limit	Plasticity Index	
MATERIAL DESCRIPTION													
		LEAN CLAY (CL): dark brown, moist, hard, medium to high plasticity firm to hard	1A	5									
			1B	8									
			1C	11	2.75		90	25					
			2A	7									
			2B	14									
			2C	35	3.0		107	21					
			3A	12									
			3B	16									
			3C	30	>4		116	14					
			4A	16									
	4B	20											
	4C	25	>4										
	5A	17											
	5B	21											
	5C	26											
	Boring terminated at approximately 20 feet. No free groundwater observed. Boring backfilled with cement grout.												


GEO_TARGET BERRYESSA LOGS.GPJ GEOTECHNICAL 08.GDT 4/19/16

Completion Depth: 20.0
Date Started: 2/16/16
Date Completed: 2/16/16
California Sampler: 2.5-inch inner diameter
SPT Sampler: 1.4-inch inner diameter

Drilling Equipment: Exploration GeoServices Mobile B-40
Drilling Method: Hollow Stem
Drive Weight: 140 lbs
Hole Diameter: 8-in
Drop: 30-in
Remarks:

EXPLANATION

GROUP SYMBOL	UNIFIED SOIL CLASSIFICATION FINE GRAINED SOIL GROUPS
OL	Organic silts and organic silty clays of low plasticity
ML	Inorganic clayey silts to very fine sands of slight plasticity
CL	Inorganic clays of low to moderate plasticity
OH	Organic clays of moderate to high plasticity, organic silts
MH	Inorganic silts and clayey silts
CH	Inorganic clays of high plasticity

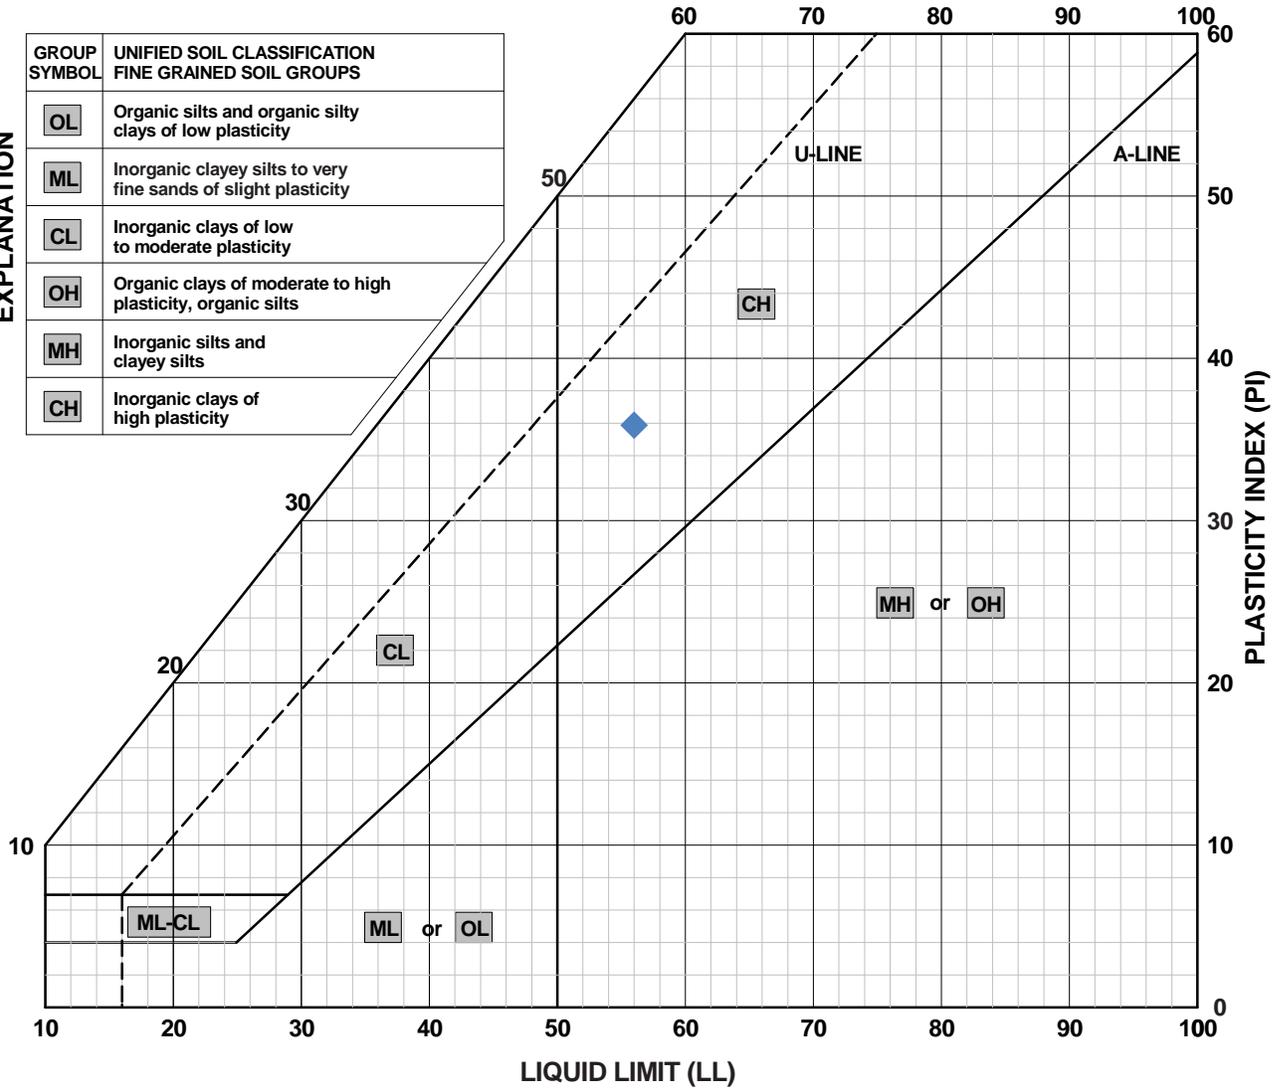

LEGEND:	SOURCE	DEPTH (ft)	LL	PL	PI	DESCRIPTION
◆	B-21	2.0	56	20	36	Olive Brown Fat CLAY (CH)

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.



PROJECT NO. G15-239-11L
 DRAWN: 3/4/16
 DRAWN BY: D. Tower
 CHECKED BY: B. Steen
 FILE NAME: Lab.indd

ATTERBERG LIMIT


Planned Solar Array Project
 Sierramont Middle School
 3155 Kimlee Drive
 San Jose, California

PLATE


H-1



Unconsolidated-Undrained Triaxial Test
ASTM D2850

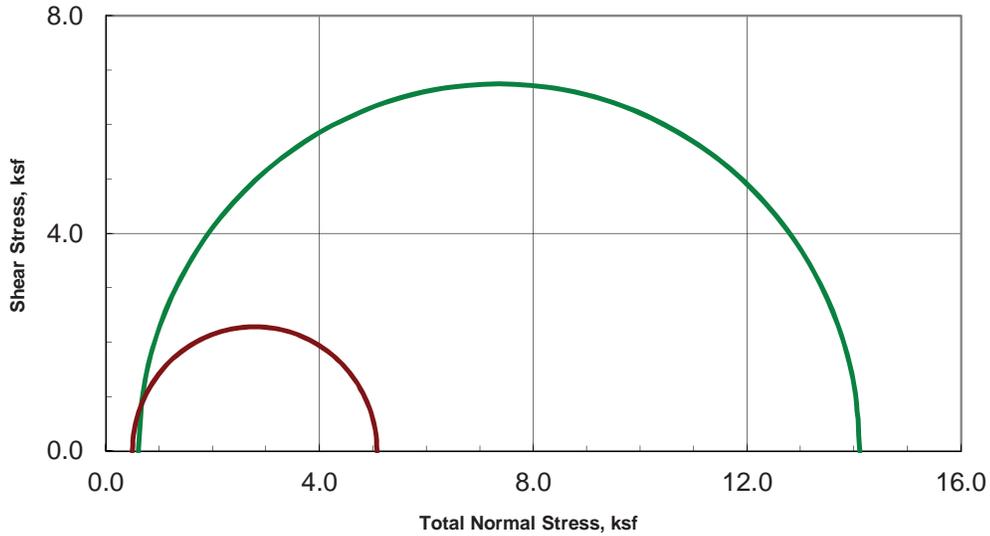

Stress-Strain Curves

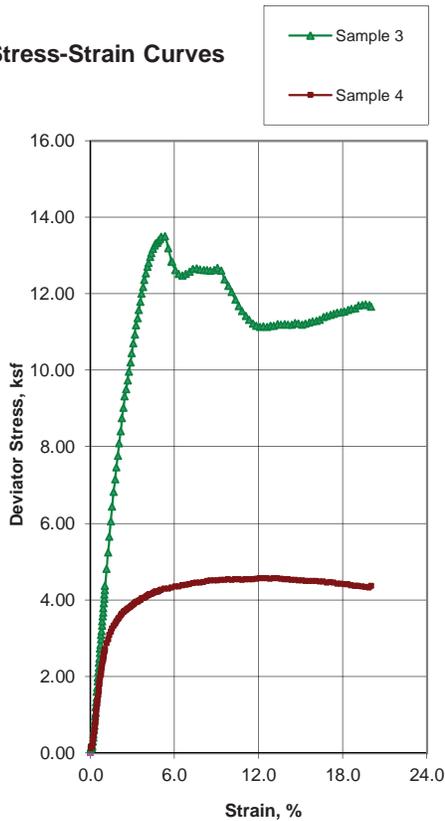

Sample Data				
	1	2	3	4
Moisture %			13.3	23.0
Dry Den,pcf			110.9	101.6
Void Ratio			0.519	0.659
Saturation %			69.1	94.2
Height in			5.01	5.02
Diameter in			2.40	2.41
Cell psi			4.2	3.5
Strain %			5.29	12.31
Deviator, ksf			13.503	4.578
Rate %/min			1.00	1.00
in/min			0.050	0.050
Job No.:	664-063c			
Client:	BSK Associates			
Project:	G15-239-11L			
Boring:			B-20	B-21
Sample:			3C	2C
Depth ft:			9.5	4.5

Visual Soil Description				
Sample #				
1				
2				
3	Light Yellowish Brown Silty CLAY w/ Sand and Gravel			
4	Olive Brown Fat CLAY			
Remarks:				

Note: Strengths are picked at the peak deviator stress or 15% strain which ever occurs first per ASTM D2850.

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.



PROJECT NO. G15-239-11L
 DRAWN: 3/4/16
 DRAWN BY: D. Tower
 CHECKED BY: B. Steen
 FILE NAME: Lab.indd

**UNCONSOLIDATED-UNDRAINED
 TRIAXIAL COMPRESSION**

Planned Solar Array Project
 Sierramont Middle School
 3155 Kimlee Drive
 San Jose, California

PLATE

H-2

2 March, 2016

Job No. 1602189
Cust. No. 12667

Mr. Brad Steen
BSK Associates Engineers & Laboratories
324 Earhart Way
Livermore, CA 94551

Subject: Project No.: G15-239-11L
Project Name: Berryessa School District
Corrosivity Analysis – ASTM Test Methods

Dear Mr. Steen:

Pursuant to your request, CERCO Analytical has analyzed the soil samples submitted on February 23, 2016. Based on the analytical results, this brief corrosivity evaluation is enclosed for your consideration.

Based upon the resistivity measurements, samples 001, 004, 005, 007, 010 & 013 are classified as "corrosive" and samples 002, 003, 006, 008, 009, 011 & 012 are classified as "moderately corrosive". All buried iron, steel, cast iron, ductile iron, galvanized steel and dielectric coated steel or iron should be properly protected against corrosion depending upon the critical nature of the structure. All buried metallic pressure piping such as ductile iron firewater pipelines should be protected against corrosion.

The chloride ion concentrations range from none detected to 77 mg/kg. Because the chloride ion concentrations are less than 300 mg/kg, they are determined to be insufficient to attack steel embedded in a concrete mortar coating.

The sulfate ion concentrations range from none detected to 80 mg/kg and are determined to be insufficient to damage reinforced concrete structures and cement mortar-coated steel at these locations.

The pH of the soils range from 7.28 to 8.44 which does not present corrosion problems for buried iron, steel, mortar-coated steel and reinforced concrete structures.

The redox potentials range from 390 to 480-mV. Sample No. 001, 002, 003, 004, 005, 006, 007, 008, 009, 010, 012 and 013 are indicative of aerobic soil conditions, and sample 011 is indicative of potentially "slightly corrosive" soils resulting from anaerobic soil conditions.

This corrosivity evaluation is based on general corrosion engineering standards and is non-specific in nature. For specific long-term corrosion control design recommendations or consultation, please call *JDH Corrosion Consultants, Inc.* at (925) 927-6630.

We appreciate the opportunity of working with you on this project. If you have any questions, or if you require further information, please do not hesitate to contact us.

Very truly yours,
CERCO ANALYTICAL, INC.


J. Darby Howard, Jr., P.E.
President


JDH/jdl
Enclosure

Client: BSK Associates Engineers & Laboratories
 Client's Project No.: G-15-239-11L
 Client's Project Name: Berryessa School District
 Date Sampled: 23-Feb-16
 Date Received: 23-Feb-16
 Matrix: Soil
 Authorization: Signed Chain of Custody

Date of Report: 2-Mar-2016

Job/Sample No.	Sample I.D.	Redox (mV)	pH	Conductivity (umhos/cm)*	Resistivity (100% Saturation) (ohms-cm)	Sulfide (mg/kg)*	Chloride (mg/kg)*	Sulfate (mg/kg)*
1602189-001	B-2 @ 1'-3'	460	7.93	-	1,000	-	77	80
1602189-002	B-3 @ 1'-3'	420	8.21	-	2,600	-	N.D.	N.D.
1602189-003	B-6 @ 1'-3'	410	7.28	-	2,500	-	N.D.	N.D.
1602189-004	B-8 @ 1'-3'	400	8.44	-	1,700	-	N.D.	73
1602189-005	B-10 @ 1'-3'	440	8.24	-	1,400	-	35	44
1602189-006	B-12 @ 1'-2'	430	8.01	-	2,300	-	N.D.	N.D.
1602189-007	B-14 @ 1'-3'	420	8.14	-	1,700	-	N.D.	28
1602189-008	B-16 @ 1'-2'	410	7.37	-	2,900	-	N.D.	N.D.
1602189-009	B-19 @ 1'-2'	420	7.85	-	4,300	-	N.D.	N.D.
1602189-010	B-20 @ 1'-3'	410	7.72	-	700	-	37	76
1602189-011	B-23 @ 1'-3'	390	7.74	-	2,900	-	N.D.	23
1602189-012	B-26 @ 1'-3'	480	8.18	-	2,400	-	25	35
1602189-013	B-30 @ 1'-3'	460	8.12	-	1,600	-	44	45

Method:	ASTM D1498	ASTM D4972	ASTM D1125M	ASTM G57	ASTM D4658M	ASTM D4327	ASTM D4327
Reporting Limit:	-	-	10	-	50	15	15
	1-Mar-2016	1-Mar-2016	-	1-Mar-2016	-	1-Mar-2016	1-Mar-2016

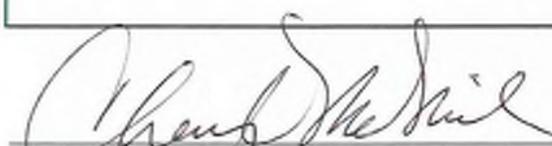

Cheryl McMillen
 Laboratory Director

* Results Reported on "As Received" Basis
 N.D. - None Detected

APPENDIX I

SUMMERDALE ELEMENTARY SCHOOL



Approximate Scale
1 in. ≈ 75 ft.



References: 1. <http://earth.google.com>, 2015

Legend

 Approximate Boring Location (BSK, 2016)

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.

	PROJECT NO. G15-239-11L	SITE PLAN	PLATE I
	DRAWN: 02/23/16		
	DRAWN BY: B. Steen	Planned Solar Array Project Summerdale Elementary School 1100 Summerdale Drive San Jose, California	
	CHECKED BY: C. Foulk		
FILE NAME: SitePlan.indd			

SITE DESCRIPTION

Summerdale Elementary School is located at 1100 Summerdale Drive in San Jose, California. The site is located in a residential neighborhood bound by Summerdale Drive to the west, Penitencia Creek Park to the east and residential housing to the north and south. Grassy playfields, asphalt paved parking and blacktop playcourts surround the campus. The proposed location of the arrays are in the parking lot directly west of the school's entrance and in an elevated grassy playfield behind the school, as shown on Plate I.

Topography of the site, as well as the proposed parking lot array location, is generally flat with elevation at approximately 178 feet above mean sea level. The parking lot planned arrays will not be located near any slopes. The playfield behind the school rises gently upward about 4 feet up from the paved play courts. The rear array will be located on top of a gentle slope about 4 feet in height. We understand that the planned arrays will be set back from the top of this slope.

SUBSURFACE CONDITIONS

We drilled three subsurface borings (B-23 through B-25) to a depth of about 20 feet deep (see Plate I for approximate locations). Our borings encountered firm to hard, gravelly and sandy clays and silts to a depth of about 8 feet. Below this depth, we encountered interbedded silty sands and gravels which exhibited a medium dense to dense consistency.

Groundwater was not encountered in our borings to a depth 20 feet below the ground surface. Historical high groundwater in the area has been mapped at greater than 50 feet below grade. It should be noted that the groundwater level can fluctuate depending on factors such as seasonal rainfall, groundwater withdrawal, and construction activities on this or adjacent properties.

The above is a general description of soil and groundwater conditions encountered at the site in the borings for this investigation. For a more detailed description of the soils encountered, refer to the attached boring logs.

It should be noted that soil and subsurface conditions can deviate from those conditions encountered at the boring locations. If significant variation in the subsurface conditions is encountered during construction, it may be necessary for BSK to review the recommendations presented herein and recommend adjustments as necessary.

2013 SEISMIC DESIGN CRITERIA

Based on the site subsurface conditions, the site may be classified as Site Class D (stiff soil profile) per the ASCE 7-10. Use of the 2013 CBC mapped seismic design criteria is considered appropriate for this site and the following parameters should be considered applicable for the design of structural improvements:

SPECTRAL ACCELERATION PARAMETERS RISK TARGETED MAXIMUM CONSIDERED EARTHQUAKE			
Seismic Design Parameter	Value		Reference
Site Class	D		Table 20.3-1, ASCE 7-10
MCE _R Mapped Spectral Acceleration (g)	S _S = 1.536	S ₁ = 0.601	USGS Mapped Values based on Figures 1613.3.1(1) and 1613.3.1(2), 2013 CBC
Site Coefficients	F _a = 1.000	F _v = 1.500	Tables 1613.3.3(1) and 1613.3.3(2), 2013 CBC
MCE _R Mapped Spectral Acceleration Adjusted for Site Class Effects (g)	S _{MS} = 1.536	S _{M1} = 0.901	Section 1613.3.3, 2013 CBC
Design Spectral Acceleration (g)	S _{DS} = 1.024	S _{D1} = 0.601	Section 1613.3.4, 2013 CBC
MCE _G peak ground acceleration adjusted for Site Class effects (g)	PGA _M = 0.595		Section 11.8.3, ASCE 7-10
Definitions:			
MCE _R = Risk-Targeted Maximum Considered Earthquake			
MCE _G = Maximum Considered Earthquake Geometric Mean			



BSK Associates
 324 Earhart Way
 Livermore, CA 94551
 Telephone: 925-315-3151
 Fax: 925-315-3152

LOG OF BORING NO. B-23

Project Name: **Berryessa School District Solar Array Project**
 Project Number: **G15-239-11L**
 Project Location: **Berryessa School District**
 Logged by: **G. Minerale**
 Checked by: **D. Tower**

Depth, feet	Graphic Log	Surface El.: 184 ft Location: Summerdale Elementary School	Samples	Sample Number	Penetration Blows / Foot	Pocket Penetrometer, TSF	% Passing No. 200 Sieve	In-Situ Dry Weight (pcf)	In-Situ Moisture Content (%)	Liquid Limit	Plastic Limit	Plasticity Index
MATERIAL DESCRIPTION												
		LEAN CLAY WITH SAND (CL): dark reddish brown, moist, hard, up to 1.5-inch subangular gravel		1A 1B 1C	3 4 7	>4		103	11			
5		sand and gravel increasing		2A 2B 2C	9 10 18	>4						
10		GRAVELLY SILT WITH SAND (ML): yellowish brown, moist, hard, fine sand, up to 1-inch subangular gravel		3A 3B 3C	16 24 31	>4		112	15			
15		SILTY SAND WITH GRAVEL (SM): light yellowish brown, slightly moist, very dense, moderately weathered sandstone, up to 1/2-inch gravel		4A	5/ 6"							
20		SILTY GRAVEL WITH SAND (GM): yellowish brown, moist, very dense, iron oxide staining		5A 5B 5C	17 31 45							
		Boring terminated at approximately 20 feet. No free groundwater observed. Boring backfilled with cement grout.										

GEO_TARGET BERRYESSA LOGS.GPJ GEOTECHNICAL 08.GDT 4/19/16

Completion Depth: 20.0
Date Started: 2/16/16
Date Completed: 2/16/16
California Sampler: 2.5-inch inner diameter
SPT Sampler: 1.4-inch inner diameter

Drilling Equipment: Exploration GeoServices Mobile B-40
Drilling Method: Hollow Stem
Drive Weight: 140 lbs
Hole Diameter: 8-in
Drop: 30-in
Remarks:



BSK Associates
 324 Earhart Way
 Livermore, CA 94551
 Telephone: 925-315-3151
 Fax: 925-315-3152

LOG OF BORING NO. B-24

Project Name: **Berryessa School District Solar Array Project**
 Project Number: **G15-239-11L**
 Project Location: **Berryessa School District**
 Logged by: **G. Minerales**
 Checked by: **D. Tower**

Depth, feet	Graphic Log	MATERIAL DESCRIPTION	Samples	Sample Number	Penetration Blows / Foot	Pocket Penetrometer, TSF	% Passing No. 200 Sieve	In-Situ Dry Weight (pcf)	In-Situ Moisture Content (%)	Liquid Limit	Plastic Limit	Plasticity Index
		Surface El.: 177 ft Location: Summerdale Elementary School										
	ASPHALT 3 inches											
	AGGREGATE BASE 4 inches											
	GRAVELLY CLAY WITH SAND (CL): olive brown, moist, hard, up to 3/4 inch subangular gravel, fine sand		1A 1B 1C	13 16 16								
5	TXUU (see Plate I-2) c=2,300 psf		2A 2B 2C	6 9 9			106	10				
	SILTY SAND WITH GRAVEL (SM): light yellowish brown, moist, medium dense, fine sand, subrounded gravel up to 3/4 inch		3A 3B 3C	10 15 13								
	grading to more silt content		4A 4B 4C	9 9 10			97	10				
	grading to more sand and gravel content		5A 5B 5C	42 50/ 4"								
		Boring terminated at approximately 20 feet. No free groundwater observed. Boring backfilled with cement grout.										

GEO_TARGET BERRYESSA LOGS.GPJ GEOTECHNICAL 08.GDT 4/19/16

Completion Depth: 20.0
Date Started: 2/16/16
Date Completed: 2/16/16
California Sampler: 2.5-inch inner diameter
SPT Sampler: 1.4-inch inner diameter

Drilling Equipment: Exploration GeoServices Mobile B-40
Drilling Method: Hollow Stem
Drive Weight: 140 lbs
Hole Diameter: 8-in
Drop: 30-in
Remarks:



BSK Associates
 324 Earhart Way
 Livermore, CA 94551
 Telephone: 925-315-3151
 Fax: 925-315-3152

LOG OF BORING NO. B-25

Project Name: **Berryessa School District Solar Array Project**
 Project Number: **G15-239-11L**
 Project Location: **Berryessa School District**
 Logged by: **G. Minerales**
 Checked by: **D. Tower**

Depth, feet	Graphic Log	MATERIAL DESCRIPTION	Samples	Sample Number	Penetration Blows / Foot	Pocket Penetrometer, TSF	% Passing No. 200 Sieve	In-Situ Dry Weight (pcf)	In-Situ Moisture Content (%)	Liquid Limit	Plastic Limit	Plasticity Index		
		Surface El.: 178 ft Location: Summerdale Elementary School												
		ASPHALT 3 inches												
		AGGREGATE BASE 4 inches												
		SANDY CLAY WITH GRAVEL (CL): olive brown moist, hard, low plasticity, fine subrounded gravel decreasing gravel content		1A	6									
				1B	12					32	18	14		
				1C	15									
5		TXUU (see Plate I-2) c=1,200 psf		2A	4	3.5		100	16					
				2B	5									
				2C	5									
		SILTY SAND WITH GRAVEL (SM): yellowish brown, moist, medium dense, fine sand, subangular gravel up to 3/4 inches		3A	4			105	15					
				3B	5									
				3C	7									
		SANDY SILT WITH GRAVEL (ML): yellowish brown, moist, hard, fine grained sand, fine subrounded gravel up to 2-inches		4A	8	>4								
				4B	11									
				4C	31									
		GRAVELLY SILT WITH SAND (ML): yellowish brown, moist, hard, fine and coarse grained sand, fine subangular gravel		5A	9	>4								
				5B	16									
				5C	24									
		Boring terminated at approximately 20 feet. No free groundwater observed. Boring backfilled with cement grout.												


GEO_TARGET BERRYESSA LOGS.GPJ GEOTECHNICAL 08.GDT 4/19/16

Completion Depth: 20.0
Date Started: 2/16/16
Date Completed: 2/16/16
California Sampler: 2.5-inch inner diameter
SPT Sampler: 1.4-inch inner diameter

Drilling Equipment: Exploration GeoServices Mobile B-40
Drilling Method: Hollow Stem
Drive Weight: 140 lbs
Hole Diameter: 8-in
Drop: 30-in
Remarks:

EXPLANATION

GROUP SYMBOL	UNIFIED SOIL CLASSIFICATION FINE GRAINED SOIL GROUPS
OL	Organic silts and organic silty clays of low plasticity
ML	Inorganic clayey silts to very fine sands of slight plasticity
CL	Inorganic clays of low to moderate plasticity
OH	Organic clays of moderate to high plasticity, organic silts
MH	Inorganic silts and clayey silts
CH	Inorganic clays of high plasticity

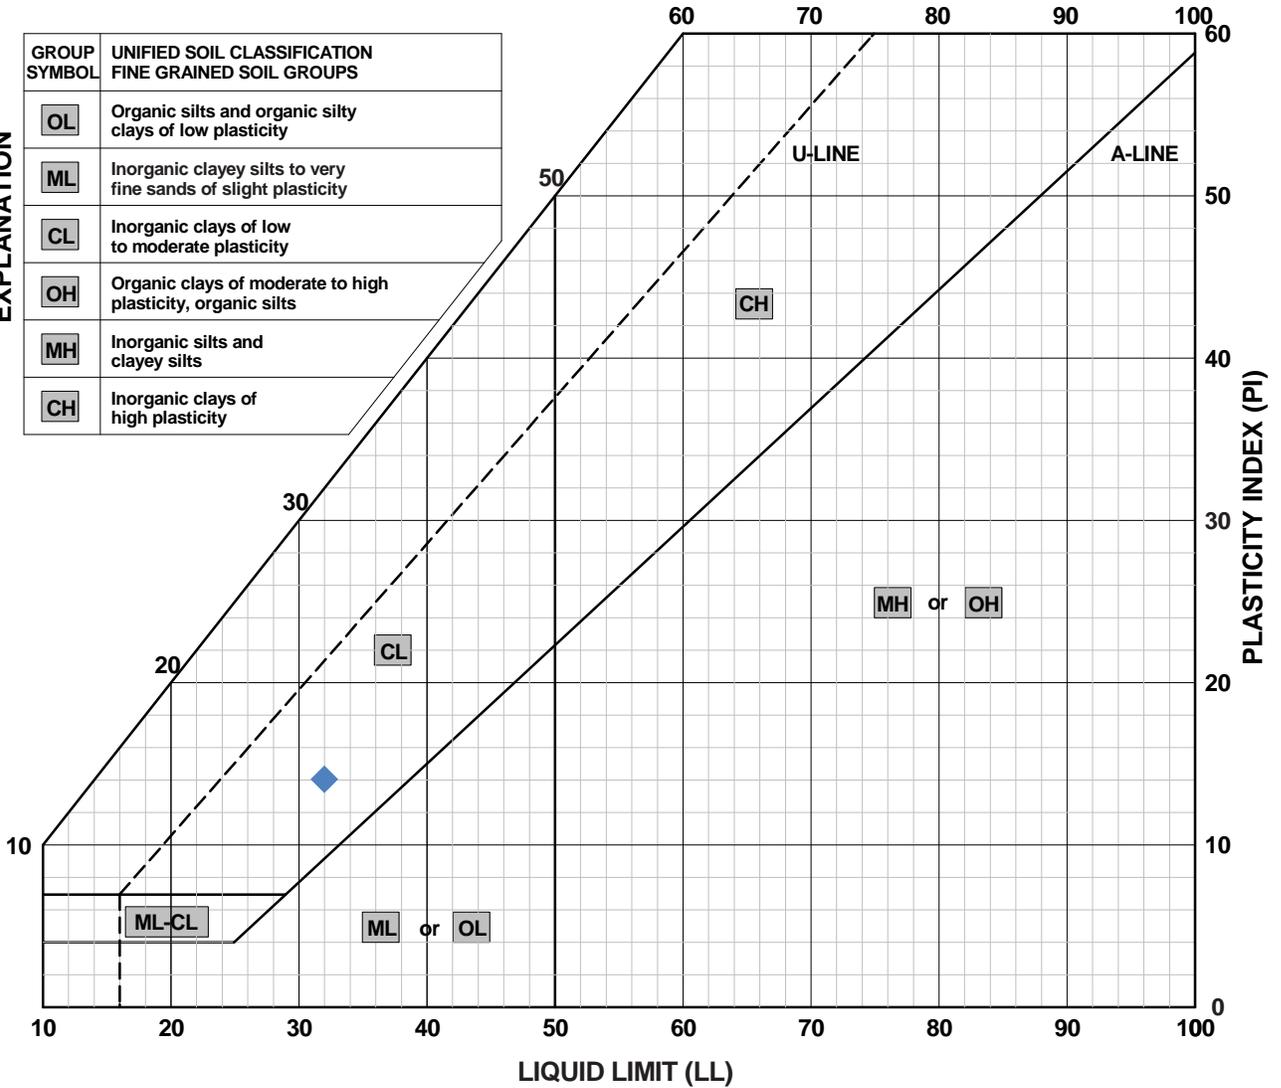

LEGEND:	SOURCE	DEPTH (ft)	LL	PL	PI	DESCRIPTION
◆	B-25	2.0	32	18	14	Brown Sandy Clay w/ Gravel (CL)

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.



PROJECT NO. G15-239-11L
 DRAWN: 3/11/16
 DRAWN BY: D. Tower
 CHECKED BY: B. Steen
 FILE NAME: Lab.indd

ATTERBERG LIMIT



Planned Solar Array Project
 Summerdale Elementary School
 1100 Summerdale Drive
 San Jose, California

PLATE

I-1



Unconsolidated-Undrained Triaxial Test ASTM D2850

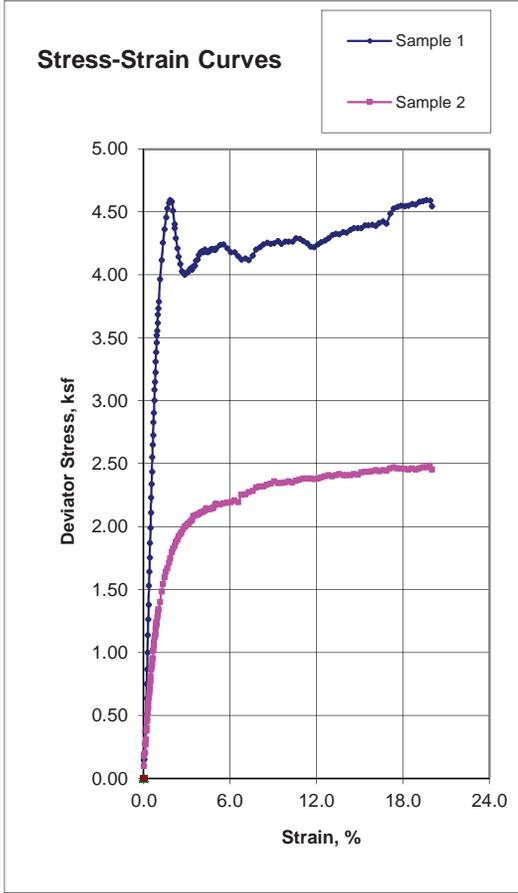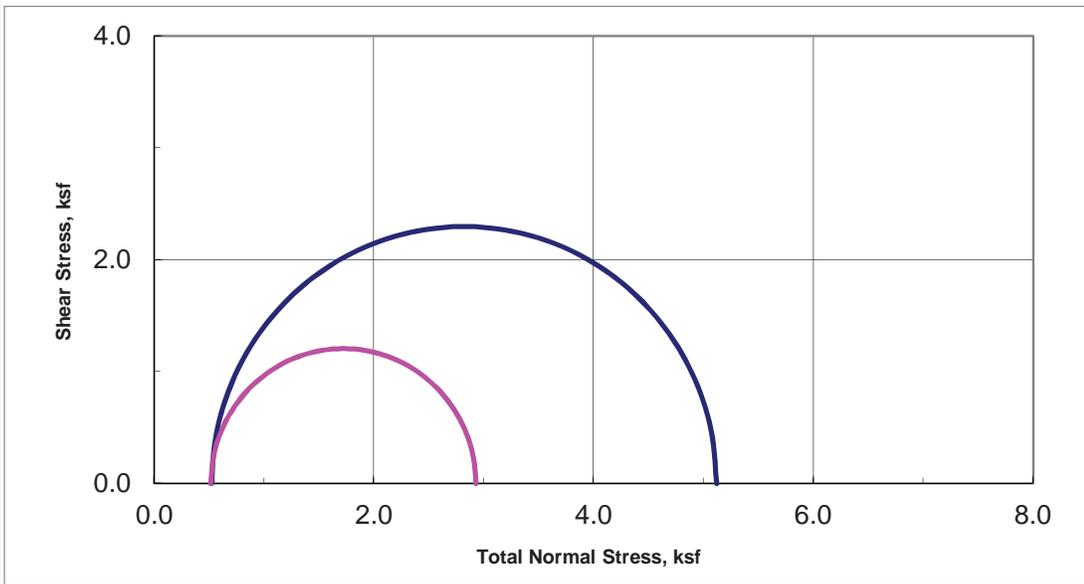

Sample Data				
	1	2	3	4
Moisture %	9.8	15.5		
Dry Den,pcf	105.5	100.3		
Void Ratio	0.598	0.681		
Saturation %	44.2	61.4		
Height in	5.00	5.01		
Diameter in	2.38	2.38		
Cell psi	3.6	3.6		
Strain %	1.84	15.00		
Deviator, ksf	4.596	2.413		
Rate %/min	1.00	1.00		
in/min	0.050	0.050		
Job No.:	666-063d			
Client:	BSK Associates			
Project:	G15-239-11L			
Boring:	B-24	B-25		
Sample:	2C	2C		
Depth ft:	4.5	4.5		

Visual Soil Description	
Sample #	
1	Olive Brown Gravelly CLAY w/ Sand
2	Olive Brown Sandy CLAY w/ Gravel
3	
4	
Remarks:	

Note: Strengths are picked at the peak deviator stress or 15% strain which ever occurs first per ASTM D2850.

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.



PROJECT NO. G15-239-11L
 DRAWN: 3/4/16
 DRAWN BY: D. Tower
 CHECKED BY: B. Steen
 FILE NAME: Lab.indd

UNCONSOLIDATED-UNDRAINED
 TRIAXIAL COMPRESSION
 Planned Solar Array Project
 Summerdale Elementary School
 1100 Summerdale Drive
 San Jose, California

PLATE

1-2

2 March, 2016

Job No. 1602189
Cust. No. 12667Mr. Brad Steen
BSK Associates Engineers & Laboratories
324 Earhart Way
Livermore, CA 94551Subject: Project No.: G15-239-11L
Project Name: Berryessa School District
Corrosivity Analysis – ASTM Test Methods

Dear Mr. Steen:

Pursuant to your request, CERCO Analytical has analyzed the soil samples submitted on February 23, 2016. Based on the analytical results, this brief corrosivity evaluation is enclosed for your consideration.

Based upon the resistivity measurements, samples 001, 004, 005, 007, 010 & 013 are classified as "corrosive" and samples 002, 003, 006, 008, 009, 011 & 012 are classified as "moderately corrosive". All buried iron, steel, cast iron, ductile iron, galvanized steel and dielectric coated steel or iron should be properly protected against corrosion depending upon the critical nature of the structure. All buried metallic pressure piping such as ductile iron firewater pipelines should be protected against corrosion.

The chloride ion concentrations range from none detected to 77 mg/kg. Because the chloride ion concentrations are less than 300 mg/kg, they are determined to be insufficient to attack steel embedded in a concrete mortar coating.

The sulfate ion concentrations range from none detected to 80 mg/kg and are determined to be insufficient to damage reinforced concrete structures and cement mortar-coated steel at these locations.

The pH of the soils range from 7.28 to 8.44 which does not present corrosion problems for buried iron, steel, mortar-coated steel and reinforced concrete structures.

The redox potentials range from 390 to 480-mV. Sample No. 001, 002, 003, 004, 005, 006, 007, 008, 009, 010, 012 and 013 are indicative of aerobic soil conditions, and sample 011 is indicative of potentially "slightly corrosive" soils resulting from anaerobic soil conditions.

This corrosivity evaluation is based on general corrosion engineering standards and is non-specific in nature. For specific long-term corrosion control design recommendations or consultation, please call *JDH Corrosion Consultants, Inc.* at (925) 927-6630.

We appreciate the opportunity of working with you on this project. If you have any questions, or if you require further information, please do not hesitate to contact us.

Very truly yours,
CERCO ANALYTICAL, INC.
J. Darby Howard, Jr., P.E.
PresidentJDH/jdl
Enclosure


Client: BSK Associates Engineers & Laboratories
 Client's Project No.: G-15-239-11L
 Client's Project Name: Berryessa School District
 Date Sampled: 23-Feb-16
 Date Received: 23-Feb-16
 Matrix: Soil
 Authorization: Signed Chain of Custody

1100 Willow Pass Court, Suite A
 Concord, CA 94520-1006
 925 462 2771 Fax. 925 462 2775
 www.cercoanalytical.com

Date of Report: 2-Mar-2016

Job/Sample No.	Sample I.D.	Redox (mV)	pH	Conductivity (umhos/cm)*	Resistivity (100% Saturation) (ohms-cm)	Sulfide (mg/kg)*	Chloride (mg/kg)*	Sulfate (mg/kg)*
1602189-001	B-2 @ 1'-3'	460	7.93	-	1,000	-	77	80
1602189-002	B-3 @ 1'-3'	420	8.21	-	2,600	-	N.D.	N.D.
1602189-003	B-6 @ 1'-3'	410	7.28	-	2,500	-	N.D.	N.D.
1602189-004	B-8 @ 1'-3'	400	8.44	-	1,700	-	N.D.	73
1602189-005	B-10 @ 1'-3'	440	8.24	-	1,400	-	35	44
1602189-006	B-12 @ 1'-2'	430	8.01	-	2,300	-	N.D.	N.D.
1602189-007	B-14 @ 1'-3'	420	8.14	-	1,700	-	N.D.	28
1602189-008	B-16 @ 1'-2'	410	7.37	-	2,900	-	N.D.	N.D.
1602189-009	B-19 @ 1'-2'	420	7.85	-	4,300	-	N.D.	N.D.
1602189-010	B-20 @ 1'-3'	410	7.72	-	700	-	37	76
1602189-011	B-23 @ 1'-3'	390	7.74	-	2,900	-	N.D.	23
1602189-012	B-26 @ 1'-3'	480	8.18	-	2,400	-	25	35
1602189-013	B-30 @ 1'-3'	460	8.12	-	1,600	-	44	45

Method:	ASTM D1498	ASTM D4972	ASTM D1125M	ASTM G57	ASTM D4658M	ASTM D4327	ASTM D4327
Reporting Limit:	-	-	10	-	50	15	15
	1-Mar-2016	1-Mar-2016	-	1-Mar-2016	-	1-Mar-2016	1-Mar-2016

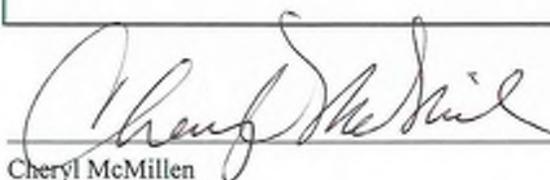

Cheryl McMillen

Laboratory Director

* Results Reported on "As Received" Basis
 N.D. - None Detected

APPENDIX J

TOYON ELEMENTARY SCHOOL



References: 1. <http://earth.google.com>, 2015

Legend


 B-24 Approximate Boring Location (BSK, 2016)

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.

	PROJECT NO. G15-239-11L	<u>SITE PLAN</u>	PLATE J
	DRAWN: 02/23/16		
	DRAWN BY: B. Steen	Planned Solar Array Project Toyon Elementary School 995 Bard Street San Jose, California	
	CHECKED BY: C. Foulk FILE NAME: SitePlan.indd		

SITE DESCRIPTION

Toyon Elementary School is located at 995 Bard Street in San Jose, California. The approximately 10 acre parcel is roughly trapezoidal and located in a residential neighborhood. The school buildings are located in the northeastern quadrant of the site. Grassy playfields, asphalt paved parking areas, and blacktop play courts surround the school. Penitencia Creek Park is located just north of the school. The proposed location of the arrays will be in the in southern parking area and in a grassy playfield just south of the blacktop play courts, as shown on Plate J.

Topography of the site, as well as the proposed array locations, is generally flat with elevation of approximately 222 feet above mean sea level. The planned arrays will not be located near any slopes.

SUBSURFACE CONDITIONS

We drilled three subsurface borings (B-26 through B-28) to a depth of about 20 feet deep (see Plate J for approximate locations). Our borings encountered firm to hard clays with a varying content sand and gravel to a depth of about 9 feet. The clays exhibit a moderate plasticity. Underlying this surface clay, we encountered dense to very dense, interbedded sands and gravels with a varying clay and silt content.

Groundwater was not encountered in our borings to a depth 20 feet below the ground surface. Historical high groundwater in the area has been measured at greater than 50 feet below grade. It should be noted that the groundwater level can fluctuate depending on factors such as seasonal rainfall, groundwater withdrawal, and construction activities on this or adjacent properties.

The above is a general description of soil and groundwater conditions encountered at the site in the borings for this investigation. For a more detailed description of the soils encountered, refer to the attached boring logs.

It should be noted that soil and subsurface conditions can deviate from those conditions encountered at the boring locations. If significant variation in the subsurface conditions is encountered during construction, it may be necessary for BSK to review the recommendations presented herein and recommend adjustments as necessary.

2013 SEISMIC DESIGN CRITERIA

Based on the site subsurface conditions, the site may be classified as Site Class D (stiff soil profile) per the ASCE 7-10. Use of the 2013 CBC mapped seismic design criteria is considered appropriate for this site and the following parameters should be considered applicable for the design of structural improvements:

SPECTRAL ACCELERATION PARAMETERS		
RISK TARGETED MAXIMUM CONSIDERED EARTHQUAKE		
Seismic Design Parameter	Value	Reference
Site Class	D	Table 20.3-1, ASCE 7-10
MCE _R Mapped Spectral Acceleration (g)	$S_S = 1.592$ $S_1 = 0.604$	USGS Mapped Values based on Figures 1613.3.1(1) and 1613.3.1(2), 2013 CBC
Site Coefficients	$F_a = 1.000$ $F_v = 1.500$	Tables 1613.3.3(1) and 1613.3.3(2), 2013 CBC
MCE _R Mapped Spectral Acceleration Adjusted for Site Class Effects (g)	$S_{MS} = 1.592$ $S_{M1} = 0.906$	Section 1613.3.3, 2013 CBC
Design Spectral Acceleration (g)	$S_{DS} = 1.062$ $S_{D1} = 0.604$	Section 1613.3.4, 2013 CBC
MCE _G peak ground acceleration adjusted for Site Class effects (g)	$PGA_M = 0.610$	Section 11.8.3, ASCE 7-10
Definitions:		
MCE _R = Risk-Targeted Maximum Considered Earthquake		
MCE _G = Maximum Considered Earthquake Geometric Mean		



BSK Associates
 324 Earhart Way
 Livermore, CA 94551
 Telephone: 925-315-3151
 Fax: 925-315-3152

LOG OF BORING NO. B-26

Project Name: **Berryessa School District Solar Array Project**
 Project Number: **G15-239-11L**
 Project Location: **Berryessa School District**
 Logged by: **G. Minerale**
 Checked by: **D. Tower**

Depth, feet	Graphic Log	MATERIAL DESCRIPTION	Samples	Sample Number	Penetration Blows / Foot	Pocket Penetrometer, TSF	% Passing No. 200 Sieve	In-Situ Dry Weight (pcf)	In-Situ Moisture Content (%)	Liquid Limit	Plastic Limit	Plasticity Index
		Surface El.: 221 ft Location: Toyon Elementary School										
	[Diagonal Hatching]	LEAN CLAY WITH SAND AND GRAVEL (CL) dark brown, moist, hard, low to medium plasticity, fine sand and gravel	█	1A 1B 1C	4 5 8	2.0 2.25		106	18			
		TXUU (see Plate J-2) c=1,250 psf										
5		GRAVELLY CLAY WITH SAND (CL) : yellowish brown, moist, hard, subrounded gravel up to 1.5 inches	█	2A 2B 2C	8 9 14	>4		109	15			
10		CLAYEY GRAVEL WITH SAND (GC) : light brown, moist, dense, fine and coarse grained sands, fine subrounded gravels up to 1.5 inches	█	3A 3B 3C	11 19 35							
15		very dense	█	4A 4B 4C	26 50/ 6"							
20		Boring terminated at approximately 19 feet. No free groundwater observed. Boring backfilled with cement grout.	█	5A	50/ 5"							

GEO_TARGET BERRYESSA LOGS.GPJ GEOTECHNICAL 08.GDT 4/19/16

Completion Depth: 19.0
Date Started: 2/17/16
Date Completed: 2/17/16
California Sampler: 2.5-inch inner diameter
SPT Sampler: 1.4-inch inner diameter

Drilling Equipment: Exploration GeoServices Mobile B-40
Drilling Method: Hollow Stem
Drive Weight: 140 lbs
Hole Diameter: 8-in
Drop: 30-in
Remarks:



BSK Associates
 324 Earhart Way
 Livermore, CA 94551
 Telephone: 925-315-3151
 Fax: 925-315-3152

LOG OF BORING NO. B-27

Project Name: **Berryessa School District Solar Array Project**
 Project Number: **G15-239-11L**
 Project Location: **Berryessa School District**
 Logged by: **G. Minerales**
 Checked by: **D. Tower**

Depth, feet	Graphic Log	Surface El.: 222 ft Location: Toyon Elementary School	Samples	Sample Number	Penetration Blows / Foot	Pocket Penetrometer, TSF	% Passing No. 200 Sieve	In-Situ Dry Weight (pcf)	In-Situ Moisture Content (%)	Liquid Limit	Plastic Limit	Plasticity Index
MATERIAL DESCRIPTION												
		LEAN CLAY WITH SAND AND GRAVEL (CL): dark brown, moist, hard, medium plasticity, fine sand and gravel	█	1A 1B 1C	5 4 5	2.25 2.0				36	18	18
5		TXUU (see Plate J-2) c=1,200 psf	█	2A 2B 2C	4 5 6	1.75		109	17			
		SILTY GRAVEL WITH SAND (GM): light yellowish brown, moist, very dense, fine to coarse sand, fine subrounded gravel up to 2 inches	█	3A 3B 3C	50/ 6"							
10			█	4A 4B 4C	26 50/ 6"							
15			█	5A 5B 5C	17 28 21							
20		dense										
		Boring terminated at approximately 20 feet. No free groundwater observed. Boring backfilled with cement grout.										

GEO_TARGET BERRYESSA LOGS.GPJ GEOTECHNICAL 08.GDT 4/19/16

Completion Depth: 20.0
Date Started: 2/17/16
Date Completed: 2/17/16
California Sampler: 2.5-inch inner diameter
SPT Sampler: 1.4-inch inner diameter

Drilling Equipment: Exploration GeoServices Mobile B-40
Drilling Method: Hollow Stem
Drive Weight: 140 lbs
Hole Diameter: 8-in
Drop: 30-in
Remarks:



BSK Associates
 324 Earhart Way
 Livermore, CA 94551
 Telephone: 925-315-3151
 Fax: 925-315-3152


LOG OF BORING NO. B-28

Project Name: **Berryessa School District Solar Array Project**
 Project Number: **G15-239-11L**
 Project Location: **Berryessa School District**
 Logged by: **G. Minerale**
 Checked by: **D. Tower**

Depth, feet	Graphic Log	MATERIAL DESCRIPTION	Samples	Sample Number	Penetration Blows / Foot	Pocket Penetrometer, TSF	% Passing No. 200 Sieve	In-Situ Dry Weight (pcf)	In-Situ Moisture Content (%)	Liquid Limit	Plastic Limit	Plasticity Index		
		Surface El.: 224 ft Location: Toyon Elementary School												
	ASPHALT 2 inches													
	AGGREGATE BASE 3 inches													
		LEAN CLAY WITH SAND AND GRAVEL (CL): olive brown, moist, hard, medium plasticity, fine to coarse sand, fine gravel	1A	5	2.5									
			1B	4										
			1C	4										
5			2A	5										
			2B	5										
			2C	9										
	CLAYEY SAND (SC): light gray, dry, very dense, completely weathered sandstone	3A	50/4"							36	19	17		
		3B												
		3C												
	SANDY GRAVEL WITH SILT (GP): light yellowish brown, slightly moist, very dense	4A	50/6"											
		4B												
		4C												
	SANDY GRAVEL WITH SILT (GP): light yellowish brown, slightly moist, very dense	5A	30											
		5B	31											
		5C	31											
	Boring terminated at approximately 20 feet. No free groundwater observed. Boring backfilled with cement grout.													

GEO_TARGET BERRYESSA LOGS.GPJ GEOTECHNICAL 08.GDT 4/19/16

Completion Depth: 20.0 Date Started: 2/17/16 Date Completed: 2/17/16 California Sampler: 2.5-inch inner diameter SPT Sampler: 1.4-inch inner diameter	Drilling Equipment: Exploration GeoServices Mobile B-40 Drilling Method: Hollow Stem Drive Weight: 140 lbs Hole Diameter: 8-in Drop: 30-in Remarks:
--	--

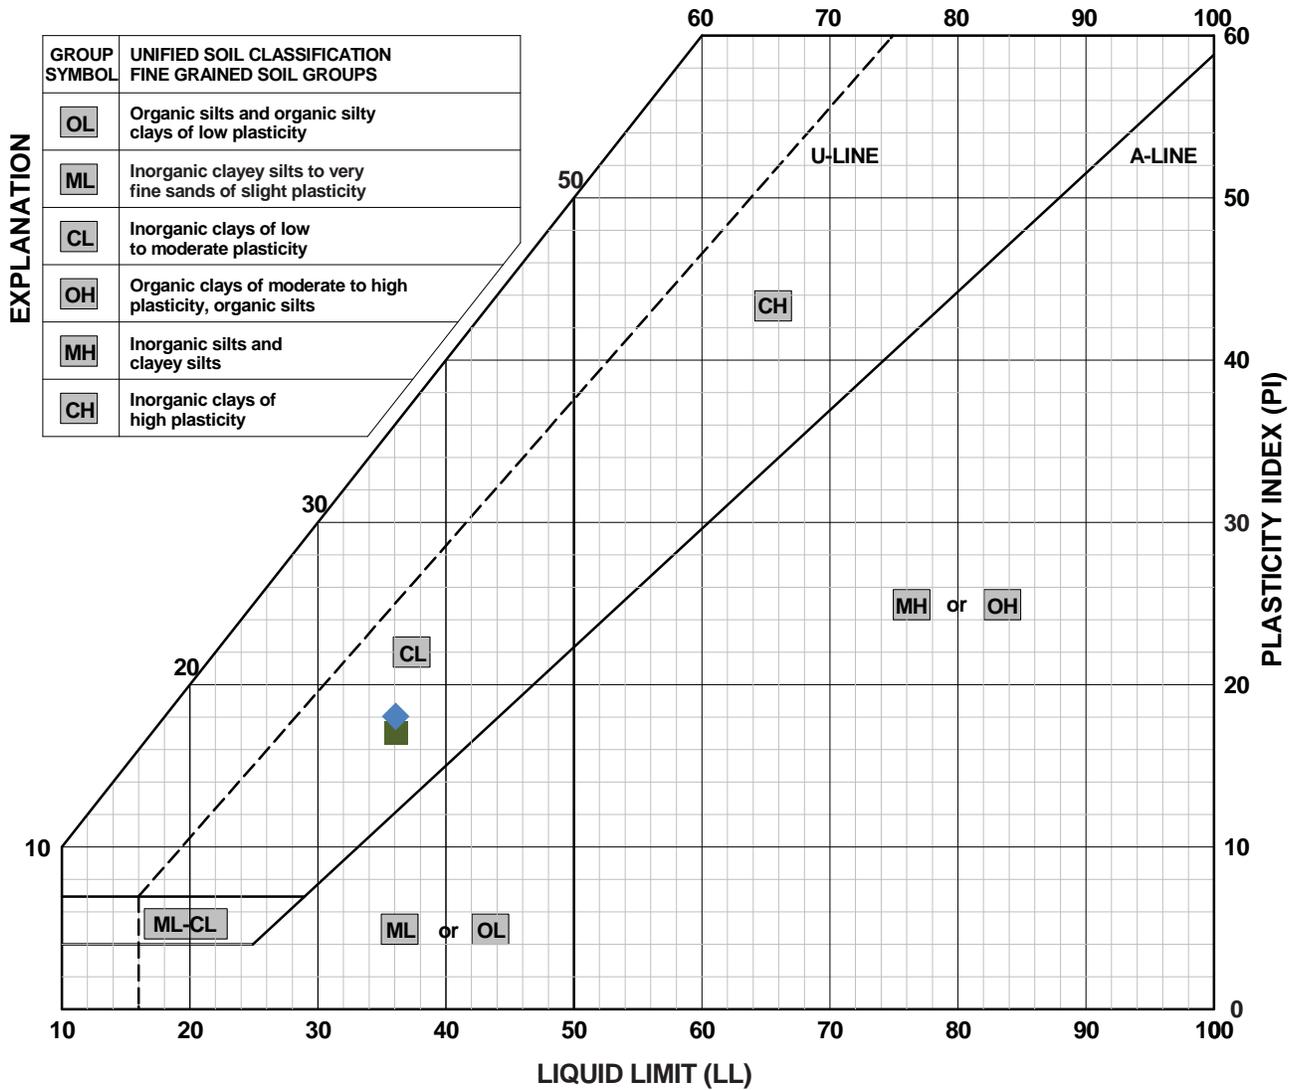

LEGEND:	SOURCE	DEPTH (ft)	LL	PL	PI	DESCRIPTION
◆	B-27	2.0	36	18	18	Brown Lean Clay w/ Sand & Gravel (CL)
■	B-28	9.0	36	19	17	Brown Clayey Sand (SC)

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.



PROJECT NO. G15-239-11L
 DRAWN: 3/4/16
 DRAWN BY: D. Tower
 CHECKED BY: B. Steen
 FILE NAME: Lab.indd

ATTERBERG LIMIT

Planned Solar Array Project
 Toyon Elementary School
 995 Bard Street
 San Jose, California



PLATE

J-1



Unconsolidated-Undrained Triaxial Test

ASTM D2850

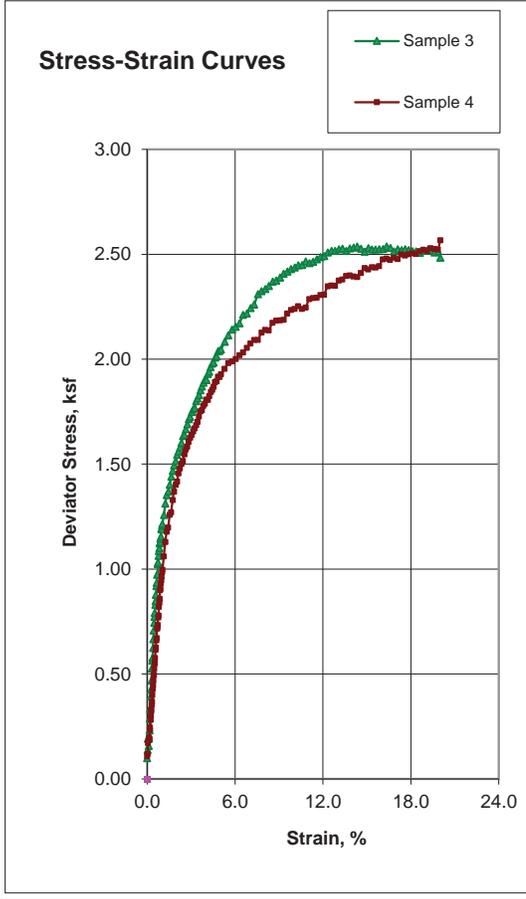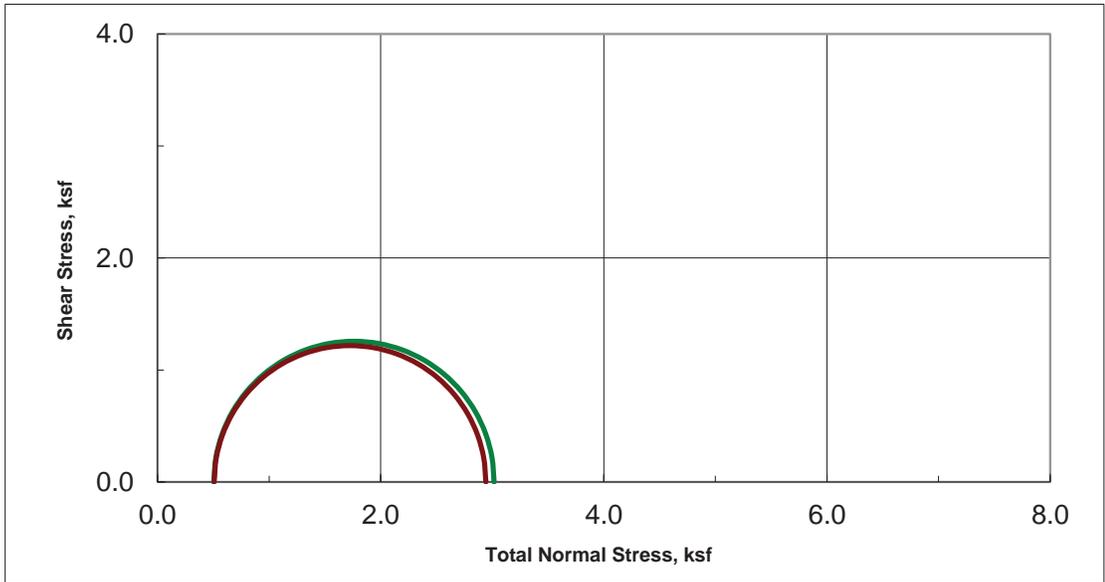

Sample Data				
	1	2	3	4
Moisture %			18.1	16.8
Dry Den,pcf			106.3	109.0
Void Ratio			0.586	0.547
Saturation %			83.4	83.0
Height in			5.02	5.02
Diameter in			2.41	2.38
Cell psi			3.5	3.5
Strain %			15.00	15.00
Deviator, ksf			2.513	2.435
Rate %/min			1.00	1.00
in/min			0.050	0.050
Job No.:	666-063d			
Client:	BSK Associates			
Project:	G15-239-11L			
Boring:			B-26	B-27
Sample:			1C	2B
Depth ft:			2.0	4.0
Visual Soil Description				
Sample #				
1				
2				
3	Brown CLAY w/ Sand and Gravel			
4	Brown CLAY w/ Sand and Gravel			
Remarks:				

Note: Strengths are picked at the peak deviator stress or 15% strain which ever occurs first per ASTM D2850.

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.



PROJECT NO. G15-239-11L
 DRAWN: 3/4/16
 DRAWN BY: D. Tower
 CHECKED BY: B. Steen
 FILE NAME: Lab.indd

**UNCONSOLIDATED-UNDRAINED
 TRIAXIAL COMPRESSION**

Planned Solar Array Project
 Toyon Elementary School
 995 Bard Street
 San Jose, California

PLATE

J-2

2 March, 2016

Job No. 1602189
Cust. No. 12667

Mr. Brad Steen
BSK Associates Engineers & Laboratories
324 Earhart Way
Livermore, CA 94551

Subject: Project No.: G15-239-11L
Project Name: Berryessa School District
Corrosivity Analysis – ASTM Test Methods

Dear Mr. Steen:

Pursuant to your request, CERCO Analytical has analyzed the soil samples submitted on February 23, 2016. Based on the analytical results, this brief corrosivity evaluation is enclosed for your consideration.

Based upon the resistivity measurements, samples 001, 004, 005, 007, 010 & 013 are classified as "corrosive" and samples 002, 003, 006, 008, 009, 011 & 012 are classified as "moderately corrosive". All buried iron, steel, cast iron, ductile iron, galvanized steel and dielectric coated steel or iron should be properly protected against corrosion depending upon the critical nature of the structure. All buried metallic pressure piping such as ductile iron firewater pipelines should be protected against corrosion.

The chloride ion concentrations range from none detected to 77 mg/kg. Because the chloride ion concentrations are less than 300 mg/kg, they are determined to be insufficient to attack steel embedded in a concrete mortar coating.

The sulfate ion concentrations range from none detected to 80 mg/kg and are determined to be insufficient to damage reinforced concrete structures and cement mortar-coated steel at these locations.

The pH of the soils range from 7.28 to 8.44 which does not present corrosion problems for buried iron, steel, mortar-coated steel and reinforced concrete structures.

The redox potentials range from 390 to 480-mV. Sample No. 001, 002, 003, 004, 005, 006, 007, 008, 009, 010, 012 and 013 are indicative of aerobic soil conditions, and sample 011 is indicative of potentially "slightly corrosive" soils resulting from anaerobic soil conditions.

This corrosivity evaluation is based on general corrosion engineering standards and is non-specific in nature. For specific long-term corrosion control design recommendations or consultation, please call *JDH Corrosion Consultants, Inc.* at (925) 927-6630.

We appreciate the opportunity of working with you on this project. If you have any questions, or if you require further information, please do not hesitate to contact us.

Very truly yours,
CERCO ANALYTICAL, INC.


J. Darby Howard, Jr., P.E.
President

JDH/jdl
Enclosure

Client: BSK Associates Engineers & Laboratories
 Client's Project No.: G-15-239-11L
 Client's Project Name: Berryessa School District
 Date Sampled: 23-Feb-16
 Date Received: 23-Feb-16
 Matrix: Soil
 Authorization: Signed Chain of Custody

Date of Report: 2-Mar-2016

Job/Sample No.	Sample I.D.	Redox (mV)	pH	Conductivity (umhos/cm)*	Resistivity (100% Saturation) (ohms-cm)	Sulfide (mg/kg)*	Chloride (mg/kg)*	Sulfate (mg/kg)*
1602189-001	B-2 @ 1'-3'	460	7.93	-	1,000	-	77	80
1602189-002	B-3 @ 1'-3'	420	8.21	-	2,600	-	N.D.	N.D.
1602189-003	B-6 @ 1'-3'	410	7.28	-	2,500	-	N.D.	N.D.
1602189-004	B-8 @ 1'-3'	400	8.44	-	1,700	-	N.D.	73
1602189-005	B-10 @ 1'-3'	440	8.24	-	1,400	-	35	44
1602189-006	B-12 @ 1'-2'	430	8.01	-	2,300	-	N.D.	N.D.
1602189-007	B-14 @ 1'-3'	420	8.14	-	1,700	-	N.D.	28
1602189-008	B-16 @ 1'-2'	410	7.37	-	2,900	-	N.D.	N.D.
1602189-009	B-19 @ 1'-2'	420	7.85	-	4,300	-	N.D.	N.D.
1602189-010	B-20 @ 1'-3'	410	7.72	-	700	-	37	76
1602189-011	B-23 @ 1'-3'	390	7.74	-	2,900	-	N.D.	23
1602189-012	B-26 @ 1'-3'	480	8.18	-	2,400	-	25	35
1602189-013	B-30 @ 1'-3'	460	8.12	-	1,600	-	44	45

Method:	ASTM D1498	ASTM D4972	ASTM D1125M	ASTM G57	ASTM D4658M	ASTM D4327	ASTM D4327
Reporting Limit:	-	-	10	-	50	15	15
	1-Mar-2016	1-Mar-2016	-	1-Mar-2016	-	1-Mar-2016	1-Mar-2016



Cheryl McMillen
 Laboratory Director

* Results Reported on "As Received" Basis
 N.D. - None Detected

APPENDIX K

SUMMARY OF COMPACTION REQUIREMENTS

SUMMARY OF COMPACTION RECOMMENDATIONS

Area	Compaction Recommendations (See Notes 1, 2, 3, 4, 5)
Subgrade Preparation and Placement of General Engineered Fill, Including Imported Fill	Compact upper 8 inches of exposed subgrade and entire fill to a minimum of 90 percent compaction at near optimum content for granular soils and to a minimum of 90 percent compaction at a minimum of 2 percent over optimum moisture content for clayey soils.
Trenches ⁵	Compact trench backfill to a minimum of 90 percent compaction at near optimum moisture content for granular soils and to a minimum of 90 percent compaction at a minimum of 2 percent over optimum moisture content for clayey soils. Compact upper 12 inches of trench backfill to a minimum of 95 percent relative compaction within paved areas. Proper granular bedding and shading should be used beneath and around new utilities.
Equipment Mat Slabs	Compact Class 2 aggregate baserock to a minimum of 95 percent compaction at near optimum moisture content.

Notes:

- (1) Depths are below finished subgrade elevation.
- (2) All compaction requirements refer to relative compaction as a percentage of the laboratory standard described by ASTM D 1557.
- (3) Fill material should be compacted in lifts not exceeding 8 inches in loose thickness.
- (4) All subgrades should be firm and stable.
- (5) Where fills are greater than 7 feet in depth below finish grade, the portion below a depth of 7 feet should be compacted to a minimum of 95 percent compaction.



GEOTECHNICAL INVESTIGATION REPORT

**VINCI PARK ELEMENTARY SCHOOL SHADE STRUCTURE
BERRYESSA UNION SCHOOL DISTRICT
SAN JOSE, CALIFORNIA**

BSK PROJECT NO. G17-178-11L

PREPARED FOR:

BERRYESSA UNION SCHOOL DISTRICT
1376 PIEDMONT ROAD
SAN JOSE, CALIFORNIA 95132

October 26, 2017



399 Lindbergh Avenue
Livermore CA 94551
P 925.315.3151
F 925.315.3152
www.bskassociates.com

October 26, 2017

Berryessa Union School District
505 12th Street, Suite 300
Oakland, California 94607

ATTENTION: Mr. Tony Kanastab

**SUBJECT: Geotechnical Site Investigation
Vinci Park Elementary School Shade Structure
San Jose, California**

Dear Mr. Kanastab:

We are pleased to submit our geotechnical site investigation and updated geologic and seismic hazards report for the proposed shade structure project at the Vinci Park Elementary School campus within the Berryessa Unified School district in San Jose, California. The enclosed report provides a description of the investigation performed and presents geotechnical site characterization in accordance with the site classifications and design recommendations established for the DSA Pre-Check Design by 4StelEngineering Structural Engineering on their plans entitled *National Carport Shade Structure*, dated 11/03/2014. A geologic and seismic hazard assessment is included as Appendix D to this report.

In summary, it is our opinion that the site does not pose significant geotechnical concerns that would preclude the shade structure provided the recommendations presented in our report are incorporated in design and construction. The main geotechnical and/or geologic hazards concerns for the project site are: 1) a moderate expansion potential of the near surface soils and 2) the potential for minor liquefaction-induced settlement, and 3) the potential for strong ground-shaking during a significant seismic event, which is typical for the entire Bay Area. The planned shade structure can be supported on drilled piers as currently shown in the DSA approved plans.

Conclusions and recommendations presented in the enclosed report are based on limited subsurface investigation and laboratory testing programs. Consequently, variations between anticipated and actual subsurface soil conditions may be found in localized areas during construction. If significant variation in the subsurface conditions is encountered during construction, BSK Associates (BSK) should review the recommendations presented herein and provide supplemental recommendations, if necessary.

Additionally, design plans should be reviewed by our office prior to their issuance for conformance with the general intent of our recommendations presented in the enclosed report.


We appreciate the opportunity of providing our services to you on this project and trust this report meets your needs at this time. If you have any questions concerning the information presented, please contact us at (925) 315-3151.

Sincerely,

BSK Associates, Inc.



Carrie Foulk, PE, GE #3016
Senior Geotechnical Engineer

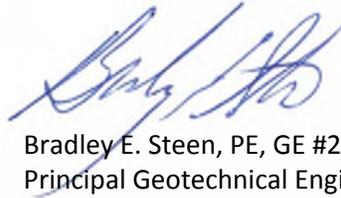

Bradley E. Steen, PE, GE #2839
Principal Geotechnical Engineer



Martin Cline, CEG #2084
Senior Engineering Geologist



Table of Contents

1.	INTRODUCTION	1
1.1	Project Description.....	1
1.2	Approach and Scope of Services	1
1.3	Previous Investigations	1
2.	SITE INVESTIGATION	3
2.1	Field Exploration	3
2.2	Laboratory Testing	4
3.	SITE CONDITIONS.....	5
3.1	Site Description	5
3.2	Subsurface Conditions.....	5
4.	DISCUSSION AND CONCLUSIONS.....	6
4.1	General.....	6
4.2	Geologic Hazards Summary	6
4.2.1	<i>Faulting and Seismicity</i>	<i>6</i>
4.2.2	<i>Liquefaction</i>	<i>6</i>
4.2.3	<i>Expansive Soils</i>	<i>8</i>
4.3	Foundation Design for Drilled Piers	8
4.4	Variations in Subsurface Conditions	8
4.5	Construction Considerations.....	9
4.6	Corrosion Potential	9
5.	ADDITIONAL SERVICES AND LIMITATIONS.....	11
5.1	Additional Services	11
5.2	Limitations.....	11



Plates and Appendices

PLATES

Plate 1 – Vicinity Map

Plate 2 – Site Plan

APPENDIX A – Boring Logs

Plate A-1 – Unified Soil Classification System (ASTM D2487/D2488)

Plate A-2 – Soil Description Key

Plate A-3 – Log Key

Log of Borings B-1

Previous Boring Logs of B-29 through B-31

APPENDIX B – Laboratory Test Results

B-1 – Previous Atterberg Limits for Borings B-29 and 31

B-2 – Unconsolidated-Undrained Triaxial Compression for Boring B-1

B-3 – Unconsolidated-Undrained Triaxial Compression for Borings B-29 and 30

Corrosivity Testing Results by Cerco Analytical (2 pages)

APPENDIX C – Previous CPT-3 Results & Revised Liquefaction Analysis of CPT-3

APPENDIX D – Geologic & Seismic Hazards Assessment Report



1. INTRODUCTION

This report presents the results of our geotechnical investigation and updated geologic and seismic hazards report for the installation of a shade structure at Vinci Park Elementary School within the Berryessa Union School District in San Jose, California. This report provides a description of the geotechnical investigation performed and presents geotechnical site characterization in accordance with the site classifications and design recommendations established for the DSA approved plans by National Carport Industries on their plans entitled *National Carport Industries Shade Structure*, dated November 3, 2014. This report is specifically intended to provide foundation design parameters for the proposed shade structure and should not be used to design other structures.

A Vicinity Map showing the location of the site is presented on Plate 1. Throughout this study, we have corresponded regularly with Mr. Kirk McKim of McKim Design Group.

1.1 Project Description

The proposed project consists of constructing a shade structure between the southern end of the main building and just north of the southern parking lot. The shade structure will be founded on drilled pier foundations. No significant site grading is currently planned. Cast-in-drilled-hole (CIDH) piers will be used to support the columns of the shade structure. These piers are dictated by the soil conditions and seismic setting. Anticipated pier diameter is 24 inches.

If the actual project differs significantly from that described above, we should be contacted to review and/or revise our conclusions and recommendations presented in this report.

1.2 Approach and Scope of Services

The purpose of this investigation was to explore and evaluate the subsurface conditions at the site in order to provide geotechnical input for the design and construction of the planned shade structure and associated earthwork for this project. The scope of services, as outlined in our August 15, 2017 proposal (File Number: GL17-15606), consisted of field investigation, laboratory testing, engineering analysis, and preparation of this report.

This investigation specifically excludes the assessment of site environmental characteristics, particularly those involving hazardous substances.

1.3 Previous Investigations

Our Principal Engineer, Mr. Brad Steen, PE, GE, had performed a previous geotechnical investigation and geologic and seismic hazard assessment during the solar array project of Vinci Park Elementary School in 2016. This past study is presented in the following document:



1. *Geotechnical Site Characterization, School Solar Project, Vinci Park Elementary School, Berryessa Union School District, San Jose, California*, dated April 24, 2016 by BSK Associates (File No.: G15-239-11L);

Pertinent information from this report was used in the preparation of this current report and the updated geologic and seismic hazards assessment report presented in Appendix D. Locations of the previous borings and CPT performed in past investigation are also shown on the Site Exploration Plan, Plate 2, and the borings logs are attached in Appendix A and CPT log is presented in Appendix C.



2. SITE INVESTIGATION

2.1 Field Exploration

A subsurface investigation was performed on October 5th, 2017 to evaluate the subsurface conditions at the site for the planned construction. As outlined in our proposal, the field investigation consisted of drilling one boring to characterize the shallow subsurface conditions (upper 20 feet) and to re-evaluate liquefaction based on our previous investigation data at the approximate locations shown on the Site Exploration Plan, Plate 2.

The location of the boring was estimated by our field engineer based on rough measurements from existing features at the site. The elevation shown on the boring log was estimated using the elevation information available on Google Earth Pro. As such the elevation and location of the boring should be considered approximate to the degree implied by the methods used.

Prior to subsurface exploration, Underground Service Alert (USA) was notified to provide utility clearance and the exploration location was cleared for detectable underground utilities by GeoTech Utility Locating of Moraga, California. Upon completion of the field investigation, the boring was backfilled with grout and capped with Quikrete. Excess cuttings generated during drilling were disposed and spread at the site in a landscaping or unimproved area.

Relatively undisturbed samples of the subsurface materials were obtained using a split spoon sampler with a 2.5-inch inside diameter (I.D.) and a 3-inch outside diameter (O.D.) fitted with stainless steel liners. The samplers were driven 18 inches using a 140-pound, semi-automatic trip hammer falling 30 inches, and blow counts for successive 6-inch penetration intervals were recorded and reported on the final boring log. After the sampler was withdrawn from the borehole, the samples were removed, sealed to reduce moisture loss, labeled, and returned to our laboratory. Prior to sealing the samples, strength characteristics of the cohesive soil samples recovered were evaluated using a hand-held pocket penetrometer. The results of these tests are shown adjacent to the samples on the boring log.

Exploration GeoServices of San Jose, California drilled the boring using a truck-mounted drill-rig equipped with hollow-stem augers. Soil classifications made in the field from auger cuttings and samples were re-evaluated in the laboratory after further examination and testing. The soils were classified in the field in general accordance with the Unified Soil Classification System (Visual/Manual Procedure - ASTM D2488). Where laboratory tests were performed, the designations reflect the laboratory test results in general accordance with ASTM D2487 as generally presented on Plate A-1. The Soil Description Key and Log Key are presented in Plate A-2 and A-3. Sample classifications, blow counts recorded during sampling, and other related information were recorded on the soil boring log. A discussion of the subsurface conditions encountered at the site is presented in the "Subsurface Conditions" section of this report.



2.2 Laboratory Testing

The laboratory testing program, for this investigation as well as the previous investigation, was formulated with the emphasis on evaluating the density, moisture content, strength, and plasticity properties of the soils encountered. Classification tests included dry unit weight, natural water content, and Atterberg Limits. These tests aid in classifying the soils from selected samples and are used to correlate the results of other field and laboratory tests conducted on samples from different borings or different depths. Where possible, testing of engineering properties included triaxial compression tests to evaluate strength parameters.

Most of the laboratory test results are presented on the boring logs. The results of the previous Atterberg Limits and previous and current TXUU tests are presented graphically in Appendix B.

A chemical analysis was performed on one sample of the near-surface soils during the 2016 investigation at the site to assist in evaluating the corrosive potential of the soil. The corrosivity testing and evaluation was performed by CERCO Analytical, a State-certified laboratory in Concord, California for redox potential, pH, resistivity, chloride content, and sulfate content in accordance with ASTM test methods. The results of the corrosion testing are discussed in Section 4.6 and presented in Appendix B.



3. SITE CONDITIONS

3.1 Site Description

Vinci Park Elementary School is located at 1311 Vinci Park Way in San Jose, California. The site is located in a residential neighborhood. The approximately 11-acre parcel is irregular in shape and is bounded by Vinci Park to the north, residential housing to the south and Vinci Park Way to the east and west. The main school building, several portables and a paved parking area occupy the western half of the parcel. Asphalt paved play courts and grassy playfields occupy the eastern half of the parcel. The proposed location of the shade structure will be between the southern edge of the main building and just north of the southern parking lot, as shown on Plate 2.

Topography of the site, as well as the proposed array locations, is generally flat with elevation of approximately 102 feet above mean sea level. The planned shade structure will not be located near any slopes.

3.2 Subsurface Conditions

The underlying stratigraphy of the site consists of interbedded alluvial soils. Based on our field explorations, this alluvium consists primarily of firm to hard lean clays interbedded with some clayey sands, and poorly graded sand with varying amounts of clay. The surface clays are typically firm and exhibit low plasticity. The laboratory test results are indicative of clays with low expansion potential when subjected to changes in moisture content.

The Historical Depth to Groundwater Map, Figure D-3 (Appendix D), presents an historical groundwater contour map from the California Geologic Survey Seismic Hazard Zone Report for the area (CGS, 2001). This map indicates that the historical high depth to groundwater was approximately 22 feet below ground surface (bgs). During our current investigation, groundwater was encountered in our boring at 18 feet bgs on October 5, 2017. Accordingly, we have used a higher groundwater table in our analyses. It should be noted that groundwater levels can fluctuate several feet depending on factors such as seasonal rainfall, groundwater withdrawal, and construction activities on this or adjacent properties.

The above is a general description of soil and groundwater conditions encountered at the site in the borings and CPT for the current and previous investigation. For a more detailed description of the soils encountered, refer to the attached boring and CPT logs.

It should be noted that soil and subsurface conditions can deviate from those conditions encountered at the boring and CPT locations. If significant variation in the subsurface conditions is encountered during construction, it may be necessary for BSK to review the recommendations presented herein and recommend adjustments as necessary.



4. DISCUSSION AND CONCLUSIONS

4.1 General

Based on the results of our field investigation, it is our opinion that the proposed shade structure may be supported on drilled piers, as currently planned. The main geotechnical concern for the project is the presence of loose granular deposits below the groundwater level which could experience minor potential liquefaction settlement during a significant seismic event. Additionally, temporary excavations within the more granular soils at the site may not stand near-vertical (e.g. drilled piers). We estimate that total elastic settlements should be less than ½ inch, and differential settlements over a 50-foot distance should be less than ½ inch. Liquefaction-induced settlement is discussed below in Section 4.2.2.

These conclusions are based on the assumption that the recommendations presented in this report will be incorporated in the design and construction of this project. Presented below are recommendations for foundations, seismic considerations, earthwork, and construction considerations for this project.

4.2 Geologic Hazards Summary

As required by the State of California in Title 24 of the California Building Code, a geologic and seismic hazard evaluation is needed for school developments. BSK has provided an evaluation of the project, along with a discussion of the geology of the site and its vicinity in a separate geologic and seismic hazards assessment report presented in Appendix D. In this assessment, we conclude that the planned structures are free of most geologic and seismic hazards except for 1) strong ground shaking from earthquakes, which is typical of the entire San Francisco Bay Area, and 2) the potential for minor liquefaction settlement at depth. A summary of the key geologic and seismic hazards is presented below.

4.2.1 *Faulting and Seismicity*

The site is not located within the California Geologic Survey (CGS) designated Alquist-Priolo Earthquake Fault Zone, and no mapped active fault traces are known to transverse the site. Therefore, the risk of ground rupture within the limits of the site is considered to be very low. However, San Jose is located in a region characterized by active and potentially active faults and recurring seismic activity. During the life cycle of the project, it is probable that at least one moderate to strong earthquake will occur, potentially causing strong ground shaking in the vicinity of the project. Seismic design criteria are presented in the Geologic and Seismic Hazards Assessment, Appendix D.

4.2.2 *Liquefaction*

Liquefaction is a condition where saturated, granular soils undergo a substantial loss of strength and deformation due to pore pressure increase, resulting from cyclic stress application induced by earthquakes. In the process, the soil acquires mobility sufficient to permit both horizontal and vertical



movements if the soil is not confined. Soils most susceptible to liquefaction are loose, clean, uniformly graded, silt and fine sand, as well as some lean clay deposits.

In order for liquefaction triggering to occur due to ground shaking, it is generally accepted that four conditions will exist:

- The subsurface soils are in a relatively loose state
- The soils are saturated
- The soils have low plasticity
- Ground shaking is of sufficient intensity to act as a triggering mechanism

In addition, after soil liquefies, dissipation of the excess pore pressures can produce volume changes within the liquefied soil layer, which can result in ground surface settlement.

We have reevaluated the liquefaction analyses for CPT-3, using the methods proposed by Boulanger and Idriss (2014)¹, due to shallower groundwater encountered in this investigation than was assumed in our previous analysis. For our analyses, we used peak ground accelerations of 0.545g associated with an earthquake magnitude of M6.7. Groundwater was encountered in our boring at an approximate depth of 18 feet and this depth was used for our analysis. The analysis performed suggested potential liquefaction-induced settlements of about ½ inch could occur during a design level earthquake. The reevaluated liquefaction analyses for CPT-3 is shown in Appendix C.

The surface settlement associated with these at-depth densifications would likely be somewhat less than the predicted magnitude due to attenuation of deformation as it migrates to the surface. As noted in Special Publication 117A, "Guidelines for Evaluating and Mitigating Seismic Hazards in California, 2008", CGS states that *"it is very difficult to reliably estimate the amount of localized differential settlement likely to occur as part of the overall predicted settlement: localized differential settlements on the order of up to two-thirds of the total settlements anticipated should be assumed unless more precise predictions of differential settlements can be made"*. On this basis, our predicted differential settlement would be about less than ½ inch at the project site. Based on Youd and Garris (1995)², we believe that the potential for ground surface disruption (such as sand boils, ground fissures, etc.) to occur at site is low due to a sufficient thickness of the non-liquefiable clayey soils above the potentially liquefiable layers.

¹ Boulanger, R. W., and Idriss, I. M. (2014). "CPT and SPT based liquefaction triggering procedures." Report No. UCD/CGM-14/01, Center for Geotechnical Modeling, Department of Civil and Environmental Engineering, University of California, Davis, CA, 134 pp.

² Youd, T. L. and Garris, C. T. (1995), Liquefaction-Induced Ground-Surface Disruption, Journal of Geotechnical Engineering, ASCE, Vol. 121, No. 11, November, pp. 805-809.



4.2.3 Expansive Soils

Our prior laboratory test data indicated that the near surface soils encountered in our borings have a low expansion potential when subjected to change in moisture content. Our visual observation of the near surface soil in our current boring matched what we had previously encountered.

4.3 Foundation Design for Drilled Piers

As part of the previously discussed DSA approved pre-check plans, a list of assumed soil/rock physical parameters for three design cases is shown on the table below (as shown on the previously referenced plans).

ALLOWABLE BEARING AND LATERAL BEARING		
SOILS CLASS	ALLOWABLE BEARING PRESSURE (psf)	LATERAL BEARING (psf/ft BELOW NATURAL GRADE)
CLASS W	1500	200
CLASS X	2000	300
CLASS Y	2000	400

We evaluated the site-specific properties of the site based on our soil borings and laboratory test results. The allowable lateral bearing pressure for the site is 300 psf/ft, which can be applied across two pier diameters (or 600 psf/ft across a single pier diameter). In addition, the allowable vertical bearing pressure is at least 2000 psf. These values include a factor of safety of at least two, and may be increased by one-third for resisting total loads, including wind and seismic. Both the vertical and lateral design values exceed Soils Class Y. **Therefore, we conclude that Soils Class Y is appropriate for this shade structure and the pier foundations shown on Sheet S-8 of the project plans.**

4.4 Variations in Subsurface Conditions

Our interpretations of soil and groundwater conditions, as described above, are based on data from the borings and laboratory test data that we collected for this study. The conclusions and recommendations provided in this report are based on these interpretations. Therefore, it is likely that undisclosed variations in subsurface conditions exist at this site.

We recommend that we be retained during construction to confirm our interpretations. Should variations from our interpretations be observed, we will need to evaluate whether any revisions should be made to our recommendations.



4.5 Construction Considerations

We recommend that drilled pier steel reinforcement and concrete be placed within about 4 to 6 hours upon completion of each drilled hole. As a minimum, the holes should be poured the same day they are drilled. The steel reinforcement should be centered in the drilled hole. Concrete used for pier construction should be discharged vertically into the holes to reduce aggregate segregation. Under no circumstances should concrete be allowed to free-fall against either the steel reinforcement or the sides of the excavation during construction.

Free groundwater was encountered in our boring at an approximate depth of 18 feet. However, groundwater levels can fluctuate depending on factors such as seasonal rainfall, groundwater withdrawal, and construction activities on this or adjacent properties. Therefore, the foundation contractor should be prepared for groundwater. If water more than 6 inches deep is present during concrete placement, either the water needs to be pumped out or the concrete needs to be placed into the hole using tremie methods. If tremie methods are used, the end of the tremie pipe must remain below the surface of the in-place concrete at all times. **Given the presence of sands and gravels at the site and the variability of silt and clay content (which tend to bind the soils), the contractor installing the drilled piers needs to be prepared to handle unstable borehole conditions.** Unit prices for dewatering and/or tremie placement methods and for casing should be obtained during the bidding process.

The bottom of the drilled holes should be clean such that no loose soil remains in the hole prior to placement of concrete. The bottom of the pier excavation should also be hand-tamped with an extension tool. A representative from BSK should be present to observe drilled holes to confirm bottom conditions prior to placing steel reinforcement.

Concrete used for pier construction should be discharged vertically into the drilled holes to reduce aggregate segregation. Under no circumstances during pile construction should concrete be allowed to free-fall against either the steel reinforcement or the sides of the excavation.

In order to develop the design skin friction, concrete used for drilled pier construction should have a slump ranging from 6 to 8 inches. The concrete mix should be designed with appropriate admixtures and/or water/cement ratios to achieve these recommended slumps. Adding water to a conventional mix to achieve the recommended slump should not be allowed. For concrete mixes with slumps over 6 inches, vibration of the concrete during placement is generally not recommended as aggregate settlement may result in the lack of aggregate within the upper portion of the pier.

4.6 Corrosion Potential

Results of corrosion testing by CERCO Analytical for the site is presented in Appendix B. Also included is an evaluation of the results of the corrosion tests. Based upon the resistivity measurements, the samples collected at the site, at shallow depths below the ground surface, are classified as “corrosive”. All buried iron, steel, cast iron, ductile iron, galvanized steel, and dielectric coated steel or iron should be properly



protected against corrosion depending upon the critical nature of the structure. All buried metallic pressure piping such as ductile iron firewater pipelines should be protected against corrosion. Given the relatively low levels of measured sulfate ion concentration within our limited sampling, we believe that Type I/ Type II concrete should provide adequate resistance to the deleterious effects of sulfate at the site. Since we are not corrosion specialists, a corrosion testing firm should be contacted for specific design details.

A more detailed investigation may include more or fewer concerns and should be directed by a corrosion expert. Consideration should also be given to soils in contact with concrete that may be imported to the site during construction, such as topsoil and landscaping materials. Also, on-site cutting and filling may result in soils contacting concrete that were not anticipated at the time of the investigation.

As an alternative or in addition to meeting CBC mix requirements, your Structural Engineer, architect or corrosion expert may choose to isolate the concrete from the corrosive soils or from ground or surface water that may leach corrosive materials from the soils and contact the concrete.



5. ADDITIONAL SERVICES AND LIMITATIONS

5.1 Additional Services

The review of plans and specifications, and field observation and testing during construction by BSK are an integral part of the conclusions and recommendations made in this report. If BSK is not retained for these services, the client will be assuming BSK's responsibility for any potential claims that may arise during or after construction due to the misinterpretation of the recommendations presented herein. The recommended tests, observations, and consultation by BSK during construction include, but are not limited to:

- review of plans and specifications; and
- observation of drilled pier construction.

5.2 Limitations

The recommendations contained in this report are based on our field observations and subsurface exploration, limited laboratory tests, and our present knowledge of the proposed construction. It is possible that soil conditions could vary between or beyond the points explored. If soil conditions are encountered during construction that differ from those described herein, we should be notified immediately in order that a review may be made, and any supplemental recommendations provided. If the scope of the proposed construction, including the proposed loads or structural locations, changes from that described in this report, our recommendations should also be reviewed.

We prepared this report in substantial accordance with the generally accepted geotechnical engineering practice as it exists in the site area at the time of our study. No warranty, either express or implied, is made. The recommendations provided in this report are based on the assumption that an adequate program of tests and observations will be conducted by BSK during the construction phase in order to evaluate compliance with our recommendations. Other standards or documents referenced in any given standard cited in this report, or otherwise relied upon by the author of this report, are only mentioned in the given standard; they are not incorporated into it or "included by reference", as that latter term is used relative to contracts or other matters of law.

This report may be used only by the Client and only for the purposes stated within a reasonable time from its issuance, but in no event later than two (2) years from the date of the report, or if conditions at the site have changed. If this report is used beyond this period, BSK should be contacted to evaluate whether site conditions have changed since the report was issued.

Also, land or facility use, on and off-site conditions, regulations, or other factors may change over time, and additional work may be required with the passage of time. Based on the intended use of the report, BSK may recommend that additional work be performed and that an updated report be issued.

The scope of work for this subsurface investigation and geotechnical report did not include environmental assessments or evaluations regarding the presence or absence of wetlands or hazardous substances in the soil, surface water, or groundwater at this site.




BSK conducted subsurface exploration and provided recommendations for this project. We understand that BSK will be given the opportunity to perform a formal geotechnical review of the final project plans and specifications. In the event BSK is not retained to review the final project plans and specifications to evaluate if our recommendations have been properly interpreted, we will assume no responsibility for misinterpretation of our recommendations.

We recommend that all foundation excavations and earthwork during construction be monitored by a representative from BSK, including site preparation and installation of drilled piers. The purpose of these services would be to provide BSK the opportunity to observe the actual soil conditions encountered during construction, evaluate the applicability of the recommendations presented in this report to the soil conditions encountered, and recommend appropriate changes in design or construction procedures if conditions differ from those described herein.



PLATES



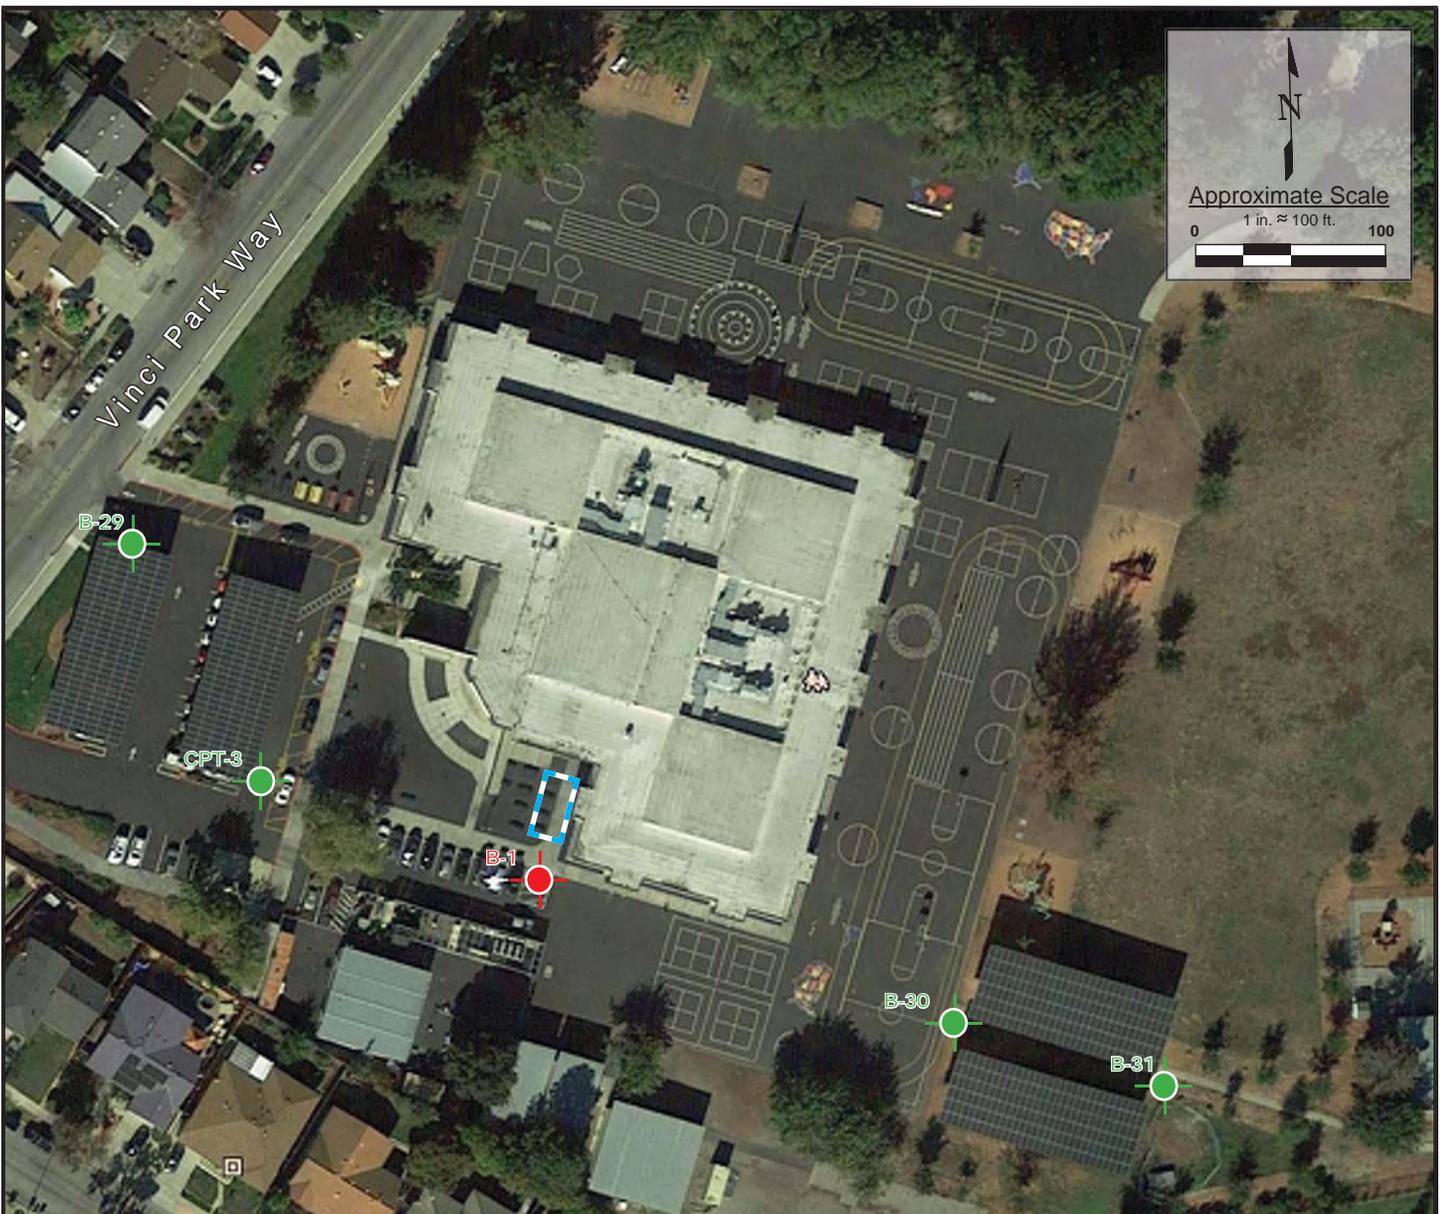

References: 1. <http://earth.google.com>, 2017

Legend

- B-29 | — Approximate Previous Boring and CPT Locations (BSK, 2016)
- B-1 | — Approximate Location of Current Boring
- Approximate Location of Shade Structure

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.



PROJECT NO. G17-178-11L

DRAWN: 10/6/17

DRAWN BY: D. Tower

CHECKED BY: B. Steen

FILE NAME:
SitePlan.indd

SITE EXPLORATION PLAN

Planned Solar Array Project
Vinci Park Elementary School
1311 Vinci Park Way
San Jose, California

PLATE

2

APPENDIX A

BORING LEGENDS AND BORING LOGS



UNIFIED SOIL CLASSIFICATION SYSTEM (ASTM D 2487/2488)

MAJOR DIVISIONS

GRAPHIC LOG

TYPICAL DESCRIPTIONS

MAJOR DIVISIONS	GRAPHIC LOG	TYPICAL DESCRIPTIONS				
COARSE GRAINED SOILS (More than half of material is larger than the #200 sieve)	GRAVELS (More than half of coarse fraction is larger than the #4 sieve)	CLEAN GRAVELS WITH <5% FINES $Cu \geq 4$ and $1 \leq Cc \leq 3$		GW	WELL-GRADED GRAVELS, GRAVEL-SAND MIXTURES WITH LITTLE OR NO FINES	
		CLEAN GRAVELS WITH <5% FINES $Cu < 4$ and/or $1 > Cc > 3$		GP	POORLY-GRADED GRAVELS, GRAVEL-SAND MIXTURES WITH LITTLE OR NO FINES	
		GRAVELS WITH 5 to 12% FINES	$Cu \geq 4$ and $1 \leq Cc \leq 3$		GW-GM	WELL-GRADED GRAVELS, GRAVEL-SAND MIXTURES WITH LITTLE FINES
			$Cu \geq 4$ and $1 \leq Cc \leq 3$		GW-GC	WELL-GRADED GRAVELS, GRAVEL-SAND MIXTURES WITH LITTLE CLAY FINES
			$Cu < 4$ and/or $1 > Cc > 3$		GP-GM	POORLY-GRADED GRAVELS, GRAVEL-SAND MIXTURES WITH LITTLE FINES
			$Cu < 4$ and/or $1 > Cc > 3$		GP-GC	POORLY-GRADED GRAVELS, GRAVEL-SAND MIXTURES WITH LITTLE CLAY FINES
		GRAVELS WITH >12% FINES			GM	SILTY GRAVELS, GRAVEL-SILT-SAND MIXTURES
					GC	CLAYEY GRAVELS, GRAVEL-SAND-CLAY MIXTURES
				GC-GM	CLAYEY GRAVELS, GRAVEL-SAND-CLAY-SILT MIXTURES	
	SANDS (More than half of coarse fraction is smaller than the #4 sieve)	CLEAN SANDS WITH <5% FINES	$Cu \geq 6$ and $1 \leq Cc \leq 3$		SW	WELL-GRADED SANDS, SAND-GRAVEL MIXTURES WITH LITTLE OR NO FINES
			$Cu < 6$ and/or $1 > Cc > 3$		SP	POORLY-GRADED SANDS, SAND-GRAVEL MIXTURES WITH LITTLE OR NO FINES
		SANDS WITH 5 to 12% FINES	$Cu \geq 6$ and $1 \leq Cc \leq 3$		SW-SM	WELL-GRADED SANDS, SAND-GRAVEL MIXTURES WITH LITTLE FINES
			$Cu \geq 6$ and $1 \leq Cc \leq 3$		SW-SC	WELL-GRADED SANDS, SAND-GRAVEL MIXTURES WITH LITTLE CLAY FINES
$Cu < 6$ and/or $1 > Cc > 3$				SP-SM	POORLY-GRADED SANDS, SAND-GRAVEL MIXTURES WITH LITTLE FINES	
$Cu < 6$ and/or $1 > Cc > 3$				SP-SC	POORLY-GRADED SANDS, SAND-GRAVEL MIXTURES WITH LITTLE CLAY FINES	
SANDS WITH >12% FINES				SM	SILTY SANDS, SAND-GRAVEL-SILT MIXTURES	
				SC	CLAYEY SANDS, SAND-GRAVEL-CLAY MIXTURES	
				SC-SM	CLAYEY SANDS, SAND-SILT-CLAY MIXTURES	
FINE GRAINED SOILS (More than half of material is smaller than the #200 sieve)	SILTS AND CLAYS (Liquid limit less than 50)			ML	INORGANIC SILTS AND VERY FINE SANDS, SILTY OR CLAYEY FINE SANDS, SILTS WITH SLIGHT PLASTICITY,	
				CL	INORGANIC CLAYS OF LOW TO MEDIUM PLASTICITY, GRAVELLY CLAYS, SANDY CLAYS, SILTY CLAYS, LEAN CLAYS	
				CL-ML	INORGANIC CLAYS-SILTS OF LOW PLASTICITY, GRAVELLY CLAYS, SANDY CLAYS, SILTY CLAYS, LEAN CLAYS	
	SILTS AND CLAYS (Liquid limit greater than 50)			OL	ORGANIC SILTS & ORGANIC SILTY CLAYS OF LOW PLASTICITY	
				MH	INORGANIC SILTS, MICACEOUS OR DIATOMACEOUS FINE SAND OR SILT	
				CH	INORGANIC CLAYS OF HIGH PLASTICITY, FAT CLAYS	
		OH	ORGANIC CLAYS & ORGANIC SILTS OF MEDIUM-TO-HIGH PLASTICITY			



PROJECT NO. G17-178-11L
 DRAWN: 10/6/17
 DRAWN BY: D. Tower
 CHECKED BY: B. Steen
 FILE NAME: Legend.indd

UNIFIED SOIL CLASSIFICATION SYSTEM (ASTM D 2487/2488)

Planned Shade Structure Project
 Vinci Park Elementary School
 1311 Vinci Park Way
 San Jose, California

PLATE

A-1

SOIL DESCRIPTION KEY

MOISTURE CONTENT

DESCRIPTION	ABBR	FIELD TEST
Dry	D	Absence of moisture, dusty, dry to the touch
Moist	M	Damp but no visible water
Wet	W	Visible free water, usually soil is below water table

CEMENTATION

DESCRIPTION	FIELD TEST
Weakly	Crumbles or breaks with handling or slight finger pressure
Moderately	Crumbles or breaks with considerable finger pressure
Strongly	Will not crumble or break with finger pressure

PLASTICITY


DESCRIPTION	ABBR	FIELD TEST
Non-plastic	NP	A 1/8-in. (3 mm) thread cannot be rolled at any water content.
Low (L)	LP	The thread can barely be rolled and the lump or thread cannot be formed when drier than the plastic limit.
Medium (M)	MP	The thread is easy to roll and not much time is required to reach the plastic limit. The thread cannot be rerolled after reaching the plastic limit. The lump or thread crumbles when drier than the plastic limit
High (H)	HP	It takes considerable time rolling and kneading to reach the plastic limit. The thread can be rerolled several times after reaching the plastic limit. The lump or thread can be formed without crumbling when drier than the plastic limit

GRAIN SIZE

DESCRIPTION	SIEVE SIZE	GRAIN SIZE	APPROXIMATE SIZE	
Boulders	>12"	>12"	Larger than basketball-sized	
Cobbles	3 - 12"	3 - 12"	Fist-sized to basketball-sized	
Gravel	coarse	3/4 - 3"	3/4 - 3"	Thumb-sized to fist-sized
	fine	#4 - 3/4"	0.19 - 0.75"	Pea-sized to thumb-sized
Sand	coarse	#10 - #4	0.075 - 0.425"	Rock salt-sized to pea-sized
	medium	#40 - #10	0.075 - 0.075"	Sugar-sized to rock salt-sized
	fine	#200 - #10	0.0025 - 0.075"	Flour-sized to sugar-sized
Fines	Passing #200	<0.0025"	Flour-sized and smaller	

REACTION WITH HCl

DESCRIPTION	FIELD TEST
None	No visible reaction
Weak	Some reaction, with bubbles forming slowly
Strong	Violent reaction, with bubbles forming immediately



ANGULARITY

DESCRIPTION	ABBR	CRITERIA	Illustration
Angular	A	Particles have sharp edges and relatively plane sides with unpolished surfaces	
Subangular	SA	Particles are similar to angular description but have rounded edges	
Subrounded	SR	Particles have nearly plane sides but have well-rounded corners and edges	
Rounded	R	Particles have smoothly curved sides and no edges	

APPARENT / RELATIVE DENSITY - COARSE-GRAINED SOIL

APPARENT DENSITY	ABBR	SPT (# blows/ft)	MODIFIED CA SAMPLER (# blows/ft)	CALIFORNIA SAMPLER (# blows/ft)	RELATIVE DENSITY (%)	FIELD TEST
Very Loose	VL	<4	<4	<5	0 - 15	Easily penetrated with 1/2-inch reinforcing rod by hand
Loose	L	4 - 10	5 - 12	5 - 15	15 - 35	Difficult to penetrate with 1/2-inch reinforcing rod pushed by hand
Medium Dense	MD	10 - 30	12 - 35	15 - 40	35 - 65	Easily penetrated a foot with 1/2-inch reinforcing rod driven with 5-lb. hammer
Dense	D	30 - 50	35 - 60	40 - 70	65 - 85	Difficult to penetrate a foot with 1/2-inch reinforcing rod driven with 5-lb. hammer
Very Dense	VD	>50	>60	>70	85 - 100	Penetrated only a few inches with 1/2-inch reinforcing rod driven with 5-lb. hammer



PROJECT NO. G17-178-11L
 DRAWN: 10/6/17
 DRAWN BY: D. Tower
 CHECKED BY: B. Steen
 FILE NAME: Legend.indd

SOIL DESCRIPTION KEY

Planned Shade Structure Project
 Vinci Park Elementary School
 1311 Vinci Park Way
 San Jose, California

PLATE

A-2

LOG SYMBOLS

	BULK / BAG SAMPLE	-4	PERCENT FINER THAN THE NO. 4 SIEVE (ASTM Test Method C 136)
	SPLIT BARREL SAMPLER (2-1/2 inch outside diameter)	-200	PERCENT FINER THAN THE NO. 200 SIEVE (ASTM Test Method C 117)
	SPLIT BARREL SAMPLER (3 inch outside diameter)	LL	LIQUID LIMIT (ASTM Test Method D 4318)
	STANDARD PENETRATION SPLIT SPOON SAMPLER (2 inch outside diameter)	PI	PLASTICITY INDEX (ASTM Test Method D 4318)
	CONTINUOUS CORE	TXUU	UNCONSOLIDATED UNDRAINED TRIAXIAL COMPRESSION (EM 1110-1-1906)/ASTM Test Method D 2850
	SHELBY TUBE	EI	EXPANSION INDEX (UBC STANDARD 18-2)
	ROCK CORE	COL	COLLAPSE POTENTIAL
	GROUNDWATER LEVEL (encountered at time of drilling)	UC	UNCONFINED COMPRESSION (ASTM Test Method D 2166)
	GROUNDWATER LEVEL (measured after drilling)		
	SEEPAGE	MC	MOISTURE CONTENT (ASTM Test Method D 2216)

GENERAL NOTES

Boring log data represents a data snapshot.

This data represents subsurface characteristics only to the extent encountered at the location of the boring.

The data inherently cannot accurately predict the entire subsurface conditions to be encountered at the project site relative to construction or other subsurface activities.

Lines between soil layers and/or rock units are approximate and may be gradual transitions.

The information provided should be used only for the purposes intended as described in the accompanying documents.

In general, Unified Soil Classification System designations presented on the logs were evaluated by visual methods.

Where laboratory tests were performed, the designations reflect the laboratory test results.



PROJECT NO. G17-178-11L

DRAWN: 10/6/17

DRAWN BY: D. Tower

CHECKED BY: B. Steen

FILE NAME:
Legend.indd

LOG KEY

Planned Shade Structure Project
Vinci Park Elementary School
1311 Vinci Park Way
San Jose, California

PLATE

A-3



BSK Associates
 399 Lindbergh Avenue
 Livermore, CA 94551
 Telephone: (925)-315-3151
 Fax: (925)-315-3152

LOG OF BORING NO. B-1

Project Name: **Vinci Park Elementary School Shade Structure**
 Project Number: **G17-178-11L**
 Project Location: **1311 Vinci Park Way, San Jose, CA**
 Logged by: **D. Tower**
 Checked by:

Depth, feet	Graphic Log	Surface El.: 102 ft Location: No parking section of parking lot	Samples	Sample Number	Penetration Blows / 6 inches	Pocket Penetrometer, TSF	% Passing No. 200 Sieve	In-Situ Dry Weight (pcf)	In-Situ Moisture Content (%)	Liquid Limit	Plastic Limit	Plasticity Index
		ASPHALT: approximately 2 inches of asphalt										
		GRAVEL: approximately 3 inches thick, possibly aggregate base										
		POORLY GRADED SAND WITH GRAVEL (SP): brown, slightly moist, fine to coarse grained sand, fine to coarse subrounded gravel										
		increased clay content										
5		LEAN CLAY WITH SAND (CL): olive brown, slightly moist, low plasticity, firm to hard, high silt content, trace fine grained sand		1A 1B 1C	5 6 10			99	18			
		iron and manganese oxide staining TXUU (see plate B-2) c=737 psf		2A 2B 2C	4 4 5	1.0 2.0		92	29			
		medium plasticity, decreased silt content		3A 3B 3C	5 8 9	1.5						
10		olive yellow, increased silt content, slightly porous, calcium carbonate present		4A 4B 4C	7 9 13	2.5		108	20			
15		yellowish brown mottled with light brownish gray, moist, increased fine grained sand, iron oxide staining		5A 5B 5C	6 11 14	1.5 1.0						
20		Boring terminated at approximately 20 feet. Water observed at approximately 18 feet. Boring was backfilled with cement grout and topped with approximately 6 inches of Quikcrete.										

GEO_TARGET VINCI PARK SHADE STRUCTURE BORING LOGS.GPJ GEOTECHNICAL 08.GDT 10/16/17

Completion Depth: 20.0
Date Started: 10/5/17
Date Completed: 10/5/17
California Sampler: 2.5-inch inner diameter
SPT Sampler:

Drilling Equipment: Exploration GeoServices Mobile B-53
Drilling Method: Hollow Stem
Drive Weight: 140 lbs
Hole Diameter: 8-in
Drop: 30-in
Remarks:



BSK Associates
 324 Earhart Way
 Livermore, CA 94551
 Telephone: 925-315-3151
 Fax: 925-315-3152

LOG OF BORING NO. B-29

Project Name: **Berryessa School District Solar Array Project**
 Project Number: **G15-239-11L**
 Project Location: **Berryessa School District**
 Logged by: **G. Minerale**
 Checked by: **D. Tower**

Depth, feet	Graphic Log	Surface El.: 98 ft Location: Vinci Park Elementary School	Samples	Sample Number	Penetration Blows / Foot	Pocket Penetrometer, TSF	% Passing No. 200 Sieve	In-Situ Dry Weight (pcf)	In-Situ Moisture Content (%)	Liquid Limit	Plastic Limit	Plasticity Index
MATERIAL DESCRIPTION												
		ASPHALT 3 inches										
		AGGREGATE BASE 4 inches										
		SANDY CLAY WITH GRAVEL (CL): light olive brown, moist, firm, low to medium plasticity, fine sands and gravels, slightly porous		1A 1B 1C	4 5 6	2.5		94	21	30	21	9
5		TXUU (see Plate B-2) c=1,300 psf		2A 2B 2C	2 3 4	2.25 2.5		99	19			
10		light olive brown		3A 3B 3C	2 3 5	1.5 2.25						
15		SANDY SILT (ML): light gray with iron oxide staining, moist, hard, low to medium plasticity		4A 4B 4C	5 8 11	2.75 >4						
20		firm		5A 5B 5C	3 5 5	1.5 1.75						
25		Boring terminated at approximately 20 feet. No free groundwater observed. Boring backfilled with cement grout.										

GEO_TARGET BERRYESSA LOGS.GPJ GEOTECHNICAL 08.GDT 4/22/16

Completion Depth: 20.0
Date Started: 2/18/16
Date Completed: 2/18/16
California Sampler: 2.5-inch inner diameter
SPT Sampler: 1.4-inch inner diameter

Drilling Equipment: Exploration GeoServices Mobile B-40
Drilling Method: Hollow Stem
Drive Weight: 140 lbs
Hole Diameter: 8-in
Drop: 30-in
Remarks:



BSK Associates
 324 Earhart Way
 Livermore, CA 94551
 Telephone: 925-315-3151
 Fax: 925-315-3152

LOG OF BORING NO. B-30

Project Name: **Berryessa School District Solar Array Project**
 Project Number: **G15-239-11L**
 Project Location: **Berryessa School District**
 Logged by: **G. Minerale**
 Checked by: **D. Tower**

Depth, feet	Graphic Log	Surface El.: 102 ft Location: Vinci Park Elementary School	Samples	Sample Number	Penetration Blows / Foot	Pocket Penetrometer, TSF	% Passing No. 200 Sieve	In-Situ Dry Weight (pcf)	In-Situ Moisture Content (%)	Liquid Limit	Plastic Limit	Plasticity Index		
MATERIAL DESCRIPTION														
		CLAYEY SAND WITH GRAVEL (SC): olive brown, moist, medium dense, fine subrounded gravel increasing sand content		1A	2			95	16					
				1B	3									
				1C	2									
5						2A	2							
						2B	3							
						2C	5							
				SILTY CLAY WITH GRAVEL (CL): olive brown, moist, hard, medium to high plasticity TXUU (see B-2) c=2,450 psf		3A	4	2.75		104	19			
10						3B	6	3.75						
						3C	8							
				SANDY SILT WITH GRAVEL (ML): yellowish brown, moist, hard, low to medium plasticity firm to hard		4A	4	>4						
15			4B		7									
			4C		11									
				5A	4	1.75								
20				5B	4	2.0								
				5C	7									
		Boring terminated at approximately 20 feet. No free groundwater observed. Boring backfilled with cement grout.												

GEO_TARGET BERRYESSA LOGS.GPJ GEOTECHNICAL 08.GDT 4/22/16

Completion Depth: 20.0
Date Started: 2/17/16
Date Completed: 2/17/16
California Sampler: 2.5-inch inner diameter
SPT Sampler: 1.4-inch inner diameter

Drilling Equipment: Exploration GeoServices Mobile B-40
Drilling Method: Hollow Stem
Drive Weight: 140 lbs
Hole Diameter: 8-in
Drop: 30-in
Remarks:



BSK Associates
 324 Earhart Way
 Livermore, CA 94551
 Telephone: 925-315-3151
 Fax: 925-315-3152

LOG OF BORING NO. B-31

Project Name: **Berryessa School District Solar Array Project**
 Project Number: **G15-239-11L**
 Project Location: **Berryessa School District**
 Logged by: **G. Minerales**
 Checked by: **D. Tower**

Depth, feet	Graphic Log	Surface El.: 105 ft Location: Vinci Park Elementary School	Samples	Sample Number	Penetration Blows / Foot	Pocket Penetrometer, TSF	% Passing No. 200 Sieve	In-Situ Dry Weight (pcf)	In-Situ Moisture Content (%)	Liquid Limit	Plastic Limit	Plasticity Index	
MATERIAL DESCRIPTION													
5		CLAYEY SAND (SC): olive brown, moist, loose, fine grained sand	█	1A	3	2.75							
			█	1B	4	2.0				28	19	9	
			█	1C	5								
			█	2A	3	1.75			98	15			
			█	2B	3	2.0							
			█	2C	4								
10		POORLY GRADED SAND WITH CLAY (SP-SC): olive brown, moist, loose, fine grained sand	█	3A	3								
			█	3B	3								
			█	3C	3								
15		SANDY SILT WITH GRAVEL (ML): olive brown, moist, firm, low to medium plasticity	█	4A	4	3.25							
			█	4B	7	3.5							
			█	4C	10								
20		SANDY SILT WITH GRAVEL (ML): olive brown, moist, firm, low to medium plasticity	█	5A	4	3.0							
			█	5B	7	3.5							
			█	5C	7								
25		Boring terminated at approximately 20 feet. No free groundwater observed. Boring backfilled with cement grout.											

GEO_TARGET BERRYESSA LOGS.GPJ GEOTECHNICAL 08.GDT 4/22/16

Completion Depth: 20.0 Date Started: 2/17/16 Date Completed: 2/17/16 California Sampler: 2.5-inch inner diameter SPT Sampler: 1.4-inch inner diameter	Drilling Equipment: Exploration GeoServices Mobile B-40 Drilling Method: Hollow Stem Drive Weight: 140 lbs Hole Diameter: 8-in Drop: 30-in Remarks:
--	--


APPENDIX B

LABORATORY TEST RESULTS



EXPLANATION

GROUP SYMBOL	UNIFIED SOIL CLASSIFICATION FINE GRAINED SOIL GROUPS
OL	Organic silts and organic silty clays of low plasticity
ML	Inorganic clayey silts to very fine sands of slight plasticity
CL	Inorganic clays of low to moderate plasticity
OH	Organic clays of moderate to high plasticity, organic silts
MH	Inorganic silts and clayey silts
CH	Inorganic clays of high plasticity

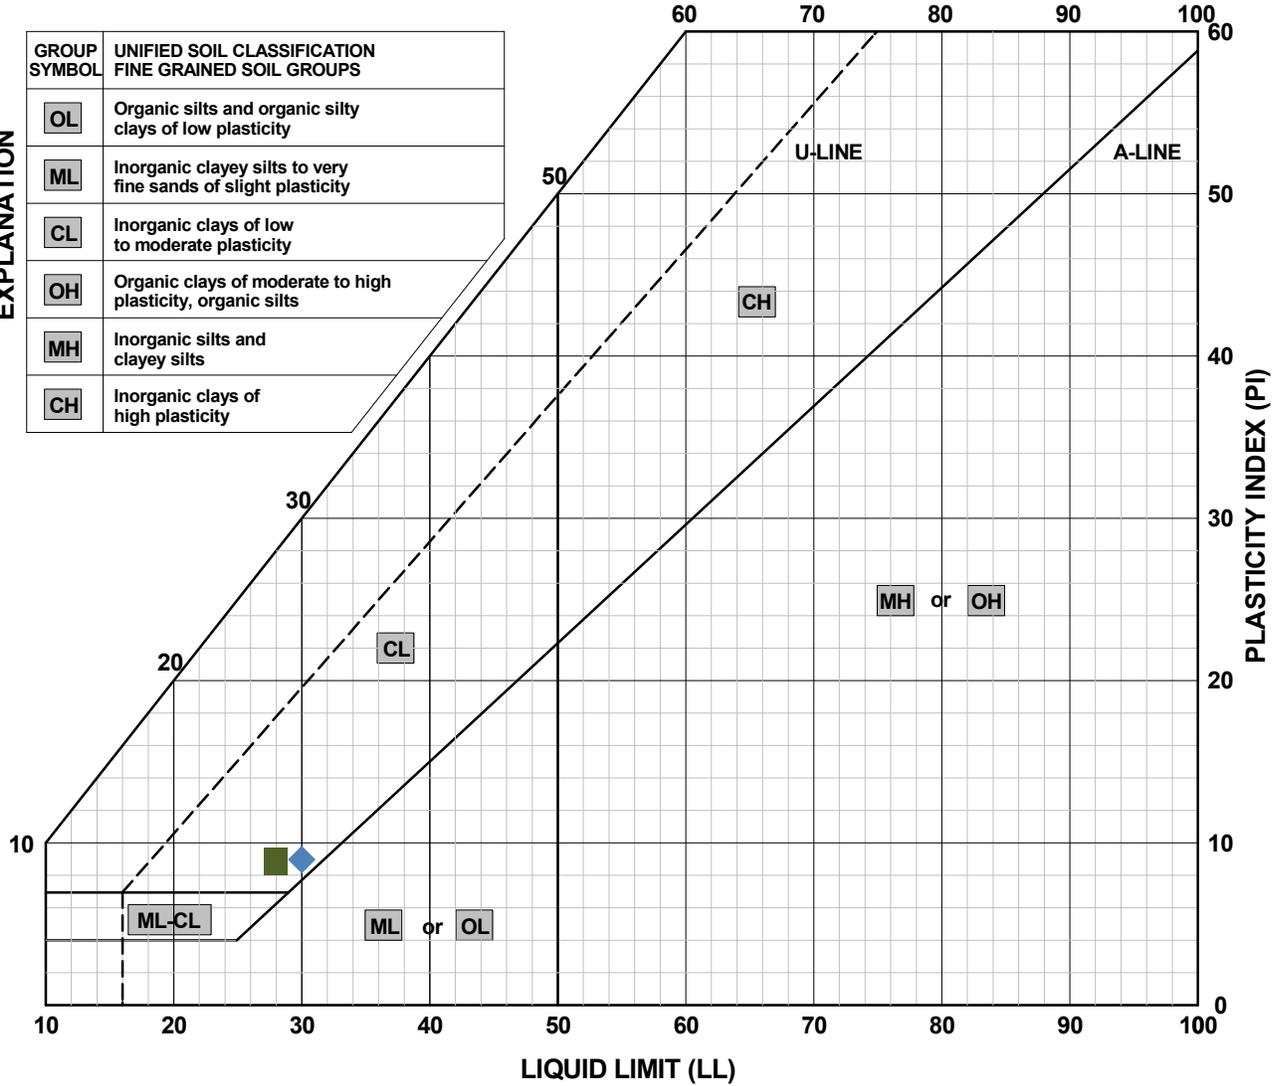

LEGEND:	SOURCE	DEPTH (ft)	LL	PL	PI	DESCRIPTION
	B-29	1.5	30	21	9	Sandy CLAY w/ Gravel (CL)
	B-31	2.0	28	19	9	Brown Lean Clay (CL)

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.



PROJECT NO. G15-239-11L
 DRAWN: 3/11/16
 DRAWN BY: D. Tower
 CHECKED BY: B. Steen
 FILE NAME: Lab.indd

ATTERBERG LIMIT



Planned Solar Array Project
 Vinci Park Elementary School
 1311 Vinci Park Way
 San Jose, California

PLATE

B-1



Unconsolidated-Undrained Triaxial Test ASTM D2850

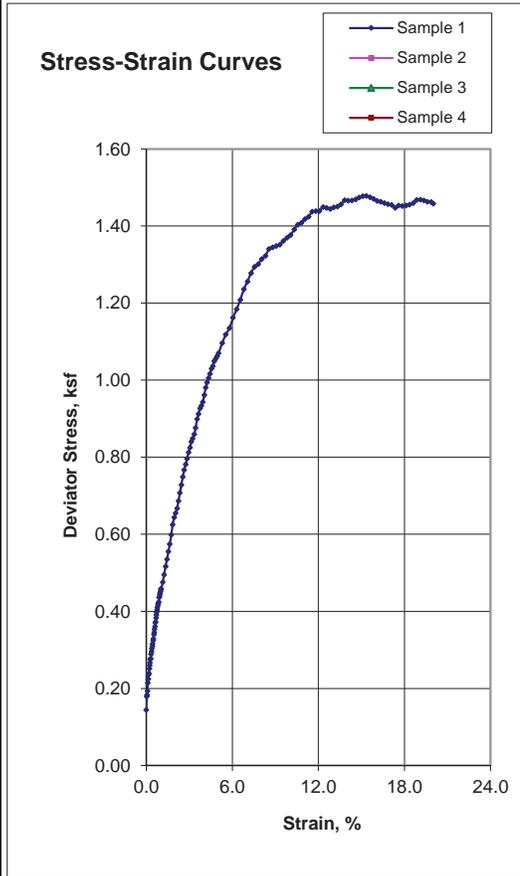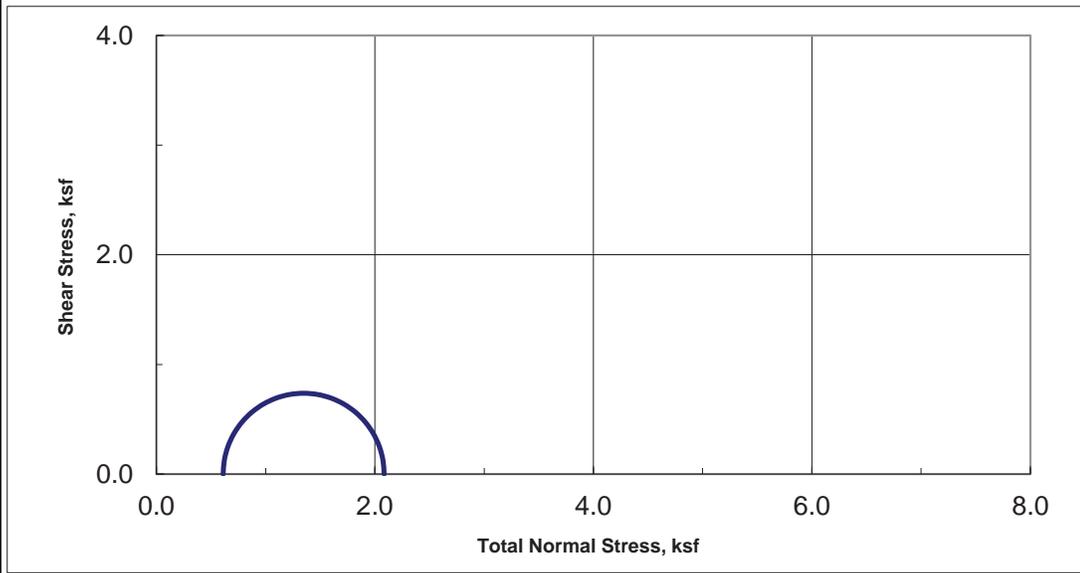

Sample Data				
	1	2	3	4
Moisture %	29.2			
Dry Den,pcf	91.5			
Void Ratio	0.842			
Saturation %	93.6			
Height in	5.00			
Diameter in	2.42			
Cell psi	4.2			
Strain %	15.00			
Deviator, ksf	1.474			
Rate %/min	1.00			
in/min	0.050			
Job No.:	664-162			
Client:	BSK Associates			
Project:	G17-178-11L			
Boring:	B-1			
Sample:	2C			
Depth ft:	7.5			
Visual Soil Description				
Sample #				
1	Olive Brown Sandy Clay			
2				
3				
4				
Remarks:				
Note: Strengths are picked at the peak deviator stress or 15% strain which ever occurs first per ASTM D2850.				

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.



PROJECT NO. G17-178-11L
DRAWN: 10/16/17
DRAWN BY: D. Tower
CHECKED BY: B. Steen
FILE NAME: SitePlan.indd

**UNCONSOLIDATED-UNDRAINED
 TRIAXIAL TEST**



**Planned Solar Array Project
 Vinci Park Elementary School
 1311 Vinci Park Way
 San Jose, California**

PLATE

B-2



Unconsolidated-Undrained Triaxial Test
ASTM D2850

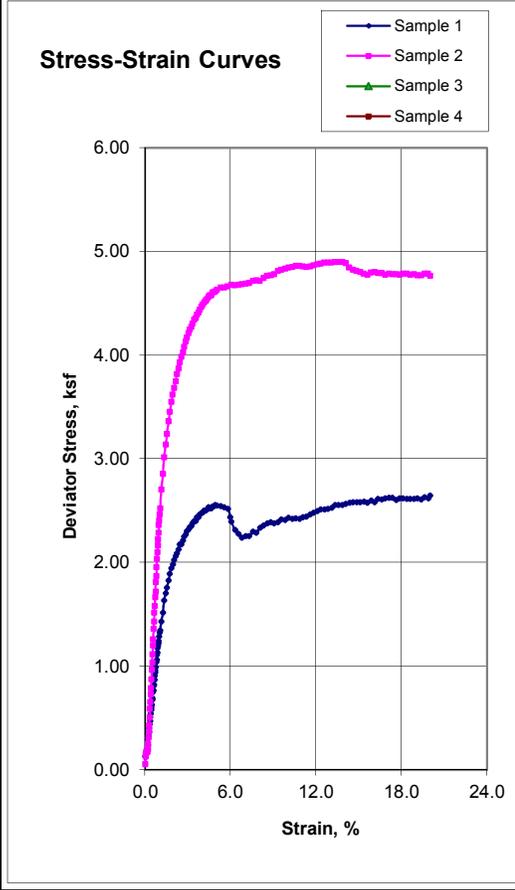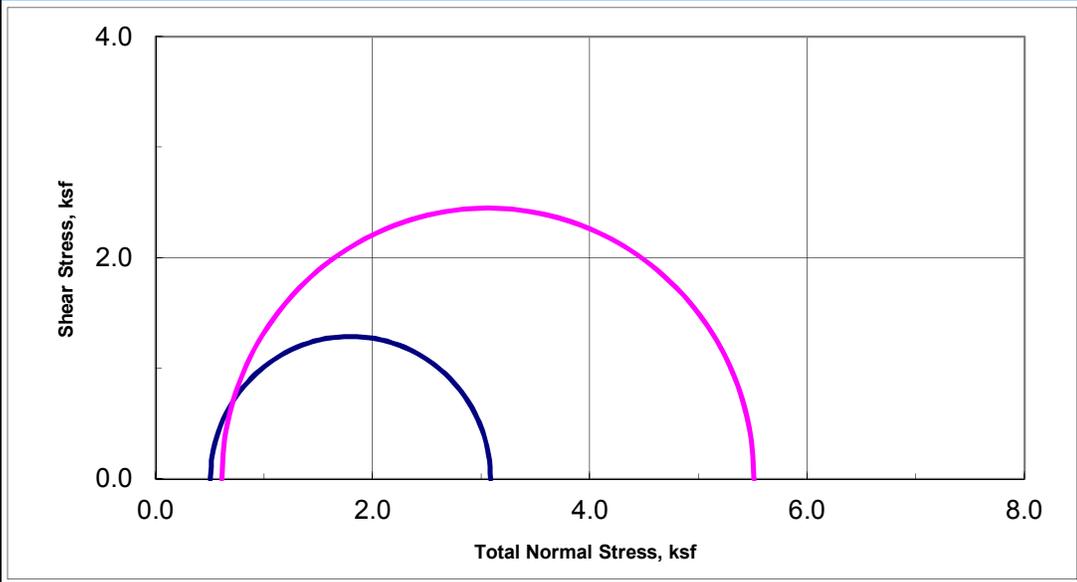

Sample Data				
	1	2	3	4
Moisture %	19.0	18.9		
Dry Den,pcf	99.0	103.7		
Void Ratio	0.703	0.625		
Saturation %	73.1	81.6		
Height in	5.02	5.03		
Diameter in	2.41	2.40		
Cell psi	3.5	4.2		
Strain %	15.00	13.58		
Deviator, ksf	2.583	4.902		
Rate %/min	1.00	1.00		
in/min	0.050	0.050		
Job No.:	664-063e			
Client:	BSK Associates			
Project:	G15-239-11L			
Boring:	B-29	B-30		
Sample:	2C	3C		
Depth ft:	4.5	9.5		
Visual Soil Description				
Sample #				
1	Olive Brown Sandy CLAY w/ Gravel			
2	Dark Brown Silty CLAY w/ Gravel			
3				
4				
Remarks:				

Note: Strengths are picked at the peak deviator stress or 15% strain which ever occurs first per ASTM D2850.

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.



PROJECT NO. G15-239-11L
 DRAWN: 3/7/16
 DRAWN BY: D. Tower
 CHECKED BY: B. Steen
 FILE NAME: Lab.indd

UNCONSOLIDATED-UNDRAINED TRIAXIAL COMPRESSION
 Planned Solar Array Project
 Vinci Park Elementary School
 1311 Vinci Park Way
 San Jose, California

PLATE
B-3

2 March, 2016

Job No. 1602189
Cust. No. 12667

Mr. Brad Steen
BSK Associates Engineers & Laboratories
324 Earhart Way
Livermore, CA 94551

Subject: Project No.: G15-239-11L
Project Name: Berryessa School District
Corrosivity Analysis – ASTM Test Methods

Dear Mr. Steen:

Pursuant to your request, CERCO Analytical has analyzed the soil samples submitted on February 23, 2016. Based on the analytical results, this brief corrosivity evaluation is enclosed for your consideration.

Based upon the resistivity measurements, samples 001, 004, 005, 007, 010 & 013 are classified as "corrosive" and samples 002, 003, 006, 008, 009, 011 & 012 are classified as "moderately corrosive". All buried iron, steel, cast iron, ductile iron, galvanized steel and dielectric coated steel or iron should be properly protected against corrosion depending upon the critical nature of the structure. All buried metallic pressure piping such as ductile iron firewater pipelines should be protected against corrosion.

The chloride ion concentrations range from none detected to 77 mg/kg. Because the chloride ion concentrations are less than 300 mg/kg, they are determined to be insufficient to attack steel embedded in a concrete mortar coating.

The sulfate ion concentrations range from none detected to 80 mg/kg and are determined to be insufficient to damage reinforced concrete structures and cement mortar-coated steel at these locations.

The pH of the soils range from 7.28 to 8.44 which does not present corrosion problems for buried iron, steel, mortar-coated steel and reinforced concrete structures.

The redox potentials range from 390 to 480-mV. Sample No. 001, 002, 003, 004, 005, 006, 007, 008, 009, 010, 012 and 013 are indicative of aerobic soil conditions, and sample 011 is indicative of potentially "slightly corrosive" soils resulting from anaerobic soil conditions.

This corrosivity evaluation is based on general corrosion engineering standards and is non-specific in nature. For specific long-term corrosion control design recommendations or consultation, please call *JDH Corrosion Consultants, Inc.* at (925) 927-6630.

We appreciate the opportunity of working with you on this project. If you have any questions, or if you require further information, please do not hesitate to contact us.

Very truly yours,
CERCO ANALYTICAL, INC.


J. Darby Howard, Jr., P.E.
President

JDH/jdl
Enclosure

Client: BSK Associates Engineers & Laboratories
 Client's Project No.: G-15-239-11L
 Client's Project Name: Berryessa School District
 Date Sampled: 23-Feb-16
 Date Received: 23-Feb-16
 Matrix: Soil
 Authorization: Signed Chain of Custody

Date of Report: 2-Mar-2016

Job/Sample No.	Sample I.D.	Redox (mV)	pH	Conductivity (umhos/cm)*	Resistivity (100% Saturation) (ohms-cm)	Sulfide (mg/kg)*	Chloride (mg/kg)*	Sulfate (mg/kg)*
1602189-001	B-2 @ 1'-3'	460	7.93	-	1,000	-	77	80
1602189-002	B-3 @ 1'-3'	420	8.21	-	2,600	-	N.D.	N.D.
1602189-003	B-6 @ 1'-3'	410	7.28	-	2,500	-	N.D.	N.D.
1602189-004	B-8 @ 1'-3'	400	8.44	-	1,700	-	N.D.	73
1602189-005	B-10 @ 1'-3'	440	8.24	-	1,400	-	35	44
1602189-006	B-12 @ 1'-2'	430	8.01	-	2,300	-	N.D.	N.D.
1602189-007	B-14 @ 1'-3'	420	8.14	-	1,700	-	N.D.	28
1602189-008	B-16 @ 1'-2'	410	7.37	-	2,900	-	N.D.	N.D.
1602189-009	B-19 @ 1'-2'	420	7.85	-	4,300	-	N.D.	N.D.
1602189-010	B-20 @ 1'-3'	410	7.72	-	700	-	37	76
1602189-011	B-23 @ 1'-3'	390	7.74	-	2,900	-	N.D.	23
1602189-012	B-26 @ 1'-3'	480	8.18	-	2,400	-	25	35
1602189-013	B-30 @ 1'-3'	460	8.12	-	1,600	-	44	45

Method:	ASTM D1498	ASTM D4972	ASTM D1125M	ASTM G57	ASTM D4658M	ASTM D4327	ASTM D4327
Reporting Limit:	-	-	10	-	50	15	15
	1-Mar-2016	1-Mar-2016	-	1-Mar-2016	-	1-Mar-2016	1-Mar-2016



Cheryl McMillen
 Laboratory Director

* Results Reported on "As Received" Basis


N.D. - None Detected

APPENDIX C

REEVALUATED CPT RESULTS AND REVISED LIQUEFACTION ANALYSIS



CPT basic interpretation plo

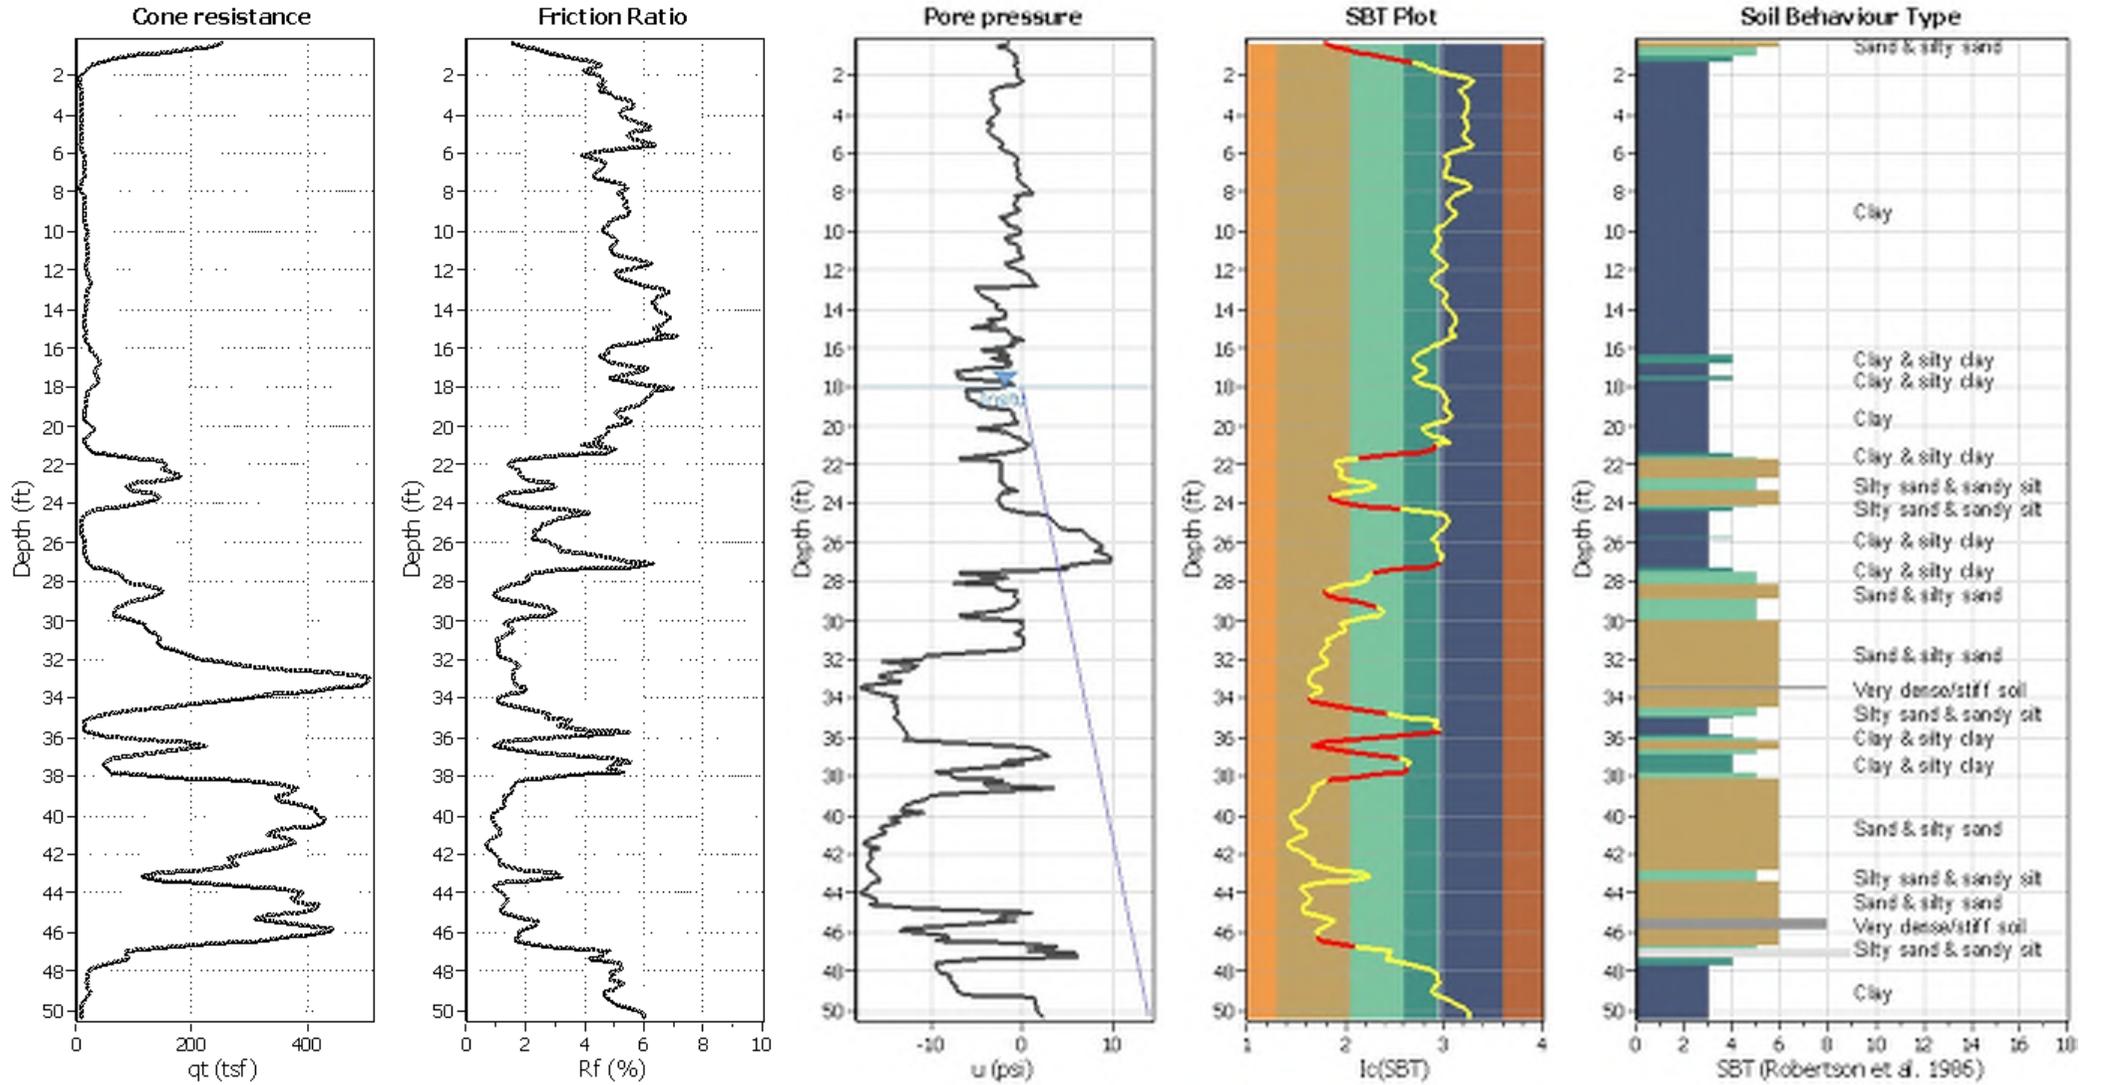


Input parameters and analysis data

Analysis method:	B&I (2014)	Depth to GWT (erthq.):	18.00 ft	Fill weight:	N/A
Fines correction method:	B&I (2014)	Average results interval:	3	Transition detect. applied:	Yes
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K _s applied:	Yes
Earthquake magnitude M _w :	6.70	Unit weight calculation:	Based on SBT	Clay like behavior applied:	Sands only
Peak ground acceleration:	0.55	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	18.00 ft	Fill height:	N/A	Limit depth:	N/A

SBT legend

1. Sensitive fine grained	4. Clayey silt to silty	7. Gravely sand to sand
2. Organic material	5. Silty sand to sandy silt	8. Very stiff sand to
3. Clay to silty clay	6. Clean sand to silty sand	9. Very stiff fine grained

Liquefaction analysis overall plot

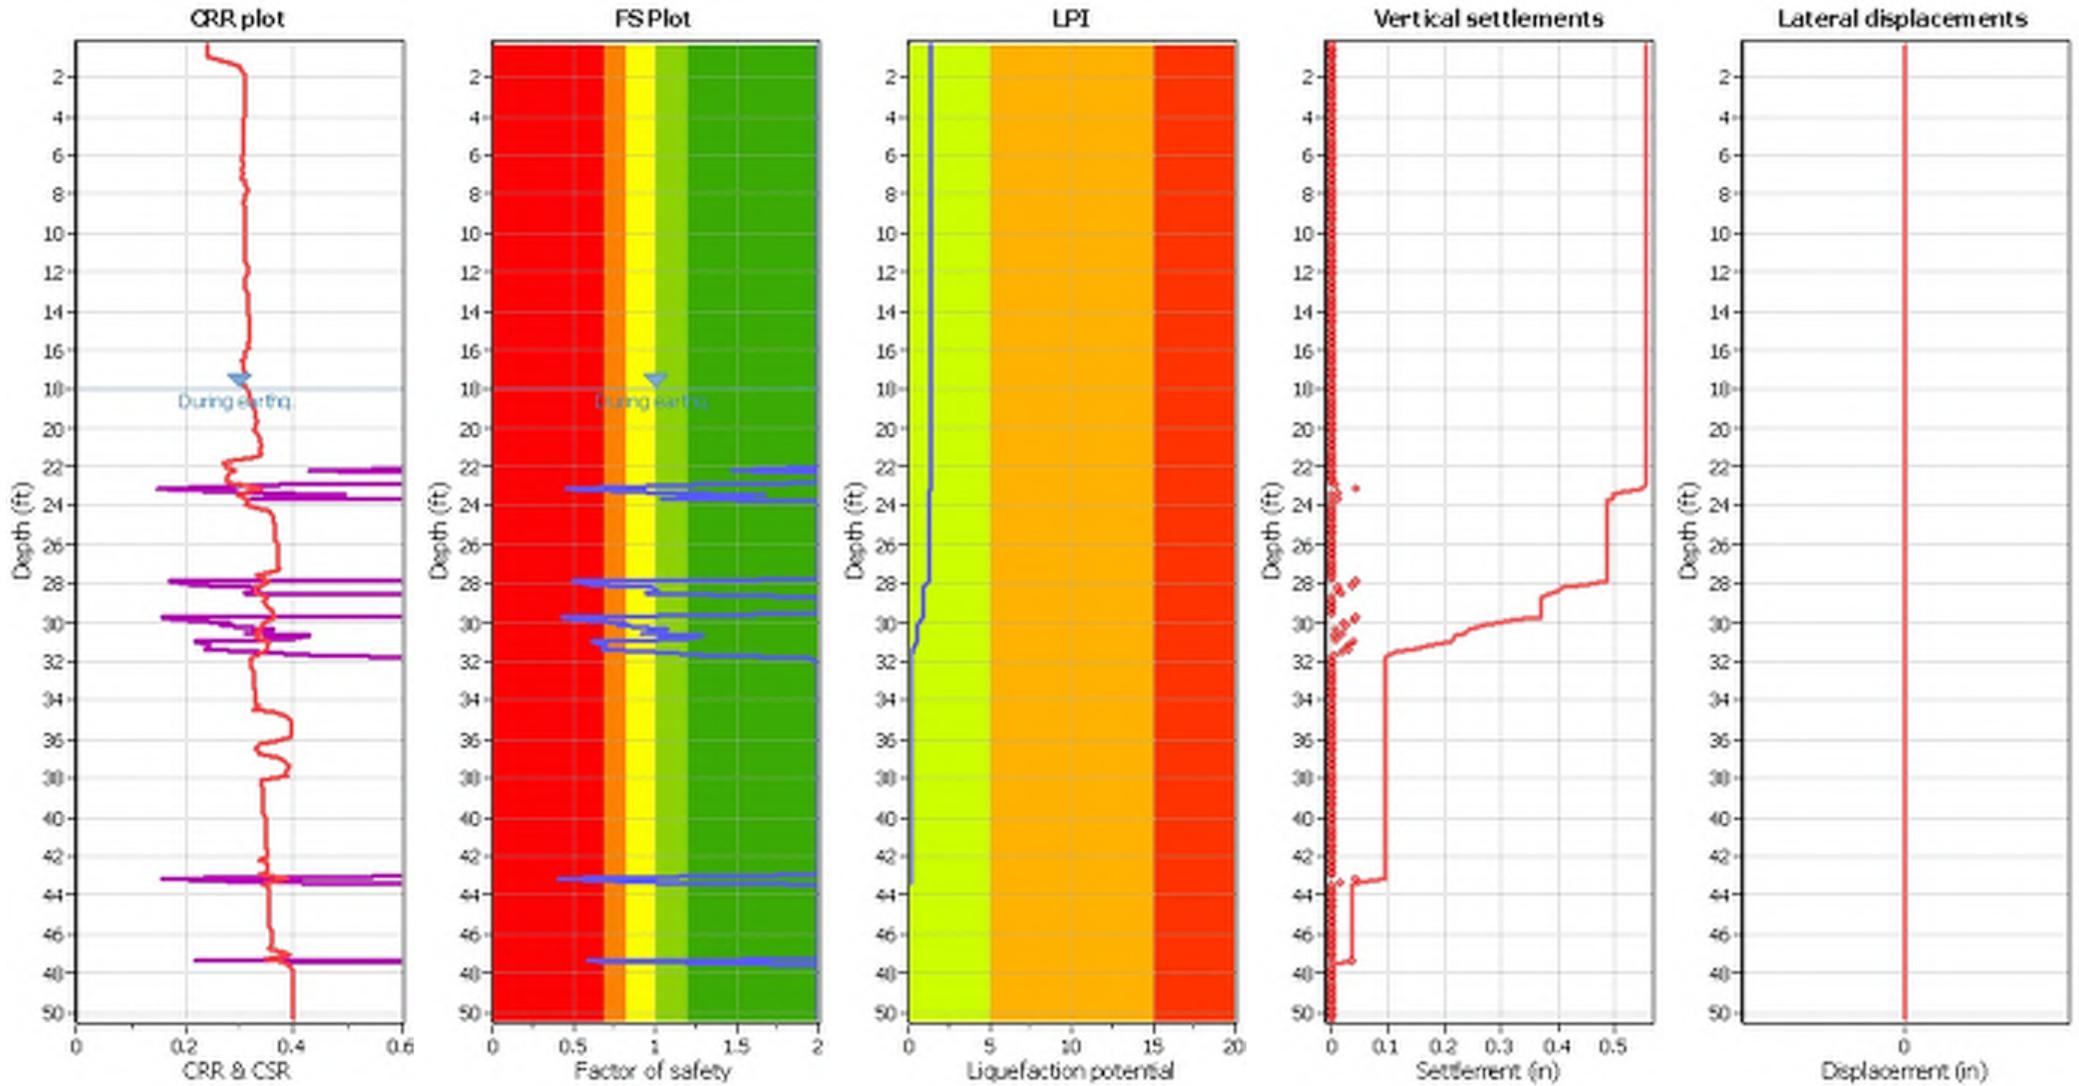

Input parameters and analysis data

Analysis method:	B&I (2014)	Depth to GWT (earthq.):	18.00 ft	Fill weight:	N/A
Fines correction method:	B&I (2014)	Average results interval:	3	Transition detect. applied:	Yes
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K ₀ applied:	Yes
Earthquake magnitude M _w :	6.70	Unit weight calculation:	Based on SBT	Clay like behavior applied:	Sands only
Peak ground acceleration:	0.55	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	18.00 ft	Fill height:	N/A	Limit depth:	N/A

F.S. color scheme

- Almost certain it will liquefy
- Very likely to liquefy
- Liquefaction and no liq. are equally likely
- Unlike to liquefy
- Almost certain it will not liquefy

LPI color scheme

- Very high risk
- High risk
- Low risk

APPENDIX D

GEOLOGIC AND SEISMIC HAZARDS ASSESSMENT



APPENDIX D
UPDATED GEOLOGIC AND SEISMIC HAZARDS ASSESSMENT REPORT
PROPOSED SHADE STRUCTURE
VINCI PARK ELEMENTARY SCHOOL
1311 VINCI PARK WAY
SAN JOSE, CALIFORNIA

Table of Contents

D1.0	INTRODUCTION.....	1
D1.1	Purpose and Scope of Services.....	1
D1.2	Site Location.....	1
D1.3	Site Topography.....	1
D1.4	Groundwater Conditions.....	2
D2.0	GEOLOGIC SETTING.....	2
D2.1	Subsurface Conditions.....	2
D3.0	GEOLOGIC/SEISMIC HAZARDS.....	4
D3.1	Fault Rupture Hazard Zones in California.....	4
D3.2	State of California Seismic Hazard Zones (Liquefaction and Landslides).....	4
D3.3	Slope Stability and Potential for Slope Failure.....	4
D3.4	Flood and Inundation Hazards.....	5
D3.4.1	Flood Hazards.....	5
D3.4.2	Inundation Hazards - Dams.....	5
D3.5	Volcanic Hazards.....	5
D3.6	Corrosion.....	5
D3.7	Expansive Soils.....	5
D3.8	Santa Clara County Safety Element.....	5
D3.9	Tsunami Hazard.....	6
D4.0	SEISMIC HAZARD ASSESSMENT.....	7
D4.1	Seismic Source Deaggregation.....	7
D4.2	Historical Seismicity.....	7
D4.3	Earthquake Ground Motion, 2016 California Building Code.....	8
D4.3.1	Site Class.....	8
D4.3.2	Seismic Design Criteria.....	8
D4.3.3	Seismic Design Category.....	9
D4.3.4	Geometric Mean Peak Ground Acceleration.....	9

D4.4	Seismically Induced Ground Failure	9
D4.4.1	Liquefaction	9
D4.4.2	Lateral Spread	10
D4.4.3	Dynamic Compaction/Seismic Settlement.....	10
D5.0	REFERENCES.....	11

Figures

Figure D-1	Area Topographic Map
Figure D-2	Site Plan
Figure D-3	Historical Depth to Groundwater Map
Figure D-4	Geologic Map
Figure D-5	Geologic Cross Section
Figure D-6	Alquist-Priolo Earthquake Fault Zone Map
Figure D-7	State of California Seismic Hazard Zones Map
Figure D-8	Landslide Hazard Map
Figure D-9	FEMA Flood Zones Map
Figure D-10	Regional Fault Map
Figure D-11	Local Fault Map
Figure D-12	Historical Earthquakes Map

D1.0 INTRODUCTION

This report presents the updated geologic and seismic hazards assessment prepared in accordance with the 2016 California Building Code (CBC), CCR Title 24, Chapters 16A and 18A requirements for a Geotechnical/Engineering Geologic Report. The assessment was performed in conformance with California Geological Survey (CGS) Note 48 (2013).

D1.1 Purpose and Scope of Services

The purpose of the geologic and seismic hazards assessment is to provide the Client with an evaluation of potential geologic or seismic hazards which may be present at the site or due to regional influences. BSK's scope of services for this assessment included the following:

1. Review of published geologic literature, and current and past investigations at the site;
2. Evaluation of the data collected and preparation of geologic cross sections;
3. Evaluation of potential geologic hazards affecting the site; and
4. Determination of site class and seismic design parameters.

The observations and conclusions presented in this report specifically exclude the assessment of environmental characteristics, particularly those involving hazardous substances, and a high-pressure pipeline risk evaluation.

D1.2 Site Location

As shown on the Area Topographic Map, Figure D-1, Vinci Park Elementary School (Site) is located at 1311 Vinci Park Way in San Jose, Santa Clara County, California. A map of the Site is shown on the Site Plan, Figure D-2.

The Site coordinates are approximately:

Latitude 37.379758°N Longitude 121.873220°W

The surrounding area is primarily residential.

D1.3 Site Topography

The Site is relatively flat with an elevation ranging from approximately 98 to 102 feet. In the area of the proposed shade structure the elevation is approximately 102 feet. The adjacent properties are relatively flat lying and slope slightly down to the west.



D1.4 Groundwater Conditions

The Site is located in the Santa Clara groundwater basin. The Historical Depth to Groundwater Contour Map, Figure D-3, presents an historical groundwater contour map from the California Geologic Survey Seismic Hazard Zone Report for the area (CGS, 2001). This map indicates that the historical high groundwater was approximately 22 feet below ground surface (bgs). During our current investigation, groundwater was encountered in our boring at 18 feet bgs on October 5, 2017. Accordingly, we have used a higher groundwater table in our analyses than was used in our previous investigation, in which our groundwater elevation was based on the CGS map.

D2.0 GEOLOGIC SETTING

The Site is located in the Coastal Range geomorphic province which is characterized by north-south trending ridges and valleys that are typically highly folded with numerous faults. The Site is situated in the Santa Clara Valley at the southern end of the San Francisco Bay.

Alluvial fans formed along the hills to the east of the Site and grade to valley fill deposits to the west and north. These fans interbed with recent bay mud and older bay mud at depth. The Site is located west of hills composed of Cretaceous to Miocene sedimentary rocks overlying Franciscan Formation chert and mélange. As shown on the Geologic Map, Figure D-4, the Site is situated on Holocene Alluvial deposits consisting of primarily gravel, sand, and clay of valley areas (Dibblee and Minch, 2005).

Nearby active faults include the Hayward fault zone located approximately 2.5 miles east of the Site, the Calaveras fault zone located approximately 5.5 miles east of the Site, and the San Andreas fault zone located approximately 14.5 miles west of the Site.

D2.1 Subsurface Conditions

Subsurface conditions are described in the 2017 geotechnical investigation report prepared by BSK Associates (BSK) and to which this geologic and seismic hazards report is appended. The Site was the subject of a current field investigation of one hollow-stem auger boring completed to a depth of approximately 20 feet bgs. The underlying stratigraphy consists of poorly graded sand with gravel in the upper 4.5 feet and firm lean clay with sand below that to the maximum explored depth of 20 feet.

Three hollow-stem auger borings and one cone penetration test were completed during our previous investigation (BSK, 2016). The borings extended to a depth of approximately 20 feet and the cone penetration test extended to approximately 50 feet. Both also encountered alluvial soils of firm clays and silts and medium dense to dense sands.



The Geologic Cross Section, Figure D-5, presents the current surface topography and the subsurface conditions inferred from current and past borings drilled at the Site.



D3.0 GEOLOGIC/SEISMIC HAZARDS

The types of geologic and seismic hazards assessed include surface ground fault rupture, liquefaction, seismically induced settlement, slope failure, flood hazards and inundation hazards.

D3.1 Fault Rupture Hazard Zones in California

The purpose of the Alquist-Priolo Geologic Hazards Zones Act, as summarized in CDMG Special Publication 42 (SP 42) (Bryant and Hart, 2007), is to "prohibit the location of most structures for human occupancy across the traces of active faults and to mitigate thereby the hazard of fault-rupture." As indicated by SP 42, "the State Geologist is required to delineate 'Earthquake Fault Zones' (EFZs) along known active faults in California. Cities and counties affected by the zones must regulate certain development 'projects' within the zones. They must withhold development permits for sites within the zones until geologic investigations demonstrate that the sites are not threatened by surface displacement from future faulting."

The Site is not located in a Fault-Rupture Hazard Zone. As shown on the Alquist-Priolo Earthquake Fault Zone Map, Figure D-6, the closest Fault-Rupture Hazard Zone is associated with the Hayward fault zone and is located approximately 2.4 miles east of the Site.

D3.2 State of California Seismic Hazard Zones (Liquefaction and Landslides)

Zones of Required Investigation referred to as "Seismic Hazard Zones" (SHZ) in CCR Article 10, Section 3722, are areas shown on Seismic Hazard Zone Maps where site investigations are required to determine the need for mitigation of potential liquefaction and/or earthquake-induced landslide ground displacements.

The Site is within the Calaveras Reservoir 7.5 Minute Quadrangle. As shown on the State of California Seismic Hazards Zone Map, Figure D-7, the Site is located in a Liquefaction Hazard Zone as established by the State of California. The Site is not located in a Landslide Hazard Zone.

D3.3 Slope Stability and Potential for Slope Failure

The Landslide Hazard Map, Figure D-8, presents a distribution of slides and earthflows as mapped by Wentworth et al. (1998). Based on this map, the Site is located on surficial deposits, not a landslide-prone area.



D3.4 Flood and Inundation Hazards

An evaluation of flooding at the Site includes review of potential hazards from flooding during periods of heavy precipitation and flooding due to a catastrophic dam breach from up-gradient surface impoundments.

D3.4.1 Flood Hazards

Federal Emergency Management Agency (FEMA) flood hazard data was obtained to present information regarding the potential for flooding at the Site. As shown on the FEMA Flood Zones Map (FEMA Flood Layer 06085C-NFHL dated 2/19/2014), Figure D-9, the Site lies in Zone X outside the 100-year and 500-year floodplains.

D3.4.2 Inundation Hazards - Dams

According to GIS data obtained from California Emergency Management Agency, there are no reservoirs capable of causing inundation due to the breach of a dam in the vicinity of the Site (Dam Inundation GIS data from California Emergency Management Agency, dated 2013).

D3.5 Volcanic Hazards

According to USGS Bulletin 1847, dated 1989, the Site is not located in an area which would be subject to hazards from volcanic eruptions (Miller, 1989).

D3.6 Corrosion

Please refer to the section titled “Corrosivity Results” in the geotechnical report for discussion of the corrosivity of the Site soils.

D3.7 Expansive Soils

The underlying stratigraphy of the site consist of interbedded alluvial soils. Based on our field explorations, this alluvium consists primarily of firm to hard lean clays interbedded with some clayey sands, and poorly graded sand with varying amounts of clay. The surface clays are typically firm and exhibit low plasticity. The laboratory test results are indicative of clays with low expansion potential when subjected to changes in moisture content.

D3.8 Santa Clara County Safety Element



According to the Santa Clara County Department of Planning and Development Geologic Hazard Zone Map, the Site is located in a County-designated liquefaction hazard zone. The Site is not located in a landslide hazard zone.

D3.9 Tsunami Hazard

According to the Tsunami Inundation Map for Emergency Planning (Cal-EMA, 2009), the Site is not located in a California State Tsunami Hazard Zone.



D4.0 SEISMIC HAZARD ASSESSMENT

D4.1 Seismic Source Deaggregation

The Regional Fault Map and Local Fault Map, Figures D-10 and D-11, respectively, present the major faults that may impact the Site in the future. Seismically induced ground motion at a site can be caused by earthquakes on any of the sources surrounding the site. Deaggregation of the seismic hazard was performed using the USGS Unified Hazard Tool. The deaggregation determination, at the maximum considered earthquake (MCE) hazard level, results in distance, magnitude, and epsilon (ground-motion uncertainty) for each source that contributes to the hazard.

Results of the deaggregation based on a probabilistic model developed by the USGS (Dynamic: Conterminous U.S. 2008 (v3.3.1)) indicate that the most extreme seismic source that contributes to the peak ground acceleration is a magnitude 8.02 earthquake from a rupture of multiple segments of the San Andreas fault zone. The modal magnitude of 6.7 at a distance of 9.09 km is consistent with the general design earthquake ground motion. For liquefaction and seismic settlement, a magnitude of 6.7 should be used.

D4.2 Historical Seismicity

The project Site and its vicinity are located in an area traditionally characterized by high seismic activity. A number of large earthquakes have occurred within the Site vicinity during historic time (since 1800). The Historical Earthquake Map, Figure D-12, presents historical earthquake magnitudes and dates of significant earthquakes located in the project area based on the Working Group on California Earthquake Probabilities (WGCEP) Historical California Earthquake Catalog (Felzer, 2008). This earthquake catalog is for California and provides a listing for all known $M \geq 5.5$ earthquakes that occurred from 1850-1932 and all known $M \geq 4.0$ earthquakes that occurred from 1932-2006. Some pre-1932 earthquakes $4 \leq M \leq 5.5$ are also listed.

Some of the significant regional earthquake events include the 1868 M6.8 earthquake that originated on the Hayward fault zone approximately 25 miles northeast of the Site, the 1906 M7.8 Great San Francisco earthquake that originated on the San Andreas fault zone approximately 41 miles northwest of the Site, and the 1989 M7.1 Loma Prieta earthquake that originated on the San Andreas fault zone approximately 23 miles southwest of the Site.

In March 2015, scientists and engineers released a new earthquake forecast for the State of California which was compiled by the USGS, the Southern California Earthquake Center, and the CGS with support from the California Earthquake Authority (Field et al., 2014). It updates the earthquake forecast made for the greater San Francisco Bay Area by the 2007 Working Group for California Earthquake Probabilities. According to this recent study, there is a 72 percent probability that one or more magnitude M6.7 or greater earthquakes will occur in the San Francisco Bay Area within the next approximately 30 years



(between 2014 and 2044). As has been demonstrated recently by the 1989 (M6.9) Loma Prieta, 1994 (M6.7) Northridge, and the 1995 (M6.9) Kobe earthquakes, earthquakes of this magnitude range can cause severe ground shaking and significant damage to modern urban environments.

D4.3 Earthquake Ground Motion, 2016 California Building Code

D4.3.1 Site Class

Based on Section 1613.3.2 of the 2016 California Building Code (CBC), the site shall be classified as Site Class A, B, C, D, E or F based on the Site soil properties and in accordance with Chapter 20 of ASCE 7-10. Based on the “N” values from our soil borings and estimated undrained shear strength, as per Table 20.3-1 of ASCE 7-10, the Site is Class D (stiff soil).

D4.3.2 Seismic Design Criteria

The 2016 CBC utilizes ground motion based on the Risk-Targeted Maximum Considered Earthquake (MCE_R), defined in the 2016 CBC as the most severe earthquake effects considered by this code, determined for the orientation that results in the largest maximum response to horizontal ground motions and with adjustment for targeted risk. Ground motion parameters in the 2016 CBC are based on ASCE 7-10, Chapter 11.

The United States Geologic Survey (USGS) has prepared maps presenting the Risk-Targeted MCE spectral acceleration (5% damping) for periods of 0.2 seconds (S_5) and 1.0 seconds (S_1). The values of S_5 and S_1 can be obtained from the USGS Ground Motion Parameter Application available at: <http://earthquake.usgs.gov/designmaps/us/application.php>.

Table D-1 below presents the spectral acceleration parameters produced for Site Class D by the USGS Ground Motion Parameter Application and Chapter 16 of the 2016 CBC based on ASCE 7-10.

TABLE D-1 SPECTRAL ACCELERATION PARAMETERS RISK TARGETED MAXIMUM CONSIDERED EARTHQUAKE			
Criteria	Value		Reference
MCE Mapped Spectral Acceleration (g)	$S_5 = 1.500$	$S_1 = 0.600$	USGS Mapped Value
Site Coefficients (Site Class D)	$F_a = 1.000$	$F_v = 1.500$	ASCE Table 11.4
Site Adjusted MCE Spectral Acceleration (g)	$S_{MS} = 1.500$	$S_{M1} = 0.900$	ASCE Equations 11.4.1-2
Design Spectral Acceleration (g)	$S_{DS} = 1.000$	$S_{D1} = 0.600$	ASCE Equations 11.4.3-4



D4.3.3 Seismic Design Category

The long period spectral response acceleration coefficient, S_1 , is less than 0.750g, therefore the Site lies in Seismic Design Category D, based on Risk Category III. When S_1 is greater than or equal to 0.750g, the Seismic Design Category is E for buildings in Risk Categories I, II, and III, and F for those in Risk Category IV.

D4.3.4 Geometric Mean Peak Ground Acceleration

As per Section 1803A.5.12 of the CBC, peak ground acceleration (PGA) utilized for dynamic lateral earth pressures and liquefaction, shall be based on a site-specific study (ASCE 7-10, Section 21.5) or ASCE 7-10, Section 11.8.3. The USGS Ground Motion Parameter Application based on ASCE 7-10, Section 11.8.3 produced the values shown in Table D-2 based on Site Class D.

TABLE D-2 GEOMETRIC MEAN PEAK GROUND ACCELERATION MAXIMUM CONSIDERED EARTHQUAKE		
Criteria	Value	Reference
Mapped Peak Ground Acceleration (g)	PGA = 0.545	USGS Mapped Value
Site Coefficients (Site Class D)	$F_{PGA} = 1.000$	ASCE Table 11.8-1
Geometric Mean PGA (g)	$PGA_M = 0.545$	ASCE Equations 11.8-1

D4.4 Seismically Induced Ground Failure

D4.4.1 Liquefaction

Liquefaction is a condition where saturated, granular soils undergo a substantial loss of strength and deformation due to pore pressure increase, resulting from cyclic stress application induced by earthquakes. In the process, the soil acquires mobility sufficient to permit both horizontal and vertical movements if the soil is not confined. Soils most susceptible to liquefaction are loose, clean, uniformly graded, silt and fine sand, as well as some lean clay deposits.

In order for liquefaction triggering to occur due to ground shaking, it is generally accepted that four conditions will exist:

- The subsurface soils are in a relatively loose state
- The soils are saturated
- The soils have low plasticity
- Ground shaking is of sufficient intensity to act as a triggering mechanism



In addition, after soil liquefies, dissipation of the excess pore pressures can produce volume changes within the liquefied soil layer, which can result in ground surface settlement.

Based on the subsurface exploration performed for the investigation, the Site is underlain by alluvial soils consisting of primarily firm to hard clays and medium dense to dense sands. Groundwater was encountered at 18 feet bgs in our current boring. Potential liquefaction-induced settlement was determined to be about ½ inch at the Site. The results and discussion of our liquefaction analyses are presented in Section 4.2.2 of the geotechnical report.

D4.4.2 Lateral Spread

Lateral spreading is a potential hazard commonly associated with liquefaction where extensional ground cracking and settlement occur as a response to lateral migration of subsurface liquefiable material. These phenomena typically occur adjacent to free faces such as slopes and creek channels. Liquefaction induced settlement is a consideration at the Site (see Section D4.4.1), however there are no free faces in the vicinity of the campus; therefore, we consider the potential for lateral spread to occur at the Site to be low.

D4.4.3 Dynamic Compaction/Seismic Settlement

Another type of seismically induced ground failure, which can occur as a result of seismic shaking, is dynamic compaction, or seismic settlement. Such phenomena typically occur in unsaturated, loose granular material or uncompacted fill soils. Fill soils were not encountered in our borings and the soils encountered in our boring consisted predominantly of firm to hard clays and medium dense to dense sands; therefore, we consider the potential for seismic settlement to occur at the Site to be very low.



D5.0 REFERENCES

- ASCE 7-10 (2010), Minimum Design Loads for Buildings and Other Structures, ASCE Standard ASCE/SEI 7-10.
- Bryant, W.A, and Hart, E.W. (2007), Fault-Rupture Hazard Zones In California, Alquist-Priolo Earthquake Fault Zoning Act, With Index to Earthquake Fault Zones Maps, Interim Revision 2007, California Geological Survey, Special Publication 42.
- California Building Code (CBC, 2016), also known as the California Code of Regulations (CCR), Title 24, Parts 2, Volume 2, California Building Standards Commission.
- California Department of Water Resources (CDWR, 2003), California's Groundwater - Bulletin 118, update 2003, <http://www.water.ca.gov/groundwater/bulletin118/bulletin118update2003.cfm>.
- California Emergency Management Agency, (Cal-EMA, 2009), Tsunami Inundation Map for Emergency Planning, Calaveras Reservoir Quadrangle, July 31, 2009.
- California Geological Survey, (CGS, 2001), Seismic Hazard Zone Report For The Milpitas and Calaveras Reservoir 7.5-Minute Quadrangle, Santa Clara County, California, Seismic Hazard Zone Report 051 and 048.
- California Geological Survey, (CGS, 2008), Guidelines for Evaluating and Mitigating Seismic Hazards in California: Special Publication 117A.
- California Geological Survey (CGS, 2013), Note 48, Checklist for the Review of Engineering Geology and Seismology Reports for California Public Schools, Hospitals, and Essential Services Buildings, October 2013.
- Dibblee, T.W., and Minch, J.A. (2005), Geologic map of the Milpitas and Calavers Reservoir, Santa Clara County, California: Dibblee Geological Foundation, Dibblee Foundation Map DF-153, DF-154, scale 1:24,000.
- Federal Emergency Management Agency (FEMA), FEMA National Flood Hazard Layer, 06085C-NFHL, 2/9/2014.
- Field, E.H., and the 2014 Working Group on California Earthquake Probabilities (2015), UCERF3: A new earthquake forecast for California’s complex fault system: U.S. Geological Survey 2015-3009.
- Miller, C.D. (1989), Potential Hazards from Volcanic Eruptions in California, U. S. Geological Survey Bulletin 1847.




Santa Clara County General Plan (2016),
<https://www.sccgov.org/sites/dpd/PlansOrdinances/GP/Pages/GP.aspx>.

United States Geological Survey (USGS, 2008), WGCEP Historical California Earthquake Catalog, Open File Report 2007-1437H.

Wentworth C.M., Graham, S.E., Pike, R.J., Beukelman, G.S., Ramsey, D.W., and Barron, A.D. (1998), San Francisco Bay Region Landslide Folio Part C - Summary Distribution of Slides and Earth Flows in the San Francisco Bay Region, California, Open-File Report 97-745c, revision date for Part C: February 17, 1998.



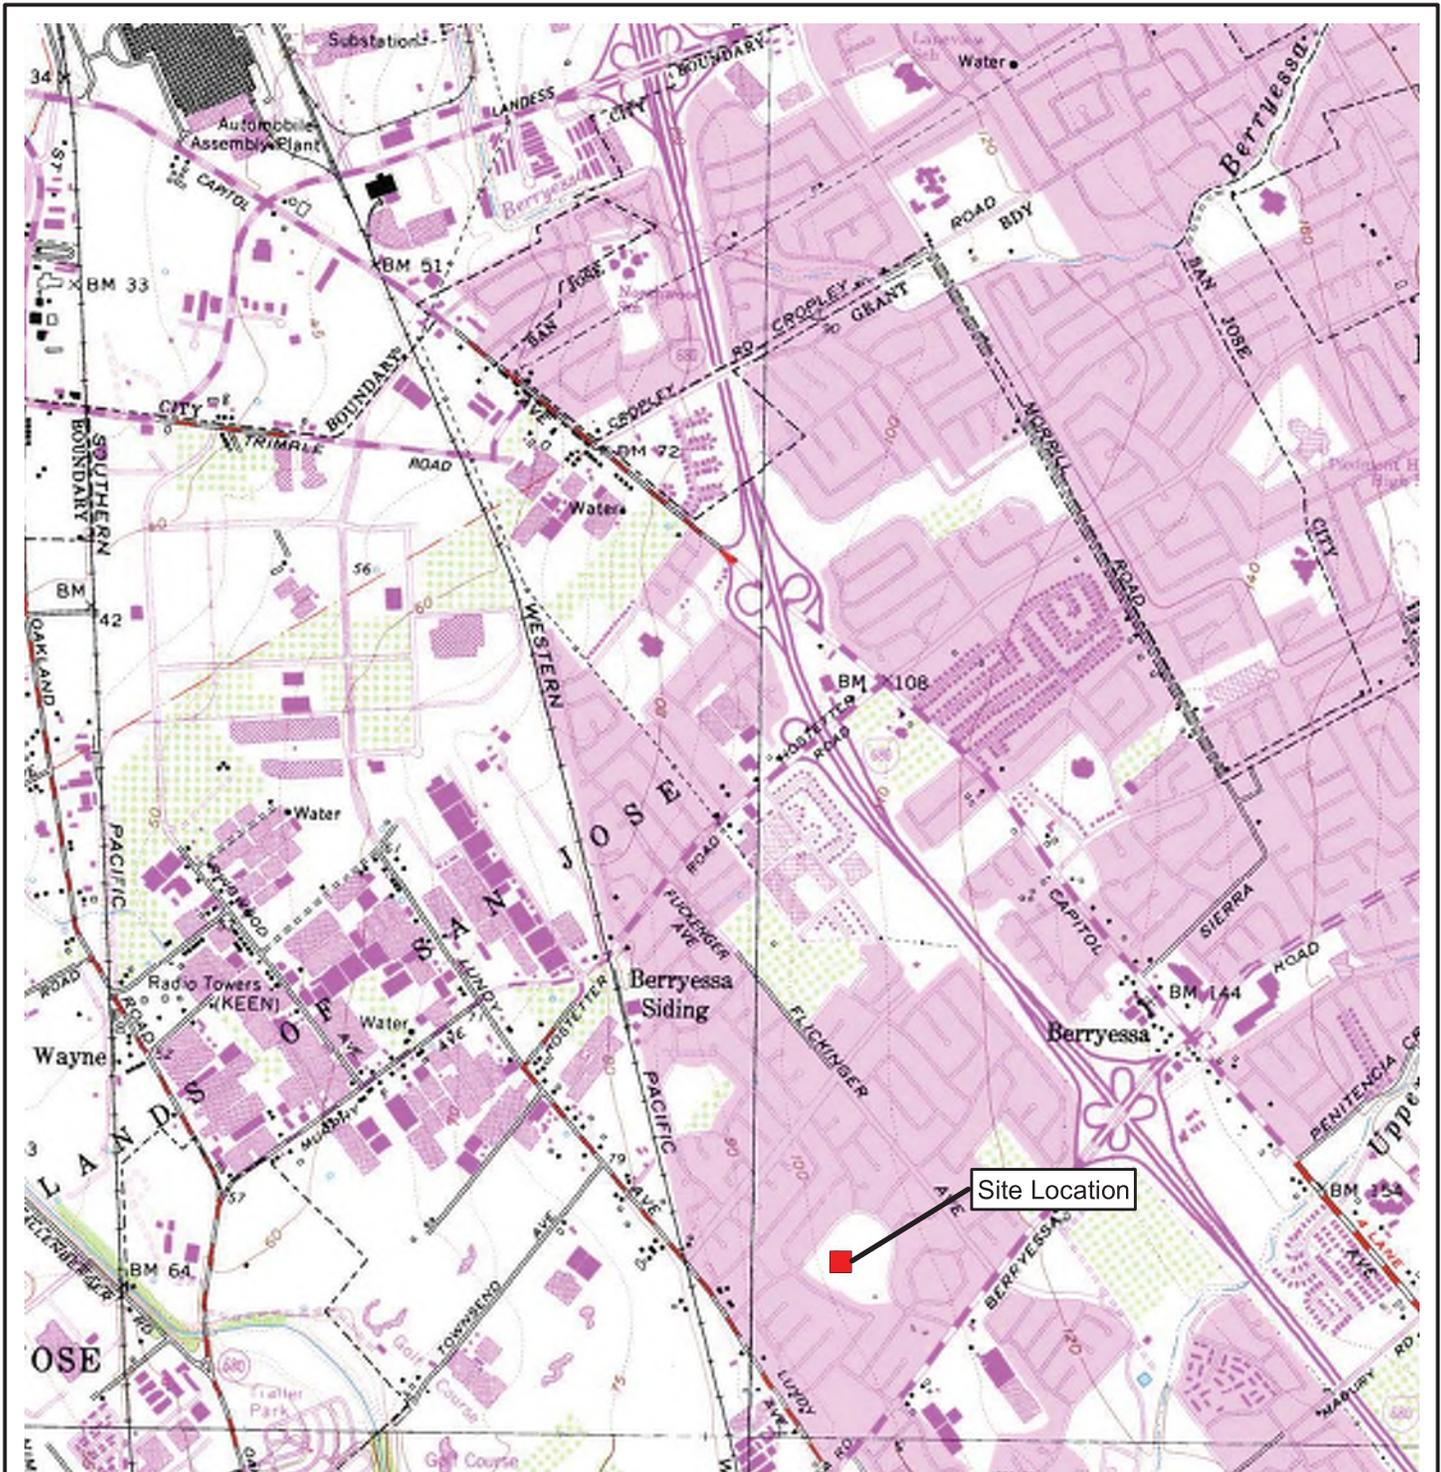

Reference: http://www.atlas.ca.gov/download.html#/casil/imageryBaseMaps/LandCover/baseMaps/drg/7.5_minute_series_albers_nad83_trimmed

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.




	PROJECT NO. G17-178-11L	AREA TOPOGRAPHIC MAP Geologic/Seismic Hazards Assessment	Figure D-1
	Drawn: 10/17/2017		
	DRAWN BY: MBC	Vinci Park Elementary School 1311 Vinci Park Way San Jose, California	
	CHECKED BY: BS		
FILE NAME: topo			




Legend

-  Soil Boring Location
-  Proposed Shade Structure Location
-  Cross Section Line

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.

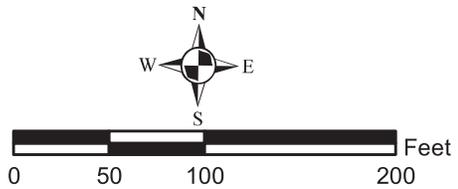

	PROJECT NO. G17-178-11L	SITE PLAN Geologic/Seismic Hazards Assessment	Figure D-2
	Drawn: 10/24/2017		
	DRAWN BY: MBC	Vinci Park Elementary School 1311 Vinci Park Way San Jose, California	
	CHECKED BY: BS		
FILE NAME: Figure D-3 Site Map			

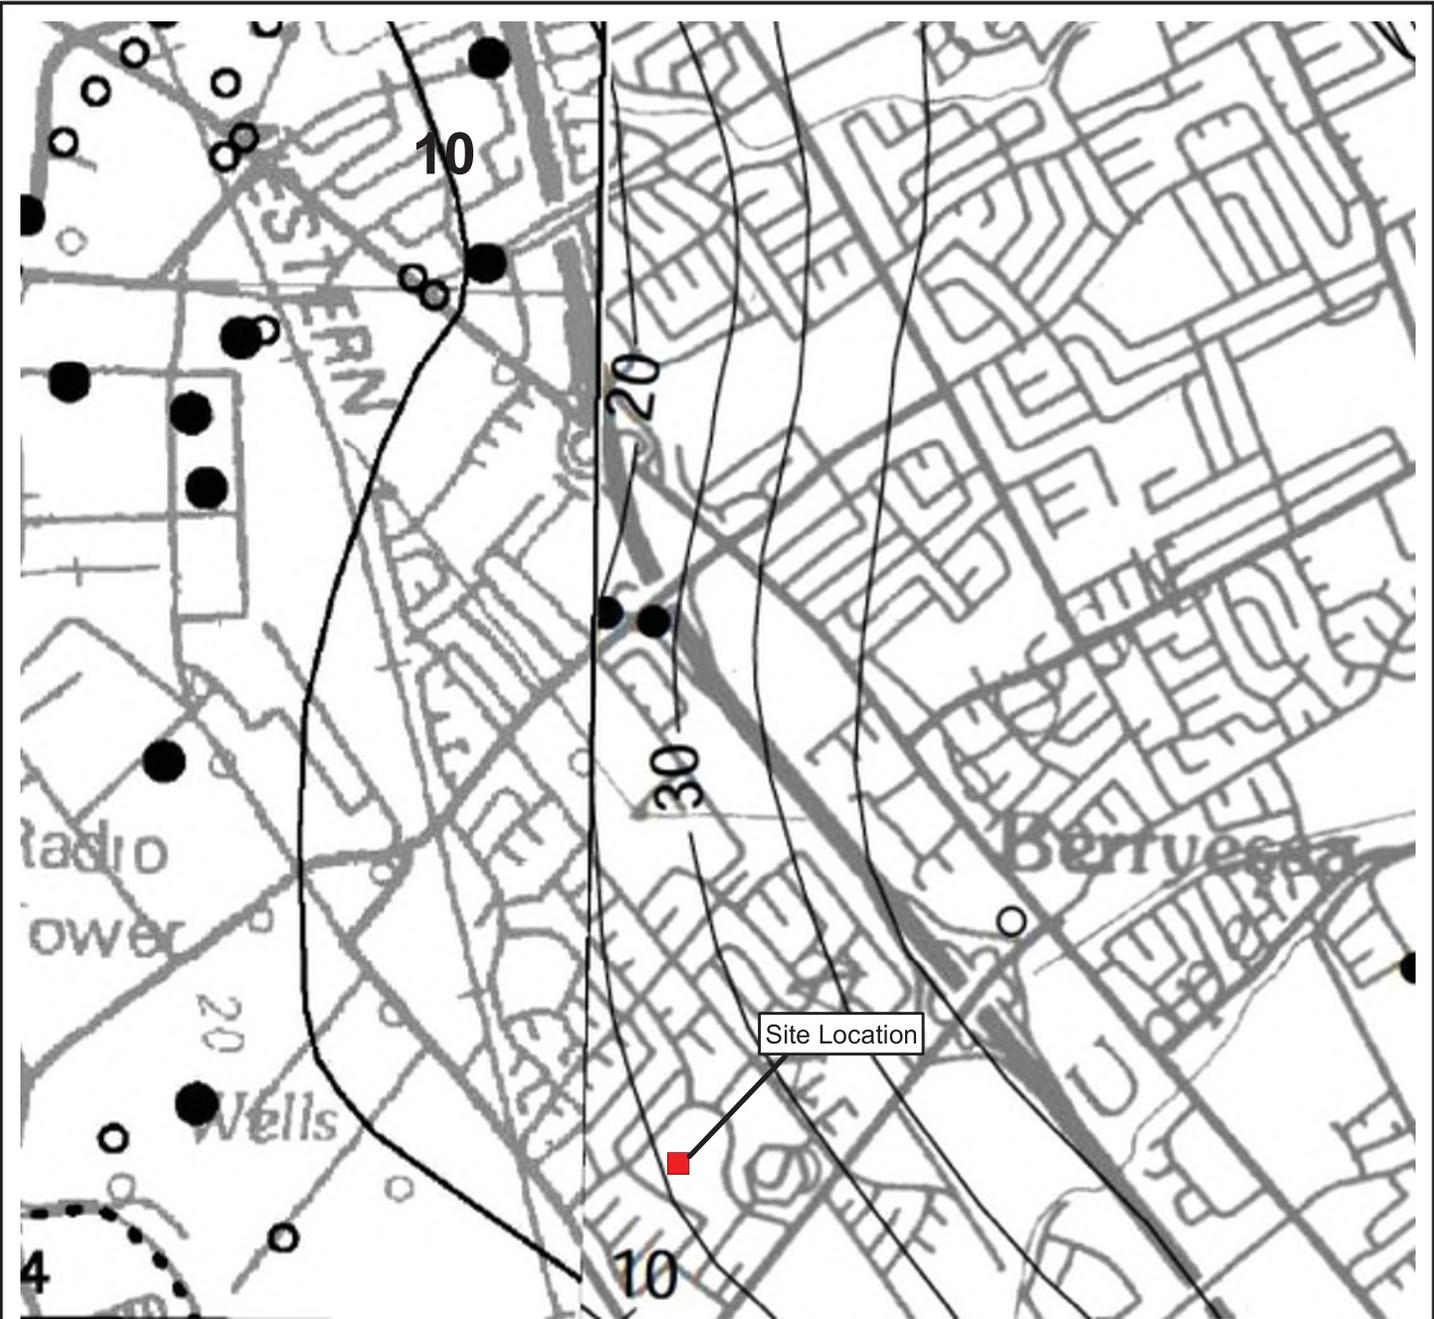

Contours Represent Historic High Depth to Groundwater (feet bgs)

Reference: CGS, 2001, Seismic Hazard Zone Report for the Milpitas and Calaveras Reservoir 7.5-Minute Quadrangle, Santa Clara County, California, Seismic Hazard Zone Report 051 & 048

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.



	PROJECT NO. G17-178-11L	HISTORICAL DEPTH TO GROUNDWATER CONTOUR MAP Geologic/Seismic Hazards Assessment	Figure D-3
	Drawn: 10/23/2017		
	DRAWN BY: MBC	Vinci Park Elementary School 1311 Vinci Park Way San Jose, California	
	CHECKED BY: BS		
FILE NAME: Figure D-2 Groundwater			




LEGEND

- Qa - Holocene Alluvial gravel, sand and clay of valley areas
- Ql - Landslide Rubble
- QTs - Pliocene Santa Clara Formation
- Tm - Miocene Monterey Formation
- Kp - Cretaceous Panoche Formation
- fs - Franciscan Shale and Graywacke
- sp - Coast Range Ophiolite, serpentinite




Reference: Dibblee, T.W., and Minch, J.A., 2005, Geologic map of the Milpitas and Calaveras Reservoir, Santa Clara County, California, DF-153, DF-154

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.



	PROJECT NO. G17-178-11L	GEOLOGIC MAP Geologic/Seismic Hazards Assessment	Figure D-4
	Drawn: 10/23/2017		
	DRAWN BY: MBC	Vinci Park Elementary School 1311 Vinci Park Way San Jose, California	
	CHECKED BY: BS		
FILE NAME: Figure D-4 Geologic			

GEOLOGIC CROSS SECTION A-A'

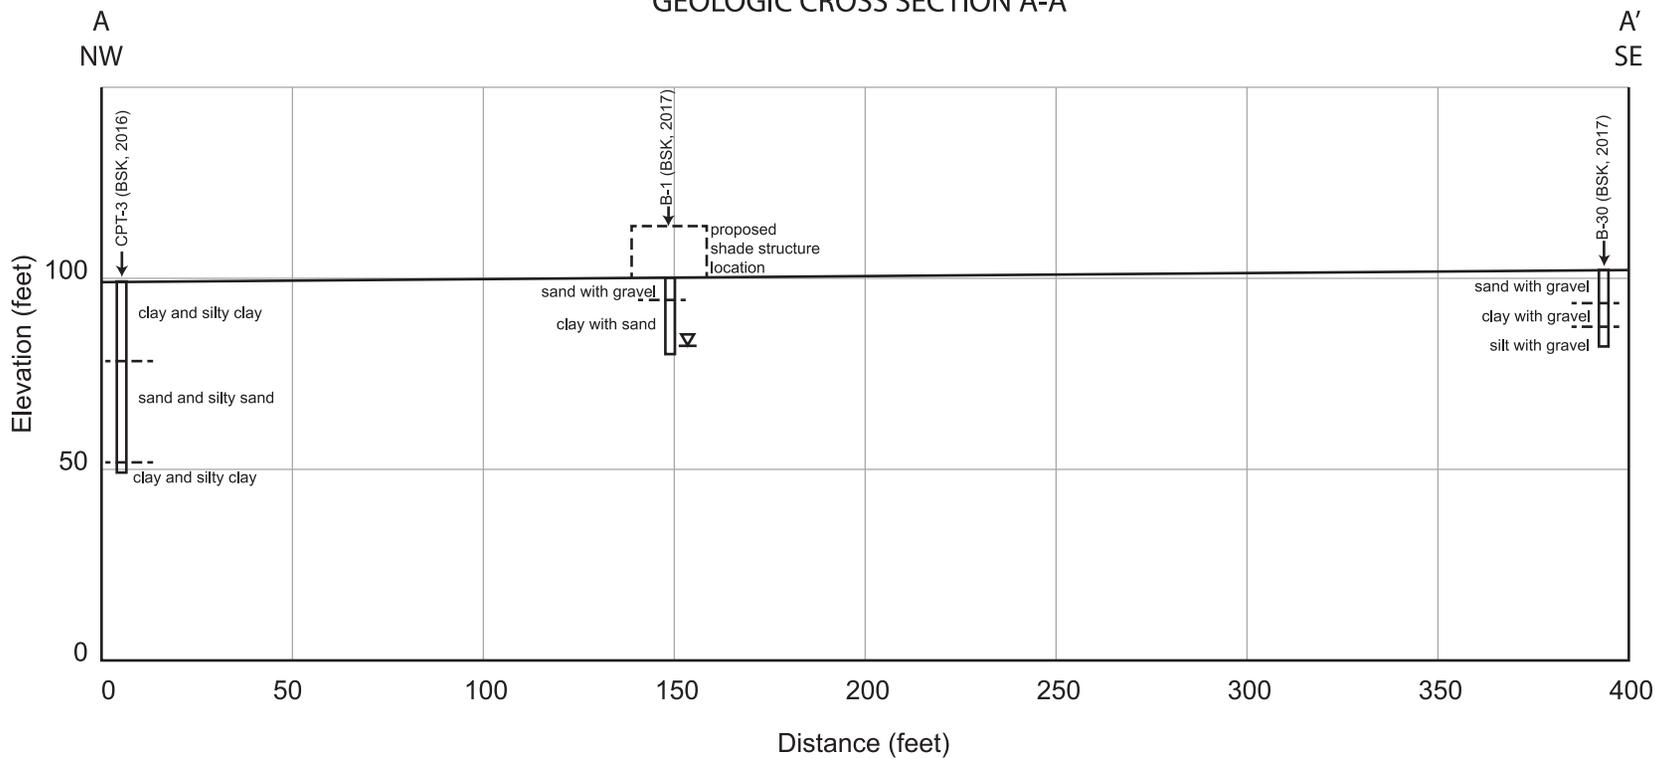


Note: Locations are approximate

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.

LEGEND	
	Soil boring location
	Unit contact
	Groundwater level

	PROJECT NO. G17-178-11L	GEOLOGIC CROSS SECTION Geologic/Seismic Hazards Assessment	Figure D-5
	Drawn: 10/24/2017		
	DRAWN BY: MBC	Vinci Park Elementary School 1311 Vinci Park Way San Jose, California	
	CHECKED BY: BS		
FILE NAME: Figure D-3 Site Map			

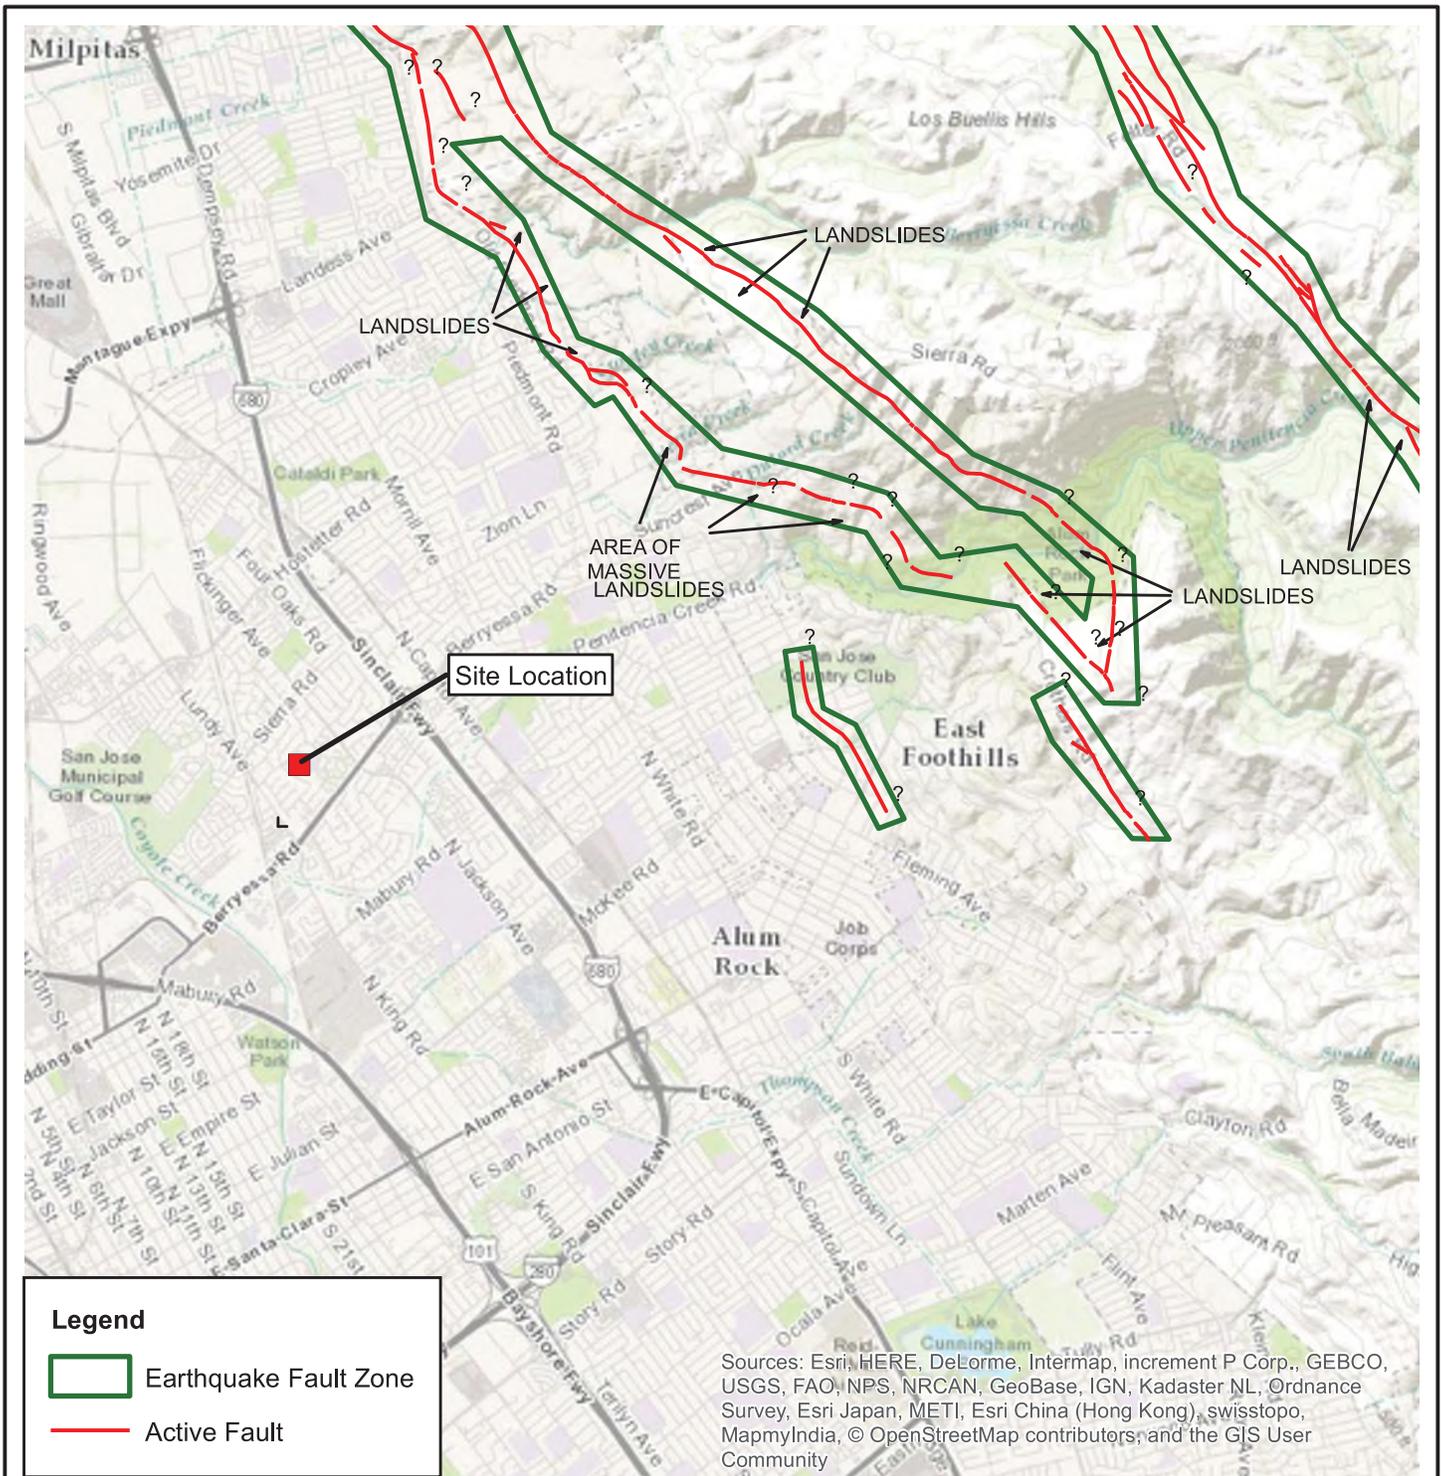

Legend

Earthquake Fault Zone

Active Fault


Sources: Esri, HERE, DeLorme, Intermap, increment P Corp., GEBCO, USGS, FAO, NPS, NRCAN, GeoBase, IGN, Kadaster NL, Ordnance Survey, Esri Japan, METI, Esri China (Hong Kong), swisstopo, MapmyIndia, © OpenStreetMap contributors, and the GIS User Community

Reference: Special Studies Zones, Calaveras Reservoir, CGS
<http://maps.conservation.ca.gov/cgs/informationwarehouse/index.html?map=regulatorymaps>

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.



	PROJECT NO. G17-178-11L	ALQUIST-PRIOLO EARTHQUAKE FAULT ZONE Geologic/Seismic Hazards Assessment	Figure D-6
	Drawn: 10/23/2017		
	DRAWN BY: MBC	Vinci Park Elementary School 1311 Vinci Park Way San Jose, California	
	CHECKED BY: BS		
FILE NAME: Figure D-6 AP_Fault_map			

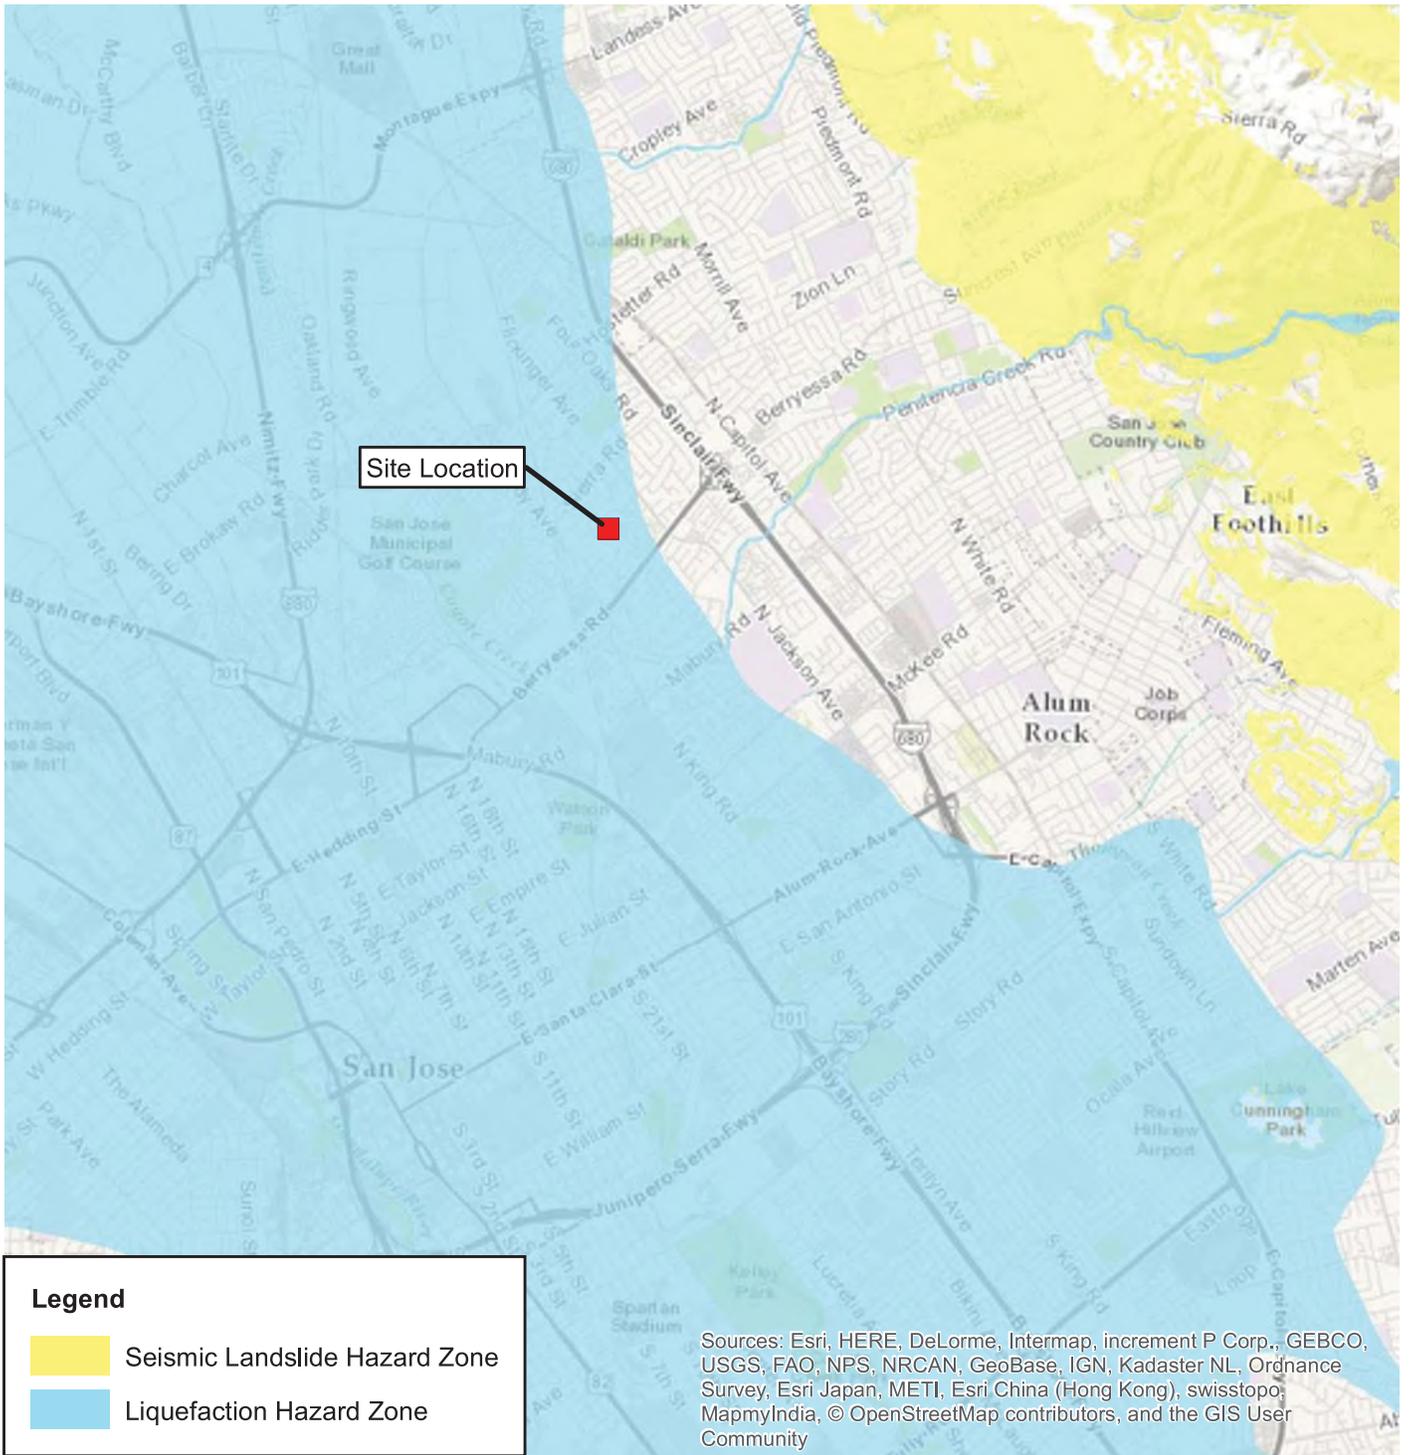

Legend

- Seismic Landslide Hazard Zone
- Liquefaction Hazard Zone

Sources: Esri, HERE, DeLorme, Intermap, increment P Corp., GEBCO, USGS, FAO, NPS, NRCAN, GeoBase, IGN, Kadaster NL, Ordnance Survey, Esri Japan, METI, Esri China (Hong Kong), swisstopo, MapmyIndia, © OpenStreetMap contributors, and the GIS User Community

Reference: Special Studies Zones, Calaveras Reservoir, CGS
<http://maps.conservation.ca.gov/cgs/informationwarehouse/index.html?map=regulatorymaps>

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.




PROJECT NO. G17-178-11L
Drawn: 10/23/2017
DRAWN BY: MBC
CHECKED BY: BS
FILE NAME: Figure D-7
Seismic Haz Zones

STATE OF CALIFORNIA SEISMIC HAZARD ZONES
Geologic/Seismic Hazards Assessment

Vinci Park Elementary School
 1311 Vinci Park Way
 San Jose, California

Figure
D-7

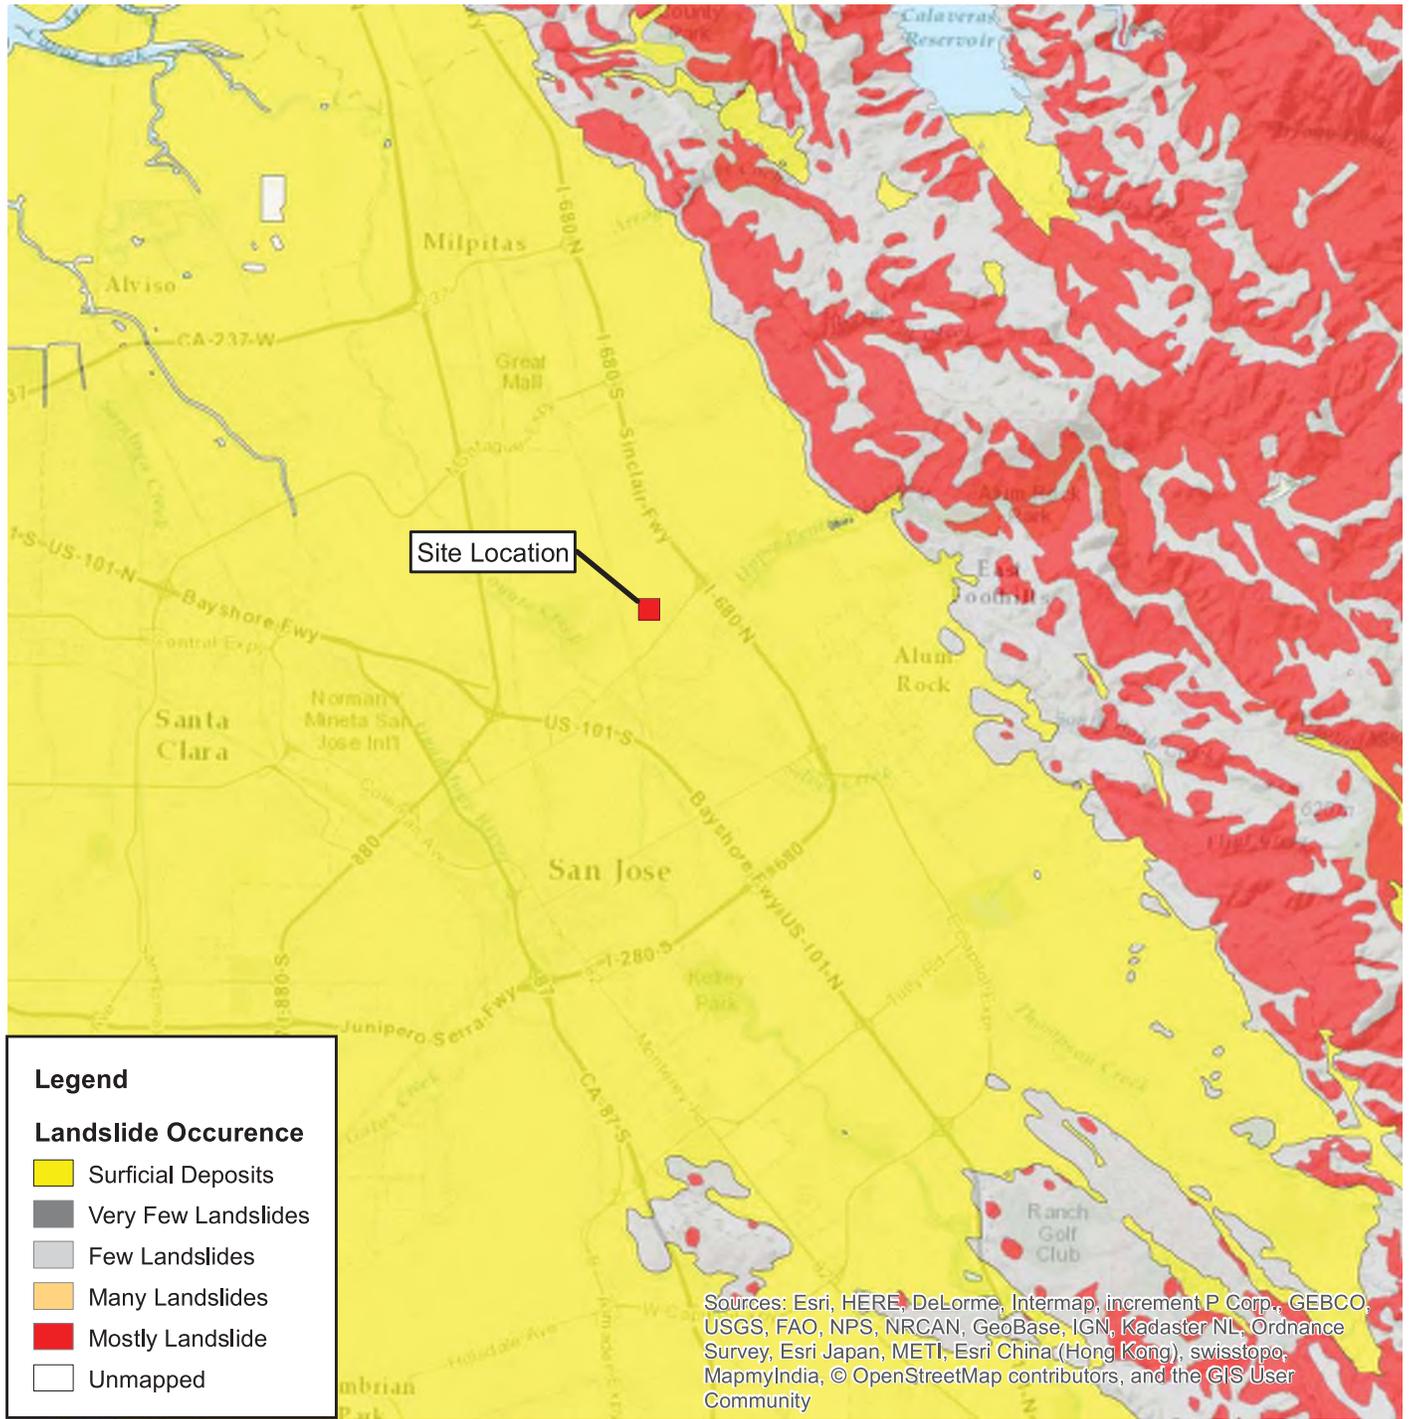

Legend


Landslide Occurrence

- Surficial Deposits
- Very Few Landslides
- Few Landslides
- Many Landslides
- Mostly Landslide
- Unmapped


Sources: Esri, HERE, DeLorme, Intermap, increment P Corp., GEBCO, USGS, FAO, NPS, NRCAN, GeoBase, IGN, Kadaster NL, Ordnance Survey, Esri Japan, METI, Esri China (Hong Kong), swisstopo, MapmyIndia, © OpenStreetMap contributors, and the GIS User Community

Reference: Adapted from USGS Open-File Report 97-745C, By: C.M. Wentworth et al, 1998

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.

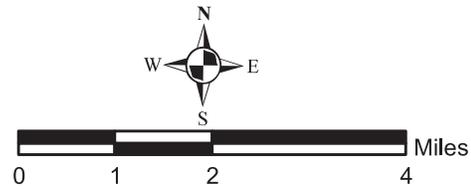

	PROJECT NO. G17-178-11L	LANDSLIDE HAZARD MAP Geologic/Seismic Hazards Assessment	Figure D-8
	Drawn: 10/23/2017		
	DRAWN BY: MBC	Vinci Park Elementary School 1311 Vinci Park Way San Jose, California	
	CHECKED BY: BS		
FILE NAME: Figure D-8 landslides			

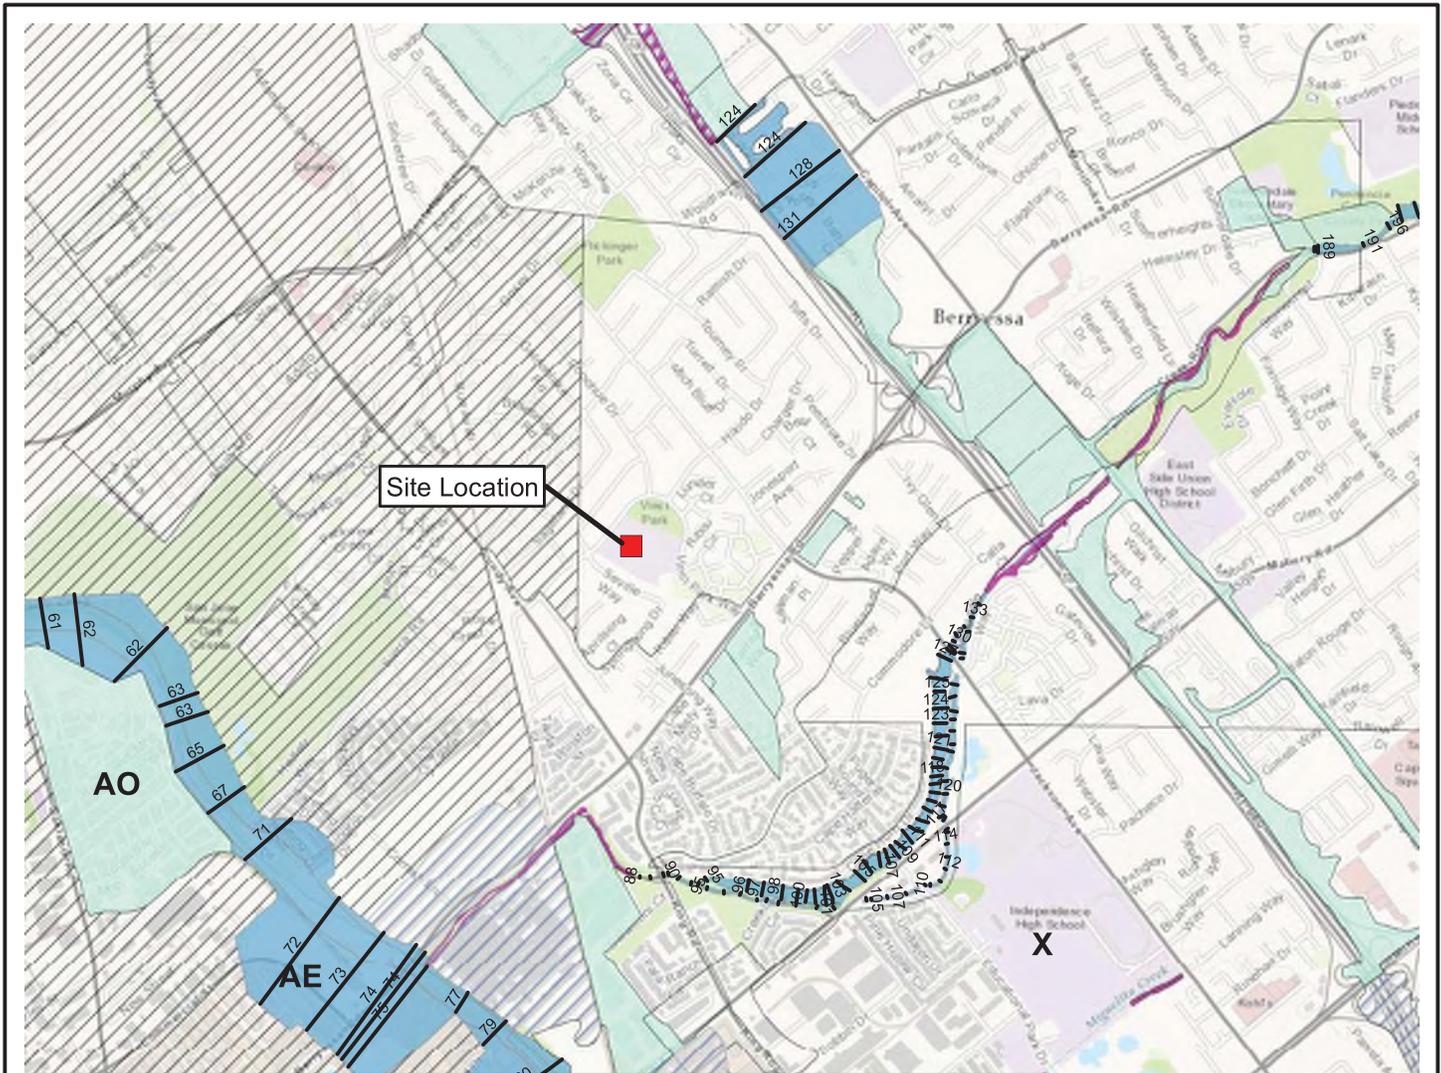

LEGEND

FEMA Flood Hazard Zones

- A - Areas with a 1% annual chance of flooding
- AH - Areas with a 1% annual chance of shallow flooding, usually in the form of a pond
- 0.2 PCT Annual Chance Flood Hazard
- AO - Areas subject to inundation by 1-percent-annual-chance shallow flooding
- AE - The base floodplain where base flood elevations are provided
- D - Possible but undetermined flood hazards, as no analysis of flood hazards has been conducted
- X - Area of minimal flood hazard
- Base Flood Elevation


Permap, increment P Corp., GEBCO, base, IGN, Kadaster NL, Ordnance na (Hong Kong), swisstopo, contributors, and the GIS User

Reference: FEMA Flood Hazard Layer, 06085C-NFHL, 2/19/2014

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.



	PROJECT NO. G17-178-11L	FEMA FLOOD ZONES Geologic/Seismic Hazards Assessment	Figure D-9
	Drawn: 10/23/2017		
	DRAWN BY: MBC	Vinci Park Elementary School 1311 Vinci Park Way San Jose, California	
	CHECKED BY: BS		
FILE NAME: Figure D-9 FEMA Map			

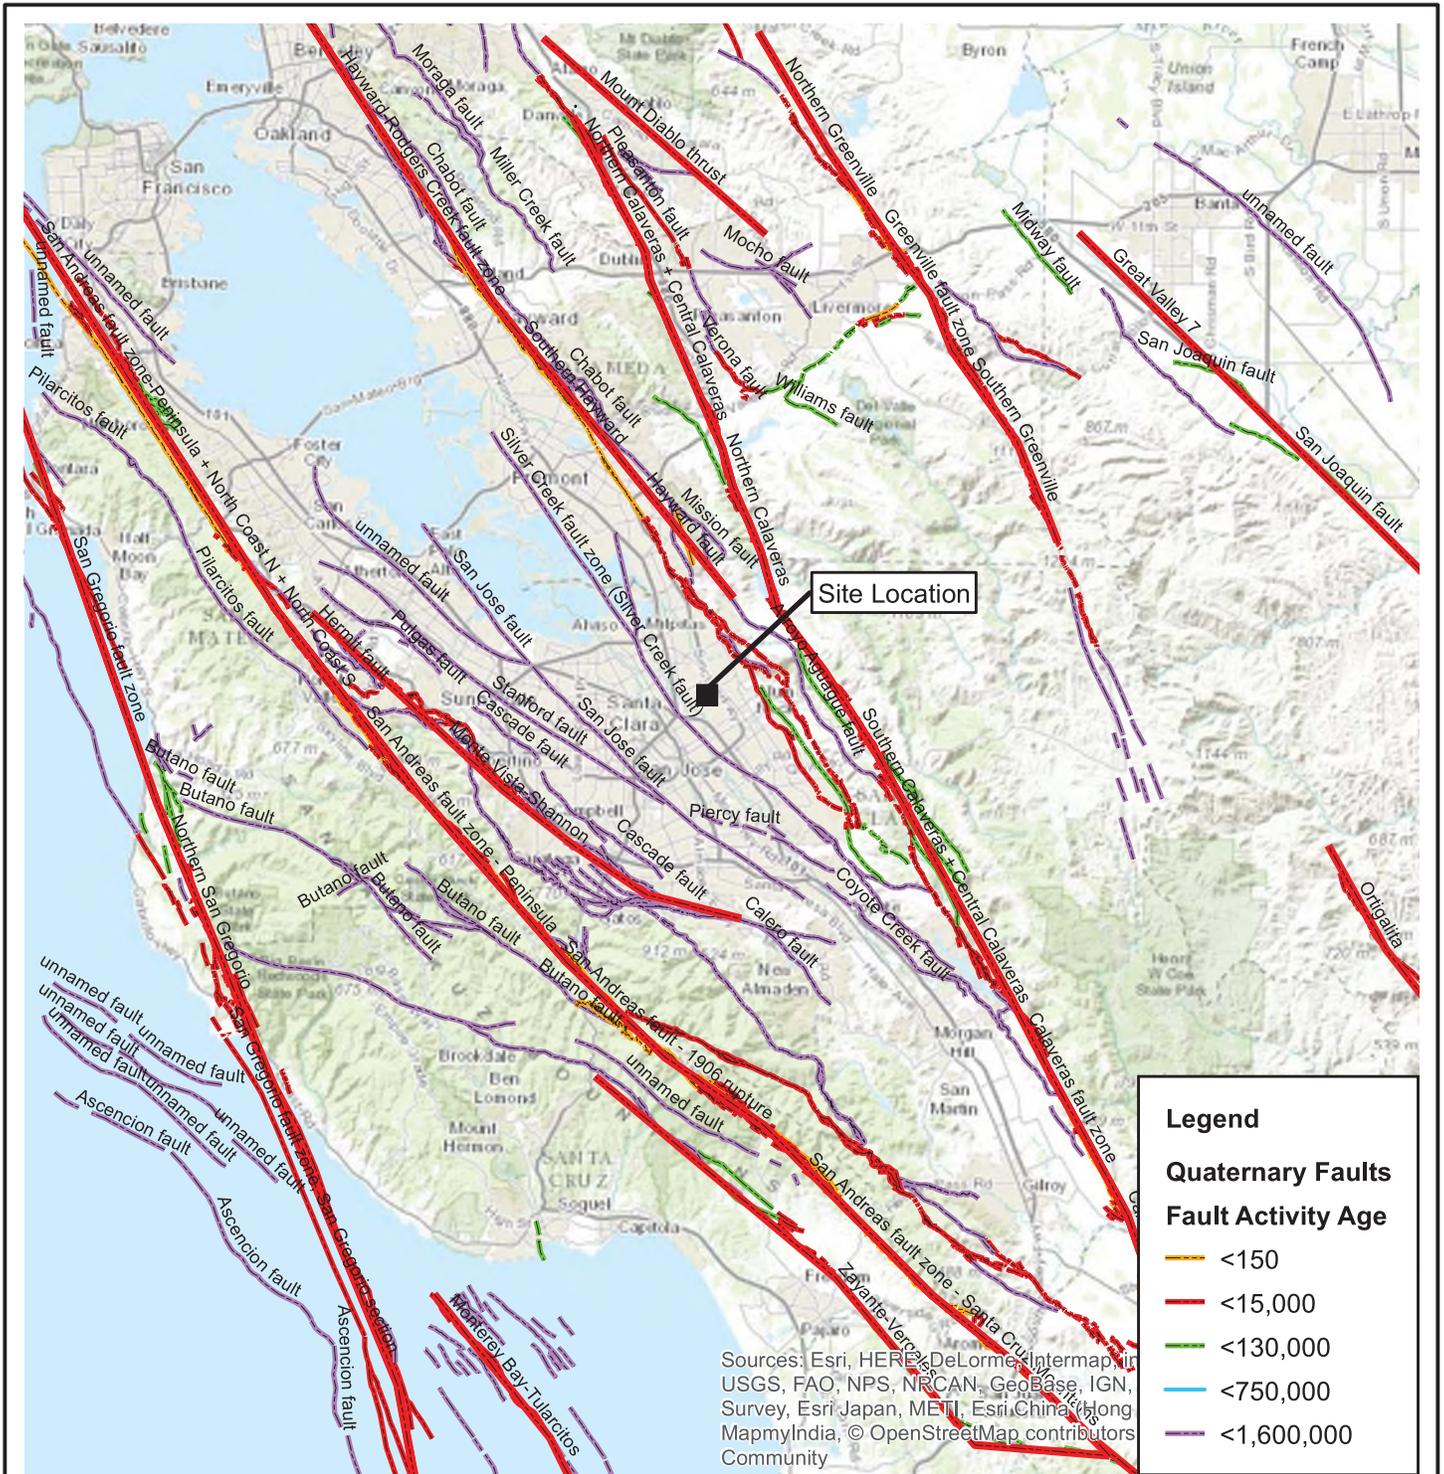

Legend

Quaternary Faults

Fault Activity Age

- <150
- <15,000
- <130,000
- <750,000
- <1,600,000


Sources: Esri, HERE, DeLorme, Intermap, Inc, USGS, FAO, NPS, NRCAN, GeBCo, IGN, Survey, Esri Japan, METI, Esri China (Hong Kong), MapmyIndia, © OpenStreetMap contributors, Community

Reference: USGS Quaternary Fault Database <ftp://hazards.cr.usgs.gov/maps/qfault/> November 3rd, 2010

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.



	PROJECT NO. G17-178-11L	REGIONAL FAULT MAP Geologic/Seismic Hazards Assessment	Figure
	Drawn: 10/23/2017		
	DRAWN BY: MBC	Vinci Park Elementary School 1311 Vinci Park Way San Jose, California	D-10
	CHECKED BY: BS		
FILE NAME: Figure D-10 Regional Fault map			

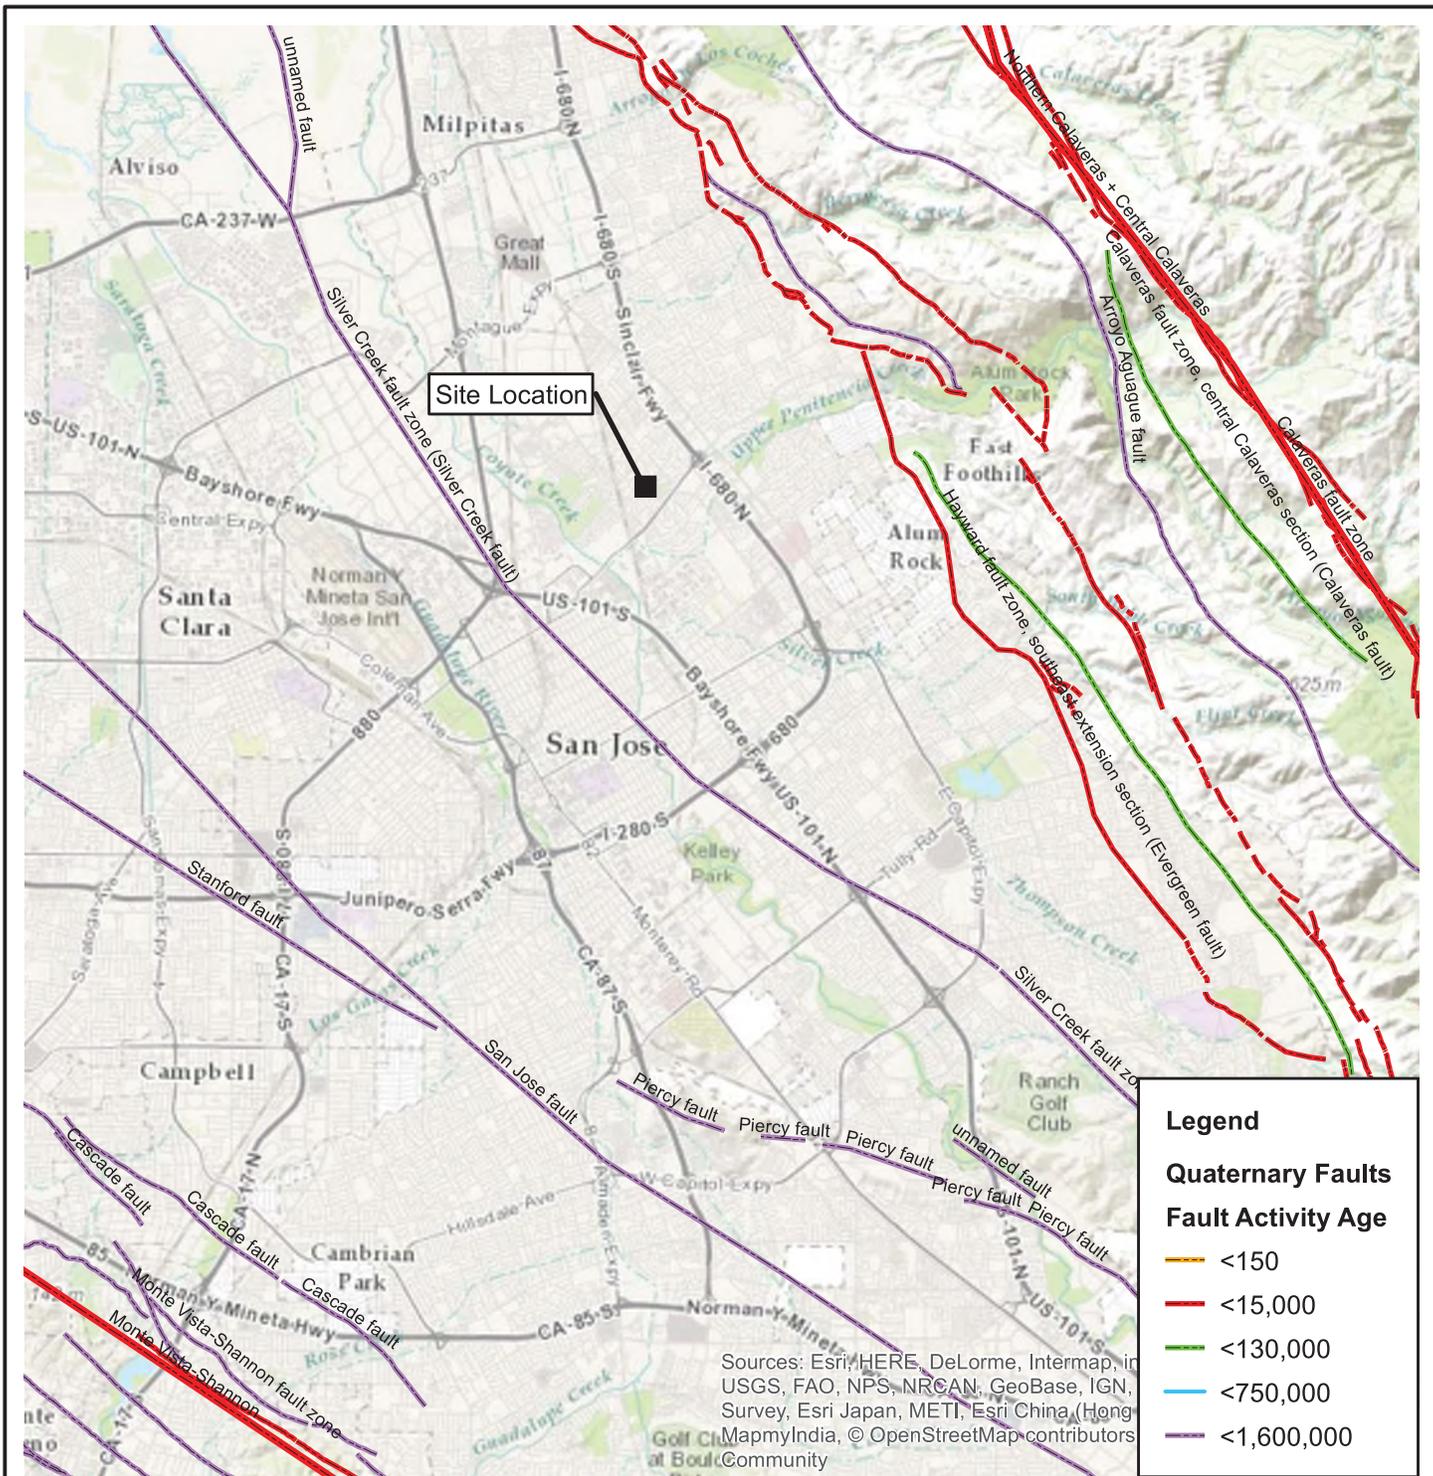


Reference: USGS Quaternary Fault Database <ftp://hazards.cr.usgs.gov/maps/qfault/>
November 3rd, 2010

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.



	PROJECT NO. G17-178-11L	LOCAL FAULT MAP Geologic/Seismic Hazards Assessment	Figure
	Drawn: 10/23/2017		
	DRAWN BY: MBC	Vinci Park Elementary School 1311 Vinci Park Way San Jose, California	D-11
	CHECKED BY: BS		
FILE NAME: Figure D-11 Local Fault map			

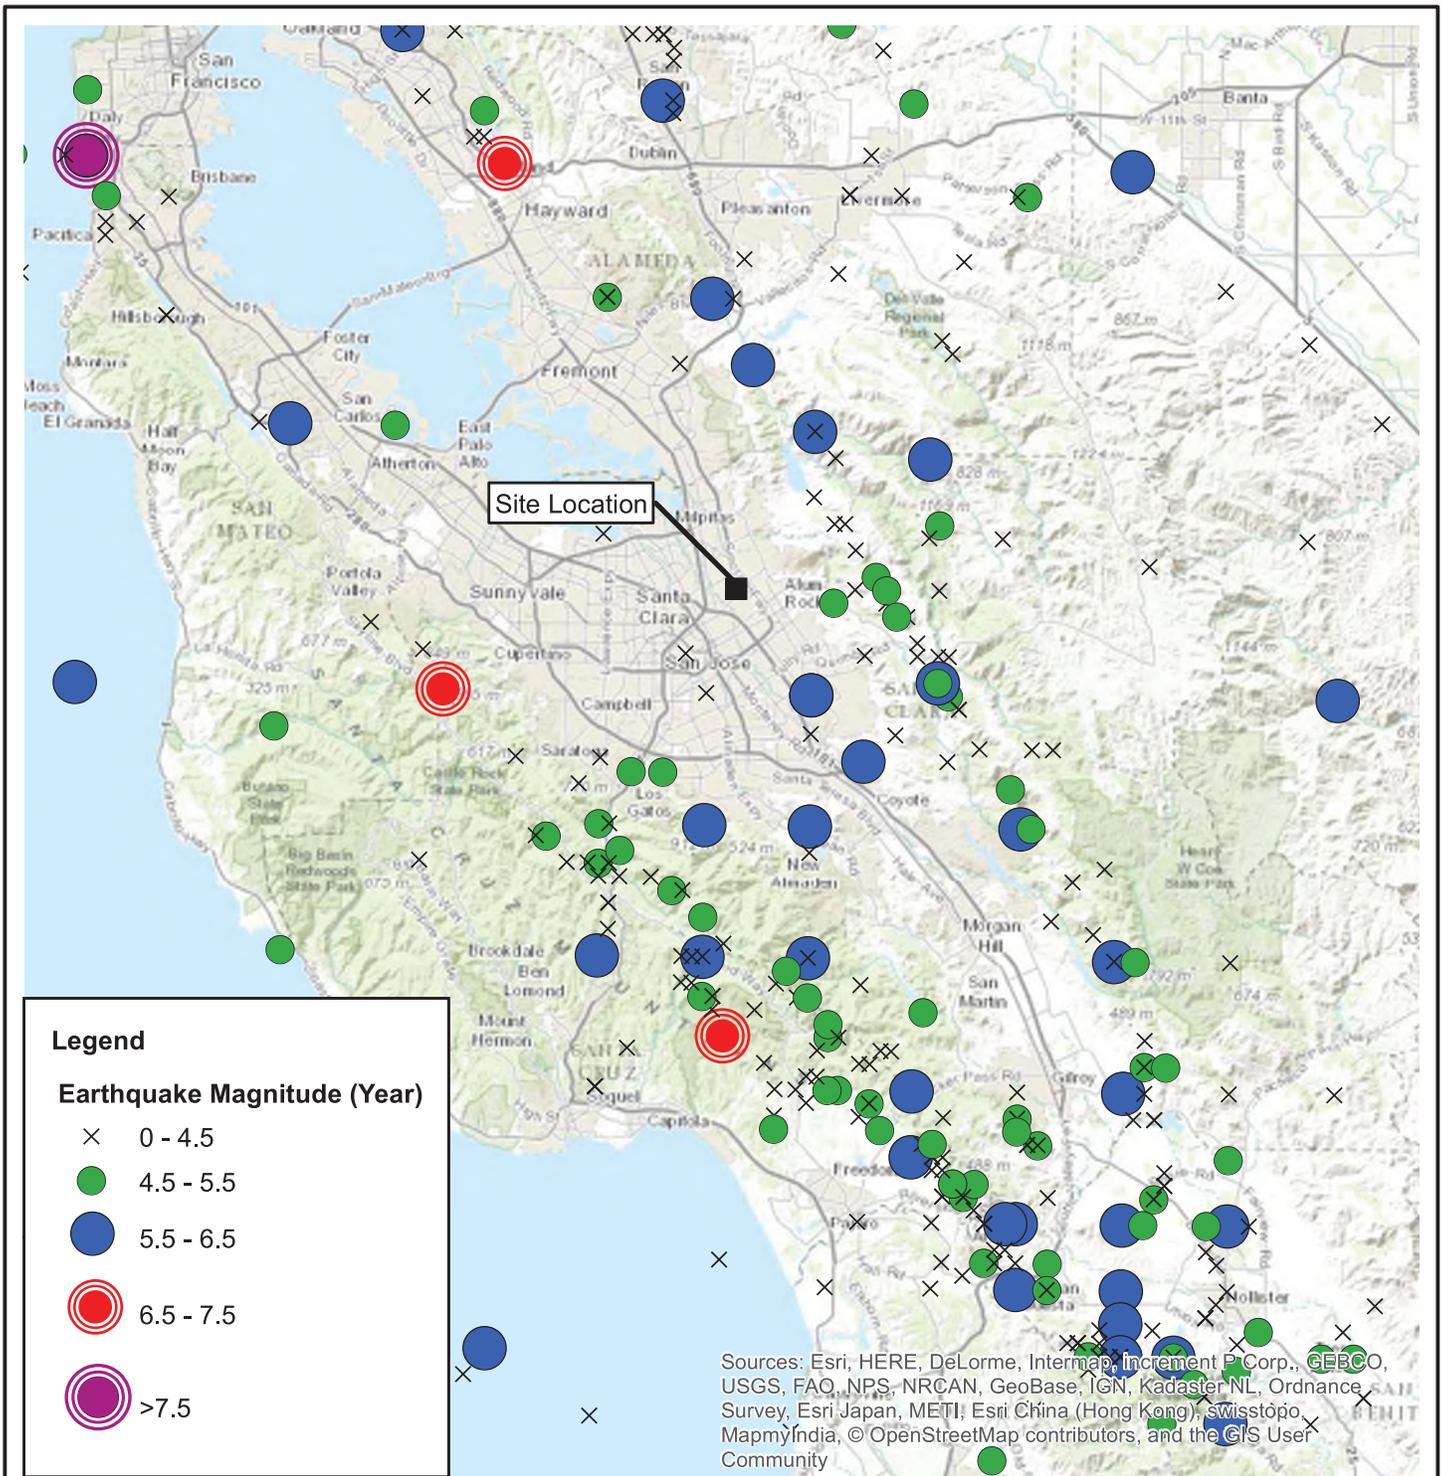

Sources: Esri, HERE, DeLorme, Intermap, Increment P Corp., GEBCO, USGS, FAO, NPS, NRCAN, GeoBase, IGN, Kadaster NL, Ordnance Survey, Esri Japan, METI, Esri China (Hong Kong), swisstopo, MapmyIndia, © OpenStreetMap contributors, and the GIS User Community

Reference: USGS Open File Report 2007-1437H, USGS WGCEP Historical California Earthquake Catalog, 2008

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.



	PROJECT NO. G17-178-11L	HISTORICAL EARTHQUAKES MAP Geologic/Seismic Hazards Assessment	Figure D-12
	Drawn: 10/23/2017		
	DRAWN BY: MBC	Vinci Park Elementary School 1311 Vinci Park Way San Jose, California	
	CHECKED BY: BS		
FILE NAME: Figure D-12 Historic Earthquakes map			



399 Lindbergh Avenue
Livermore CA 94551
P 925.315.3151
F 925.315.3152
www.bskassociates.com

Sent via email: tkanastab@busd.net

August 3, 2020

BSK Project No.: G20-163-10L

Mr. Tony Kanastab
Director of Bond Facilities and Modernization
Berryessa Union School District
1376 Piedmont Road
San Jose, California 95132

**SUBJECT: Supplemental Geotechnical Services
Vinci Park Elementary School Shade Structure
1311 Vinci Park Way
San Jose, California**

Dear Mr. Kanastab:

The purpose of this letter is to provide a discussion regarding the applicability of our existing geotechnical investigation and geologic hazards assessment report¹ for a shade structure at Vinci Park Elementary School located at 1311 Vinci Park Way, San Jose, California to the new location of the planned shade structure. It is our understanding that, subsequent to the submission of our report, the shade structure layout was changed. The new proposed shade structure location is about 100 feet (maximum) west of the original location, as shown on the attached Site Plan, Figure 1. In addition to the layout and location of the shade structure changing, it is our understanding that a different pre-check (PC) plan is being used than the PC design we referenced in our 2017 report. The new PC is entitled "MBCARC Versa-Canopy" by 4StelEngineering, dated 11/28/2018. The new PC is still based on the 2016 CBC and ASCE 7-10. We have provided a discussion of the general conformance of the new PC to our geotechnical report as well.

DISCUSSIONS AND CONCLUSIONS

[New Shade Structure Location](#)

As shown on Figure 1, the proposed shade structure location has shifted approximately 100 feet to the west from the original location at the time of our geotechnical investigation in 2017. In 2017, we advanced a 20 foot boring near the previous proposed location of the shade structure, which is about 70 feet southeast of the southeast edge of the new shade structure location. In addition, we advanced a 50 foot

¹ Geotechnical Investigation Report, Vinci Park Elementary School Shade Structure, Berryessa Union School District, San Jose, California, dated October 26, 2017, BSK Project No. G17-178-11L

deep cone penetration test during our 2016 investigation for the existing solar canopies west of the proposed shade structure. This CPT is about 40 feet west of the new shade structure location. It is our opinion that the existing boring and CPT adequately characterize the subsurface conditions for the new location of the shade structure.

New DSA Pre-Check (PC) Plans

We have reviewed the geotechnical aspects of the MBARC Versa-Canopy PC plans and conclude that they are in general conformance with our 2017 geotechnical report. Because the plans are based on the 2016 CBC and ASCE 7-10, the seismic design parameters provided in our 2017 report are applicable. We take no exception to the seismic parameters used in the PC plans because they are greater than those provided in our report. Our 2017 report concluded that, based on the site specific soil properties, a Soil Class Y as presented in the older PC was appropriate for design. It is our understanding that a Soil Class W, as presented on Sheet S-3 in the new 2018 PC, is proposed for design of the shade structure. It is our opinion that the soil parameters associated with Soil Class W in the new PC are appropriate for design of the proposed shade structure.

Spread Footing Option

We have reviewed the spread footing schedule presented on Sheet S-10 of the new 2018 PC. It is our understanding that the design of the spread footing option is based on a Soil Class V. It is our opinion that the soil parameters for a Soil Class V and the proposed depth of the footing are conservative for this site, and we therefore would take no exception to the use of the spread footing option.

CLOSURE

We appreciate the opportunity of providing our services to the District on this project and trust this meets your needs currently. Please, contact us at (925) 315-3151 if you have any questions or require additional information.

Respectfully submitted,
BSK Associates




Carrie L. Foulk, PE, GE 3016
Senior Geotechnical Engineer




Brad Steen, PE, GE
Principal Geotechnical Engineer

Enclosures: Figure 1 – Site Plan



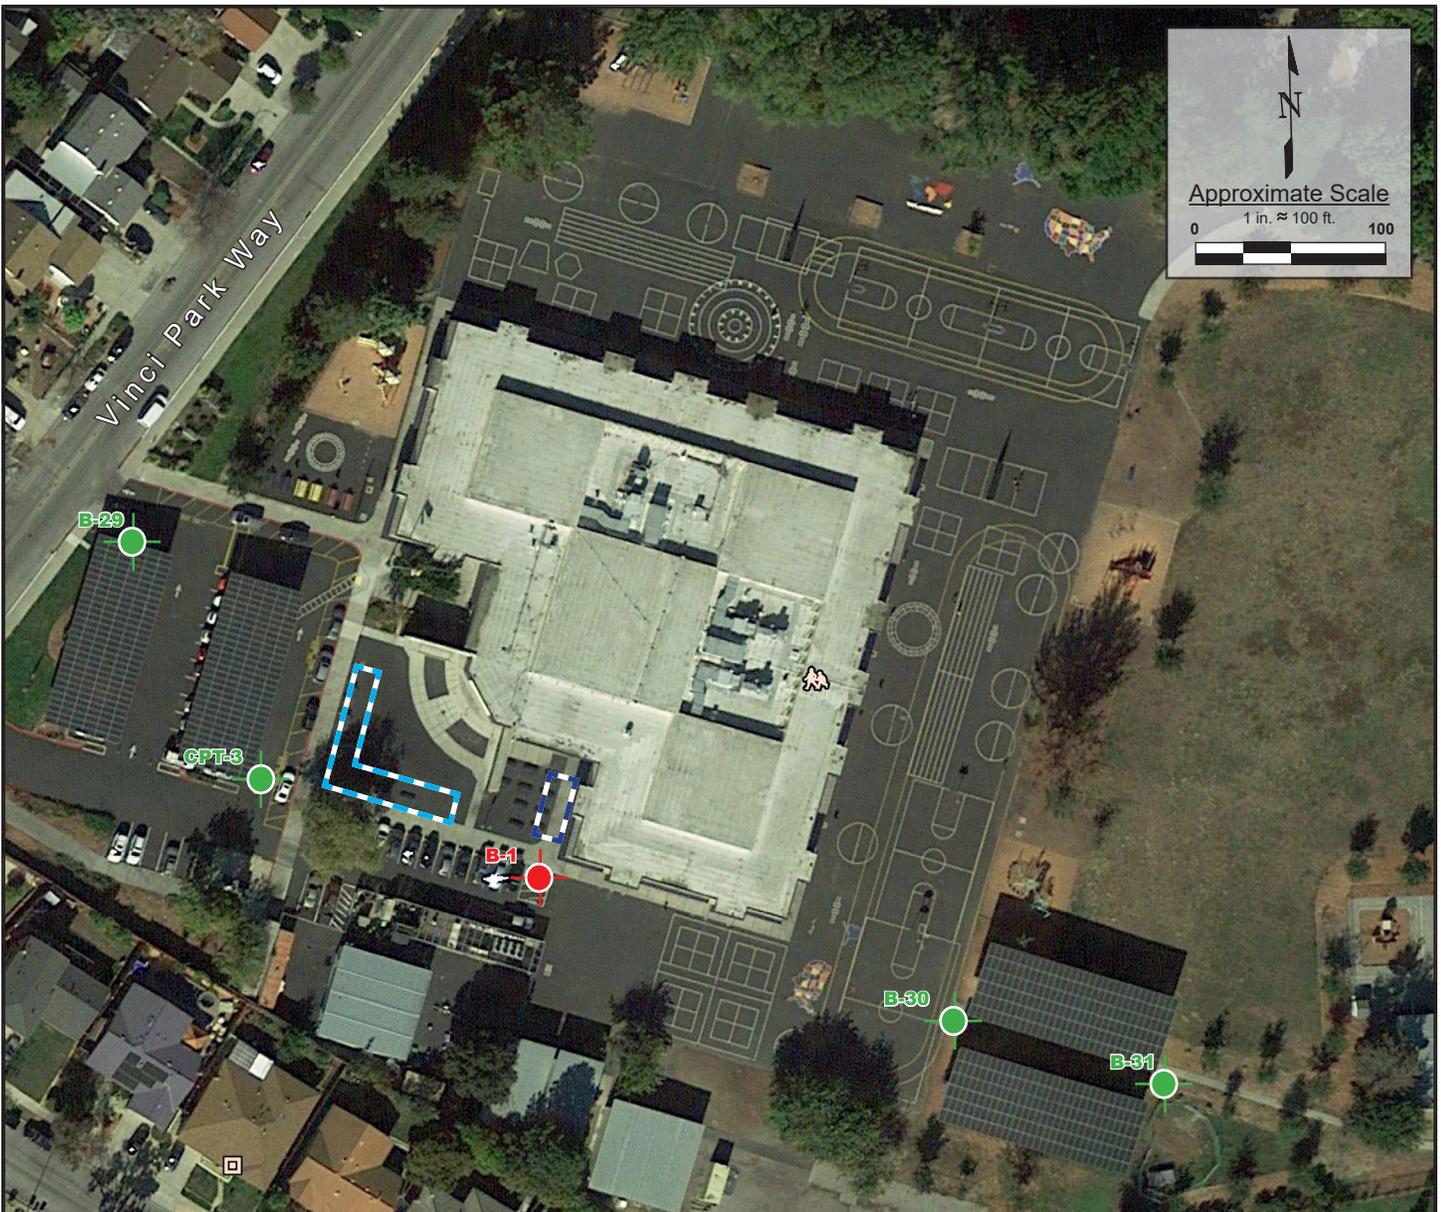

References: 1. <http://earth.google.com>, 2017
 2. New shade structure location based on Sheet T2, Site Plan, Fire Life Safety & Access Compliance by SFA, dated 09/03/2019

Legend

- B-29 | Approximate Boring and CPT Locations (BSK, 2016)
- B-1 | Approximate Location of Current Boring (BSK, 2017)
- Old Location of Shade Structure
- New Location of Shade Structure

The information included on this graphic representation has been compiled from a variety of sources and is subject to change without notice. BSK makes no representations or warranties, express or implied, as to accuracy, completeness, timeliness, or rights to the use of such information. This document is not intended for use as a land survey product nor is it designed or intended as a construction design document. The use or misuse of the information contained on this graphic representation is at the sole risk of the party using or misusing the information.



PROJECT NO. G20-163-10L

DRAWN: 08/03/20

DRAWN BY: D. Tower

CHECKED BY: C. Foulk

FILE NAME:
SitePlan.indd

SITE PLAN

Shade Structure
 Vinci Park Elementary School
 1311 Vinci Park Way
 San Jose, California

FIGURE

1